


JOSEPH H. DIXON, JR.
LICENSE
No. 7768
STATE OF FLORIDA
PROFESSIONAL ENGINEER
2/16/12

REVISIONS			
REV.	DESCRIPTION	DATE	APPROVAL
1	DRAWING RELEASE	5-30-07	DM
2	NOTE REVISIONS	6-17-09	CS

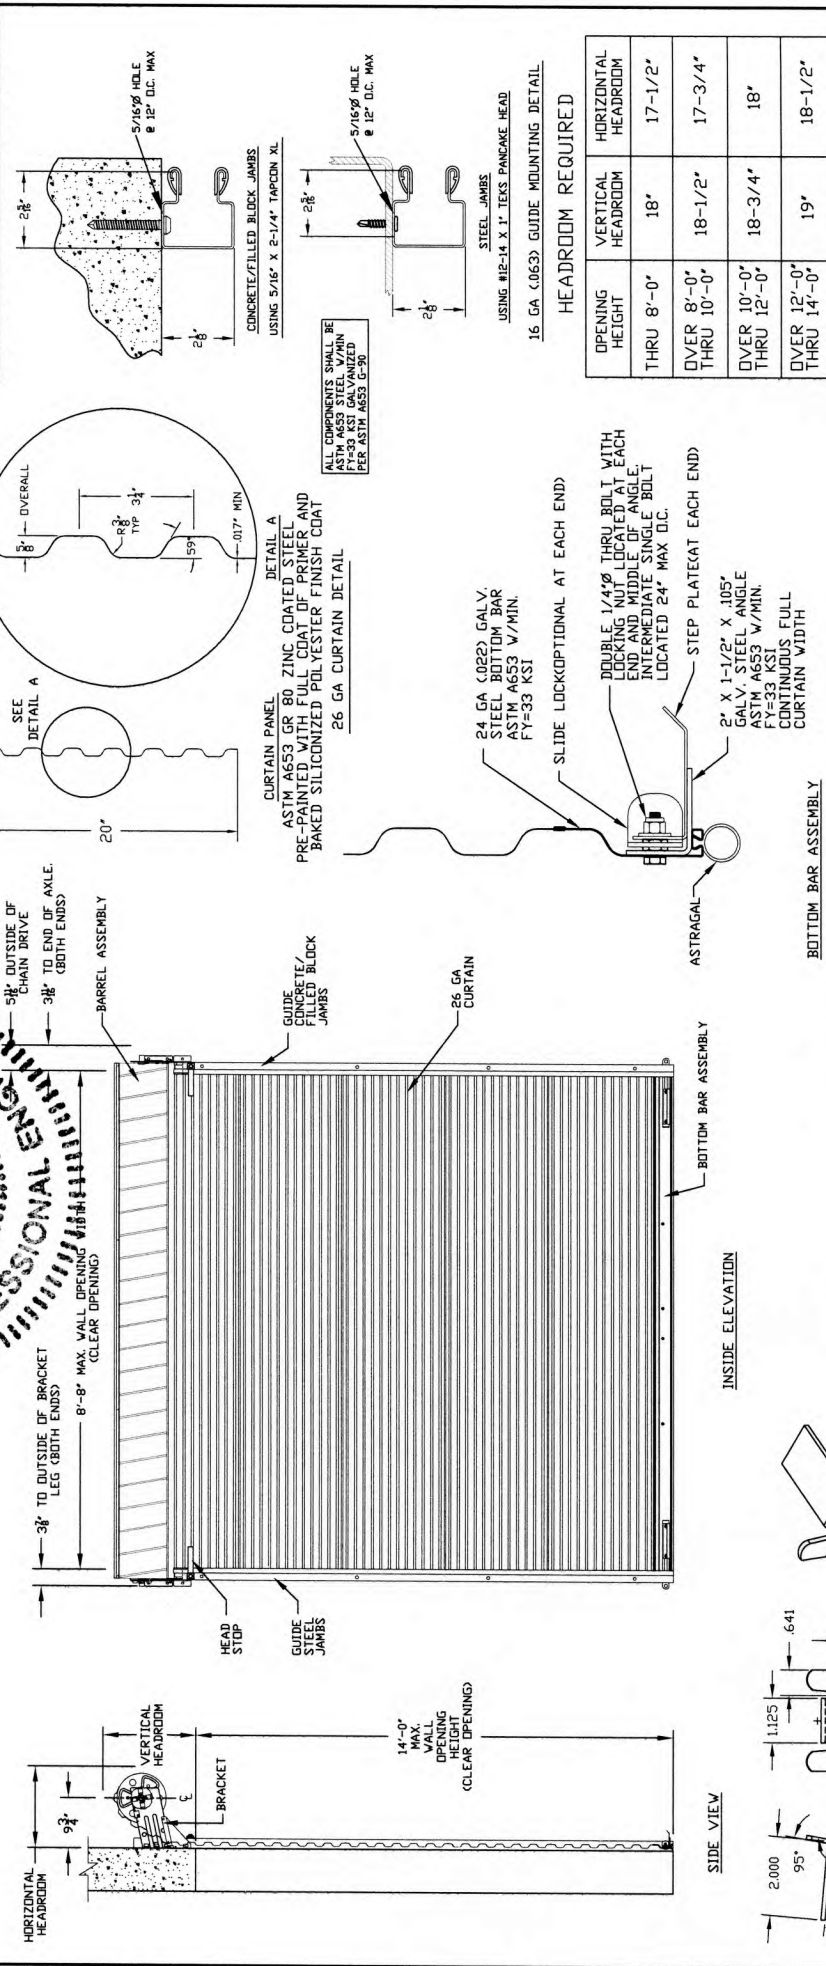

REVISIONS			
REV.	DESCRIPTION	DATE	APPROVAL
1	DRAWING RELEASE	5-30-07	DM
2	NOTE REVISIONS	6-17-09	CS


PART NUMBER		DATE	
MATERIAL		APPROVALS	
APPLIED FINISH		DRAWN	
UNIT OF MEASURE		CHECKED	
		APPROVED	
		DON MILLS	
		DON MILLS	

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES AND TOLERANCES ARE:		HOLE DIAMETERS	
DECIMAL		FRACTIONS	
.XX ±.03		± 1/16	
.XXX ±.005		± 0° 30'	
		UNDER .251	
		.251 to .500	
		OVER .500	

WINDLOCK		HOLE DIAMETERS	
GALV. STEEL,		UNDER .251	
ASTM A653		.251 to .500	
WITH MIN.		OVER .500	
FY=33KSI			


JANUS INTERNATIONAL CORPORATION		T1012	
134 JANUS INTERNATIONAL BLVD TEMPE, AZ 85283		SCALE: NONE	
770-562-2850/Fax 770-562-2264		SHEET: 1	
© 2012 Janus International Corporation All Rights Reserved		OF: 2	

CERTIFIED WIND LOAD RATED		REV: A	
26 GA SERIES 1100 DOOR ASSEMBLY		DRAWING NUMBER	
MAX. SIZE 8'-8" X 14'-0"		SIZE	

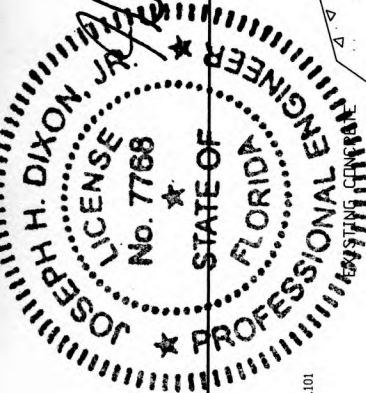

2/16/12

REVISIONS			
REV	DESCRIPTION	DATE	APPROVAL
A	DRAWING RELEASE	5-30-07	JM
A	NOTE REVISIONS	6-17-09	CS

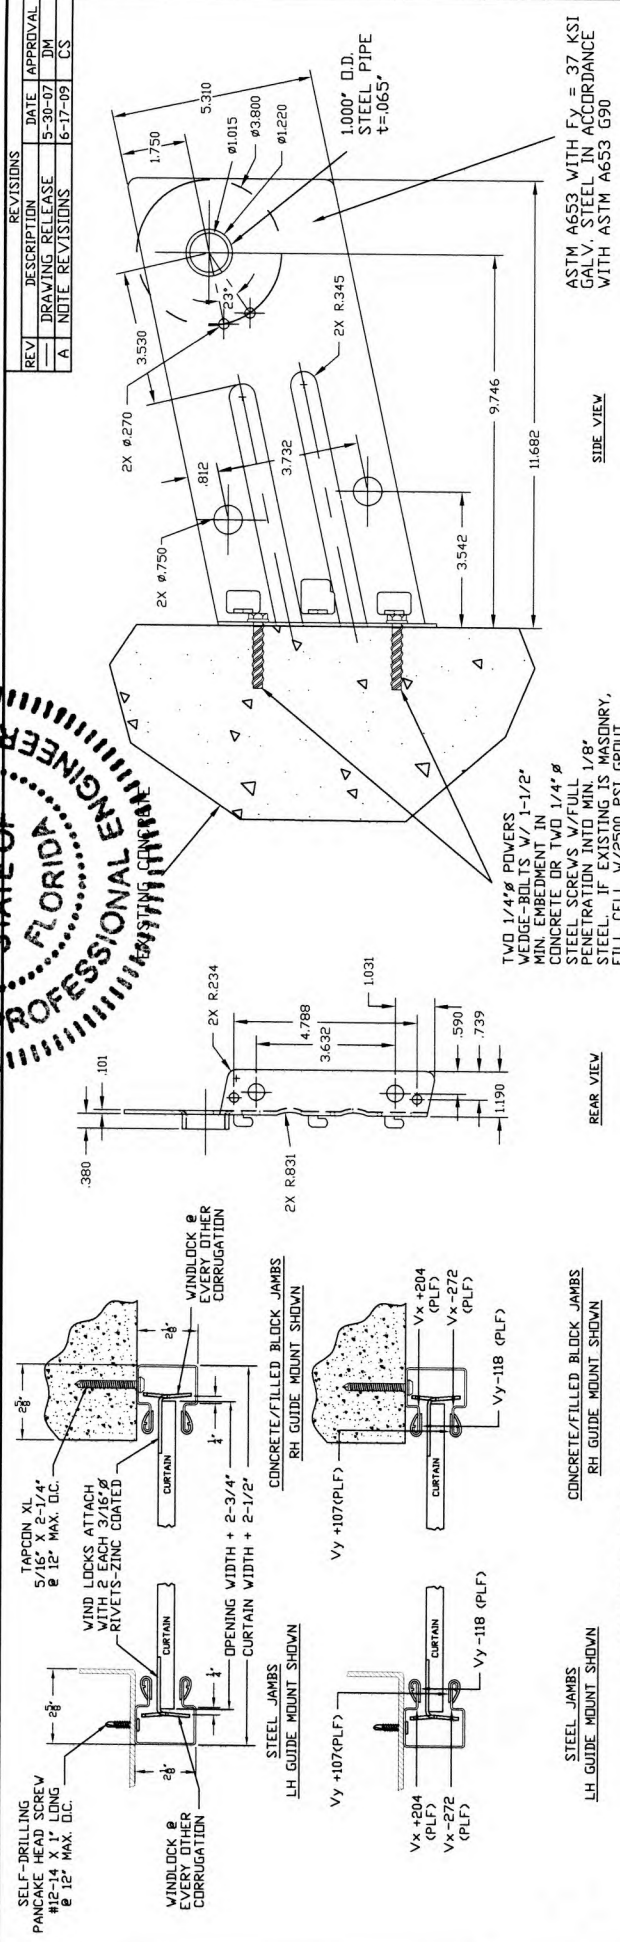

- GENERAL NOTES
- THIS ROLL-UP DOOR SYSTEM IS DESIGNED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE.
 - THIS ROLL-UP DOOR HAS BEEN TESTED IN ACCORDANCE WITH ASTM E-330 AND COMPLIES WITH ANSI/DASHA 108.
 - WIND LOADS FOR BUILDING OPENINGS SHALL BE DETERMINED BY A PROFESSIONAL ENGINEER USING APPROPRIATE WIND SPEED AND DESIGN CRITERIA. THIS DOOR SHALL BE USED WHERE THE DESIGN LOAD MEETS OR EXCEEDS THE DESIGN LOAD FOR THE BUILDING OPENING.
 - SUPERIMPOSED LOADS ON THE JAMBS FROM THIS DOOR ARE DESIGNED AS Vx AND Vy HEREIN. CONTRACTORS SHALL HAVE BUILDING ENGINEER VERIFY ADEQUACY OF BUILDING STRUCTURE TO RESIST SUPERIMPOSED LOADS Vx, Vy AND BRACKET LOADS SHOWN.
 - ALL WELDING SHALL BE PERFORMED BY QUALIFIED WELDERS IN ACCORDANCE WITH A.S.S. SPECIFICATIONS, LATEST EDITION. ALL WELDING ELECTRODES SHALL CONFORM TO A.S.S. A51 GRADE E-70.
 - DOORS SHALL BE PROVIDED WITH LOCK MECHANISMS AT THE OPTION OF THE OWNER.
 - ALL BOLTS AND WASHERS SHALL BE GALVANIZED OR STAINLESS STEEL WITH A MINIMUM TENSILE STRENGTH OF 60 KSI.
- DESIGN LOAD = +24.4 PSF
-27.0
- ANCHOR NOTES:
- EMBEDMENT LENGTH DOES NOT INCLUDE STUCCO FINISH.
 - FOR HOLLOW MASONRY, FILL ALL CELLS & ANCHOR WITH 2500 PSI GROUT.
 - ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.
- DOOR OPERATION TYPE TO BE PUSH-UP, HAND CHAIN OR ELECTRIC.
- DOOR MOUNTING BRACKET DETAIL
11. GUIDE TO JAMB ATTACHMENT FASTENERS BEGIN 4" FROM FLOOR AND END 3-1/2" BELOW TOP OF WALL OPENING.
12. TEST DOOR WALL OPENING SIZE: 8'-8" x 8'-0".

PART NUMBER		DATE	
MATERIAL		APPROVALS	
APPLIED FINISH		DRAWN	
UNIT OF MEASURE		CHECKED	
APPROVED		DATE	
DON MILLS		5-30-07	
SCALE		5-30-07	
SHEET		2 OF 2	

JANUS INTERNATIONAL CORPORATION
134 JANUS INTERNATIONAL BLVD TEMPLE, GA 30179
770-562-2850/Fax 770-562-2264
© 2012 Janus International Corporation All Rights Reserved

CERTIFIED WIND LOAD ASSEMBLY
26 GA SERIES 1100 DOOR ASSEMBLY
MAX. SIZE 8'-8" X 14'-0"

DRAWING NUMBER T1012

REV. A