

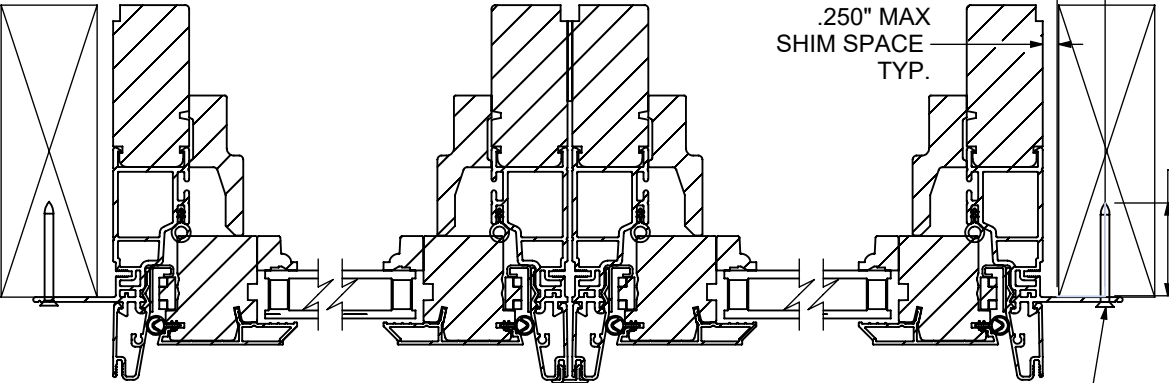


0.040"X 1-1/2" WIDE GALVANIZED STEEL
CLIPS 5" ON EITHER SIDE OF MULLION
CENTERLINE

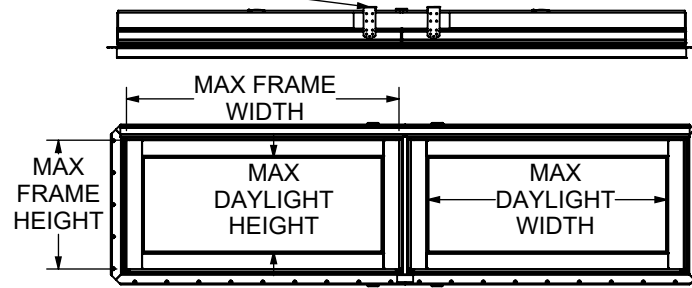

#6 X (1-5/8") NON-CORROSIVE SCREW
1-1/2" MIN PENETRATION INTO FRAMING MEMBER
8-10" ON CENTER THROUGH NAILING FIN
AROUND THE UNITS ENTIRE PERIMETER TYP.

USE SILICONE SEALANT
AROUND PERIMETER
BETWEEN NAILIED FIN &
WOOD BUCK BY OTHER TYP.

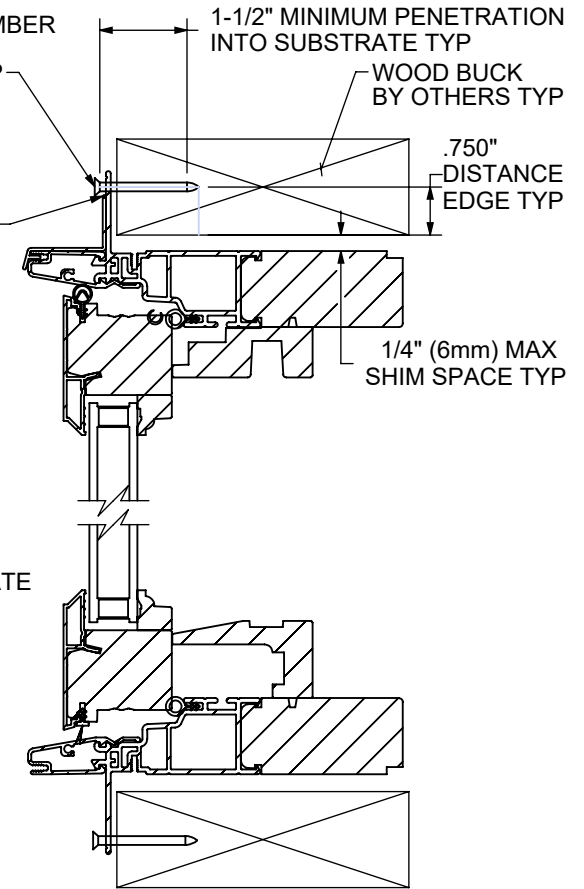

NOTE(S):

1. THESE UNITS HAVE BEEN TESTED, ANALYZED, HALLMARK CERTIFIED AND FBC APPROVED.
2. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ. THE PRODUCT HAS BEEN EVALUATED TO THE FOLLOWING.
 1. AAMA/WDMA/CSA 101/I.S.2/A440-17
 2. AAMA/WDMA/CSA 101/I.S.2/A440-22
3. THIS SCHEDULE ADDRESSES ONLY THE FASTENERS REQUIRED TO ANCHOR THE WINDOW(S) TO ACHIEVE THE RATED DESIGN PRESSURE. THOROUGHLY READ AND FOLLOW MANUFACTURERS INSTALLATION INSTRUCTIONS RECEIVED WITH UNIT. THIS GUIDE DOES NOT ADDRESS THE SEALING CONSIDERATIONS THAT MAY ARISE IN DIFFERENT WALL CONDITIONS.
4. FASTENERS, ANCHORS, AND CONNECTORS SHALL COMPLY WITH THE CORROSION RESISTANCE REQUIREMENTS OF THE 2026 FLORIDA BUILDING CODE, SECTION 1711, BASED ON EXPOSURE CONDITIONS AND PROXIMITY TO A SALTWATER SHORELINE AND NOT ALL THE ONES SHOWN HERE NECESSARILY APPLY.

**8211 Awning Twin
NAILING FIN INSTALLATION**

Description	Max Frame Size		Max Daylight Opening		Design Pressure (psf)	Frame Material	Installation Method
	Width (IN)	Height (IN)	Width (IN)	Height (IN)			
8211 AWNING TWIN	59.50	59.50	53.75	53.75	+/-50	ALUM/WOOD/VINYL	THRU NAIL FIN

MATERIAL:

DIV./ORDER #:

DATE ORDERED:

Q.C. COMPARATOR CHECK: ☐

FINISH:

CUT STOCK SIZE:

ECO OR W.S. #:

DRAWN BY:
JK/DT

DATE:
4-9-14

**Weather Shield
Windows & Doors**

PRODUCTS:
8211 AWNING TWIN

TITLE: **INSTALLATION INSTRUCTIONS**

DWG. NO.
85-7808-07

SCALE: 1:16 SHEET NAME: Sheet1

REV.
.1

REVISION	DATE	DESCRIPTION	WHITE SLIP NUMBER	ENG.	DO NOT SCALE DRAWING