

YKK AP AMERICA, Inc.

35D OUTSWING DOOR SYSTEM

(HVHZ) (NON-IMPACT)

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- FOR INSTALLATION INTO WOOD FRAMING USE *#14 FLAT HEAD WOOD SCREWS* OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
- FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE *1/4 INCH DIAMETER FLAT HEAD ITW TAPCONS* OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4 INCH MINIMUM EMBEDMENT.
- FOR INSTALLATION THROUGH STEEL STUD USE *#14 FLAT HEAD SELF-TAPPING SCREW* OR EQUIVALENT OF SUFFICIENT LENGTH TO ACHIEVE *3 THREADS* MINIMUM PENETRATION BEYOND STEEL FRAME SUBSTRATE.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
 - FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
 - CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - CONCRETE -MINIMUM COMPRESSIVE STRENGTH OF 2700 PSI.
 - MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER) WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI.
 - STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM 18 GA. WALL THICKNESS.

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - ASTM E283-19
 - ASTM E330-14
 - TAS 202-94
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- DOOR FRAME MATERIAL: ALUMINUM 6063-T5
- ALL STRUCTURAL MATERIALS & DISSIMILIAR METALS SHALL BE PROTECTED, TREATED, PAINTED, COATED, AND/OR ISOLATED AS REQUIRED IN THE APPLICABLE SECTIONS OF THE CURRENT FLORIDA BUILDING CODE AND REFERENCED DESIGN SPECIFICATIONS.
- GLASS SHALL MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 4 FOR GLAZING DETAILS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	ELEVATIONS & ANCHOR LAYOUTS
3	ELEVATIONS, ANCHOR LAYOUTS & DESIGN PRESSURE TABLE
4	VERTICAL SECTIONS & GLAZING DETAILS
5	HORIZONTAL SECTIONS
6	VERTICAL & HORIZONTAL SECTIONS
7	COMPONENTS & BILL OF MATERIALS
8	COMPONENTS

DESIGN PRESSURE TABLE				
PRODUCT CONFIGURATION	MAX. DOOR FRAME SIZE		DESIGN PRESSURE	MISSILE IMPACT RATING
	WIDTH	HEIGHT		
"XX"	96"	96"	+/-55 PSF	NOT RATED
"X"	49.75"	96"		



YKK AP AMERICA, Inc.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (478)277-1955 FAX: (678)838-6001

TITLE:
35D OUTSWING DOOR SYSTEM
(HVHZ) (NON-IMPACT)

INSTALLATION & GENERAL NOTES

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

PH: (954)399-8478

FAX: (954)744-4738


WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	SH	07.06.26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.08.06 14:11:55 -0400'

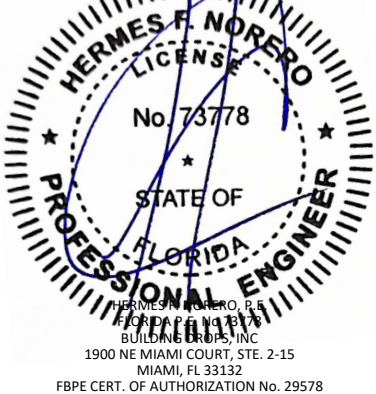


FL #:		FL12892	
DATE:		04.10.12	
DWG. BY:	GRN	CHK. BY:	HFN
SCALE:		NTS	
DWG. #:		YKK001	
SHEET:		REV. A	
1		OF 8	


c:\users\sebastianhereros\building drops, inc\building drops landing - common\projects\2026 code change projects\ykk ap america, inc\26-0247.1 - 2026 code change\dwgs\112892\ykk001.dwg 8/5/2026 8:29 PM

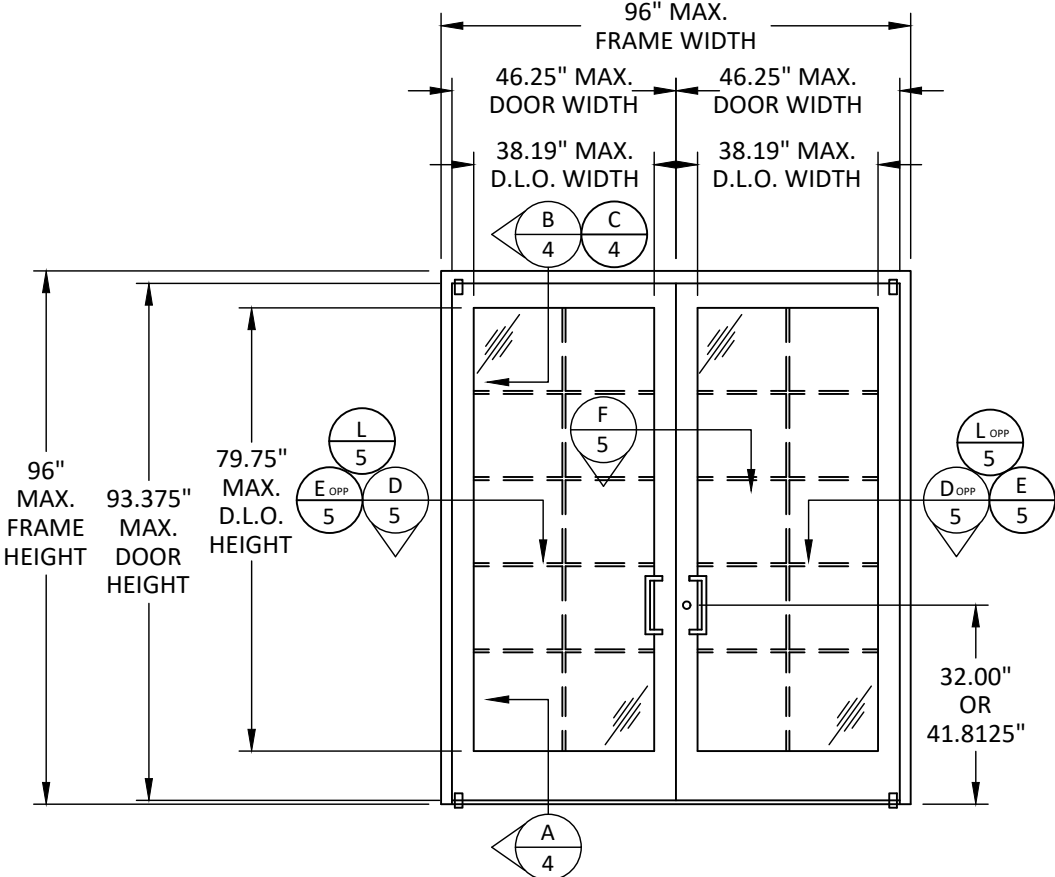


ELEVATION

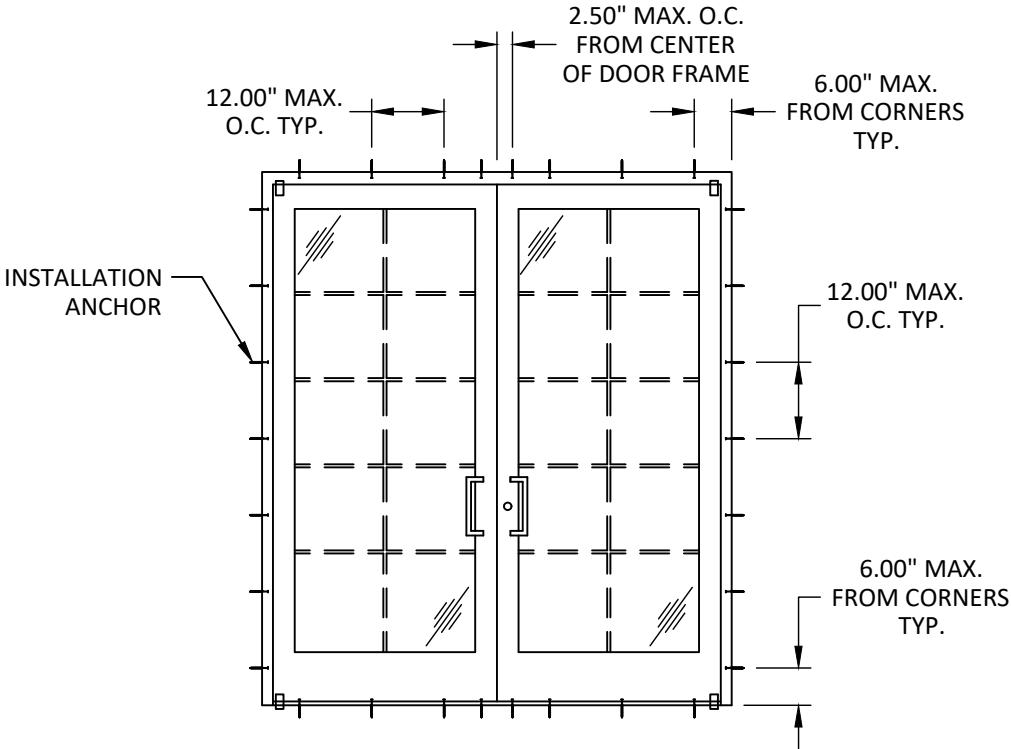

ANCHOR LAYOUT

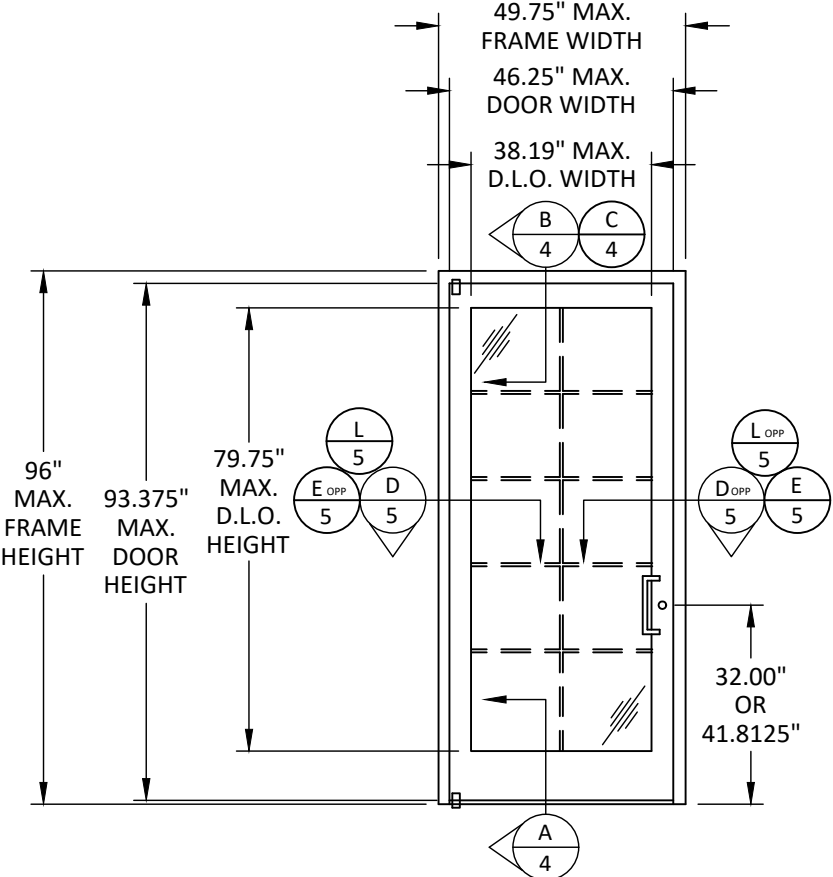

ELEVATION

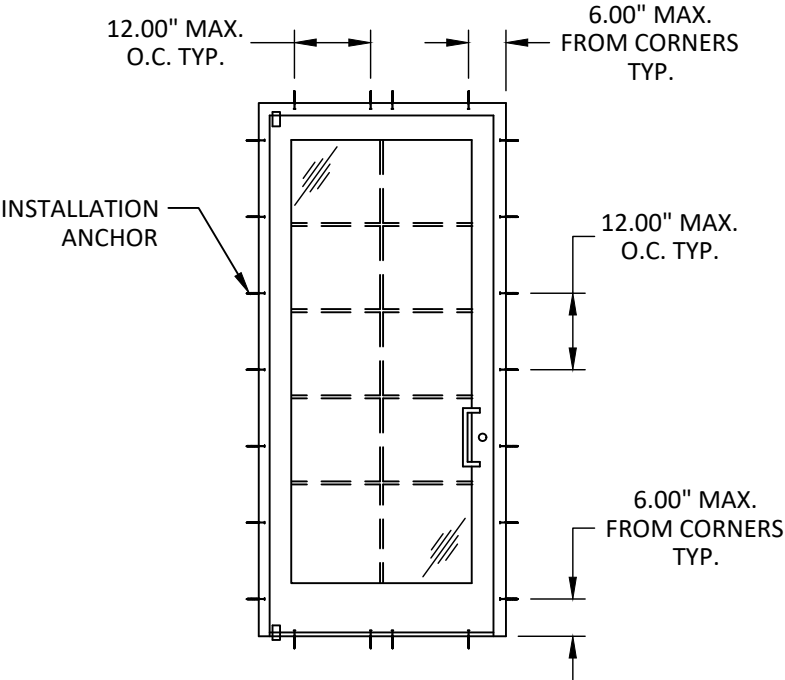

ANCHOR LAYOUT



Quality
inspires™

YKK AP AMERICA, Inc.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (478)277-1955 FAX: (678)838-6001


TITLE:
35D OUTSWING DOOR SYSTEM
(HVHZ) (NON-IMPACT)
ELEVATIONS & ANCHOR LAYOUTS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	SH	07.06.26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

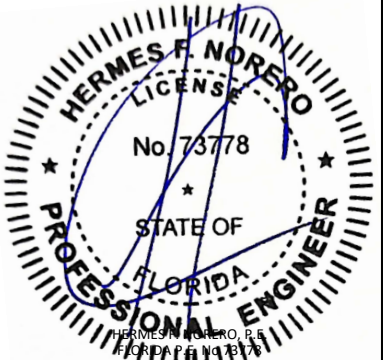


HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL12892
DATE:	04.10.12
DWG. BY:	CHK. BY:
GRN	HFN
SCALE:	NTS
DWG. #:	YKK001
SHEET:	REV. A

c:\users\sebastianhereros\building drops, inc\building drops landing - common\projects\2026 code change projects\ykk ap america, inc\ce-26-0247-1 - 2026 code change\dwgs\112892\ykk001.dwg
8/5/2026 8:29 PM


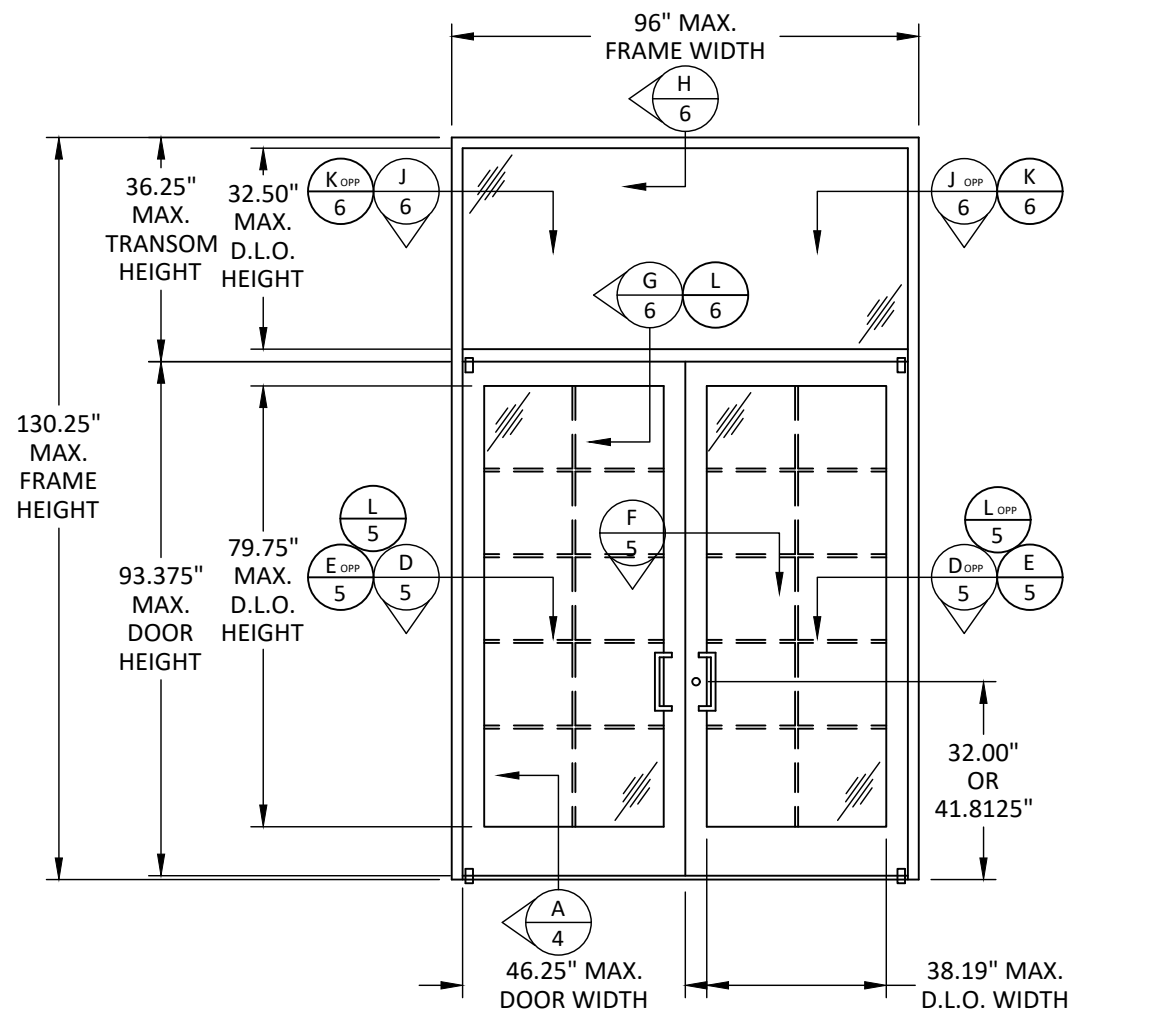


ELEVATION

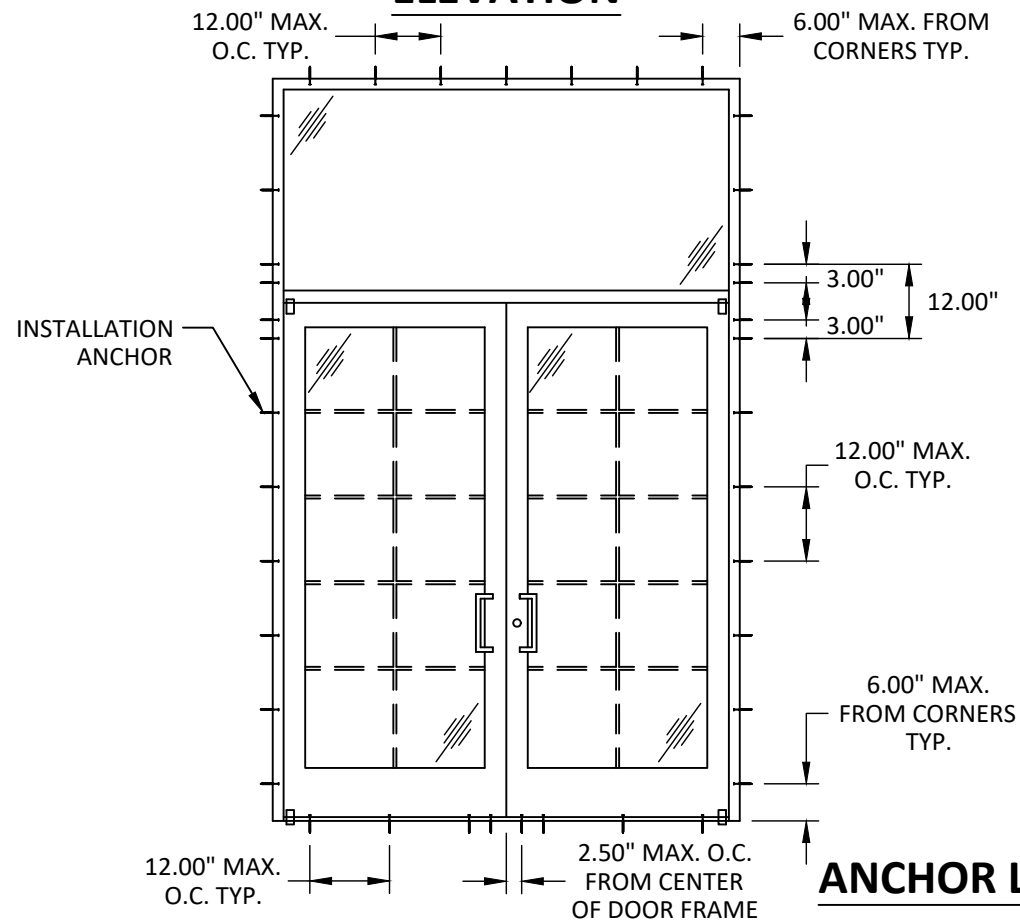


ANCHOR LAYOUT

HORIZONTAL LOAD CAPACITY - PSF			
WIDTH-W1 INCHES	WIDTH-W2 INCHES	DOOR LEAF HEIGHT-A INCHES	DESIGN PRESSURE EXT.(+) INT. (-)
60	24"	80	55.0
	30"		55.0
	36"		55.0
	40"		55.0
75-1/2	24"	80	55.0
	30"		55.0
	36"		55.0
	40"		55.0
96	24"	80	30.0
	30"		29.0
	36"		27.0
	40"		26.0
60	24"	83-1/8	55.0
	30"		55.0
	36"		55.0
	40"		55.0
75-1/2	24"	83-1/8	55.0
	30"		55.0
	36"		55.0
	40"		55.0
96	24"	83-1/8	29.0
	30"		28.0
	36"		26.0
	40"		26.0
60	24"	96	39.8
	30"		39.8
	36"		39.8
	40"		39.8
75-1/2	24"	96	33.6
	30"		33.6
	36"		33.6
	40"		33.6
96	24"	96	26.0
	30"		25.0
	36"		24.0
	40"		24.0

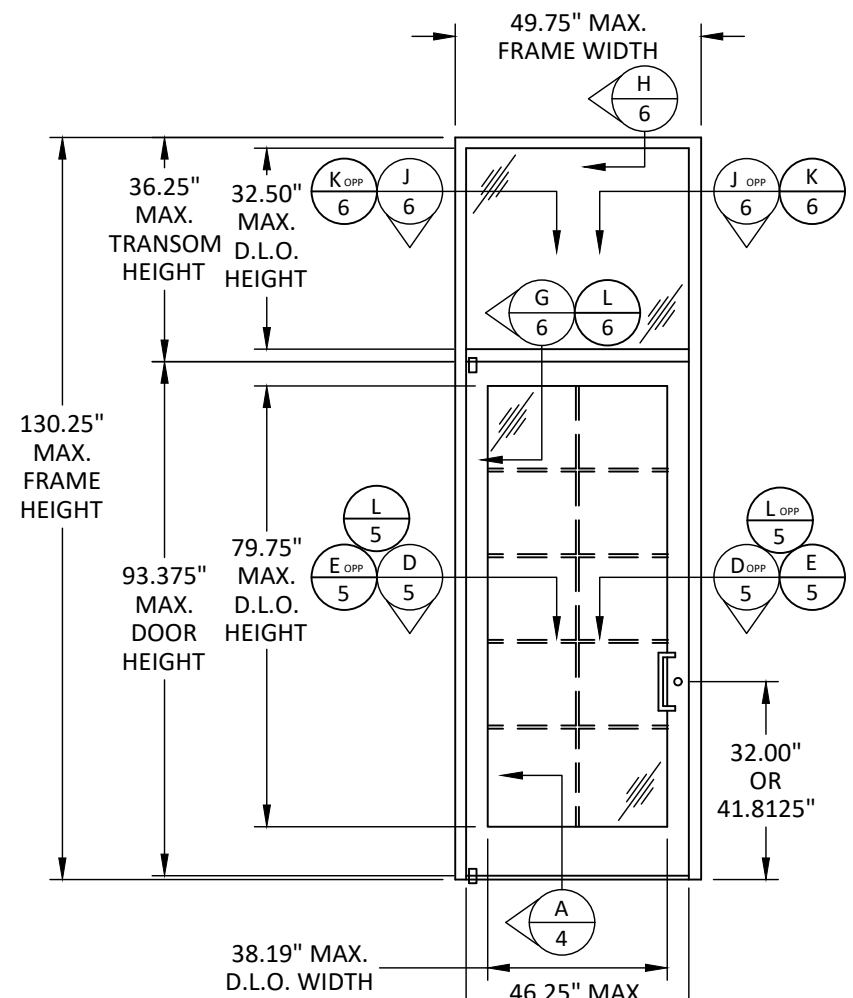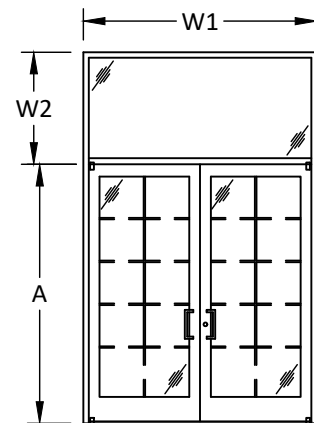

ELEVATION

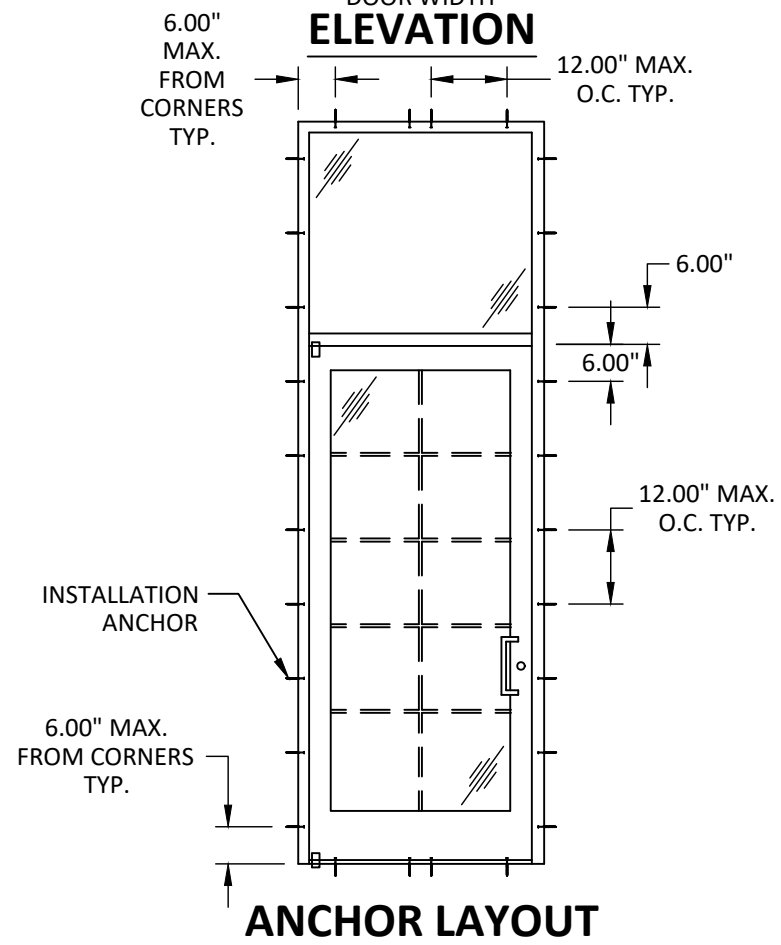

ANCHOR LAYOUT




YKK AP AMERICA, Inc.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (478)277-1955 FAX: (678)838-6001

TITLE: 35D OUTSWING DOOR SYSTEM (HVHZ) (NON-IMPACT)
ELEVATIONS, ANCHOR LAYOUTS & DESIGN PRESSURE TABLE

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com






REMARKS	BY	DATE
2026 FBC UPDATE	SH	07.06.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

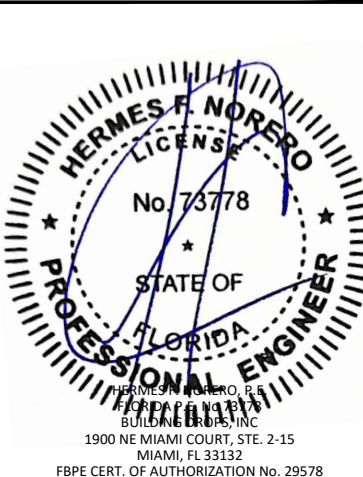

FL #:	FL12892
DATE:	04.10.12
DWG. BY:	GRN
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK001
SHEET:	3
REV.	A

c:\users\sebastianherrerros\building drops, inc\building drops landing - common\projects\2026 code change projects\ykk ap america, inc\cc-26-0247-1 - 2026 code change\dwgs\112892\ykk001.dwg
8/5/2026 8:29 PM

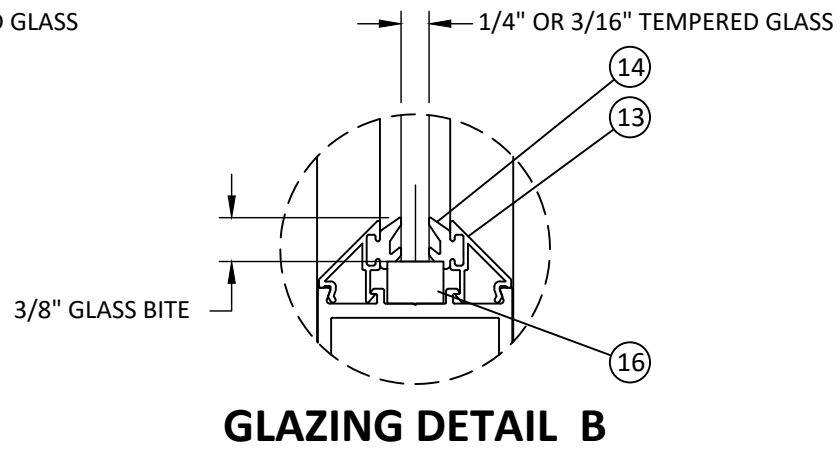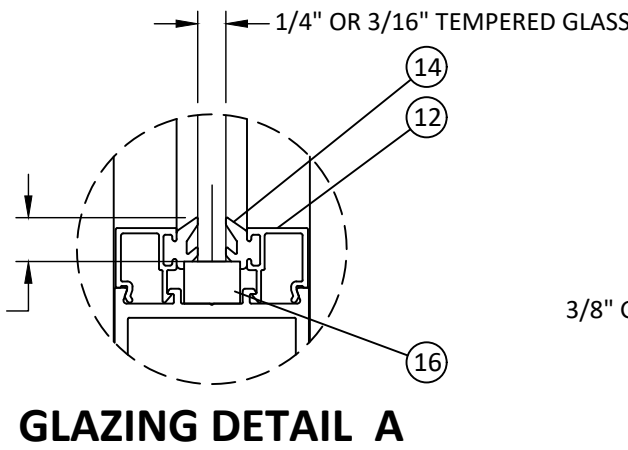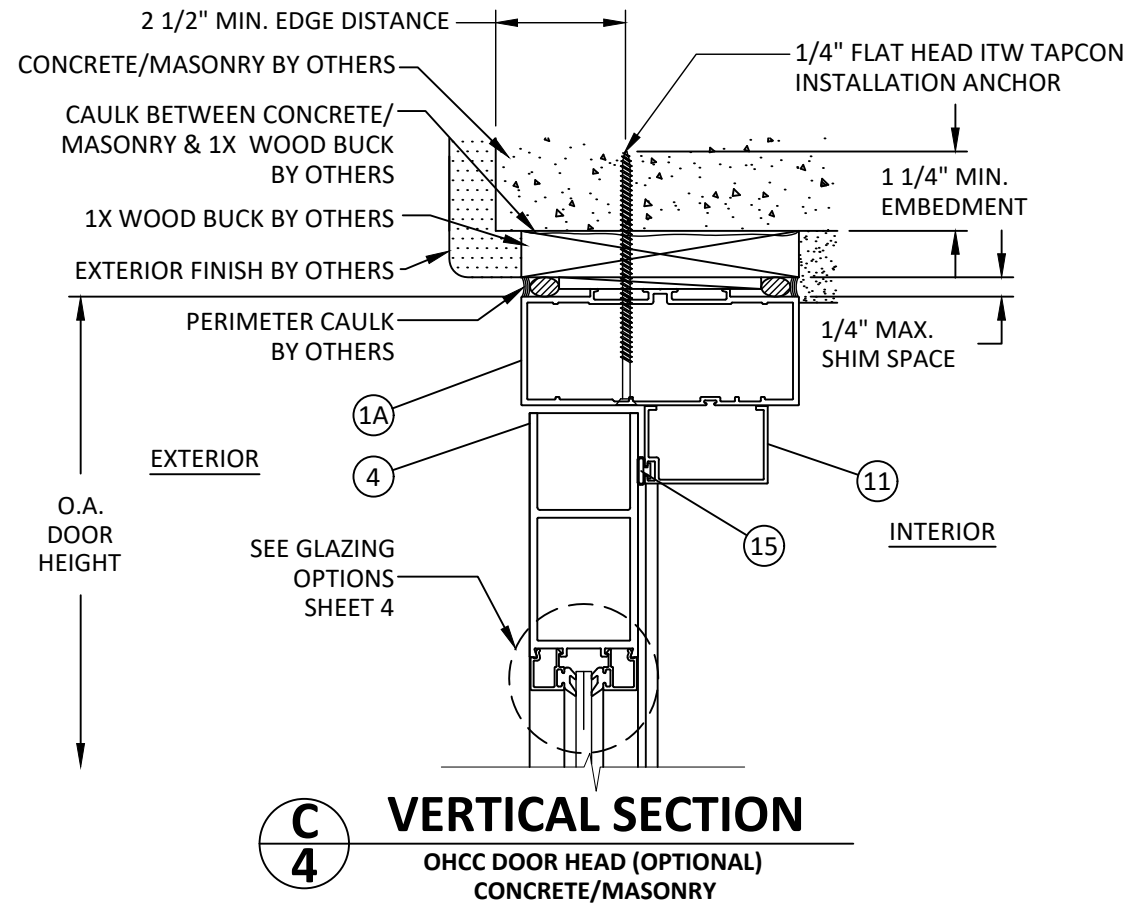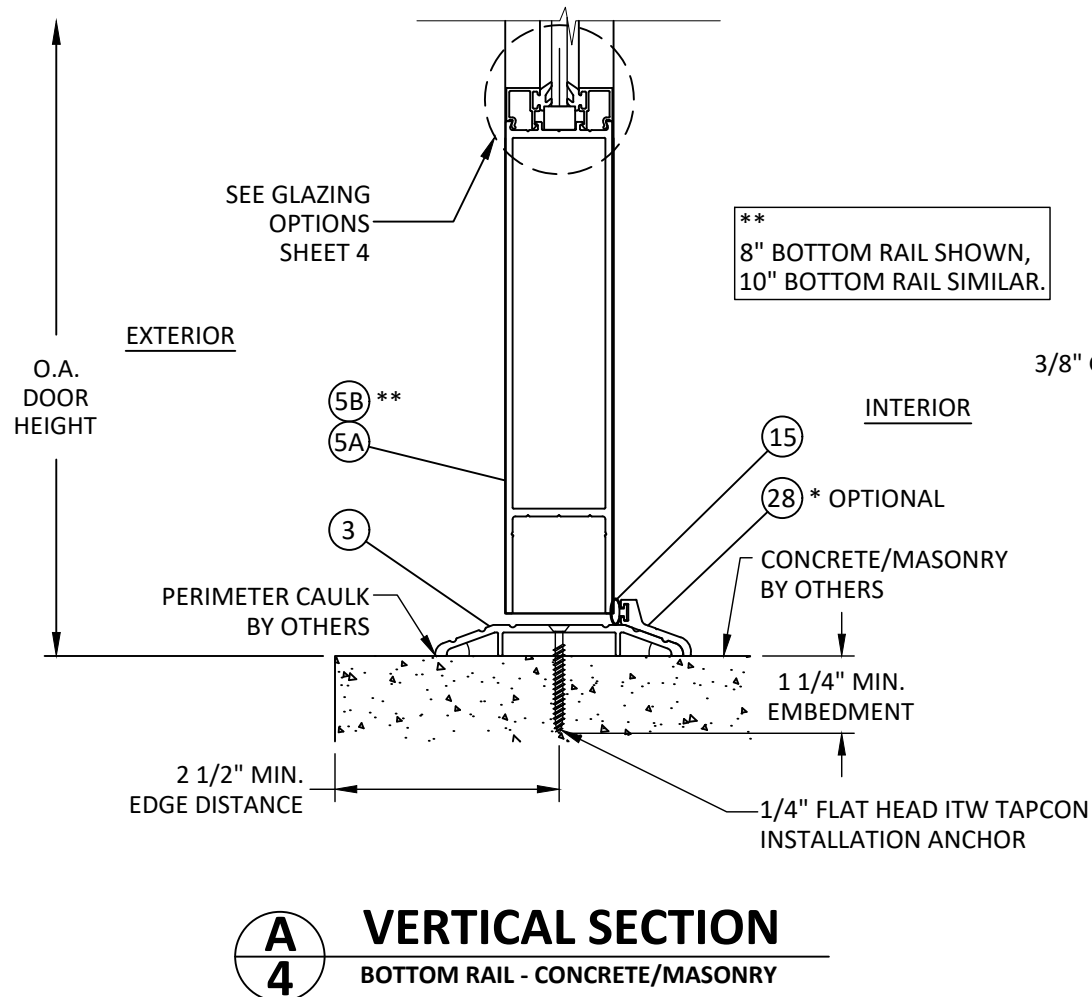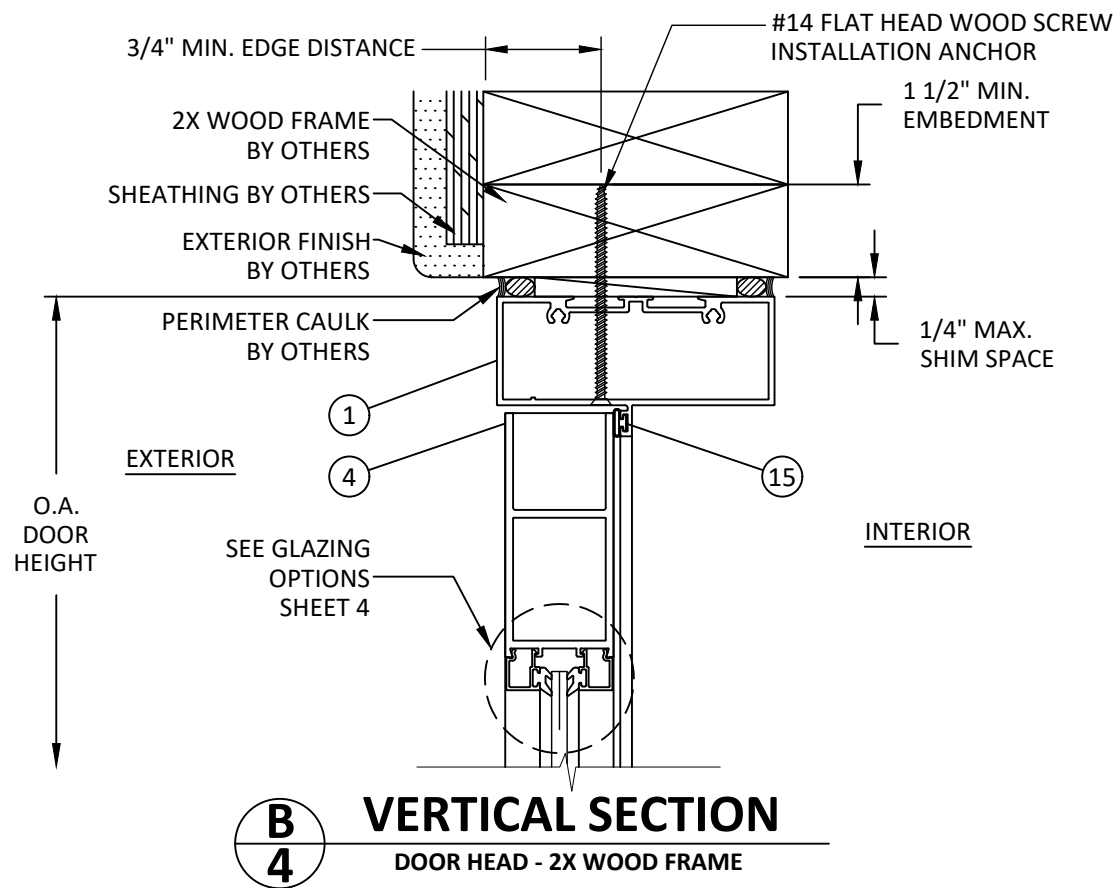

GLAZING NOTES:

- GLASS TYPE AND THICKNESS SHALL COMPLY WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. THICKNESS, TEMPER, AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
- SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
- SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
- D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES IN GLASS CHARTS.



YKK AP AMERICA, Inc.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (478)277-1955 FAX: (678)838-6001

TITLE:
35D OUTSWING DOOR SYSTEM
(HVHZ) (NON-IMPACT)
VERTICAL SECTIONS &
GLAZING DETAILS


PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	SH	07.06.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

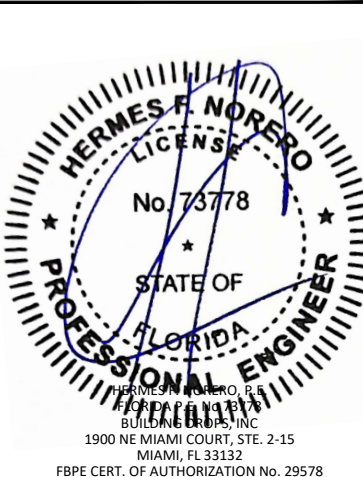


FL #:	FL12892
DATE:	04.10.12
DWG. BY:	GRN
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK001
SHEET:	4
REV.	A
OF	8


c:\Users\sebastianherrerero\building drops, inc\building drops, inc\change projects\ykk ap america, inc\2026 code change projects\ykk001.dwg 8/5/2026 8:29 PM

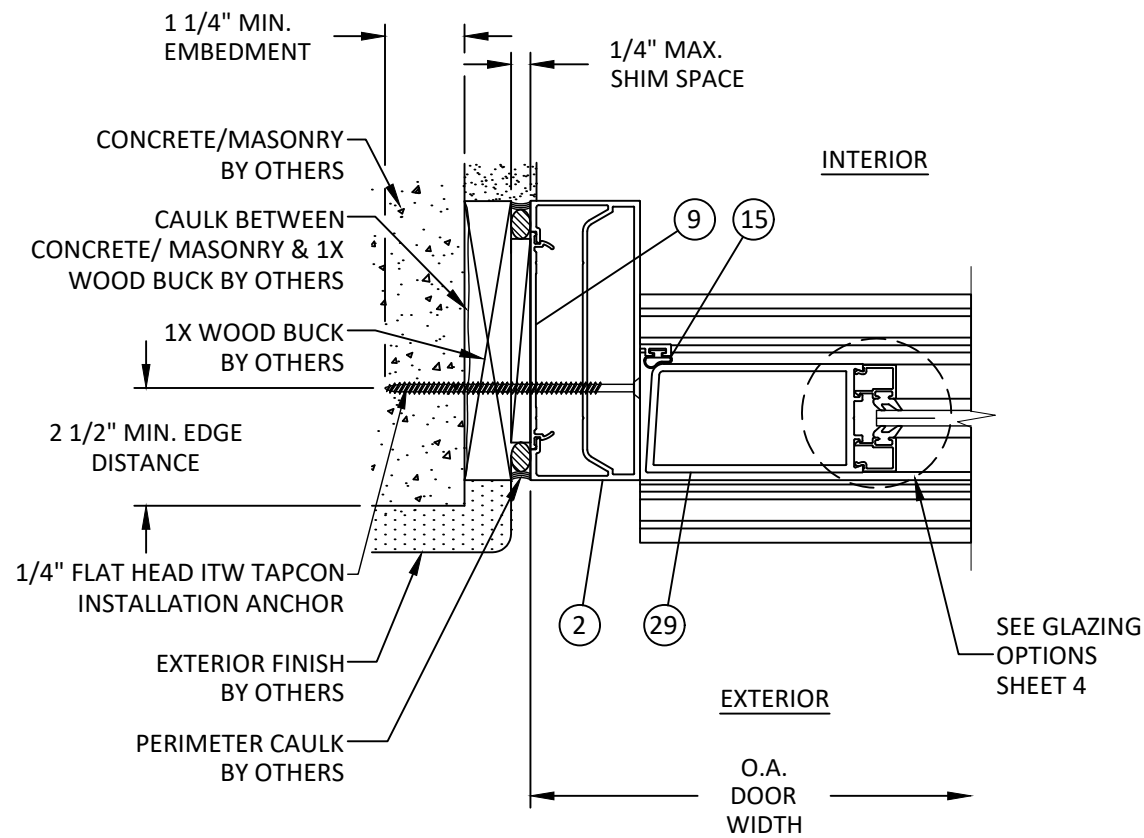

D HORIZONTAL SECTION
5 JAMB - CONCRETE/MASONRY

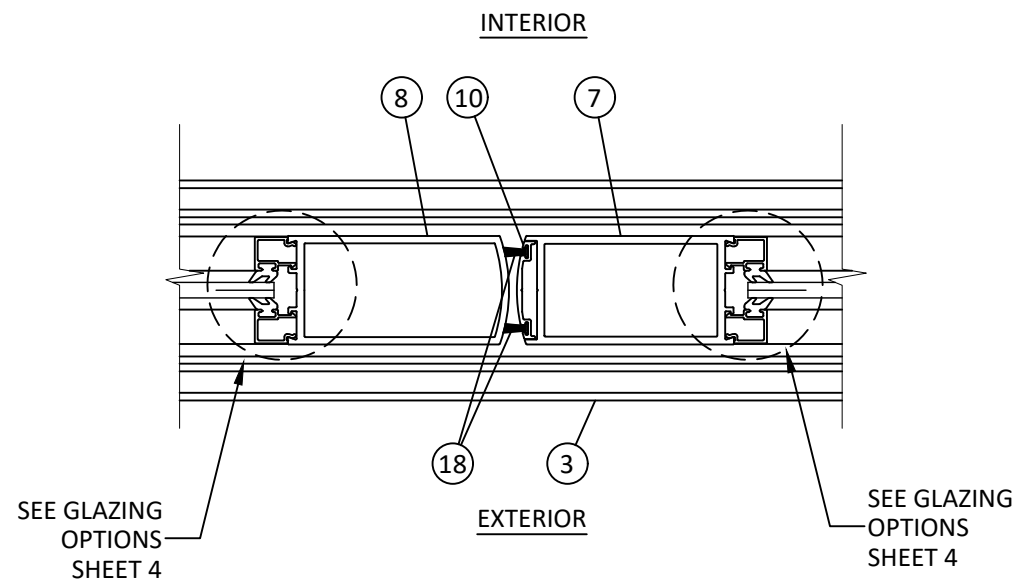


F HORIZONTAL SECTION
5 MEETING STILE

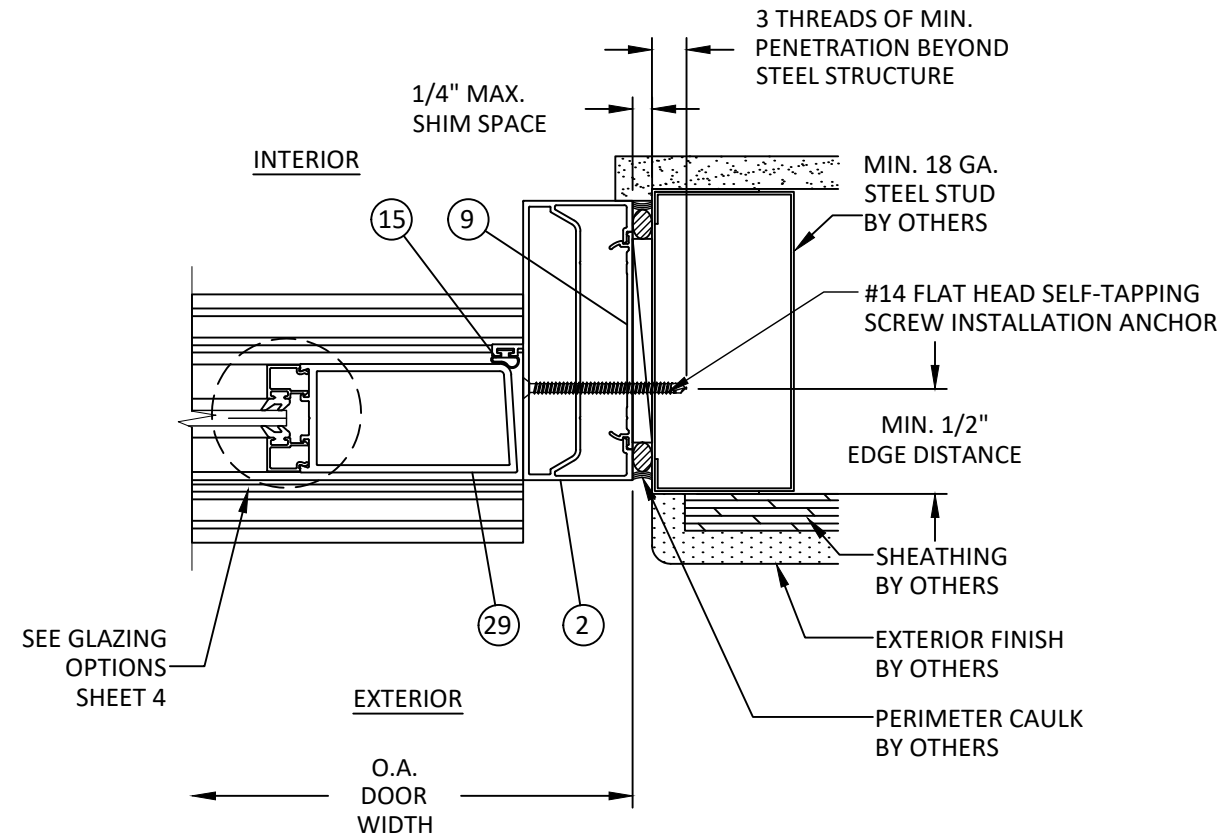

E HORIZONTAL SECTION
5 JAMB - STEEL STUD

YKK AP AMERICA STOREFRONT
UNDER SEPARATE APPROVAL

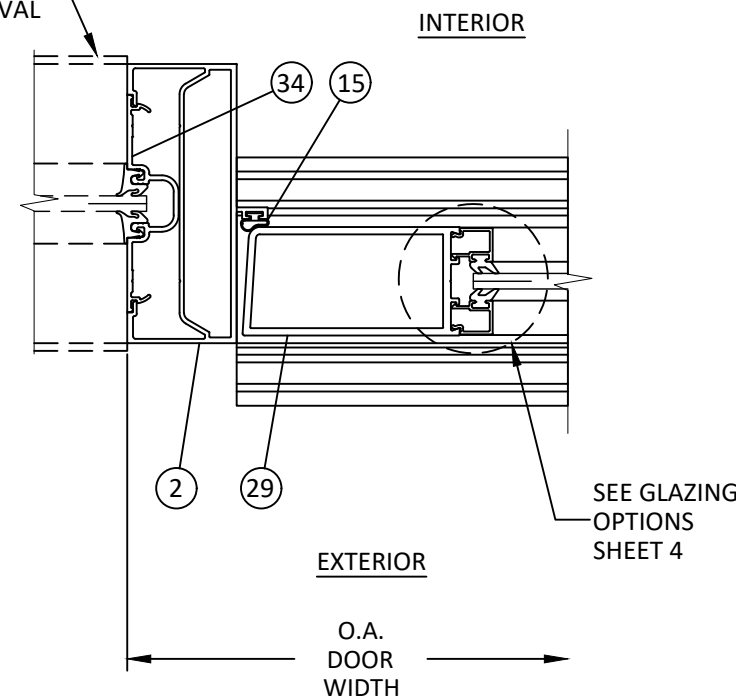

L HORIZONTAL SECTION
5 JAMB - STOREFRONT INSTALLATION



YKK AP AMERICA, Inc.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (478)277-1955 FAX: (678)838-6001

TITLE:
35D OUTSWING DOOR SYSTEM
(HVHZ) (NON-IMPACT)

HORIZONTAL SECTIONS


PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	SH	07.06.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

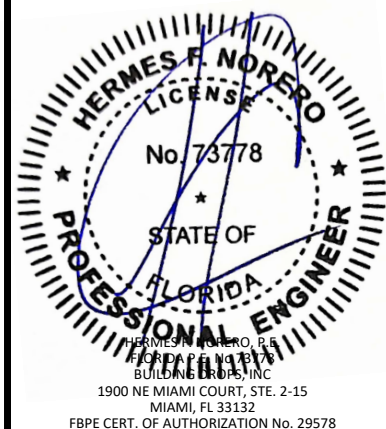


FL #:	FL12892
DATE:	04.10.12
DWG. BY:	GRN
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK001
SHEET:	5
REV.	A


c:\users\sebastianhereros\building drops, inc\building drops landing - common\projects\2026 code change projects\ykk ap america, inc\ce-26-0247.1 - 2026 code change\dwgs\112892\ykk001.dwg
8/5/2026 8:29 PM
c:\users\sebastianhereros\building drops, inc\building drops landing - common\projects\2026 code change projects\ykk ap america, inc\ce-26-0247.1 - 2026 code change\dwgs\112892\ykk001.dwg

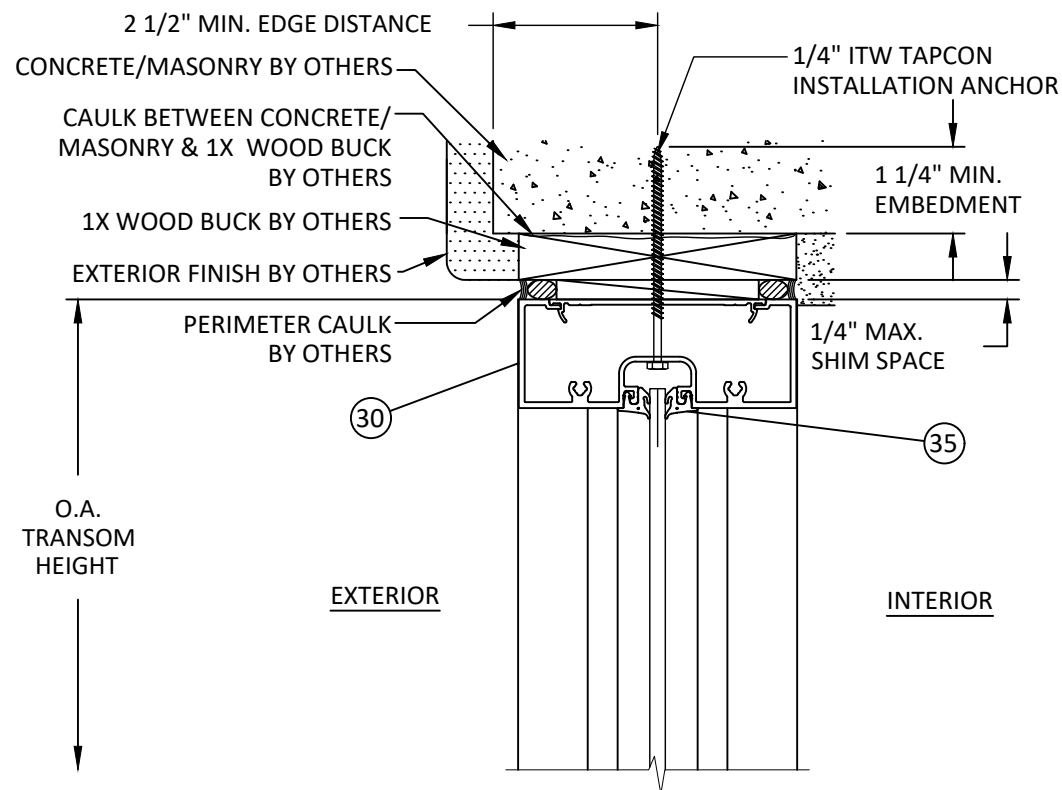


H
6 VERTICAL SECTION
HEAD - CONCRETE/MASONRY

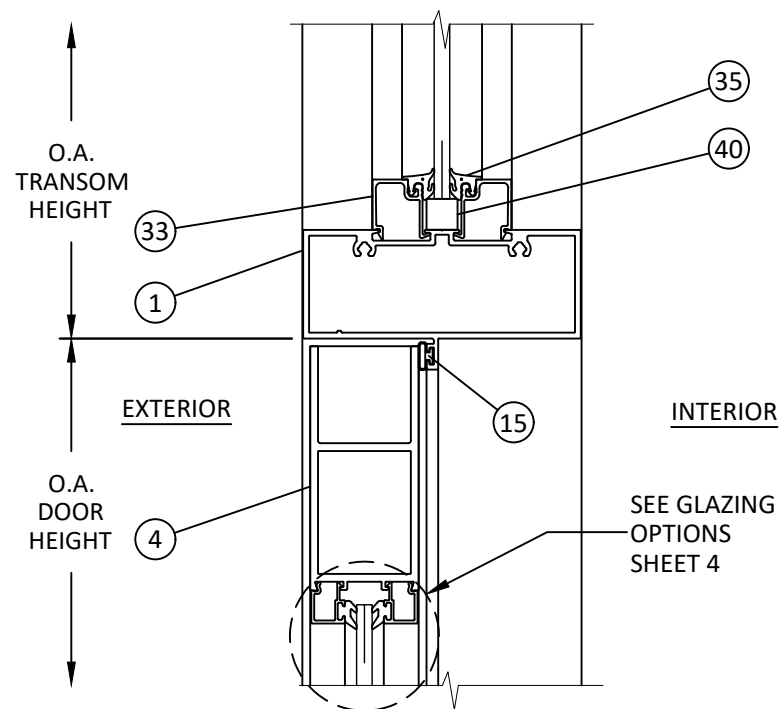


G
6 VERTICAL SECTION
TRANSOM BAR AT DOOR HEAD

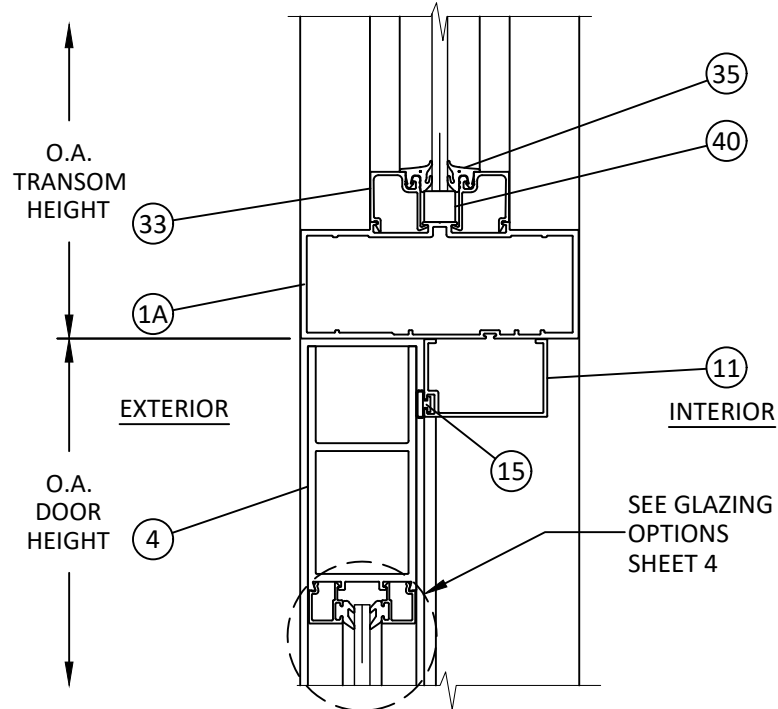

G
6 VERTICAL SECTION
TRANSOM BAR AT DOOR HEAD OHCC

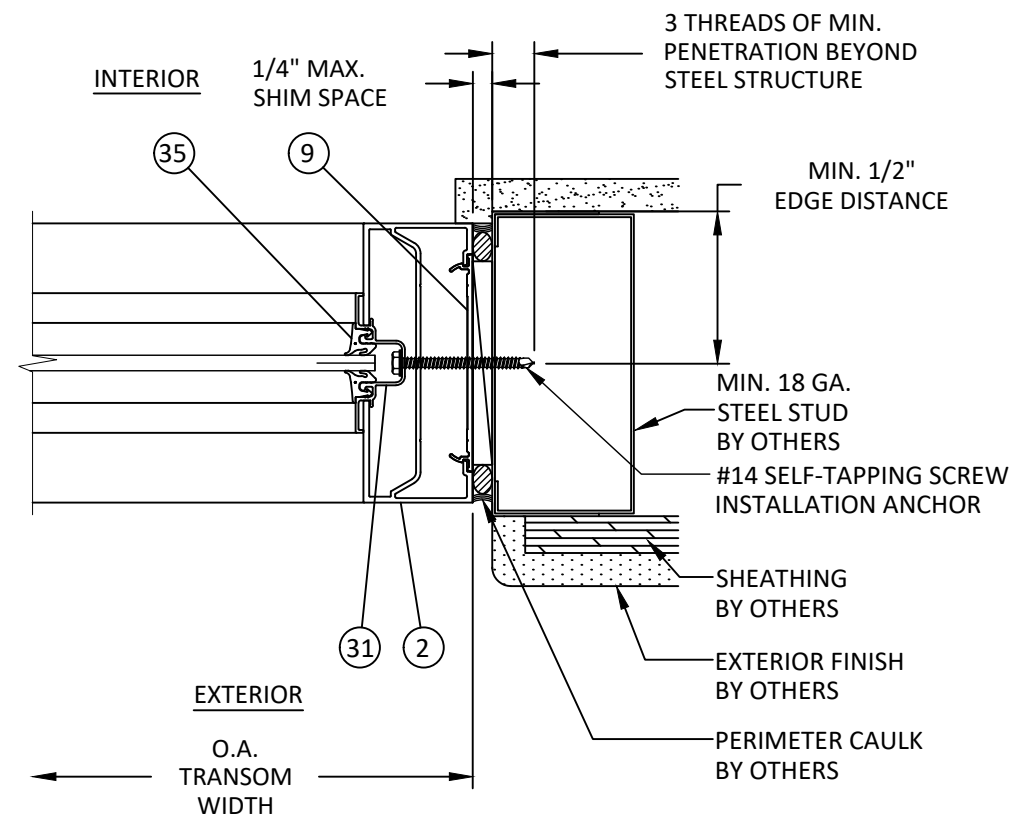

K
6 HORIZONTAL SECTION
TRANSOM JAMB - STEEL STUD

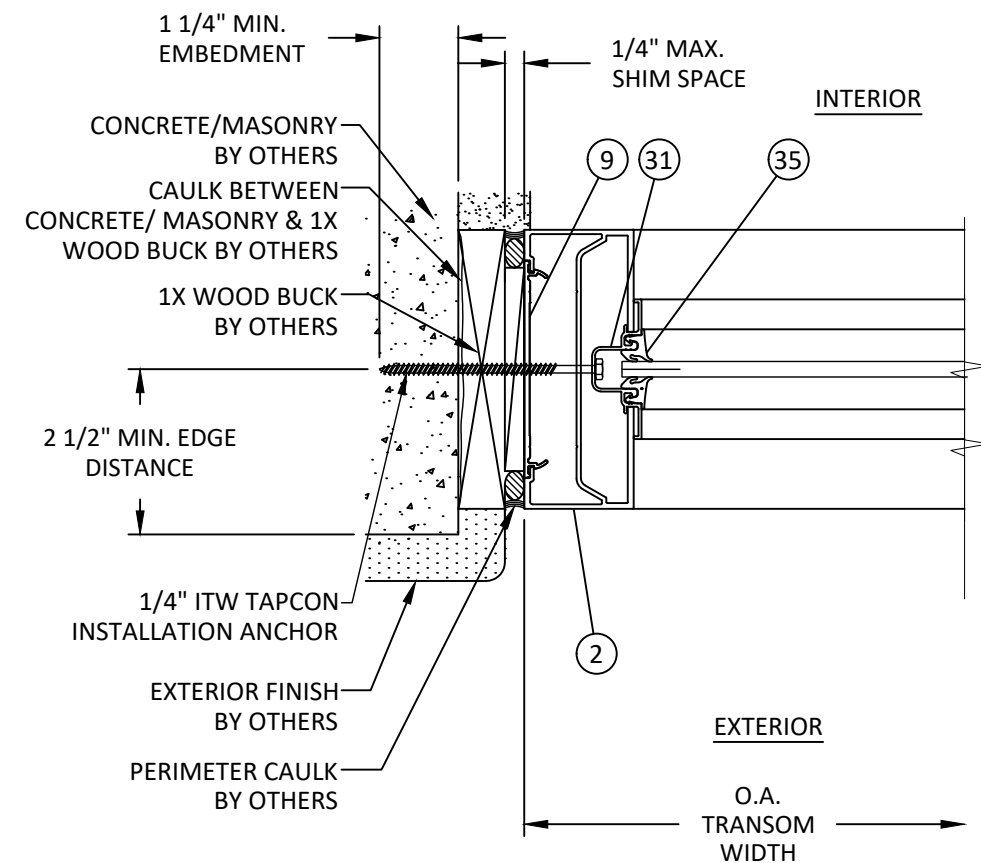

J
6 HORIZONTAL SECTION
TRANSOM JAMB - CONCRETE/MASONRY




YKK AP AMERICA, Inc.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (478)277-1955 FAX: (678)838-6001

TITLE:	35D OUTSWING DOOR SYSTEM (HVHZ) (NON-IMPACT)
	VERTICAL & HORIZONTAL SECTIONS
PREPARED BY:	BUILDING DROPS, INC. 1900 NE MIAMI COURT, STE. 2-15 MIAMI, FL 33132 PH: (954)399-8478 FAX: (954)744-4738 WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPDATE	SH	07.06.26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

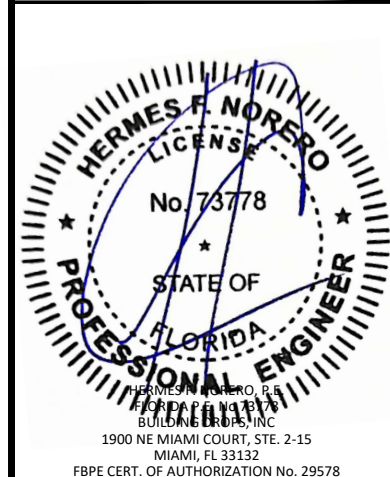


FL #:	FL12892
DATE:	04.10.12
DWG. BY:	GRN
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK001
SHEET:	6
REV.	A

ITEM NO.	PART NO.	DESCRIPTION	MATERIAL	MANUFACTURER
1	E9-0402	DOOR HEAD O/P	6063-T5	YKK AP
1A	E9-0425	DOOR HEAD OHCC	6063-T5	YKK AP
2	E9-0421	DOOR JAMB O/P	6063-T5	YKK AP
3	E9-0407	4" THRESHOLD	6063-T5	YKK AP
4	E9-0306	TOP RAIL	6063-T5	YKK AP
5A	E9-0317	8" BOTTOM RAIL	6063-T5	YKK AP
5B	E9-0323	10" BOTTOM RAIL	6063-T5	YKK AP
7	E9-0330	MEETING STILE (ACTIVE)	6063-T5	YKK AP
8	E9-0310	MEETING STILE (INACTIVE)	6063-T5	YKK AP
9	E1-1054	FLAT FILLER	6063-T5	YKK AP
10	E9-0332	MEETING STILE COVER	6063-T5	YKK AP
11	E9-0215	DOOR STOP OHCC	6063-T5	YKK AP
12	E9-0314	1/4" GLASS STOP	6063-T5	YKK AP
13	E9-0339	1/4" BEVELED GLASS STOP	6063-T5	YKK AP
14	E2-0050	DOOR GASKET	EPDM	---
15	E2-0051	AIRTIGHT GASKET	SANTOPRENE	---
16	E2-0054	DOOR SETTING BLOCK (1/4")	EPDM	---
17	H-7107	DOOR SWEEP PACKAGE (OPTIONAL)	---	---
18	E2-0087	DOOR WEATHERSEAL	POLYPROPYLENE	---
19	PC-1216	#12 X 1" PHSMS TYPE AB	ZINC PLATED STEEL	---
20	--	3/8"-16 X 5/8"	ZINC PLATED STEEL	
21	--	#10 X 1" FHMS	ZINC PLATED STEEL	
22	E1-0308	JOINT CLIP FOR TOP RAIL	6063-T5	YKK AP
23	E1-0309	JOINT CLIP FOR BOTTOM RAIL	6063-T5	YKK AP
24	E1-0311	BACKER PLATE	ZINC PLATED STEEL	---
25	--	PUSH/PULL HARDWARE	---	---
28	AS-0427	THRESHOLD STOP	6063-T5	YKK AP
29	E9-0308	JAMB STILE	6063-T5	YKK AP
30	E9-1003	HEAD (MONO)	6063-T5	YKK AP
31	E9-0434	TRANSOM GLAZING POCKET FILLER (1/4")	6063-T5	YKK AP
33	E9-0403	TRANSOM GLASS STOP (1/4")	6063-T5	YKK AP
34	E9-1009	DEEP POCKET GLAZING FILLER (1/4")	6063-T5	YKK AP
35	E2-0052	TRANSOM GLAZING GASKET	EPDM	---
36	--	HOOK BOLT LOCK (MS1850)	---	---
37	--	OFFSET PIVOT SET	---	---
38	--	KEEPERS	---	---
39	--	PUSH/PULL HARDWARE	---	---
40	E2-0019	TRANSOM SETTING BLOCK	EPDM	---


1 DOOR HEAD O/P

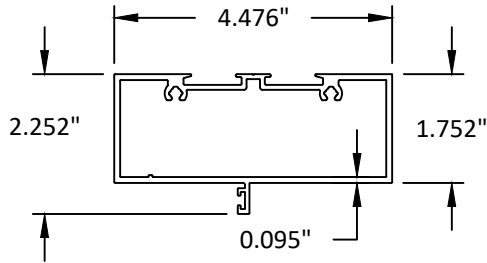


1A DOOR HEAD OHCC

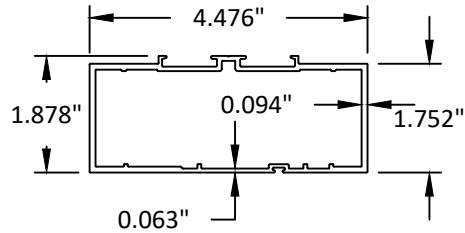


2 DOOR FRAME JAMB O/P

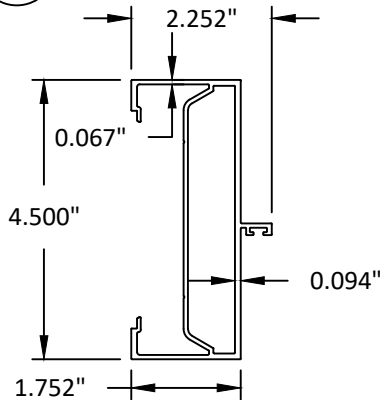


3 4" THRESHOLD

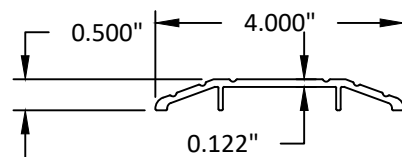


4 TOP RAIL

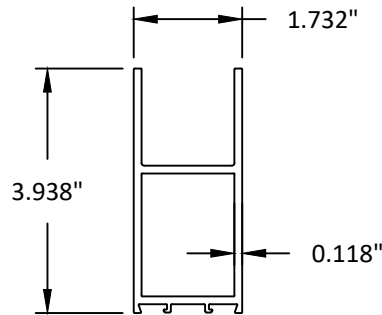

5B 10" BOTTOM RAIL

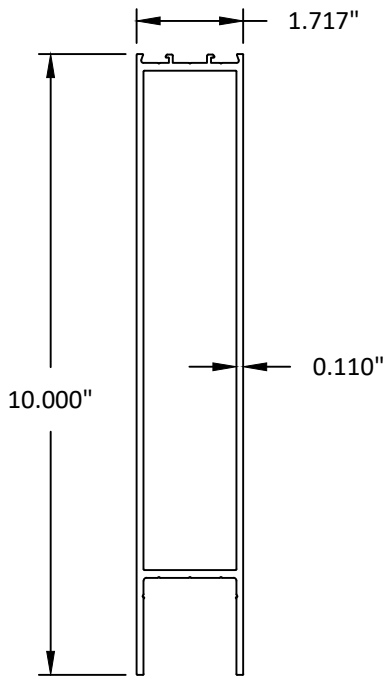

5A 8" BOTTOM RAIL

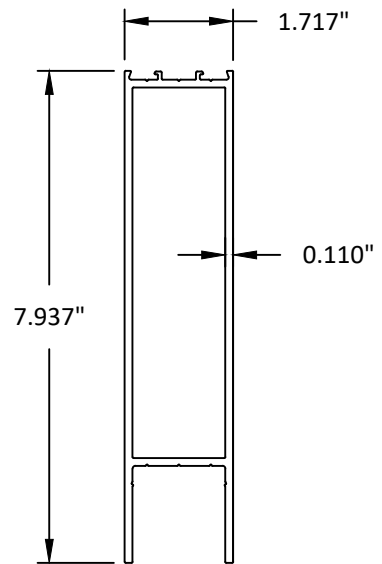

YKK AP AMERICA, Inc.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (478)277-1955 FAX: (678)838-6001

TITLE:
35D OUTSWING DOOR SYSTEM
(HVHZ) (NON-IMPACT)

BILL OF MATERIALS & COMPONENTS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

PH: (954)399-8478

FAX: (954)744-4738

WEB: www.buildingdrops.com



BUILDING DROPS

REMARKS

BY

DATE

2026 FBC UPDATE

SH

07.06.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:

FL12892

DATE: 04.10.12

DWG. BY:
GRN

CHK. BY:
HFN

SCALE: NTS

DWG. #: YKK001

SHEET:

7


REV.

A


OF 8

c:\users\sebastianh\projects\building drops, inc\building drops, inc\change projects\ykk ap america, inc\2026 fbc update\112892\ykk001.dwg 8/5/2026 8:29 PM


7 MEETING STILE (ACTIVE)

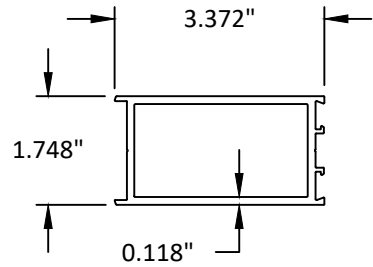


8 MEETING STILE (INACTIVE)

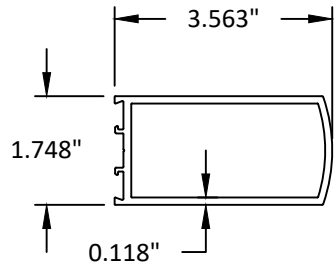


9 FLAT FILLER

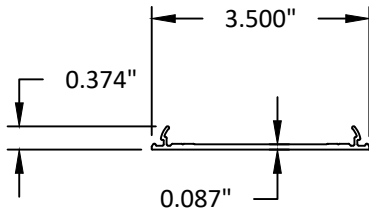


10 MEETING STILE COVER




11 DOOR STOP OHCC

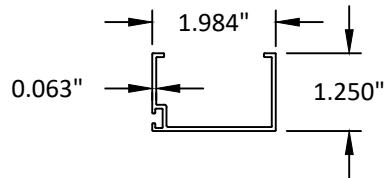


12 1/4" GLASS STOP

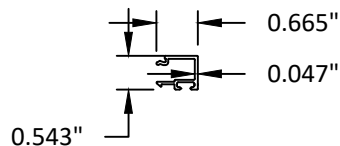


13 1/4" BEVELED GLASS STOP

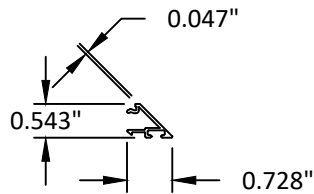


28 THRESHOLD STOP




29 JAMB STILE

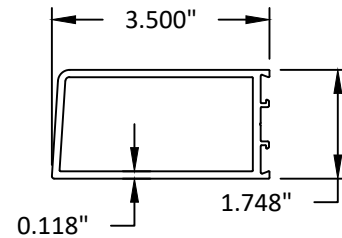


30 HEAD (MONO)

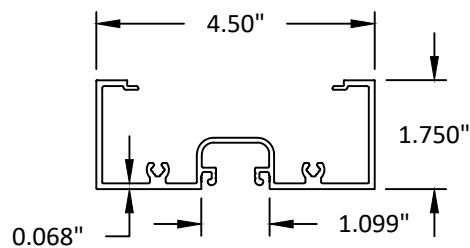


31 TRANSOM GLAZING POCKET FILLER (1/4")

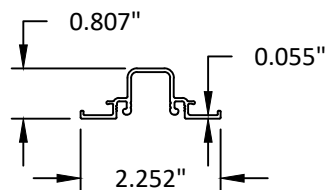

33 TRANSOM GLASS STOP (1/4")



34 DEEP POCKET GLAZING FILLER (1/4")

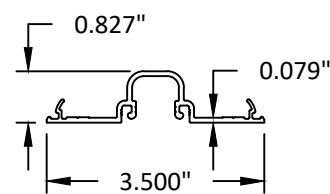

YKK AP AMERICA, Inc.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (478)277-1955 FAX: (678)838-6001

TITLE:
35D OUTSWING DOOR SYSTEM
(HVHZ) (NON-IMPACT)

COMPONENTS


PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	SH	07.06.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

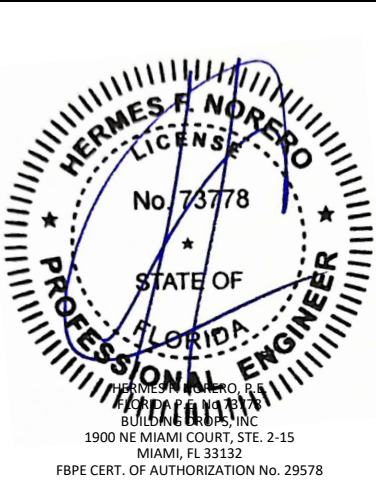

FL #:	FL12892
DATE:	04.10.12
DWG. BY:	GRN
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK001
SHEET:	8
REV.	A
	OF 8