

YKK AP AMERICA, Inc.

50M MONUMENTAL (HD) ENTRANCE SYSTEM (NON-HVHZ) (NON-IMPACT)

INSTALLATION NOTES:


- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- REFER TO SHEET 2 & 3 FOR INSTALLATION DETAILS, ANCHOR SELECTION, AND ANCHOR REQUIREMENTS.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
 - FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
 - CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - CONCRETE -MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
 - MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI.
 - STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM 18 GA. WALL THICKNESS.
 - ALUMINUM - MINIMUM 1/16 INCH THICK 6063-T5 ALUMINUM.

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - ASTM E283-19
 - ASTM E330-14
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- DOOR FRAME MATERIAL: ALUMINUM 6063-T5
- ALL STRUCTURAL MATERIALS & DISSIMILAR METALS SHALL BE PROTECTED, TREATED, PAINTED, COATED, AND/OR ISOLATED AS REQUIRED IN THE APPLICABLE SECTIONS OF THE CURRENT FLORIDA BUILDING CODE AND REFERENCED DESIGN SPECIFICATIONS.
- ALLOWABLE CONFIGURATIONS: X (SINGLE DOOR).
XX (DOUBLE DOOR)

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	ELEVATION, ANCHOR LAYOUTS & SCHEDULE
3	ELEVATION, ANCHOR LAYOUTS & SCHEDULE
4	VERTICAL SECTIONS
5	HORIZONTAL SECTIONS
6	HORIZONTAL SECTIONS & GLAZING DETAILS
7	COMPONENTS & BILL OF MATERIALS

DESIGN PRESSURE TABLE				
PRODUCT CONFIGURATION	MAX. FRAME SIZE		DESIGN PRESSURE	MISSILE IMPACT RATING
	WIDTH	HEIGHT		
"XX"	88"	98"	+/-65 PSF	NOT RATED
"X"	46"	98"		

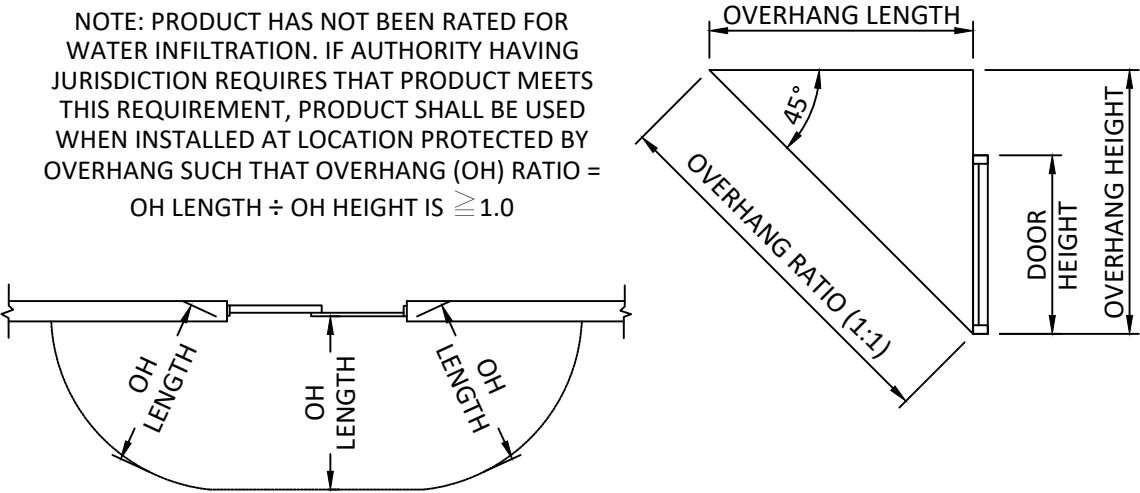

YKK AP AMERICA, Inc.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (478)277-1955 FAX: (678)838-6001

TITLE:
50M MONUMENTAL (HD)
ENTRANCE SYSTEM
(NON-HVHZ) (NON-IMPACT)

INSTALLATION & GENERAL NOTES


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
JAMB PROFILE UPDATE	MS	MAY/22
2026 FBC UPDATE	SH	07.06.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.08.23 16:46:51 -0400'

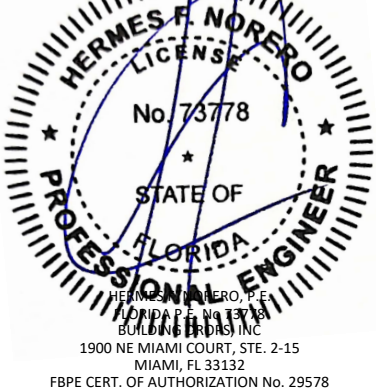

FL #:

FL12892

DATE:

08.23.17

DWG. BY:

EG

CHK. BY:

HFN

SCALE:

NTS

DWG. #:

YKK221

SHEET:

1

REV.


B

OF


7

7/24/2026 9:56 AM

c:\users\sebastianherrerros\desktop\ykk 2026 ca\112892\ykk221.dwg

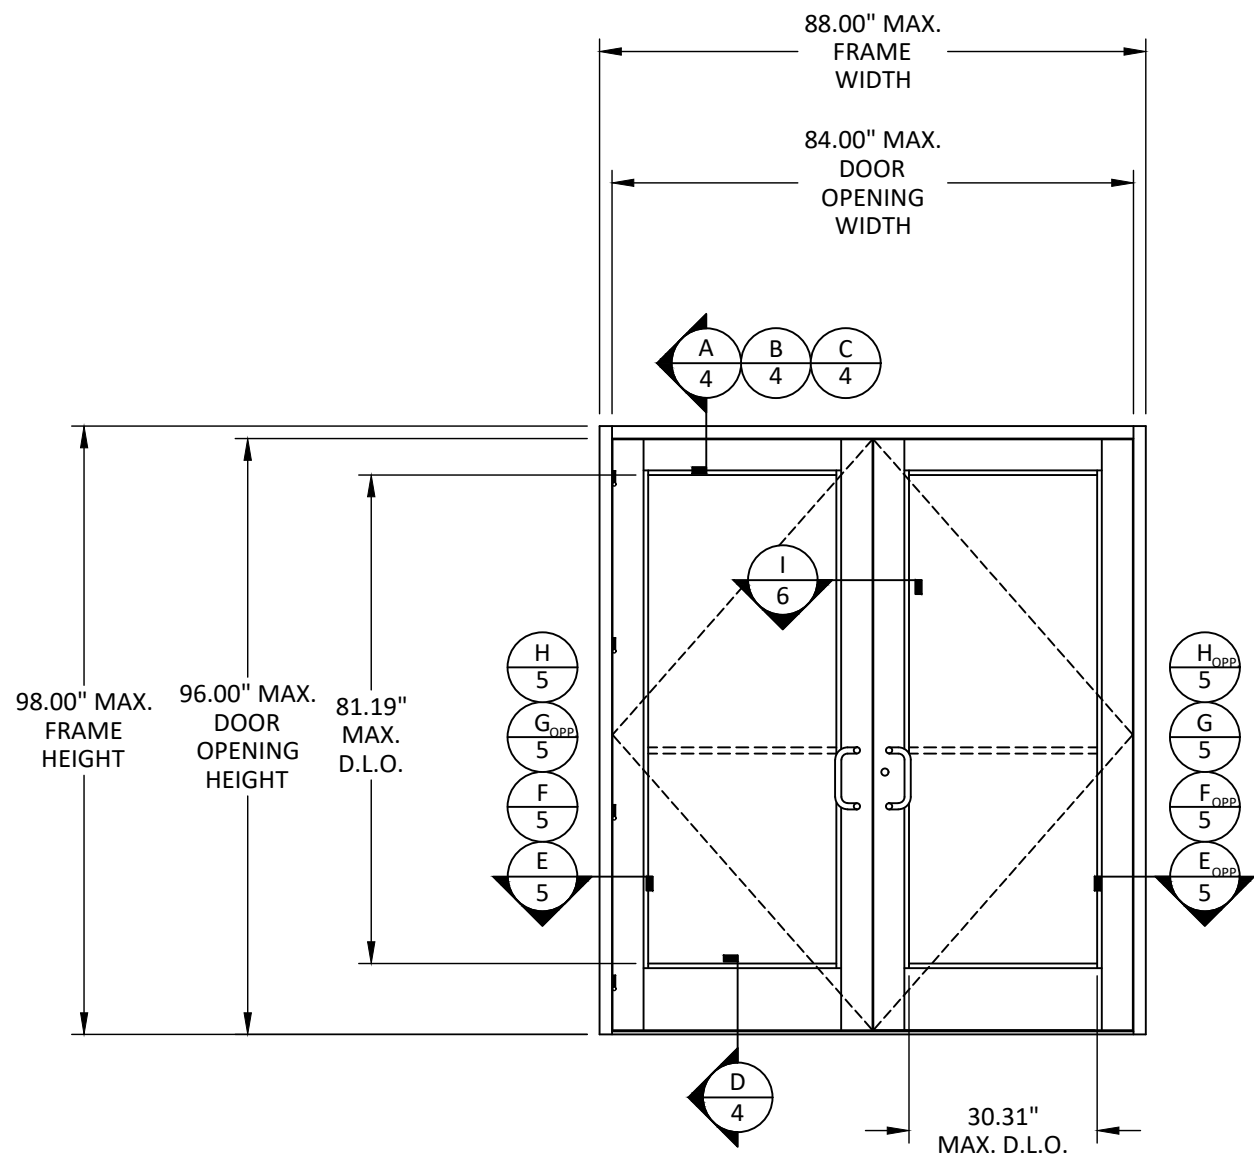

**TYPICAL ELEVATION
OUTSWING DOOR**

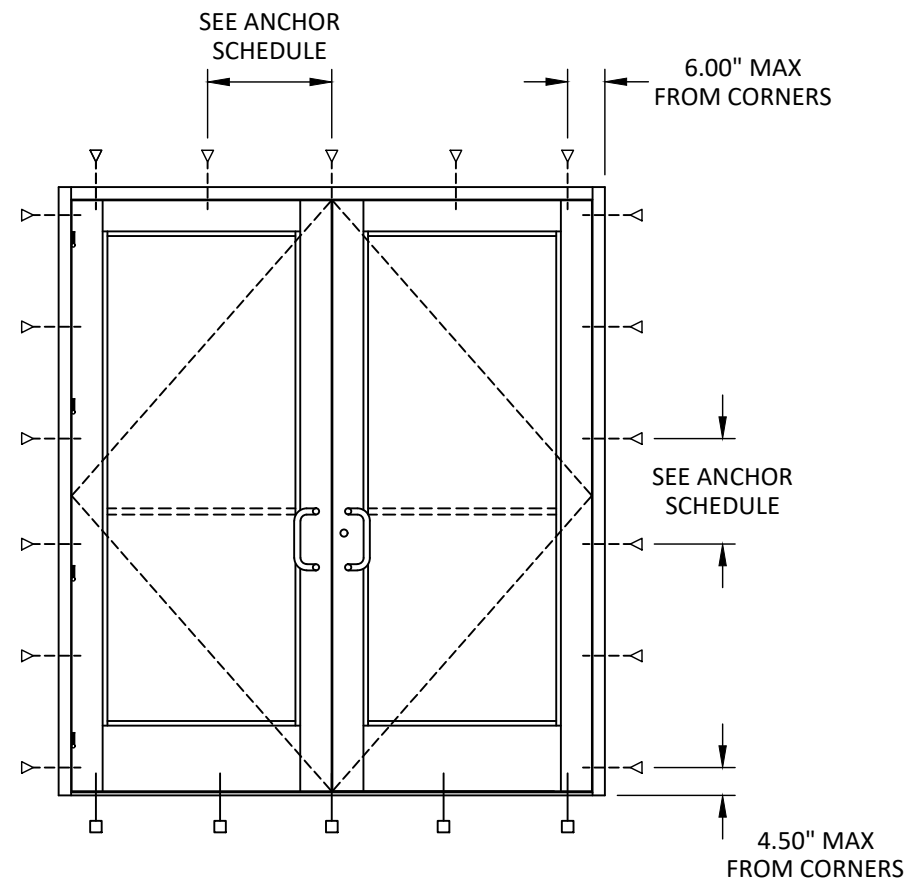

**ANCHOR LAYOUT
OUTSWING DOOR**

ANCHOR SCHEDULE						
METHOD	SUBSTRATE	ANCHOR SCHEDULE	MIN EMBEDMENT	MIN. EDGE DISTANCE	MAX. SPACING HEAD & SILL	MAX. SPACING JAMB
THROUGH FRAME	WOOD MIN. SG = 0.55	#14 WOOD SCREW	1.5"	0.75"	19	22
	18 GAUGE STEEL, MIN. Fy = 33KSI	#14 TEK SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.75"	25	44
	CONCRETE f'c = 3000PSI	1/4" ITW TAPCON	1.75"	2.5"	19	17
	CMU per ASTM C90	1/4" ITW TAPCON	1"	2.5"	19	17
	ALUMINUM 1/16" THICK 6063-T5	1/4" SELF DRILLING OR SELF TAPPING SCREW GRADE 5	3 THREADS MIN PENETRATION BEYOND METAL	0.7500	25	44



YKK AP AMERICA, Inc.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (478)277-1955 FAX: (678)838-6001


TITLE:
50M MONUMENTAL (HD)
ENTRANCE SYSTEM
(NON-HVHZ) (NON-IMPACT)
ELEVATION, ANCHOR LAYOUTS
& SCHEDULE

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-9478
FAX: (954)744.4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
JAMB PROFILE UPDATE	MS	MAY/22
2026 FBC UPDATE	SH	07.06.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

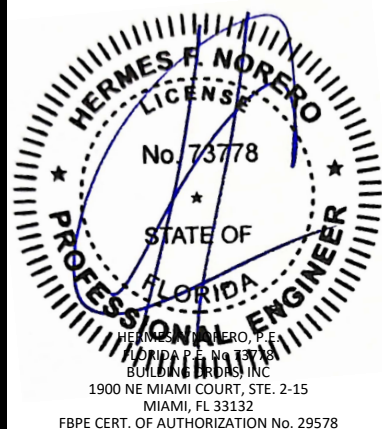

FL #:
FL12892

DATE: **08.23.17**


DWG. BY: EG	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**


DWG. #: **YKK221**

SHEET: 2	REV. B
--------------------	------------------

c:\users\sebastianherrerros\desktop\ykk 2026 ca\112892\ykk221.dwg 7/24/2026 9:56 AM

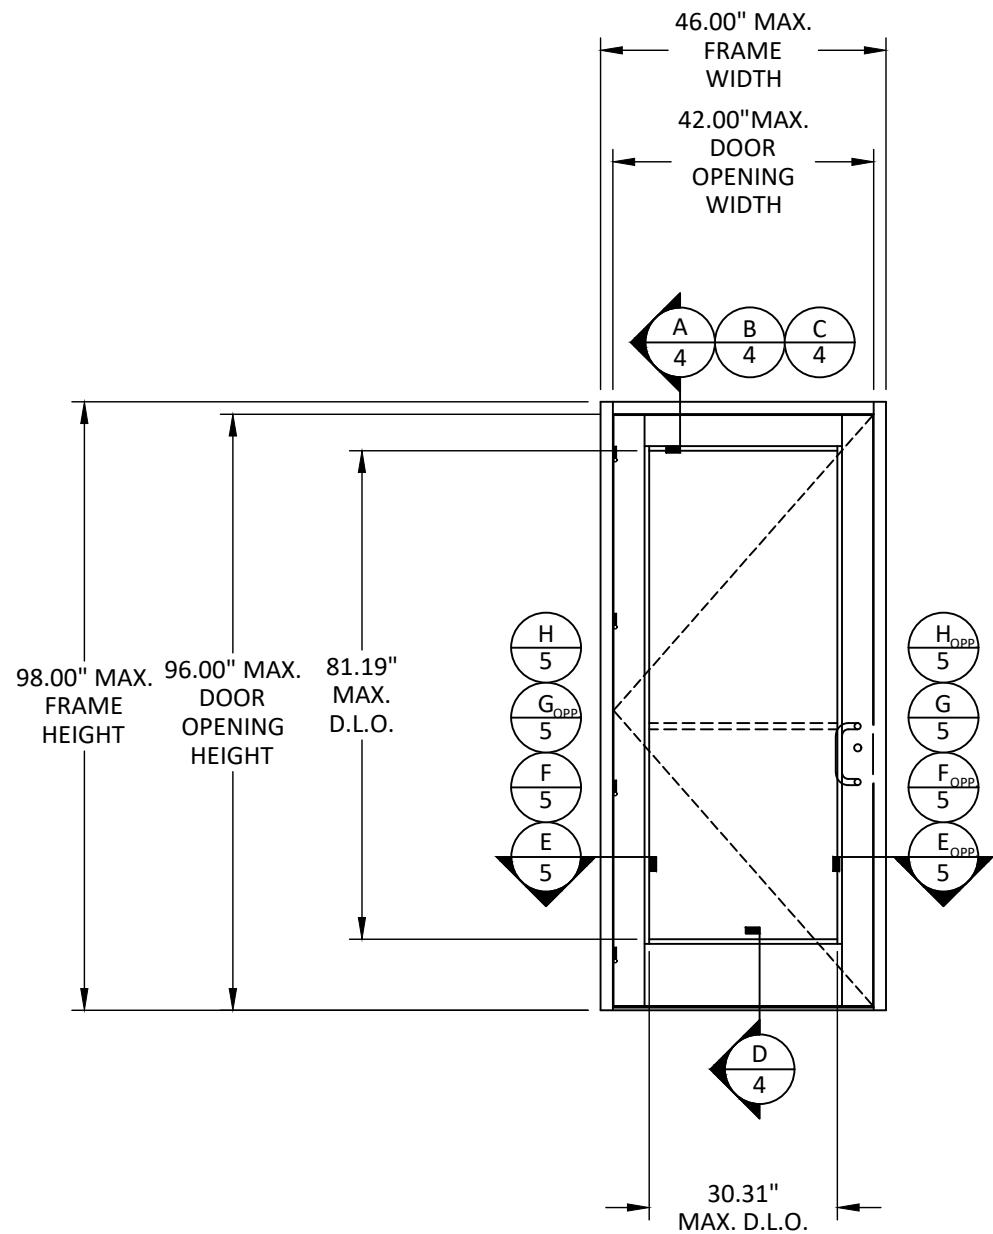

TYPICAL ELEVATION
OUTSWING DOOR

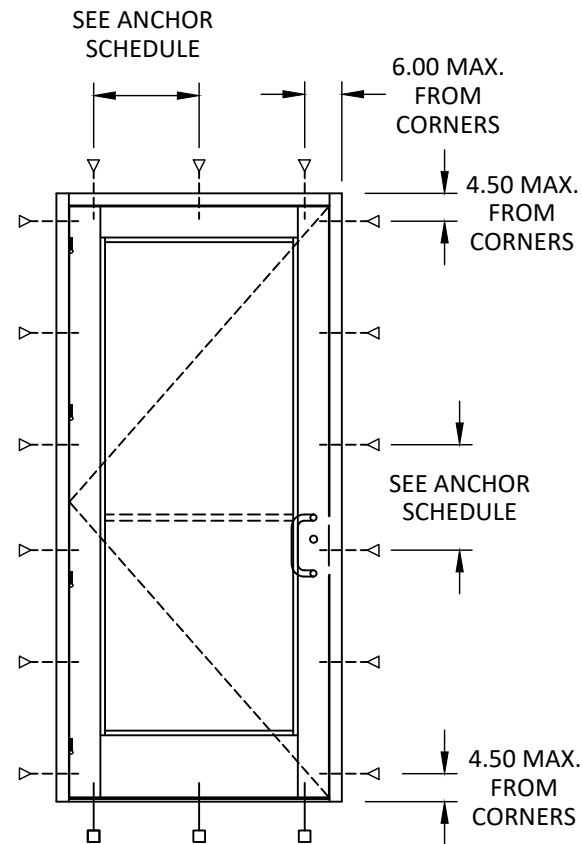

ANCHOR LAYOUT
THROUGH FRAME
OUTSWING DOOR

ANCHOR SCHEDULE						
METHOD	SUBSTRATE	ANCHOR SCHEDULE	MIN EMBEDMENT	MIN. EDGE DISTANCE	MAX. SPACING HEAD & SILL	MAX. SPACING JAMB
THROUGH FRAME	WOOD MIN. SG = 0.55	#14 WOOD SCREW	1.5"	0.75"	38	29
	18 GAUGE STEEL, MIN. Fy = 33KSI	#14 TEK SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.75"	38	44
	CONCRETE f'c = 3000PSI	1/4" ITW TAPCON	1.75"	2.5"	38	29
	CMU per ASTM C90	1/4" ITW TAPCON	1"	2.5"	38	29
	ALUMINUM 1/16" THICK 6063-T5	1/4" SELF DRILLING OR SELF TAPPING SCREW GRADE 5	3 THREADS MIN PENETRATION BEYOND METAL	0.7500	38	44



Quality
inspires™

YKK AP AMERICA, Inc.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (478)277-1955 FAX: (678)838-6001

TITLE:
50M MONUMENTAL (HD)
ENTRANCE SYSTEM
(NON-HVHZ) (NON-IMPACT)
ELEVATION, ANCHOR LAYOUTS
& SCHEDULE


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-9478
FAX: (954)744.4738
WEB: www.buildingdrops.com



BUILDING DROPS

REMARKS	BY	DATE
JAMB PROFILE UPDATE	MS	MAY/22
2026 FBC UPDATE	SH	07.06.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

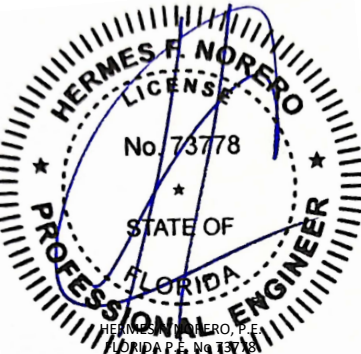

HERMES F. NORERO, P.E.
FLORIDA P.E. NO. 73778
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL12892

DATE: **08.23.17**

DWG. BY: **EG**CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **YKK221**





SHEET:
3

REV.
B

OF 7



c:\users\sebastianherrerros\desktop\ykk 2026 ca\112892\ykk221.dwg 7/24/2026 9:56 AM

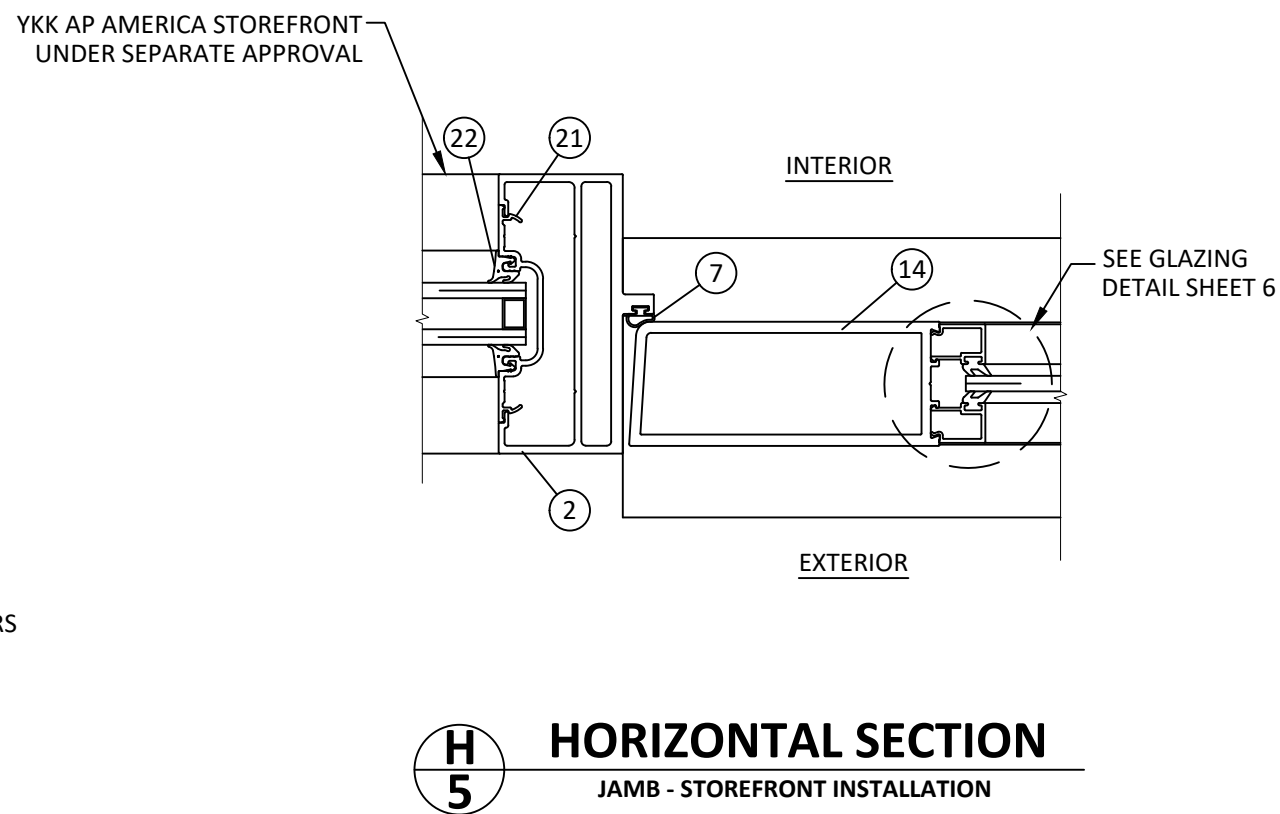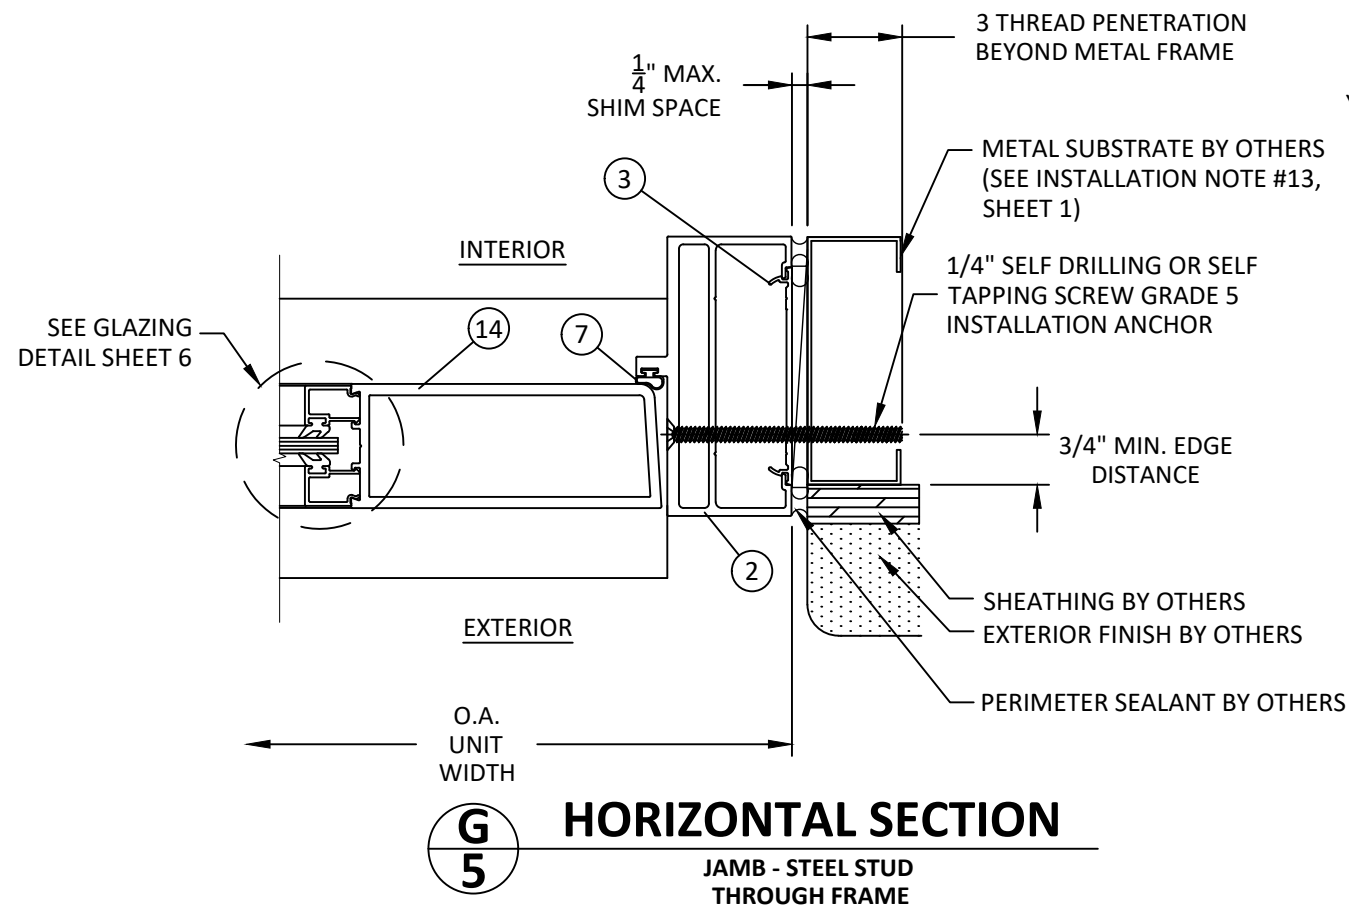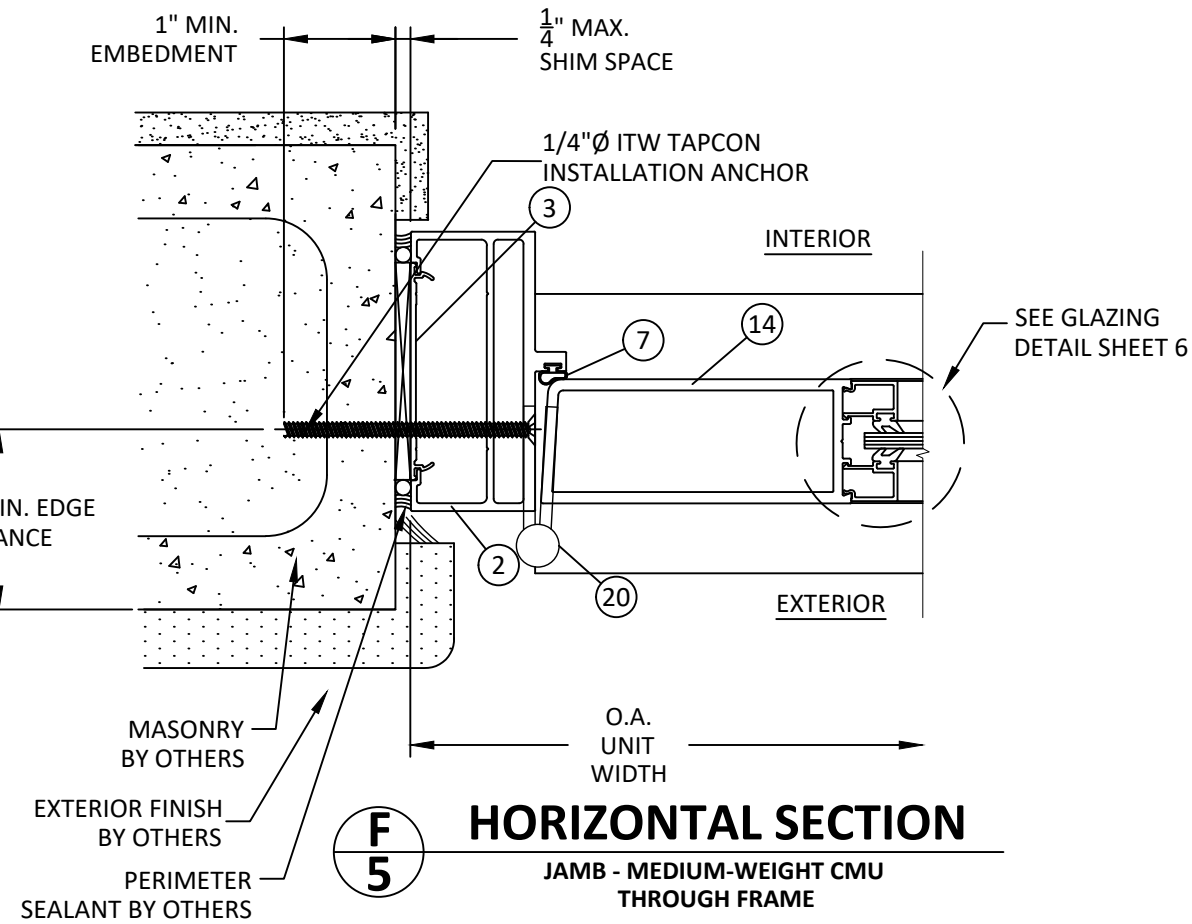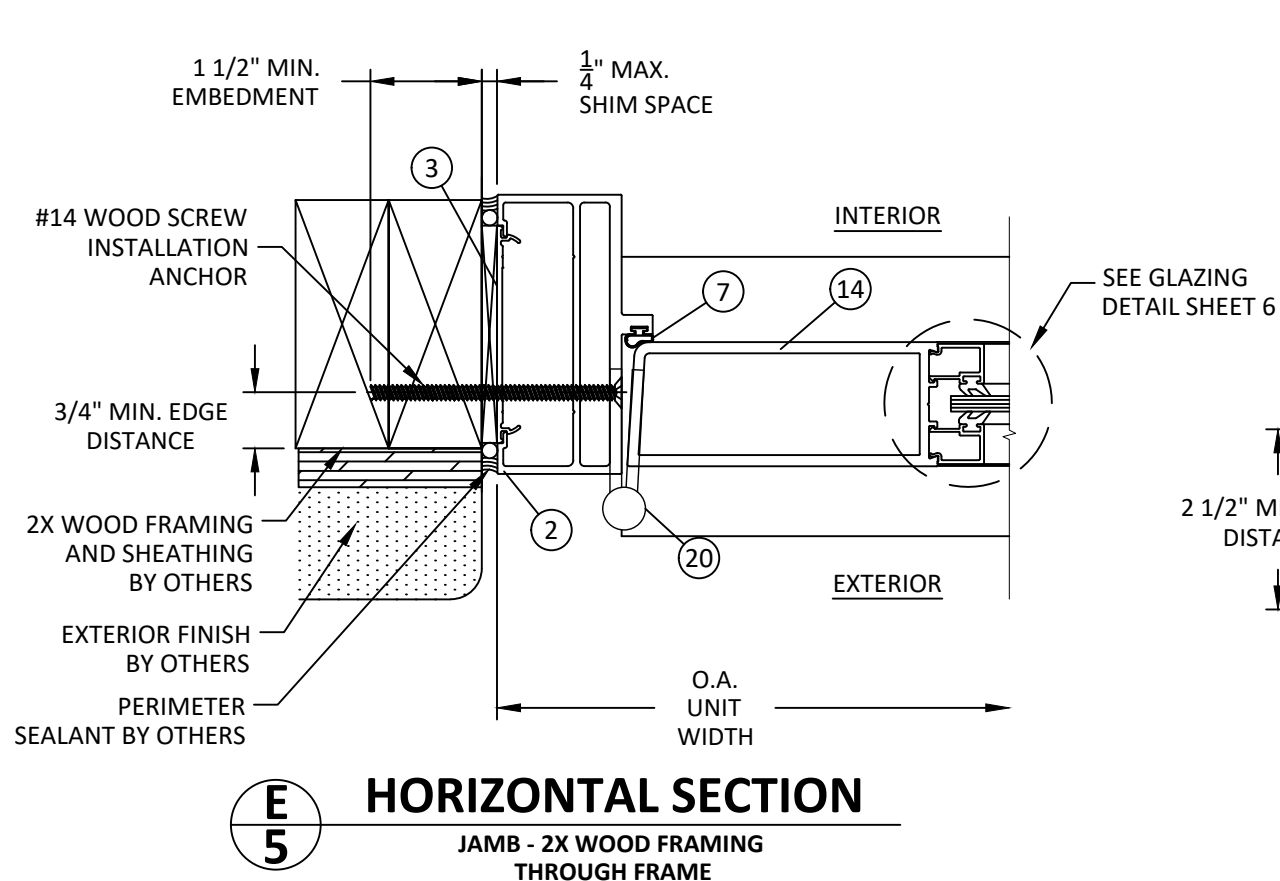

YKK AP AMERICA, Inc.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (478)277-1955 FAX: (678)838-6001


TITLE:
50M MONUMENTAL (HD)
ENTRANCE SYSTEM
(NON-HVHZ) (NON-IMPACT)
HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-9478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
JAMB PROFILE UPDATE	MS	MAY/22
2026 FBC UPDATE	SH	07.06.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

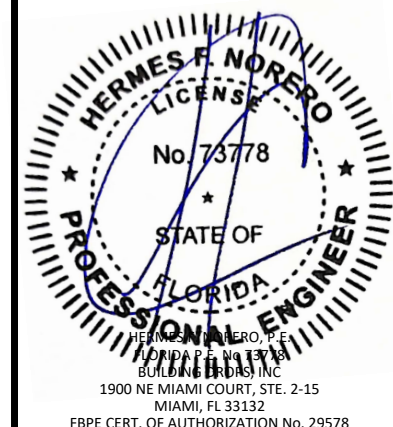

FL #:
FL12892


DATE: **08.23.17**

DWG. BY: **EG** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **YKK221**

SHEET: **5** REV. **B**

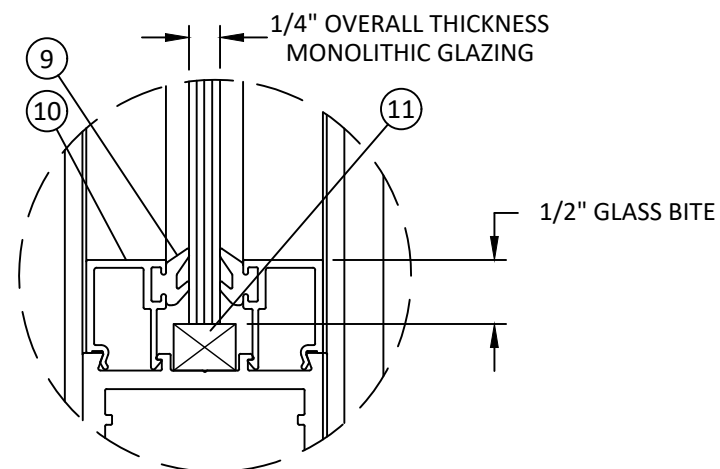


GLAZING DETAIL


1. GLASS TYPE AND THICKNESS SHALL COMPLY WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. THICKNESS, TEMPER, AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
3. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
4. D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES IN GLASS CHARTS.




ITEM	PART NO.	DESCRIPTION	MATERIAL	MANUFACTURER
1	E9-0467	DOOR HEAD O/P	6063-T5	YKK AP
2	E9-0466	DOOR JAMB O/P	6063-T5	YKK AP
3	E1-1054	FLAT FILLER	6063-T5	YKK AP
4	E9-0375	5" TOP RAIL	6063-T5	YKK AP
5	E9-0347	DOOR SWEEP BASE	6063-T5	YKK AP
6	E9-0348	DOOR SWEEP COVER	6063-T5	YKK AP
7	E2-0051	AIRTIGHT GASKET	SANTOPRENE	---
8	E2-0067	AIRTIGHT GASKET FOR DOOR SWEEP	EPDM	---
9	E2-0050	DOOR GASKET	EPDM	---
10	E9-0356	1/4" GLASS STOP	6063-T5	YKK AP
11	E2-0054	DOOR SETTING BLOCK (1/4")	EPDM	---
12A	E9-0355	7-1/2" BOTTOM RAIL	6063-T5	YKK AP
12B	E9-0359	10" BOTTOM RAIL	6063-T5	YKK AP
13	E9-0433	4-1/2" THRESHOLD	6063-T5	YKK AP
14	E9-0378	HINGE STILE	6063-T5	YKK AP
15	E9-0377	MEETING STILE (INACTIVE)	6063-T5	YKK AP
16	E9-0332	MEETING STILE COVER	6063-T5	YKK AP
17	E9-0376	MEETING STILE (ACTIVE)	6063-T5	YKK AP
18	E2-0087	DOOR WEATHERSEAL	POLYPROPYLENE	---
20	P-1303-HP	HINGE	---	---
21	E9-1012	SHALLOW POCKET FILLER	6063-T5	YKK AP
22	E2-0052	GASKET	EPDM	---

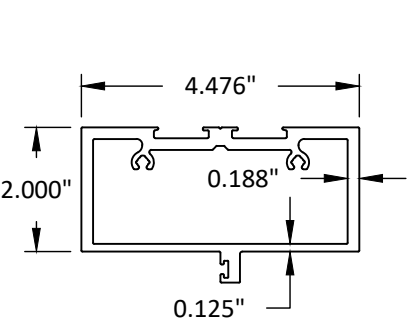


1 DOOR HEAD O/P

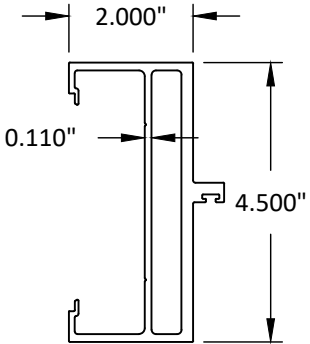


2 DOOR JAMB O/P

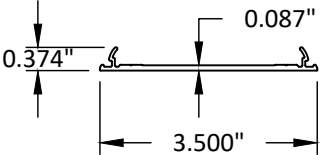


3 FLAT FILLER

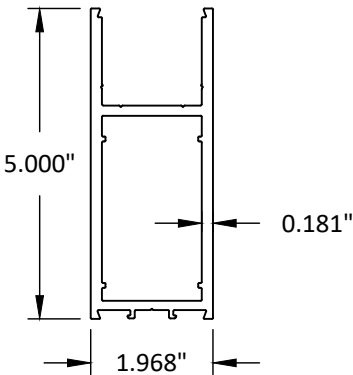


4 5" TOP RAIL



5 DOOR SWEEP BASE (OPTIONAL)

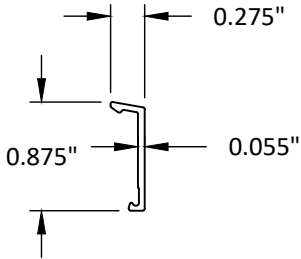


6 DOOR SWEEP COVER (OPTIONAL)

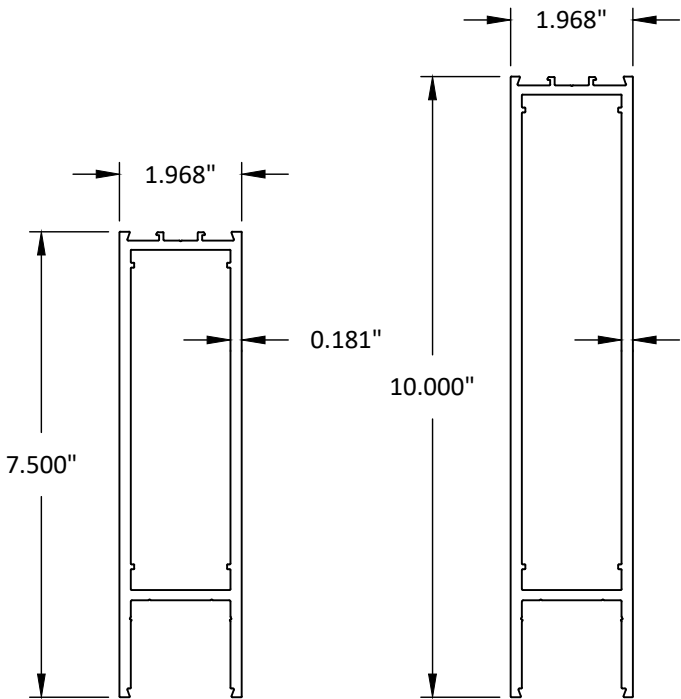


12A 7-1/2" BOTTOM RAIL


12B 10" BOTTOM RAIL

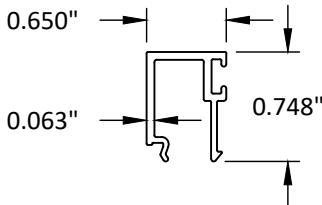


10 1/4" GLASS STOP

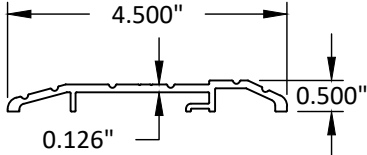


13 4-1/2" DOOR THRESHOLD

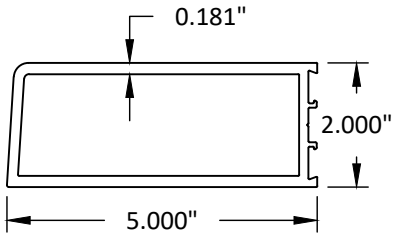


14 HINGE STILE

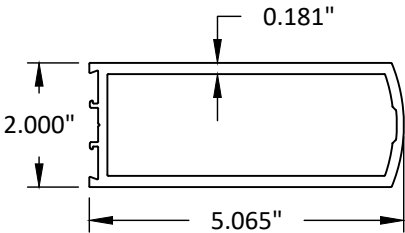


15 MEETING STILE (INACTIVE)



16 MEETING STILE COVER

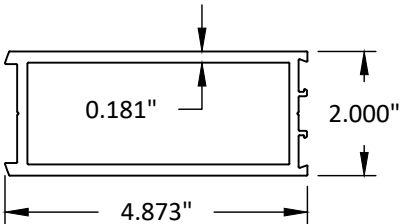

17 MEETING STILE (ACTIVE)

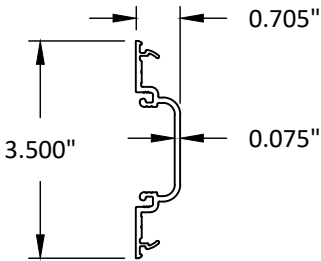

21 SHALLOW POCKET FILLER



YKK AP AMERICA, Inc.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (478)277-1955 FAX: (678)838-6001

TITLE:
50M MONUMENTAL (HD)
ENTRANCE SYSTEM
(NON-HVHZ) (NON-IMPACT)
COMPONENTS & BILL OF MATERIALS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

PH: (954)399-9478

FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS

BY

DATE

JAMB PROFILE UPDATE

MS

MAY/22

2026 FBC UPDATE

SH

07.06.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:
FL12892

DATE: **08.23.17**

DWG. BY:
EG

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **YKK221**

SHEET:

7

REV.

B

OF 7