

GENERAL NOTES:

1. ALL FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS. SPECIFIED ANCHOR EMBED TO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.
2. OPENINGS, BUCKING & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE.
3. THESE NON-IMPACT RATED PRODUCT INSTALLATIONS ARE IN ACCORDANCE WITH AND MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (FBC).
4. ALL ANCHORS SECURING PRODUCT FRAMES TO PRESSURE TREATED BUCKS OR WOOD FRAMING SHALL BE CAPABLE OF RESISTING CORROSION CAUSED BY THE PRESSURE TREATING CHEMICALS IN THE WOOD.
5. MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF FLORIDA BUILDING CODE CHAPTER 20.
6. TO THE BEST OF OUR KNOWLEDGE, THE PRODUCT SHOWN HEREIN IS CERTIFIED & QUALITY ASSURED BY A FLORIDA STATE APPROVED CERTIFICATION/QA ENTITY & SHALL BE LABELED IN ACCORDANCE WITH THE FBC AND THE FLORIDA DEPARTMENT OF BUSINESS & PROFESSIONAL REGULATION SPECIFICATIONS. PRODUCT ASSEMBLY IS NOT PART OF THIS DRAWING AND SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S QUALITY ASSURANCE SPECIFICATIONS & TESTING REPORTS.
7. CERTIFICATION OF THESE PRODUCT INSTALLATIONS SHALL BE CONSIDERED VOID IF ANY OF THE FOLLOWING APPLY: 1) PRODUCT IS INSTALLED WITHOUT A BUILDING PERMIT FROM THE APPLICABLE LOCAL BUILDING DEPARTMENT. 2) PRODUCT IS INSTALLED BY ANYONE OTHER THAN A LICENSED CONTRACTOR EXPERIENCED WITH INSTALLATIONS OF THIS TYPE OF PRODUCT. 3) IF CHANGES HAVE OCCURRED TO THE PRODUCT'S CERTIFICATION ENTITY'S CERTIFICATE THAT CAUSE THESE INSTALLATIONS TO BE INCORRECT OR INCONSISTENT WITH WHAT HAS BEEN TESTED.
8. THE LEAST DESIGN PRESSURE SPECIFIED EITHER IN THIS DRAWING OR IN THE PRODUCTS CERTIFICATION SHALL CONTROL FOR THE INSTALLED PRODUCT.
9. THESE DRAWINGS CERTIFY THE PRODUCT INSTALLATION ONLY. WATER PROOFING OF THE INSTALLED PRODUCT IS NOT PART OF THIS INSTALLATION CERTIFICATION. THAT RESPONSIBILITY SHALL BE THAT OF THE MANUFACTURER &/OR INSTALLER.

INSTALLATION EVALUATION IS BASED ON APPLICABLE ANCHOR STANDARDS AND/OR INFORMATION & RESULTS FROM APPLICABLE TEST REPORTS. THE FLORIDA BUILDING CODE VERSION CONSIDERED WITH THE EVALUATION WAS THAT IN FORCE AT THE TIME OF THE EVALUATION. IN THE EVENT OF CODE VERSION CHANGES/UPDATES OR IN THE EVENT THAT NEW OR ADDITIONAL TESTING IS COMPLETED ON THE REFERENCED PRODUCT, PRIOR TO STATING CODE COMPLIANCE WITH THE STATE, THE MANUFACTURER SHALL CONFIRM WITH THE INSTALLATION EVALUATION ENGINEER OF RECORD THAT THE INSTALLATIONS SPECIFIED HERE-IN ARE CURRENT WITH THE THEN CURRENT TESTING, CODE AND APPLICABLE STANDARDS.

FRAME ANCHOR REQUIREMENTS TABLE

(3) FRAME SCREWS

OPENING TYPE (SUBSTRATE)	FRAME TO OPENING FASTENER TYPE	MINIMUM EMBED	MINIMUM EDGE DIST.
MIN. 2X4 WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	NO. 10 SMS OR WOOD SCREW	1 1/4"	3/4"
MIN. 18 GA. 33 KSI METAL STUD	NO. 10 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. 1/8" THK A36 STEEL	NO. 10 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. 1/8" THK 6063-T5 ALUM.	NO. 10 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
C-90 CMU/2500 PSI CONCRETE	(1) 1/4" CONCRETE SCREW	1 1/4"	2"


(2) NAILING FIN FASTENERS

MIN. 2X4 WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	NO. 8 SMS OR WOOD SCREW	1 3/8"	1/2"
MIN. 2X4 WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	2" X 11 GA. ROOFING NAIL	1 7/8"	1/2"
MIN. 1/8" THK A36 STEEL	NO. 8 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. 1/8" THK 6063-T5 ALUM.	NO. 8 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"

- (1) CONCRETE SCREWS SHALL BE ELCO ULTRACONS (C.S.), ELCO CRETE-FLEX (S.S.), ITW RAMSET/RED HEAD TAPCONS (C.S. OR S.S.) OR HILTI KWIK-CON II (C.S. OR S.S.).
- (2) WHEN SCREWS ARE USED WITH THE NAIL FIN, THEY MUST BE A WAFFLE HEAD SCREW OR HAVE A FLAT WASHER AT THE SCREW HEAD.
- (3) FRAME SCREWS MUST BE A PAN OR HEX HEAD SCREW.

EXTERIOR ELEVATION: SINGLE WINDOW

SCALE: 3/4" = 1'-0"
(NAIL FIN MOUNT CONDITION)

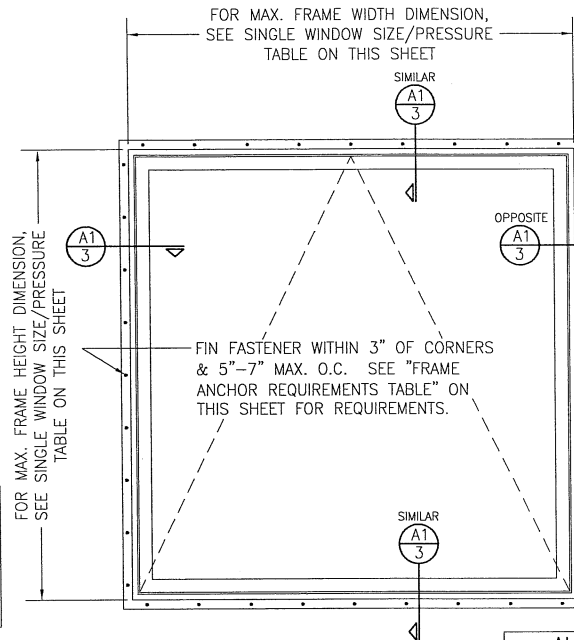

ALLOWABLE SINGLE WINDOW SIZE/PRESSURE TABLE

MAXIMUM FRAME WIDTH DIMENSION (IN.)	MAXIMUM FRAME HEIGHT DIMENSION (IN.)	ALLOWABLE PRESSURE (+/- PSF)
41 1/2	59 1/2	50
53 1/2	29 1/2	50
59 1/2	59 1/2	30


CONDITIONS SHOWN ON THIS DRAWING ARE GOVERNED BY INSTALLATION REQUIREMENTS ONLY. THE GOVERNING CONDITIONS ON ANY SPECIFIC WINDOW SHALL BE THE LESSER OF THOSE SPECIFIED IN THE WINDOWS STATE APPROVAL OR THAT SHOWN IN THESE DRAWINGS.

ALTERNATE ANCHOR/SUBSTRATE EVALUATION NOTE:


ALL ALTERNATE ANCHORS IN THEIR SPECIFIED SUBSTRATES HAVE BEEN ANALYZED IN ACCORDANCE WITH THEIR APPLICABLE STANDARD(S) AND ARE FOUND TO BE EQUIVALENT TO OR STRONGER THAN THE ANCHOR(S) USED IN TESTING WITH THIS PRODUCT.

EXTERIOR ELEVATION: SINGLE WINDOW


SCALE: 3/4" = 1'-0"
(STANDARD FRAME SCREW MOUNT CONDITION)

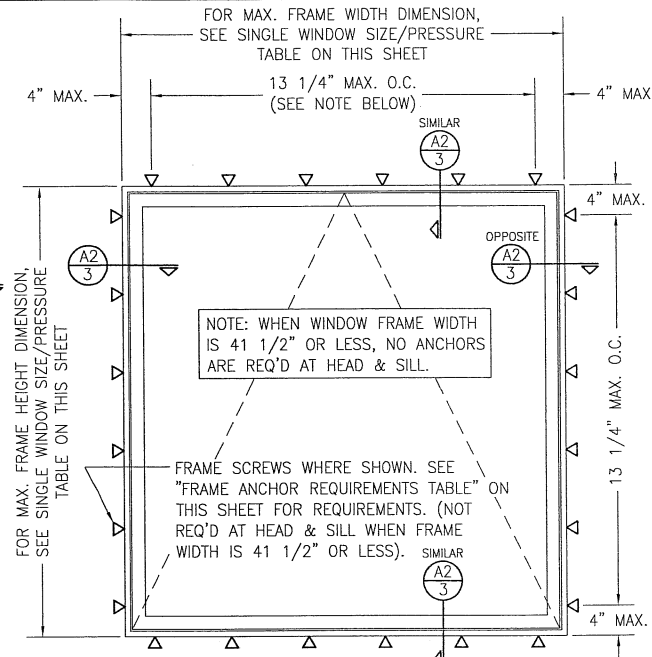

THESE DRAWINGS ARE APPLICABLE ONLY TO THE PRODUCT SPECIFIED. THEY MAY NOT BE USED FOR THE ASSEMBLY AND/OR INSTALLATION OF ANY OTHER PRODUCT NOR MAY THEY BE USED FOR RATIONAL AND/OR LOCAL APPROVAL OF ANY PRODUCT NOT PRODUCED BY THE MANUFACTURER LISTED ON THESE DRAWINGS.



DRAWN BY: W.R.M.		CHECKED BY: W.W.S.	
PLOT: 1-18		DATE: 08/11/08	
DATE	BY	REVISION DESCRIPTION	NO.
02/18/13	W.R.M.	A1 UPDATE TO CURRENT STANDARDS	1
08/14/13	W.R.M.	B1 UPDATE PER NEW TESTING	2
10/27/18	W.W.S.	C1 UPDATE TO CURRENT STANDARDS	3
07/28/19	W.W.S.	D1 CHANGE FRAME PROFILE & ADD OPTIONAL INSTALLATION ELEVATION	4
DRAWING TITLE: IMPERVA NON-IMPACT AWNING WINDOW MANUFACTURER: PELLA CORPORATION CONSULTANTS: W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809) 7480 150TH COURT NORTH, 33418 PALM BEACH GARDENS, FL PHONE: 561-744-3424 REV. 1676 D SHEET NO. 1 OF 3			

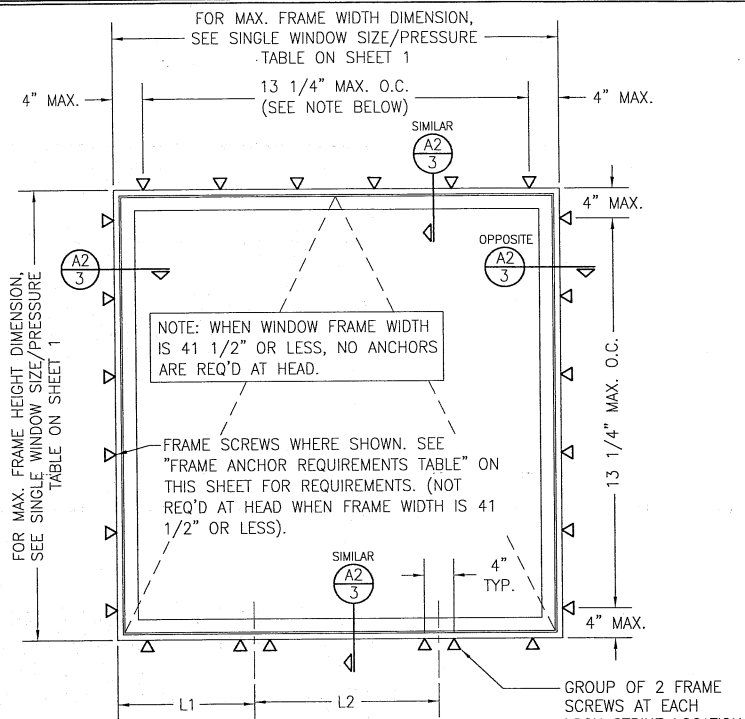


**EXTERIOR ELEVATION:
SINGLE WINDOW**

SCALE: 3/4" = 1'-0"
(ALTERNATE FRAME SCREW MOUNT CONDITION
FOR STANDARD AWNINGS WITH SILL LOCKS)

LOCK LOCATION TABLE (STANDARD AWNING)		
MAX. FRAME WIDTH (IN.)	L1 (IN.)	L2 (IN.)
27.5	12.8	N/A
29.5	12.8	8.0
35.5	12.8	10.5
41.5	12.8	16.5
47.5	12.8	22.5
53.5	12.8	28.5
59.5	12.8	34.5

"N/A" = NO LOCK AT THAT LOCATION

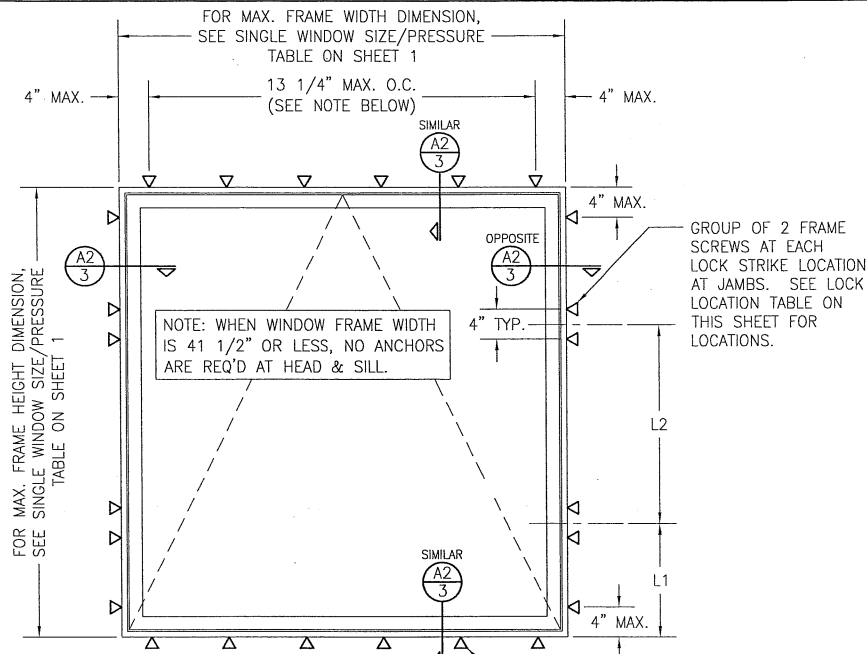


**EXTERIOR ELEVATION:
SINGLE WINDOW**


SCALE: 3/4" = 1'-0"
(ALTERNATE FRAME SCREW MOUNT CONDITION
FOR LARGE AWNINGS WITH JAMB LOCKS)

LOCK LOCATION TABLE (LARGE AWNING)		
MAX. FRAME HEIGHT (IN.)	L1 (IN.)	L2 (IN.)
35.5	12.8	N/A
41.5	12.8	N/A
47.5	12.8	10.5
59.5	12.8	10.5

"N/A" = NO LOCK AT THAT LOCATION




DRAWN BY: W.W.S.		CHECKED BY: W.W.S.	
PLOT: 1=16		DATE: 08/11/09	
DATE	BY	NO.	REVISION DESCRIPTION
DRAWING TITLE: IMPERVA NON-IMPACT AWNING WINDOW			
CONSULTANTS:		MANUFACTURER:	
W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809) 7480 150TH COURT NORTH PALM BEACH GARDENS, FL 33418 PHONE 561-744-3424		PELLA CORPORATION 102 MAIN STREET PELLA, IA 50219 641-621-1000	
DRAWING NO. 1676		REV. D	
SHEET NO. 2		OF 3	

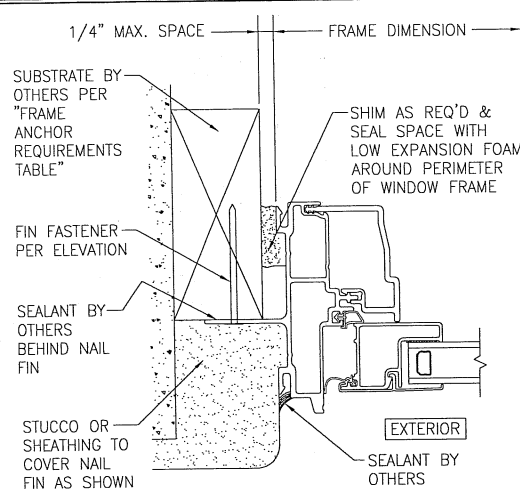


SECTION
SCALE: 1/2 FULL

INTEGRAL NAIL FIN MOUNT CONDITION SHOWN.
SEE DETAIL ON THIS SHEET FOR SLIDE-IN
NAIL FIN MOUNT CONDITION.

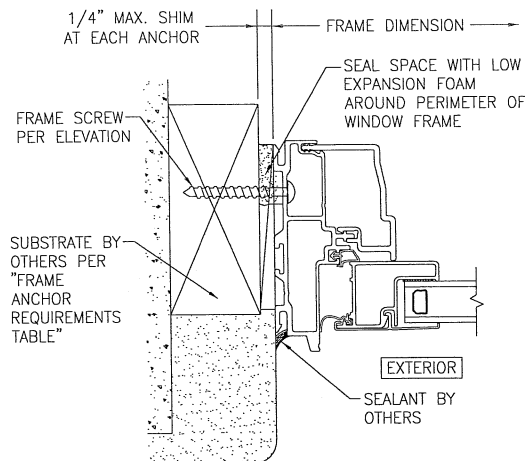


SECTION
SCALE: 1/2 FULL


TYPICAL FRAME SCREW MOUNT CONDITION
SHOWN. SEE DETAILS ON THIS SHEET FOR
FLANGED FRAME & DIRECT MOUNT CONDITIONS.

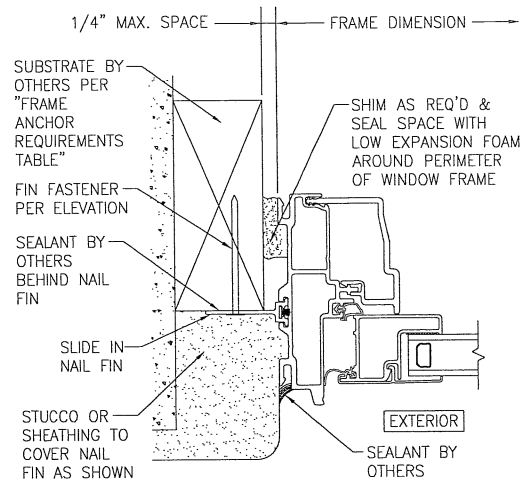


OPTIONAL SLIDE-IN NAIL FIN INSTALLATION DETAIL
(SIDE SECTION SHOWN. HEAD & SILL ARE INSTALLED THE SAME.)

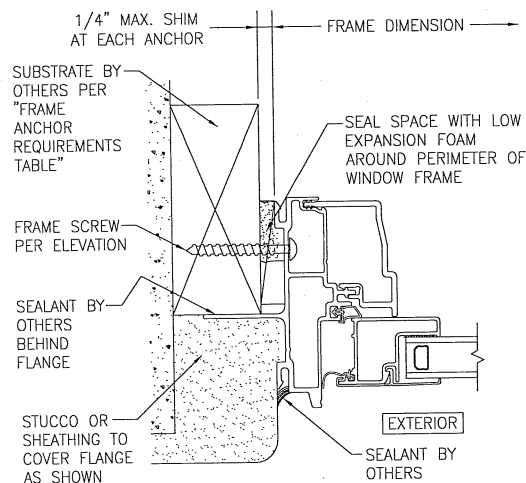


OPTIONAL FLANGED FRAME INSTALLATION DETAIL
(SIDE SECTION SHOWN. HEAD & SILL ARE INSTALLED THE SAME.)

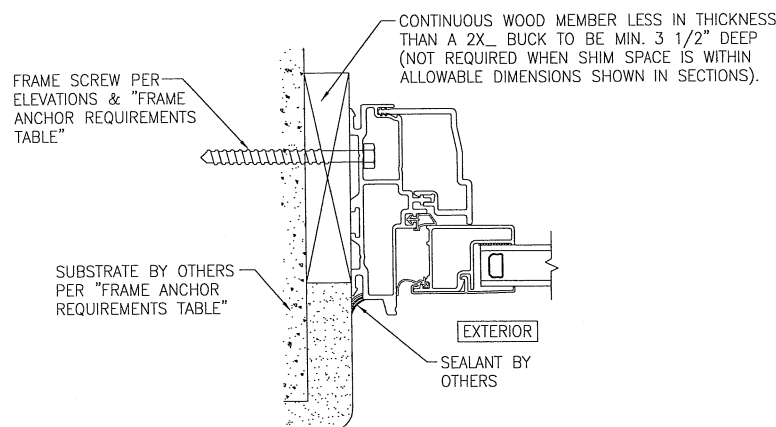

OPTIONAL DIRECT MOUNT DETAIL
TO SUBSTRATE WITH SPACER
(SIDE SECTION SHOWN. HEAD & SILL ARE INSTALLED THE SAME.)



RIGID PVC SLIDE-IN NAIL FIN



DRAWN BY: W.R.M.		CHECKED BY: W.W.S.	
PLOT: 1=2		DATE: 08/11/09	
NO.	REVISION	DESCRIPTION	DATE
DRAWING TITLE: IMPERVIA NON-IMPACT AWNING WINDOW MANUFACTURER: PELLA CORPORATION 102 MAIN STREET PELLA, IA 50219 641-621-1000 CONSULTANTS: W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809) 7480 150TH COURT NORTH PALM BEACH, FL 33418 PHONE: 561-744-3424 DATE: JAN 28 2019 WARREN W. SCHAEFER, P.E. P.E. NO. 44135			
DRAWING NO. 1676		REV. D	
SHEET NO. 3		OF 3	