
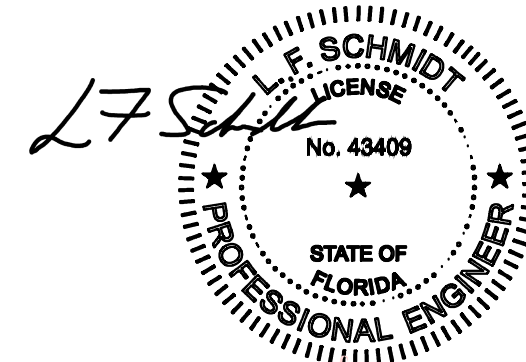
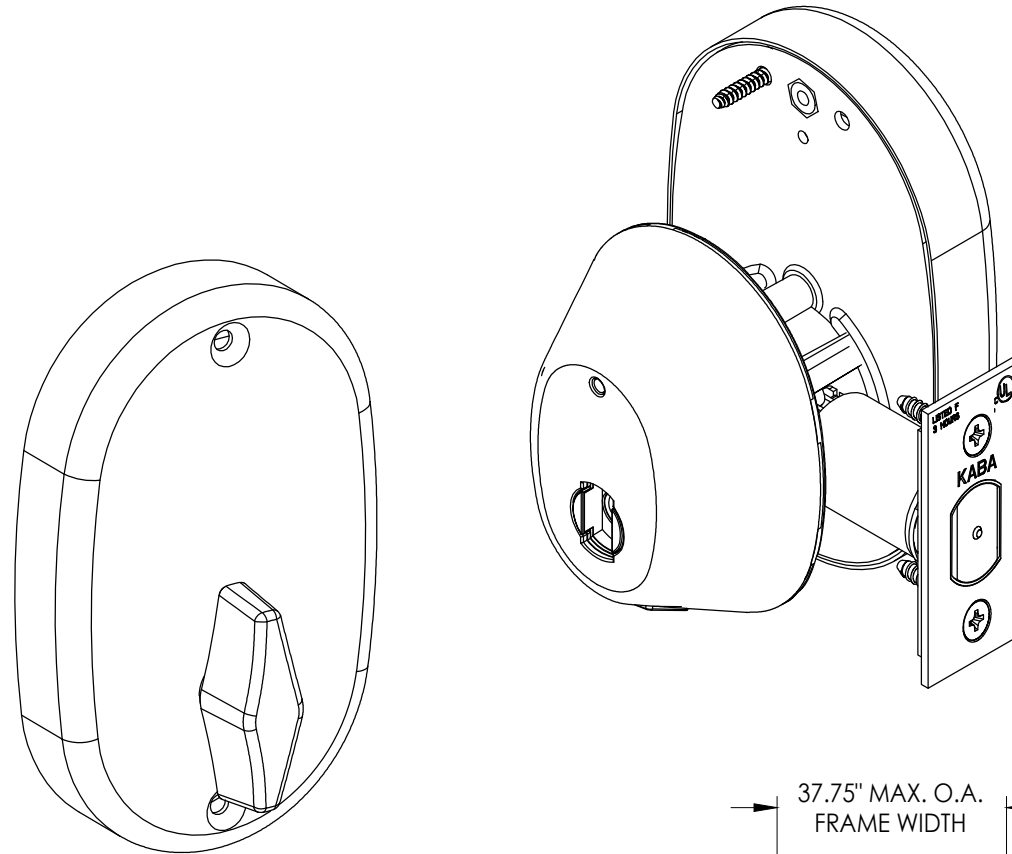


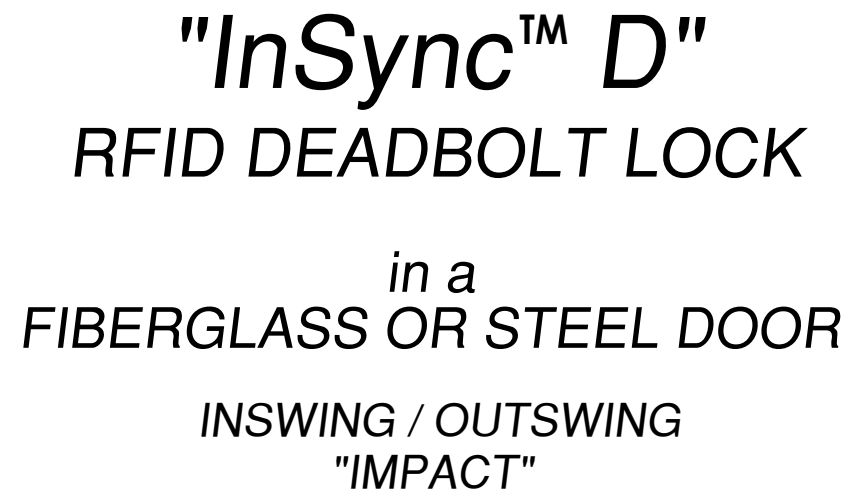


This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

1. This product has been evaluated and is in compliance with the 8th Edition (2023) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. When used in areas requiring wind borne debris protection, this product complies with FBC Sections 1609.1.2 & R301.2.1.2. and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E 1996 and FBC Sections 1609.1.2.2 & R301.2.1.2.1.
3. This product has been tested in the door panels as specified in this approval. Substitution into a similar product may be approved for use by the local Authority Having Jurisdiction. In all cases, the steel or fiberglass door used must possess a comparable current Florida Statewide product approval. The door panel size and design pressure (DP) rating shall not exceed the sizes and DP ratings shown in this approval or the side hinged swing door approval being used.
4. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS	
SHEET#	DESCRIPTION
1	Typical elevation, design pressures & general notes
2	Lock details
3	Door panel details

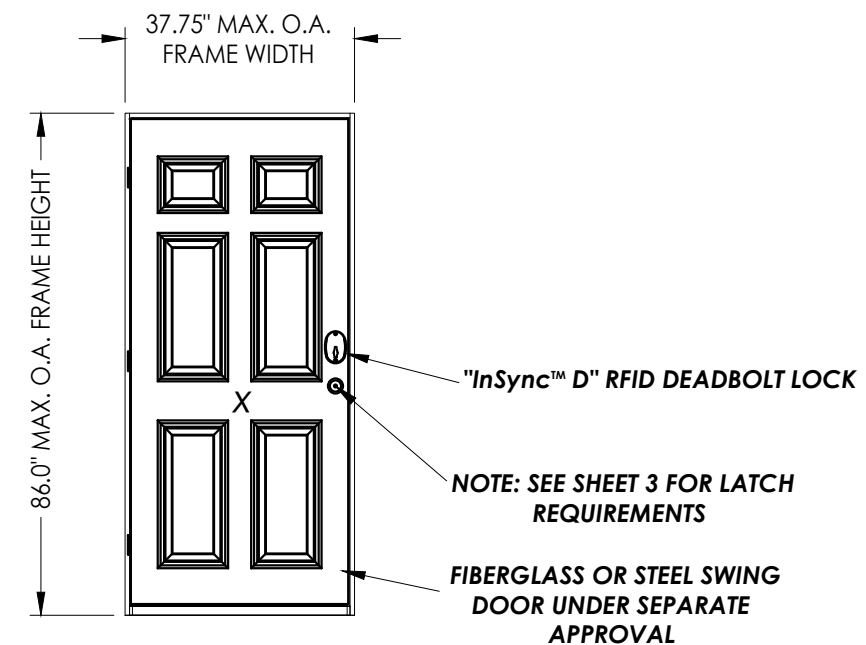

MAX FRAME DIMENSION	LOCK TYPE	DOOR MATERIAL	DESIGN PRESSURE (PSF)			
			INSWING		OUTSWING	
			POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
37.75" x 86.0"	"InSync™ D" RFID DEADBOLT LOCK	FIBERGLASS	+65.0	-75.0	+65.0	-65.0
		STEEL (STEEL EDGE)	+65.0	-75.0	+65.0	-65.0
		STEEL (WOOD EDGE)	N/A	N/A	+65.0	-65.0

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


PRODUCT: KABA
RFID LOCK

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33486



PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

DATE:		6/4/14	
SCALE:		N.T.S.	
DWG. BY:		JK	
CHK. BY:		LFS	
DRAWING NO.:		FL-13061.5	
SHEET		1	OF 3



Z:\2023 FBC Drawings\dormakaba Canada\FL-13061 R16\FL-13061.5--8.dwg

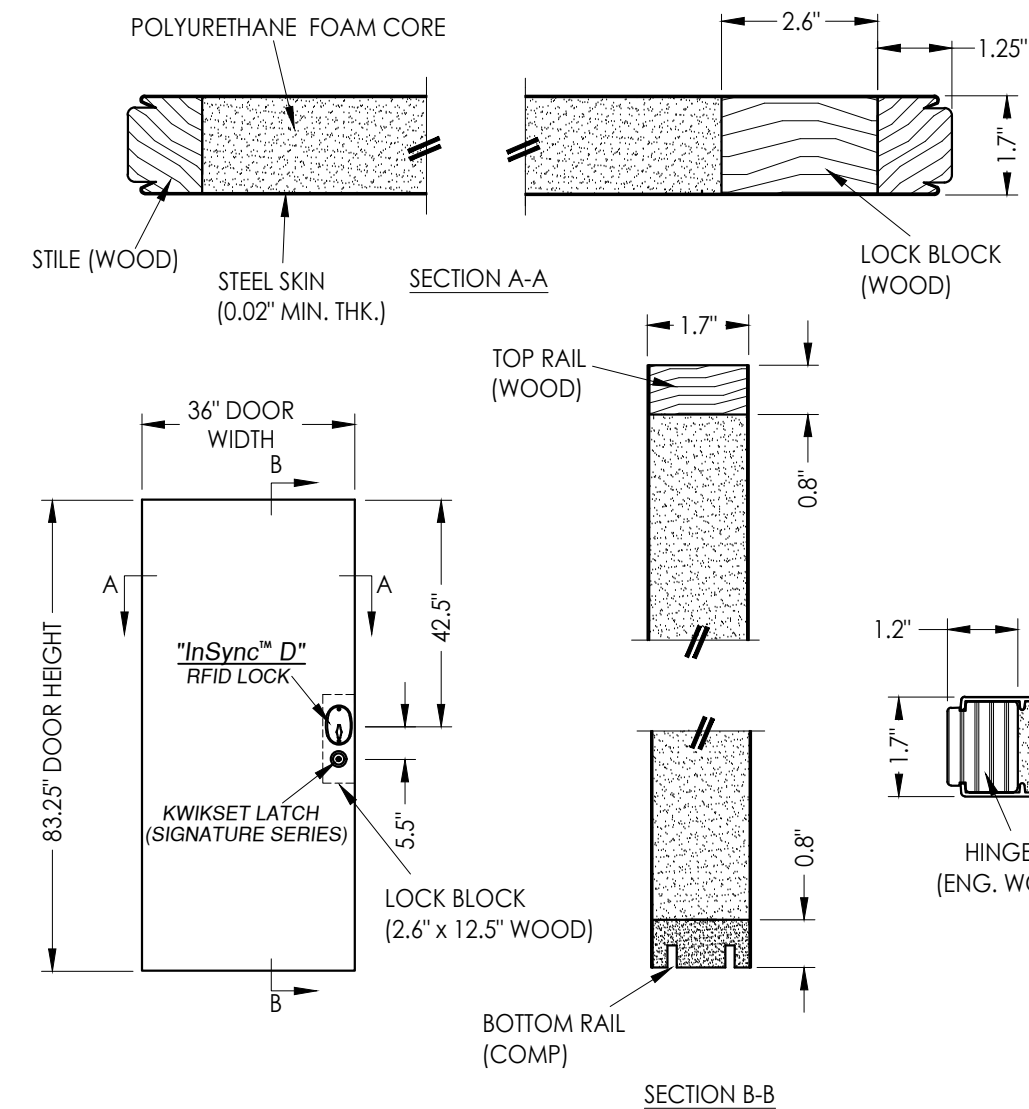

STEEL DOOR PANEL
Therma-Tru 7' 0" (Wood Edge)
DOOR TESTED w/ Kwikset Signature Series Latch

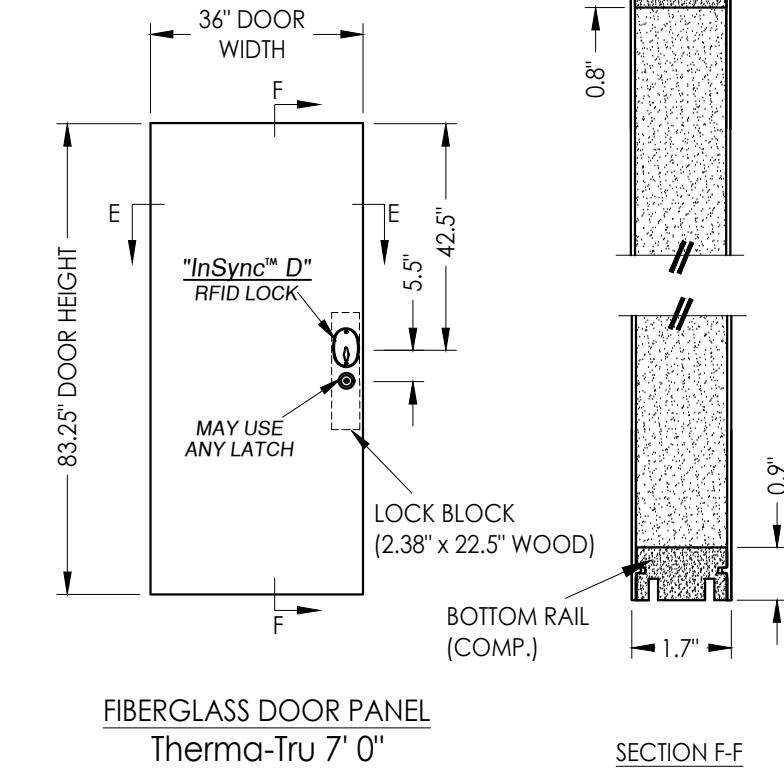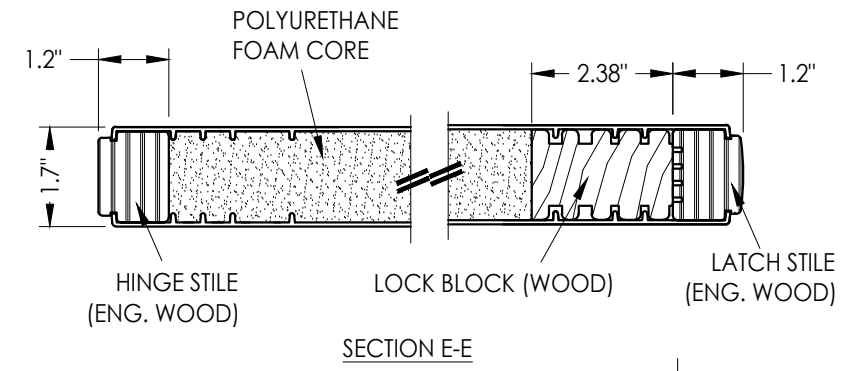

FIBERGLASS DOOR PANEL
Therma-Tru 7' 0"
DOOR TESTED WITHOUT LATCH - MAY USE ANY LATCH

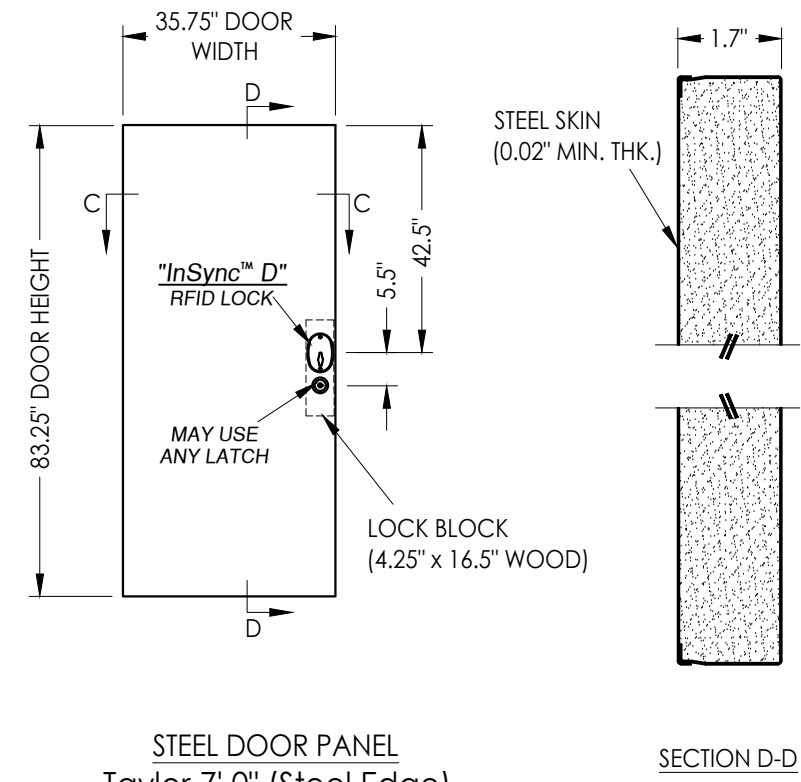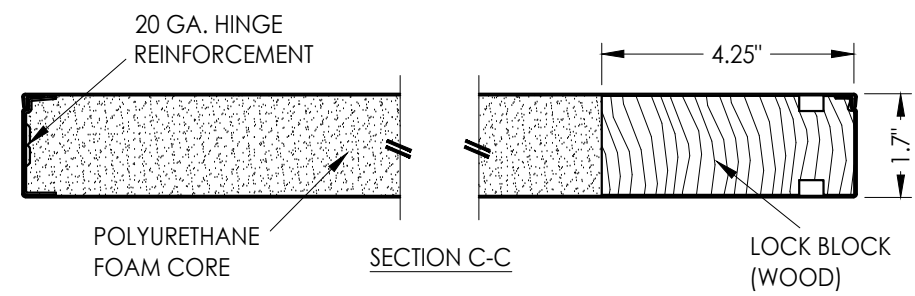

STEEL DOOR PANEL
Taylor 7' 0" (Steel Edge)
DOOR TESTED WITHOUT LATCH - MAY USE ANY LATCH

NOTE: Door panels shown as tested. Refer to current Florida Statewide Product Approval for actual specifications and installation instructions (See General Note 3, Sheet 1).

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
KABA
RFID LOCK

PART OR ASSEMBLY:
KABA
RFID LOCK

DOOR PANELS DETAILS

NO.	DATE	REVISIONS
4	8/31/23	UPDATE TO 8TH ED. (2023) FBC
3	9/28/20	UPDATE TO 7TH ED. (2020) FBC
2	10/19/17	UPDATE TO 6TH ED. (2017) FBC
1	8/31/15	UPDATE TO 5TH ED. (2014) FBC

DATE: 6/4/14

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-13061.5

SHEET 3 OF 3

© 2014 R.W. BUILDING CONSULTANTS INC.

RWBUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813