



Product Evaluation Report
R & R ROOFING OF BREVARD, INC.

SL1000 24 Ga. Snap Lock Roof Panel over Plywood

Florida Product Approval # 13314.1 R6

Florida Building Code 2026
Per Rule 61G20-3
Method: 1 –D

Category: Roofing
Subcategory: Metal Roofing
Compliance Method: 61G20-3.005(1)(d)
NON HVHZ

Product Manufacturer:


R & R Roofing
996 Creel Street
Melbourne, Florida 32935

Engineer Evaluator:

Johnathan Green, P.E. #88223
Florida Evaluation ANE ID: 12901

Contents:

Evaluation Report: Page 1 - 3
Installation Detail: Page 4, 5

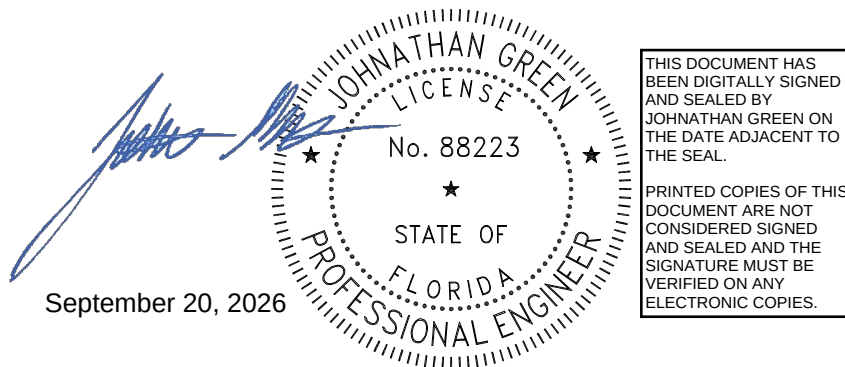

THIS DOCUMENT HAS
BEEN DIGITALLY SIGNED
AND SEALED BY
JOHNATHAN GREEN ON
THE DATE ADJACENT TO
THE SEAL.

PRINTED COPIES OF THIS
DOCUMENT ARE NOT
CONSIDERED SIGNED
AND SEALED AND THE
SIGNATURE MUST BE
VERIFIED ON ANY
ELECTRONIC COPIES.



Compliance Statement: The product as described in this report has demonstrated compliance with the Florida Building Code 2026, Sections 1504.3.2.

Product Description: Snap Lock Roof Panel, 24 Ga. steel, 17" Wide, Roof Panel restrained with fixed clips into 15/32" APA Plywood decking. Non-structural Application.

Panel Material/Standards: Material: 24 Ga. Steel conforming to Florida Building Code 2026 Section 1507.4.3
 Yield Strength: Min. 50 ksi
 Corrosion Resistance: Panel Material shall comply with Florida Building Code 2026, Section 1507.4.3

Panel Dimension(s): Thickness: Min. 0.024"
 Width: 17" Max coverage
 Rib Height: 1"
 Panel Seam: Snap Lock
 Panel Rollformer: Zimmerman Metals, Inc.

Roof Panel Clips: Product Name: 1" DMPSLZ
 Material: 24 Ga. Steel
 Type: Fixed
 Thickness: 0.024"
 Dimensions: 3" long
 Corrosion Resistance: Per Florida Building Code 2026 Section 1506.7 and Section 1711 for installations within 3000 ft. of a saltwater coastline.

Panel Clip Fastener: (2) #10-12 x 1" Pancake Type A
 Corrosion Resistance: Per Florida Building Code 2026 Section 1506.6, 1507.4.4 and Section 1711 for installations within 3000 ft. of a saltwater coastline.

Substrate Description: Min. 15/32" thick, APA Rated plywood over supports at maximum 24" O.C.
 Design of plywood and plywood supports are outside the scope of this evaluation. Substrate must be designed in accordance w/ Florida Building Code.

Allowable Design Uplift Pressures:


Table "A"

Maximum Allowable Design Uplift Pressure:	86.0 psf
Clip Spacing:	12" O.C.
# Fasteners per Clip:	2

*Design Pressure includes a Safety Factor = 2.0.





Code Compliance:	The product described herein has demonstrated compliance with The Florida Building Code 2026, Section 1504.3.2
Evaluation Report Scope:	The product evaluation is limited to compliance with the structural wind load requirements of the Florida Building Code 2026, as relates to Rule 61G20-3.
Performance Standards:	The product described herein has demonstrated compliance with: § UL 580 (2006) - Test for Uplift Resistance of Roof Assemblies § UL 1897 (2015) - Uplift Test for Roof Covering Systems
Reference Data:	1. UL 580-94 / 1897-98 Uplift Test Force Engineering & Testing (FBC Organization # TST-5328) Report No. 380-0114T-11A 2. Certificate of Independence By Johnathan E. Green, P.E. (No. 88223) @ Force Engineering & Testing. (FBC Organization # ANE ID: 1920)
Test Standard Equivalency:	1. The UL 580-94 test standard is equivalent to the UL 580-06 test standard. 2. The UL 1897-98 test standard is equivalent to the UL 1897-2015 test standard.
Quality Assurance Entity:	The manufacturer has established compliance of roof panel products in accordance with the Florida Building Code and Rule 61G20-3.005(1) (d) for manufacturing under a quality assurance program audited by an approved quality assurance entity through.
Minimum Slope Range:	Minimum Slope shall comply with Florida Building Code 2026, including Section 1507.4.2 and in accordance with Manufacturers recommendations.
Installation:	Install per manufacturer's recommended details.
Limitation:	Metal hip and ridge covers are outside the scope of this evaluation report and must be in compliance with FBC 2026 Section 1504.3.1.1 through other product approval.
Underlayment:	Per Florida Building Code 2026, Section 1507.1. and manufacturer's installation guidelines
Roof Panel Fire Classification:	Fire classification is not part of this acceptance.
Shear Diaphragm:	Shear diaphragm values are outside the scope of this report.
Design Procedure:	Based on the dimensions of the structure, appropriate wind loads are determined using Chapter 16 of the Florida Building Code 2026 for roof cladding wind loads. These component wind loads for roof cladding are compared to the allowable pressures listed above. The design professional shall select the appropriate erection details to reference in his drawings for proper fastener attachment to his structure and analyze the panel fasteners for pullout and pullover. Support framing must be in compliance with Florida Building Code 2026 Chapter 22 for steel, Chapter 23 for wood and Chapter 16 for structural loading.

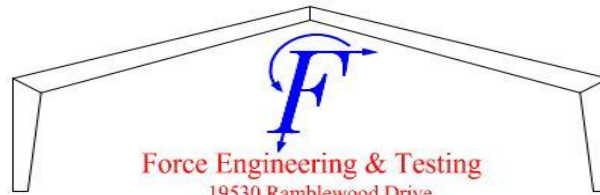


Force Engineering & Testing
19530 Ramblewood Drive
Humble, Texas 77338
Office: (281) 540-6603 Test Lab: (832) 720-4251
www.forceengineeringtesting.com

SL1000 SNAP LOCK 24 GA. STEEL PANEL

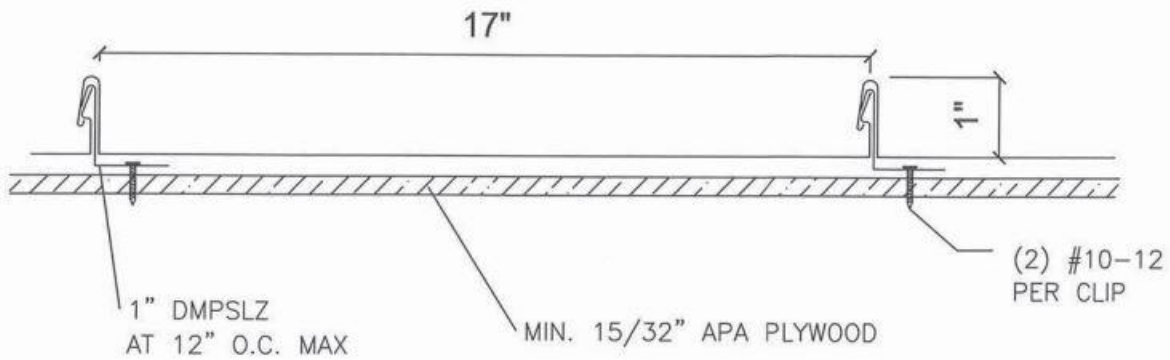


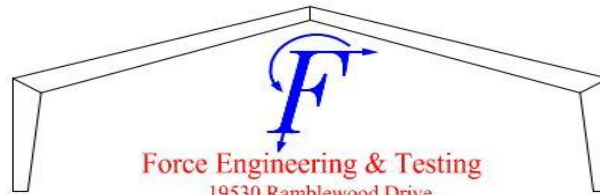

Force Engineering & Testing
 19530 Ramblewood Drive
 Humble, Texas 77338
 Office: (281) 540-6603 Test Lab: (832) 720-4251
www.forceengineeringtesting.com

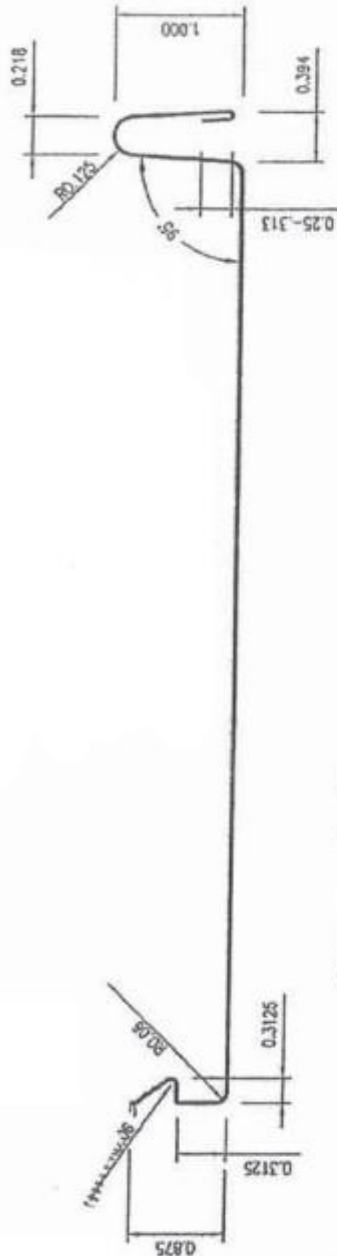

"SL1000" 17-INCH WIDE PANEL PROFILE

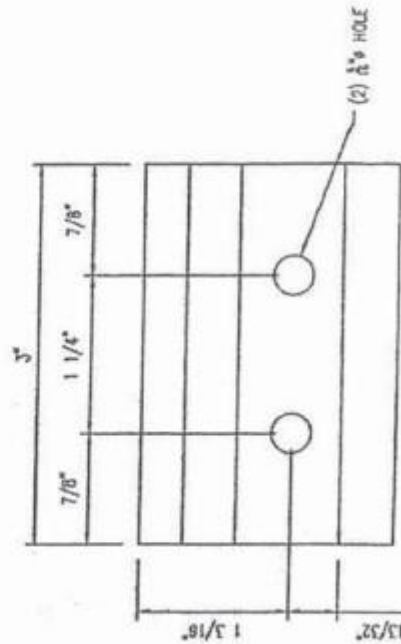

PANEL CLIP-TOP VIEW



PANEL CLIP-SIDE VIEW