
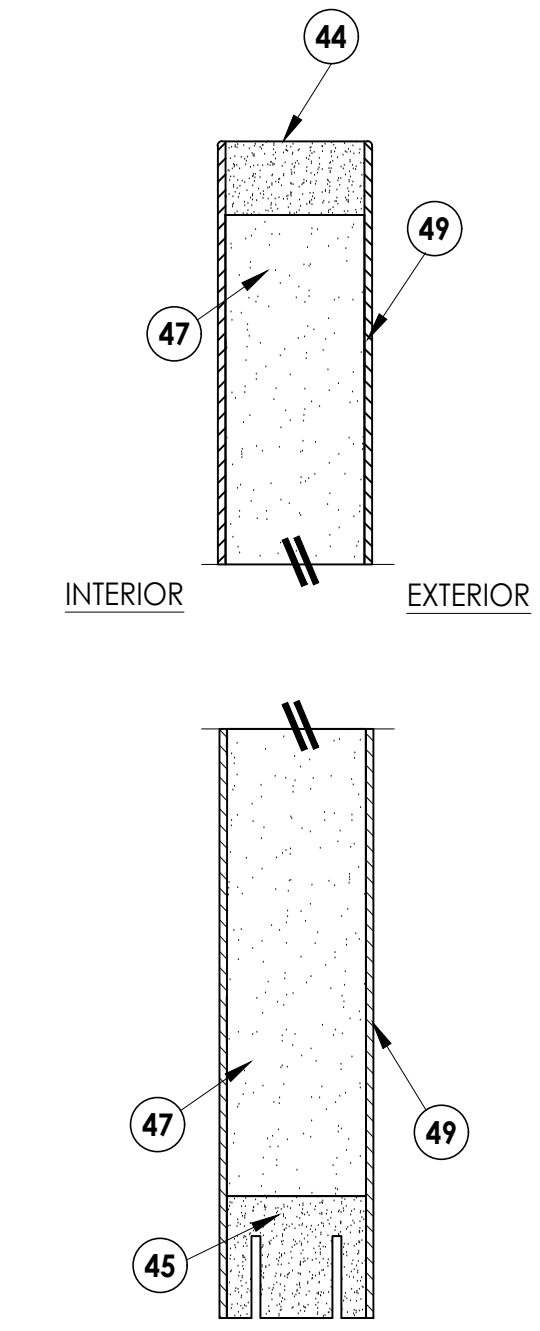
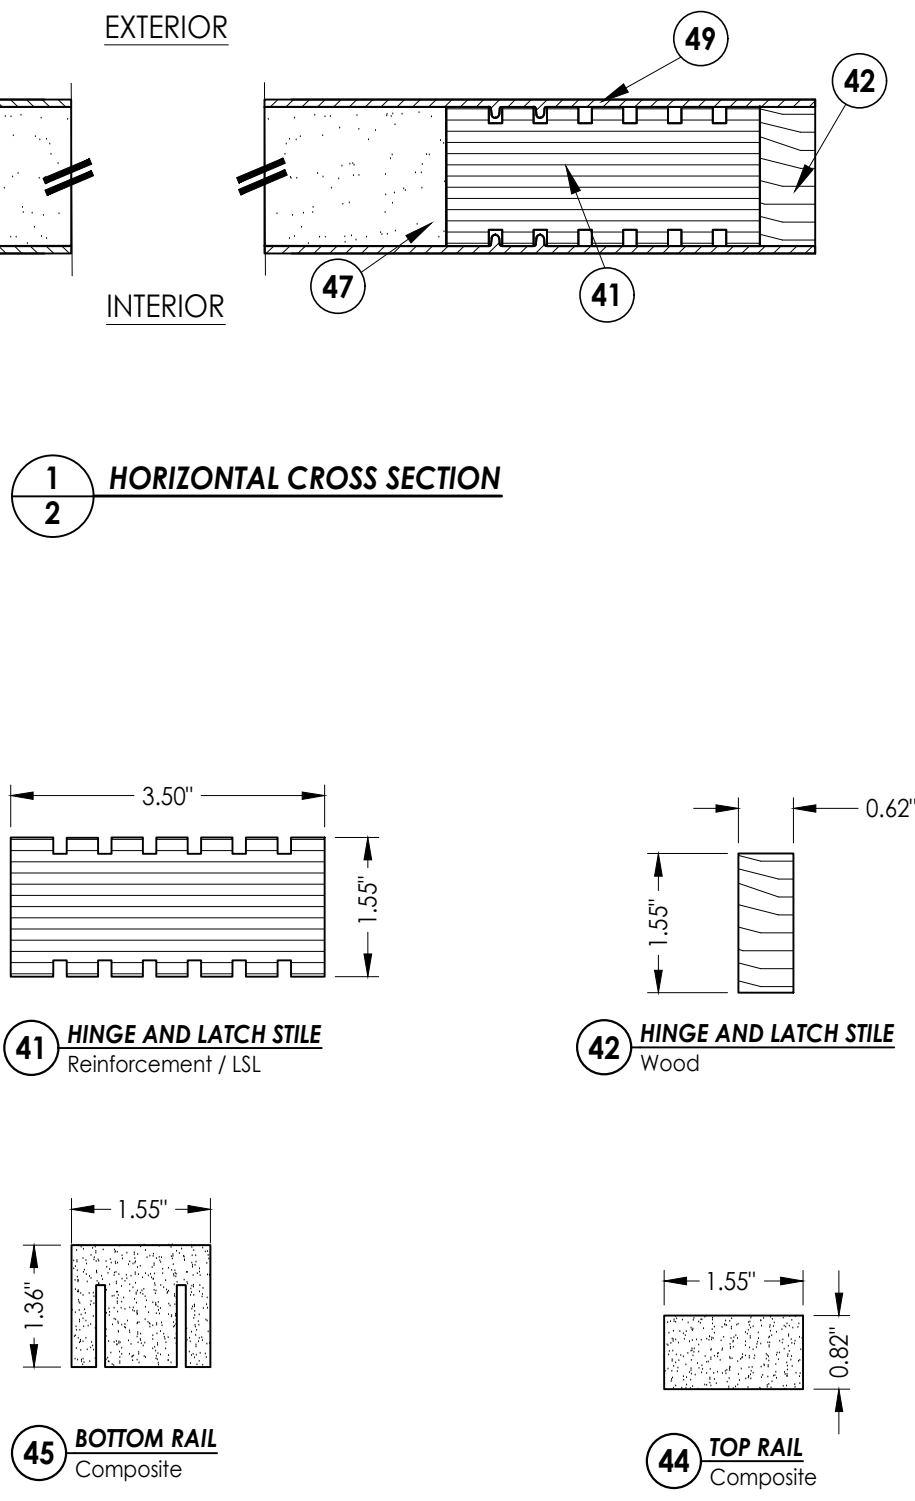



© 2008 B W BUILDING CONSULTANTS INC

Z:\2023 FBC Drawings\MasterGrain\FL-13320 R7\FL-13320.3.dwg

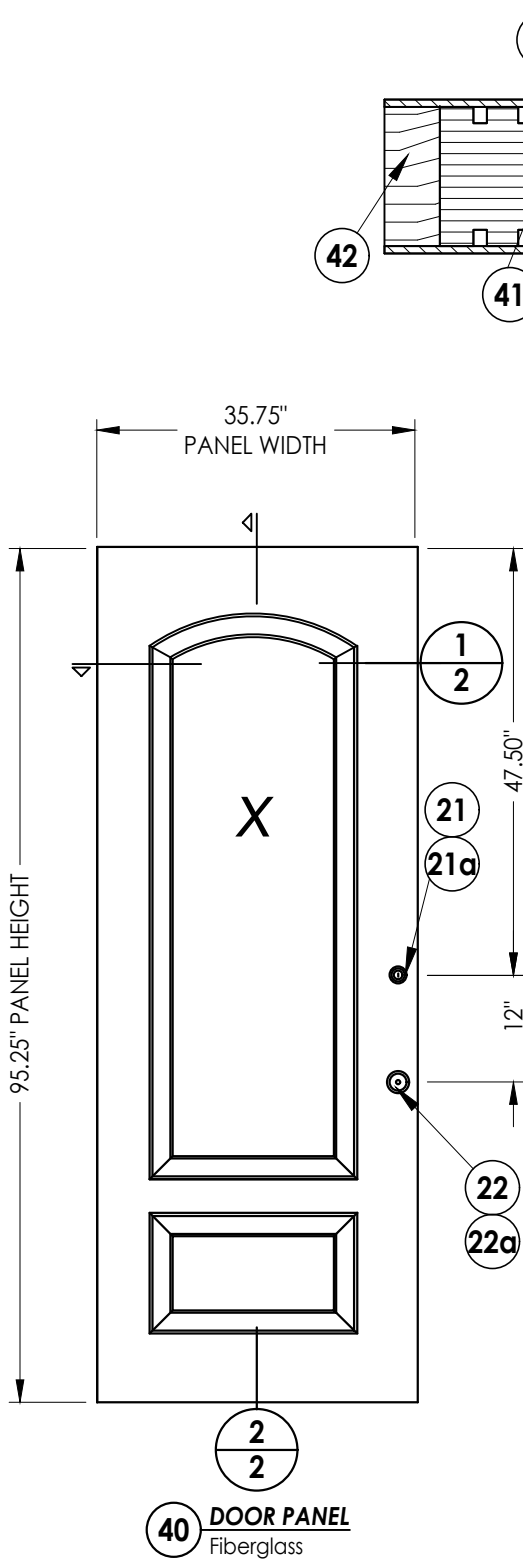


Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409				BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813				
PRODUCT: MASTERGRAIN FIBERGLASS DOOR				PART OR ASSEMBLY: DOOR PANEL DETAILS				
				6	7/01/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
				5	7/01/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
				4	7/08/20	UPDATE TO 7TH ED. (2020)	FBC	LFS
				NO.	DATE			BY
				REVISIONS				
DATE: 11/30/09								
SCALE: N.T.S.								
DWG. BY: AP								
CHK. BY: LFS								
DRAWING NO.: FL-13320.3								
SHEET 2 OF 12								


Z:\2023 FBC Drawings\MasterGrain\FL-13320 R7\FL-13320.3.dwg

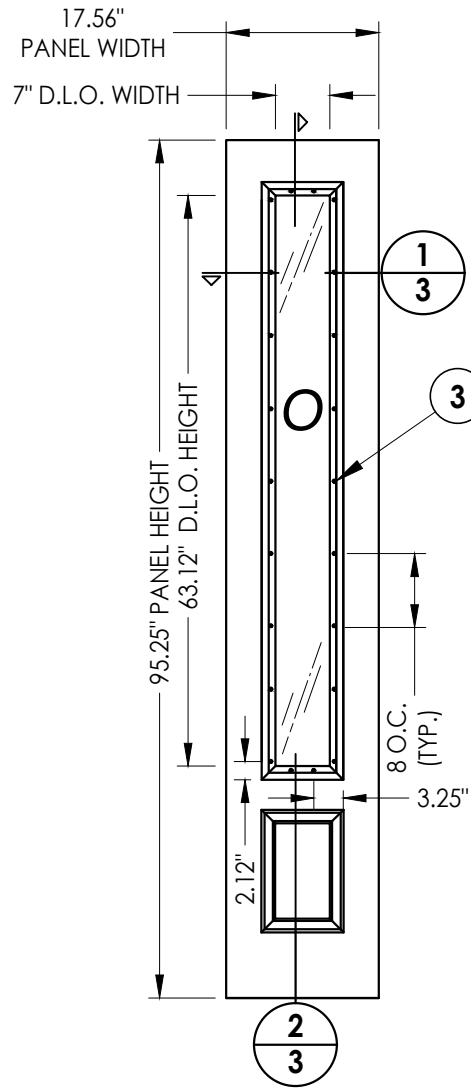


50 SIDELITE PANEL
Fiberglass




52 SIDELITE STILE
Wood




53 SIDELITE BOTTOM RAIL
Wood




54 SIDELITE TOP RAIL
Wood

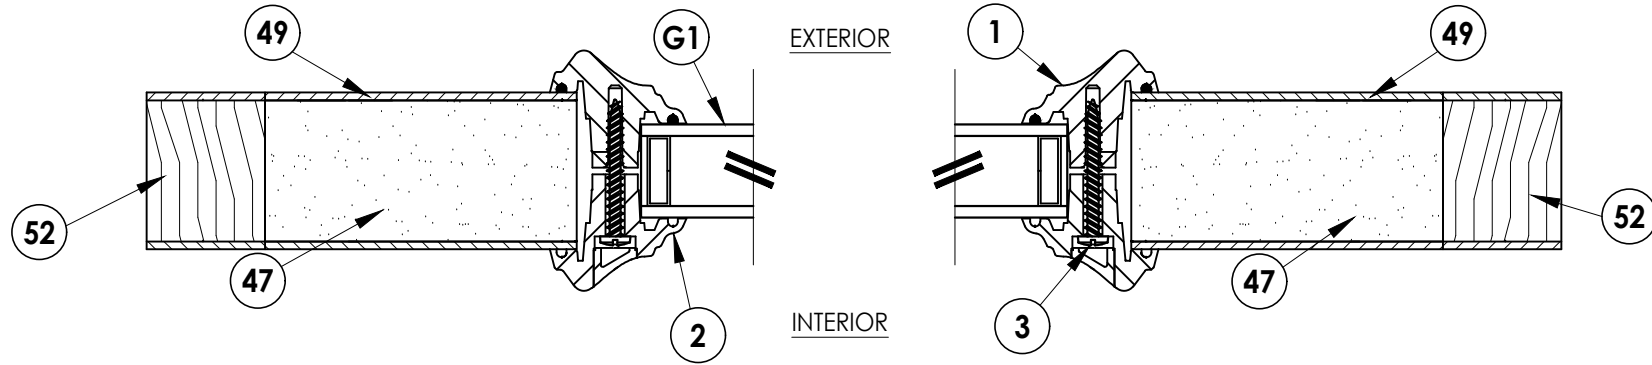

1/3 HORIZONTAL CROSS SECTION

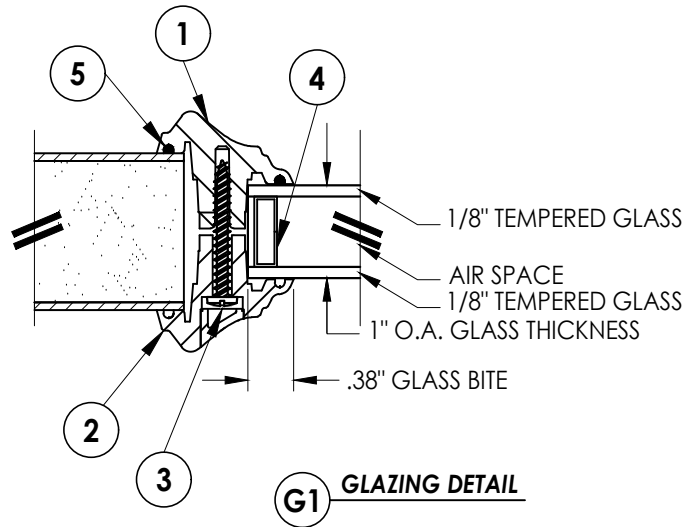

G1 GLAZING DETAIL

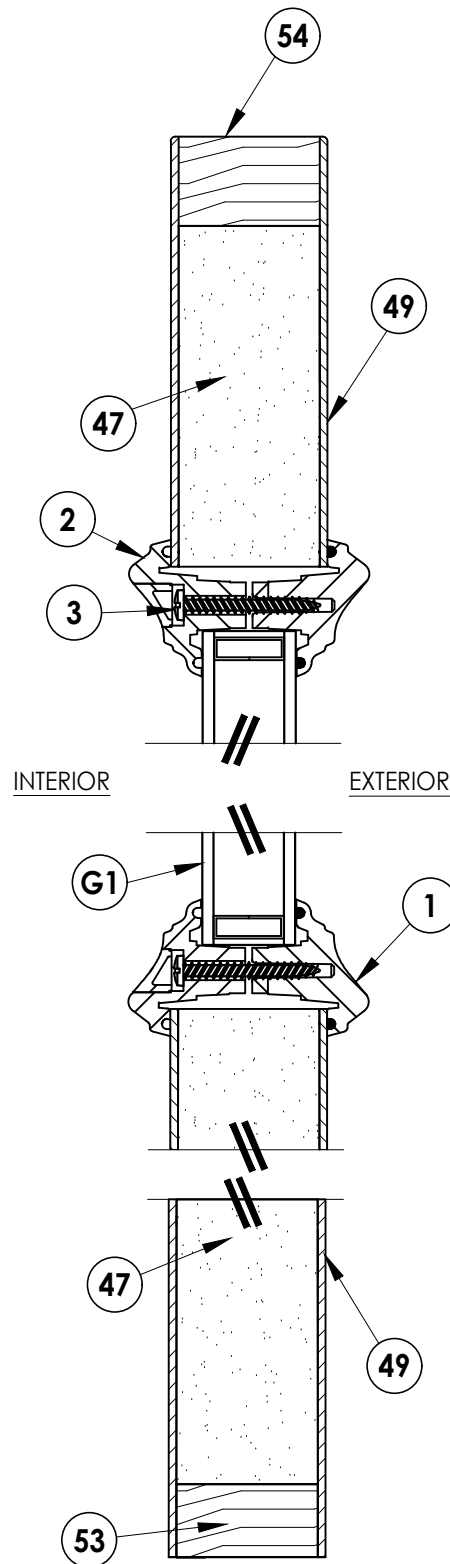

2/3 VERTICAL CROSS SECTION

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: MASTERGRAIN
FIBERGLASS DOOR

PART OR ASSEMBLY:
SIDELITE PANEL DETAILS
AND GLAZING DETAIL

NO.	DATE	REVISIONS			
		BY	LFS	FBC	(2020)
6	7/01/26	UPDATE TO 9TH ED.	(2026)	FBC	(2026)
5	7/01/23	UPDATE TO 8TH ED.	(2023)	FBC	(2023)
4	7/08/20	UPDATE TO 7TH ED.	(2020)	FBC	(2020)

DATE: 11/30/09

SCALE: N.T.S.

DWG. BY: AP


CHK. BY: LFS

DRAWING NO.:


FL-13320.3

SHEET 3 OF 12


Z:\2023 FBC Drawings\MasterGrain\FL-13320 R7\FL-13320.3.dwg

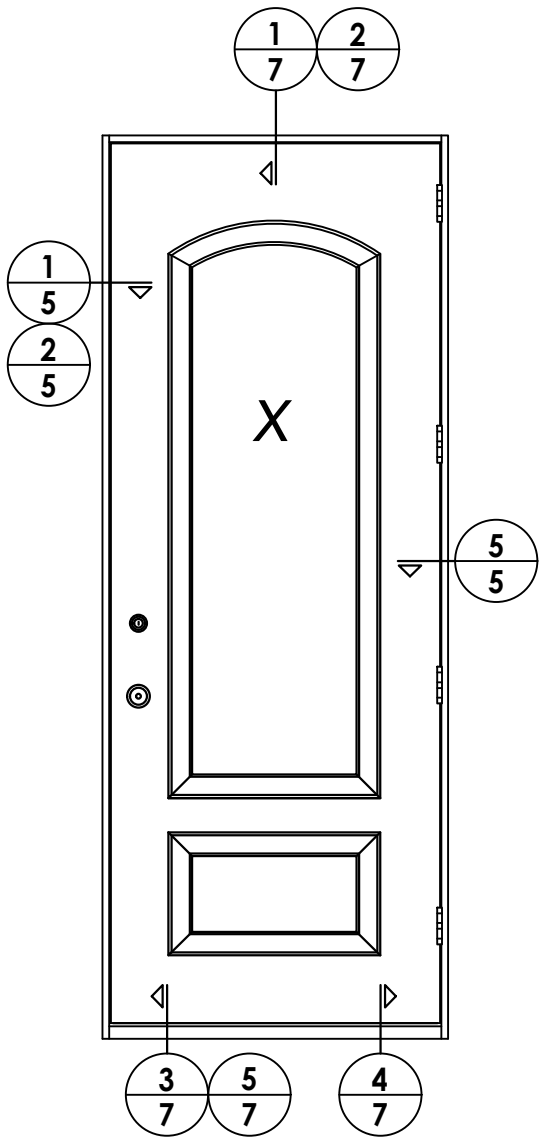

ELEVATION (X)

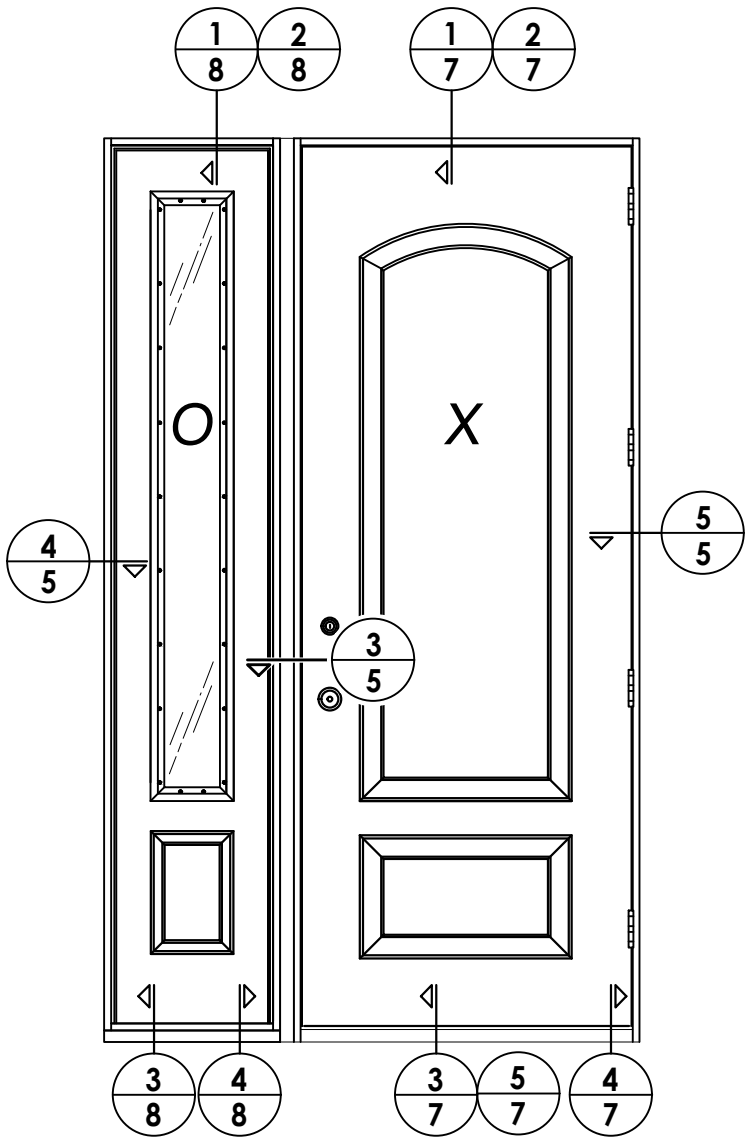

ELEVATION (OX / XO)

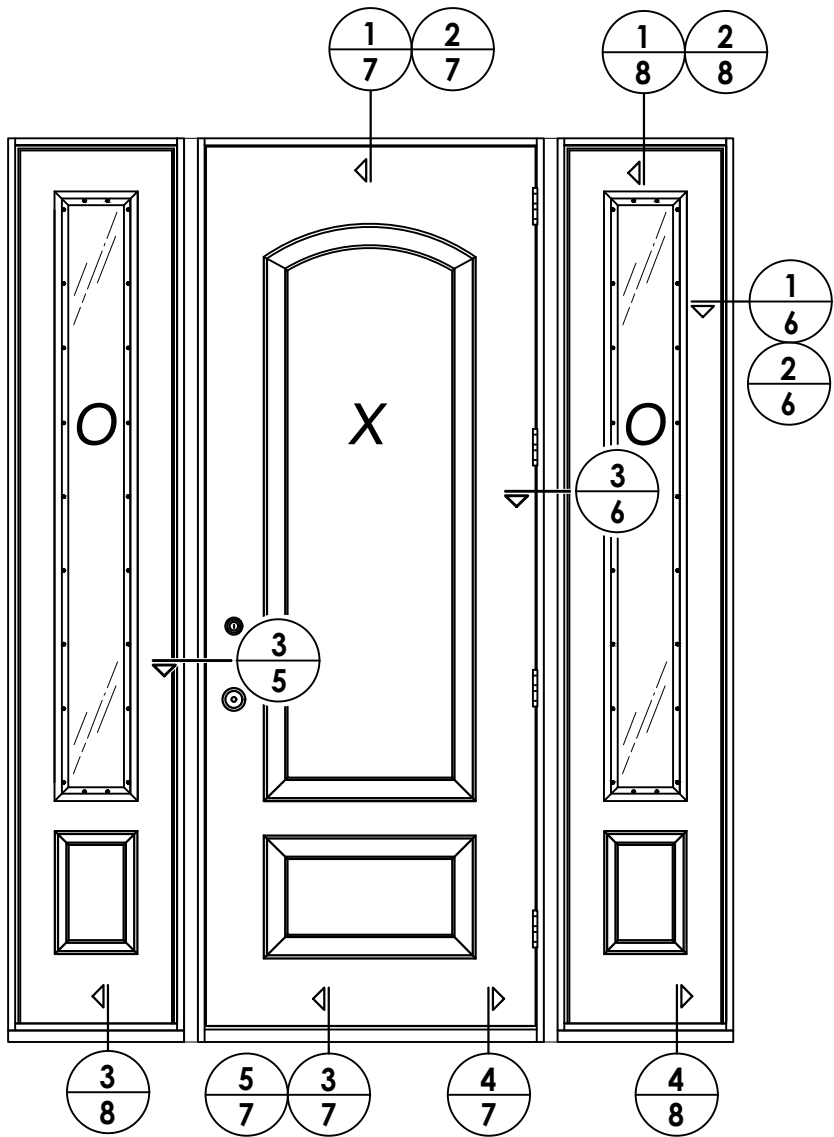

ELEVATION (OXO)

REVISIONS	
NO.	DATE
6	7/01/26
5	7/01/23
4	7/08/20

DATE: 11/30/09

SCALE: N.T.S.

DWG. BY: AP

CHK. BY: LFS

DRAWING NO.:
FL-13320.3

SHEET 4 OF 12

PRODUCT:
MASTERGRAIN
FIBERGLASS DOOR

PART OR ASSEMBLY:
ELEVATIONS

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\MasterGrain\FL-13320 R7\FL-13320.3.dwg

NOTE:

1. Sidelite ass'y fastener; 6" from each end and 6 more screws equally spaced between. (8 screws total per jamb.)
2. Trim secured with 1" Brad Nail @ 6" O.C. (TYP).

EXTERIOR


INTERIOR

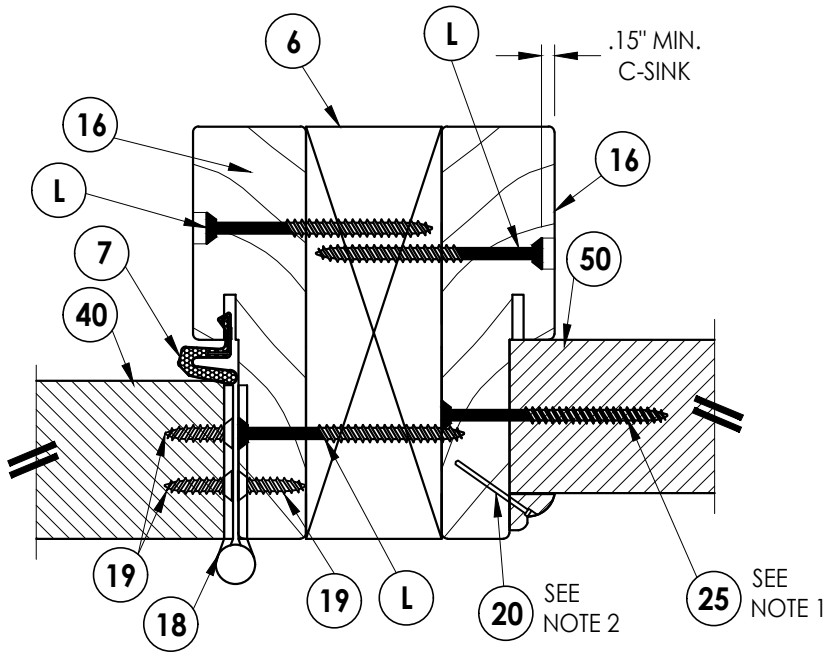

3
6 **HORIZONTAL CROSS SECTION**
Inswing shown - outswing
also approved

EXTERIOR


INTERIOR

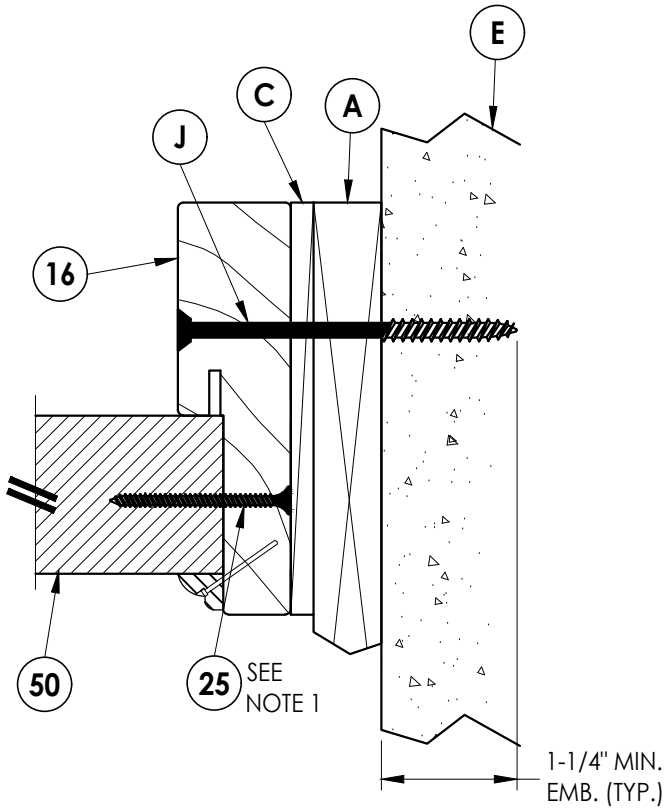

1
6 **HORIZONTAL CROSS SECTION**
Shown w/1X sub-buck

EXTERIOR

INTERIOR

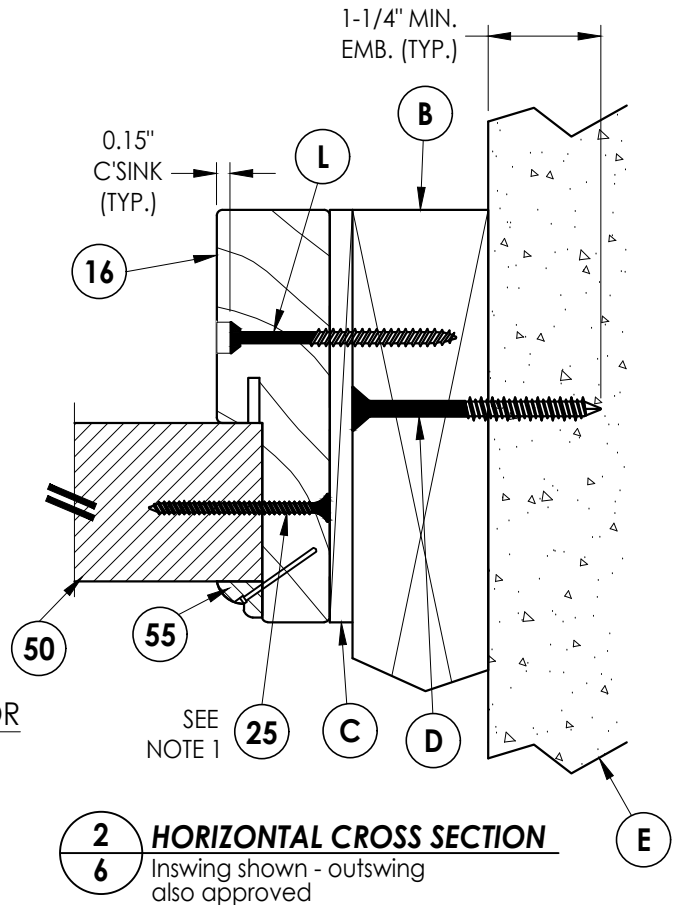

2
6 **HORIZONTAL CROSS SECTION**
Inswing shown - outswing
also approved

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
MASTERGRAIN
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL CROSS SECTIONS

NO.	DATE	REVISIONS	BY
6	7/01/26	UPDATE TO 9TH ED. (2026) FBC	LFS
5	7/01/23	UPDATE TO 8TH ED. (2023) FBC	LFS
4	7/08/20	UPDATE TO 7TH ED. (2020) FBC	LFS

DATE: 11/30/09

SCALE: N.T.S.


DWG. BY: AP

CHK. BY: LFS


DRAWING NO.:

FL-13320.3


SHEET 6 OF 12

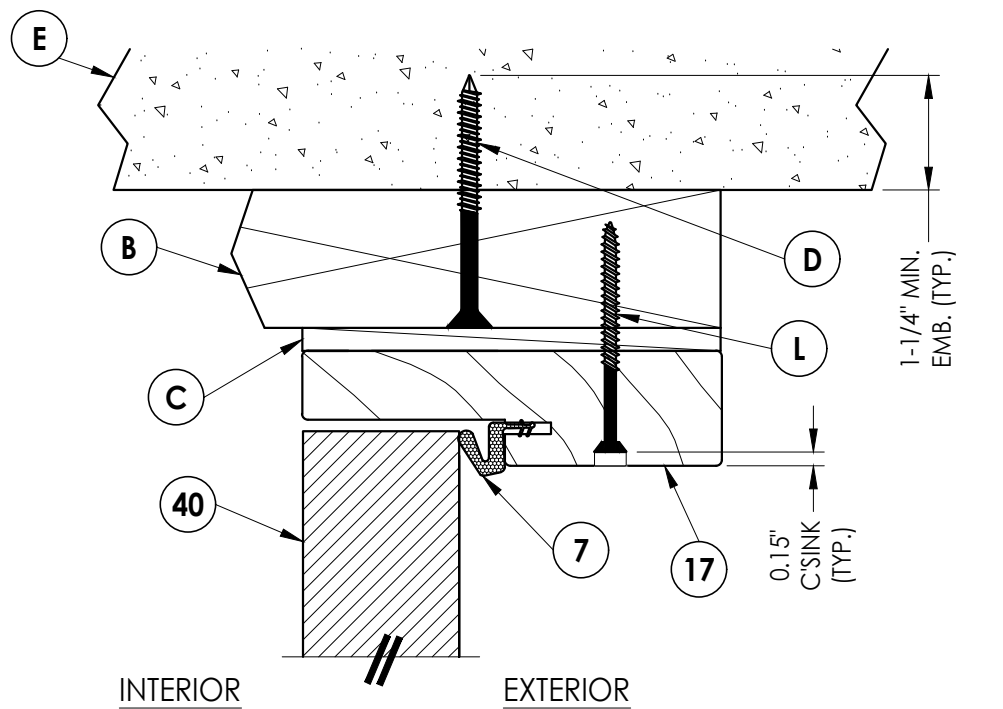


1 **VERTICAL CROSS SECTION**
7 Inswing shown - outswing
also approved

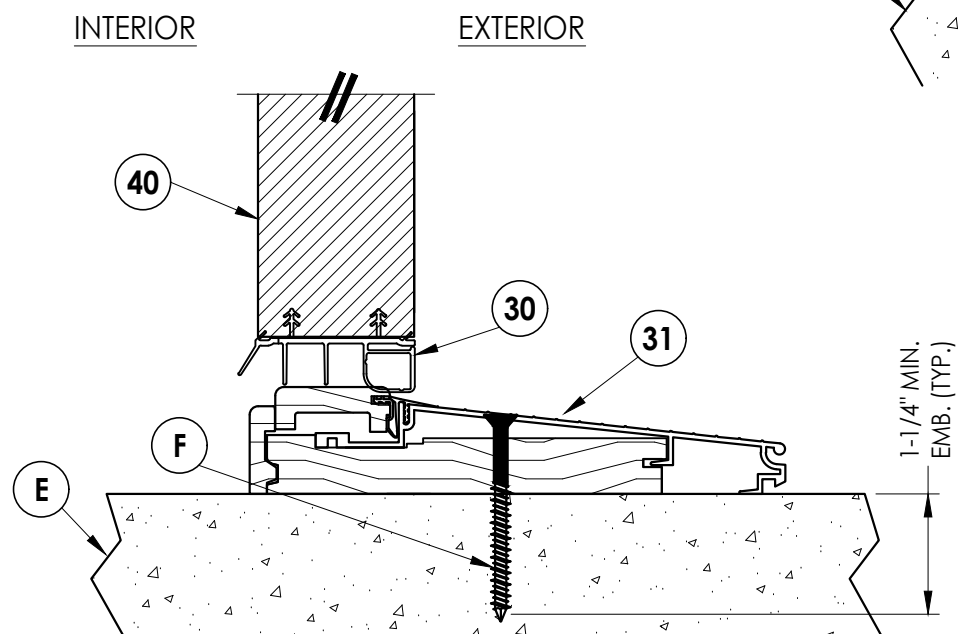


3 7 **VERTICAL CROSS SECTION** Inswing configuration

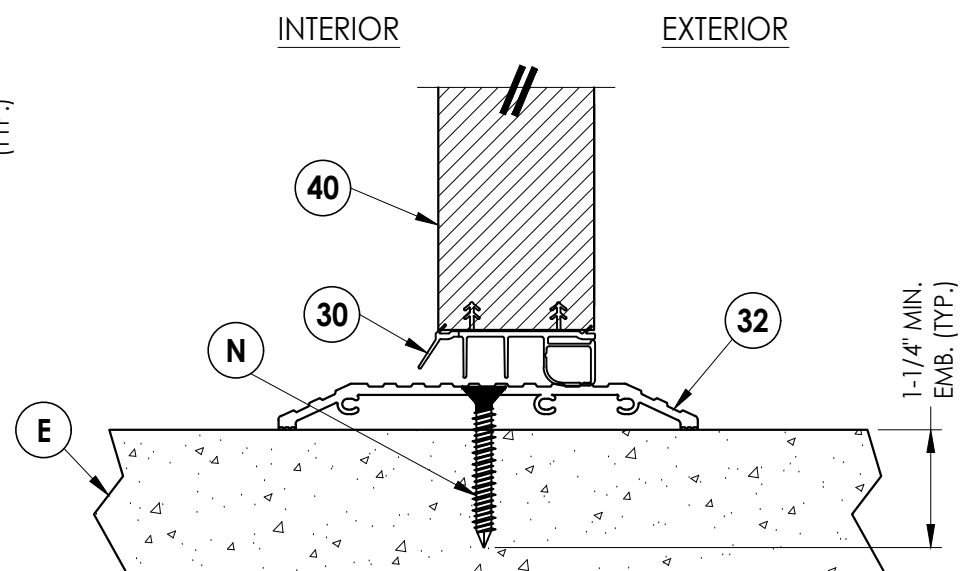

5 VERTICAL CROSS SECTION
7 Shown w/ ADA threshold

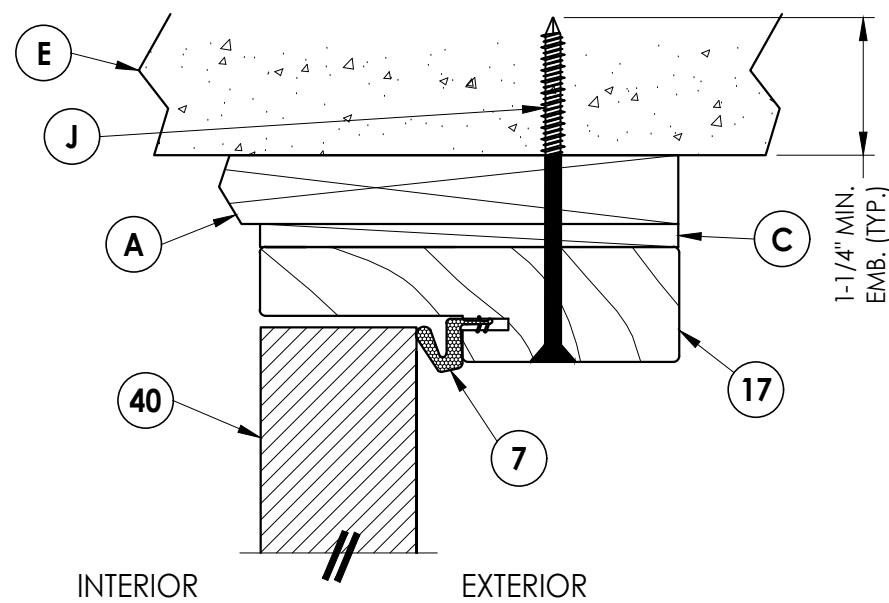

2 **VERTICAL CROSS SECTION**
7 Shown w/1X sub-buck

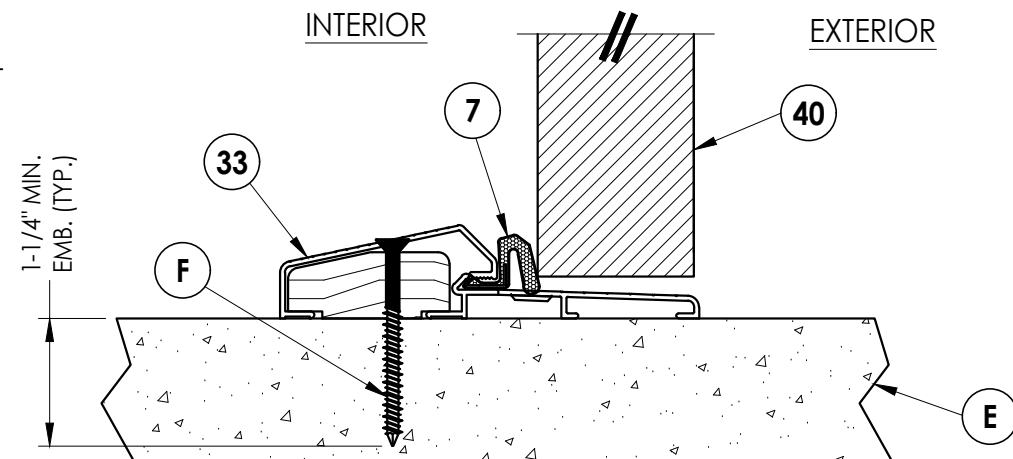


4 7 **VERTICAL CROSS SECTION** Outswing configuration

6	7/01/26	UPDATE TO 9TH ED.	(2026)	FBC	LFS
5	7/01/23	UPDATE TO 8TH ED.	(2023)	FBC	LFS
4	7/08/20	UPDATE TO 7TH ED.	(2020)	FBC	LFS
NO.	DATE				
		REVISIONS			


DATE:	11/30/09
SCALE:	N.T.S.
DWG. BY:	AP
CHK. BY:	LFS
DRAWING NO.:	FL-13320.3
SHEET	7 OF 12

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


R^gW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

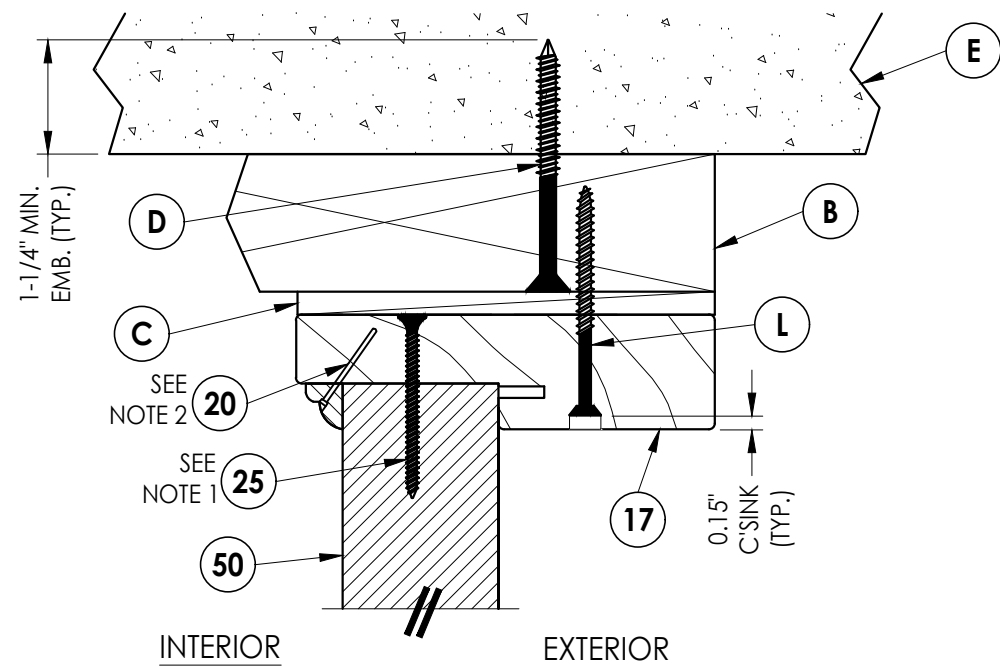


1 **VERTICAL CROSS SECTION**
8 Inswing shown - outswing
also approved

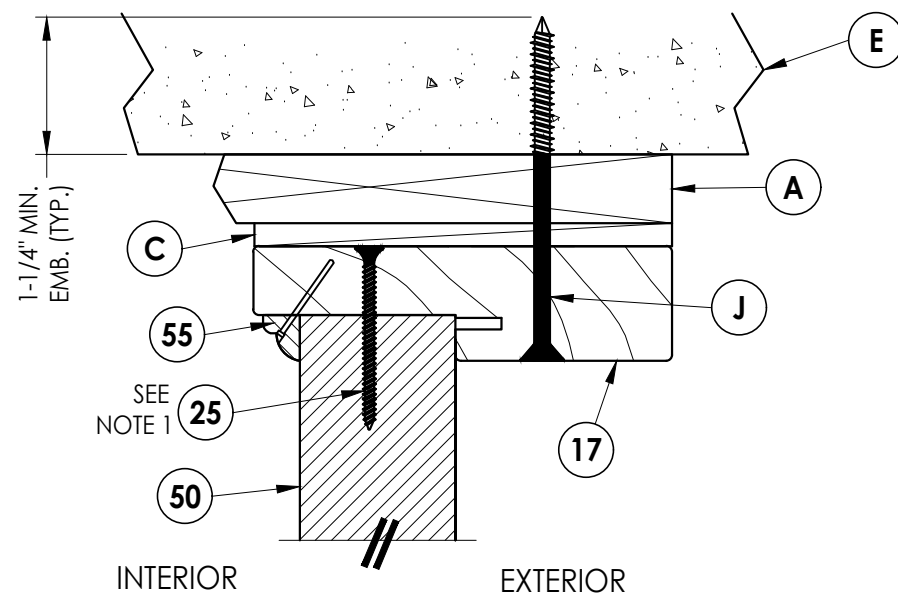

2 **VERTICAL CROSS SECTION**
8 Shown w/1X sub-buck

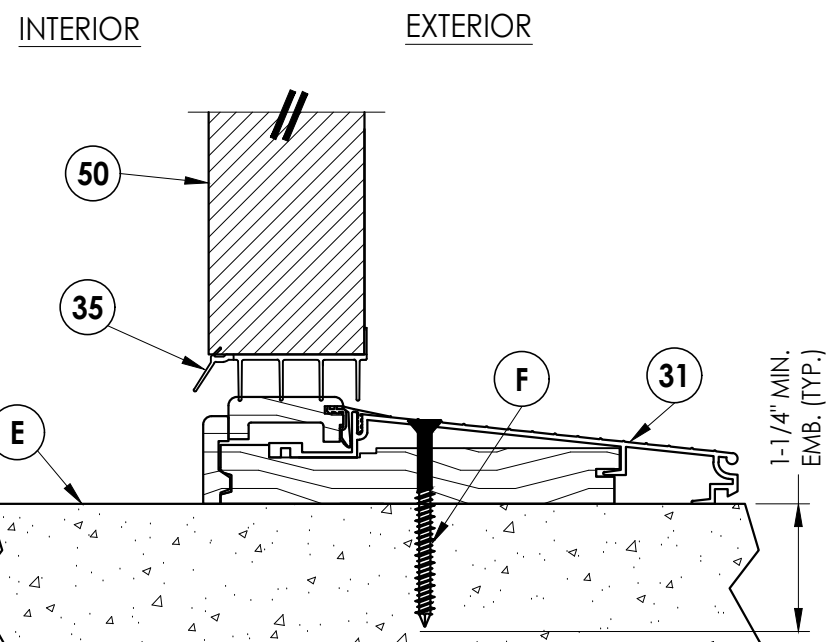

3 **VERTICAL CROSS SECTION**
8 Inswing configuration

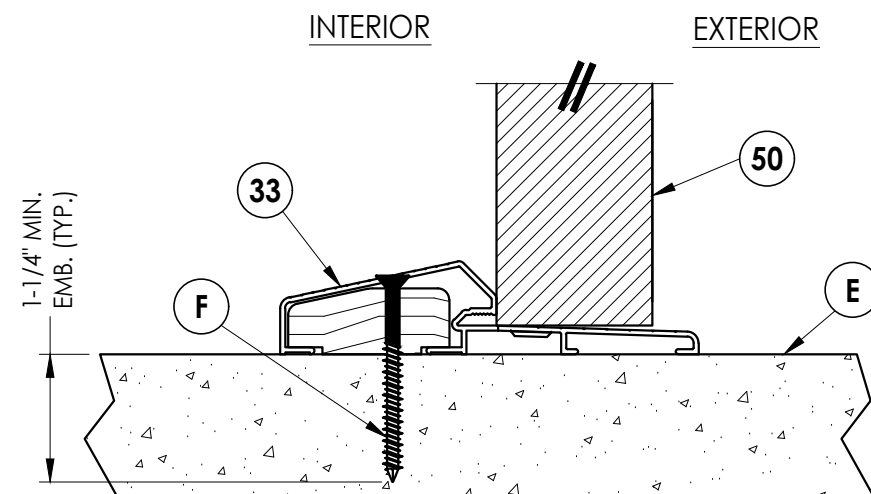

4 **VERTICAL CROSS SECTION**
8 Outswing configuration


NOTE:

1. Screws thru head jamb located 3" from each end.
2. Trim secured with 1" Brad Nail @ 6" O.C. (TYP).


[illegible]

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


R^gW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

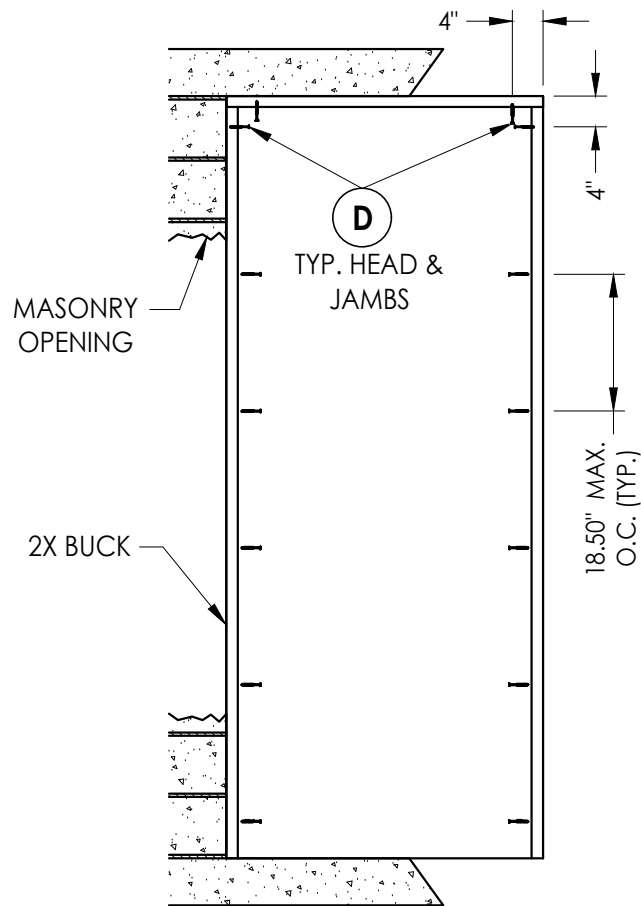


BUCK ANCHORING

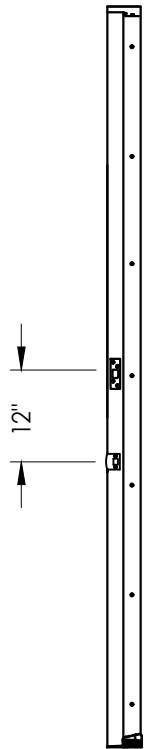

STRIKE JAMB

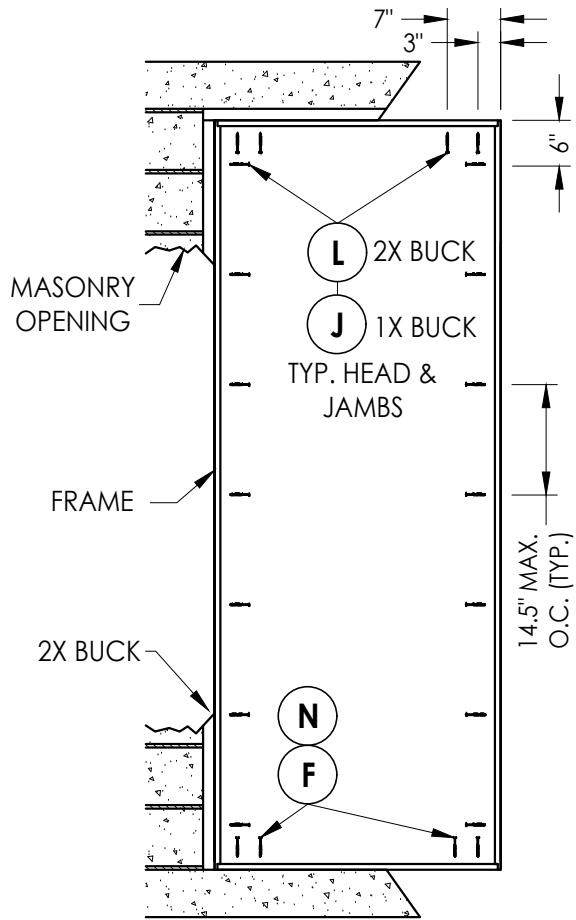

FRAME ANCHORING
Masonry construction



HINGE JAMB


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRA CON+®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	3"	1-1/2"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

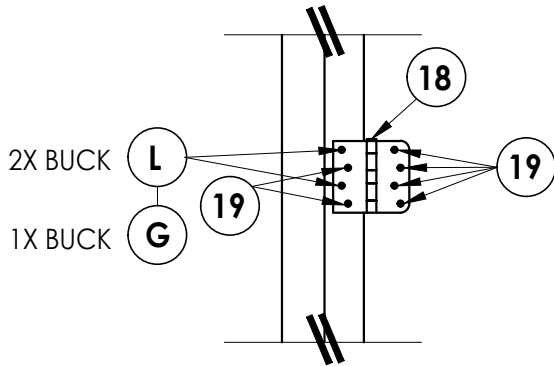

HINGE DETAIL

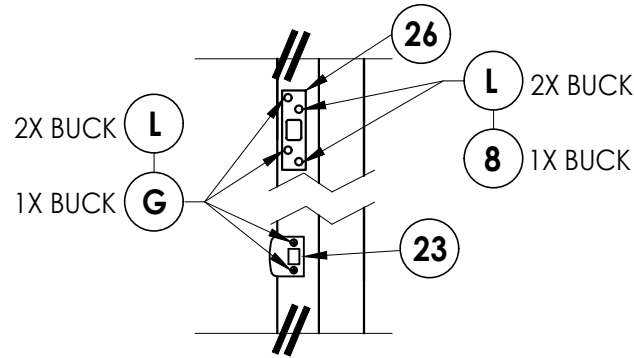

LATCH & DEADBOLT DETAIL
SECURITY STRIKE

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
MASTERGRAIN
FIBERGLASS DOOR

PART OR ASSEMBLY:
BUCK & FRAME ANCHORING
(X)

NO.	DATE	REVISIONS
6	7/01/26	UPDATE TO 9TH ED. (2026) FBC LFS
5	7/01/23	UPDATE TO 8TH ED. (2023) FBC LFS
4	7/08/20	UPDATE TO 7TH ED. (2020) FBC LFS

DATE: 11/30/09

SCALE: N.T.S.

DWG. BY: AP


CHK. BY: LFS

DRAWING NO.:


FL-13320.3

SHEET 9 OF 12


Z:\2023 FBC Drawings\MasterGrain\FL-13320 R7\FL-13320.3.dwg

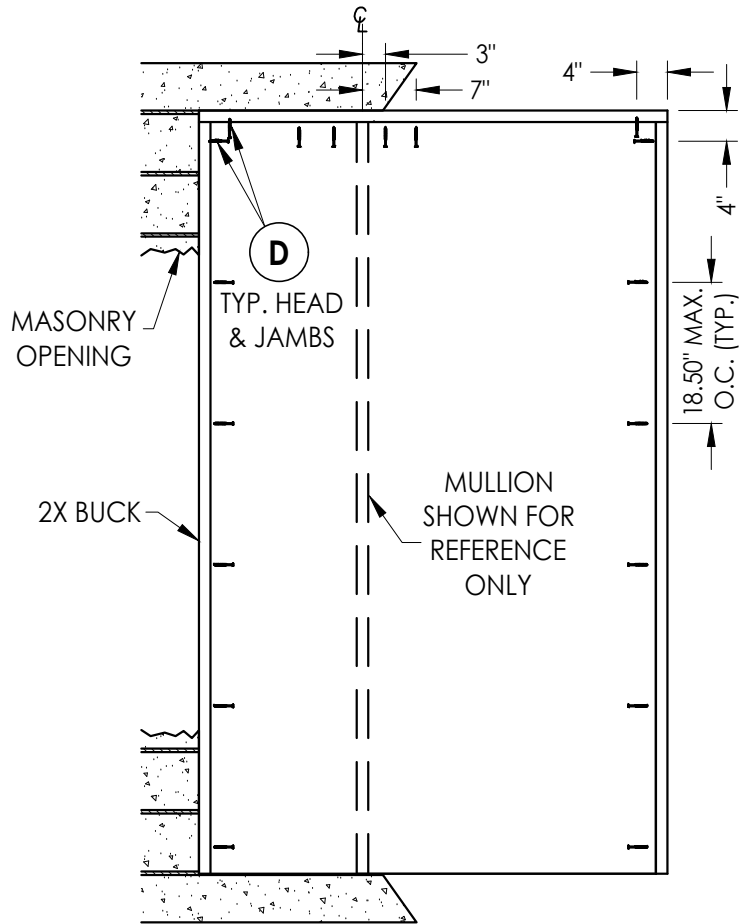


BUCK ANCHORING

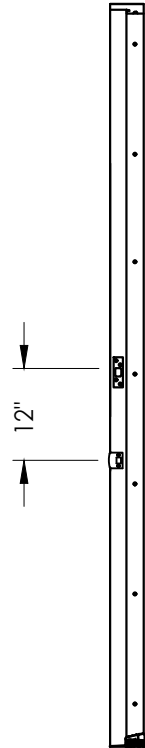

STRIKE JAMB

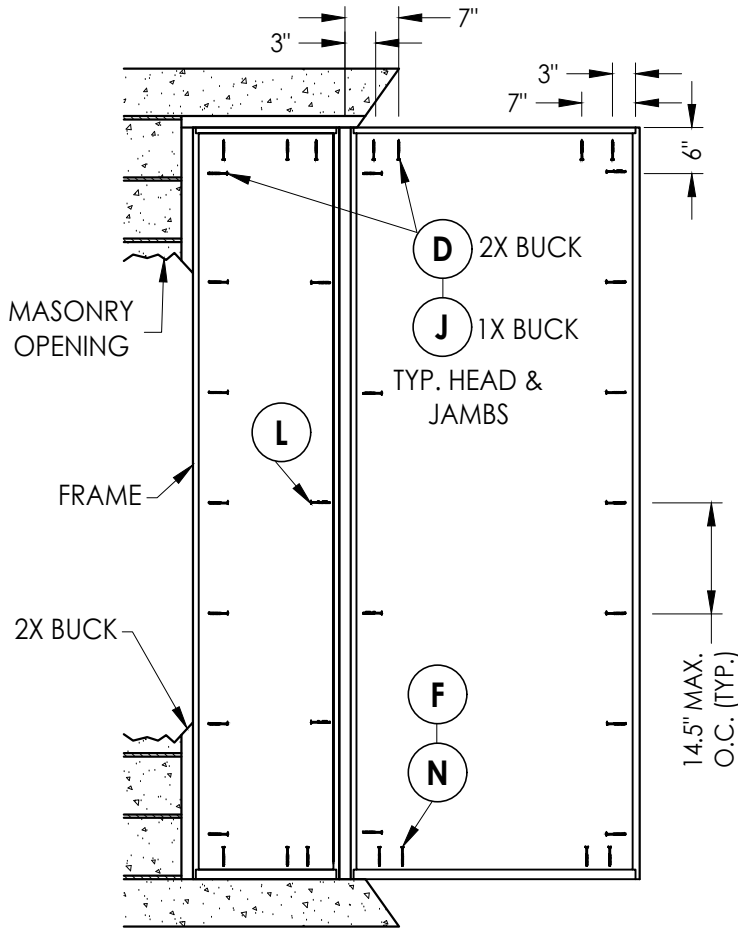

FRAME ANCHORING
Masonry construction



HINGE JAMB


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	3"	1-1/2"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

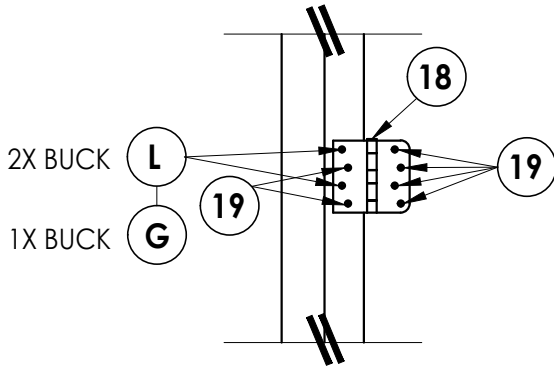

HINGE DETAIL

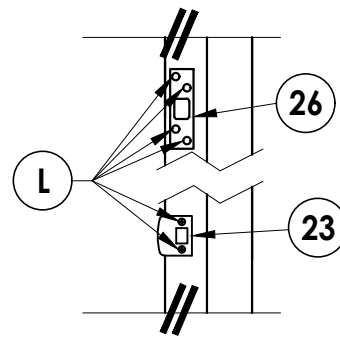

LATCH & DEADBOLT DETAIL
SECURITY STRIKE

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
MASTERGRAIN
FIBERGLASS DOOR

PART OR ASSEMBLY:
BUCK & FRAME ANCHORING
(OX/XO)

NO.	DATE	REVISIONS
6	7/01/26	UPDATE TO 9TH ED. (2026) FBC LFS
5	7/01/23	UPDATE TO 8TH ED. (2023) FBC LFS
4	7/08/20	UPDATE TO 7TH ED. (2020) FBC LFS
		BY

DATE: 11/30/09

SCALE: N.T.S.

DWG. BY: AP


CHK. BY: LFS

DRAWING NO.:

FL-13320.3


SHEET 10 OF 12

Z:\2023 FBC Drawings\MasterGrain\FL-13320 R7\FL-13320.3.dwg

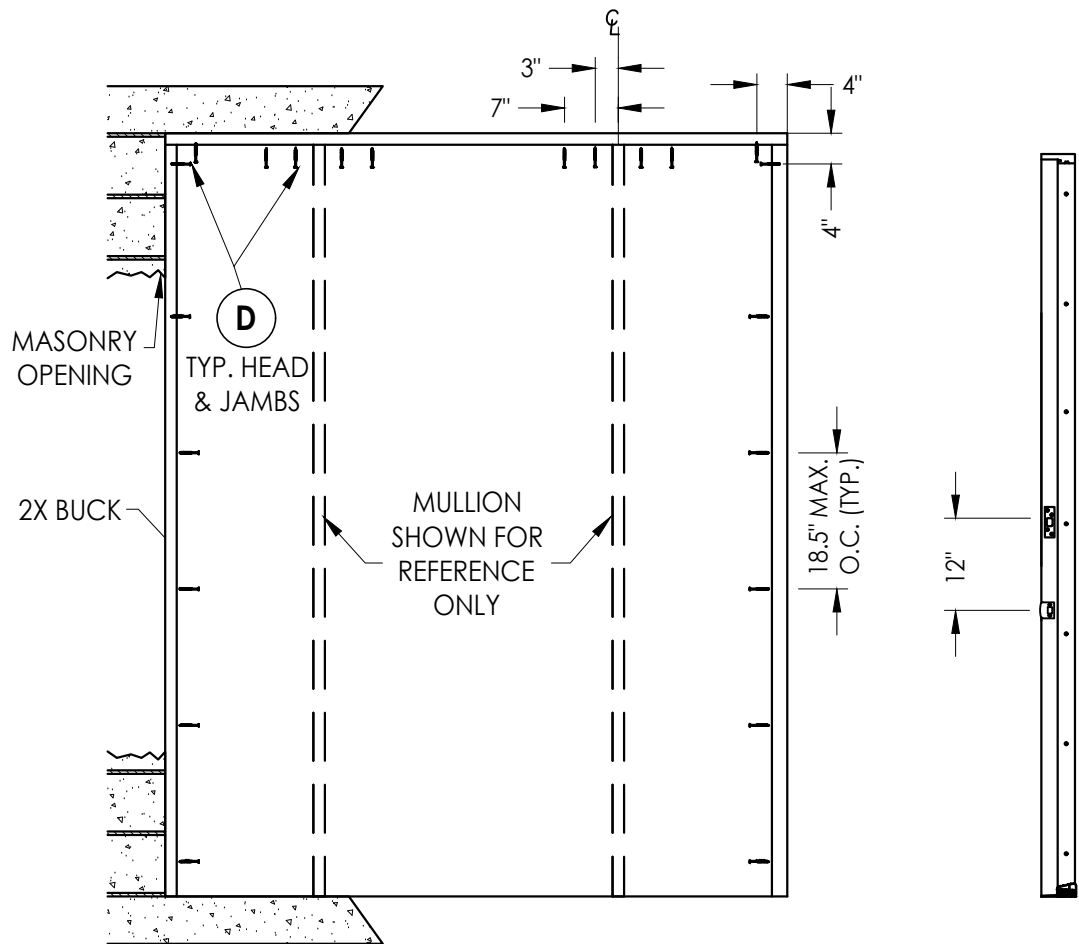


BUCK ANCHORING

STRIKE JAMB

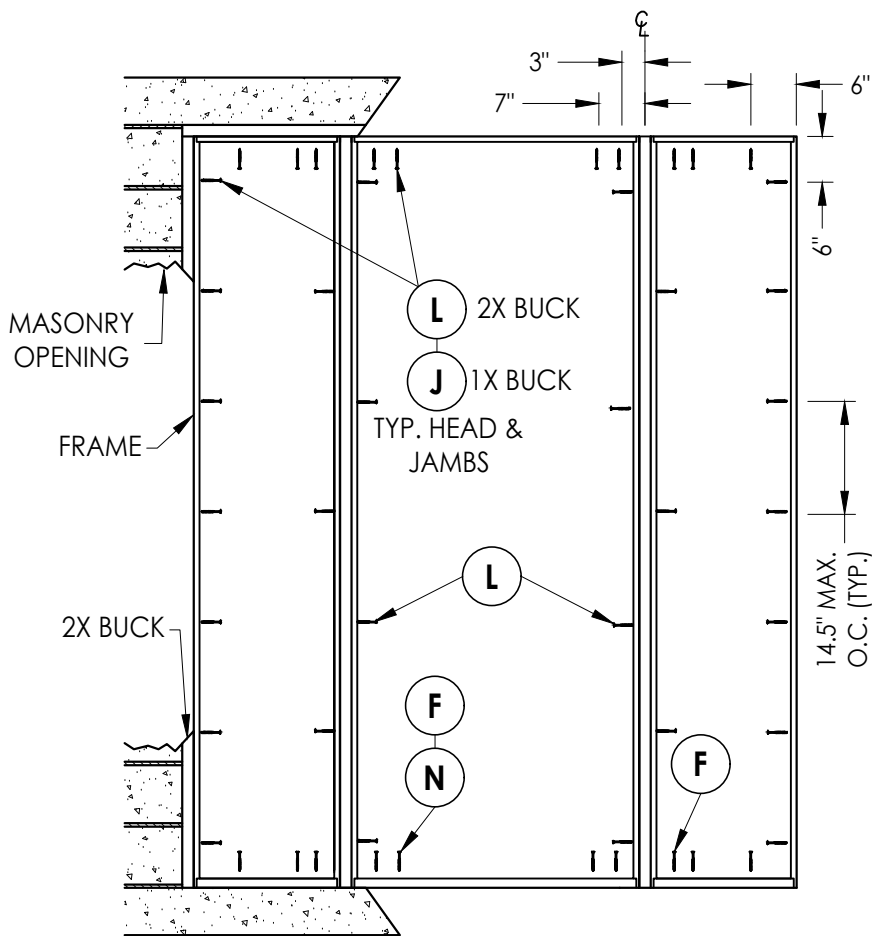

FRAME ANCHORING
Masonry construction

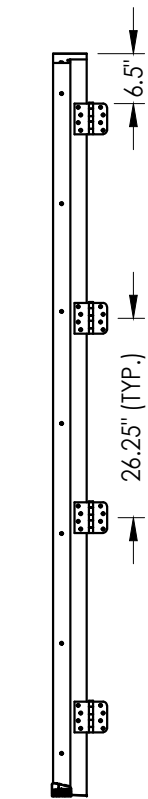

HINGE JAMB


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	3"	1-1/2"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

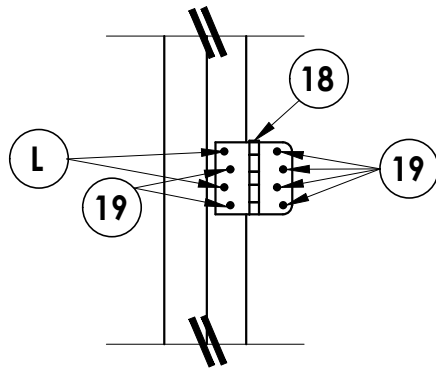

HINGE DETAIL

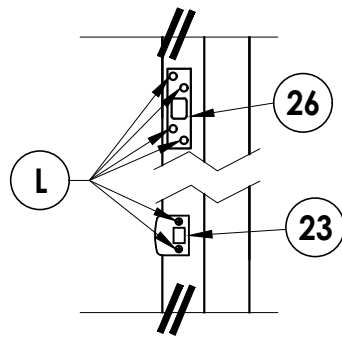

LATCH & DEADBOLT DETAIL
SECURITY STRIKE

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
MASTERGRAIN
FIBERGLASS DOOR

PART OR ASSEMBLY:
BUCK & FRAME ANCHORING
(OXO)

NO.	DATE	REVISIONS
6	7/01/26	UPDATE TO 9TH ED. (2026) FBC LFS
5	7/01/23	UPDATE TO 8TH ED. (2023) FBC LFS
4	7/08/20	UPDATE TO 7TH ED. (2020) FBC LFS
		BY

DATE: 11/30/09

SCALE: N.T.S.

DWG. BY: AP

CHK. BY: LFS


DRAWING NO.:

FL-13320.3


SHEET 11 OF 12

Z:\2023 FBC Drawings\MasterGrain\FL-13320 R7\FL-13320.3.dwg


BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK SG >= 0.55	WOOD
B	2X BUCK SG >= 0.55	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	1/4" X 2-1/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
G	3/16" X 3-1/4" PFH ITW CONCRETE SCREW	STEEL
H	1/4" X 3-1/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
J	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
K	#9 X 2-1/2" PFH WS	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL
N	1/4" X 1-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
1	FEMALE LITE FRAME - MASTERGRAIN	POLYPROPYLENE
2	MALE LITE FRAME - MASTERGRAIN	POLYPROPYLENE
3	#8 X 1-3/4" PANHEAD SMS (LIGHT FRAME SCREW)	STEEL
4	ALUMINUM SPACER SYSTEM	ALUMINUM
5	SILICONE WEATHER SEAL MG #2500	SILICONE
6	2X MULLION SG > = 0.55	WOOD
7	WEATHER STRIP	FOAM
8	#10 X 1-1/2" PFH	STEEL
16	SIDE JAMB SG > = 0.42	WOOD
17	HEAD JAMB SG > = 0.42	WOOD
18	4" X 4" HINGE MIN 0.1" THICK	STEEL
19	#10 X 3/4" PFH WS	STEEL
20	1" BRAD NAIL	STEEL

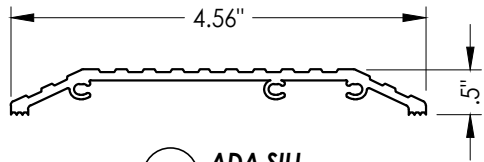


32 ADA SILL

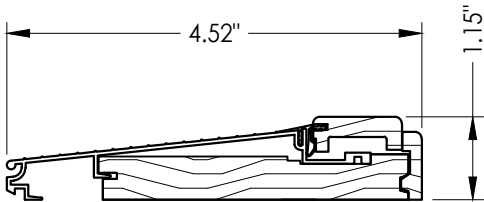


31 INSWING THRESHOLD

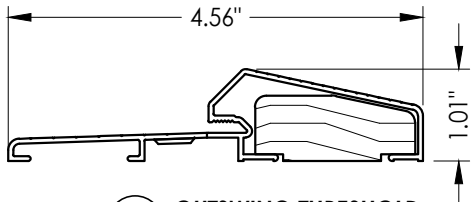

33 OUTSWING THRESHOLD

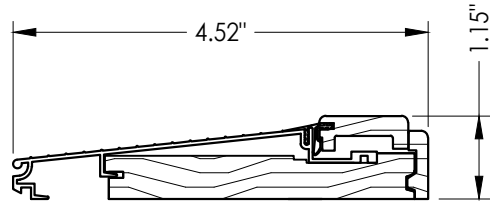

34 SIDELITE THRESHOLD

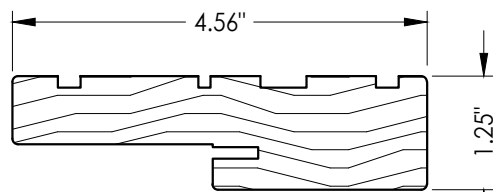

16 17 HEAD & SIDE Jamb

21	DEADBOLT KWIKSET - SERIES 660	STEEL
21A	DEADBOLT - COPPER CREEK E-SERIES	STEEL
22	KNOB - KWIKSET SERIES	STEEL
22A	KNOB - COPPER CREEK E-SERIES	STEEL
23	LATCH STRIKE PLATE	STEEL
24	DEADBOLT STRIKE PLATE	STEEL
25	#8 X 2-1/2" PFH WOOD SCREW	STEEL
26	SECURITY STRIKE PLATE	STEEL
30	DOOR BOTTOM SWEEP	VINYL
31	INSWING THRESHOLD	ALUM/COMP.
32	ADA THRESHOLD	ALUM.
33	OUTSWING THRESHOLD	ALUM./WOOD
34	SIDELITE THRESHOLD	ALUM./COMP.
35	SIDELITE SWEEP	VINYL
40	DOOR PANEL - SEE DOOR PANEL DETAIL SHEET FOR CONSTRUCTION DETAILS	-
41	HINGE AND LATCH REINFORCMENT	WOOD
42	HINGE AND LATCH STILE - SG >= 0.42	WOOD
44	TOP RAIL	COMP.
45	BOTTOM RAIL	COMP.
47	POLYURETHANE FOAM	POLYURETHANE
49	FIBERGLASS SKIN 0.08" MIN. THICKNESS	FIBERGLASS
50	SIDELITE PANEL - SEE SIDELITE PANEL DETAIL SHEET FOR CONSTRUCTION DETAILS	-
52	SIDELITE STILE - SG>= 0.42	WOOD
53	SIDELITE BOTTOM RAIL SG > = 0.42	WOOD
54	SIDELITE TOP RAIL SG > = 0.42	WOOD
55	SIDELITE TRIM	WOOD

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
MASTERGRAIN
FIBERGLASS DOOR

PART OR ASSEMBLY:
BILL OF MATERIALS

NO.	DATE	REVISIONS
6	7/01/26	UPDATE TO 9TH ED. (2026) FBC
5	7/01/23	UPDATE TO 8TH ED. (2023) FBC
4	7/08/20	UPDATE TO 7TH ED. (2020) FBC

DATE: 11/30/09

SCALE: N.T.S.

DWG. BY: AP

CHK. BY: LFS

DRAWING NO.:

FL-13320.3

SHEET 12 OF 12