

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING AND METAL STRUCTURE TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. SHIM AS NEEDED. AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
4. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
5. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
6. FRAME MATERIAL: EXTRUDED RIGID PVC.
7. UNITS MUST BE GLAZED PER ASTM E1300.
8. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
9. FOR ANCHORING THROUGH FIN INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
10. FOR ANCHORING THROUGH FIN INTO METAL STRUCTURE USE #8 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
11. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:

11.1. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42

11.2. METAL STRUCTURE: STEEL 18GA (.048") FY=33KSI/FU=52KSI

SIGNED: 08/05/2026

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATION
3 – 4	INSTALLATION DETAILS
5	COMPONENTS

KRESTMARK INDUSTRIES, L.P.
3950 BASTILLE RD., SUITE 100
DALLAS, TX 75212

200/275 VINYL HORIZONTAL SLIDER WINDOW
NON-IMPACT 72" X 48"
NOTES

DRAWN:
A.R.

DWG NO.
08-03919


REV
-

SCALE NTS

DATE 10/10/2023


SHEET 1 OF 5

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

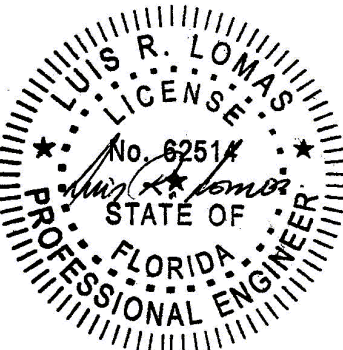


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

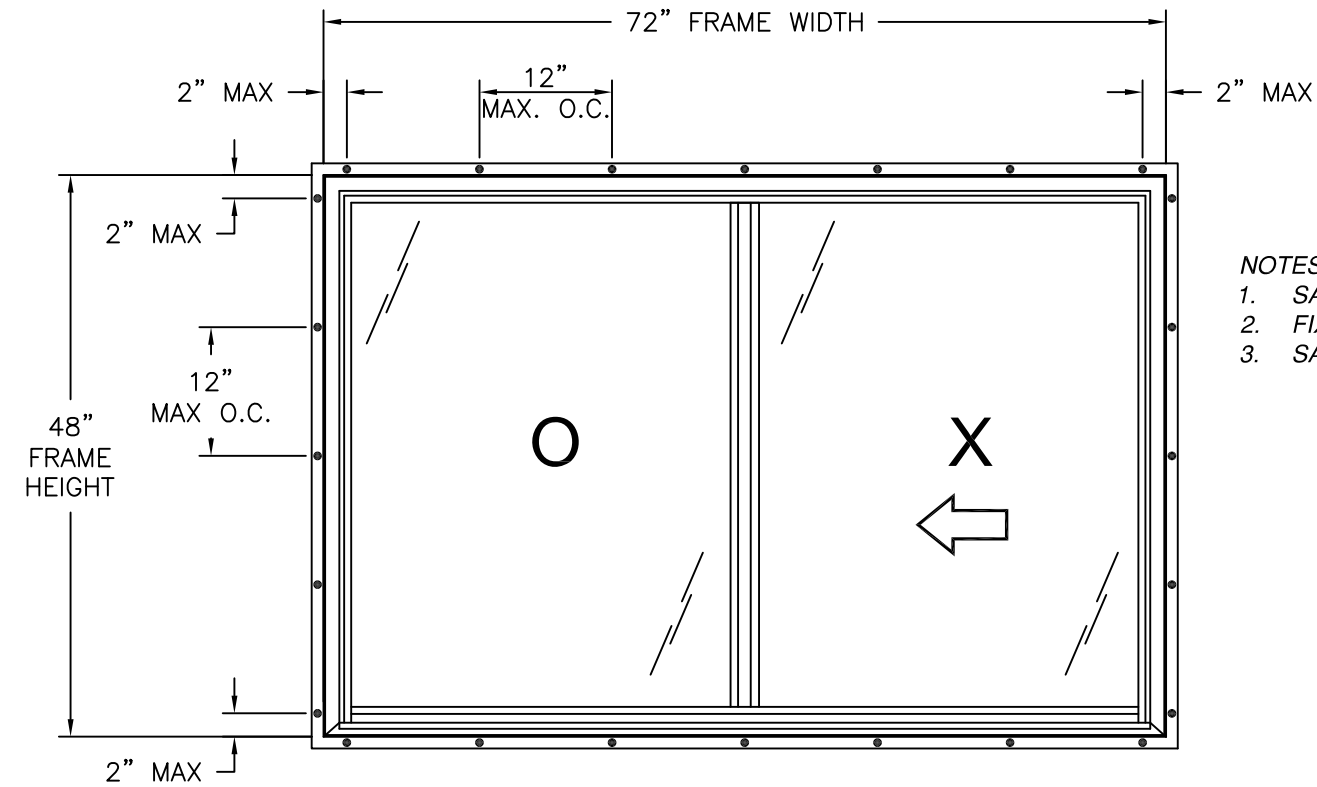

- NOTES:
1. SASH SIZE: 35" X 45 1/2"
 2. FIXED D.L.O.: 32 1/4" X 42 5/16"
 3. SASH D.L.O.: 32 1/8" X 42 1/16"

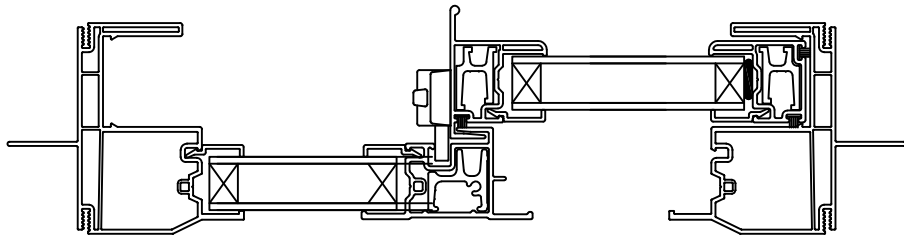

HORIZONTAL CROSS SECTION

200/275 VINYL HORIZONTAL SLIDER WINDOW
EXTERIOR VIEW

DESIGN PRESSURE RATING	IMPACT RATING
±35.0PSF	NONE

FOR OTHER SIZES APPROVED. SEE CHART #1, THIS SHEET

Chart #1
Design pressure rating (psf)

Frame Height (in)	Frame Width (in)																			
	24.0		30.0		36.0		42.0		48.0		54.0		60.0		66.0		72.0		78.0	
	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg
18.0	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5
24.0	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5
30.0	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5
36.0	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5
42.0	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	52.5	35.0	49.1	35.0	46.7	35.0	44.9	35.0	43.8	35.0	43.1
48.0	35.0	52.5	35.0	52.5	35.0	52.5	35.0	48.0	35.0	43.8	35.0	40.6	35.0	38.2	35.0	36.4	35.0	35.0	-	-
54.0	35.0	52.5	35.0	47.9	35.0	40.5	35.0	35.3	31.5	28.6	28.6	26.4	-	-	-	-	-	-	-	-
60.0	35.0	43.0	34.7	34.7	29.3	29.3	25.4	25.4	22.6	22.6	20.4	20.4	-	-	-	-	-	-	-	-
66.0	32.2	32.2	26.0	26.0	21.9	21.9	18.9	18.9	16.8	16.8	-	-	-	-	-	-	-	-	-	-
72.0	24.8	24.8	19.9	19.9	16.8	16.8	-	-	-	-	-	-	-	-	-	-	-	-	-	-
78.0	19.5	19.5	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

HARDWARE SCHEDULE

A.	PVC PLASTIC CAM ACTION LOCKS, 5 1/2" FROM EACH END OF SASH LOCK STILE
B.	TANDEM METTALIC ROLLER WITH PLASTIC HOUSING SNAPPED INTO SASH BOTTOM RAIL, 2 1/4" FROM EACH END
C.	ALUMINUM REINFORCEMENT (10635) IN FIXED INTERLOCK
D.	ALUMINUM REINFORCEMENT (10712) IN ALL SASH STILES AND RAILS

SIGNED: 08/05/2026

KRESTMARK INDUSTRIES, L.P.
3950 BASTILLE RD., SUITE 100
DALLAS, TX 75212

200/275 VINYL HORIZONTAL SLIDER WINDOW
NON-IMPACT 72" X 48"
ELEVATION

DRAWN:
A.R.

DWG NO.
08-03919

REV
-

SCALE NTS

DATE 10/10/2023



SHEET 2 OF 5

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

LUIS R. LOMAS
LICENSED PROFESSIONAL ENGINEER
No. 62514
STATE OF FLORIDA


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

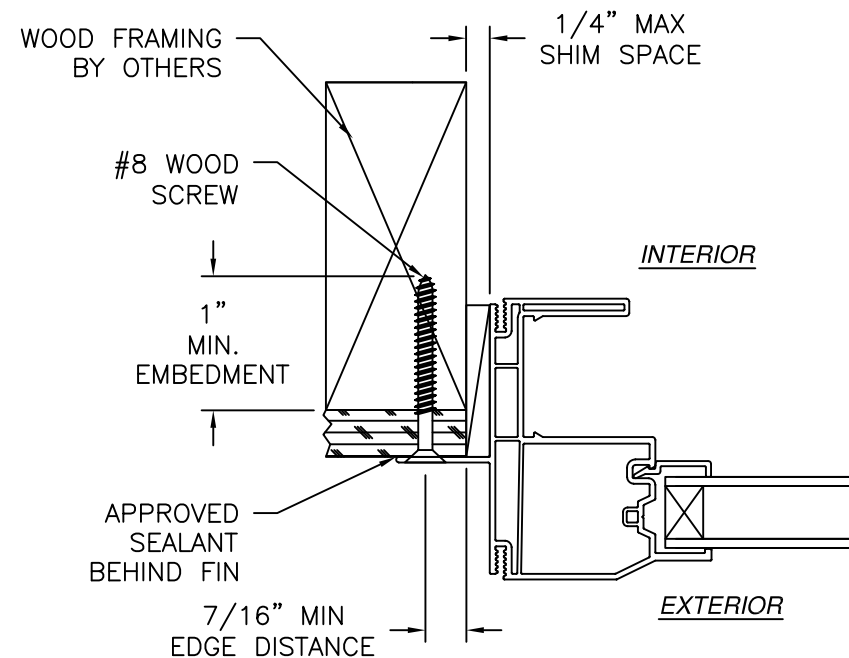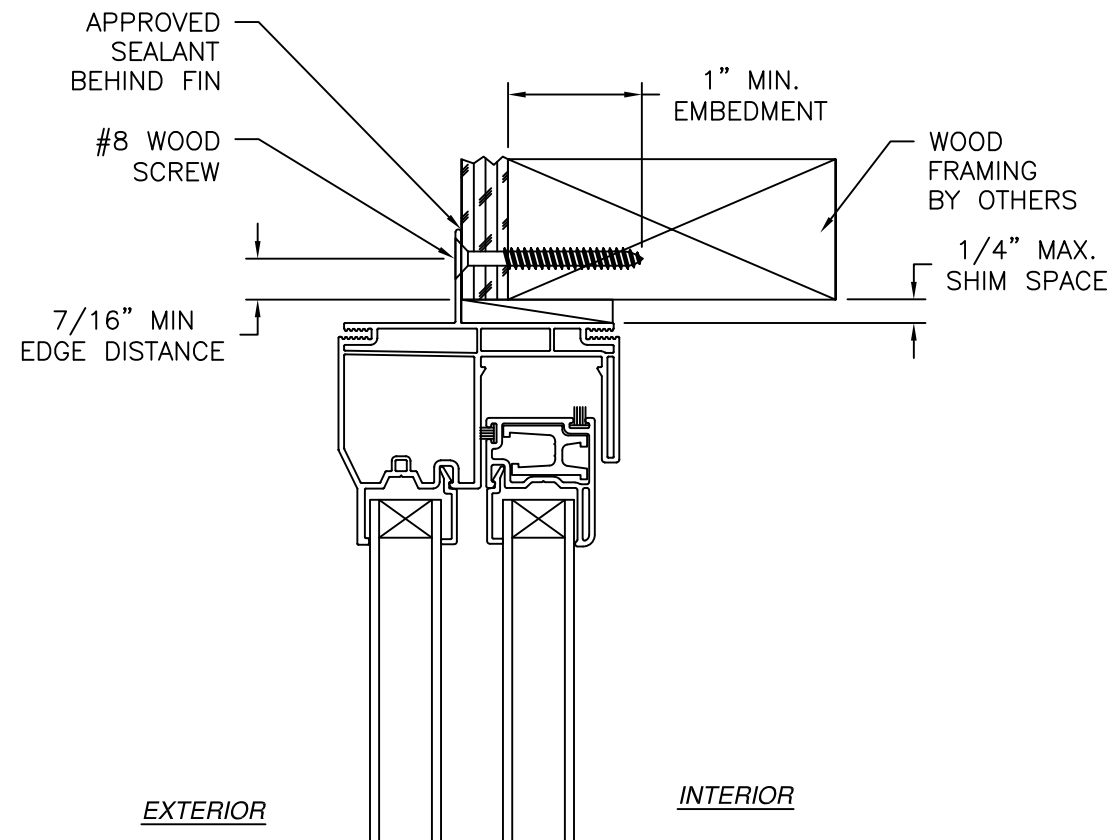

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

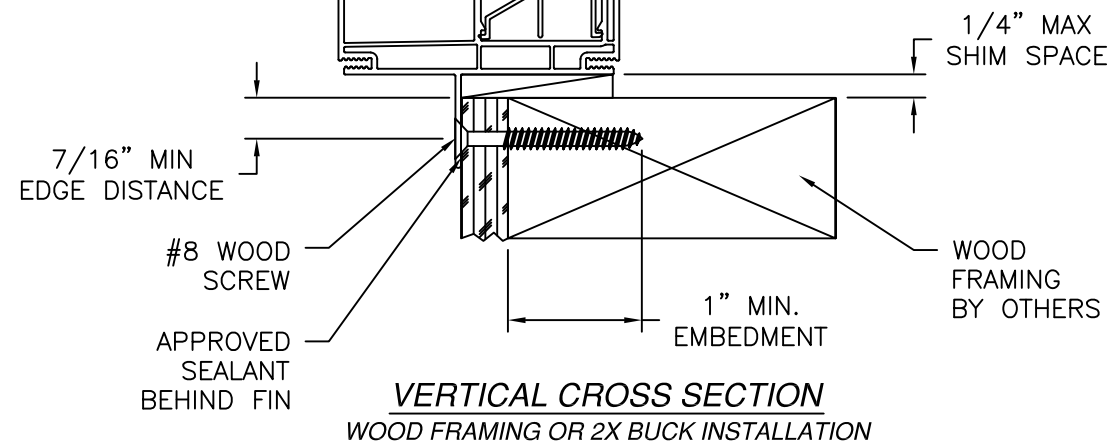

KRESTMARK INDUSTRIES, L.P.

3950 BASTILLE RD., SUITE 100
DALLAS, TX 75212

200/275 VINYL HORIZONTAL SLIDER WINDOW
NON-IMPACT 72" X 48"
INSTALLATION DETAILS

DRAWN:
A.R.

DWG NO.
08-03919

REV
-

SCALE
NTS

DATE
10/10/2023

SHEET
3 OF 5

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 08/05/2026

LUIS R. LOMAS

LICENS. M.S.

No. 62514

STATE OF



FLORIDA

PROFESSIONAL ENGINEER

Luis R. Lomas P.E.

FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

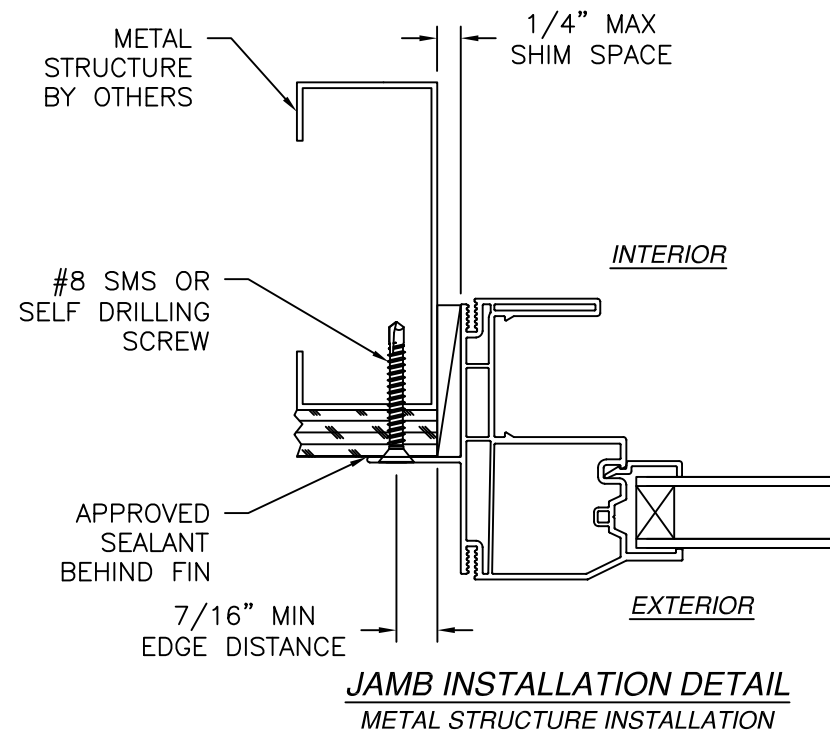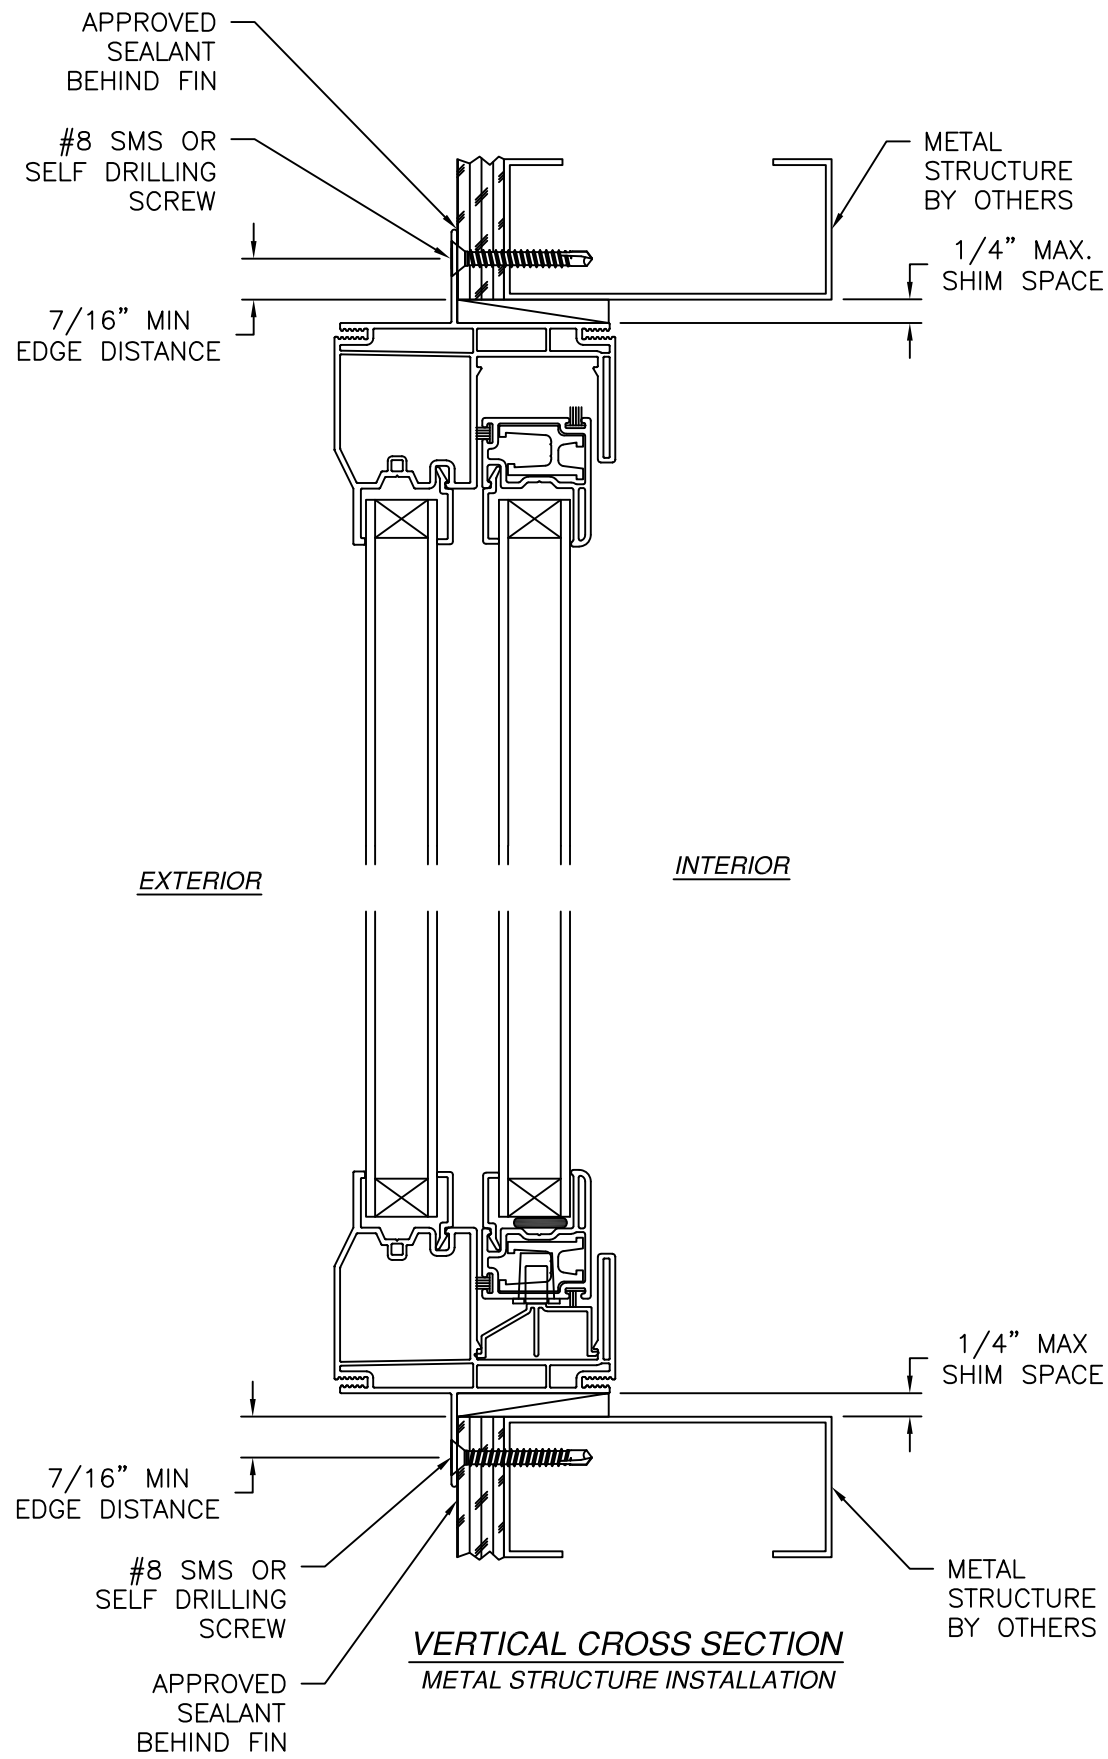


- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 08/05/2026

KRESTMARK INDUSTRIES, L.P. 3950 BASTILLE RD., SUITE 100 DALLAS, TX 75212			
200/275 VINYL HORIZONTAL SLIDER WINDOW NON-IMPACT 72" X 48" INSTALLATION DETAILS			
DRAWN: A.R.	DWG NO. 08-03919	REV -	
SCALE NTS	DATE 10/10/2023	SHEET 4 OF 5	
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com			Luis R. Lomas P.E. FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

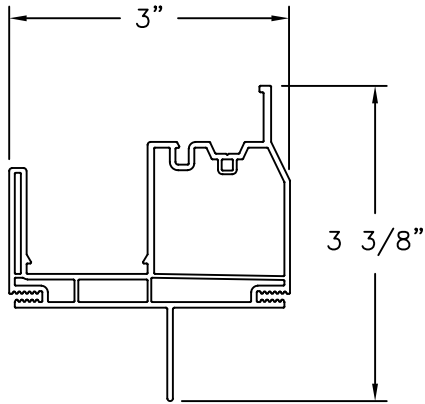


MAIN FRAME (9204)
EXTRUDED RIGID PVC

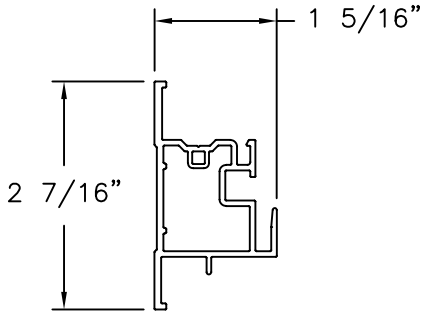


MEETING RAIL (9207)
EXTRUDED RIGID PVC

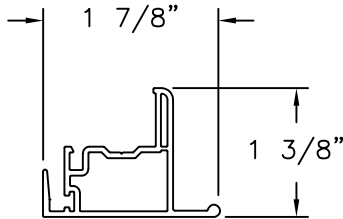


LOCK RAIL (9036)
EXTRUDED RIGID PVC




RAIL/ STILE (9008)
EXTRUDED RIGID PVC

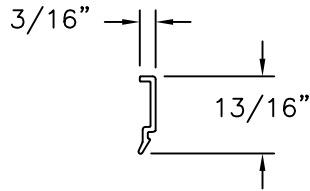


GLAZING BEAD (DT0848-R)
EXTRUDED RIGID PVC

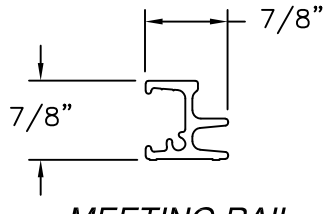

MEETING RAIL
REINFORCEMENT (10635)
ALUMINUM 6005-T5

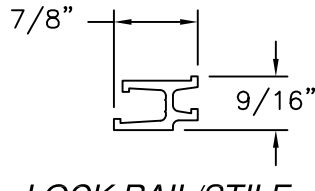


LOCK RAIL/STILE
REINFORCEMENT (10712)
ALUMINUM 6005-T5

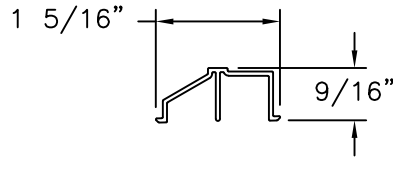

SILL TRACK (9247)
EXTRUDED RIGID PVC

SIGNED: 08/05/2026

KRESTMARK INDUSTRIES, L.P. 3950 BASTILLE RD., SUITE 100 DALLAS, TX 75212		
200/275 VINYL HORIZONTAL SLIDER WINDOW NON-IMPACT 72" X 48" COMPONENTS		
DRAWN: A.R.	DWG NO. 08-03919	REV -
SCALE NTS	DATE 10/10/2023	SHEET 5 OF 5
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

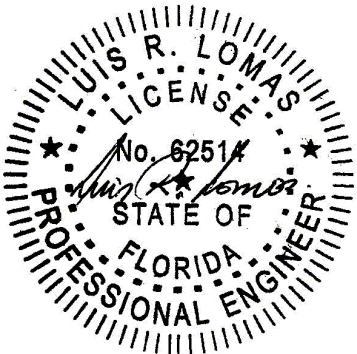

Luis R. Lomas P.E.
FL No.: 62514