

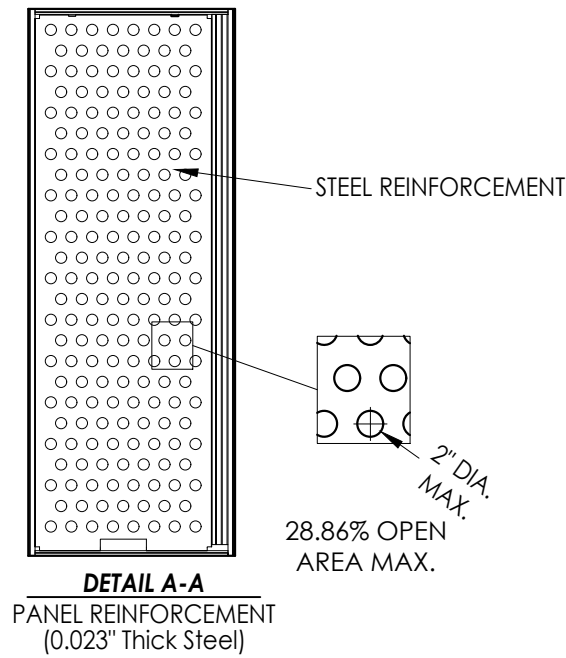
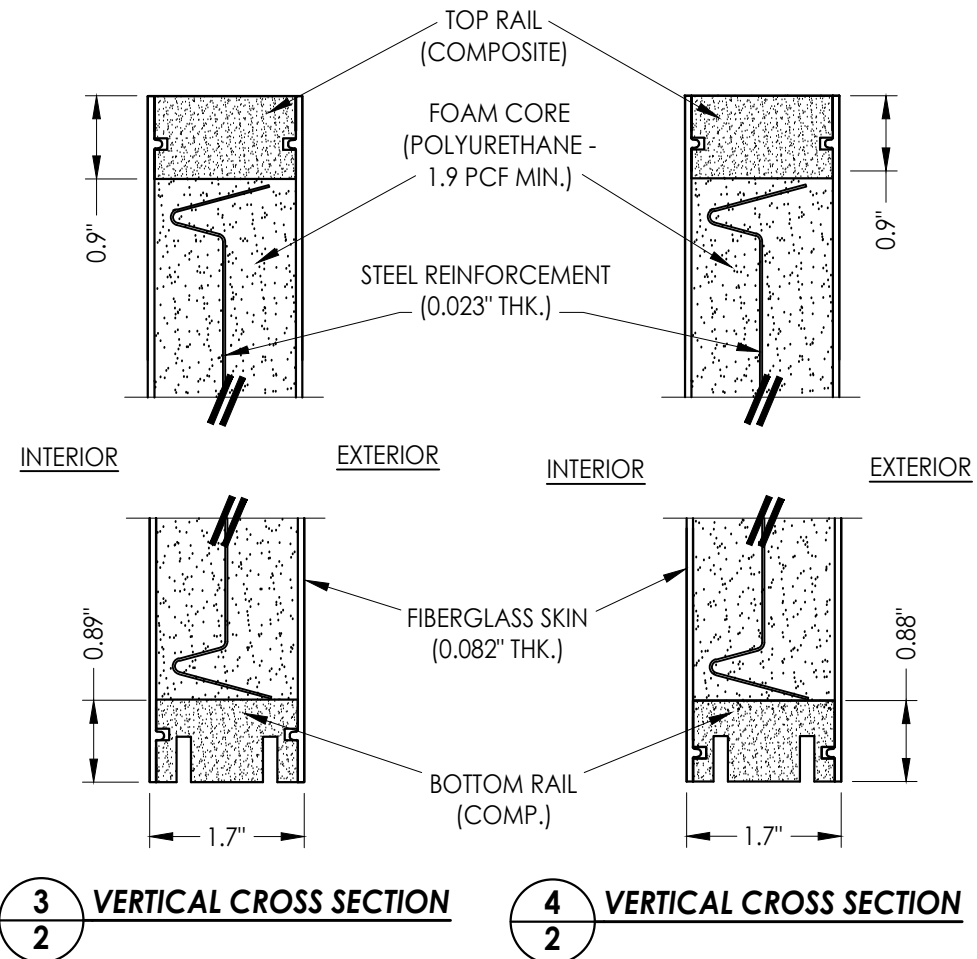
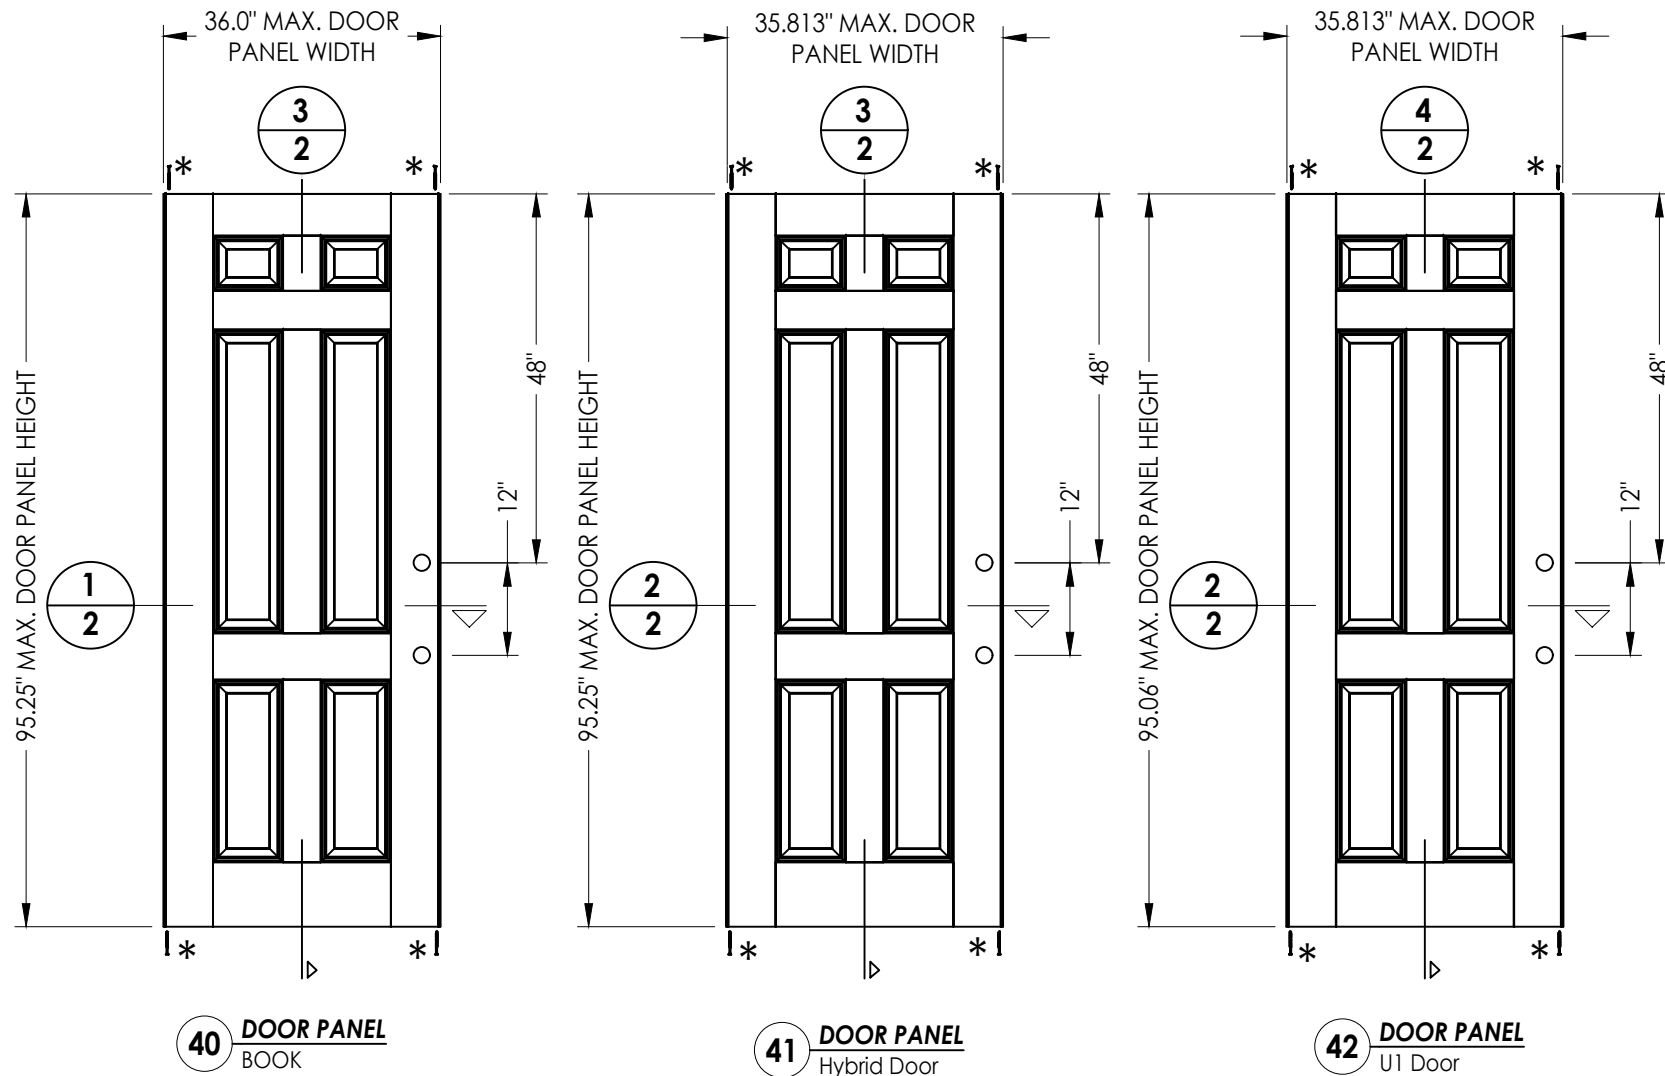


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-13459 R8\FL-13459.1-4.dwg

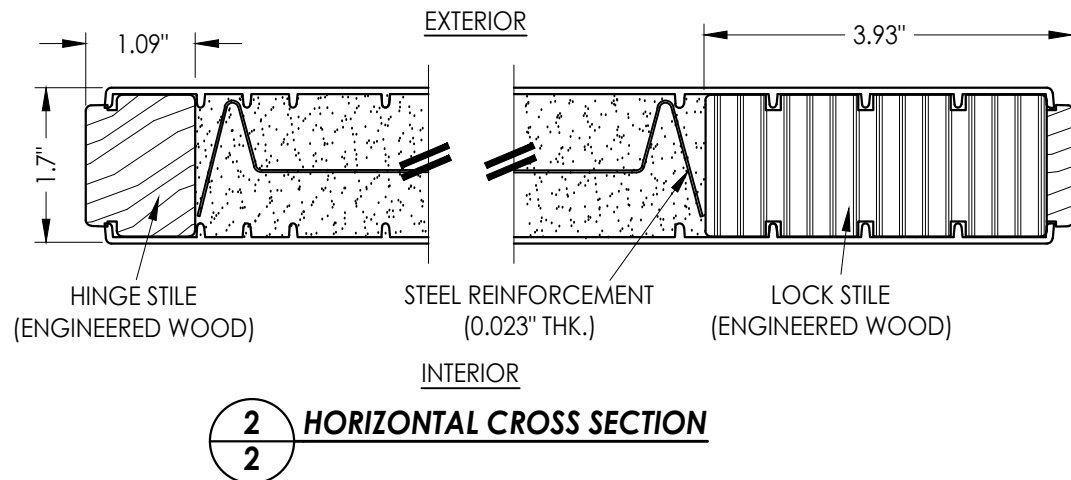

* #8 X 2.5" PFH WS (TYP. @ EACH DOOR CORNER)

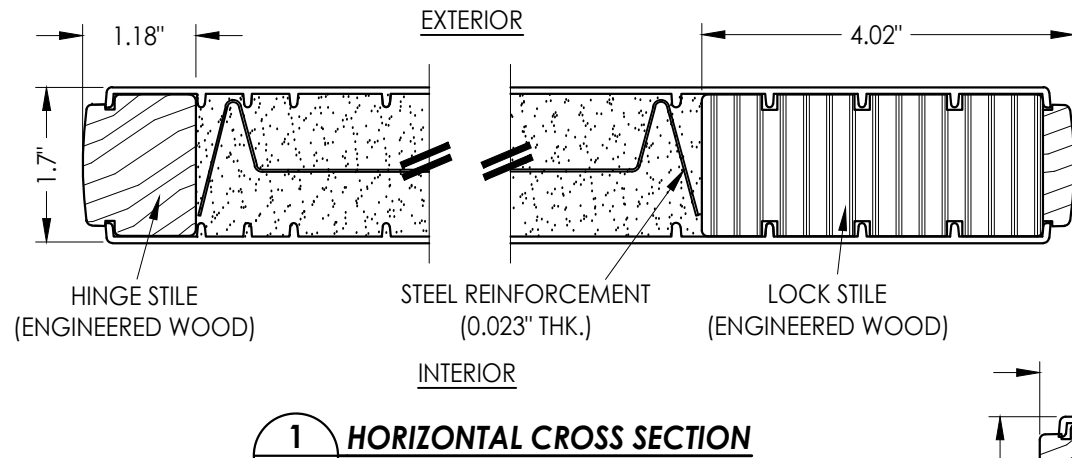

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


PART OR ASSEMBLY:
DOOR PANEL DETAILS

		REVISIONS				
		NO.	DATE	BY	JK	BY
4	7/02/26	UPDATE TO 9th ED (2026)	FBC	LFS		
3	7/10/23	UPDATE TO 8th ED (2023)	FBC	LFS		
2	7/14/20	UPDATE TO 7th ED (2020)	FBC	LFS		
1	7/17/19	UPDATE TO 6th ED (2017)	FBC	JK		
DATE: 4/28/15						
SCALE: N.T.S.						
DWG. BY: JK						
CHK. BY: LFS						
DRAWING NO.: FL-13459.3						
SHEET 2 OF 11						

G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-13459 R8\FL-13459.1-4.dwg

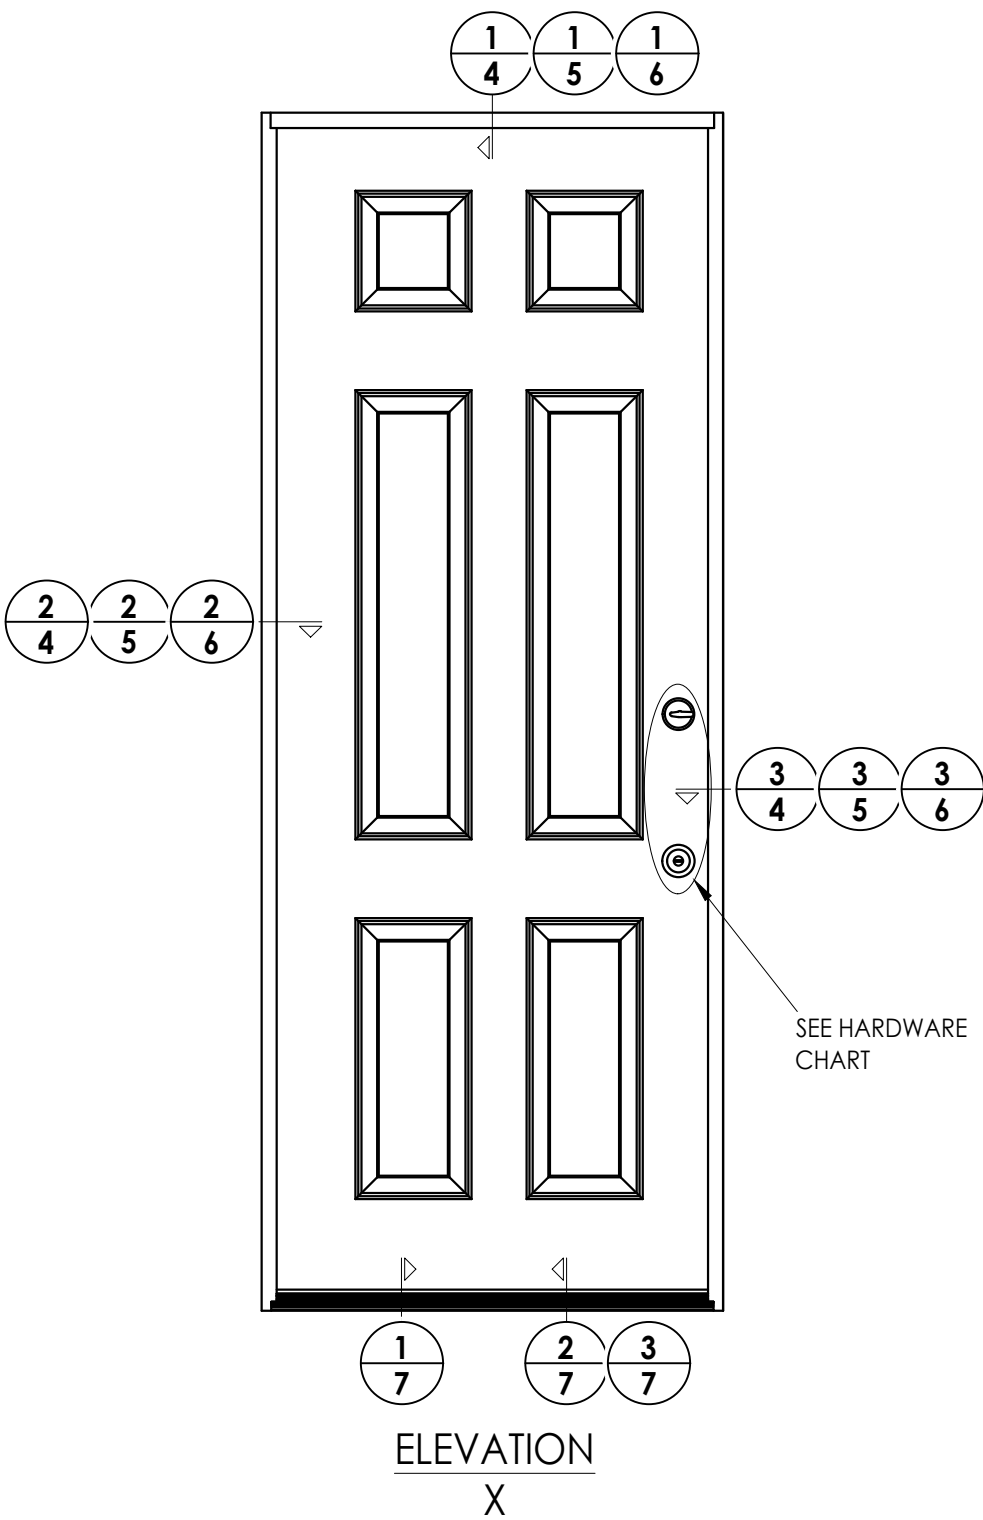

HARDWARE TABLE		
MANUFACTURER	MODEL	
SCHLAGE	KNOB:	F51
	DEADBOLT:	B60
KWIKSET	KNOB:	SIGNATURE SERIES
	DEADBOLT:	SIGNATURE SERIES (980)

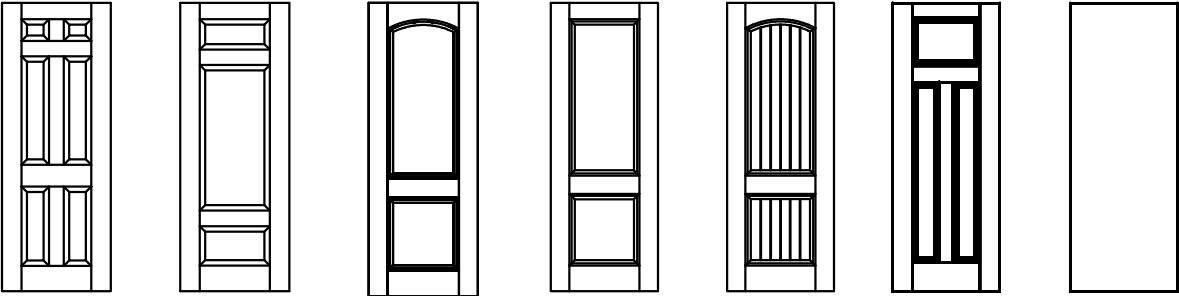

Benchmark Door Panel Options
Panel options shown are for illustration and are representative only
(similar opaque panel configurations are allowed)

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813		
PRODUCT: THERMA-TRU FIBERGLASS DOOR		PART OR ASSEMBLY: ELEVATIONS		
		REVISIONS		
4	7/02/26	UPDATE TO 9th ED (2026)	FBC	LFS
3	7/10/23	UPDATE TO 8th ED (2023)	FBC	LFS
2	7/14/20	UPDATE TO 7th ED (2020)	FBC	LFS
1	7/17/19	UPDATE TO 6th ED (2017)	FBC	JK
NO.	DATE			
DATE:		4/28/15		
SCALE:		N.T.S.		
DWG. BY:		JK		
CHK. BY:		LFS		
DRAWING NO.:		FL-13459.3		
SHEET		3 OF 11		


Technical drawing of a window assembly cross-section. The drawing shows the exterior (left) and interior (right) components. The exterior component is labeled 'EXTERIOR' and the interior component is labeled 'INTERIOR'. The drawing includes callouts A through E and dimensions. Callout A points to the exterior frame. Callout B points to the exterior sash. Callout C points to the interior sash. Callout D points to the exterior sash. Callout E points to the exterior frame. The dimensions are 1-1/4" MIN. and EMB. (TYP.).

Technical drawing of a window frame cross-section, showing both interior and exterior views. The drawing includes the following labels and dimensions:


- Interior View (Left):**
 - 0.15" C-SINK (TYP):** Dimension for the interior sealant.
 - 6:** Label for the interior sealant.
 - 40, 41, 42:** Labels for the interior frame components.
 - 27:** Label for the interior frame component.
 - 1:** Label for the interior frame component.
- Exterior View (Right):**
 - 1.15" MIN. EMB. (TYP.):** Dimension for the exterior sealant.
 - B:** Label for the exterior frame component.
 - C:** Label for the exterior frame component.
 - E:** Label for the exterior sealant.
 - L:** Label for the exterior frame component.
 - D:** Label for the exterior frame component.
 - L:** Label for the exterior frame component.
 - 1-1/4" MIN. EMB. (TYP.):** Dimension for the exterior sealant.

© 2015 R.W. BUILDING CONSULTANTS INC.


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-13459 R8\FL-13459.1-4.dwg

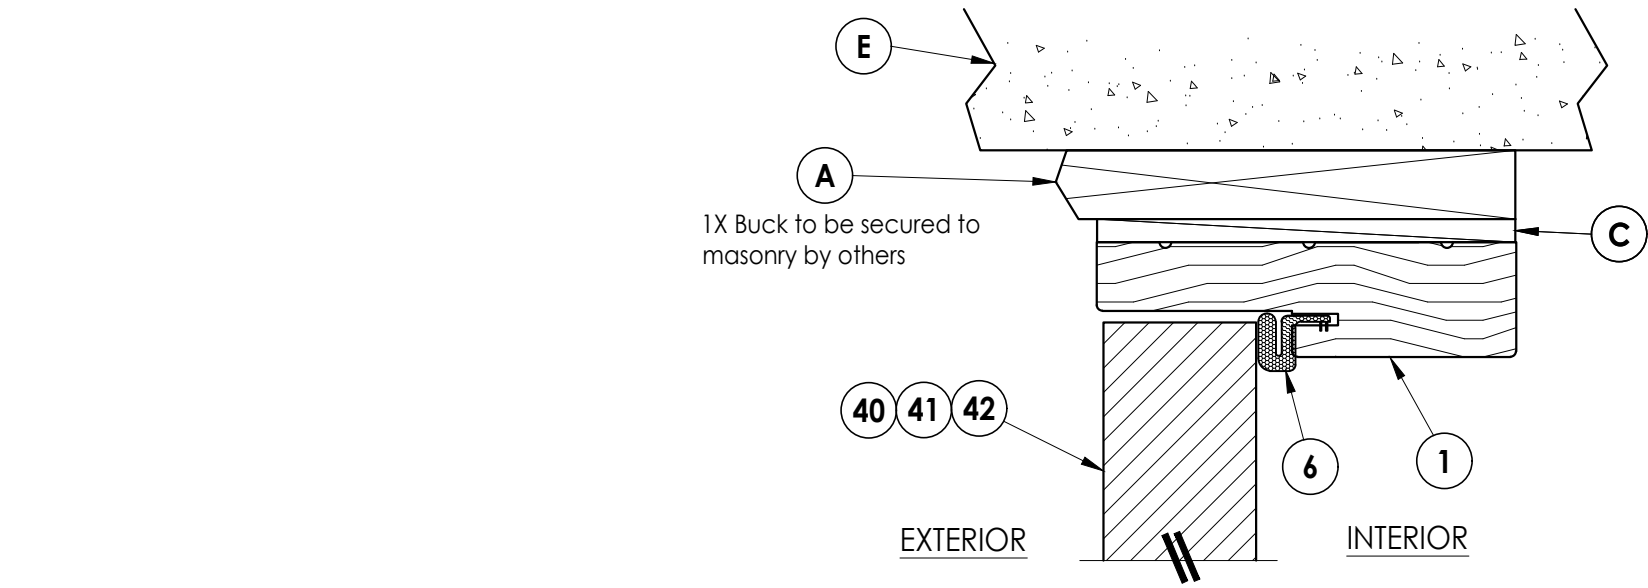

1 VERTICAL CROSS SECTION
5 Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

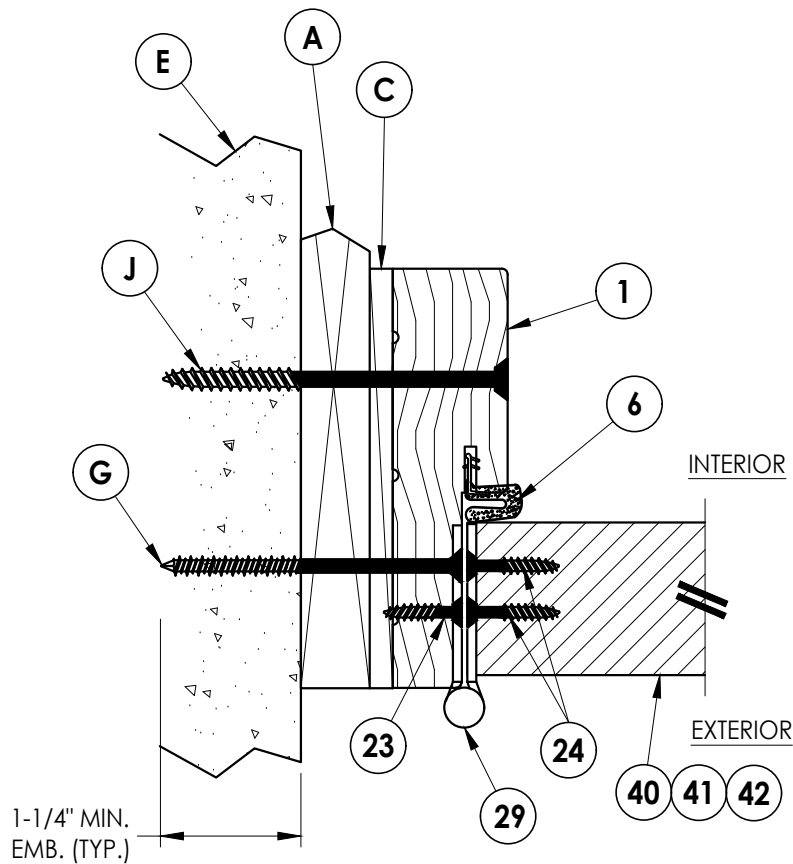

2 HORIZONTAL CROSS SECTION
5 Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

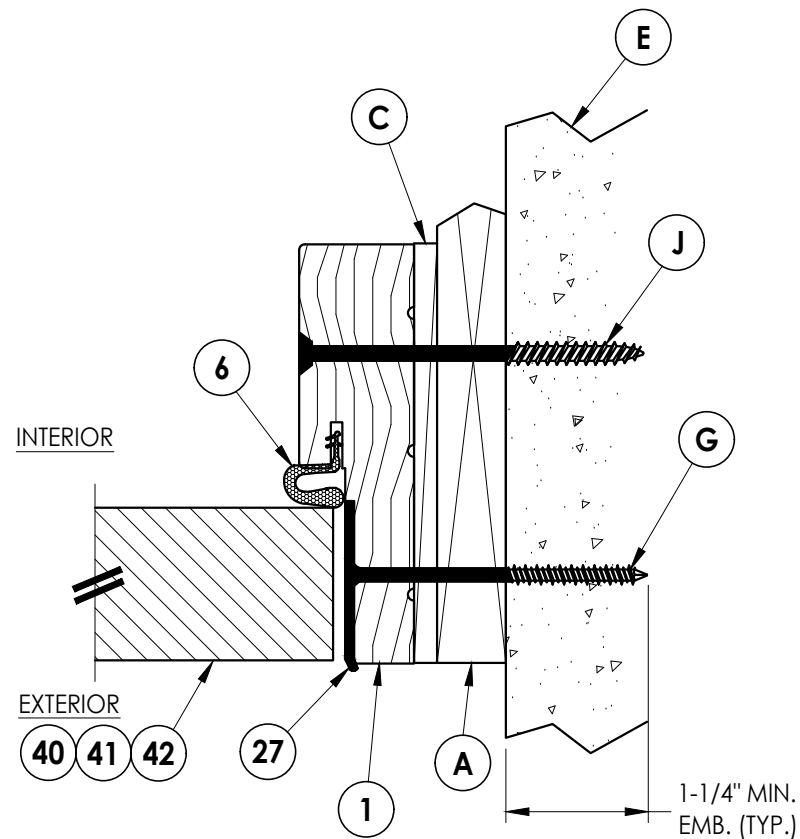

3 HORIZONTAL CROSS SECTION
5 Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (1X BUCK)

NO.	DATE	REVISIONS			
		BY	DATE	DESCRIPTION	DATE
4	7/02/26	JK	2026	UPDATE TO 9th ED	7/02/26
3	7/10/23	JK	2023	UPDATE TO 8th ED	7/10/23
2	7/14/20	JK	2020	UPDATE TO 7th ED	7/14/20
1	7/17/19	JK	2017	UPDATE TO 6th ED	7/17/19

DATE: 4/28/15

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS


DRAWING NO.:

FL-13459.3

SHEET 5 OF 11

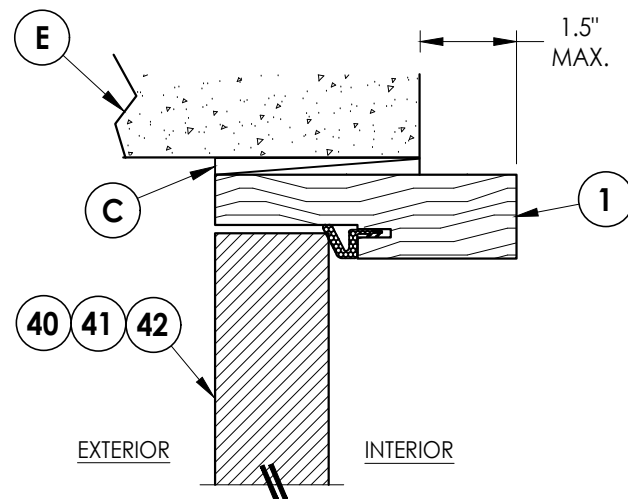


1 **VERTICAL CROSS SECTION**
6 Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb

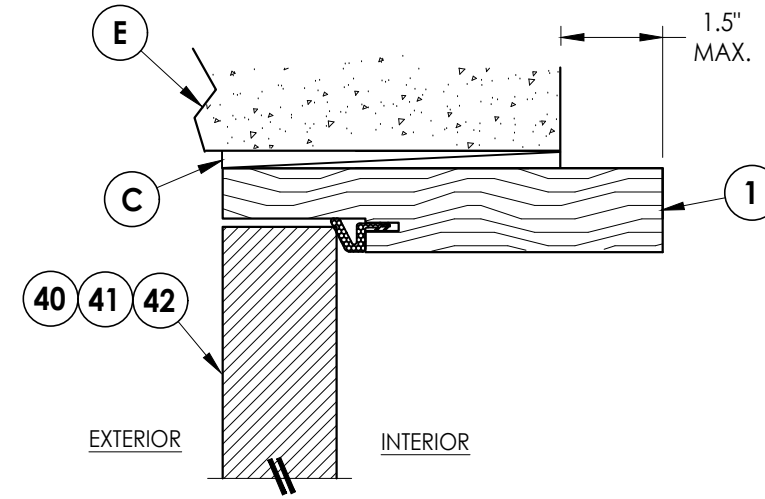


4 **VERTICAL CROSS SECTION**
6 Shown Direct to Masonry
 Outswing only w/ 6-9/16" jamb

DIRECT TO MASONRY MAX. DESIGN PRESSURE:
w/ STANDARD STRIKE = ± 47 PSF
w/ SECURITY STRIKE = ± 55 PSF

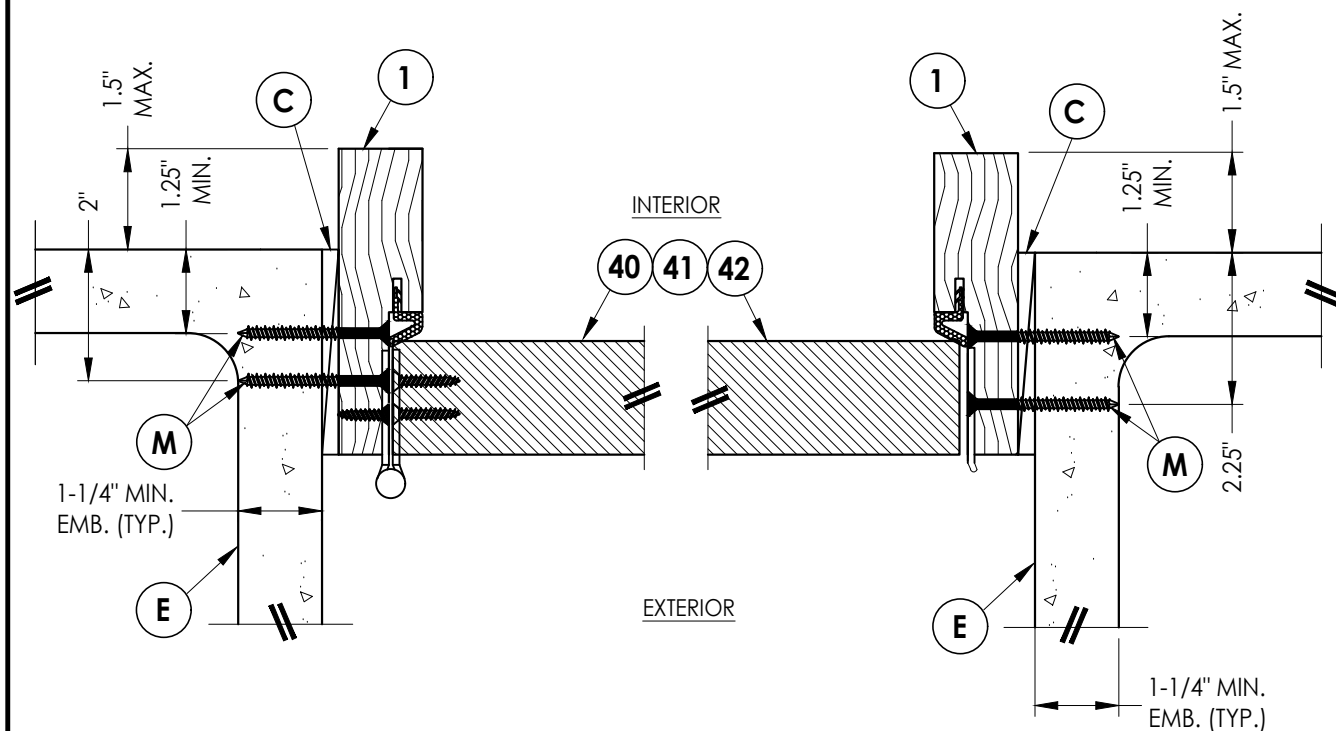

2 **HORIZONTAL CROSS SECTION**
6 Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb

3 **HORIZONTAL CROSS SECTION**
6 Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb

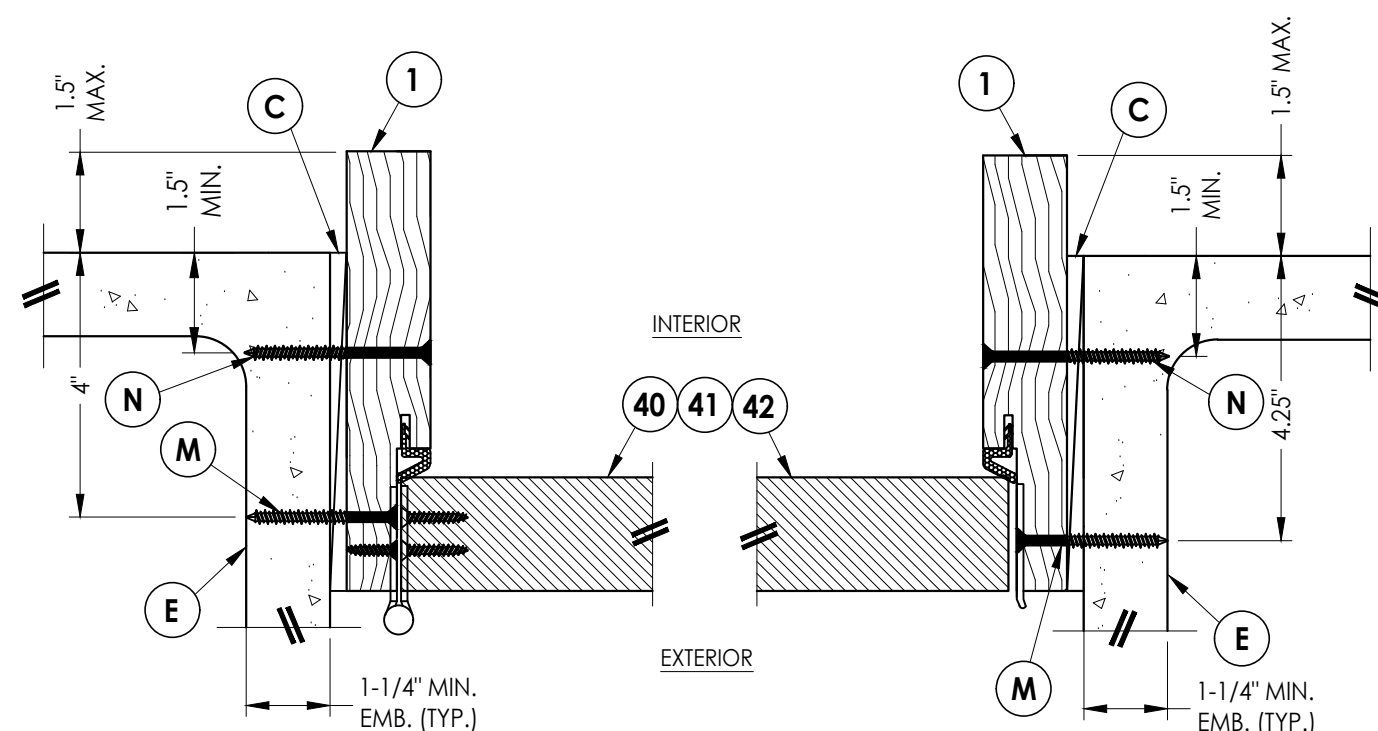

5 HORIZONTAL CROSS SECTION
6 Shown Direct to Masonry
 Outswing only w/ 6-9/16" jamb

6 HORIZONTAL CROSS SECTION
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

DATE: 4/28/15		PRODUCT: THERMA-TRU FIBERGLASS DOOR	
SCALE: N.T.S.		PART OR ASSEMBLY: HORIZONTAL & VERTICAL SECTIONS (DIRECT TO MASONRY)	
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-13459.3			
SHEET 6 OF 11			

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R^W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

1. Sill Item #'s 32, 38, 39, 43, 44, 45, 46, 47 & 48 are attached to jambs w/ (3) #8 X 2-1/2" pph screws or (3) 2.5" 16 GA. STAPLES at each end.
2. Sill Item #'s 16, 17, 18 & 19 are attached to jambs w/ (2) #8 X 2-1/2" pph screws at each end.
3. Sill Item #15 is attached to jambs utilizing (2) #10 X 2" pph SMS screws at each end.


[illegible]

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


R^W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2015 R.W. BUILDING CONSULTANTS INC.



G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-13459 R8\FL-13459.1-4.dwg

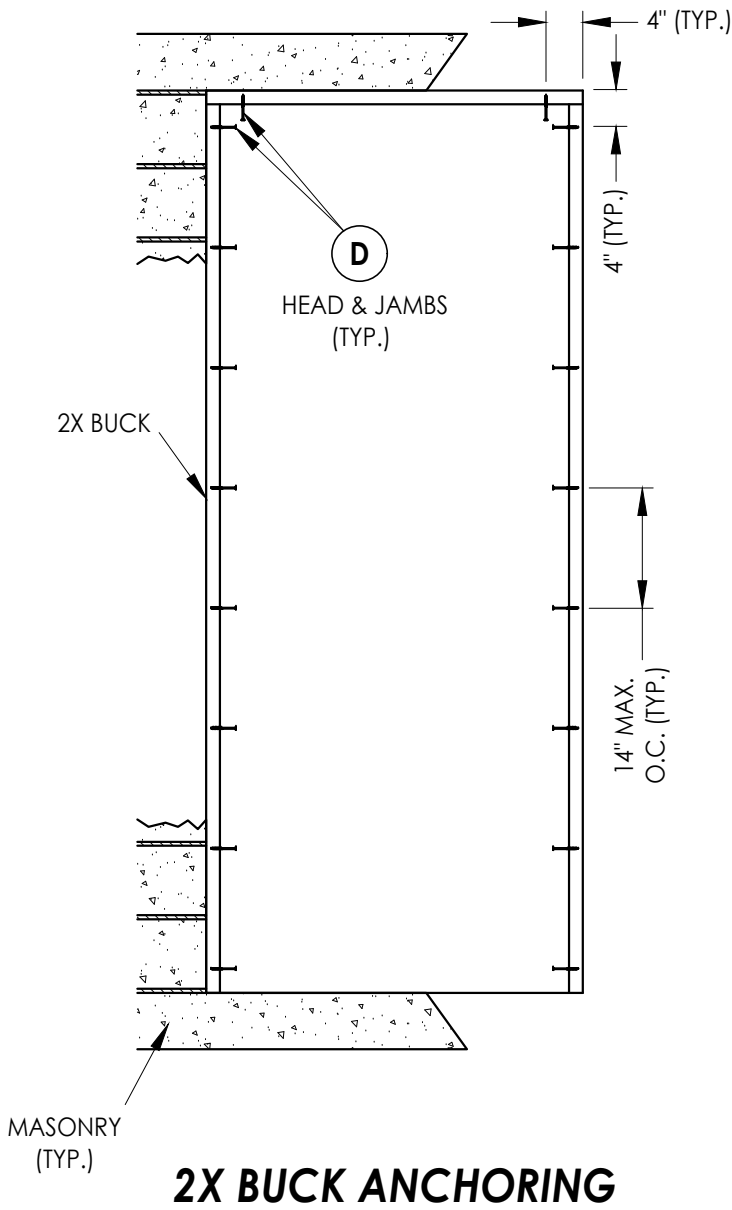

2X BUCK ANCHORING

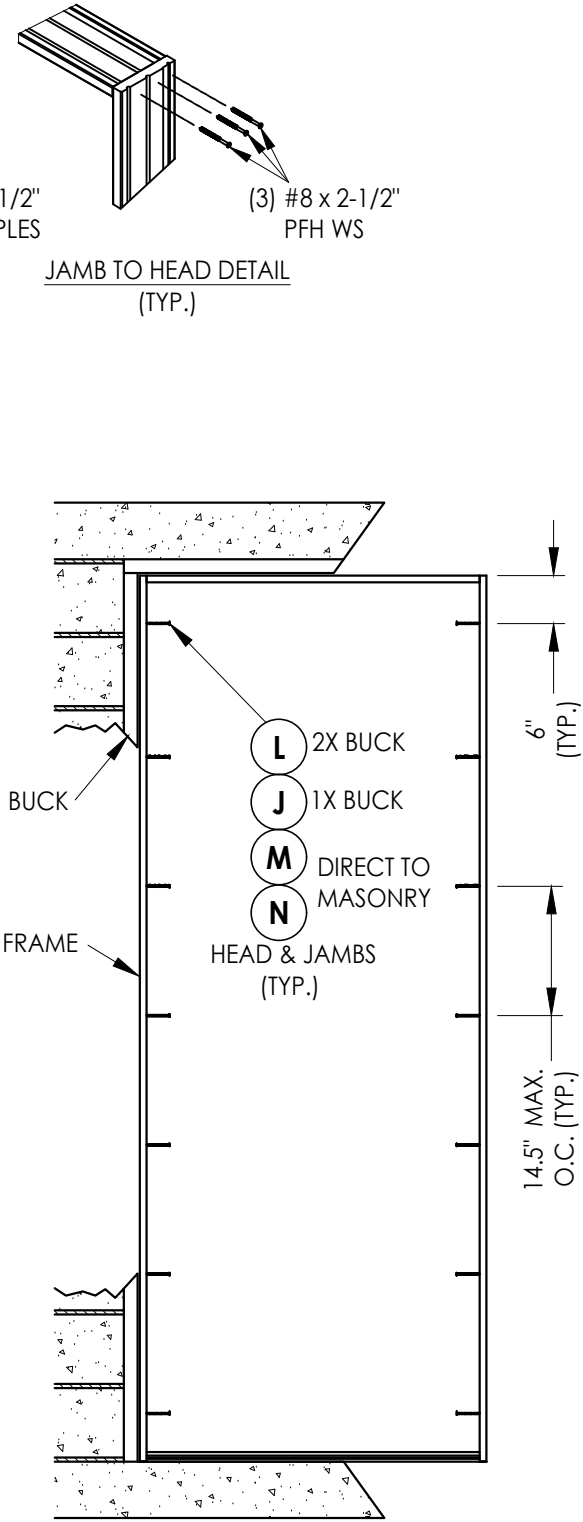

FRAME ANCHORING

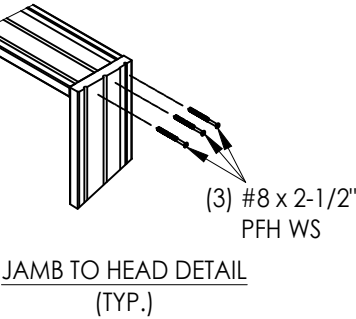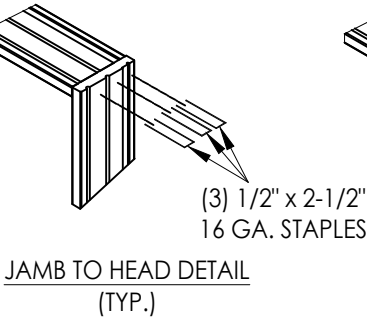

NO.		DATE	REVISIONS			
4	7/02/26	UPDATE TO 9th ED (2026)	FBC	LFS		
3	7/10/23	UPDATE TO 8th ED (2023)	FBC	LFS		
2	7/14/20	UPDATE TO 7th ED (2020)	FBC	LFS		
1	7/17/19	UPDATE TO 6th ED (2017)	FBC	JK		
				BY		

DATE: 4/28/15

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-13459.3

SHEET 8 OF 11



PRODUCT: THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
BUCK AND FRAME ANCHORING





Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R.W. BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-13459 R8\FL-13459.1-4.dwg

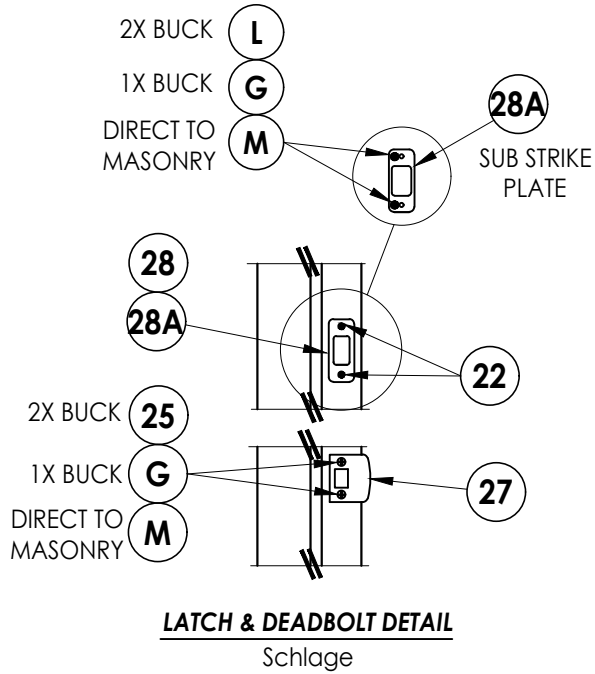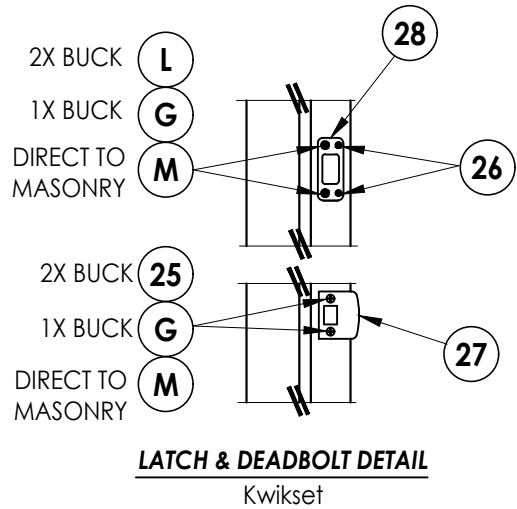

LATCH & DEADBOLT STRIKE DETAILS

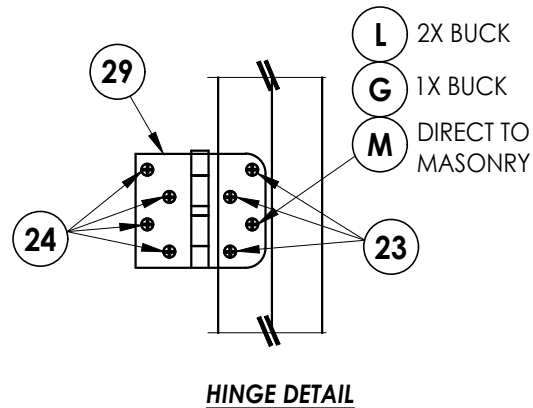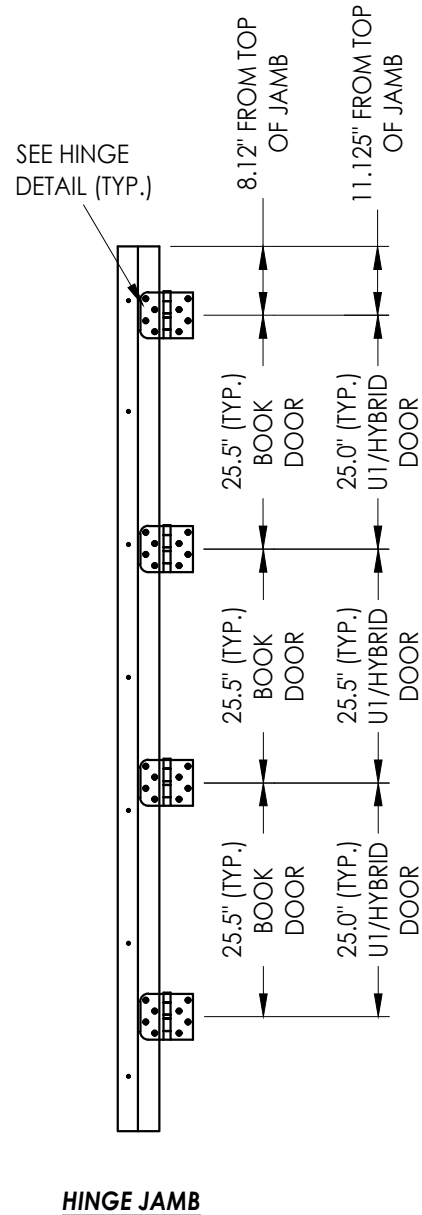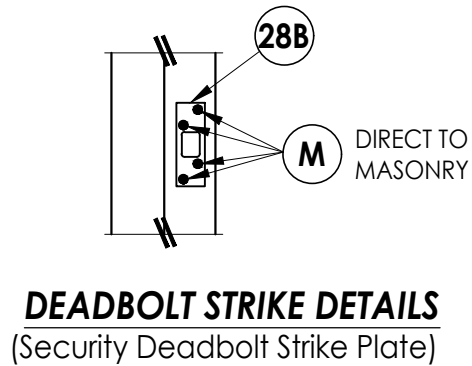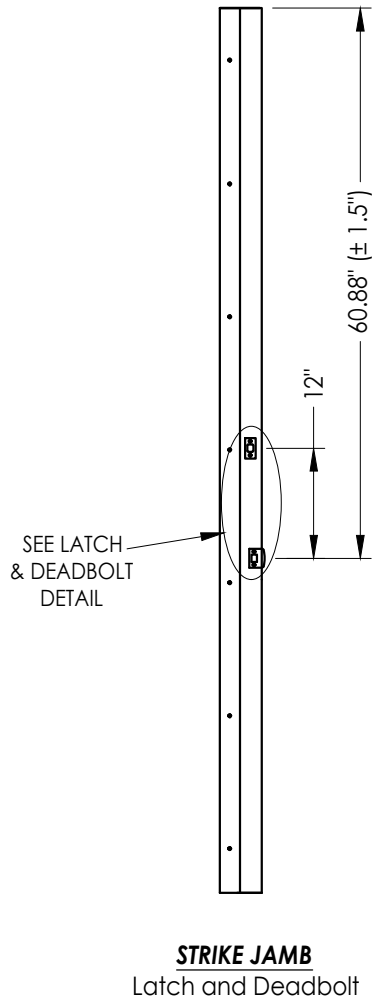


NO.	DATE	REVISIONS			
		DATE	BY	JK	LFS
4	7/02/26	UPDATE TO 9th ED (2026)	FBC	LFS	
3	7/10/23	UPDATE TO 8th ED (2023)	FBC	LFS	
2	7/14/20	UPDATE TO 7th ED (2020)	FBC	LFS	
1	7/17/19	UPDATE TO 6th ED (2017)	FBC	JK	

DATE:	4/28/15
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-13459.3
SHEET	9 OF 11


PRODUCT:	THERMA-TRU FIBERGLASS DOOR
PART OR ASSEMBLY:	HARDWARE DETAILS

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409	RW BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813
---	--


G:\2023 FBC DRAWINGS 7-27-26\Therma-Tru\FL-13459 R8\FL-13459.1-4.dwg

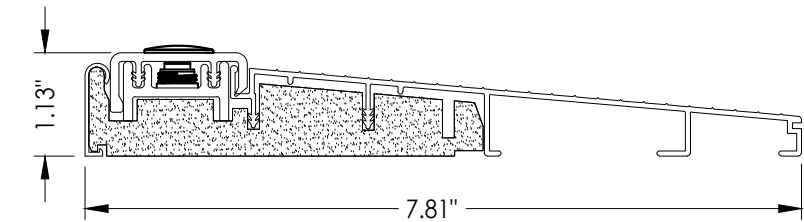


32 INSWING THRESHOLD
Inswing Composite Adjustable 7-3/4" Sill

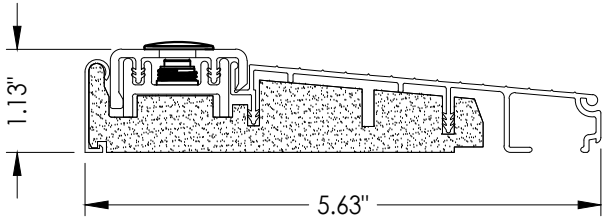


39 INSWING THRESHOLD
Inswing Composite Adjustable Sill

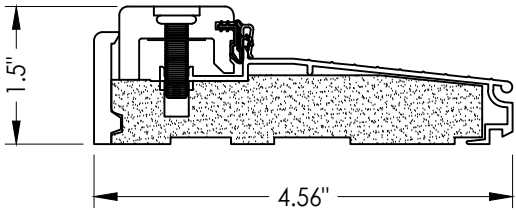


38 INSWING THRESHOLD
Inswing Composite Adjustable Sill

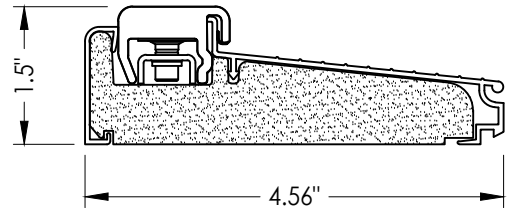


43 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

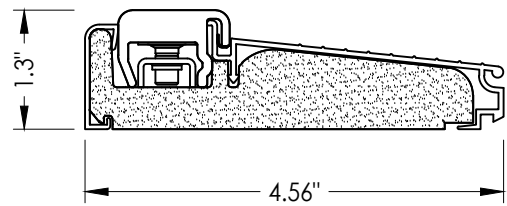


46 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

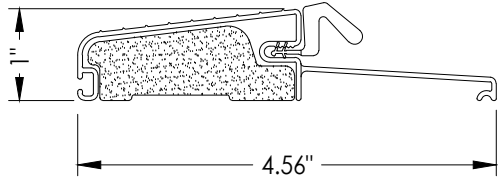


16 OUTSWING THRESHOLD
Composite Sill

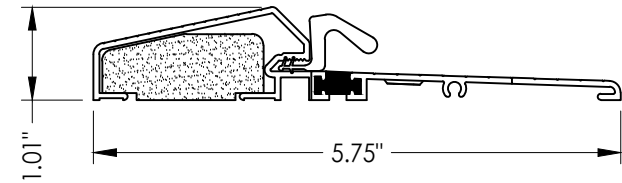


18 OUTSWING THRESHOLD
Composite / Aluminum Sill
(Thermal Break)

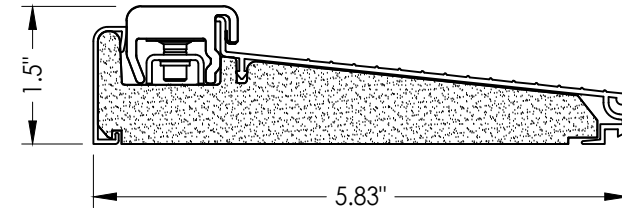


44 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

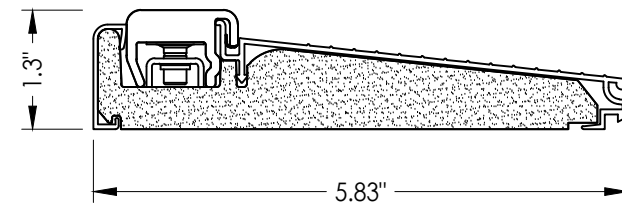


47 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

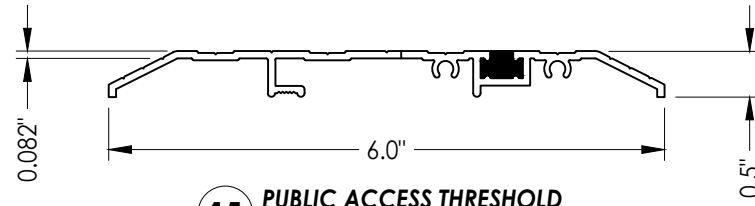


15 PUBLIC ACCESS THRESHOLD

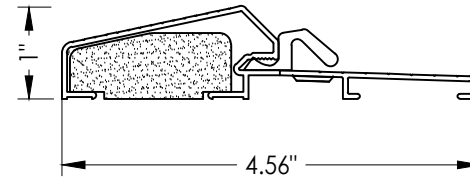


17 OUTSWING THRESHOLD
Composite / Aluminum Sill

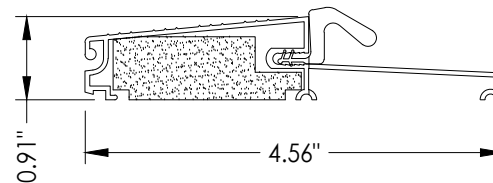

19 OUTSWING THRESHOLD
Composite Sill

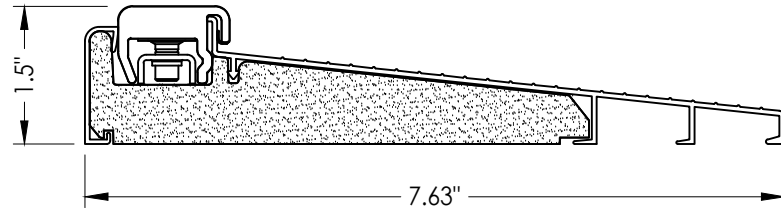

45 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

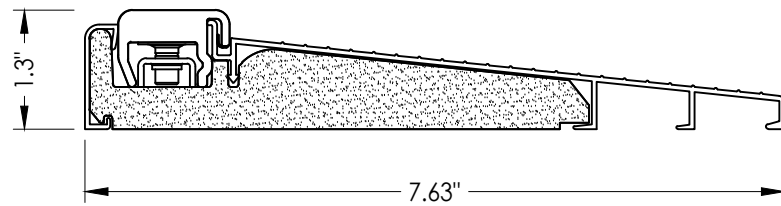

48 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Vairico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:

COMPONENTS

NO.	DATE	REVISIONS			
		DATE	BY	JK	LFS
4	7/02/26	UPDATE TO 9th ED (2026)	FBC	LFS	
3	7/10/23	UPDATE TO 8th ED (2023)	FBC	LFS	
2	7/14/20	UPDATE TO 7th ED (2020)	FBC	LFS	
1	7/17/19	UPDATE TO 6th ED (2017)	FBC	JK	

DATE: 4/28/15

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-13459.3

SHEET 10 OF 11

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.42)	WOOD
B	2X BUCK (SG >= 0.42)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
G	3/16" X 3-1/4" ITW CONCRETE SCREW	STEEL
J	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL
M	3/16" X 2-1/4" ITW CONCRETE SCREW	STEEL
N	3/16" X 2-3/4" ITW CONCRETE SCREW	STEEL
1	JAMB (FINGER JOINT PINE)	WOOD
2	JAMB (FINGER JOINT PINE)	WOOD
6	WEATHERSTRIP (MEDIUM REACH)	FOAM
7	WEATHERSTRIP (LONG REACH)	FOAM
8	SWEEP	VINYL
9	SWEEP	VINYL
10	SWEEP (USE w/ PUBLIC ACCESS THRESHOLD)	VINYL
15	PUBLIC ACCESS THRESHOLD	ALUM
16	OUTSWING THRESHOLD	ALUM/COMP
17	OUTSWING THRESHOLD	ALUM/COMP
18	OUTSWING THRESHOLD	ALUM/COMP
19	OUTSWING THRESHOLD	ALUM/COMP
22	#8 x 3/4" PFH WOOD SCREW	STEEL
23	#10 x 3/4" PFH WOOD SCREW	STEEL
24	#10 x 1" PFH WOOD SCREW	STEEL

CONCRETE ANCHOR NOTES:






1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON+	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	AS SHOWN	1-1/2"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
25	#8 x 2-1/2" PFH WOOD SCREW	STEEL
26	#8 x 5/8" PFH WOOD SCREW	STEEL
27	LATCH STRIKE PLATE	STEEL
28	DEADBOLT STRIKE PLATE (STANDARD)	STEEL
28A	DEADBOLT SUB STRIKE PLATE	STEEL
28B	DEADBOLT STRIKE PLATE (SECURITY)	STEEL
29	4" X 4" HINGE	STEEL
32	INSWING THRESHOLD	ALUM/COMP
38	INSWING THRESHOLD	ALUM/COMP
39	INSWING THRESHOLD	ALUM/COMP
40	DOOR PANEL (BOOK)	-
41	DOOR PANEL (HYBRID)	-
42	DOOR PANEL (U1)	-
43	INSWING THRESHOLD	ALUM/COMP
44	INSWING THRESHOLD	ALUM/COMP
45	INSWING THRESHOLD	ALUM/COMP
46	INSWING THRESHOLD	ALUM/COMP
47	INSWING THRESHOLD	ALUM/COMP
48	INSWING THRESHOLD	ALUM/COMP

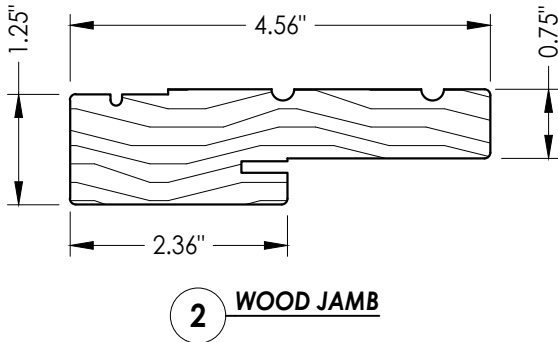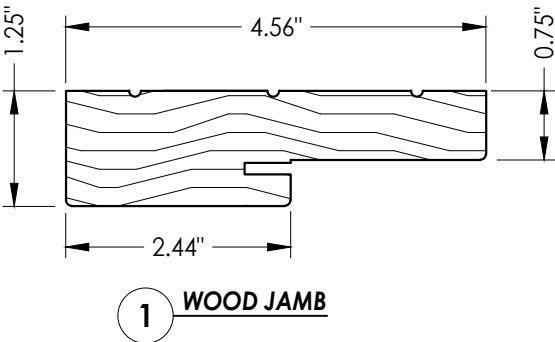

CORROSION RESISTANCE - SALTWATER ENVIRONMENT

Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or R332.1.

[illegible]