

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED TO ADD CORROSION CHART	09/28/26	R.L.

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. WOOD FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
4. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1–1/2” UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER’S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
5. WHERE WOOD BUCK THICKNESS IS 1–1/2” OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER’S PUBLISHED INSTALLATION INSTRUCTIONS.
6. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
7. BUCKS SHALL EXTEND BEYOND UNIT FRAME INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
8. SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16” OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4”.
9. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
10. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
11. FRAME MATERIAL: WOOD G .46 MINIMUM OR FRAMESAVER, OR FUSION FRAME.
12. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
13. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4” MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

14. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 3/16” TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4” MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2” MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
15. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #8 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. ALL FASTENERS TO BE CORROSION RESISTANT.
17. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER’S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:

A. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42

B. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.

C. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH Fm=2,000PSI MINIMUM.

D. METAL STRUCTURE: STEEL 18GA (.048”) FY=33KSI/FU=52KSI OR ALUMINUM 6063–T5 FU=30KSI .048” THICK MINIMUM
18. DOOR PANEL MATERIAL: 20GA. STEEL SKIN WITH .054” STEEL TOP AND BOTTOM RAILS.
19. UNITS MAY BE INSTALLED WITH EITHER SCHLAGE F–SERIES DOOR KNOB AND B–SERIES OR F–SERIES DEADBOLT OR EMTEK RESIDENTIAL GRADE DOOR HANDLE ASSEMBLY OR MULTI–POINT LOCK HANDLE ASSEMBLY BY TRILENNIUM. SEE HARDWARE SCHEDULE SHEET 3 FOR APPROVED HARDWARE.

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2 – 3	ELEVATIONS
4	ANCHORING LAYOUTS
5 – 10	INSTALLATION DETAILS
11 – 12	COMPONENTS AND HINGES DETAILS

PROVIA, LLC.
2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

20GA. STEEL ENTRY DOOR
IS/OS
NOTES

DRAWN:
TJH

DWG NO.
08–00905

REV
E


SCALE NTS

DATE 12/16/09

SHEET 1 OF 12

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com


SIGNED: 09/28/2026

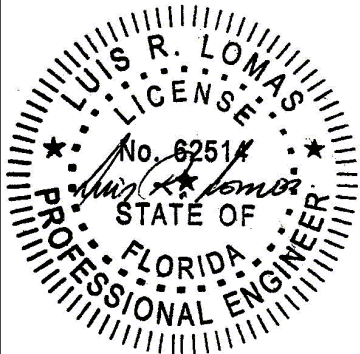


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED TO ADD CORROSION CHART	09/28/26	R.L.

HARDWARE SCHEDULE	
A.	F-SERIES LOCK ASSEMBLY DOOR KNOB BY SCHLAGE.
B.	B-SERIES DEADBOLT ASSEMBLY BY SCHLAGE.
C.	F-SERIES DEADBOLT ASSEMBLY BY SCHLAGE.
D.	RESIDENTIAL GRADE DOOR HANDLE ASSEMBLY BY EMTEK (ALTERNATE).
E.	MULTI-POINT LOCK HANDLE ASSEMBLY BY TRILENNIUM (ALTERNATE).
F.	INSWING HURRICANE ASTRAGAL BY ENDURA.
G.	OUTSWING HURRICANE ASTRAGAL BY ENDURA.
H.	(3) 4" x 4" BALL BEARING HINGES BY PENROD.
I.	(3) 4" x 4" SPRING BOMMER HINGES BY PENROD.

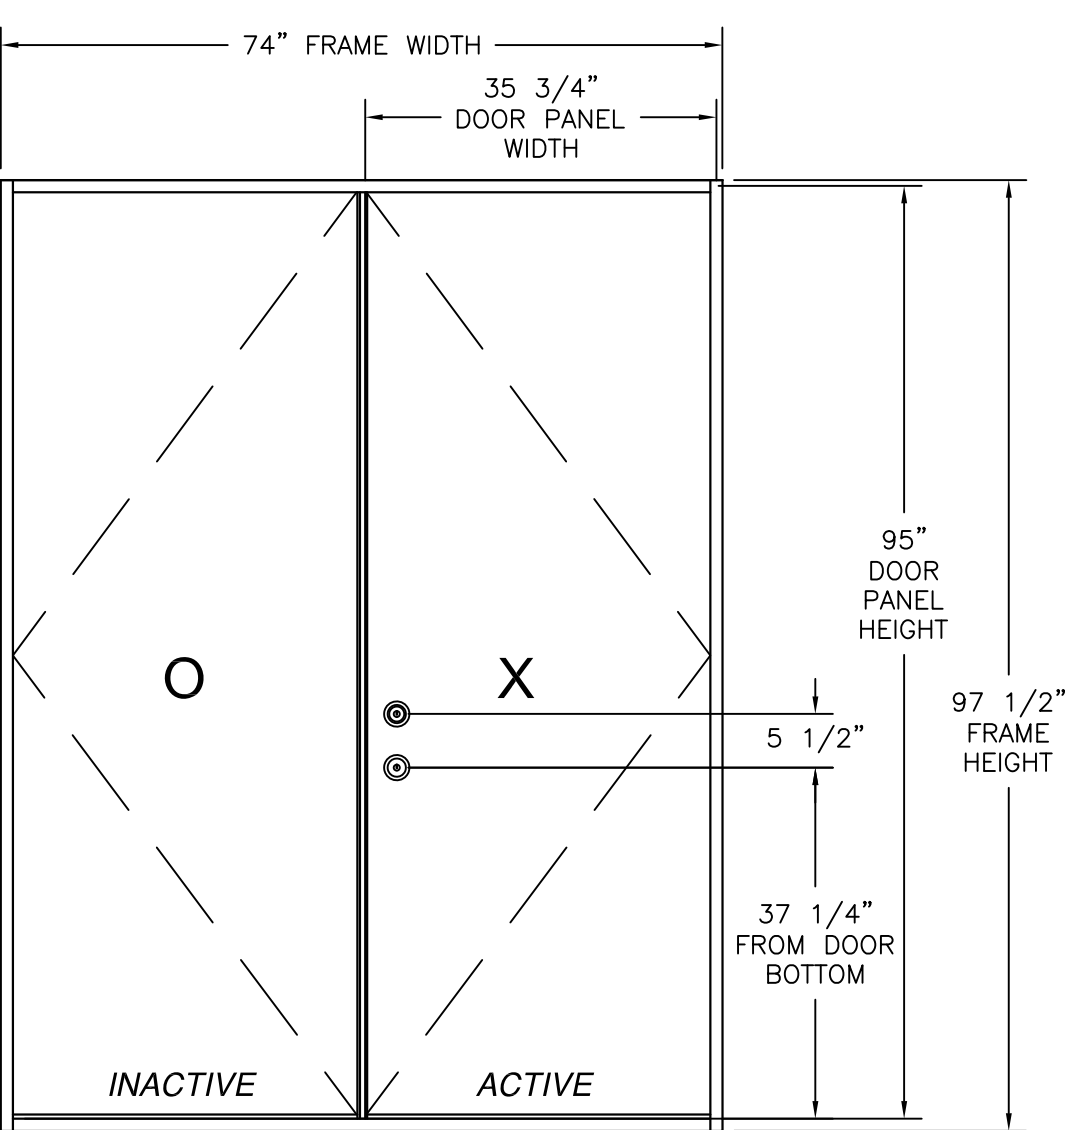

20GA. STEEL
INSWING DOUBLE DOOR
EXTERIOR VIEW

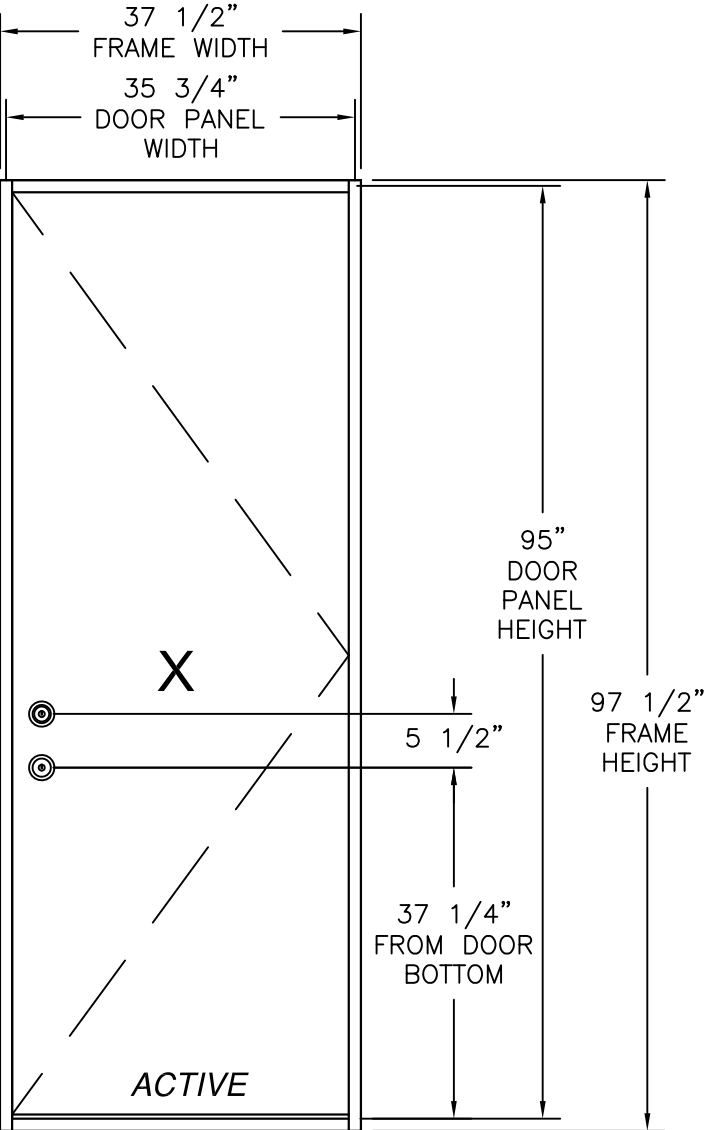


20GA. STEEL
INSWING SINGLE DOOR
EXTERIOR VIEW

DESIGN PRESSURE RATING	IMPACT RATING
±51.0PSF	LARGE AND SMALL MISSILE IMPACT
THIS SYSTEM WAS NOT TESTED FOR WATER INFILTRATION AND IS TO BE INSTALLED ONLY WHERE THE WATER REQUIREMENT IS NOT NEEDED	

35 3/4" X 95" PANEL SHOWN, OTHER SIZES APPROVED AS LONG AS
INDIVIDUAL PANEL AREA DOES NOT EXCEED 23.58 FT²


PROVIA, LLC. 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681		
20GA. STEEL ENTRY DOOR IS/OS INSWING ELEVATIONS		
DRAWN: TJH	DWG NO. 08-00905	REV E
SCALE NTS	DATE 12/16/09	SHEET 2 OF 12
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

SIGNED: 09/28/2026

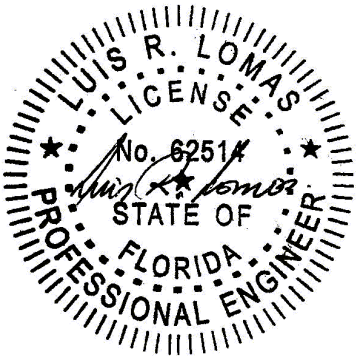

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED TO ADD CORROSION CHART	09/28/26	R.L.

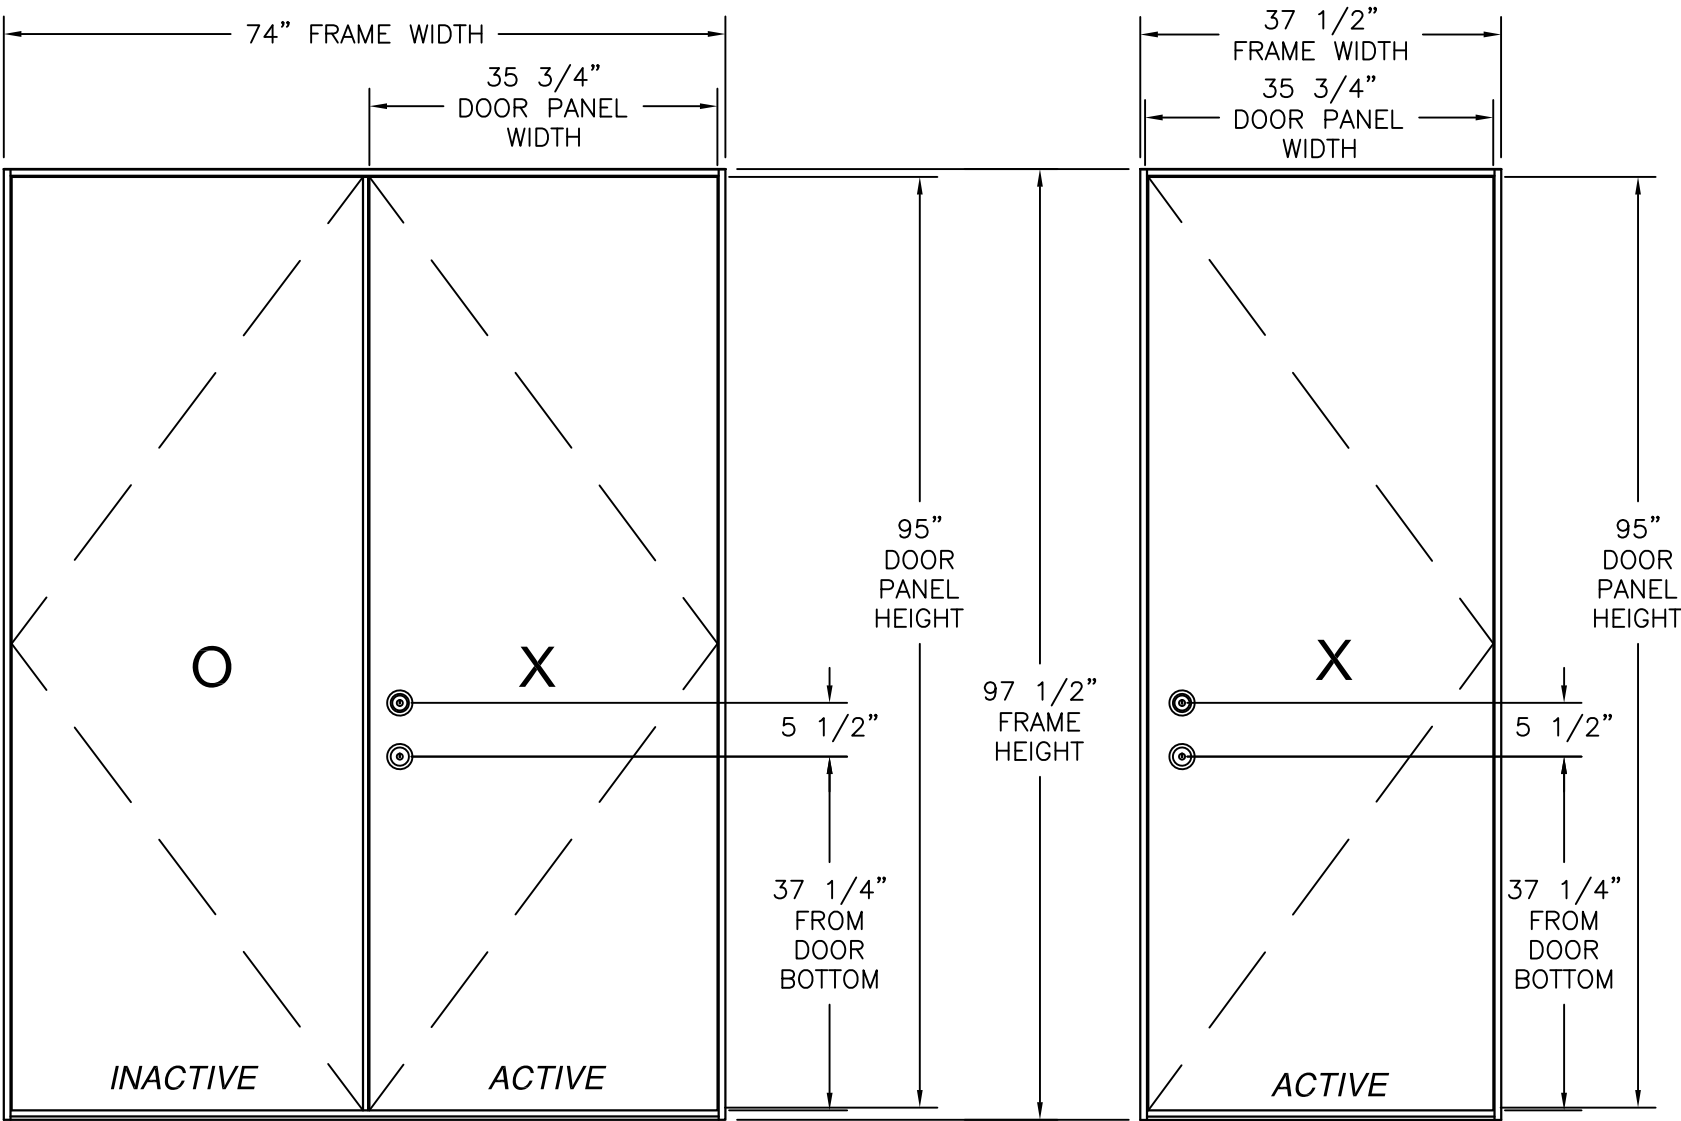

20GA. STEEL
OUTSWING DOUBLE DOOR
EXTERIOR VIEW

20GA. STEEL
OUTSWING SINGLE DOOR
EXTERIOR VIEW


DESIGN PRESSURE RATING	IMPACT RATING
$\pm 51.0\text{PSF}$	LARGE AND SMALL MISSILE IMPACT
THIS SYSTEM WAS NOT TESTED FOR WATER INFILTRATION AND IS TO BE INSTALLED ONLY WHERE THE WATER REQUIREMENT IS NOT NEEDED	

35 3/4" X 95" PANEL SHOWN, OTHER SIZES APPROVED AS LONG AS INDIVIDUAL PANEL AREA DOES NOT EXCEED 23.58 FT²

<u>HARDWARE SCHEDULE</u>
A. F-SERIES LOCK ASSEMBLY DOOR KNOB BY SCHLAGE.
B. B-SERIES DEADBOLT ASSEMBLY BY SCHLAGE.
C. F-SERIES DEADBOLT ASSEMBLY BY SCHLAGE.
D. RESIDENTIAL GRADE DOOR HANDLE ASSEMBLY BY EMTEK (ALTERNATE).
E. MULTI-POINT LOCK HANDLE ASSEMBLY BY TRILENNIUM (ALTERNATE).
F. INSWING HURRICANE ASTRAGAL BY ENDURA.
G. OUTSWING HURRICANE ASTRAGAL BY ENDURA.
H. (3) 4" x 4" BALL BEARING HINGES BY PENROD.
I. (3) 4" x 4" SPRING BOMMER HINGES BY PENROD.


SIGNED: 09/28/2026

PROVIA, LLC. 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681		
20GA. STEEL ENTRY DOOR IS/OS OUTSWING ELEVATIONS		
DRAWN: TJH	DWG NO. 08-00905	REV E
SCALE NTS	DATE 12/16/09	SHEET 3 OF 12
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

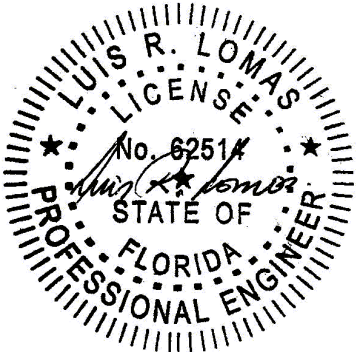

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED TO ADD CORROSION CHART	09/28/26	R.L.

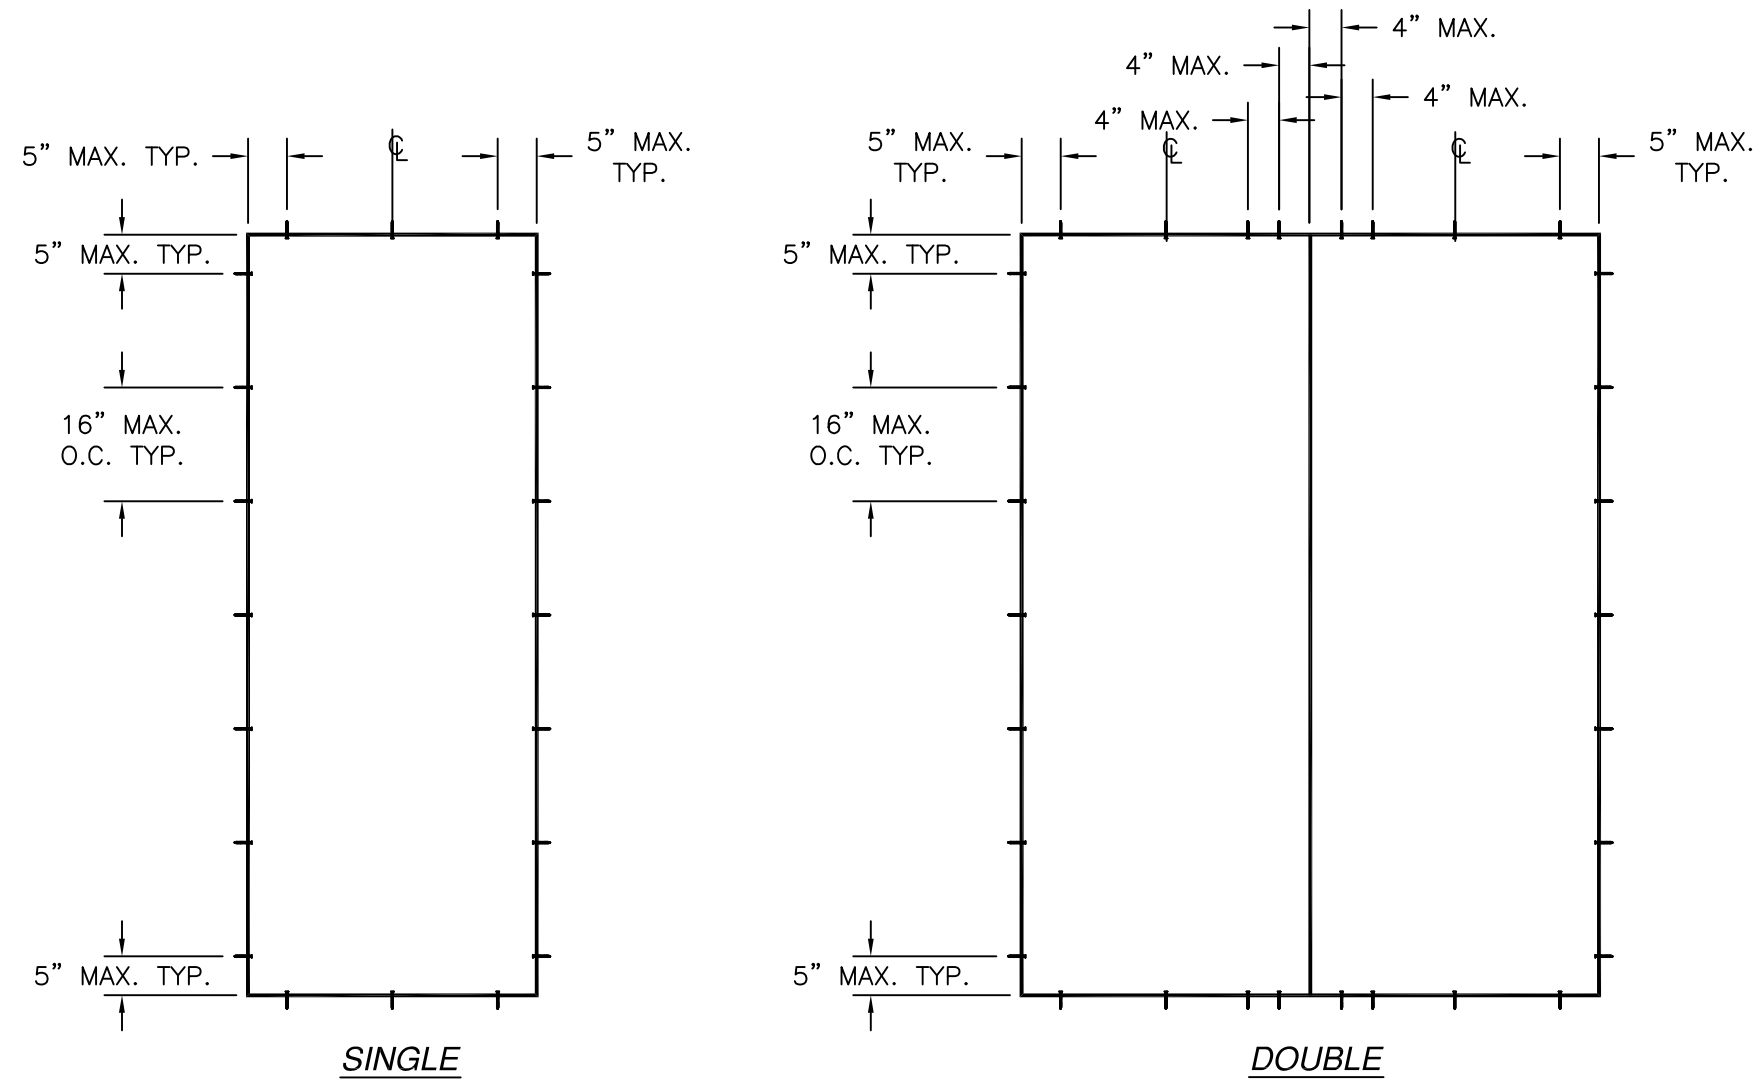

Anchors and anchor connectors corrosion resistance chart		
Exposure	Distance from coastal shoreline	
	0' up to 300'	>300' up to 3000'
Exterior - partially sheltered	304 or A305 or 306 Stainless steel per ASTM A240	Galvanized per ASTM A153 class D or ASTM A641 class 3S
Exterior - open exposed	304 or A305 or 306 Stainless steel per ASTM A240	Galvanized per ASTM A153 class D or ASTM A641 class 3S
Unconditioned interior-vented enclosed	Galvanized per ASTM A153 class D or ASTM A641 class 3S	Galvanized per ASTM A153 class D or ASTM A641 class 3S
Unconditioned interior-unvented enclosed	Galvanized per ASTM A153 class D or ASTM A641 class 3S	Galvanized per ASTM A153 class D or ASTM A641 class 3S

SIGNED: 09/28/2026

PROVIA, LLC.
2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

20GA. STEEL ENTRY DOOR
IS/OS
ANCHORING LAYOUTS

DRAWN:
TJH

DWG NO.
08-00905

REV
E







SCALE
NTS

DATE
12/16/09

SHEET
4 OF 12

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

Luis R. Lomas P.E.
FL No.: 62514

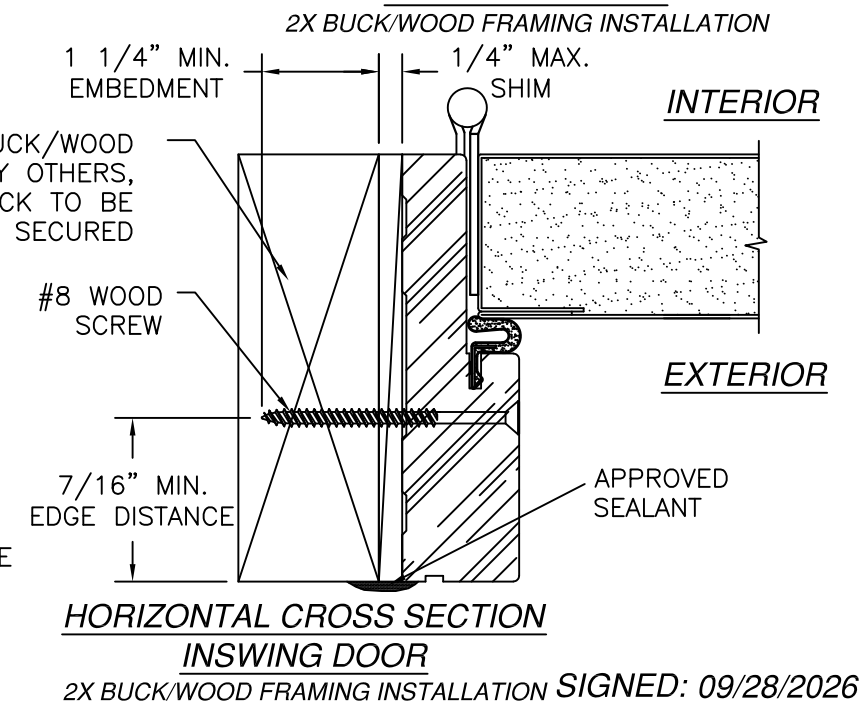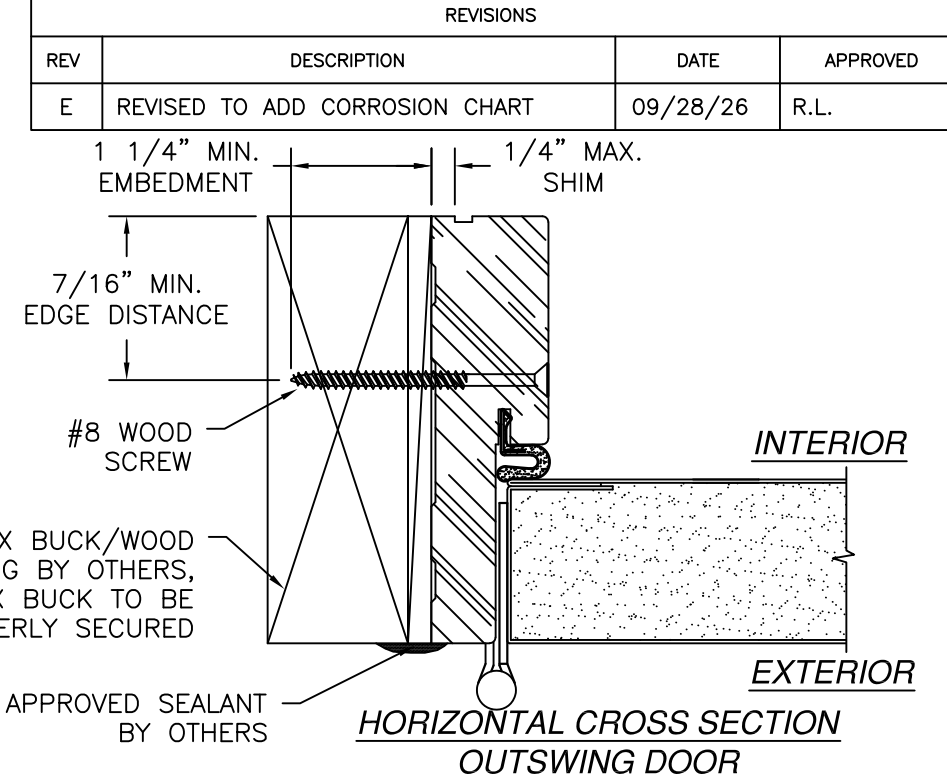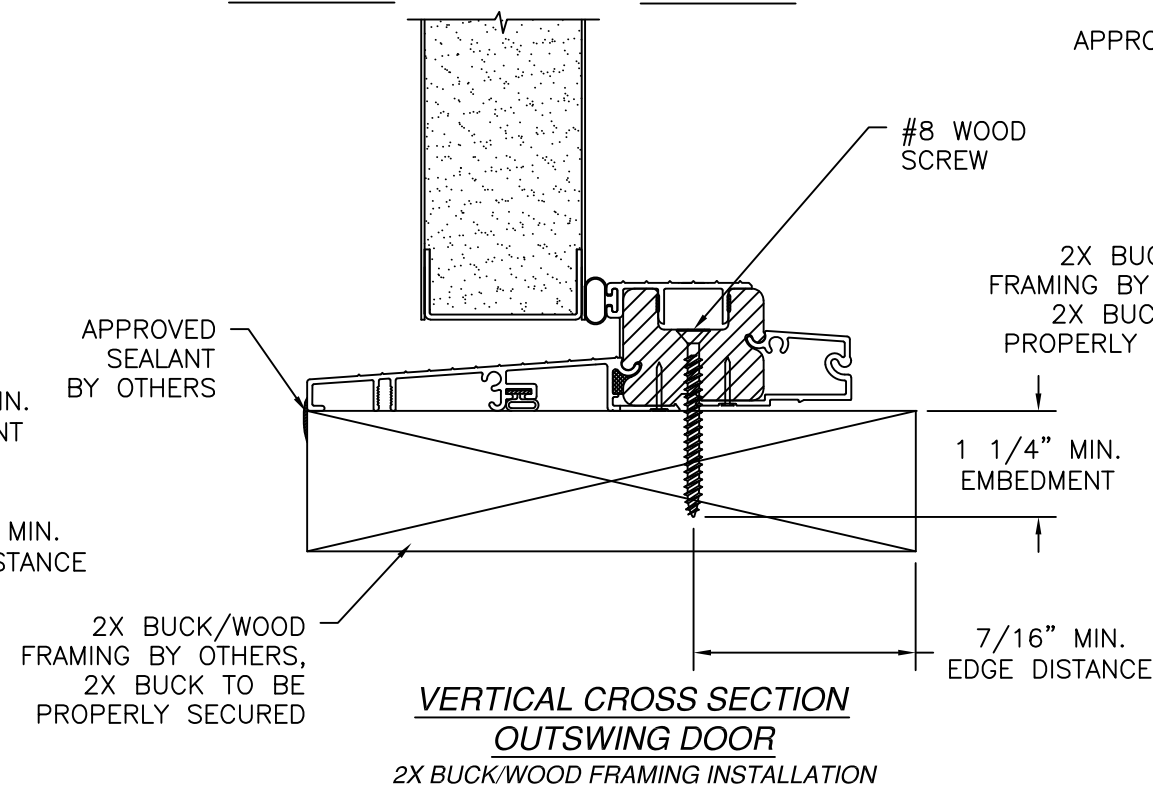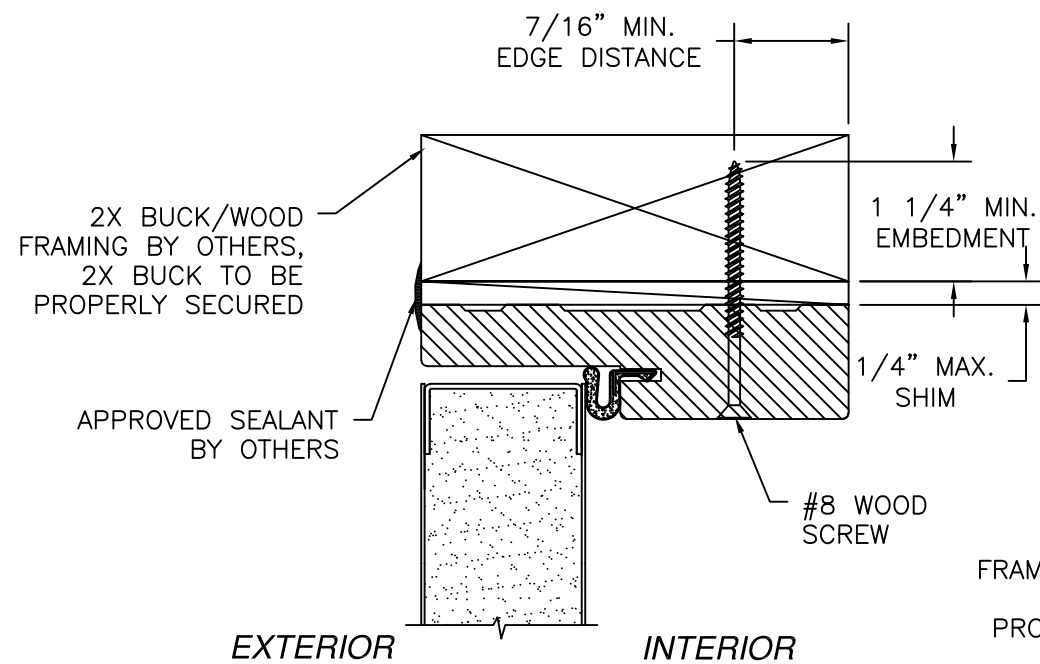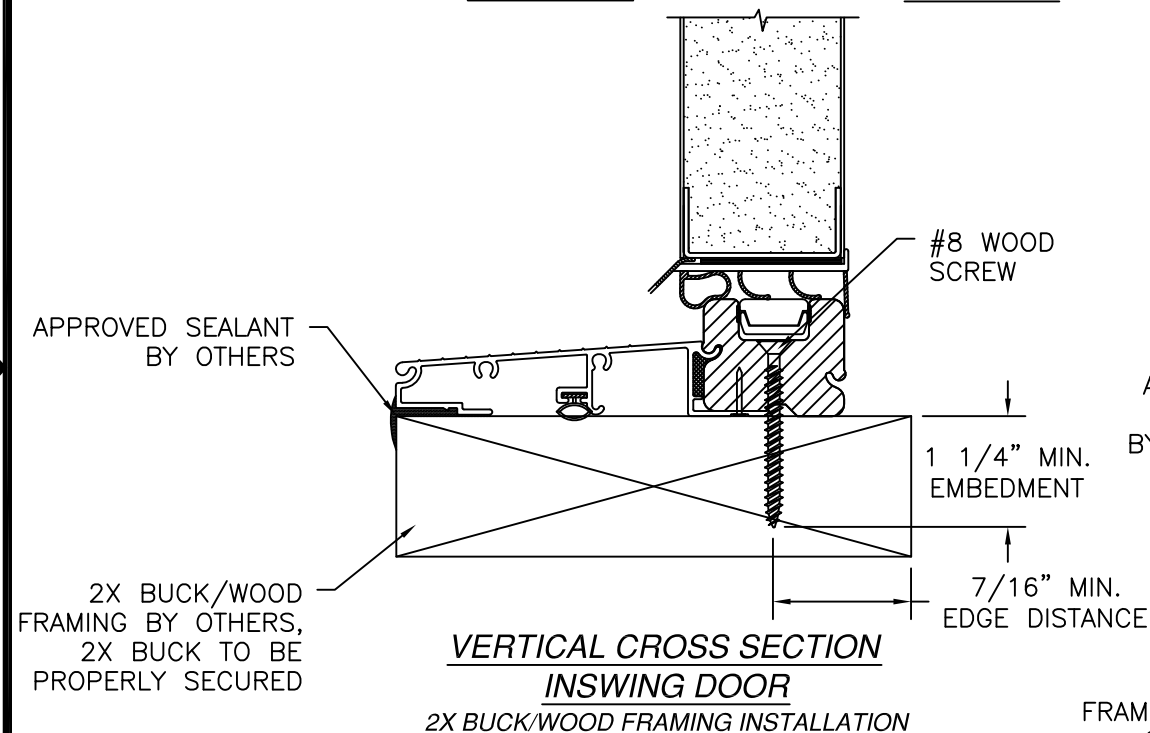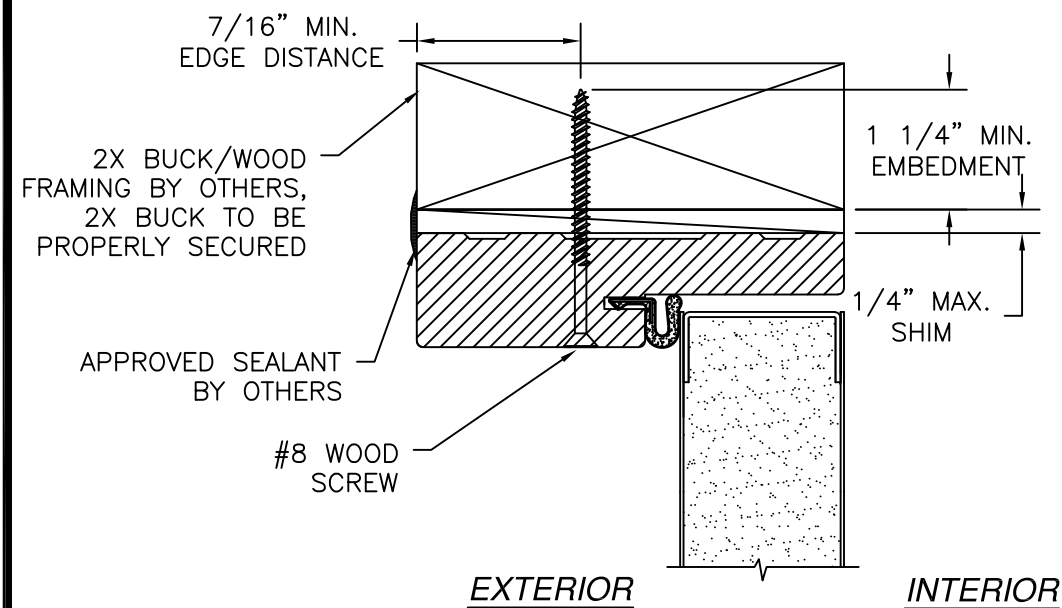

NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

PROVIA, LLC.

2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

20GA. STEEL ENTRY DOOR IS/OS INSTALLATION DETAILS

DRAWN:
TJH

DWG NO.	08-00905
---------	----------


REV
E

SCALE NTS


DATE 12/16/09

SHEET 5 OF 12


L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rlomas@lrlomaspe.com

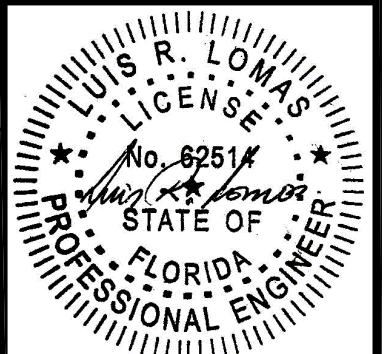

Luis R. Lomas P.E.
FL No.: 62514

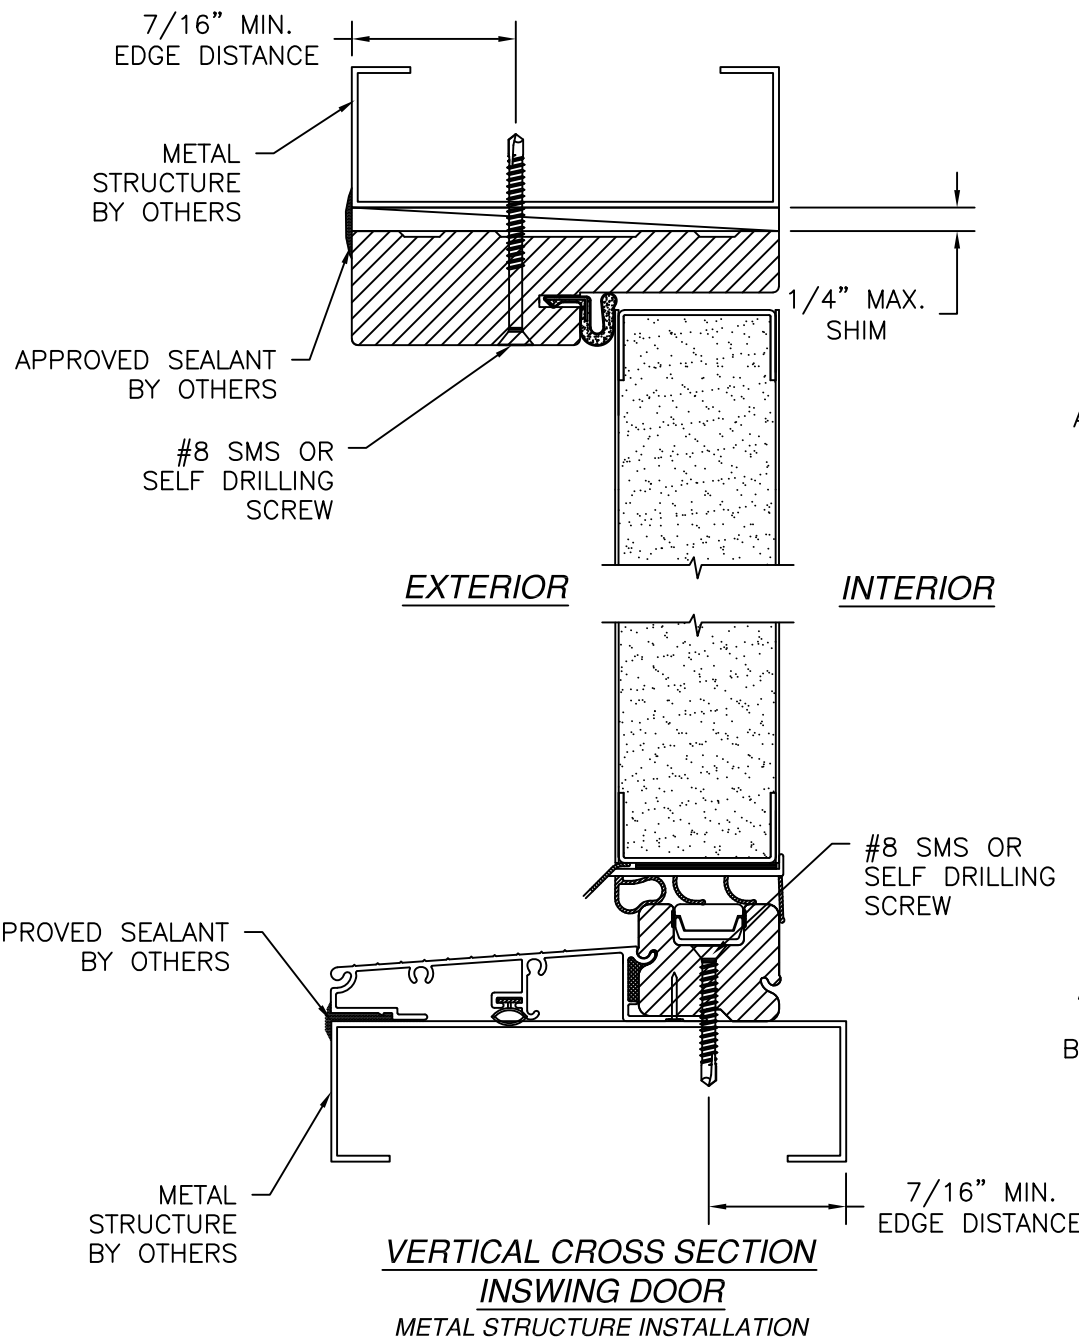


**VERTICAL CROSS SECTION
INSWING DOOR**
METAL STRUCTURE INSTALLATION

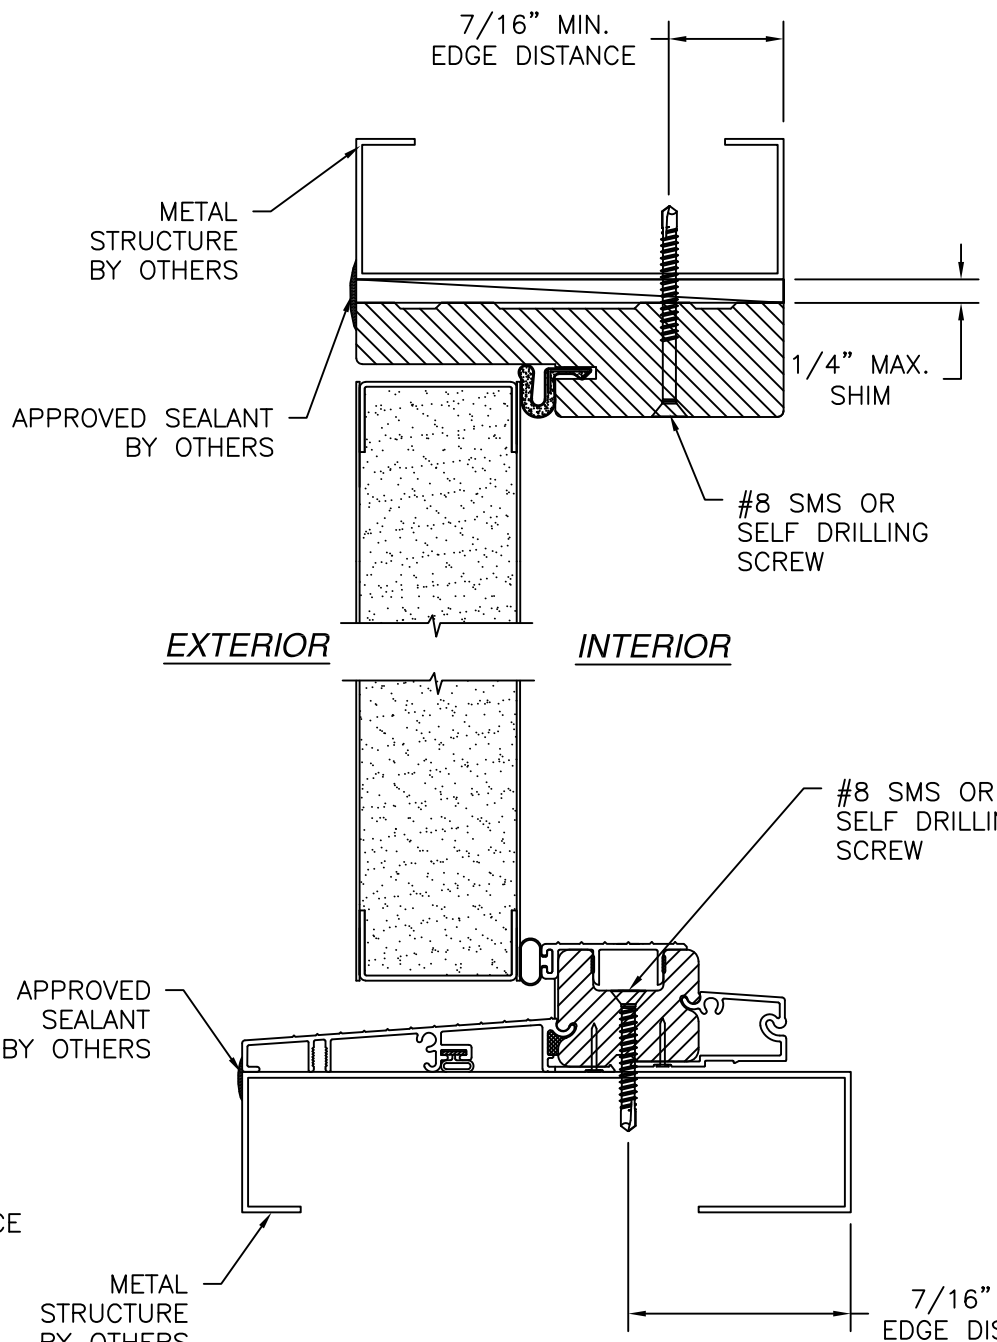


**VERTICAL CROSS SECTION
OUTSWING DOOR**
METAL STRUCTURE INSTALLATION

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED TO ADD CORROSION CHART	09/28/26	R.L.

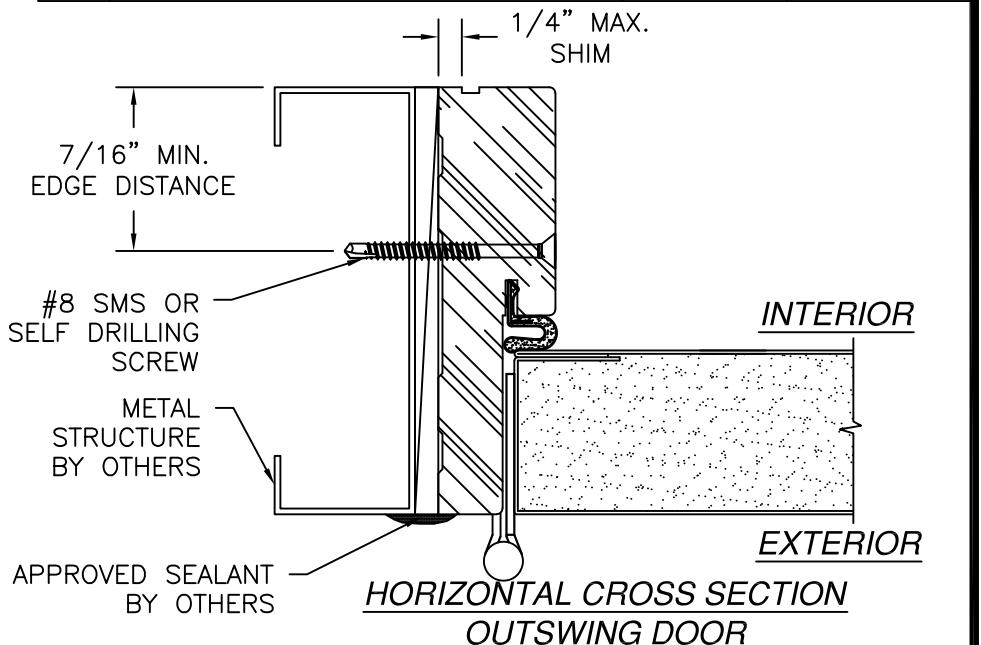

**HORIZONTAL CROSS SECTION
OUTSWING DOOR**
METAL STRUCTURE INSTALLATION

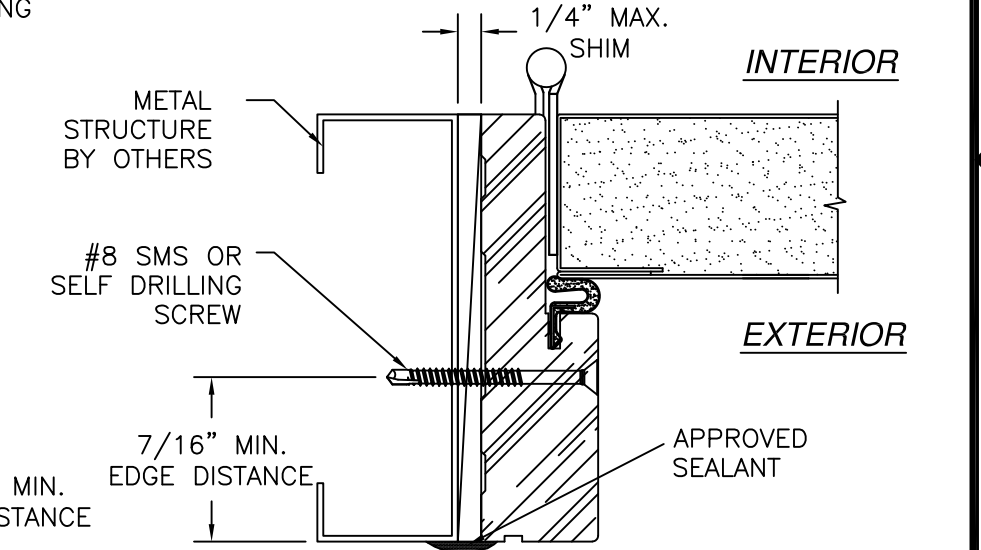

**HORIZONTAL CROSS SECTION
INSWING DOOR**
METAL STRUCTURE INSTALLATION

SIGNED: 09/28/2026

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

PROVIA, LLC.

2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

20GA. STEEL ENTRY DOOR
IS/OS

INSTALLATION DETAILS

DRAWN: TJH

DWG NO. 08-00905

REV E

SCALE NTS

DATE 12/16/09

SHEET 6 OF 12

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903

434-688-0609 rllomas@lrlomaspe.com

LUIS R. LOMAS

LICENS. M. S.


No. 62514

STATE OF FLORIDA


PROFESSIONAL ENGINEER

Luis R. Lomas P.E.

FL No.: 62514

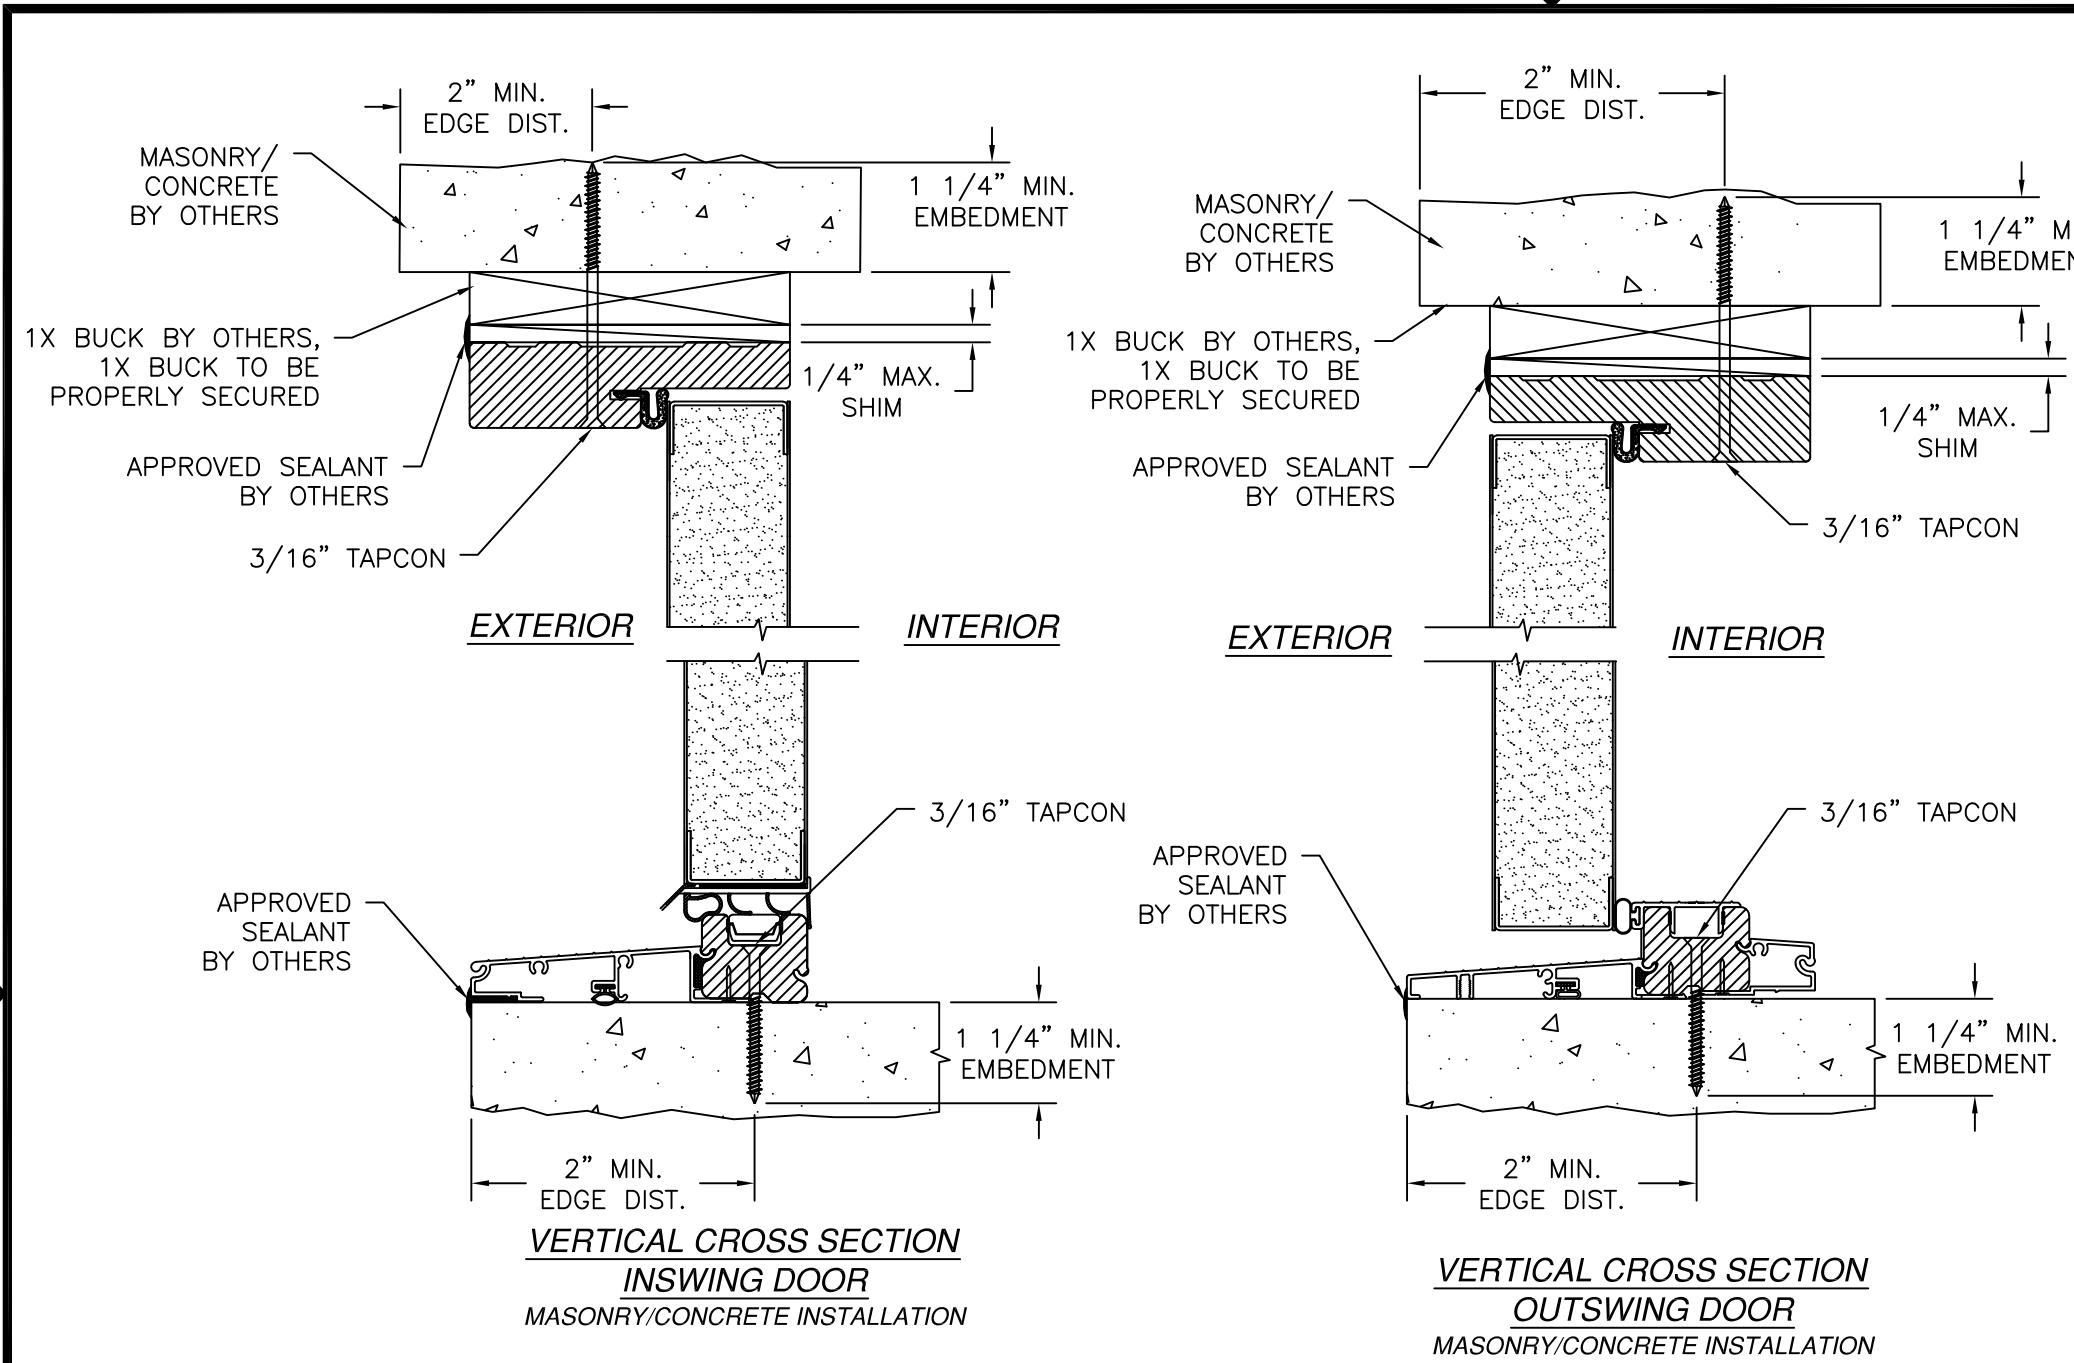

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED TO ADD CORROSION CHART	09/28/26	R.L.

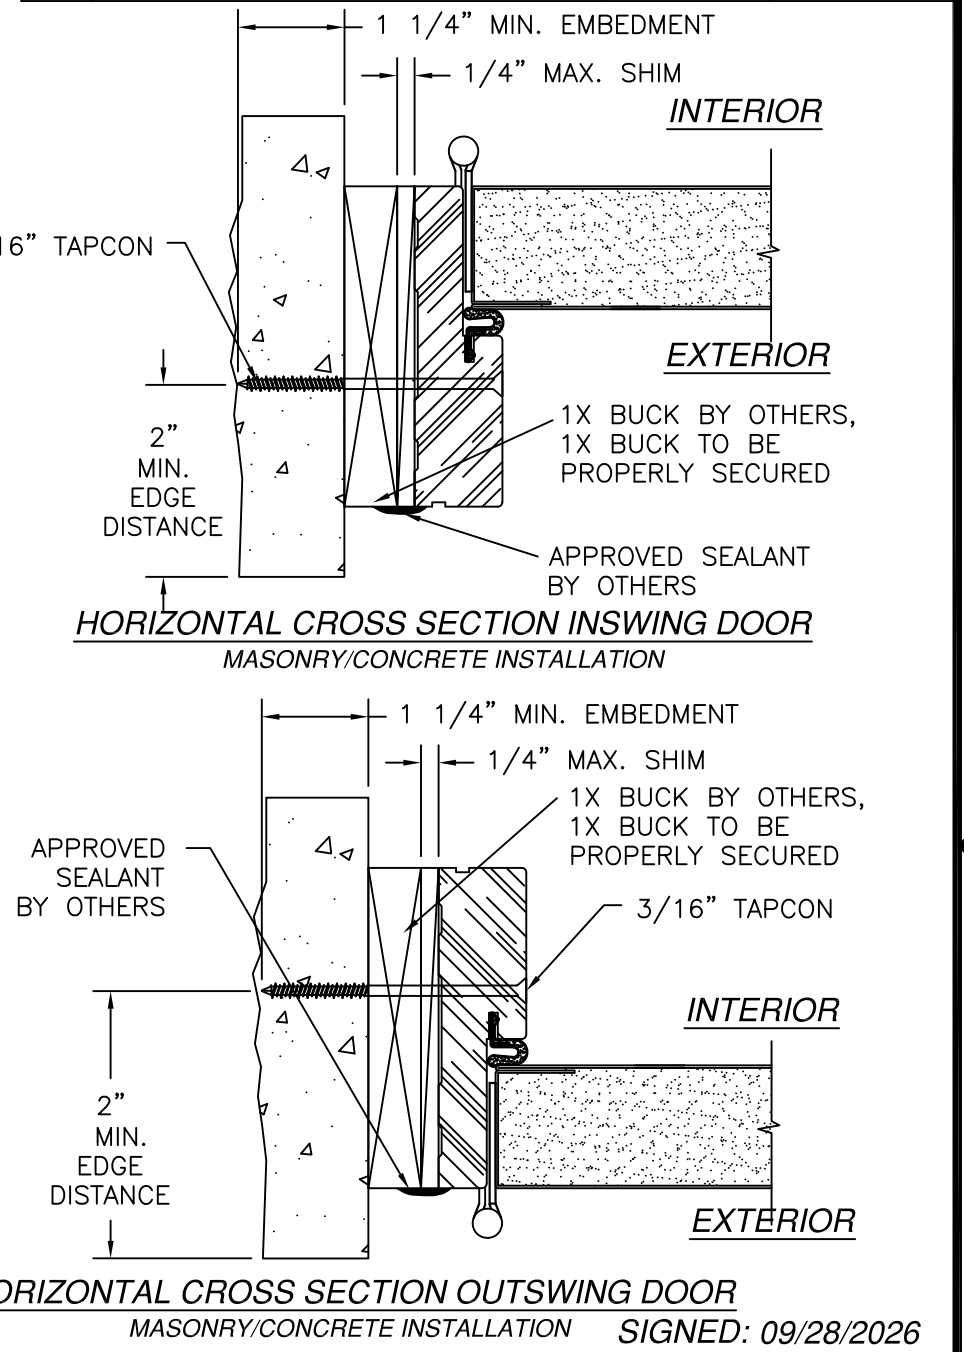

- NOTES:
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


PROVIA, LLC.
2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

20GA. STEEL ENTRY DOOR
IS/OS
INSTALLATION DETAILS


DRAWN: TJH	DWG NO. 08-00905	REV E
SCALE NTS	DATE 12/16/09	SHEET 7 OF 12

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com


Luis R. Lomas P.E.
FL No.: 62514

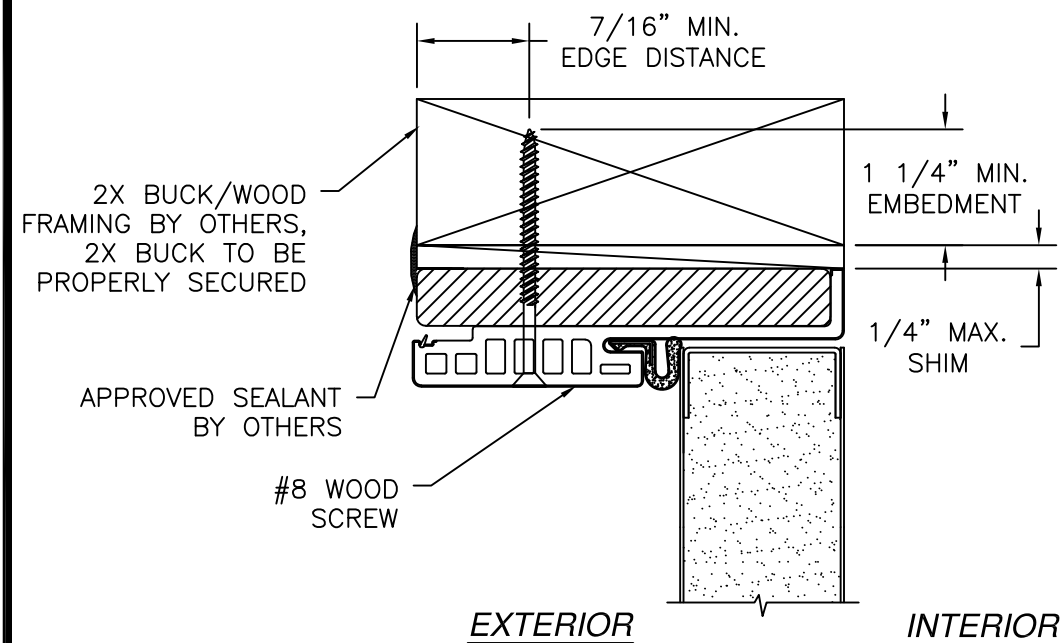


**VERTICAL CROSS SECTION
INSWING DOOR**
2X BUCK/WOOD FRAMING INSTALLATION

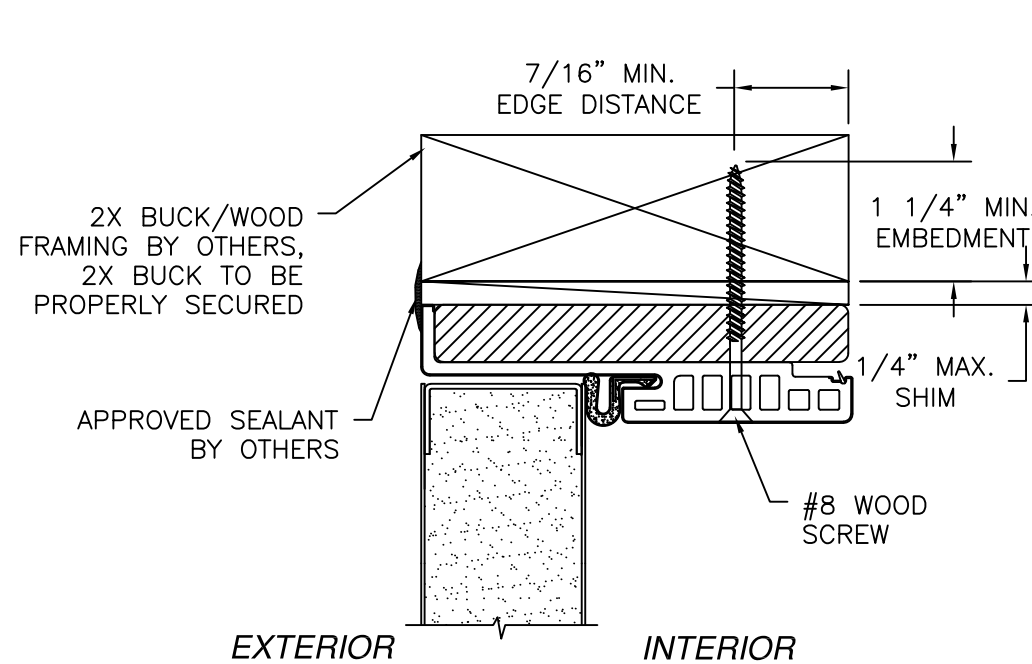

**VERTICAL CROSS SECTION
OUTSWING DOOR**
2X BUCK/WOOD FRAMING INSTALLATION

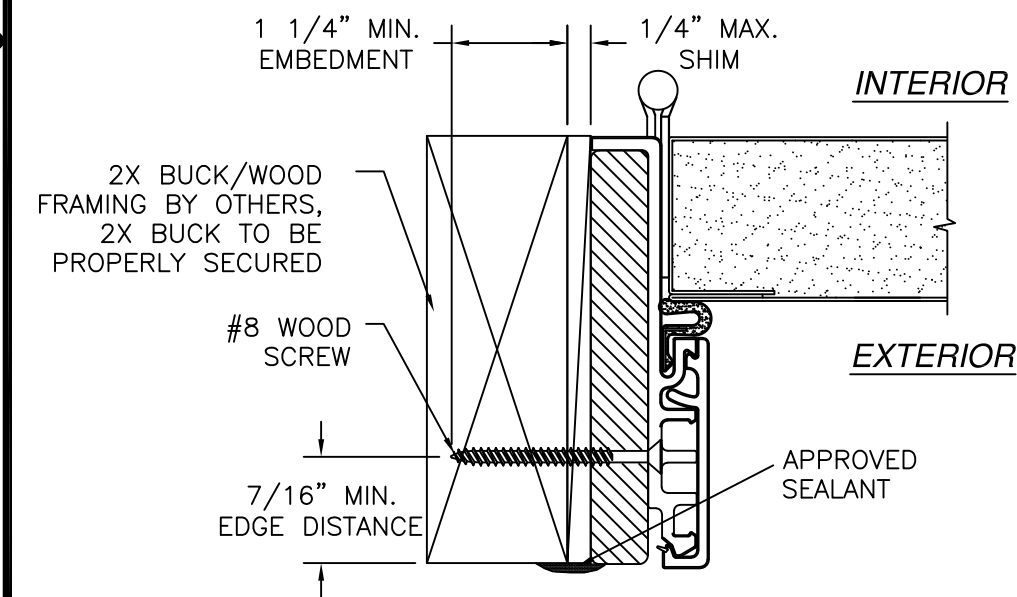

**HORIZONTAL CROSS SECTION
INSWING DOOR**
2X BUCK/WOOD FRAMING INSTALLATION

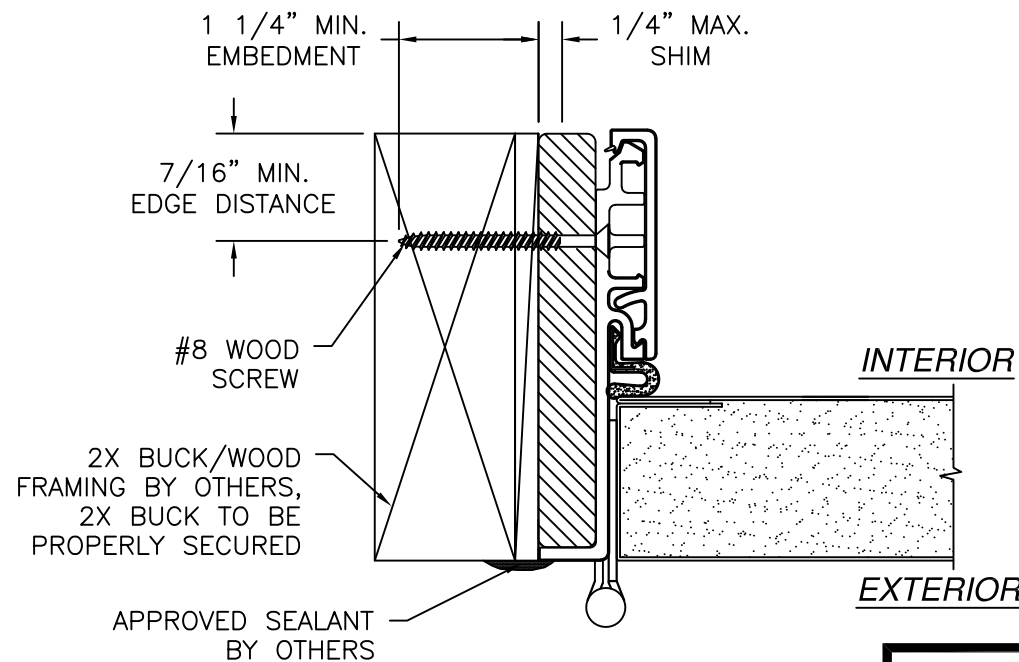

**HORIZONTAL CROSS SECTION
OUTSWING DOOR**
2X BUCK/WOOD FRAMING INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED TO ADD CORROSION CHART	09/28/26	R.L.

PROVIA, LLC.

2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

20GA. STEEL ENTRY DOOR
IS/OS

INSTALLATION DETAILS W/FUSION FRAME

DRAWN: TJH

DWG NO. 08-00905

REV E

SCALE NTS

DATE 12/16/09


SHEET 8 OF 12

L. ROBERTO LOMAS P.E.



208 7th Ave, INDIALANTIC, FL 32903

434-688-0609 rllomas@lrlomaspe.com



SIGNED: 09/28/2026

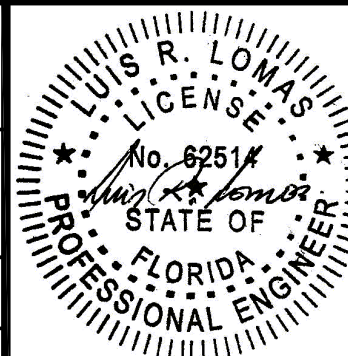

Luis R. Lomas P.E.
FL No.: 62514

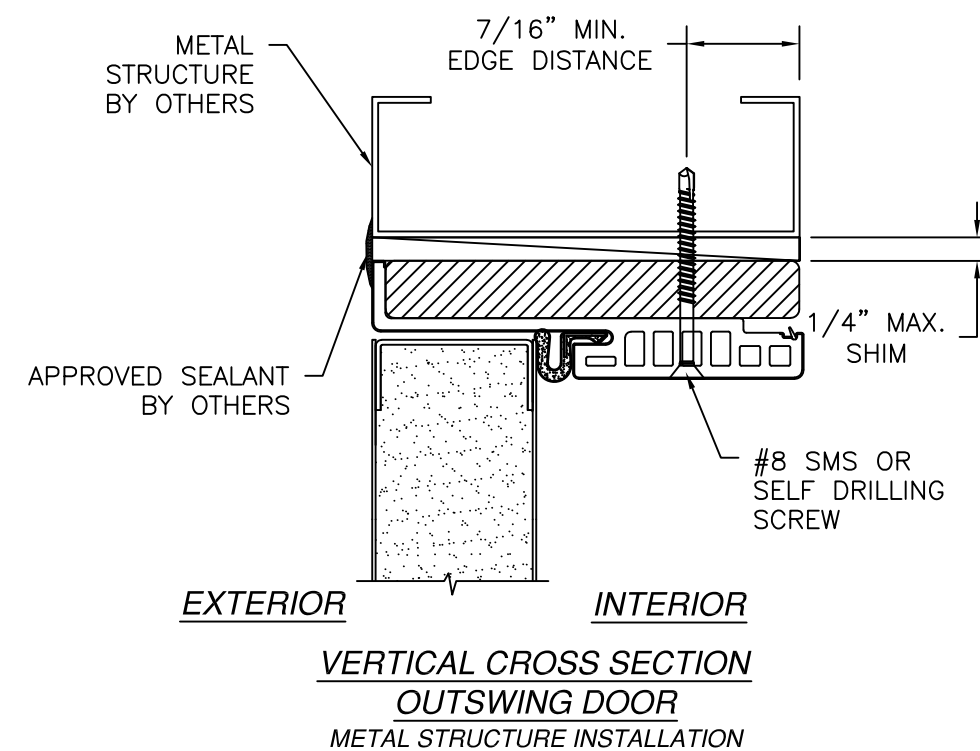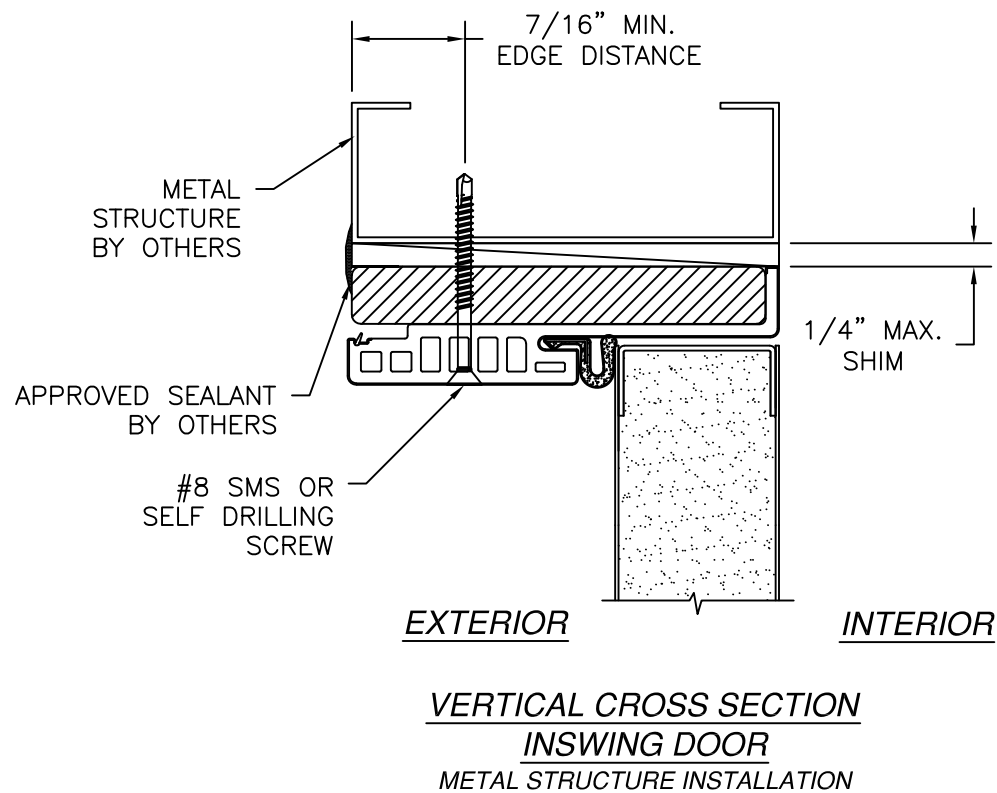

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED TO ADD CORROSION CHART	09/28/26	R.L.

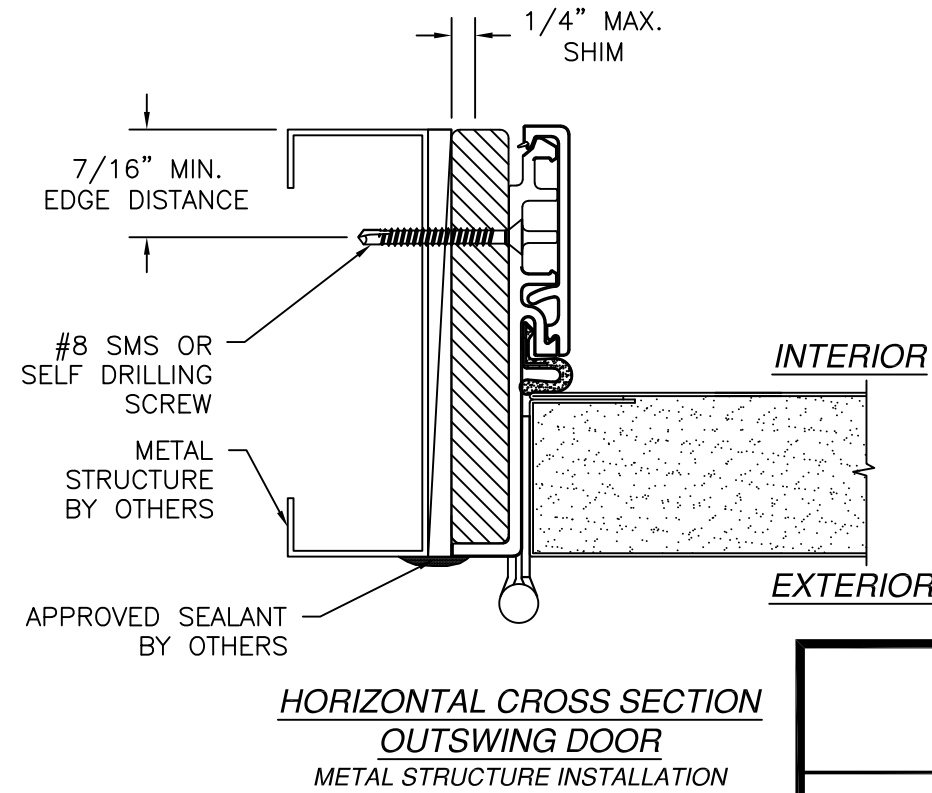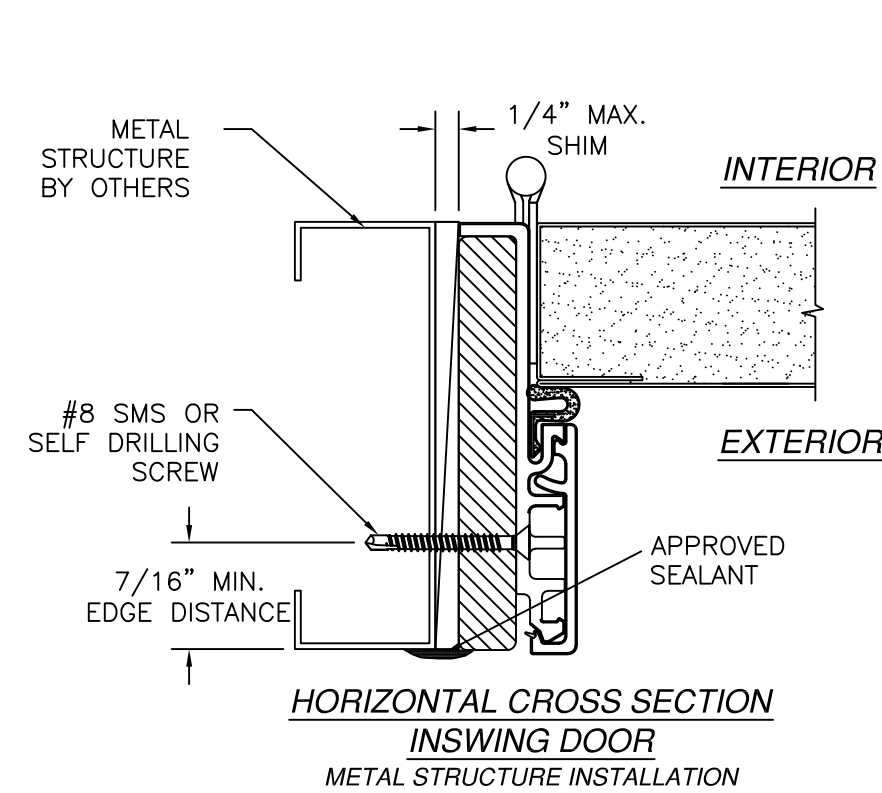

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

PROVIA, LLC.
 2150 STATE ROUTE 39 WEST
 SUGARCREEK, OH 44681


20GA. STEEL ENTRY DOOR
 IS/OS
 INSTALLATION DETAILS W/FUSION FRAME

DRAWN: TJH
 SCALE NTS
 DATE 12/16/09
 DWG NO. 08-00905
 SHEET 9 OF 12
 REV E


L. ROBERTO LOMAS P.E.
 208 7th Ave, INDIALANTIC, FL 32903
 434-688-0609 rllomas@lrlomaspe.com

SIGNED: 09/28/2026

Luis R. Lomas P.E.
FL No.: 62514

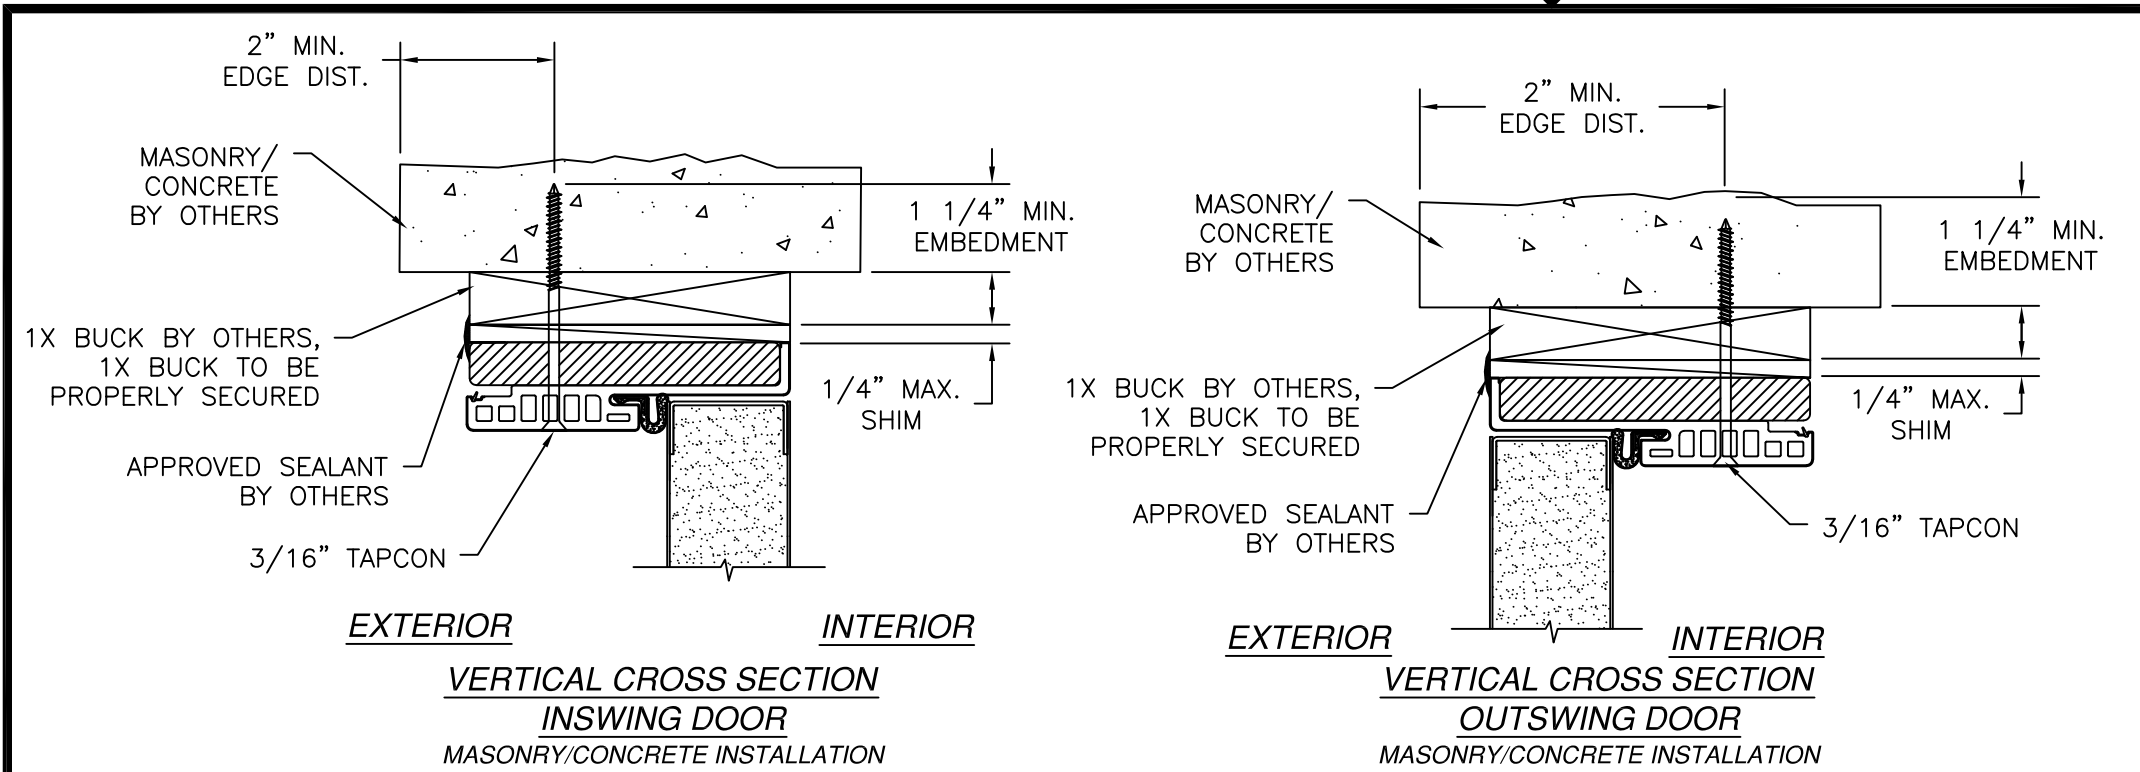

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED TO ADD CORROSION CHART	09/28/26	R.L.

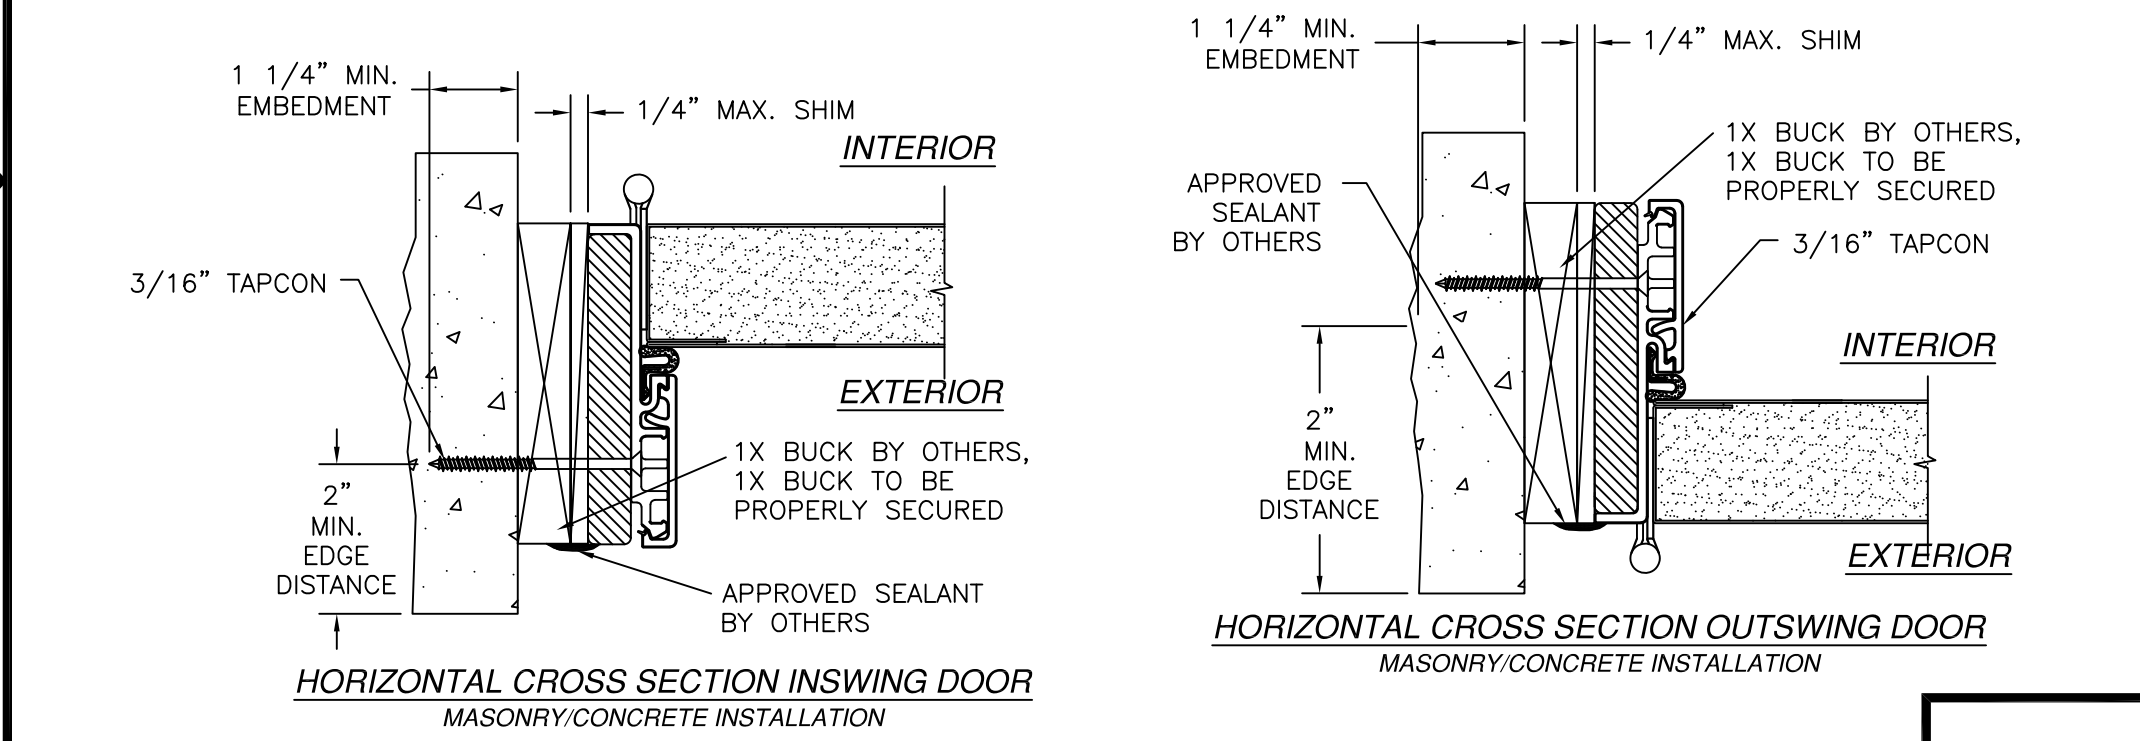

- NOTES:
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

PROVIA, LLC.
2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

**20GA. STEEL ENTRY DOOR
IS/OS
INSTALLATION DETAILS W/FUSION FRAME**

DRAWN: TJH	DWG NO. 08-00905	REV E
SCALE NTS	DATE 12/16/09	SHEET 10 OF 12


L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 09/28/2026


LUIS R. LOMAS
P.E.
No. 62514
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

Luis R. Lomas P.E.
FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED TO ADD CORROSION CHART	09/28/26	R.L.

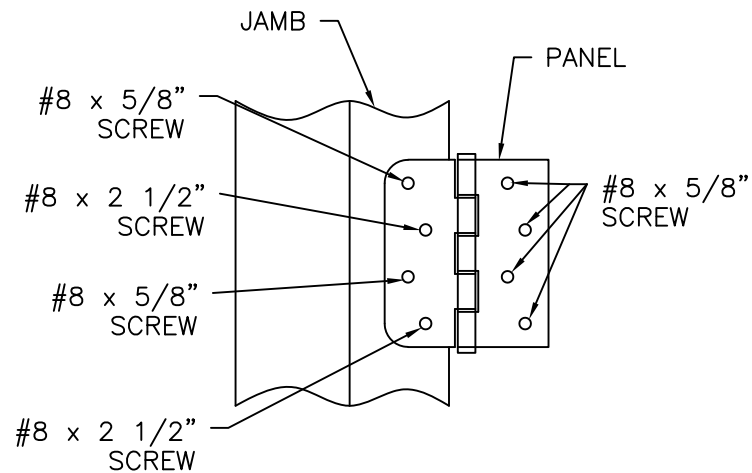


HINGE INSTALLATION DETAIL
2X BUCK/WOOD FRAMING INSTALLATION

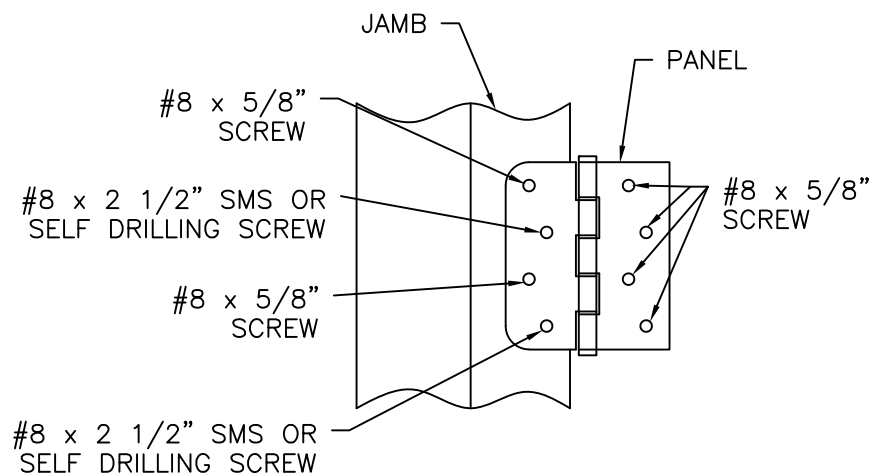


HINGE INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION

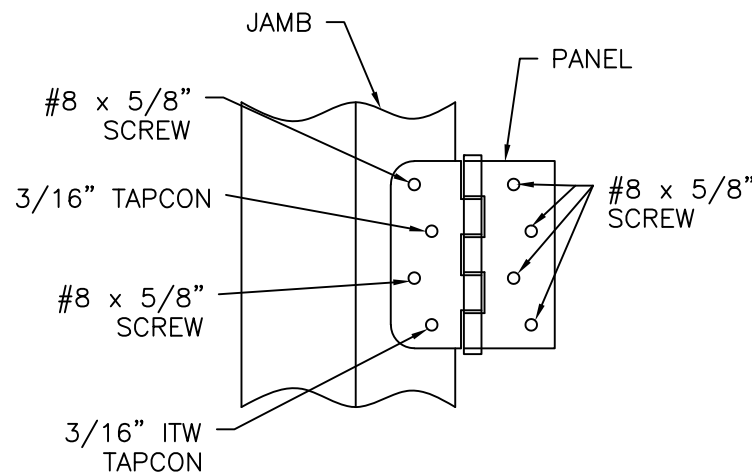


HINGE INSTALLATION DETAIL
MASONRY/CONCRETE INSTALLATION

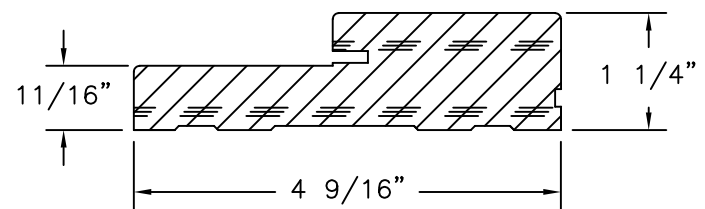


FRAME
WOOD G.46 MIN.

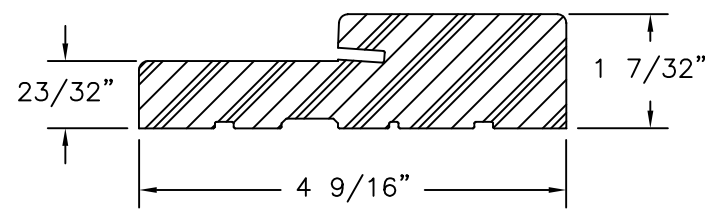


FRAMESAVER
COMPOSITE

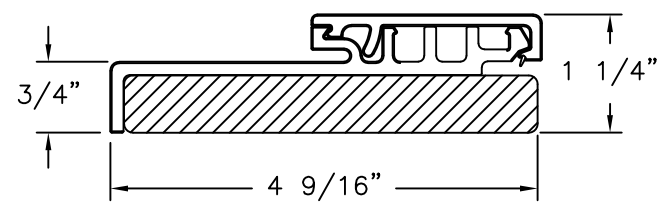


HYBRID JAMB
WOOD/COMPOSITE

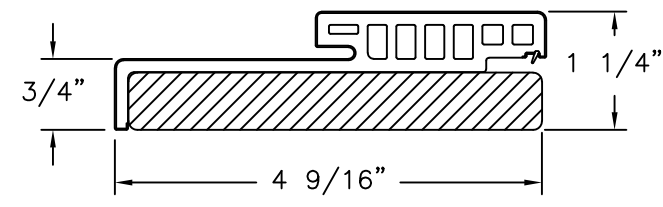


HYBRID HEAD
WOOD/COMPOSITE

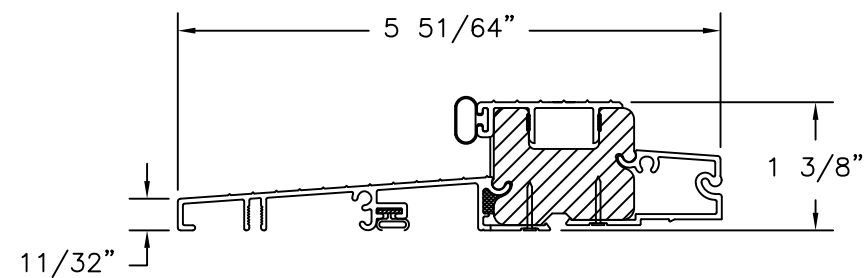


OUTSWING SILL

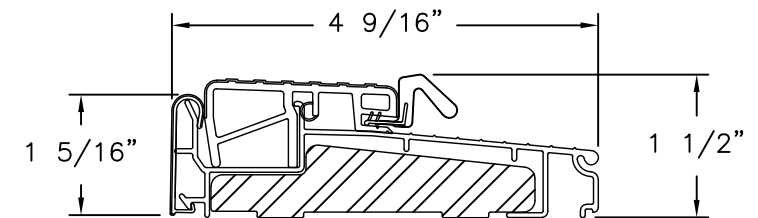

OUTSWING SILL ZOBL4565

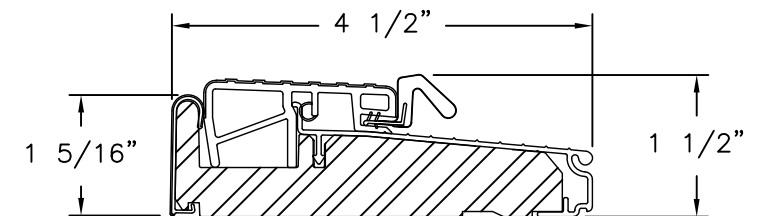

OUTSWING SILL ZOB4565F

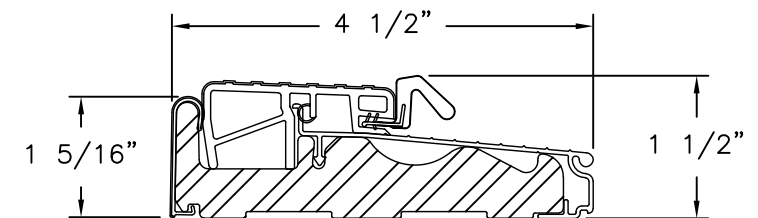








OUTSWING SILL ZOBLH4565

SIGNED: 09/28/2026

PROVIA, LLC. 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681			
20GA. STEEL ENTRY DOOR IS/OS COMPONENTS AND HINGES DETAILS			
DRAWN: TJH	DWG NO. 08-00905	REV E	
SCALE NTS	DATE 12/16/09	SHEET 11 OF 12	
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com			

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
E	REVISED TO ADD CORROSION CHART	09/28/26	R.L.

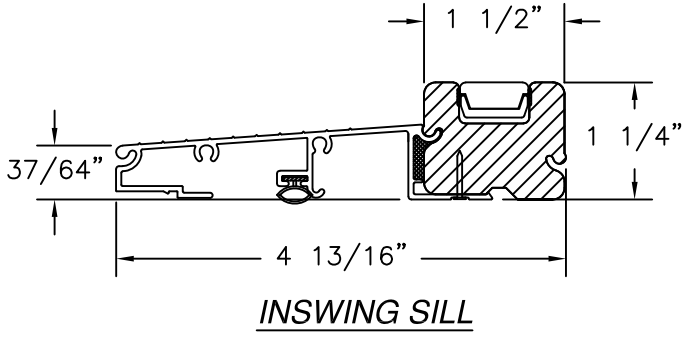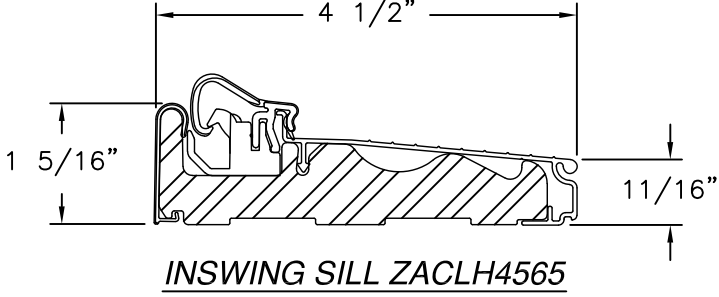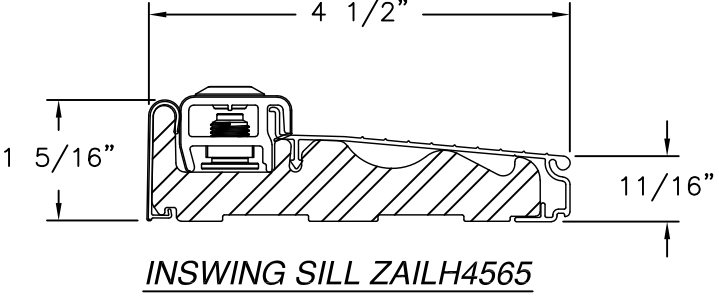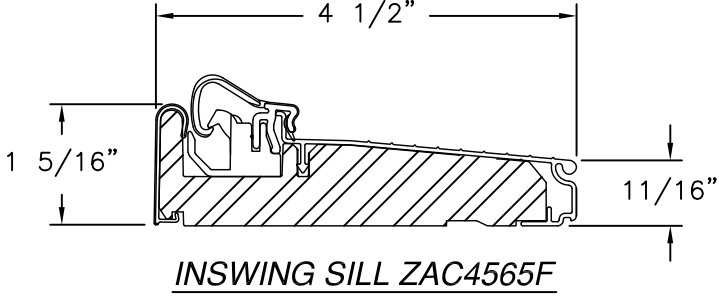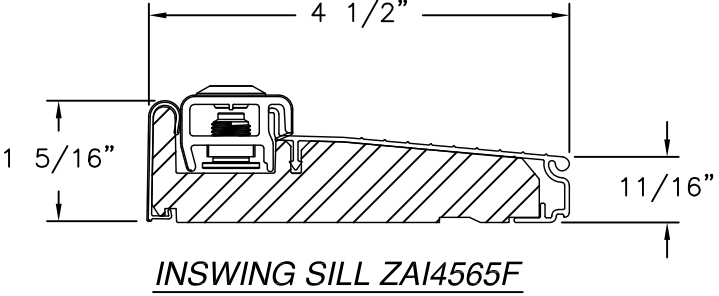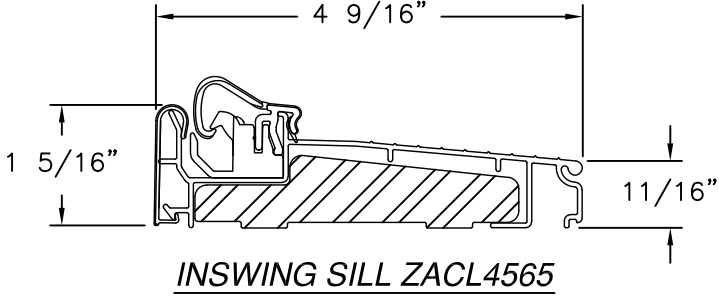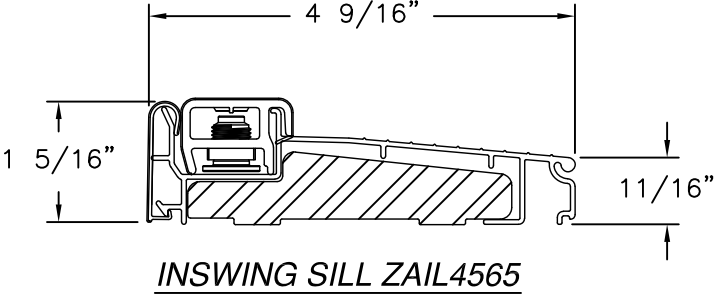


PROVIA, LLC.
2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

20GA. STEEL ENTRY DOOR
IS/OS
COMPONENTS

DRAWN: TJH	DWG NO. 08-00905	REV E
SCALE NTS	DATE 12/16/09	SHEET 12 OF 12

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 09/28/2026

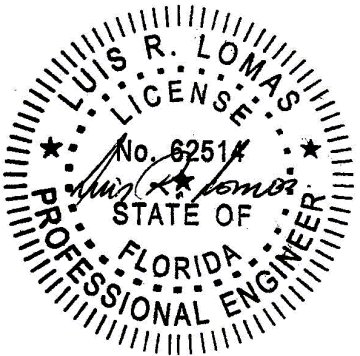

Luis R. Lomas P.E.
FL No.: 62514