

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
4. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" WINDOW UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
5. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. WINDOW UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
6. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
7. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
8. FOR FIN INSTALLATION SHIM AS NEEDED. FOR FRAME INSTALLATION SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
9. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
10. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
11. FRAME MATERIAL: EXTRUDED RIGID PVC.
12. UNITS MUST BE GLAZED PER ASTM E1300-04.
13. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
14. FOR ANCHORING THROUGH FIN INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

15. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 3/16" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
17. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
18. ALL FASTENERS TO BE CORROSION RESISTANT.
19. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - A. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42
 - B. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.
 - C. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH f'm=2,000PSI MINIMUM.
 - D. METAL STRUCTURE: STEEL 18GA (.048") FY=33KSI/FU=52KSI OR ALUMINUM 6063-T5 FU=30KSI 1/8" THICK MINIMUM


SINGNED: 09/28/2015

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATIONS
3 - 6	INSTALLATION DETAILS


COMFORT VIEW PRODUCTS, LLC 320 COWETA INDUSTRIAL PARKWAY BUILDING 7, SUITE C-I, NEWNAN, GA 30265		
1900 TWIN SINGLE HUNG MULLED ASSEMBLY 71" X 83" - NON-IMPACT NOTES		
DRAWN: N.G.	DWG NO. 08-02824	REV -
SCALE NTS	DATE 09/28/15	SHEET 1 OF 6




REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

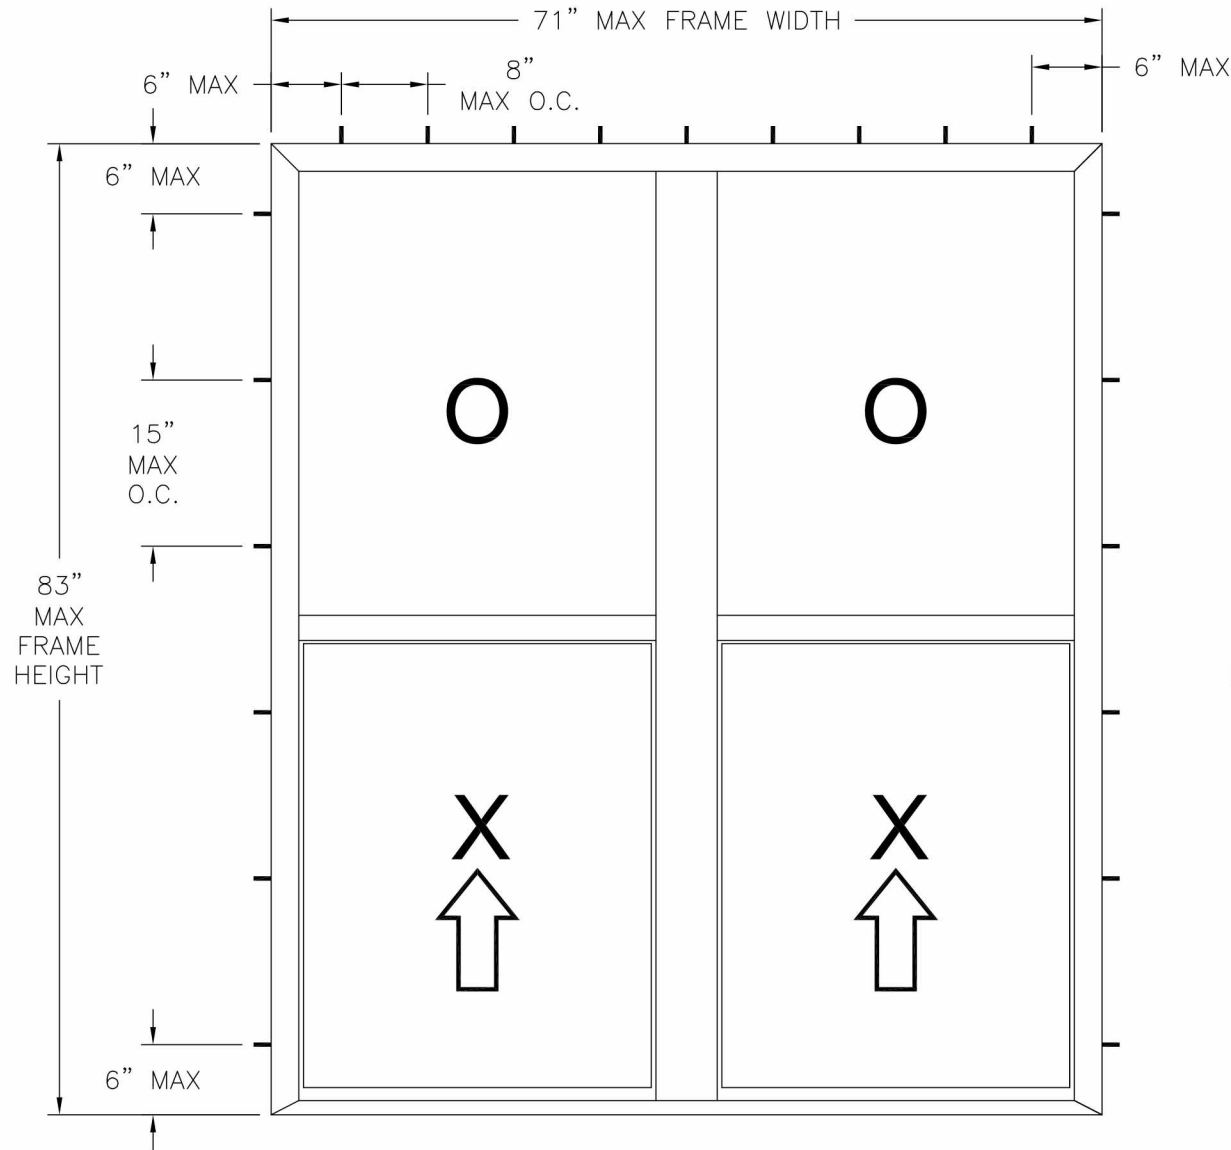

1900 TWIN SINGLE HUNG MULLED ASSEMBLY
EXTERIOR VIEW
FRAME INSTALLATION

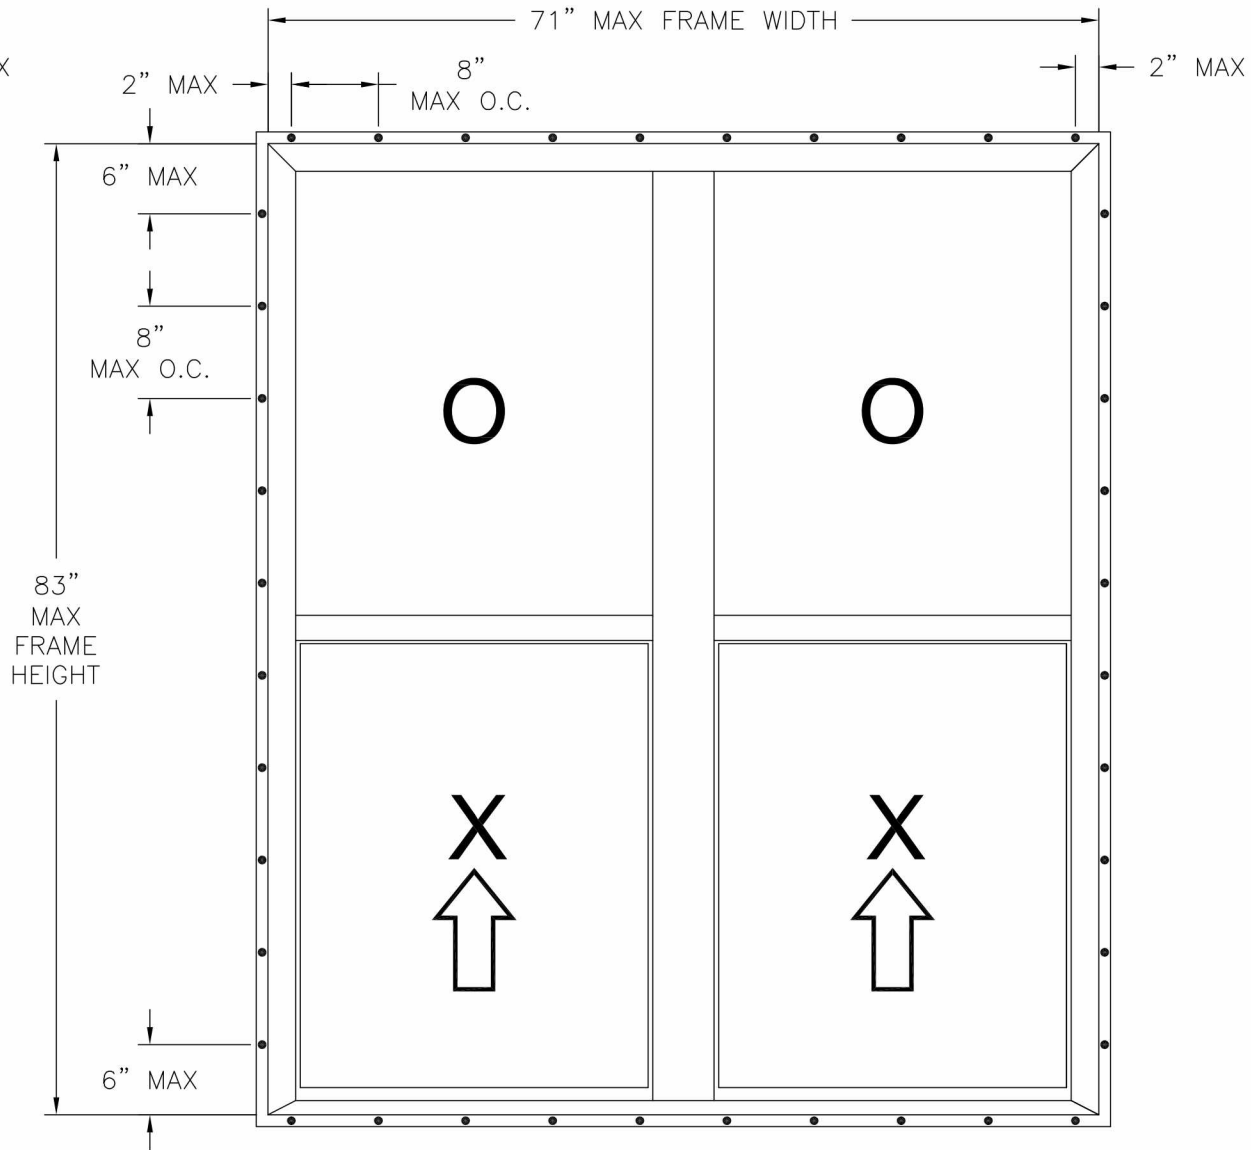

1900 TWIN SINGLE HUNG MULLED ASSEMBLY
EXTERIOR VIEW
FIN INSTALLATION

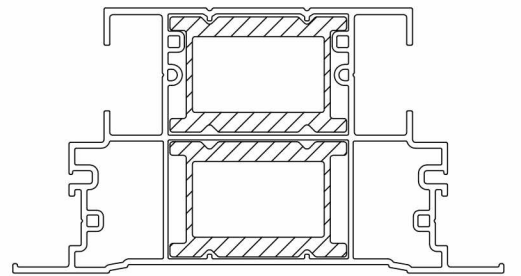

MULLION

- NOTES:
1. MAXIMUM SASH SIZE: 32 1/2" X 40 3/4"
 2. MAXIMUM D.L.O.: 30 11/16" X 38 3/16"
 3. 1 1/4" NOTCH AT EACH END OF EXTERIOR SILL WALLS.
 4. 1/8" X 7/16" WEEP HOLE AT 4 1/4" FROM EACH END OF BOTTOM RAILS

DESIGN PRESSURE RATING	IMPACT RATING
±50.0PSF	NONE


HARDWARE SCHEDULE

A.	CAM-TYPE SWEEP LOCK AT 6 7/8" FROM EACH END OF ACTIVE MEETING RAIL
B.	GROOVE KEEPER AT FIXED MEETING RAIL
C.	BALANCE BLOCK AND TACKLE OMEGA AT JAMBS
D.	METAL PIVOT BAR AT BOTTOM RAIL
E.	3 1/8" X 1/4" ALUMINUM PLATE REINFORCEMENT INSIDE I SHAPED PVC SPACER
F.	15/16" X 5/16" U-SHAPED ALUMINUM REINFORCEMENT AT ACTIVE MEETING RAILS
G.	1 1/16" X 1/8" U-SHAPED ALUMINUM REINFORCEMENT AT FIXED MEETING, BOTTOM RAILS AND STILES


COMFORT VIEW PRODUCTS, LLC 320 COWETA INDUSTRIAL PARKWAY BUILDING 7, SUITE C-I, NEWNAN, GA 30265		
1900 TWIN SINGLE HUNG MULLED ASSEMBLY 71" X 83" - NON-IMPACT ELEVATIONS		
DRAWN: N.G.	DWG NO. 08-02824	REV -
SCALE NTS	DATE 09/28/15	SHEET 2 OF 6

SINGNED: 09/28/2015



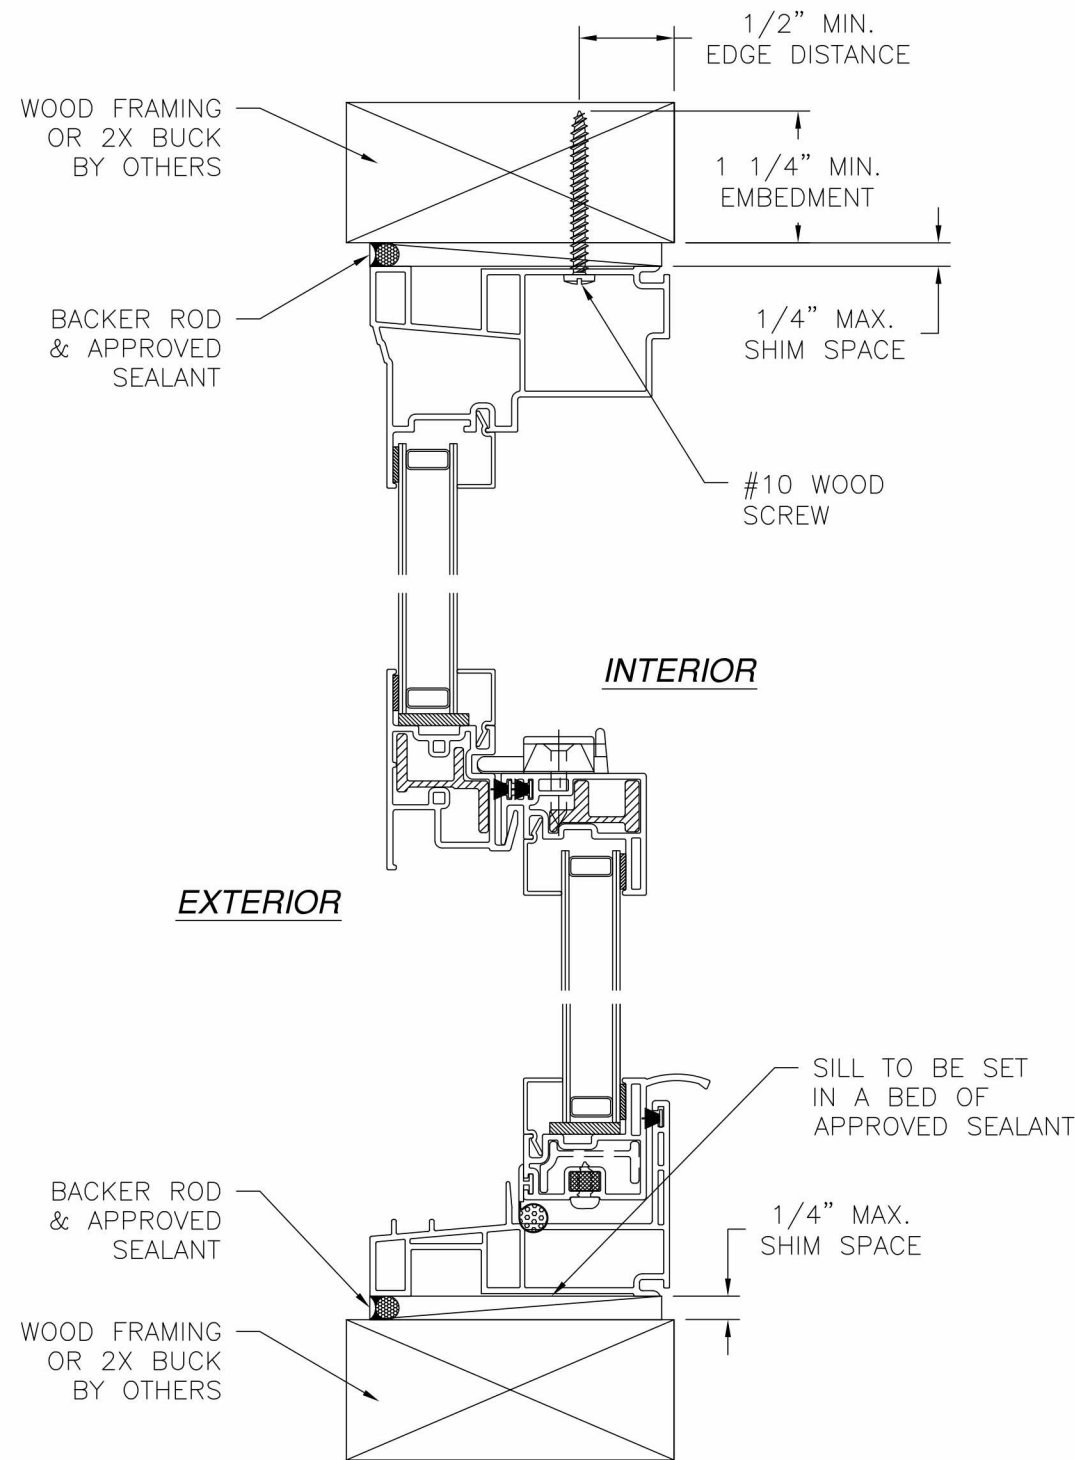

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

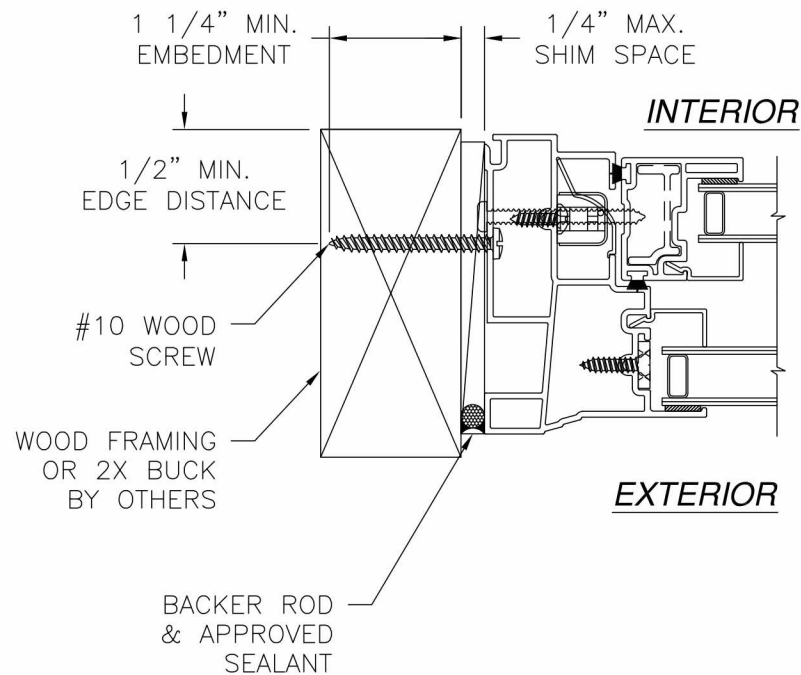

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION


- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

SINGNED: 09/28/2015


COMFORT VIEW PRODUCTS, LLC 320 COWETA INDUSTRIAL PARKWAY BUILDING 7, SUITE C-I, NEWNAN, GA 30265			
1900 TWIN SINGLE HUNG MULLED ASSEMBLY 71" X 83" - NON-IMPACT INSTALLATION DETAILS			
DRAWN: N.G.	DWG NO. 08-02824	REV -	
SCALE NTS	DATE 09/28/15	SHEET 3 OF 6	

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

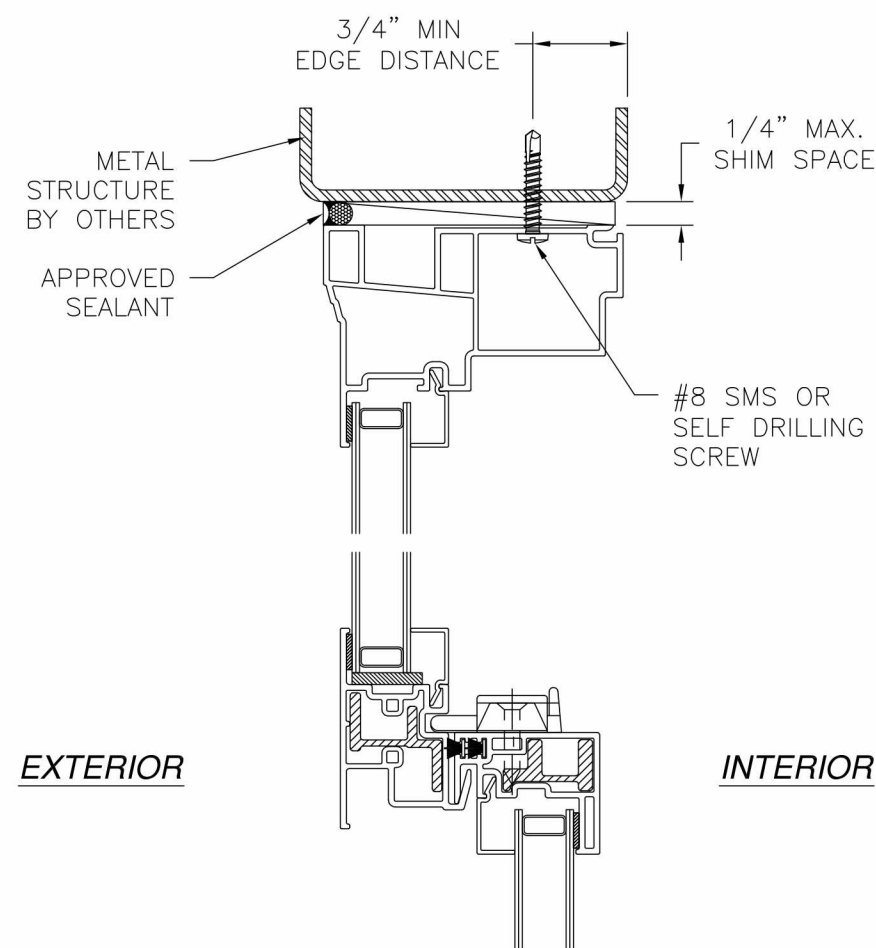


EXTERIOR

INTERIOR

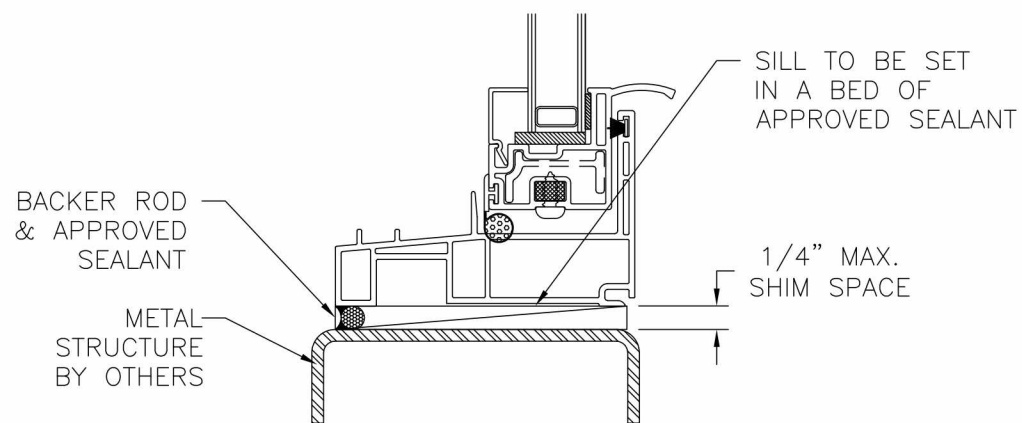

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

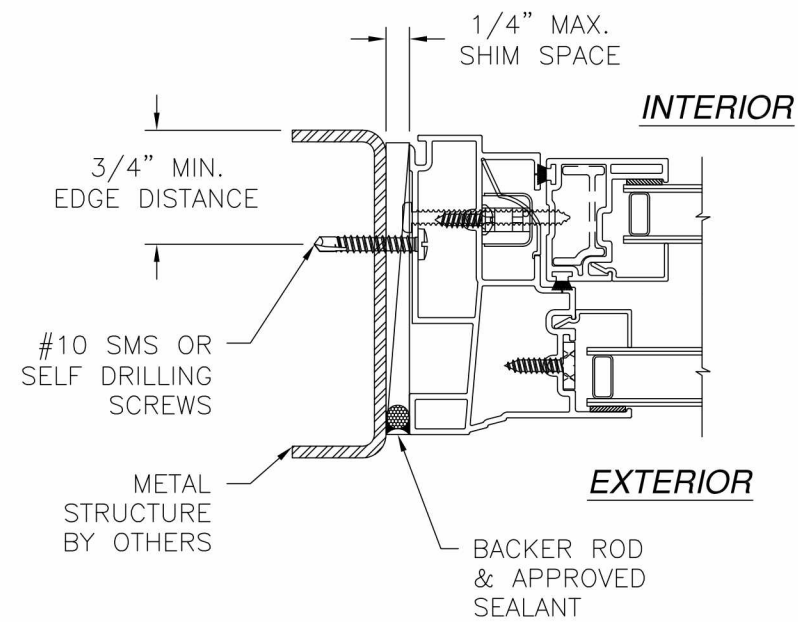

INTERIOR

EXTERIOR


JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION

NOTES:


1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SINGNED: 09/28/2015

COMFORT VIEW PRODUCTS, LLC 320 COWETA INDUSTRIAL PARKWAY BUILDING 7, SUITE C-1, NEWNAN, GA 30265			
1900 TWIN SINGLE HUNG MULLED ASSEMBLY 71" X 83" - NON-IMPACT INSTALLATION DETAILS			
DRAWN: N.G.	DWG NO. 08-02824	REV -	
SCALE NTS	DATE 09/28/15	SHEET 4 OF 6	

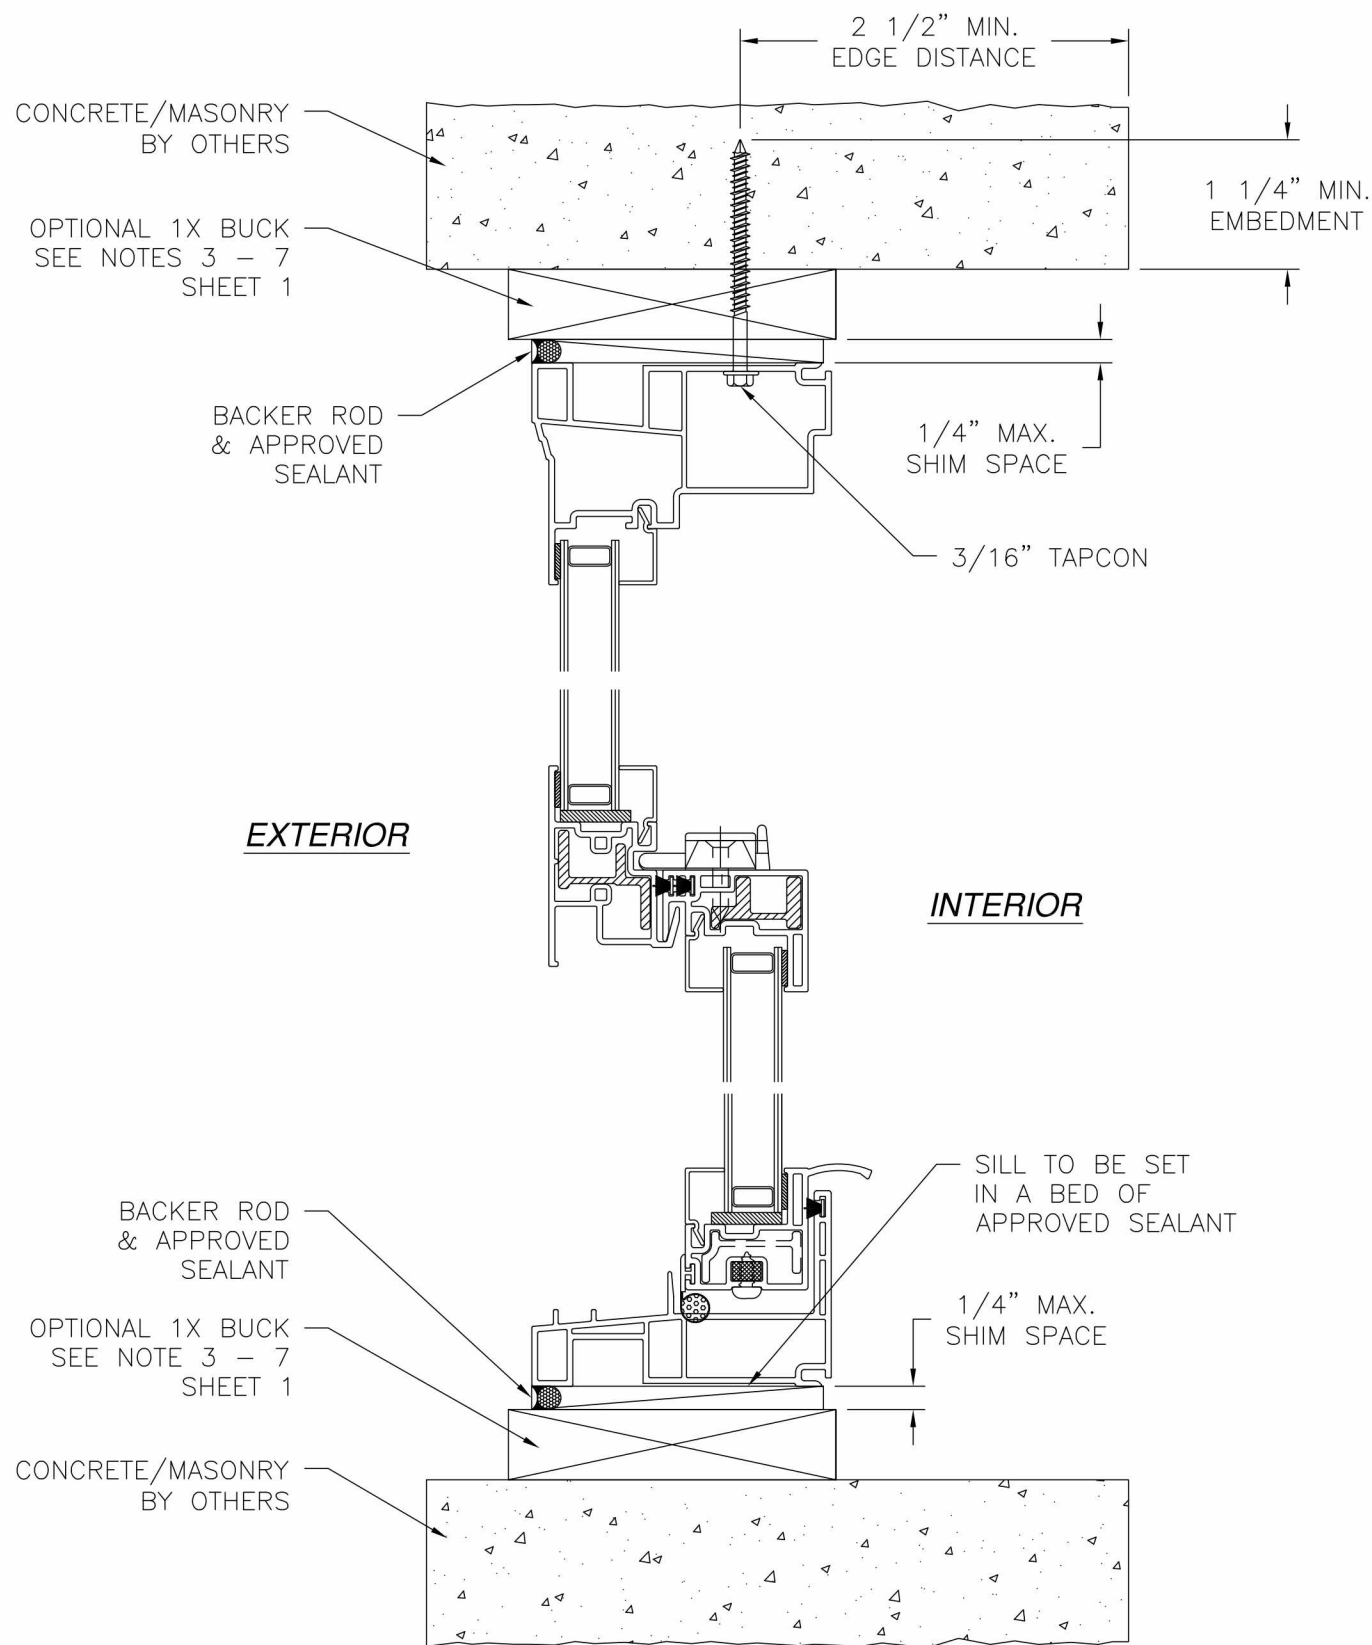

VERTICAL CROSS SECTION
CONCRETE/MASONRY INSTALLATION

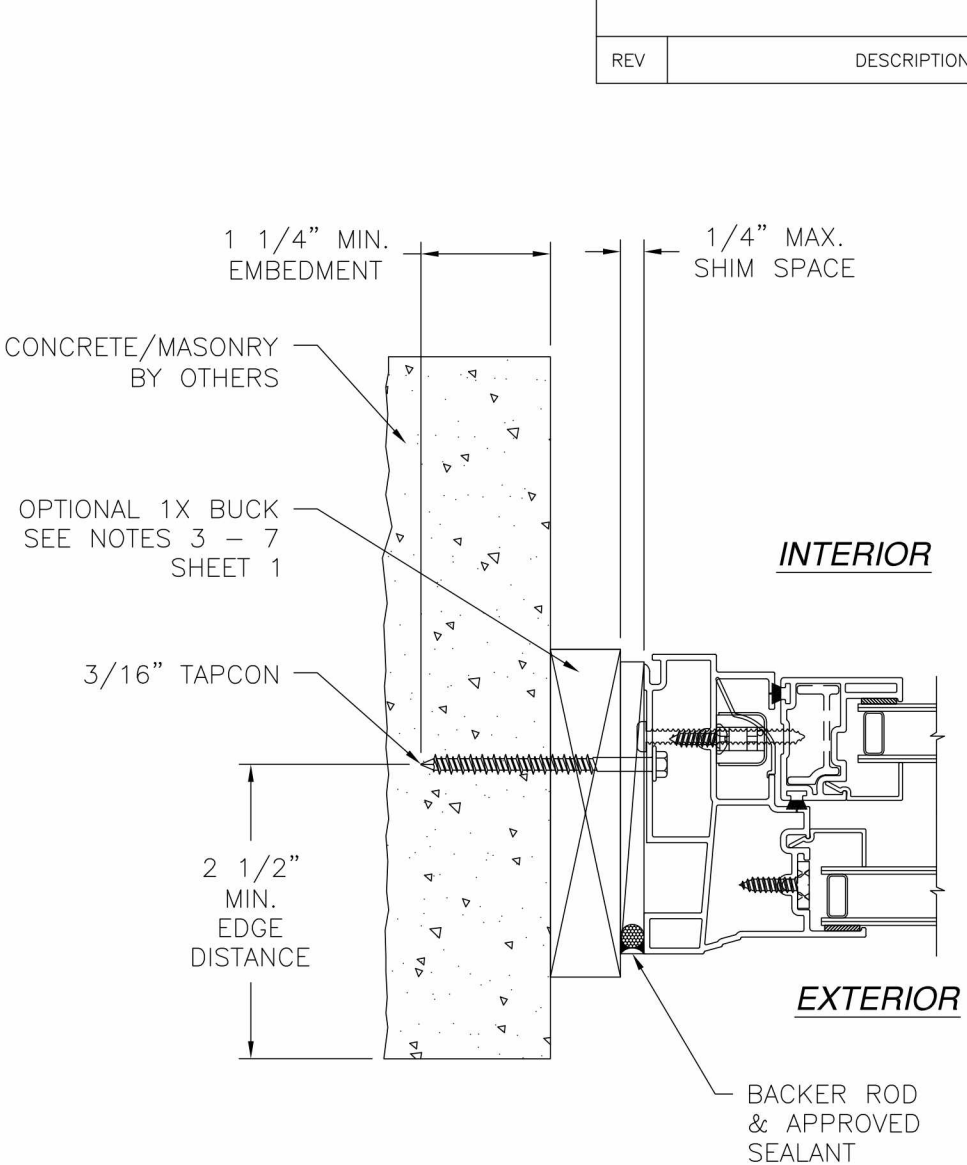

JAMB INSTALLATION DETAIL
CONCRETE/MASONRY INSTALLATION

- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

SINGNED: 09/28/2015

COMFORT VIEW PRODUCTS, LLC
320 COWETA INDUSTRIAL PARKWAY
BUILDING 7, SUITE C-I, NEWNAN, GA 30265

1900 TWIN SINGLE HUNG MULLED ASSEMBLY
71" X 83" - NON-IMPACT
INSTALLATION DETAILS

DRAWN:
N.G.

DWG NO.
08-02824




REV
-

SCALE NTS

DATE 09/28/15

SHEET 5 OF 6



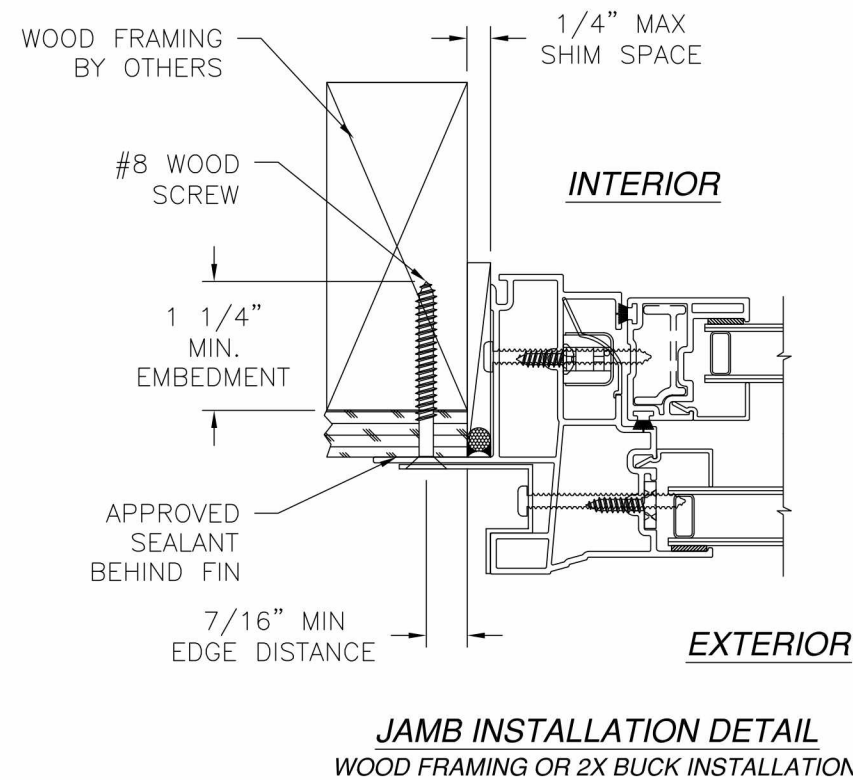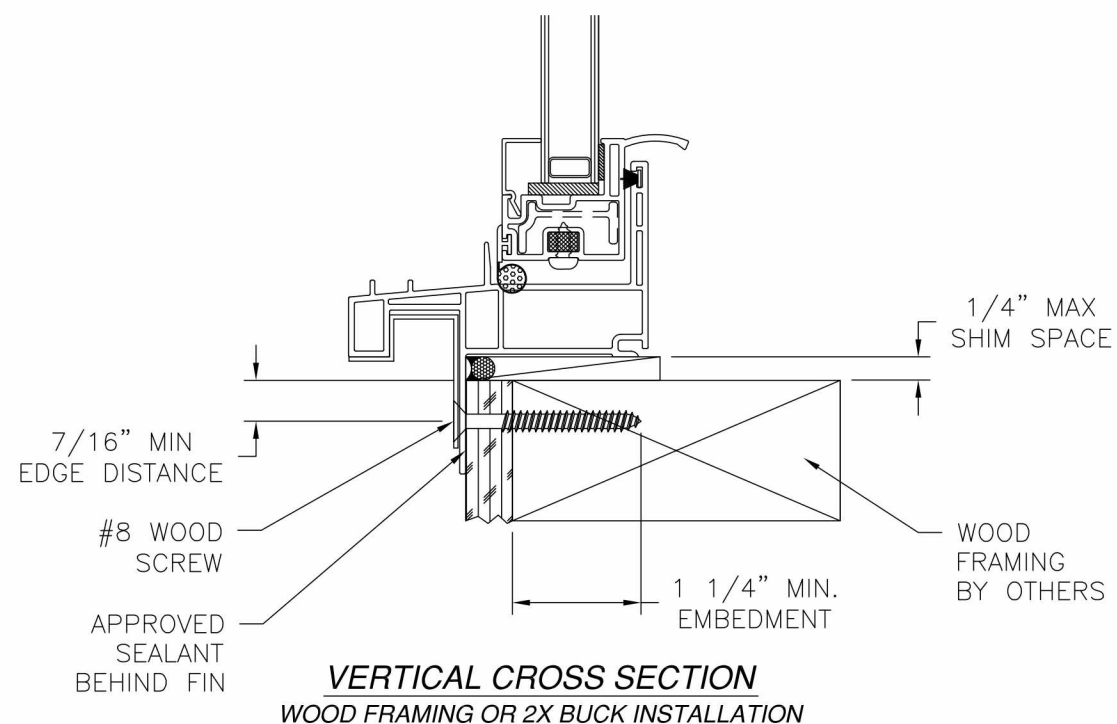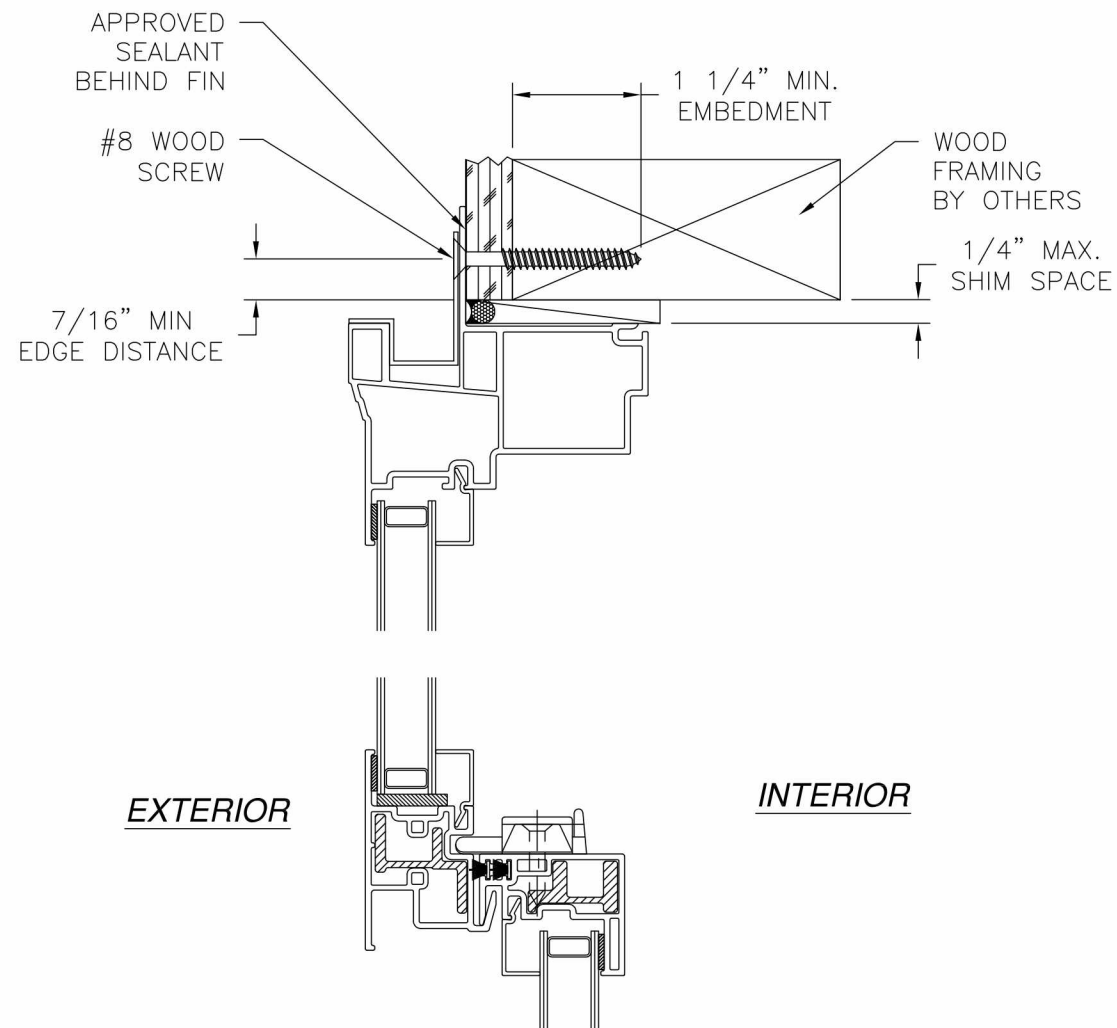

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

SINGNED: 09/28/2015

COMFORT VIEW PRODUCTS, LLC			
320 COWETA INDUSTRIAL PARKWAY BUILDING 7, SUITE C-I, NEWNAN, GA 30265			
1900 TWIN SINGLE HUNG MULLED ASSEMBLY 71" X 83" - NON-IMPACT INSTALLATION DETAILS			
DRAWN: N.G.		DWG NO. 08-02824	
		REV —	
SCALE NTS	DATE 09/28/15	SHEET 6 OF 6	

A circular professional engineer seal for Luis R. Lomas, State of Florida. The seal features the text "LUIS R. LOMAS" at the top, "LICENSE" in the middle, "No. 62514" below the license word, "STATE OF FLORIDA" below the number, and "PROFESSIONAL ENGINEER" at the bottom. The seal is surrounded by a decorative border of small vertical lines.