



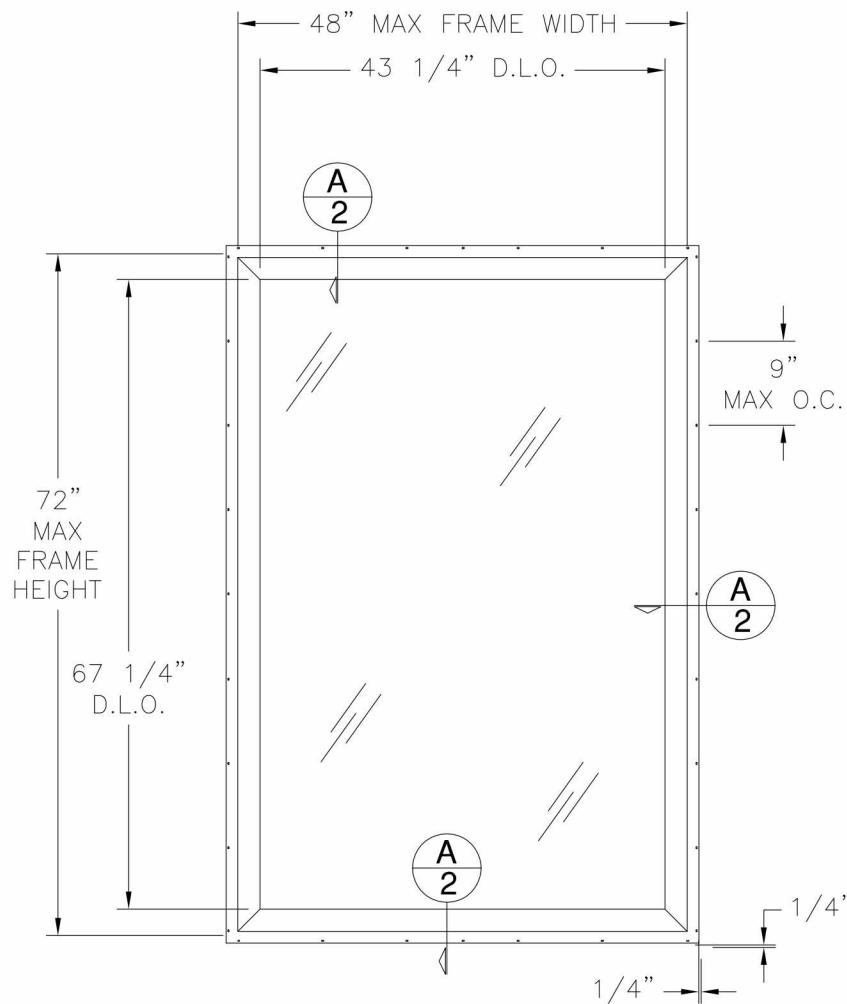

1901 PICTURE WINDOW

FIN INSTALLATION EXTERIOR VIEW

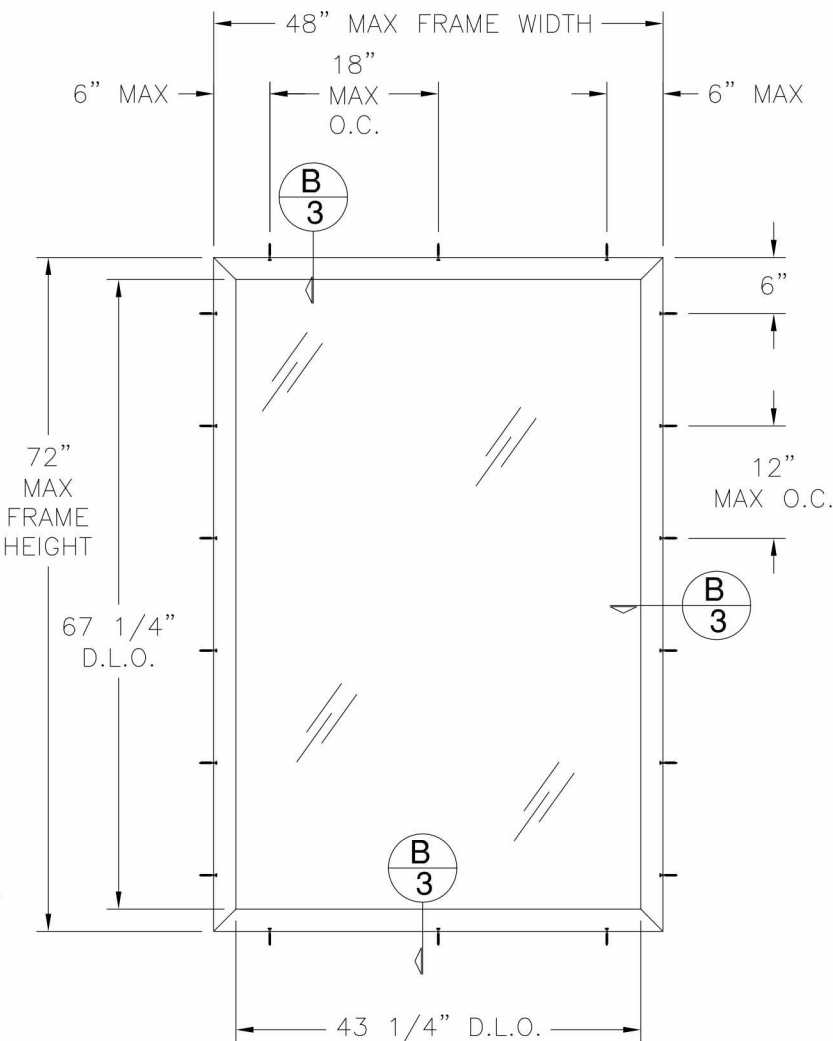

1901 PICTURE WINDOW

FRAME INSTALLATION EXTERIOR VIEW

DESIGN PRESSURE RATING	IMPACT RATING
±50.0PSF	NONE

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	ADDED FRAME INSTALLATION	03/12/12	R.L.
B	ADDED EDGE DIMENSIONS	07/06/15	R.L.


- NOTES:
- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
 - WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
 - 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
 - FRAME MATERIAL: EXTRUDED RIGID PVC.
 - UNITS MUST BE GLAZED PER ASTM E1300-04.
 - APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
 - SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
 - FOR FIN INSTALLATION INTO WOOD FRAMING OR 2X BUCK USE #6 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 3/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
 - FOR FRAME INSTALLATION INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 3/8" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
 - FOR FRAME INSTALLATION INTO MASONRY/CONCRETE USE 3/16" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
 - ALL FASTENERS TO BE CORROSION RESISTANT.
 - INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
A. WOOD – MINIMUM SPECIFIC GRAVITY OF G=0.42
B. CONCRETE – MINIMUM COMPRESSIVE STRENGTH OF 3,192 PSI.
C. MASONRY – STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).

SIGNED: 07/07/2015

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	ELEVATION, ANCHORING AND GENERAL NOTES
2	INSTALLATION DETAILS, B.O.M. AND COMPONENTS


COMFORT VIEW PRODUCTS, LLC 27 FIRST AVENUE NEWNAN, GA 30264		
1901 PICTURE WINDOW 48 x 72 ELEVATION AND NOTES		
DRAWN: DAS	DWG NO. 08-00949	REV B
SCALE NTS	DATE 2/18/10	SHEET 1 OF 3



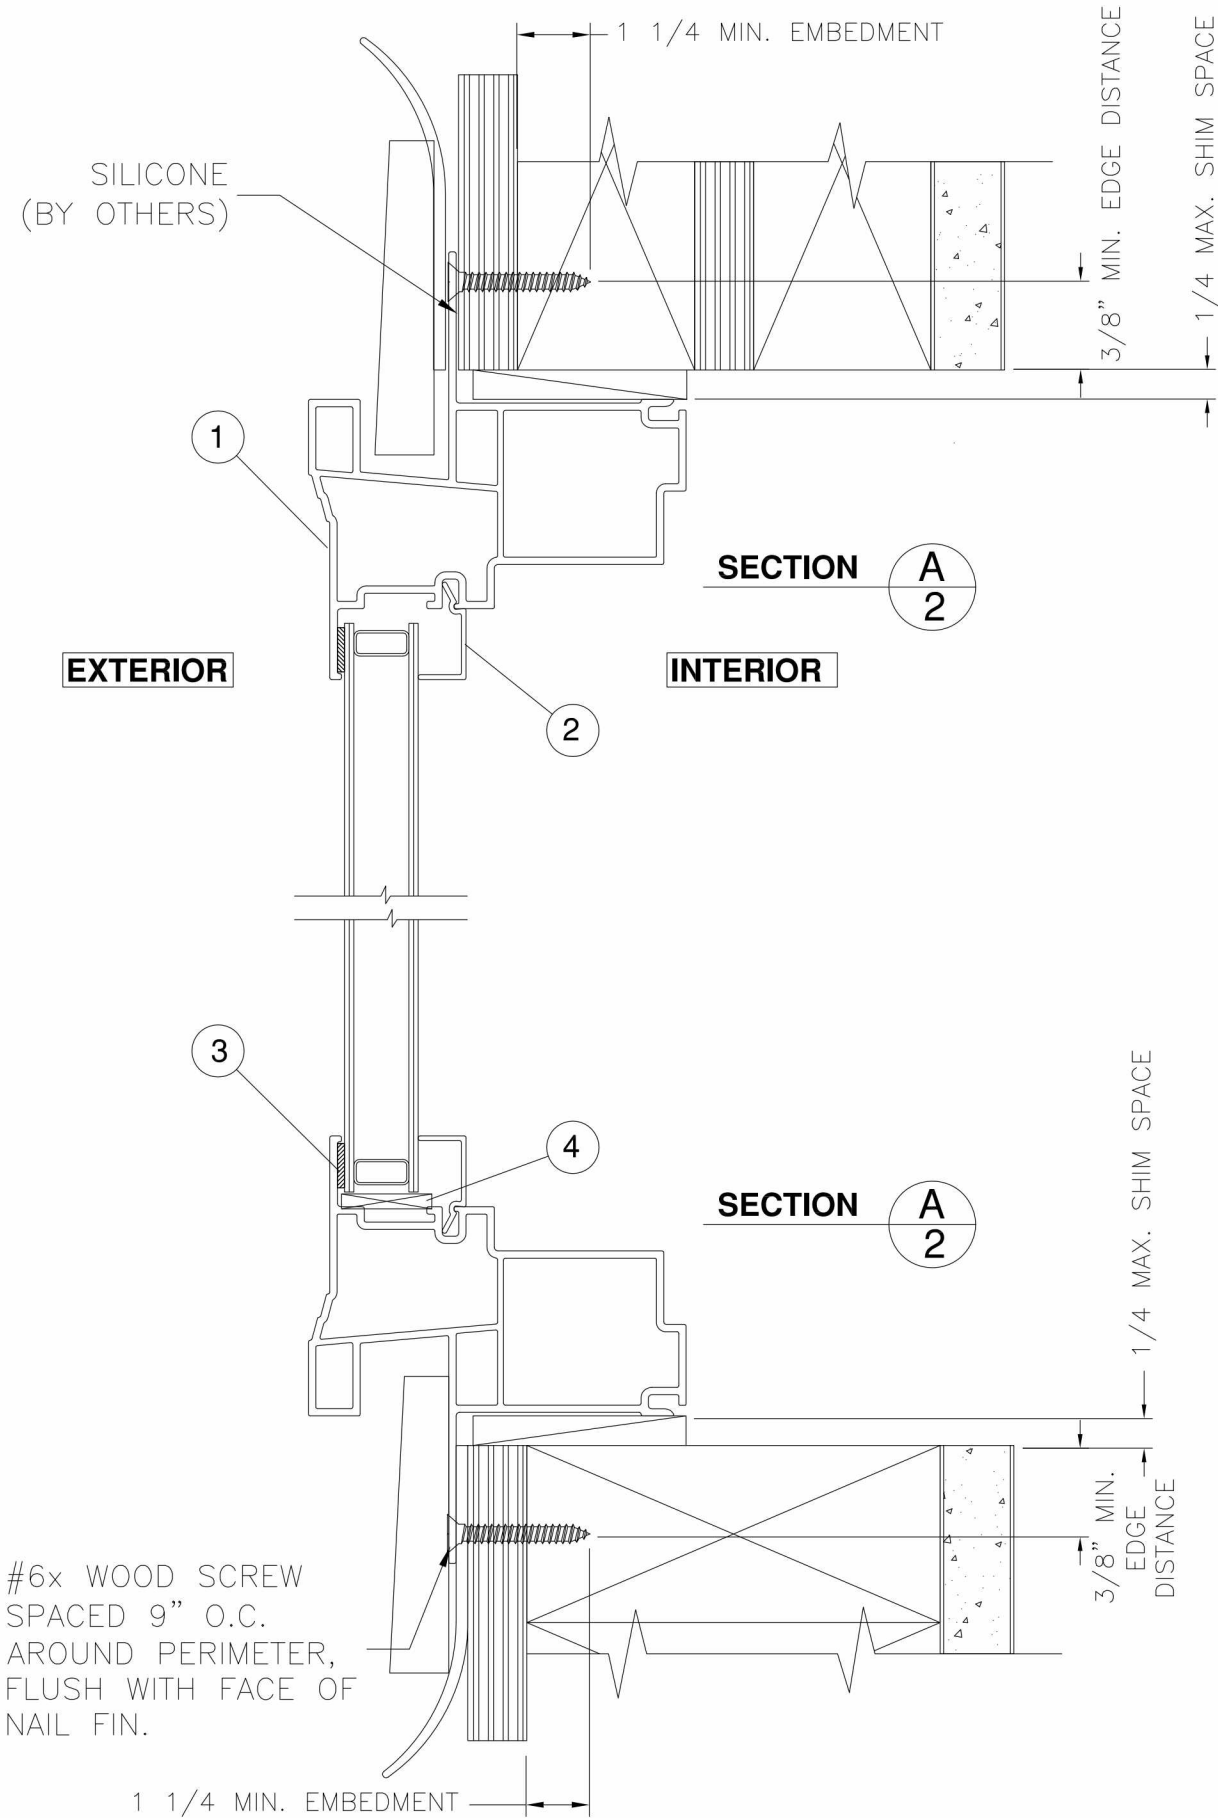

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	ADDED FRAME INSTALLATION	03/12/12	R.L.
B	ADDED EDGE DIMENSIONS	07/06/15	R.L.


PARTS		
ITEM #	ITEM DESCRIPTION	MANUFACTURER/NOTES
1	HEAD	8336 / WALL=.062 VINYL
2	GLAZING BEAD	8351 / WALL=.040 VINYL
3	GLAZING TAPE	.062 X .375
4	GLAZING BLOCK	.125 X .750 / RUBBER

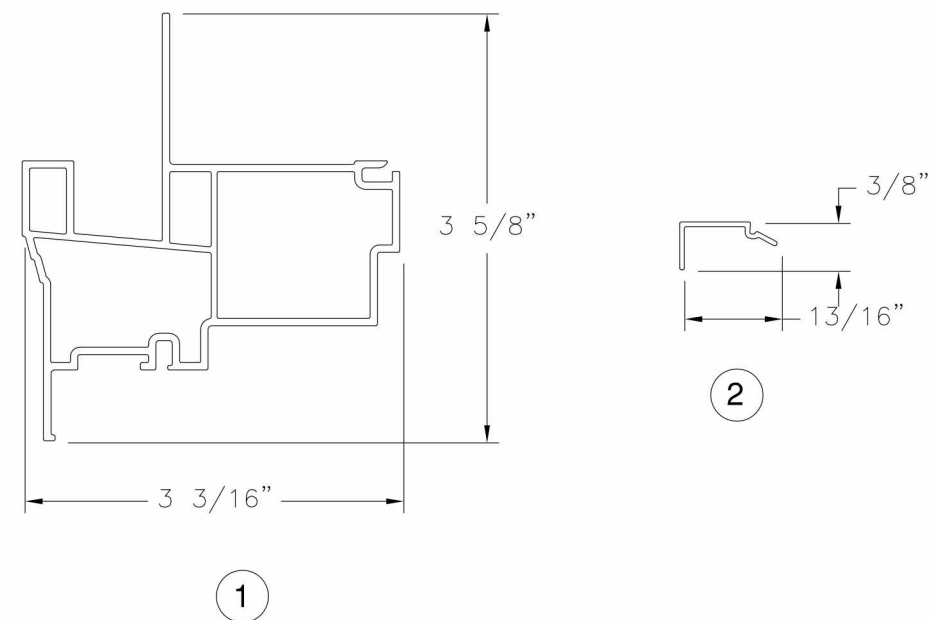

SIGNED: 07/07/2015


COMFORT VIEW PRODUCTS, LLC		
27 FIRST AVENUE NEWNAN, GA 30264		
1901 PICTURE WINDOW 48 x 72 INSTALLATION DETAILS		
DRAWN: DAS	DWG NO. 08-00949	REV B
SCALE NTS	DATE 2/18/10	SHEET 2 OF 3

LUIS R. LOMAS
LICENSE
No. 62514
STATE OF FLORIDA
PROFESSIONAL ENGINEER

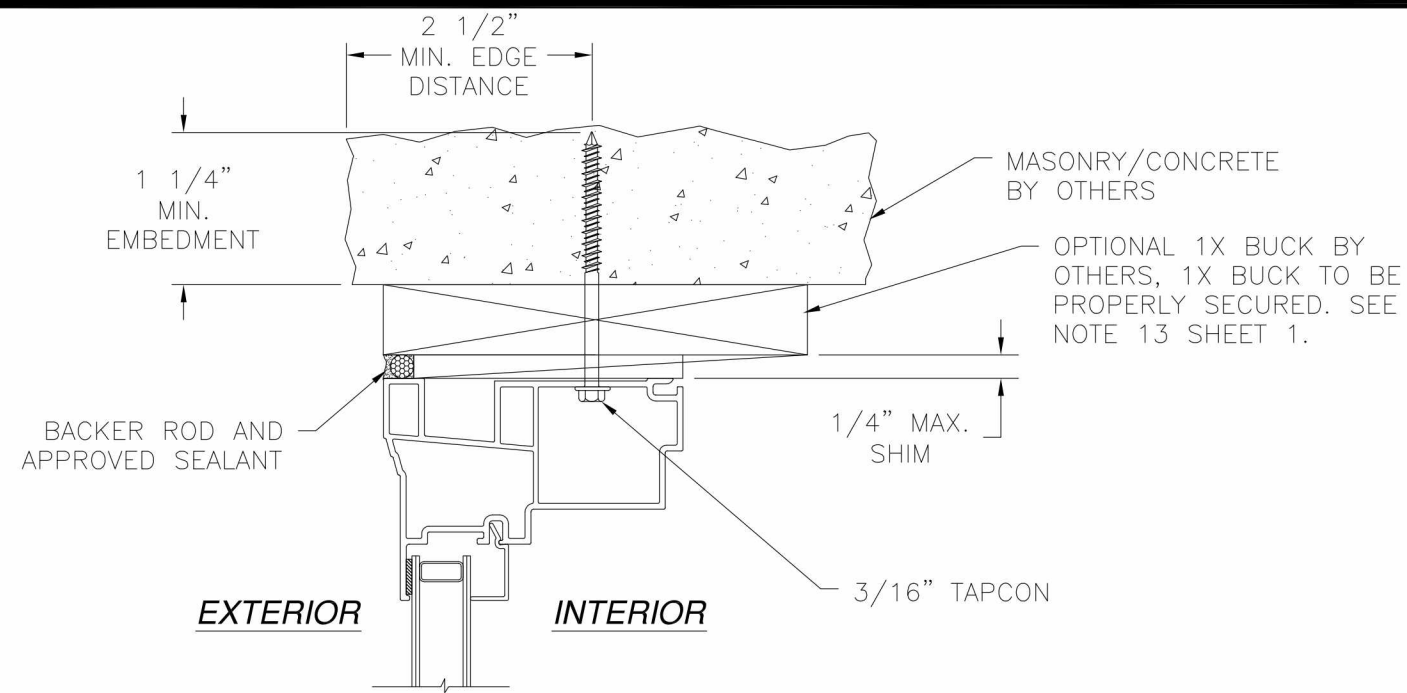

B
3

VERTICAL CROSS SECTION
MASONRY/CONCRETE FRAME INSTALLATION
HEAD SHOWN, JAMBS AND SILL SIMILAR

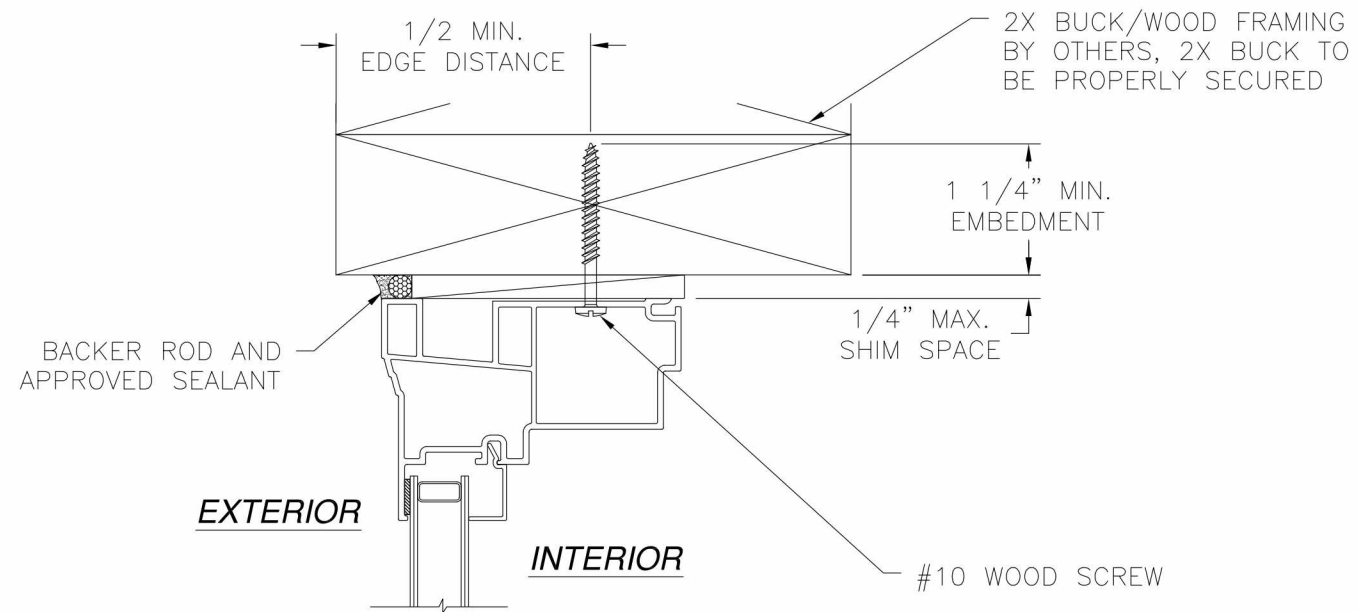

B
3

VERTICAL CROSS SECTION
2X BUCK/WOOD FRAME INSTALLATION
HEADS SHOWN, JAMBS AND SILL SIMILAR

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	ADDED FRAME INSTALLATION	03/12/12	R.L.
B	ADDED EDGE DIMENSIONS	07/06/15	R.L.

SIGNED: 07/07/2015

COMFORT VIEW PRODUCTS, LLC 27 FIRST AVENUE NEWNAN, GA 30264		
1901 PICTURE WINDOW 48 x 72 INSTALLATION DETAILS		
DRAWN: DAS	DWG NO. 08-00949	REV B
SCALE NTS	DATE 2/18/10	SHEET 3 OF 3

LUIS R. LOMAS
LICENSE
No. 62514
STATE OF FLORIDA
PROFESSIONAL ENGINEER