

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED PER NEW REQUIREMENTS	02/02/26	R.L.

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
4. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1–1/2” WINDOW UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER’S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
5. WHERE WOOD BUCK THICKNESS IS 1–1/2” OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. WINDOW UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER’S PUBLISHED INSTALLATION INSTRUCTIONS.
6. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
7. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
8. SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16” OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4”.
9. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
10. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
11. FRAME MATERIAL: EXTRUDED RIGID PVC.
12. UNITS MUST BE GLAZED PER ASTM E1300.
13. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.

14. FOR ANCHORING THROUGH FIN INTO WOOD FRAMING OR 2X BUCK USE #6 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 3/4” MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
15. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 3/8” MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 3/16” TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4” MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2 1/2” MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
17. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER’S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:

17.A. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42

17.B. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.

17.C. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH f’m=2,000PSI MINIMUM.
18. APPROVED CONFIGURATIONS: OX, XO.

SIGNED: 02/10/2026

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATIONS
3 – 5	INSTALLATION DETAILS

COMFORT VIEW PRODUCTS, LLC.
320 COWETA INDUSTRIAL PARKWAY
NEWNAN, GA 30265

1920/1952 HORIZONTAL SLIDER WINDOW
NON-IMPACT
NOTES

DRAWN:
DAS

DWG NO.
08-00959D


REV
D

SCALE NTS

DATE 02/22/10


SHEET 1 OF 5

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

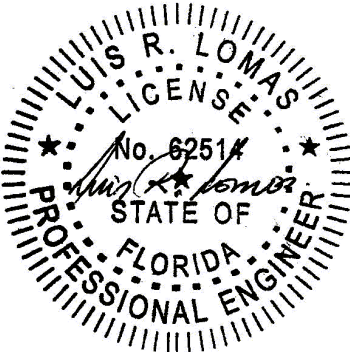


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED PER NEW REQUIREMENTS	02/02/26	R.L.

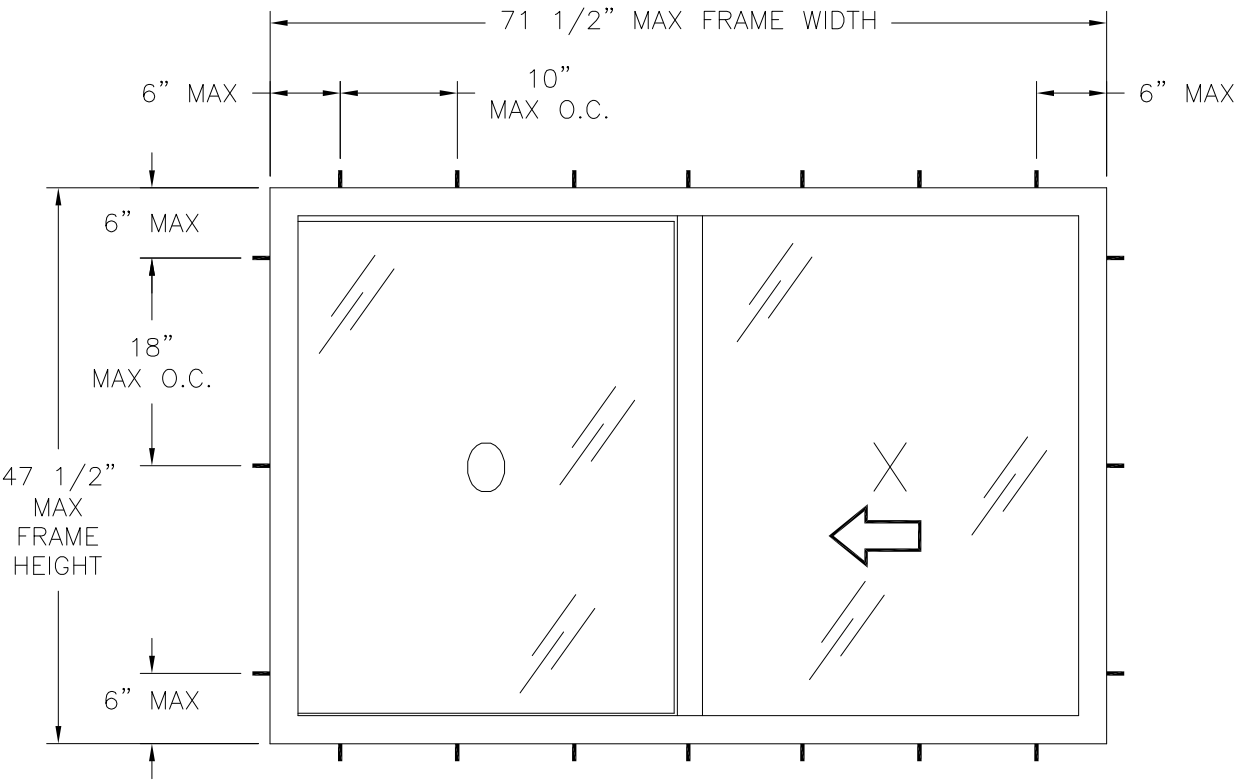

1920 HP HORIZONTAL SLIDER
EXTERIOR VIEW
FRAME INSTALLATION

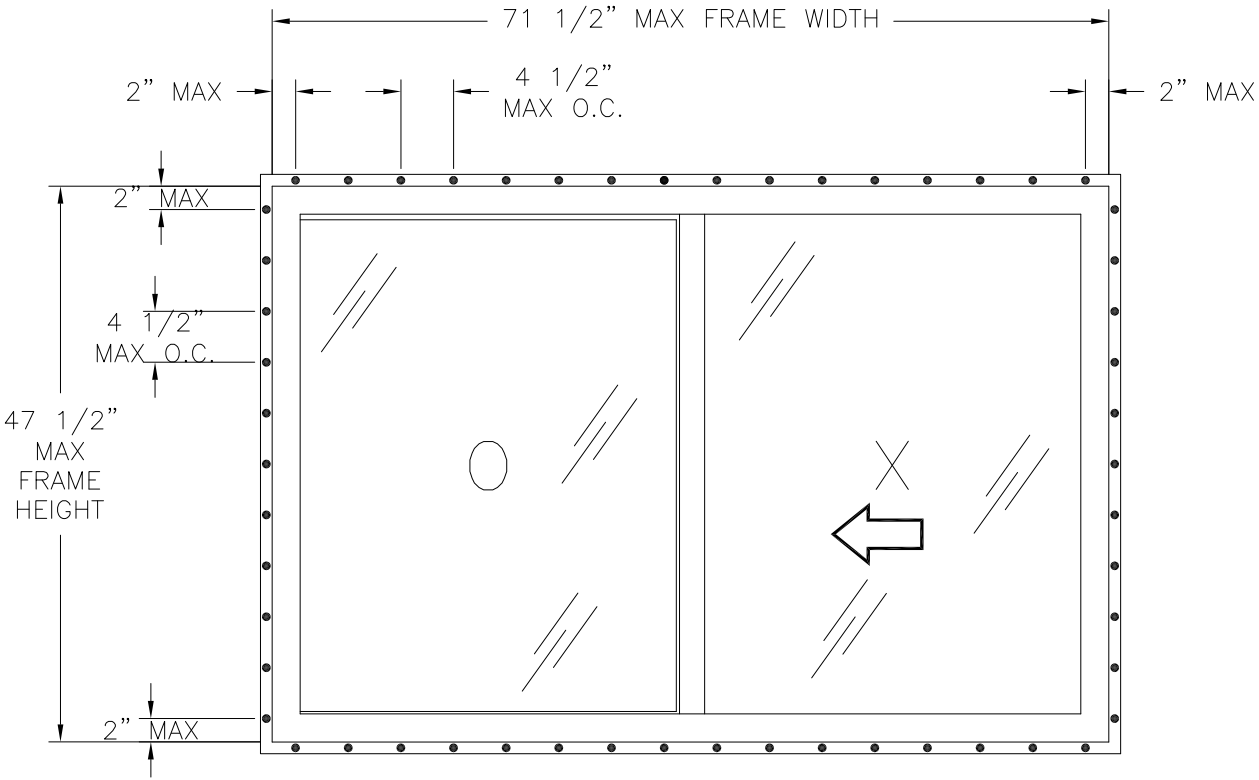

1920 HP HORIZONTAL SLIDER
EXTERIOR VIEW
FIN INSTALLATION


DESIGN PRESSURE RATING	IMPACT RATING
+50.0/-55.0PSF	NONE

- NOTES:
1. MAXIMUM SASH SIZE: 34 7/8" X 44 1/2"
 2. MAXIMUM D.L.O.: 32 1/4" X 42 3/4"

HARDWARE SCHEDULE	
A.	(2) PLASTIC SWEEP LOCK AT 8" FROM TOP & BOTTOM RAILS
B.	EXTRUDED ALUMINUM REINFORCEMENT (1557-PM08) AT INTERMEDIATE STILE




COMFORT VIEW PRODUCTS, LLC. 320 COWETA INDUSTRIAL PARKWAY NEWNAN, GA 30265		
1920/1952 HORIZONTAL SLIDER WINDOW NON-IMPACT ELEVATIONS		
DRAWN: DAS	DWG NO. 08-00959D	REV D
SCALE NTS	DATE 02/22/10	SHEET 2 OF 5
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

SIGNED: 02/10/2026

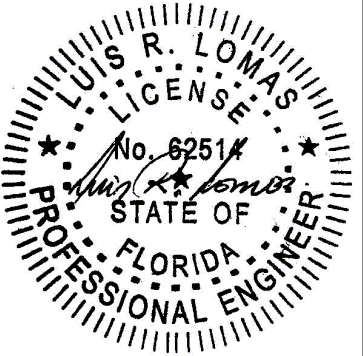

Luis R. Lomas P.E.
FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED PER NEW REQUIREMENTS	02/02/26	R.L.

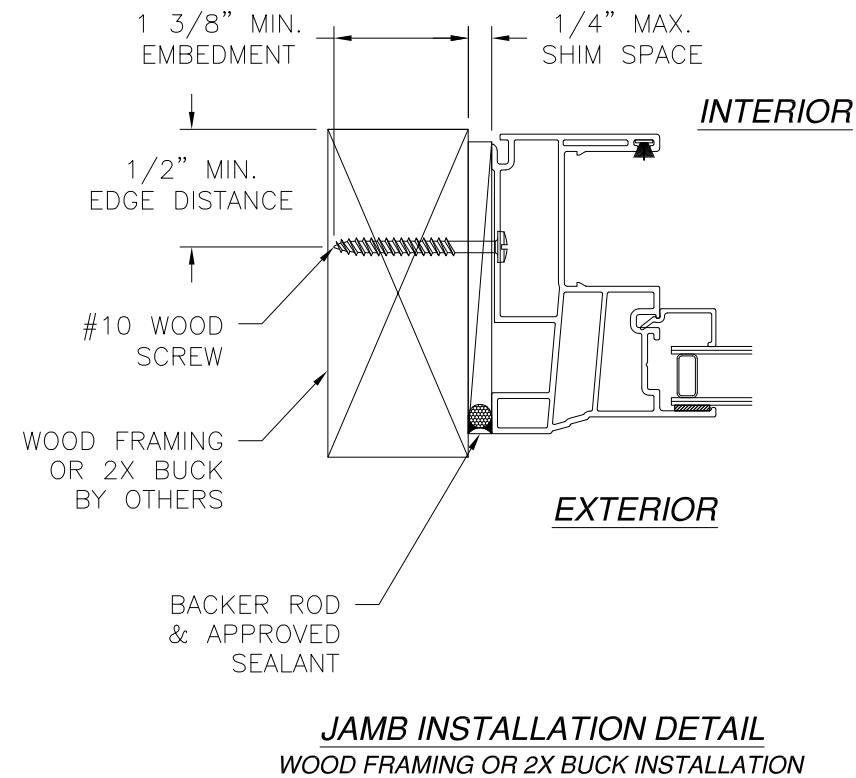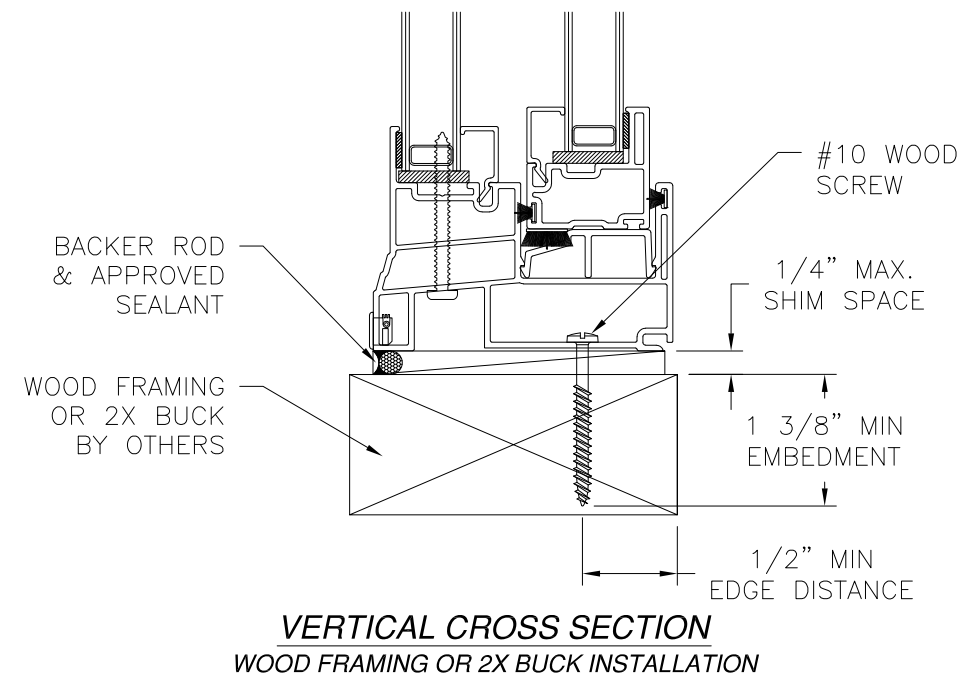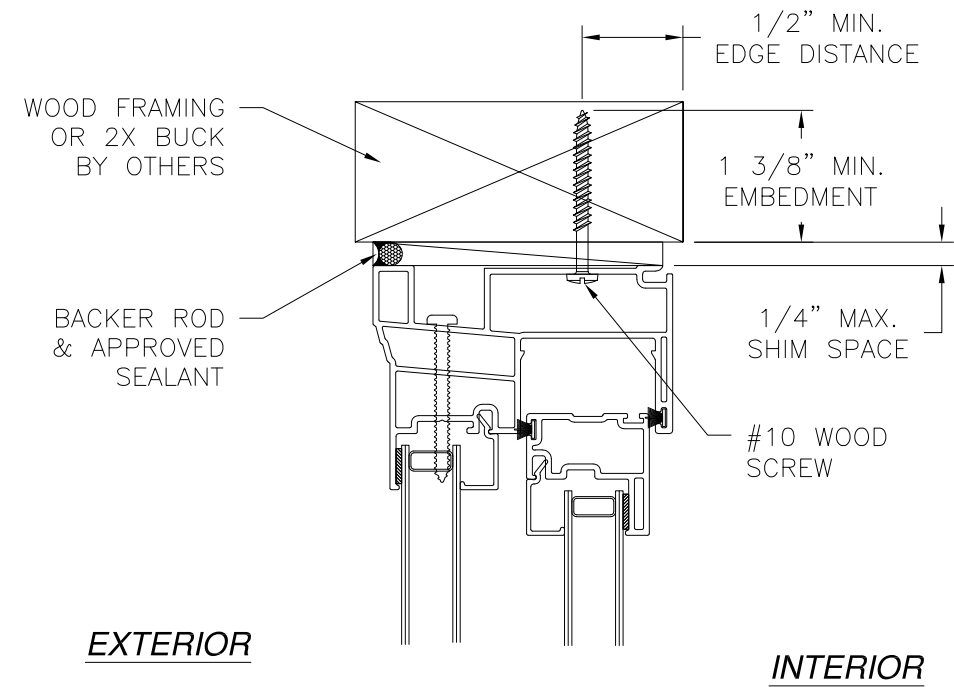

- NOTES:
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112



SIGNED: 02/10/2026

COMFORT VIEW PRODUCTS, LLC. 320 COWETA INDUSTRIAL PARKWAY NEWNAN, GA 30265		
1920/1952 HORIZONTAL SLIDER WINDOW NON-IMPACT INSTALLATION DETAILS		
DRAWN: DAS	DWG NO. 08-00959D	REV D
SCALE NTS	DATE 02/22/10	SHEET 3 OF 5
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

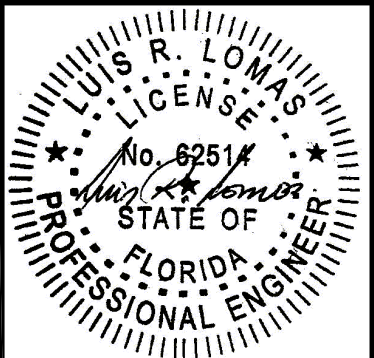


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED PER NEW REQUIREMENTS	02/02/26	R.L.

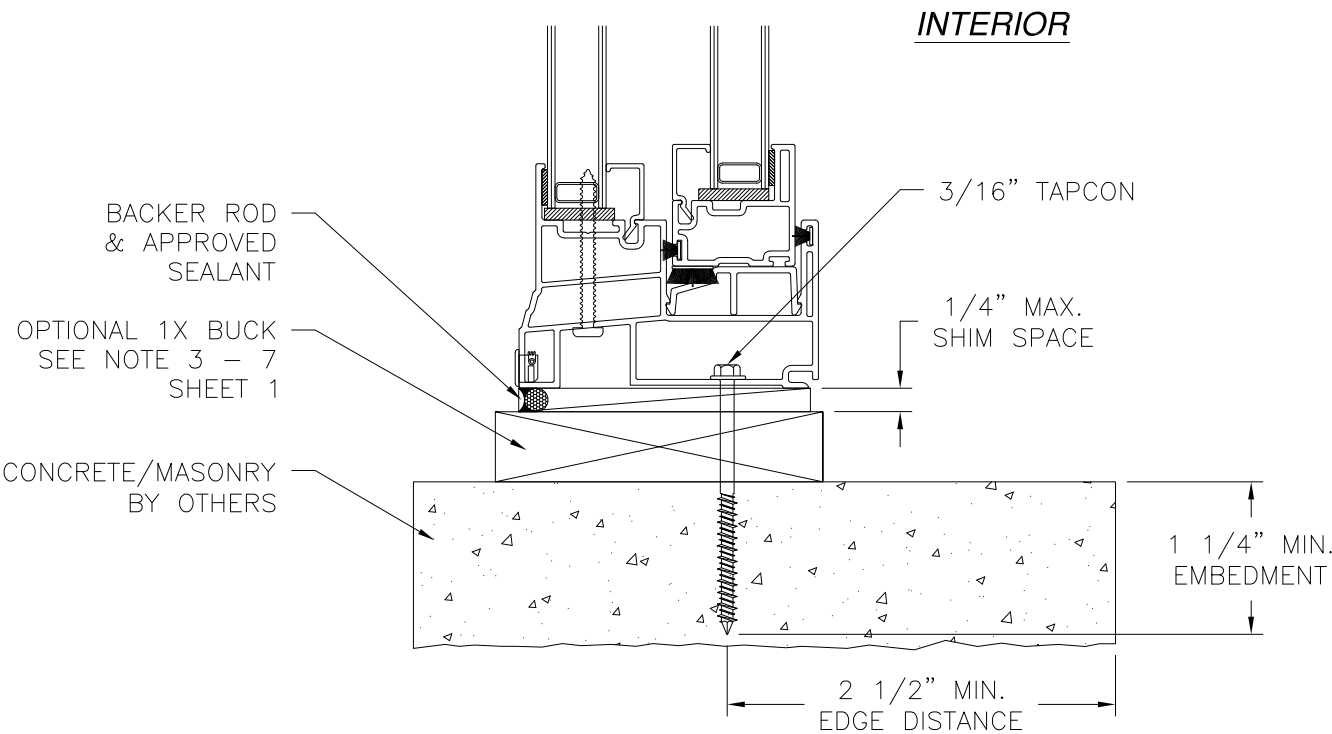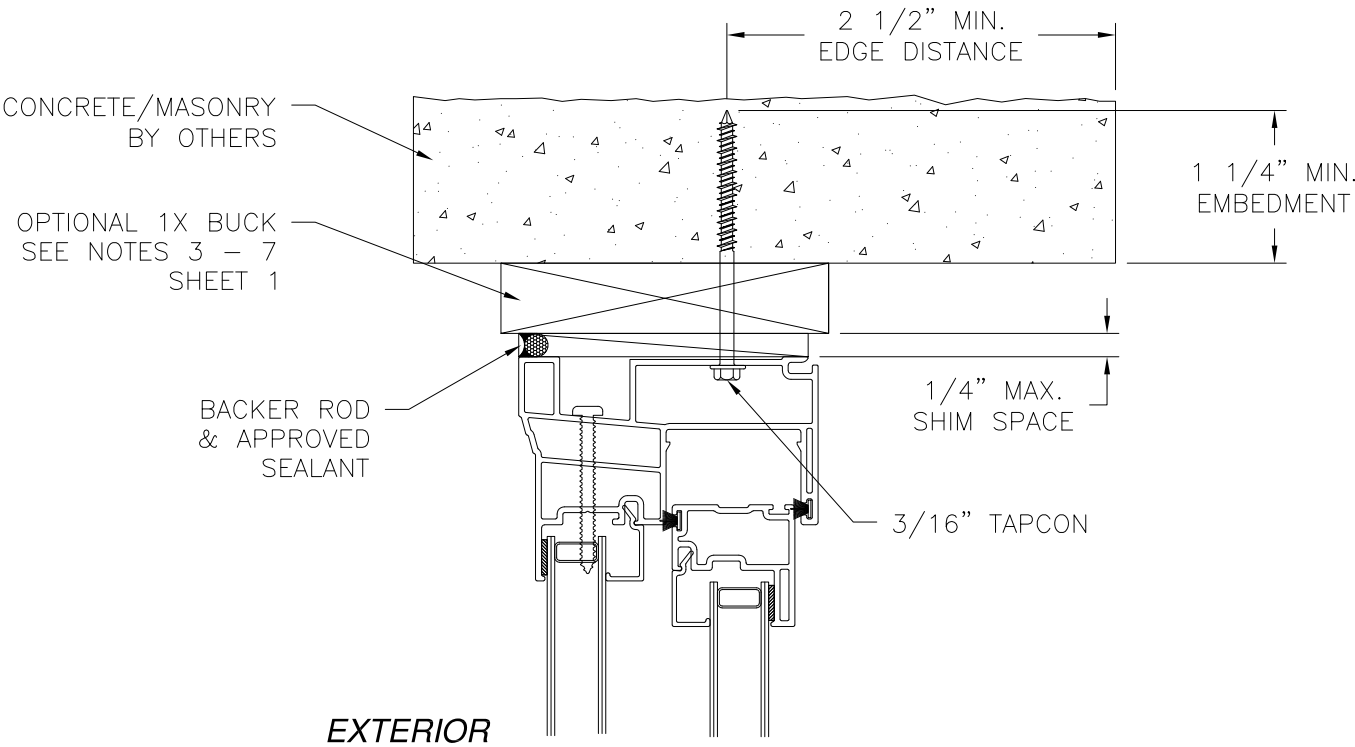

VERTICAL CROSS SECTION
CONCRETE/MASONRY INSTALLATION

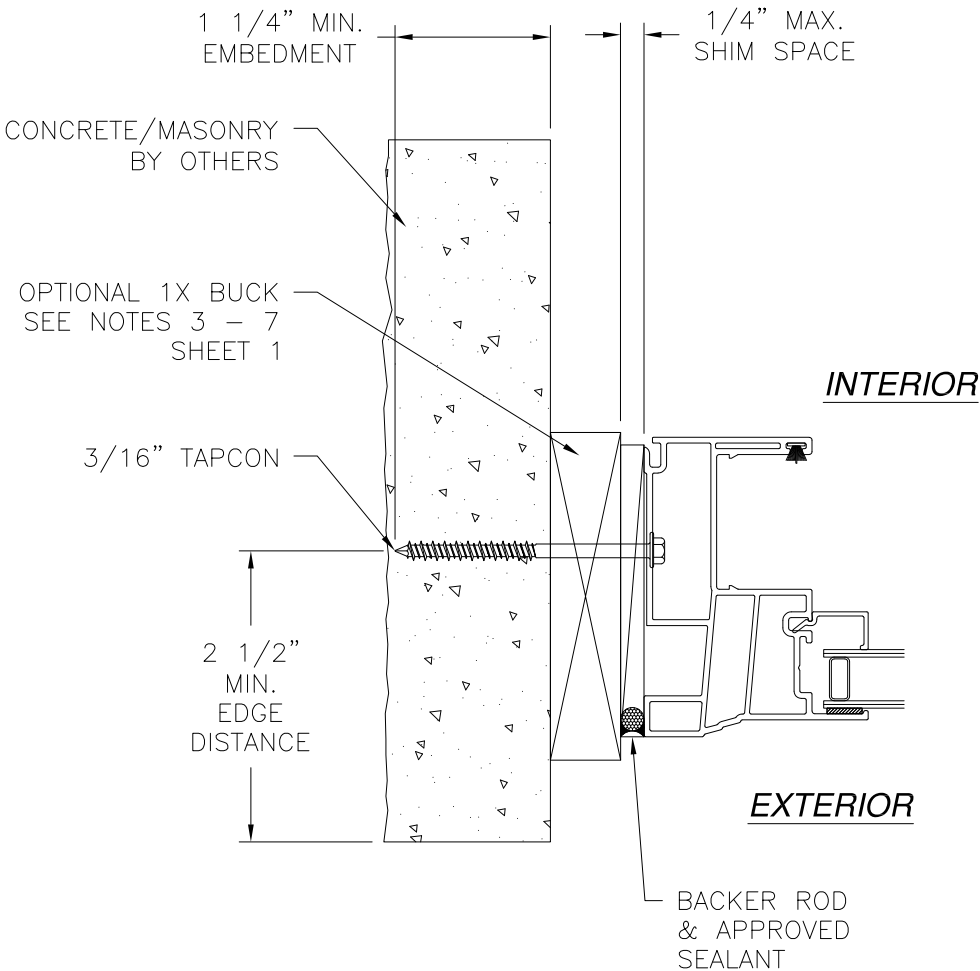


JAMB INSTALLATION DETAIL
CONCRETE/MASONRY INSTALLATION

- NOTES:**
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 02/10/2026

COMFORT VIEW PRODUCTS, LLC. 320 COWETA INDUSTRIAL PARKWAY NEWNAN, GA 30265		
1920/1952 HORIZONTAL SLIDER WINDOW NON-IMPACT INSTALLATION DETAILS		
DRAWN: DAS	DWG NO. 08-00959D	REV D
SCALE NTS	DATE 02/22/10	SHEET 4 OF 5
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

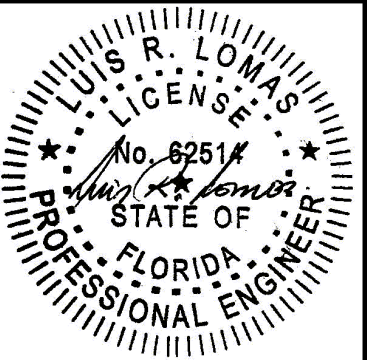


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
D	REVISED PER NEW REQUIREMENTS	02/02/26	R.L.

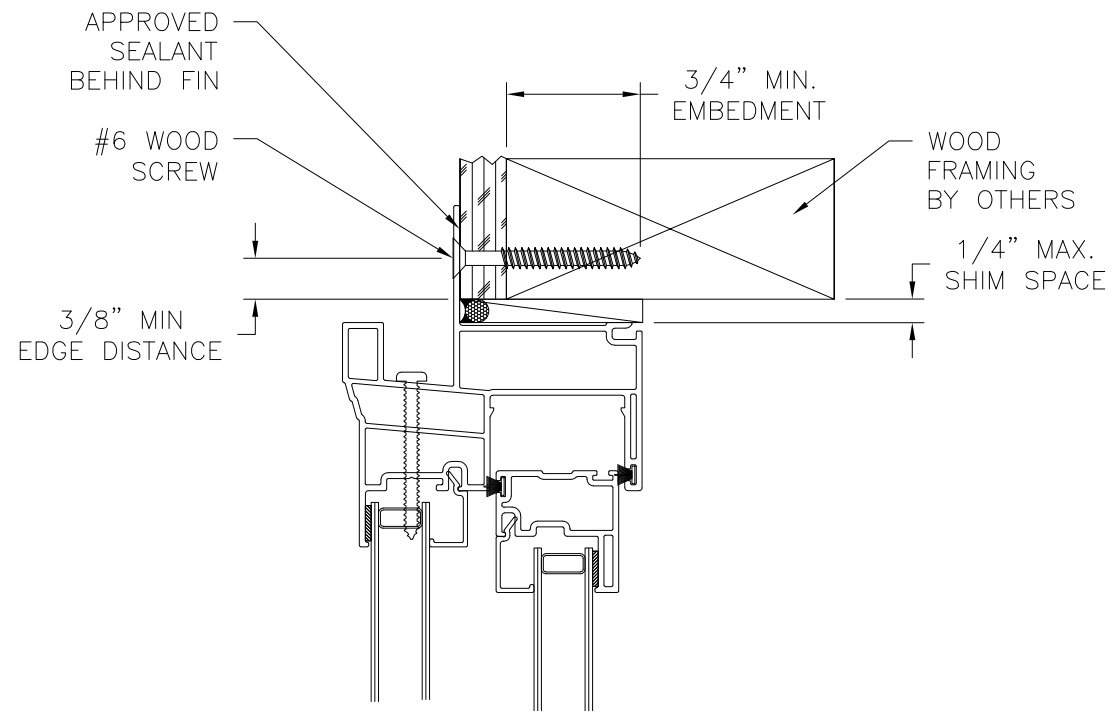


EXTERIOR

INTERIOR

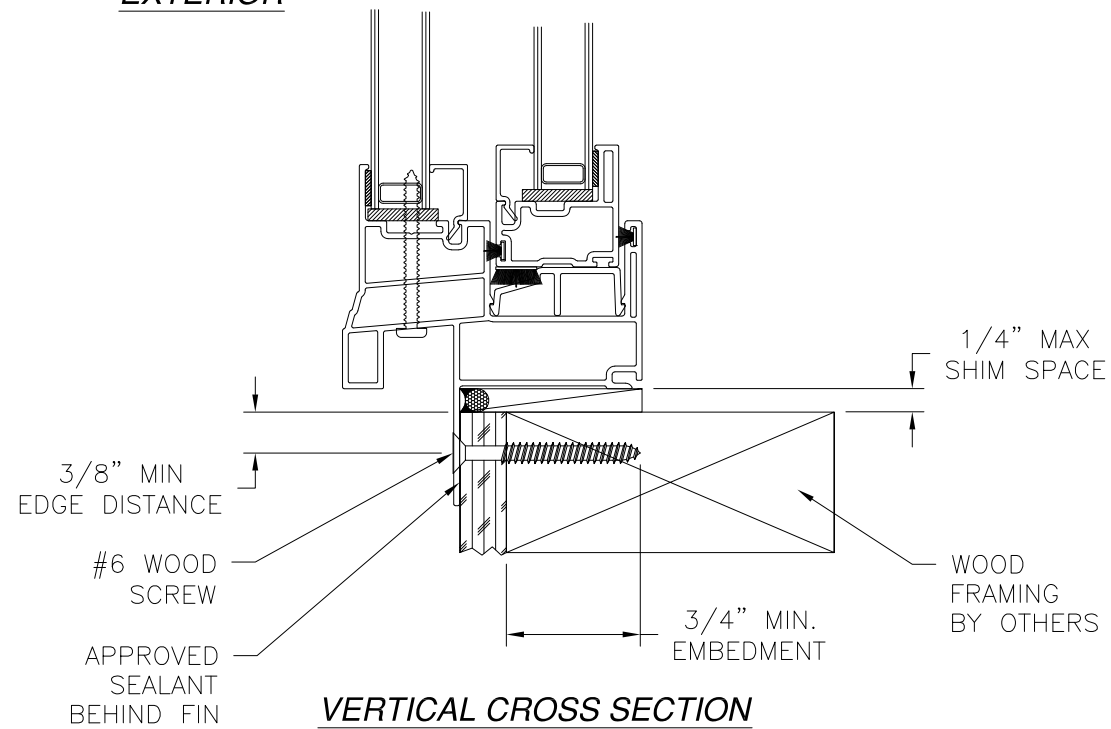

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

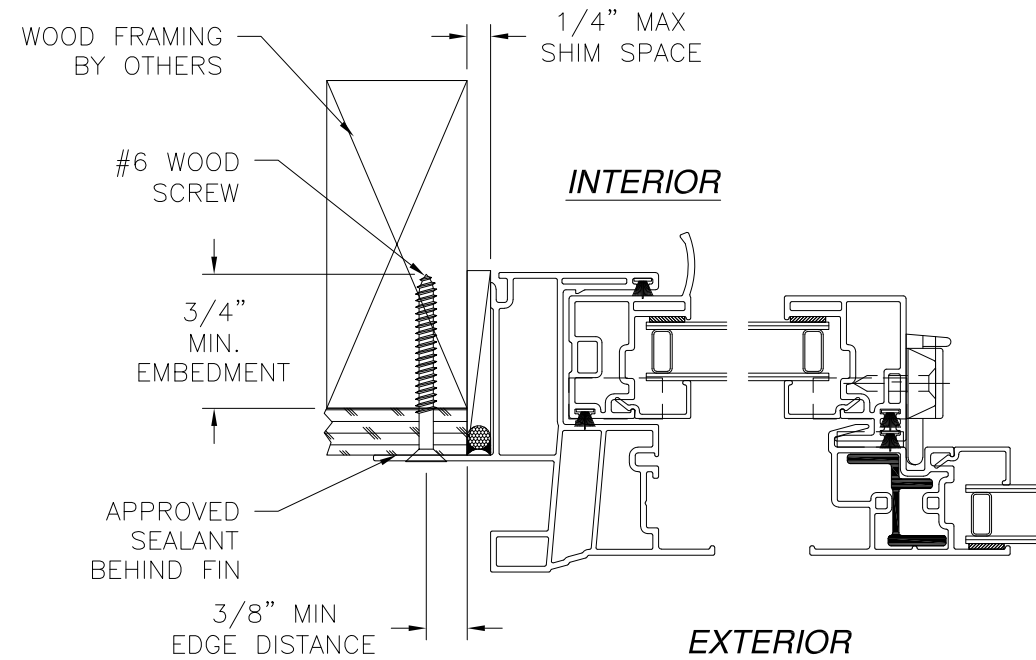

INTERIOR

EXTERIOR

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 02/10/2026

COMFORT VIEW PRODUCTS, LLC.
320 COWETA INDUSTRIAL PARKWAY
NEWNAN, GA 30265

1920/1952 HORIZONTAL SLIDER WINDOW
NON-IMPACT
INSTALLATION DETAILS

DRAWN: DAS	DWG NO. 08-00959D	REV D
SCALE NTS	DATE 02/22/10	SHEET 5 OF 5

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

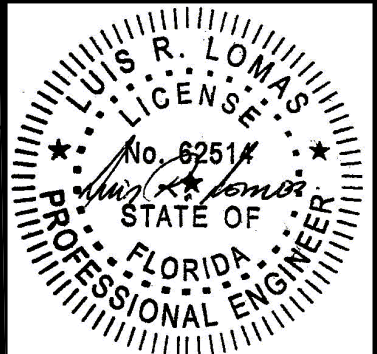

Luis R. Lomas P.E.
FL No.: 62514