

PLY GEM WINDOWS

CONTRACTOR SERIES 2000 HORIZONTAL
SLIDING WINDOW (NON-IMPACT)

NOTES:

1. THIS INSTALLATION HAS BEEN EVALUATED FOR USE IN LOCATIONS ADHERING TO THE FLORIDA BUILDING CODE OUTSIDE THE HVHZ, AND WHERE PRESSURE REQUIREMENTS AS DETERMINED BY ASCE 7 MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES DO NOT EXCEED THE DESIGN PRESSURE RATINGS HEREIN.

2. WHEN USED IN AREAS REQUIRING IMPACT PROTECTION, THIS PRODUCT REQUIRES THE USE OF APPROVED IMPACT PROTECTIVE DEVICES (SHUTTERS).

3. ANCHOR TYPE, SIZE, SPACING, EMBEDMENT, AND EDGE DISTANCE SHALL BE AS SPECIFIED IN THESE DRAWINGS. USE APPROPRIATE ANCHORAGE FROM TABLE I ACCORDING TO SUBSTRATE TYPE. A MINIMUM CENTER-TO-CENTER SPACING OF 3" SHALL BE MAINTAINED BETWEEN ALL INSTALLATION FASTENERS IN ANY DIRECTION.

4. ANCHOR EMBEDMENT TO SUBSTRATE SHALL BE BEYOND WALL DRESSING OR STUCCO. FOR MASONRY OPENINGS WITH WOOD BUCKS LESS THAN 1-1/2" THICK, EMBEDMENT SHALL BE BEYOND WOOD BUCKS, IF USED, AND INTO MASONRY SUBSTRATE. WOOD BUCKS WITH MASONRY ARE OPTIONAL.

5. WOOD, METAL, OR MASONRY OPENINGS, BUCKS, AND BUCK FASTENERS, BY OTHERS, SHALL BE PROPERLY DESIGNED AND INSTALLED BY OTHERS TO TRANSFER SUPERIMPOSED LOADS TO THE STRUCTURE. ADEQUACY OF THE STRUCTURE TO RECEIVED THESE LOADS SHALL BE VERIFIED BY THE CONTRACTOR OR AUTHORITY HAVING JURISDICTION (AHJ).

6. IT IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD OR AS APPROVED BY THE AHJ TO SELECT PLY GEM PRODUCTS TO MEET ALL APPLICABLE LOCAL LAWS, BUILDING CODES, ORDINANCES, OR OTHER SAFETY REQUIREMENTS FOR EACH INSTALLATION.

7. SHIMS ARE REQUIRED WHERE GAPS OF GREATER THAN 1/16" EXIST BETWEEN OPENING AND FRAME. MAX. SHIM STACK IS 1/4". SHIMS SHALL BE LOAD-BEARING AND CAPABLE OF TRANSFERRING LOADS TO THE SUBSTRATE.

8. SEALING AND FLASHING STRATEGIES FOR OVERALL WATER INFILTRATION RESISTANCE OF THE INSTALLED PRODUCT SHALL BE THE RESPONSIBILITY OF OTHERS USING ASTM E 2112 AND IS NOT ADDRESSED BY THIS DOCUMENT.

9. INSTALLED GLAZING SHALL COMPLY WITH ASTM E 1300.

10. ALL FASTENERS PENETRATING INTO PRESSURE TREATED WOOD SHALL BE CAPABLE OF PREVENTING CORROSION DUE TO REACTION WITH PRESSURE TREATMENT CHEMICALS. ANY DISSIMILAR MATERIALS THAT COME INTO CONTACT SHALL BE PROTECTED TO PREVENT REACTIONS IN ACCORDANCE WITH CODE REQUIREMENTS.

11. A WIND LOAD DURATION FACTOR Cd = 1.6 WAS USED FOR THE ANALYSIS OF WOOD SCREWS ONLY.

12. PRODUCTS SHALL BE CONSTRUCTED AS SPECIFIED IN TEST REPORTS NATIONAL CERTIFIED TESTING LABORATORIES I10-I2917-1, I10-I2917-2, I10-I2963-3 & I10-I2963-4.

13. DESIGNATION "X" IS FOR OPERABLE PANEL AND "O" IS FOR FIXED PANEL.

14. USE A BACKER ROD ON ALL JOINTS >3/4" DEEP AND/OR WIDER THAN 1/4". FINISHED CAULK JOINT SHOULD BE A MINIMUM OF 3/8" DEEP.

SIZE CHART				
OVERALL SIZE		CONFIGURATION	PRODUCT RATING	MAX. DESIGN PRESSURE
WIDTH	HEIGHT			
63"	44"	XX	HS-R25	+25/-30 PSF*
84"	48"	XXX	HS-R25	+25/-30 PSF*
84"	48"	XXX (QHQ)	HS-R25	+/-25 PSF

* SPECIMENS STRUCTURALLY TESTED TO +/- 30 PSF

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL & INSTALLATION NOTES
2	ELEVATIONS & ANCHOR LAYOUTS
3	VERTICAL & HORIZONTAL SECTIONS, & GLAZING DETAIL

Lucas
Turner
2020.12.0
9 10:30:54
-06'00'

TABLE I: INSTALLATION FASTENERS TABLE

ID	SUBSTRATE TYPE	ANCHOR TYPE	MIN. EMBED.	MIN. EDGE DISTANCE
A	CONCRETE (2 KSI MIN.)	3/16" ITW TAPCON	1-1/2"	1-1/8"
B	HOLLOW OR GROUT-FILLED CMU (117 PCF MIN.)	3/16" ITW TAPCON	1"	2"
C	2X MIN. SOUTHERN PINE WOOD (G=0.55)	#10 WOOD SCREW	1-1/2"	3/8"
D	2X MIN. SOUTHERN PINE WOOD (G=0.55)	3/16" ITW TAPCON	1-3/8"	7/8"
E	16 GAUGE (0.060") STEEL 36 KSI MIN. OR 1/8" ALUM. 6063-T5 MIN.	#10-16 SELF-DRILLING SCREW (TEKS/DRIL-FLEX/KWIK-FLEX)	FULL, PLUS 3 THREADS MIN.	1/2"

*NOTE: ALL SCREWS SHALL HAVE MOD. TRUSS, PAN, OR HEX WASHER HEAD, 0.42" MIN. HEAD OR WASHER DIAMETER. ALL NAILS SHALL HAVE FULL ROUND HEAD (OR USE CAPS/WASHERS), 0.42" MIN. HEAD OR WASHER DIAMETER.

PlyGem

RESIDENTIAL SOLUTIONS

A division of Cornerstone Building Brands

433 N. MAIN ST., PO BOX 559
ROCKY MOUNT, VA 24151

PH: 540-484-6348
FX: 540-484-6683

TITLE: CONTRACTOR SERIES 2000 HORIZONTAL SLIDER GENERAL AND INSTALLATION NOTES	REVISION DESCRIPTION		DATE	
	NO.	BY	DATE	
	A	TJM	1.14.14	
	B	LMH	01.15.18	
2010 FBC REVISIONS		UPDATED FORMAT		
		UPDATED FOR 7TH EDITION (2020) FBC		
DATE: 06.03.10	DWN BY: MSS	CHK BY:	SCALE: NTS	

LUCAS A. TURNER

LICENSE

No. 58201

STATE OF FLORIDA

PROFESSIONAL ENGINEER

12/09/2020
LUCAS A. TURNER, P.E.
FL PE # 58201
TURNER ENGINEERING & CONSULTING, INC.
(COA # 29779)
1239 JABARA AVE.
NORTH PORT, FL 34288
PH. 941-380-1574


FL#:
13847

DWG#:
PGW007

SHEET:
1 OF 3

TITLE: CONTRACTOR SERIES 2000 HORIZONTAL SLIDER ELEVATIONS & ANCHOR LAYOUTS	DATE	1.14.14
	BY	TJM
	REVISION DESCRIPTION	2010 FBC REVISIONS
	NO.	A
	DATE	01.15.18
	BY	LMH
	REVISION DESCRIPTION	UPDATED FORMAT
	NO.	B
	DATE	11.11.20
	BY	LMH
	REVISION DESCRIPTION	UPDATED FOR 7TH EDITION (2020) FBC
	NO.	C

DATE:	06.03.10
DWN BY:	MSS
CHK BY:	
SCALE:	NTS

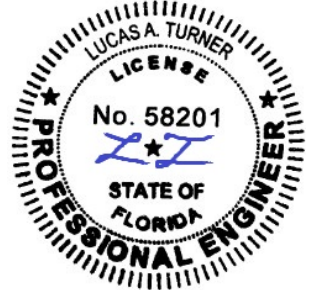


12/09/2020
LUCAS A. TURNER, P.E.
FL PE # 58201
TURNER ENGINEERING &
CONSULTING, INC.
(COA # 29779)
1239 JABARA AVE.
NORTH PORT, FL 34288
PH. 941-380-1574


FL#:
13847

DWG#:
PGW007


SHEET: **2 OF 3**

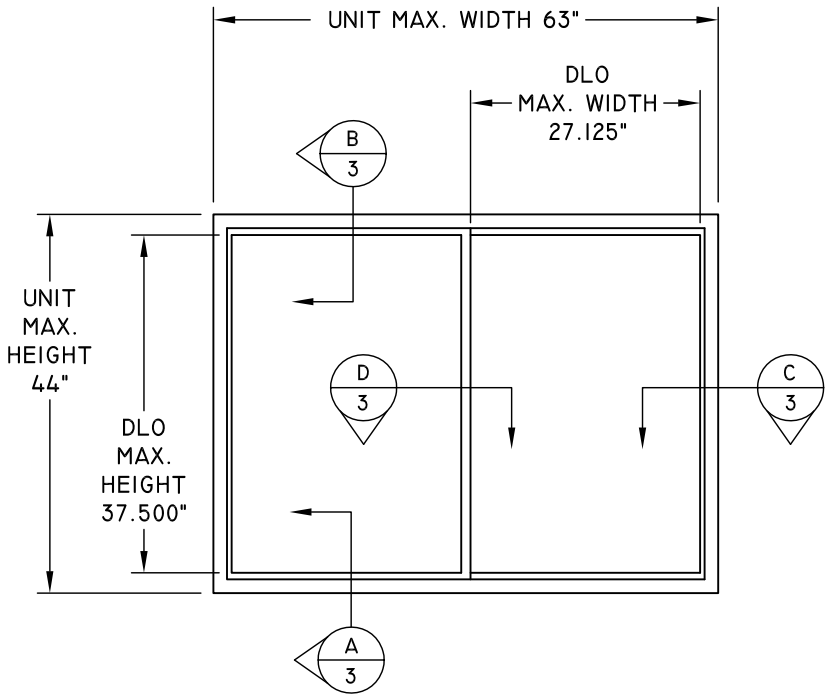


ELEVATION

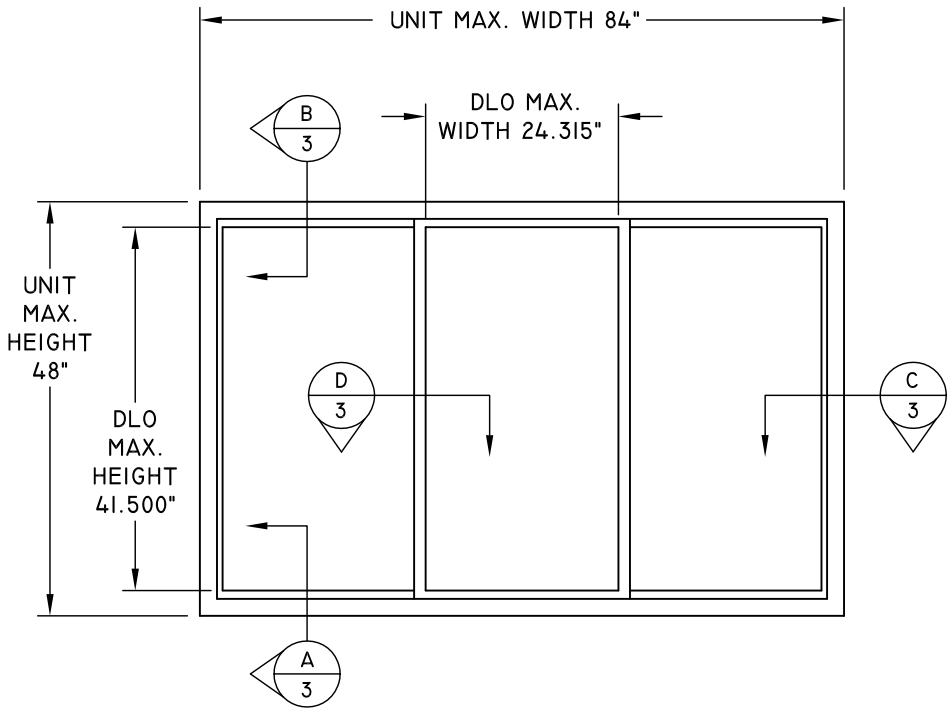


ELEVATION

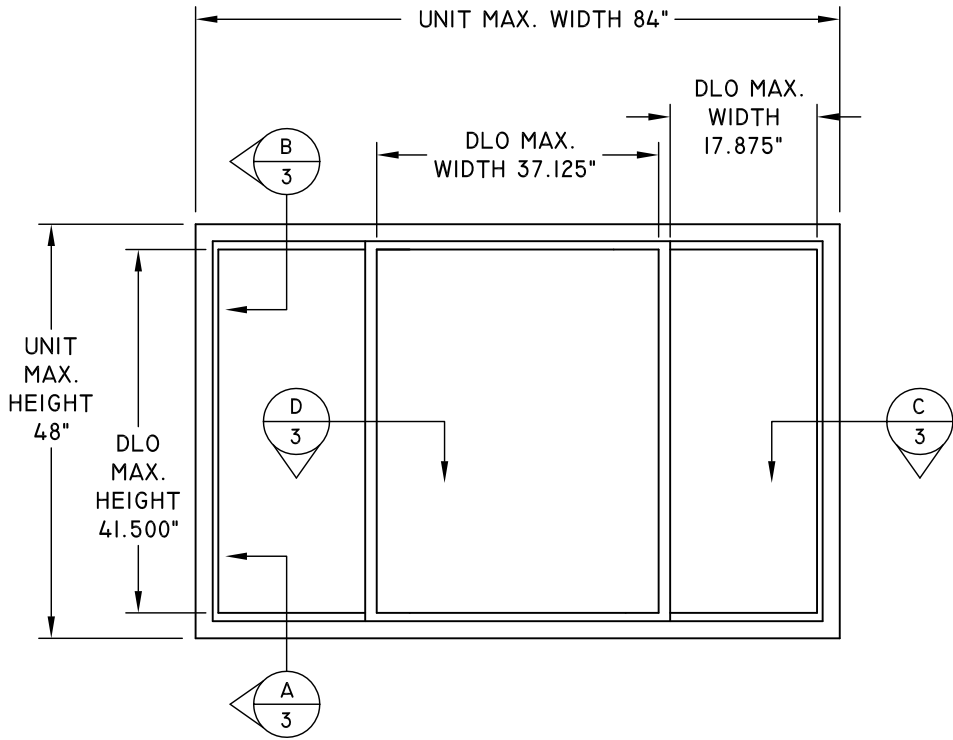


ELEVATION

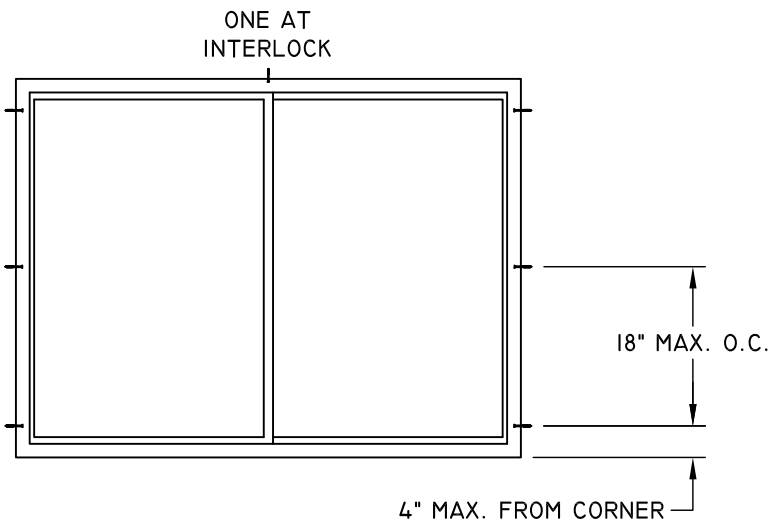

ANCHOR LAYOUT

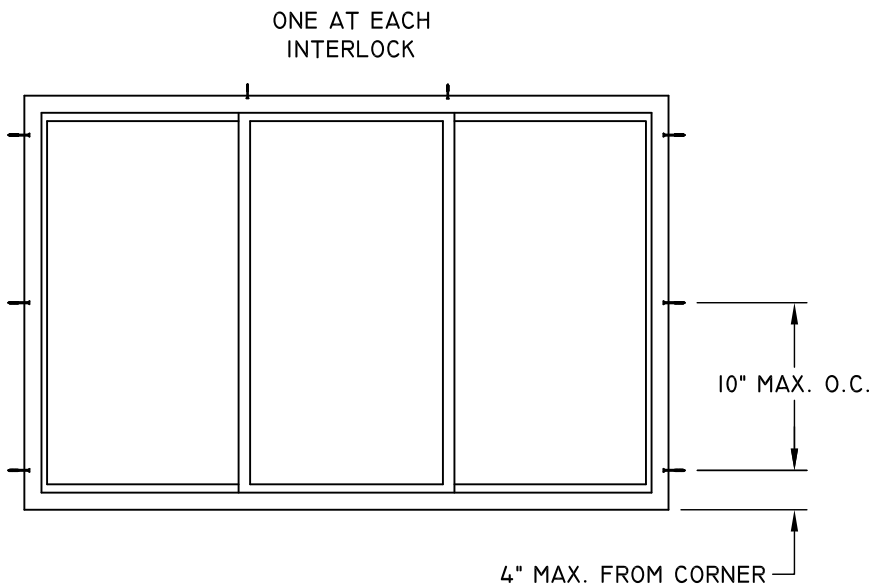


ANCHOR LAYOUT

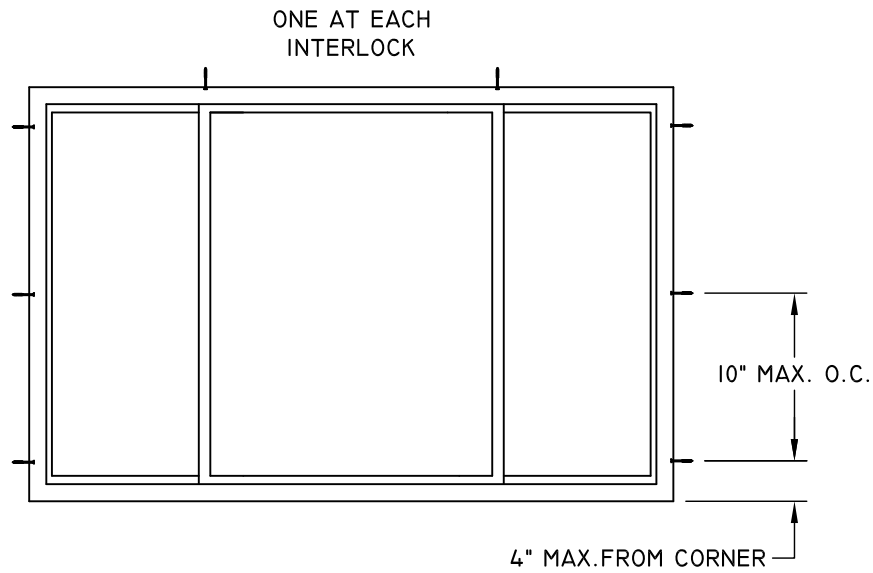

ANCHOR LAYOUT

TITLE: CONTRACTOR SERIES 2000 HORIZONTAL SLIDER VERTICAL SECTIONS, HORIZONTAL SECTIONS, & GLAZING DETAIL	DATE	BY	REVISION DESCRIPTION
	NO.	BY	REVISION DESCRIPTION
	A	TJM	2010 FBC REVISIONS
	B	LMH	UPDATED FORMAT
	C	LMH	UPDATED FOR 7TH EDITION (2020) FBC

DATE: 06.03.10	DWN BY: MSS	CHK BY:	SCALE: NTS
-------------------	----------------	---------	---------------

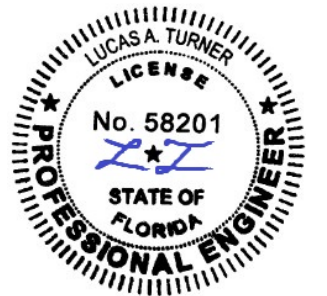


12/09/2020
LUCAS A. TURNER, P.E.
FL PE # 58201
TURNER ENGINEERING &
CONSULTING, INC.
(COA # 29779)
1239 JABARA AVE.
NORTH PORT, FL 34288
PH. 941-380-1574


FL#:
13847

DWG#:
PGW007


SHEET:
3 OF 3

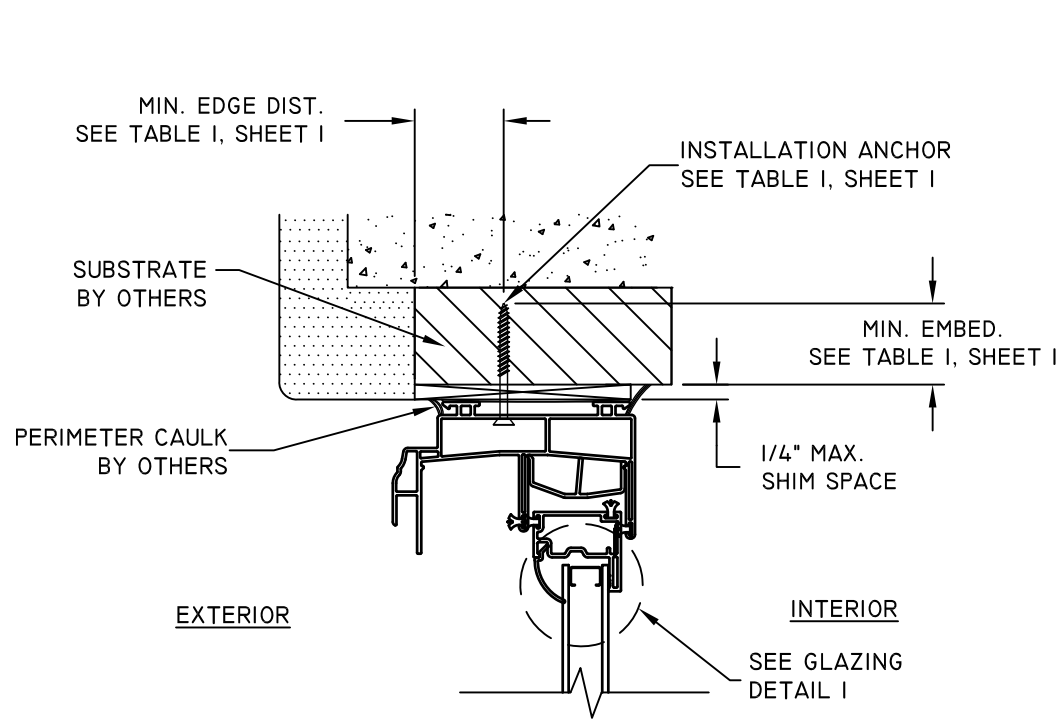


B
3 VERTICAL SECTION
HEAD

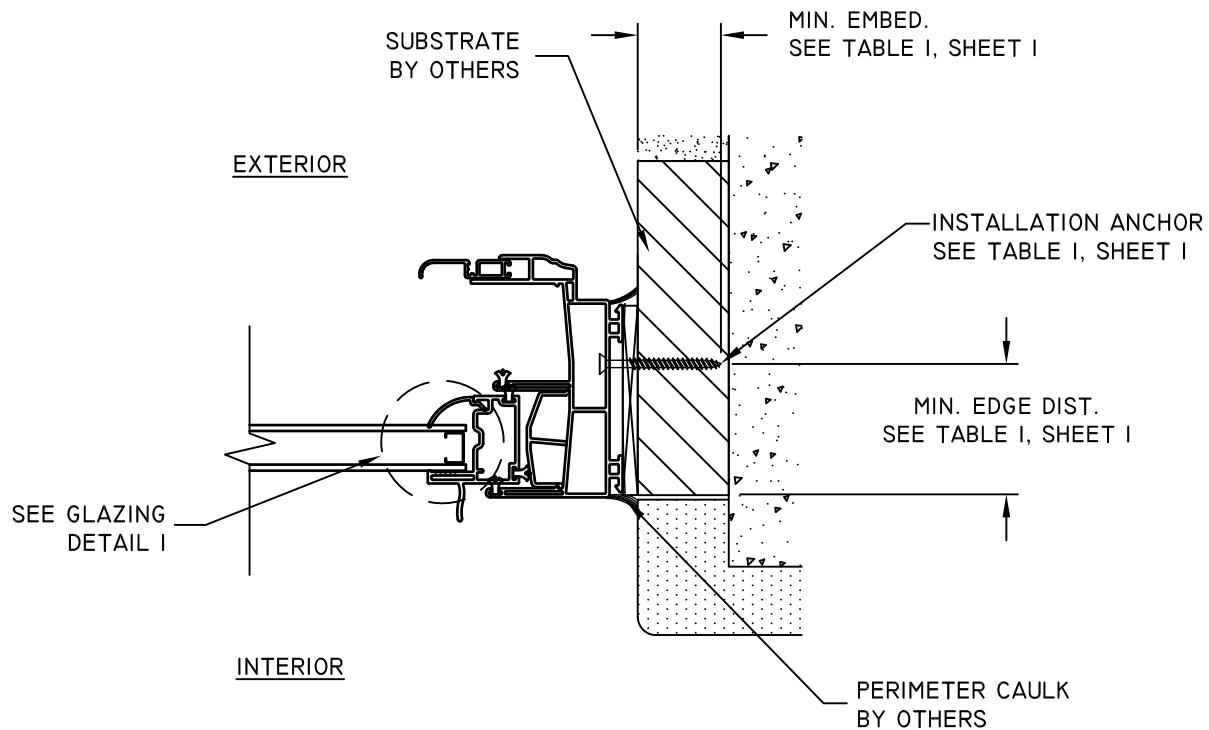


C
3 HORIZONTAL SECTION
JAMB

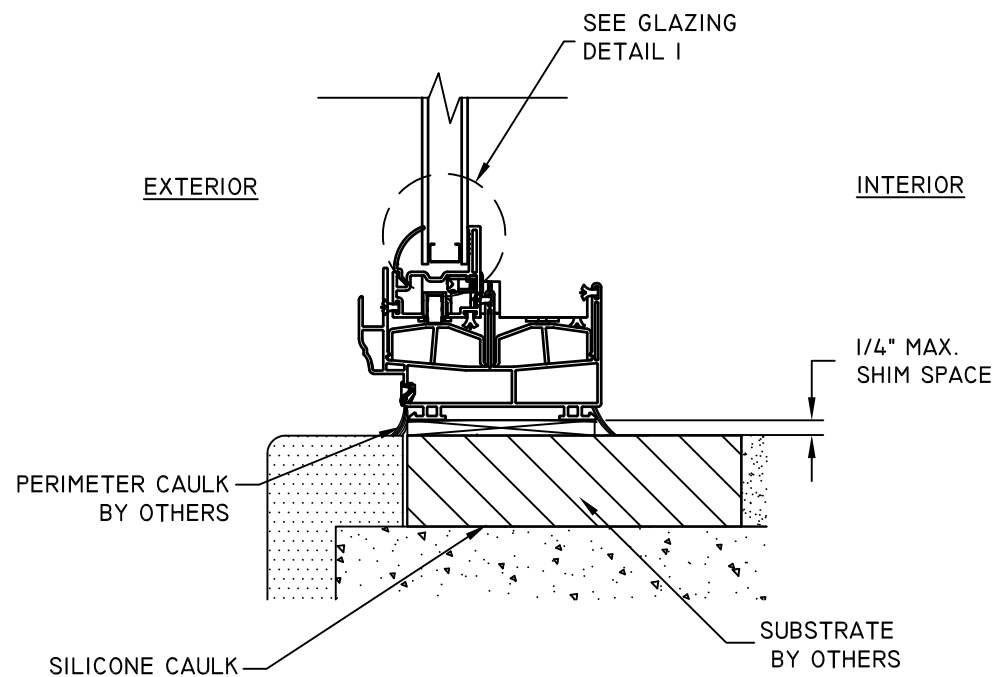

A
3 VERTICAL SECTION
SILL

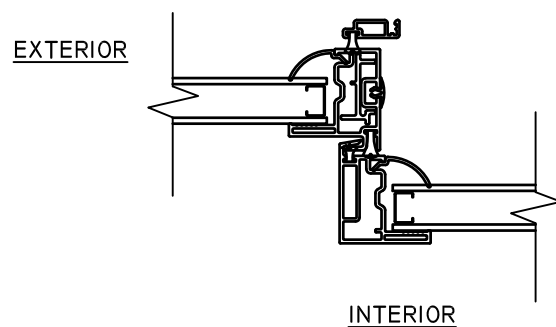

D
3 HORIZONTAL SECTION
MEETING RAIL

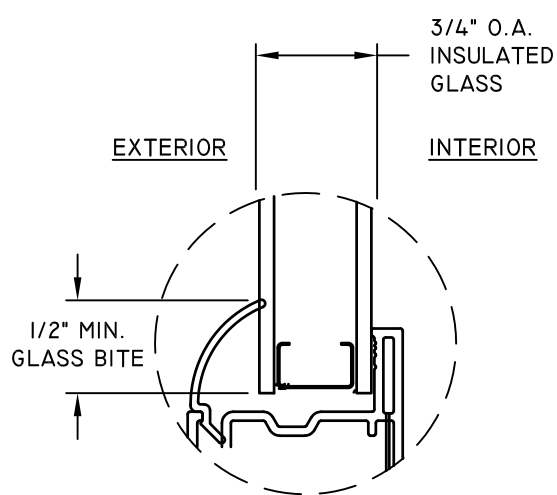

GLAZING DETAIL 1

NOTE:
GLASS THICKNESS AND TYPE
MAY VARY PER ASTM E 1300
GLASS CHART REQUIREMENTS