


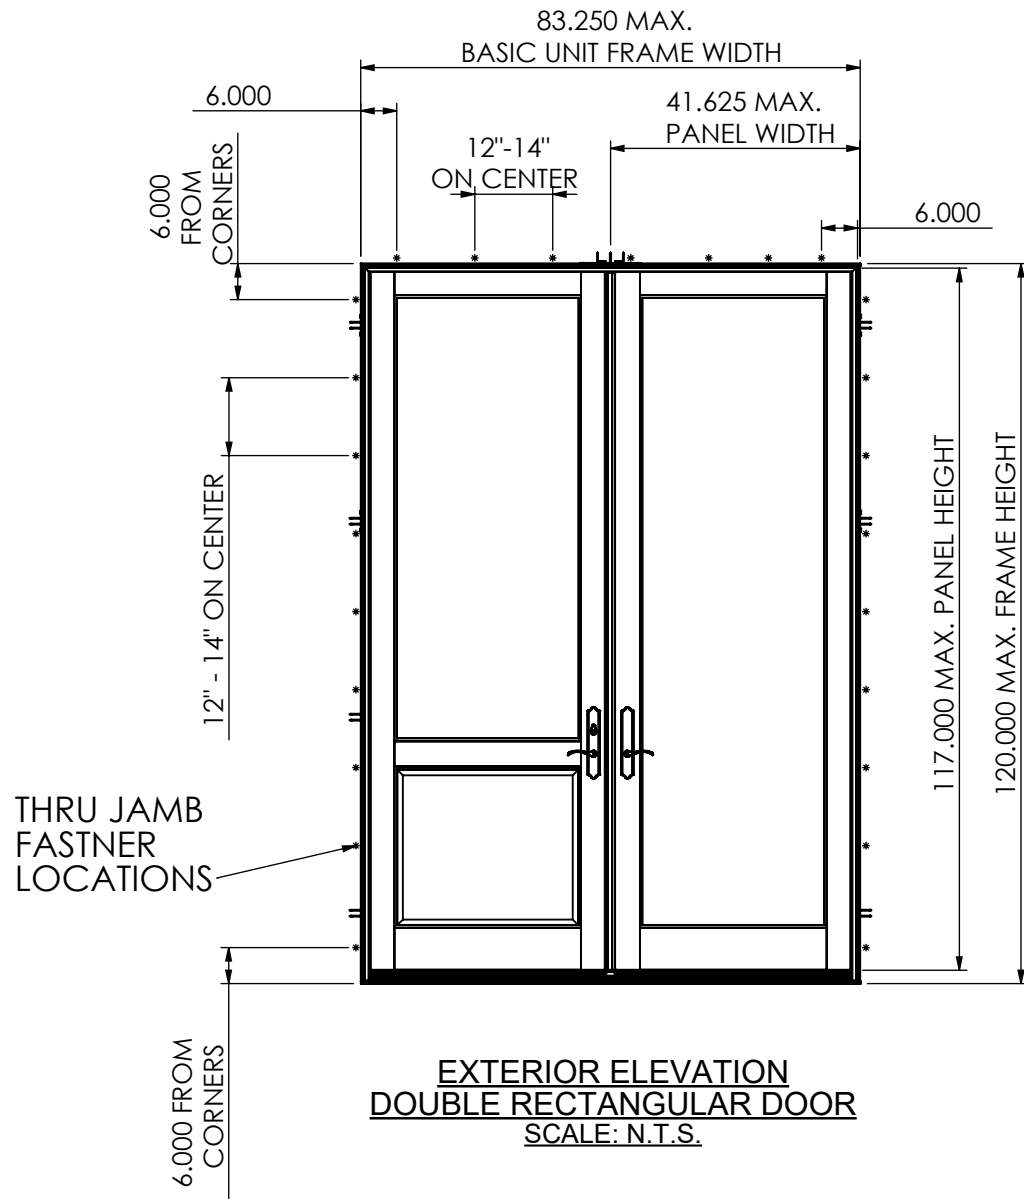

NOTES:

1. THOROUGHLY READ AND FOLLOW MANUFACTURE'S INSTALLATION INSTRUCTIONS RECEIVED WITH UNIT. THIS GUIDE DOES NOT ADDRESS THE SEALING CONSIDERATIONS THAT MAY ARISE IN DIFFERENT WALL CONDITION
2. SPECIFIED ANCHOR EMBEDMENT TO BASIC MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.
3. JAMB FASTENER WITHIN 6" FROM CORNERS & 12-14" MAX. O.C. SEE "FRAME ANCHOR REQUIREMENTS TABLE" ON SHEET 2 FOR REQUIREMENTS
4. SEE LAB TEST REPORTS OR MANUFACTURE FOR QUALIFYING HINGE AND LOCK OPTIONS.

Weather Shield

1507 Inswing French Door
Lifeguard "IG"
Through Jamb Installation

**EXTERIOR ELEVATION
DOUBLE RECTANGULAR DOOR**
SCALE: N.T.S.

TOLERANCES UNLESS SPECIFIED:	
INCHES	ANGLE
.x ± .1"	xx ± 1°
.xx ± .03"	xx.x ± .5° (1/2°)
.xxx ± .015"	xx.xx ± .25° (1/4°)

WEATHER SHIELD®
WINDOWS & DOORS

TYP. WALL THICKNESS:

PRODUCTS:
1507

WT/FT:	AREA:
MAT:	FINISH:
DIE TOOL:	CUT STOCK:
PDR #: 28105	PROFILE #:

DRAWN BY:
S.STAMOS

DATE:
8-9-12

TITLE:
INSTAL INSTRUCTIONS - THRU JAMB


DWG NO.:
85-7382-08

REV
N

SCALE: 1:32 SHEET NAME: Sheet1 SHEET 1 OF 2

DO NOT SCALE DRAWING

REV	DATE	DESCRIPTION	PCR NO.	ENG

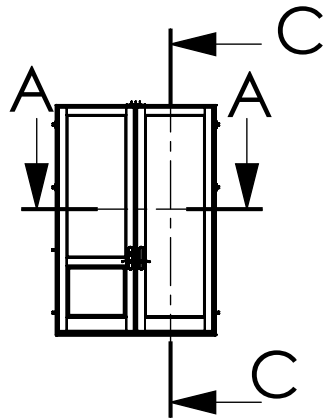

Weather Shield

1507 Inswing French Door
Lifeguard "IG"
Through Jamb Installation

ALL METHODS OF INSTALLATION REQUIRE:

- TWO(2) #9 X 2-1/2" SCREWS PER HINGE
- THREE(3) #9 X 2-1/2" SCREWS IN STRIKE PLATE
- #11 X 3-1/2 SCREWS THRU THRESHOLD, 4-1/2" FROM CORNER AND 8" ON CENTER

0.250
MAX. SHIM
SPACE TYP.

#9 X 2-1/2" SCREWS MIN.;
6" FROM CORNERS,
12"-14" ON CENTER,
1-1/4" MIN. EMBEDMENT



.750" MIN.
EDGE
DISTANCE

SILICONE BACK OF JAMB TO
OPENING; FULL PERIMETER
WITH 1/4" BEAD MINIMUM.

INTERIOR

EXTERIOR

SILICONE BACK OF JAMB
TO OPENING; FULL PERIMETER
WITH 1/4" BEAD MINIMUM.

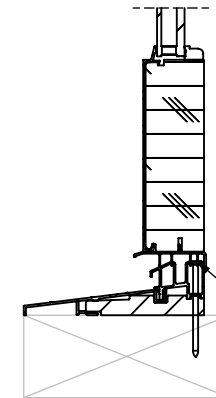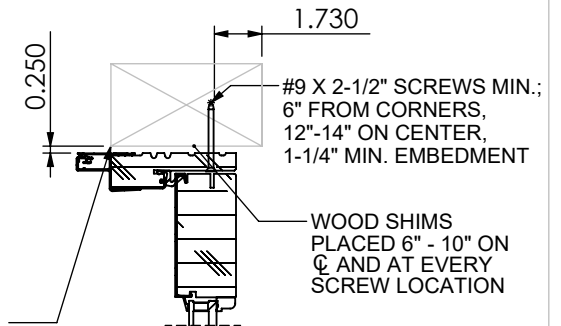

#10 X 3-1/2" FH SCREWS;
8" ON CENTER THROUGH THRESHOLD,
4-1/2" FROM CORNER(MAX)

1-1/4" MINIMUM EMBEDMENT

FRAME ANCHOR REQUIREMENTS TABLE

OPENING TYPE (SUBSTRATE)	FRAME / HINGE / STRIKE / NAIL FIN TO OPENING FASTENER TYPE	MINIMUM EMBED	MINIMUM EDGE DIST.
FRAME / HINGE / STRIKE SCREWS			
MIN. 2X4 WOOD FRAME OR BUCK	NO. 11 SMS OR WOOD SCREWS	1 1/4"	3/4"
THROUGH JAMB INSTALLATION			
THROUGH JAMBS INTO BUCK	#9 X 2-1/2" SCREW	1 3/8"	1/2"

TOLERANCES UNLESS SPECIFIED:	
INCHES	ANGLE
.x ± .1"	xx ± 1°
.xx ± .03"	xx.x ± .5° (1/2°)
.xxx ± .015"	xx.xx ± .25° (1/4°)

WEATHER SHIELD.
WINDOWS & DOORS

TYP. WALL THICKNESS:

PRODUCTS:
1507

WT/FT:

AREA:

DRAWN BY:

DATE:

TITLE:

MAT:

FINISH:

S.STAMOS

8-9-12

INSTAL INSTRUCTIONS - THRU JAMB

DIE TOOL:

CUT STOCK:

DWG NO.:

85-7382-08

REV

N

REV	DATE	DESCRIPTION	PCR NO.	ENG	PDR #:	28105	PROFILE #:
-----	------	-------------	---------	-----	--------	-------	------------

SCALE:	1:50	SHEET NAME:	Sheet2	SHEET 2	OF 2
--------	------	-------------	--------	---------	------

DO NOT SCALE DRAWING