

**EVALUATION REPORT OF
CENTRAL STATES MANUFACTURING, INC.
'R-LOC PANEL'**


**FLORIDA BUILDING CODE 9TH EDITION (2026)
FLORIDA PRODUCT APPROVAL
FL 14024.3-R7
PANEL WALLS
SIDING**

**Prepared For:
Central States Manufacturing, Inc.
302 Jane Place
Lowell, AR 72745
Telephone: (800) 356-2733
Fax: (800) 356-2971**

**Prepared By:
Bala Sockalingam, Ph.D., P.E.
Florida Professional Engineer #62240
1216 N Lansing Ave., Suite C
Tulsa, OK 74106
Telephone: (918) 492-5992**

**This report consists of
Evaluation Report (2 Pages including cover)
Installation Details (1 Page)
Load Span Table (1 Page)**

**Report No. C3075-3
Date: 10.17.2026**

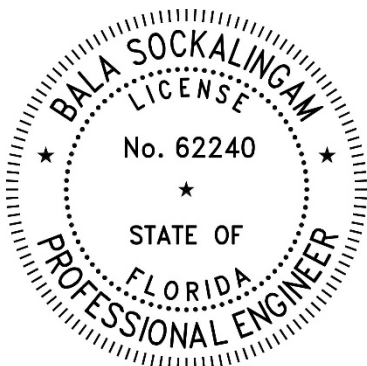

This item has been digitally signed and sealed by Bala Sockalingam, PE, on the date indicated.

Printed copies of this document are not considered signed and sealed and this signature must be verified on any electronic copies.

**2026.10.17
22:57:28
-05'00'**

Manufacturer: Central States Manufacturing, Inc.

Product Name: R-Loc Panel

Panel Description: 36" wide coverage with (4) 1-1/4" high ribs

Materials: Min. 26 ga., 80 ksi steel or min. 24 ga., 50 ksi steel. Galvanized coated steel (ASTM A653) or Galvalume coated steel (ASTM A792) or painted steel (ASTM A755) as per FBC 2026 Section 1405.2.

Support Description: Min. 16 ga., 50 ksi steel section. (Must be designed by others)

Design Uplift Pressure: 44.2 psf at fastener spacing of 60 o.c. (3 or more spans)
(Factor of Safety = 2) 112.7 psf at fastener spacing of 24 o.c. (3 or more spans)

Panel Attachment: All fasteners are corrosion resistant as per FBC 2026 Section 1405.17. For installation in areas within 3000 ft. of a saltwater coastline, fasteners are corrosion resistant as per FBC 2026 Section 1711.

At all supports: #12-14 x 1-1/4" long SDS with washer at 12" o.c. across panel width

Sidelap Attachment: 1/4"-14 x 7/8" long SDS with washer at 20" o.c.


Test Standards: Wall assembly tested in accordance with ASTM E1592-01 'Test Method for Structural Performance of Sheet Metal Roof and Siding Systems by Uniform Static Air Pressure Difference'.

Test Equivalency: The test procedures in ASTM E1592-01 comply with test procedures prescribed in ASTM E1592-05(2017).

Code Compliance: The product described herein has demonstrated compliance with FBC 2026 Section 1404.5.

Product Limitations: Design wind loads shall be determined for each project in accordance with FBC 2026 Section 1609 or ASCE 7-22 using allowable stress design. The maximum fastener spacing listed herein shall not be exceeded. The design pressure for reduced fastener spacing may be computed using rational analysis prepared by a Florida Professional Engineer or based on Central States load span table. This evaluation report is not applicable in High Velocity Hurricane Zone.

Supporting Documents: ASTM E1592 Test Report
Force Engineering and Testing Inc.
Report No. 410-0237T-13A, B, Reporting Date 12/21/2013

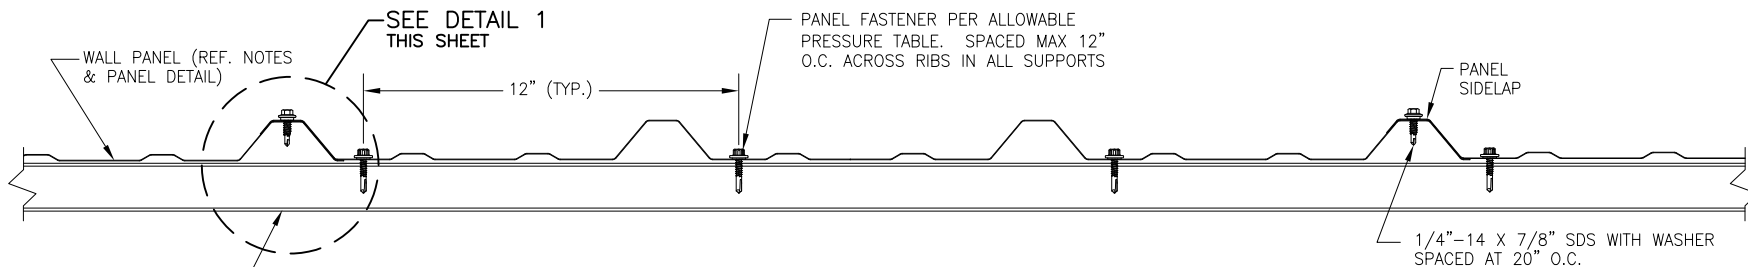

MIN 16 GA., 50 KSI STEEL
(DESIGN BY OTHERS)

TYPICAL PANEL INSTALLATION X-SECTION

#12-14 X 1-1/4" LONG
SELF DRILLING SCREW
WITH INTEGRAL WASHER
@ 12" O.C.

R-LOC PANEL

SIDLAP FASTENER
1/4"-14 SDS WITH
WASHER @ 20" O.C.

MAX 60" O.C.


#12-14 X 1-1/4" LONG
SELF DRILLING SCREW
WITH INTEGRAL WASHER
@ 12" O.C.

MIN 16 GA. SUPPORTS
(DESIGN BY OTHERS)

SECTION VIEW

GENERAL NOTES:

1. STRUCTURAL WALL PANEL HAS BEEN DESIGNED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE (FBC).
2. PANELS SHALL BE MIN. 26 GA. ($t = 0.019"$). EFFECTIVE COVERING WIDTH OF PANEL = 36".
3. WALL PANELS SHALL BE INSTALLED OVER STRUCTURE AS SPECIFIED ON THIS DRAWING.
4. REQUIRED DESIGN WIND LOADS SHALL BE DETERMINED FOR EACH PROJECT. THIS PANEL SYSTEM MAY NOT BE INSTALLED WHEN THE REQUIRED DESIGN WIND LOADS ARE GREATER THAN THE ALLOWABLE WIND LOADS SPECIFIED ON THIS DRAWING.
5. ALL FASTENERS MUST BE IN ACCORDANCE WITH THIS DRAWING & THE FLORIDA BUILDING CODE. IF A DIFFERENCE OCCURS BETWEEN THE MINIMUM REQUIREMENTS OF THIS DRAWING & THE CODE, THE CODE SHALL CONTROL.
6. SUPPORTS MUST BE DESIGNED TO WITHSTAND WIND LOADS AS REQUIRED FOR EACH APPLICATION AND ARE THE RESPONSIBILITY OF OTHERS.

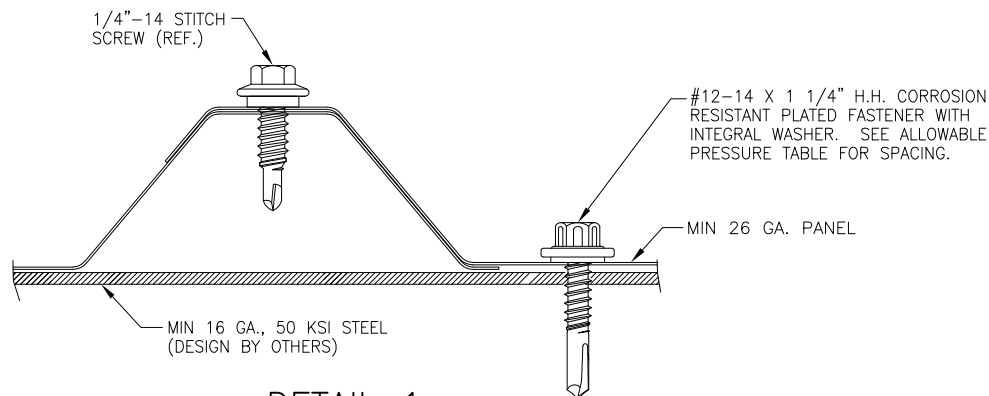

DETAIL 1

DRAWN BY: B.S.	CHECKED BY: A.W.
PLOT:	DATE: 10/17/2026
NO.	REVISION DESCRIPTION
DATE	BY
DRAWING TITLE	R-LOC PANEL
CONSULTANTS	MANUFACTURER
BALA SOCKALINGAM, PH.D., P.E.	CENTRAL STATES MANUFACTURING, INC.
1216 N. LANSING AVE., SUITE C TULSA, OK 74106 PHONE: 918-492-5992	302 JANE PLACE LOWELL, AR 72745 800-356-2733
DRAWING NO. 3075-3	REV.
PAGE NO. 1	OF 1

CENTRAL STATES MANUFACTURING, INC.
R-Loc Panel Outward Loads
(Min 26 ga.)

Description	Fastener Spacing along panel length (in)	Allowable Outward Load (psf)
Coverage width: 36"	24	112.7
	27	100.2
Panel Fasteners #12-14 x 1.25" long hex head screws with integral washer	30	90.2
	33	82.0
	36	75.1
	39	69.4
	42	64.4
Panel fasteners spaced at 12" o.c. across panel width at interior supports	45	60.1
	48	56.4
	51	53.0
	54	50.1
Sidelap fasteners spaced at 20" o.c.	57	47.5
	60	44.2

Notes:

1. The bold numbers indicate design loads calculated from test data with safety factor of 2.
2. Panels must be installed as per Evaluation Report FL 14024.3 and Central States current installation procedure.
3. Three or more spans condition.