





HEAD JAMB

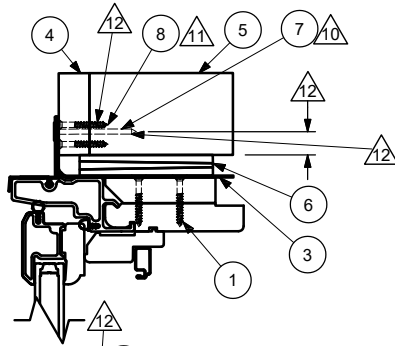

JAMB

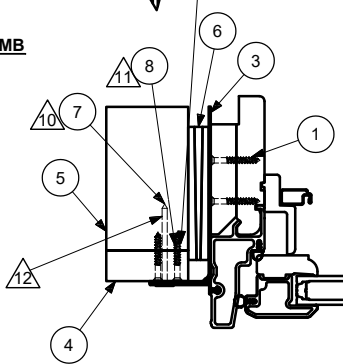

SILL

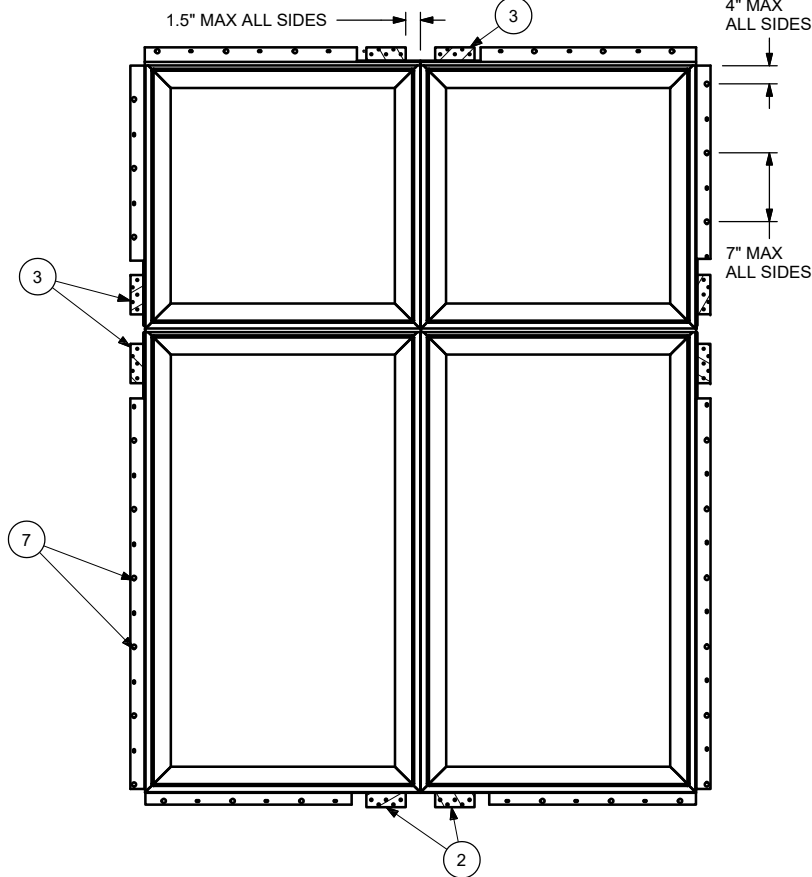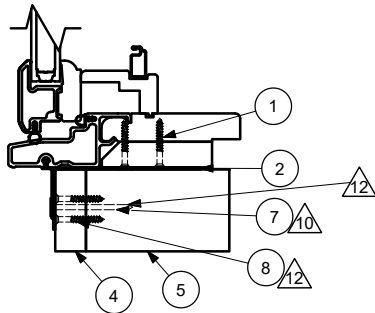

NAILING FIN INSTALLATION

- APPLY MULL CLIPS ALONG HEAD JAMB, JAMB AND SILL AT MULL ANCHOR POINTS. SPACE 1-1/2" OFF CENTER OF MULL
- ATTACH MULL CLIPS TO FRAME WITH EIGHT #8 X 1.25" WOOD SCREWS
- ATTACH MULL CLIPS TO FRAMING WITH 1.25" DRYWALL SCREWS
- SECURE NAILING FIN WITH 2" GALVANIZED ROOFING NAILS, MINIMUM OF TWO PER SIDE. SPACE PER ELEVATION

NOTES:

1. FOR GENERAL SPECIFICATIONS, REFER TO DOC 00003952
2. THIS PRINT IS FOR STRUCTURAL PERFORMANCE ONLY. FOR FLASHING & SEALING INSTRUCTIONS, REFER TO THE INSTALLATION INSTRUCTIONS
3. SHIMS:
 - PLACE SHIMS WITHIN 4" - 6" OF EACH CORNER AND SPACE ALL OTHERS EVENLY, A MAXIMUM OF 15" APART
4. IF CHEMICALLY TREATED LUMBER IS USED FOR FRAMING MATERIAL, FASTENERS INTO THE FRAMING MUST BE A MINIMUM OF 0.90 OZ/FT² ZINC HOT DIPPED GALVANIZED OR STAINLESS STEEL TYPE 304 OR 316
5. #8 X 1 1/4" PAN HEAD OR WAFFLE HEAD SCREWS MAY BE SUBSTITUTED FOR 2" ROOFING NAILS
6. 2W2H CONFIGURATION IS SHOWN
7. NAILFIN IS DISCONTINUOUS ALONG JAMBS AND SILL
8. HEADER DRIP CAP IS CONTINUOUS
9. APPROVED PRODUCTS: FL 14133
10. MINIMUM NAIL EMBEDMENT DEPTH: 1 15/16"
11. MINIMUM SCREW EMBEDMENT DEPTH: 1 3/16"
12. MINIMUM EDGE DISTANCE: 1/2"
13. APPROVED PRODUCTS: FL 14133

8	NA	1.25" DRYWALL SCREW
7	NA	2" GALVANIZED ROOFING NAIL
6	NA	SHIM
5	NA	FRAMING MATERIAL
4	NA	SHEATHING
3	00104030	MULL CLIP, JAMB
2	00104023	MULL CLIP, SILL
1	00046846	#8 X 1.250 PH, BH, COARSE PB 2/3 THREAD SCREW

ITEM	DWG NO	DESCRIPTION
------	--------	-------------

PARTS LIST



RESEARCH & DEVELOPMENT
WARROAD, MN, USA, (218) 386-4021

PRODUCT CATEGORY: ELEVATE

UNIT TYPE: ELCA, ELCA P, ELAWN, ELDG

DWG TYPE: INSTALLATION
DESCRIPTION: ELEVATION/METHODS, NAIL FIN, CERT MULL, ELCA

CHK: CLE **SIZE:** B **CLASS:** ASSY **DWG NO:** 00104329

APP: JCS **SCALE:** NA **DATE:** 01/18/17 **DWG BY:** MURPHY, CASEY **SHEET:** 1 OF 1

1.1	UPDATED ASSEMBLY (DRIP CAP, JAMB AND SILL NAIL FINS ADDED) AND TAXONOMY OF BRANDS	23650	03/07/19	AAA
1.0	UPDATED FASTENER EDGE DISTANCE AND EMBEDMENT REQUIREMENTS	23650	10/16/17	RMR
0.1	UPDATED FASTENER EDGE DISTANCE AND EMBEDMENT REQUIREMENTS	21162	04/20/17	RJA
0.0	ORIGINAL ISSUE	21162	02/13/17	CAM
REV	DESCRIPTION / REQUESTOR	ECN NO	DATE	REV BY

NOTICE - CONFIDENTIAL INFORMATION

The information in this document is privileged and strictly confidential. The information contained herein shall be used only by Marvin Windows and Doors employees and by those agents or suppliers granted official written permission. If the reader of this document is not the intended recipient, or the employee or agent of the intended recipient, please delete this document from all data storage devices, and destroy all hard copies. Any unauthorized dissemination, distribution, copying or other use of the information contained in this document is strictly prohibited.