
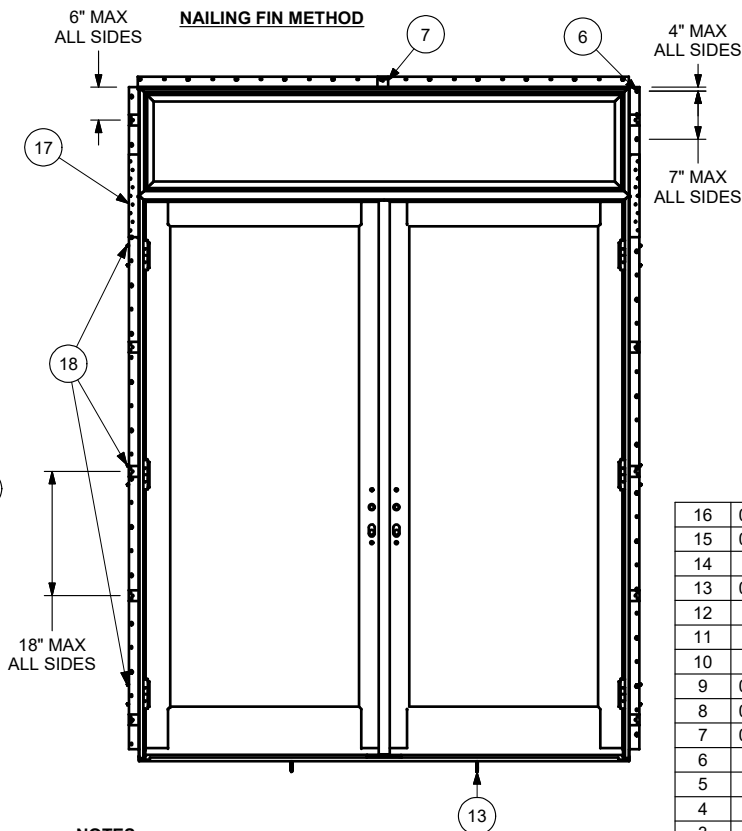


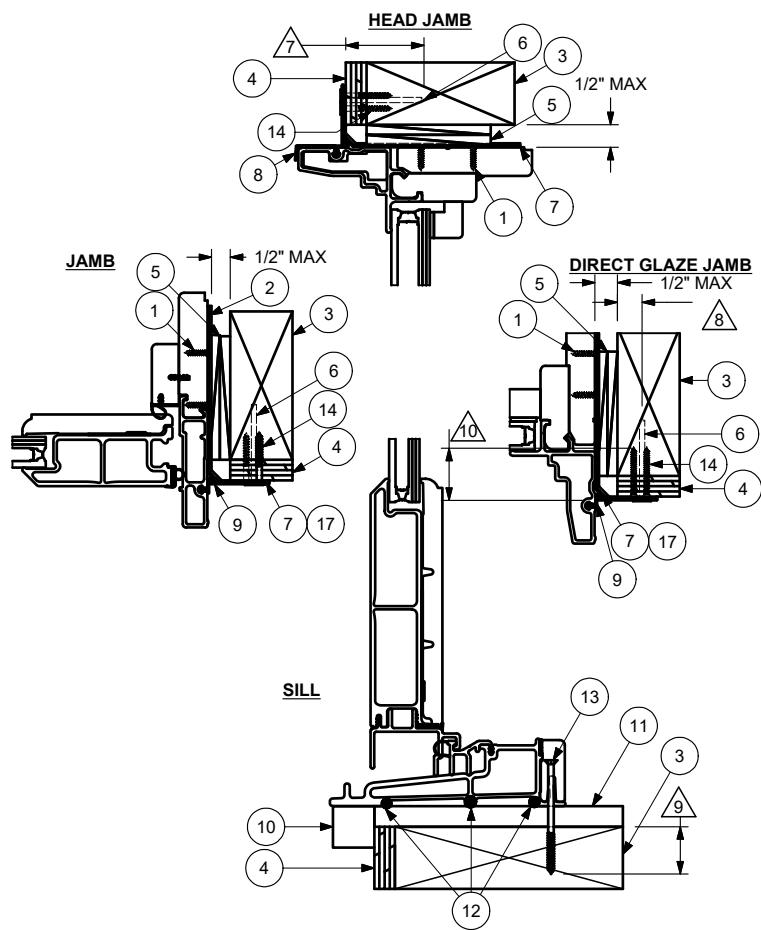

#### NAILING FIN INSTALLATION:

- APPLY INSTALLATION CLIP TO UNIT AT HEAD JAMB AND JAMBS. SPACE PER ELEVATION WITH A MINIMUM OF 2 PER SIDE.
- FASTEN WITH TWO #7 X .625\" WOOD SCREWS.
- APPLY MULL CLIP TO MULL JOINTS AT EACH END OF MULL.
- FASTEN WITH #7 X .625\" WOOD SCREWS AT EACH FRAME IDENTIFIED HOLE LOCATION.
- PLACE THREE 3/8\" DIA BEADS OF GRADE NS CLASS 25 SEALANT PER ASTM C920 TO BOTTOM OF SILL/ FLOOR.
- ATTACH EACH INSTALLATION CLIP TO FRAMING WITH THREE 1.25\" WOOD SCREWS SPACE PER ELEVATION.
- ATTACH EACH MULL CLIP TO FRAMING WITH 1.25\" WOOD SCREWS AT EACH FRAMING HOLE LOCATION.
- SECURE NAILING FIN WITH 2\" GALVANIZED ROOFING NAILS, MINIMUM OF TWO PER SIDE. SPACE PER ELEVATION.
- ANCHOR THE SILL AT THE CENTER WITH 3/16\" X 2.75\" MASONRY SCREWS.
- APPLY INSTALLATION SCREWS AT PRE-DRILLED HOLES THROUGH JAMBS INTO R.O.

|      |          |                                           |
|------|----------|-------------------------------------------|
| 16   | 00003228 | #8 X 2.500\" PH, FH, TYPE A, FULL THREAD  |
| 15   | 00067877 | ELOFD INSTALLATION CLIP                   |
| 14   | NA       | 1.250\" DRYWALL SCREW                     |
| 13   | 00064718 | #10 X 2.750\", FH, PH, 2/3, MASONRY SCREW |
| 12   | NA       | CLASS 25 SEALANT                          |
| 11   | NA       | FLOORING                                  |
| 10   | NA       | SILL NOSE SUPPORT                         |
| 9    | 00005291 | NAILING FIN, HINGED                       |
| 8    | 00005332 | NAILING FIN/DRIP CAP                      |
| 7    | 00052256 | INSTALLATION CLIP                         |
| 6    | NA       | 2.00\" GAL. ROOF NAIL                     |
| 5    | NA       | SHIMS                                     |
| 4    | NA       | SHEATHING                                 |
| 3    | NA       | FRAMING MATERIAL                          |
| 2    | 00003778 | STRUCTURAL BRACKET 6\" & 10\"             |
| 1    | 00003212 | #7 X .625\" DRYWALL SCREW                 |
| ITEM | DWG NO   | DESCRIPTION                               |

#### PARTS LIST

**MARVIN** 

**RESEARCH & DEVELOPMENT**

**PRODUCT** ELEVATE

**CATEGORY:**

**UNIT TYPE:** ELOFD IZ3, ELDG IZ3

**DWG TYPE:** INSTALLATION

**DESCRIPTION:** IMPACT ELOFD/ELD G ELEVATION, FL 14133

**CHK:** **SIZE:** B **CLASS:** MISC **DWG NO:** 00069364

**APP:** **SCALE:** 1:18 **DATE:** 04/26/10 **DWG BY:** DAWKINS, ANDY **SHEET:** 1 OF 1

#### NOTES:

1. FOR GENERAL SPECIFICATIONS, REFER TO DOC 00003952
2. THIS PRINT IS FOR STRUCTURAL PERFORMANCE ONLY; FOR FLASHING & SEALING INSTRUCTIONS, REFER TO THE INSTALLATION INSTRUCTIONS
3. SHIMS:
  - PLACE SHIMS WITHIN 4\" - 6\" OF EACH CORNER AND SPACE ALL OTHERS EVENLY AT A MAXIMUM OF 15\" APART
  - PLACE SHIMS AT EACH LOCATION WHERE INSTALLATION SCREWS PASS THROUGH JAMBS/ HEAD JAMB
4. IF CHEMICALLY TREATED LUMBER IS USED FOR FRAMING MATERIAL, FASTENERS INTO THE FRAMING MUST BE A MINIMUM OF 0.90 OZ/FT\*2 ZINC HOT DIPPED GALVANIZED OR STAINLESS STEEL TYPE 304 OR 316
5. INSTALLATION HOLE THROUGH SILL IS PRE-DRILLED
6. APPROVED PRODUCTS: FL14133
7. MINIMUM NAIL EMBEDMENT DEPTH 1 15/16"
8. MINIMUM EDGE DISTANCE 1/2"
9. MINIMUM SCREW EMBEDMENT DEPTH 1 1/2"
10. MINIMUM SCREW EMBEDMENT DEPTH 1 1/4"

|      |                                                                                                                  |        |          |        |
|------|------------------------------------------------------------------------------------------------------------------|--------|----------|--------|
| 5.0  | UPDETEDE TITLE BLOCK AND BRANDING INFO                                                                           | 23921  | 06/11/19 | TDG    |
| 4.0  | UPDATED MODEL (PANEL EUROGROOVE WEATHERSTRIP, TOP RAIL WEATHERSTRIP)                                             | 21926  | 09/29/17 | GMB    |
| 3.12 | UPDATED MODEL (SILL STRIKE XX, SILL STRIKE PLATE XX, PANEL CORNER KEY SCREWS, MULTI-POINT SCREWS, HINGE S WEDGE) | 21604  | 06/19/17 | GMB    |
| 3.11 | UPDATED MODEL (SILL WEATHERSTRIP, SILL INSTALLATION HOLES, JAMB/SLL PLUG)                                        | 21604  | 03/30/17 | RLB    |
| 3.10 | ADDED DETAIL VIEWS, NOTES AND INSTALLATION INSTRUCTIONS. UPDATED PARTS LIST.                                     | 21604  | 02/16/17 | MDM    |
| REV  | DESCRIPTION / REQUESTOR                                                                                          | ECN NO | DATE     | REV BY |

#### NOTICE - CONFIDENTIAL INFORMATION

The information in this document is privileged and strictly confidential. The information contained herein shall be used only by Marvin employees and by those agents or suppliers granted official written permission. If the reader of this document is not the intended recipient, or the employee or agent of the intended recipient, please delete this document from all data storage devices, and destroy all hard copies. Any unauthorized dissemination, distribution, copying or other use of the information contained in this document is strictly prohibited.