

YKK AP AMERICA, INC

YHS 50 TU ALUMINUM STOREFRONT SYSTEM - OUTSIDE GLAZED (HVHZ) (IMPACT)

INSTALLATION NOTES:

1. SEE SHEET 10 FOR ANCHOR TYPE REQUIREMENTS, MINIMUM EMBEDMENTS, AND MINIMUM EDGE DISTANCES. ALL ANCHOR REQUIREMENTS MUST BE ADHERED TO. ANY DEVIATIONS FROM ANCHOR REQUIREMENTS REQUIRES SEPARATE EVALUATION AND APPROVAL.
2. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
3. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
6. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
7. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
8. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
9. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- 10.INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:

A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.

B. CONCRETE -MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.

C. MASONRY - CMU UNIT STRENGTH CONFORMS TO ASTM C-90, WITH MIN. COMPRESSIVE STRENGTH OF 2000 PSI AND GROUT CONFORMS TO ASTM C 476, MIN. GROUT COMPRESSIVE STRENGTH OF 2000 PSI.

D. STEEL - MINIMUM YIELD STRENGTH OF 36 KSI. MINIMUM 12 GA. WALL THICKNESS.

E. STEEL - MINIMUM YIELD STRENGTH OF 36 KSI. MINIMUM 18 GA. WALL THICKNESS.

F. ALUMINUM - MINIMUM 1/8 INCH THICK 6063-T5 ALUMINUM.

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), **INCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:

TAS 201-94

TAS 202-94

TAS 203-94

AAMA 501-15

ASTM E1886-13a

ASTM E1996-17
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE. SEE SHEETS 3 & 4 FOR LMI AND SMI GLASS TYPES.
6. STOREFRONT FRAME MATERIAL: ALUMINUM 6063-T5
7. ALL STRUCTURAL MATERIALS & DISSIMILAR METALS SHALL BE PROTECTED, TREATED, PAINTED, COATED, AND/OR ISOLATED AS REQUIRED IN THE APPLICABLE SECTIONS OF THE CURRENT FLORIDA BUILDING CODE AND REFERENCED DESIGN SPECIFICATIONS.
8. GLASS SHALL MEET THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEETS 3 & 4 FOR GLAZING DETAILS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	ELEVATION & ANCHOR LAYOUT
3	DRY GLAZING DETAILS
4	WET GLAZING DETAILS
5	MULLION TABLES
6	TYPE A & B ANCHOR TABLES
7	TYPE C & D ANCHOR TABLES
7A	TYPE E ANCHOR TABLES
8	DOOR MULLION TABLE
9	DOOR MULLION TABLES (1)
10	VERTICAL SECTIONS & ANCHOR DESCRIPTIONS
11	HORIZONTAL SECTIONS
12	COMPONENTS & BILL OF MATERIALS
13	COMPONENTS & BILL OF MATERIALS

INSTRUCTIONS FOR USE:

1. DETERMINE DESIGN WIND LOAD REQUIREMENTS BASED ON WIND VELOCITY, BUILDING HEIGHT, WIND ZONE, AND RISK CATEGORY USING APPLICABLE ASCE 7 STANDARD.
2. SEE CHARTS ON SHEETS 3 & 4 FOR DESIGN LOAD CAPACITY OF DESIRED GLASS SIZE.
3. CHECK MULLION CAPACITY FOR A GIVEN SPACING AND HEIGHT USING CHARTS ON SHEET 5 FOR STORE FRONT MULLION AND SHEETS 8 & 9 FOR DOOR MULLION, THE CAPACITY SHOULD EXCEED THE DESIGN LOAD.
4. USING CHART ON SHEETS 6, 7, & 7A SELECT ANCHOR OPTION WITH DESIGN RATING MORE THAN DESIGN LOAD SPECIFIED IN STEP 1 ABOVE.
5. THE LOWEST VALUE RESULTING FROM STEPS 2, 3 AND 4 SHALL APPLY TO ENTIRE SYSTEM.



YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
YHS 50 TU ALUMINUM STOREFRONT
SYSTEM - OUTSIDE GLAZED
(HVHZ) (IMPACT)

INSTALLATION & GENERAL NOTES

PREPARED BY:


BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
PROFILE UPDATE	SH	07.03.24
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.01.14 17:24:41 -0500

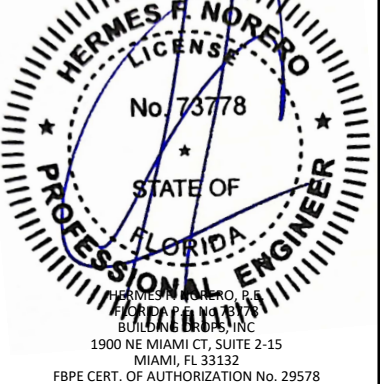

FL #:
FL14218

DATE:
10.20.15

DWG. BY:
SM

CHK. BY:
HFN


SCALE:
NTS

DWG. #:
YKK161

SHEET:
1

[Page 1 of 14]


c:\users\sebastianhereros\building drops, inc\building drops, inc\projects\ykk ap america, inc\fb-26-0123 - fl14218 yhs 50 tu pre-glazed storefront systems\dwgs\tu\ykk161.dwg
2/11/2026 9:22 AM

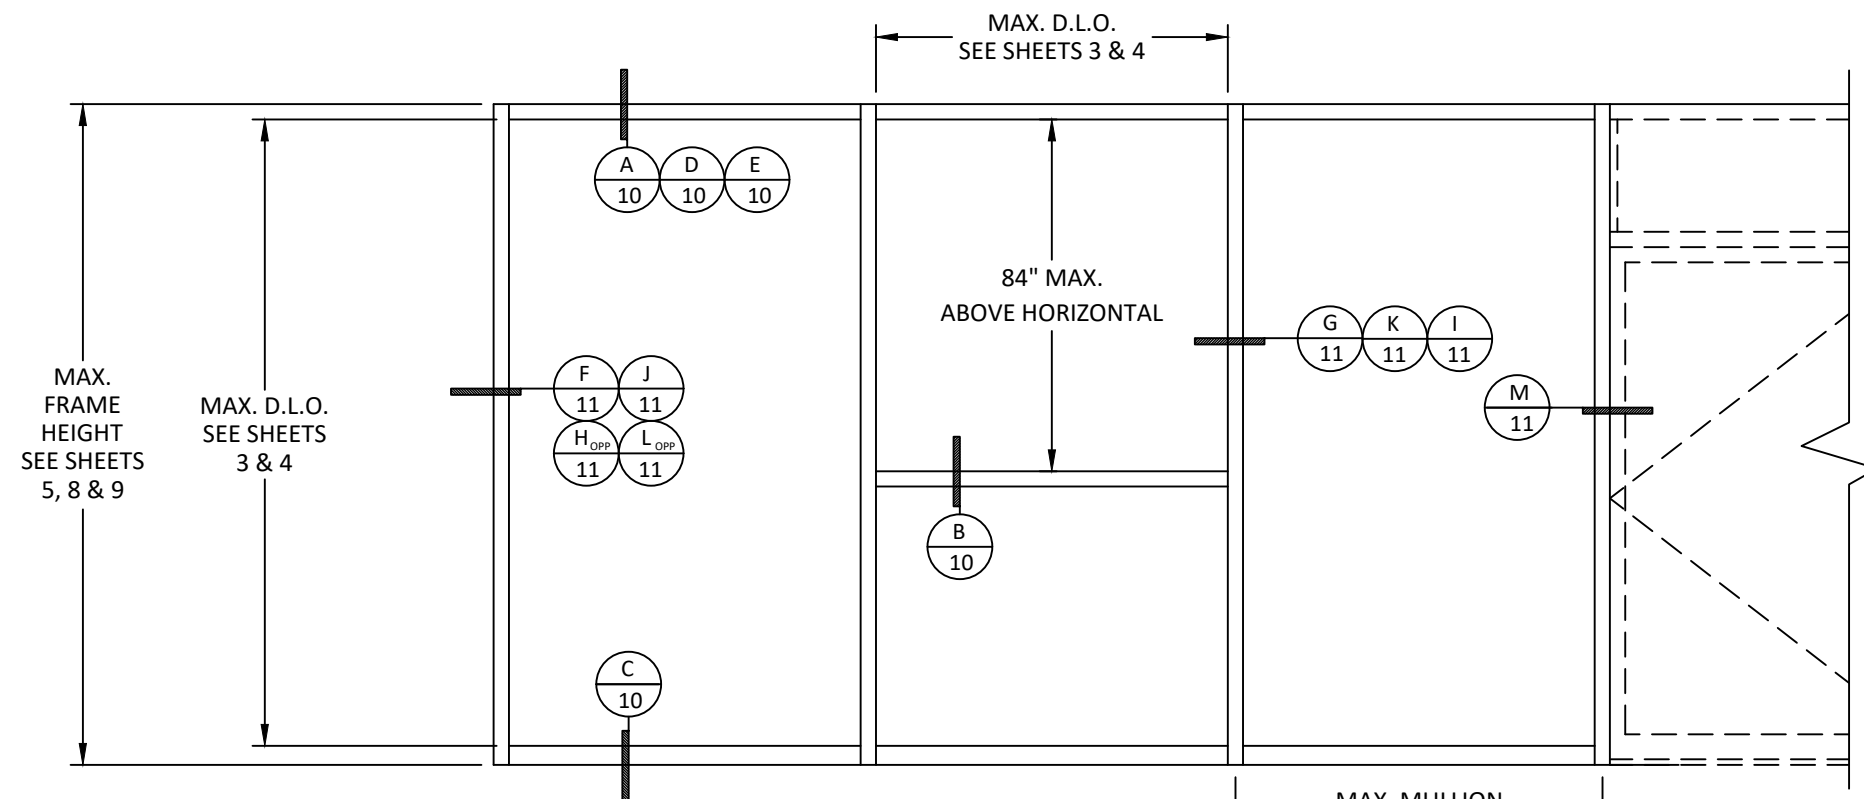


ELEVATION
TYPICAL YHS 50 TU STOREFRONT

MAX. MULLION
SPACING
SEE SHEET 5


SEE SEPARATE DOOR APPROVAL FOR DOOR
RATING & DETAILS.
LOWER DESIGN PRESSURE FROM
STOREFRONT OR DOOR APPROVAL WILL
APPLY TO ENTIRE SYSTEM.

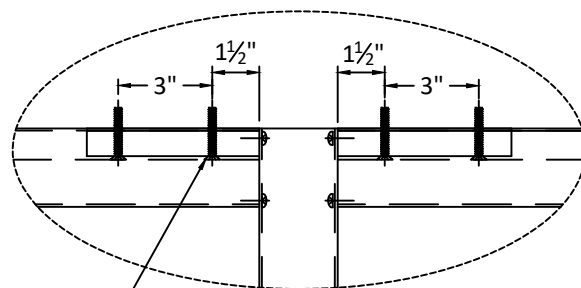

ANCHORS, TYPE A, B, C, D OR E
SEE SHEETS 6, 7, & 7A FOR QUANTITIES AND
SHEET 10 FOR DESCRIPTION

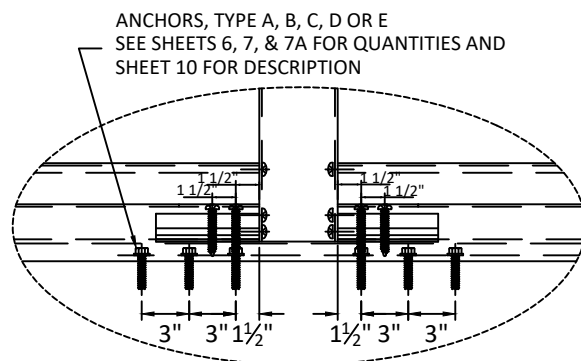

ANCHORS, TYPE A, B, C, D OR E
SEE SHEETS 6, 7, & 7A FOR QUANTITIES AND
SHEET 10 FOR DESCRIPTION

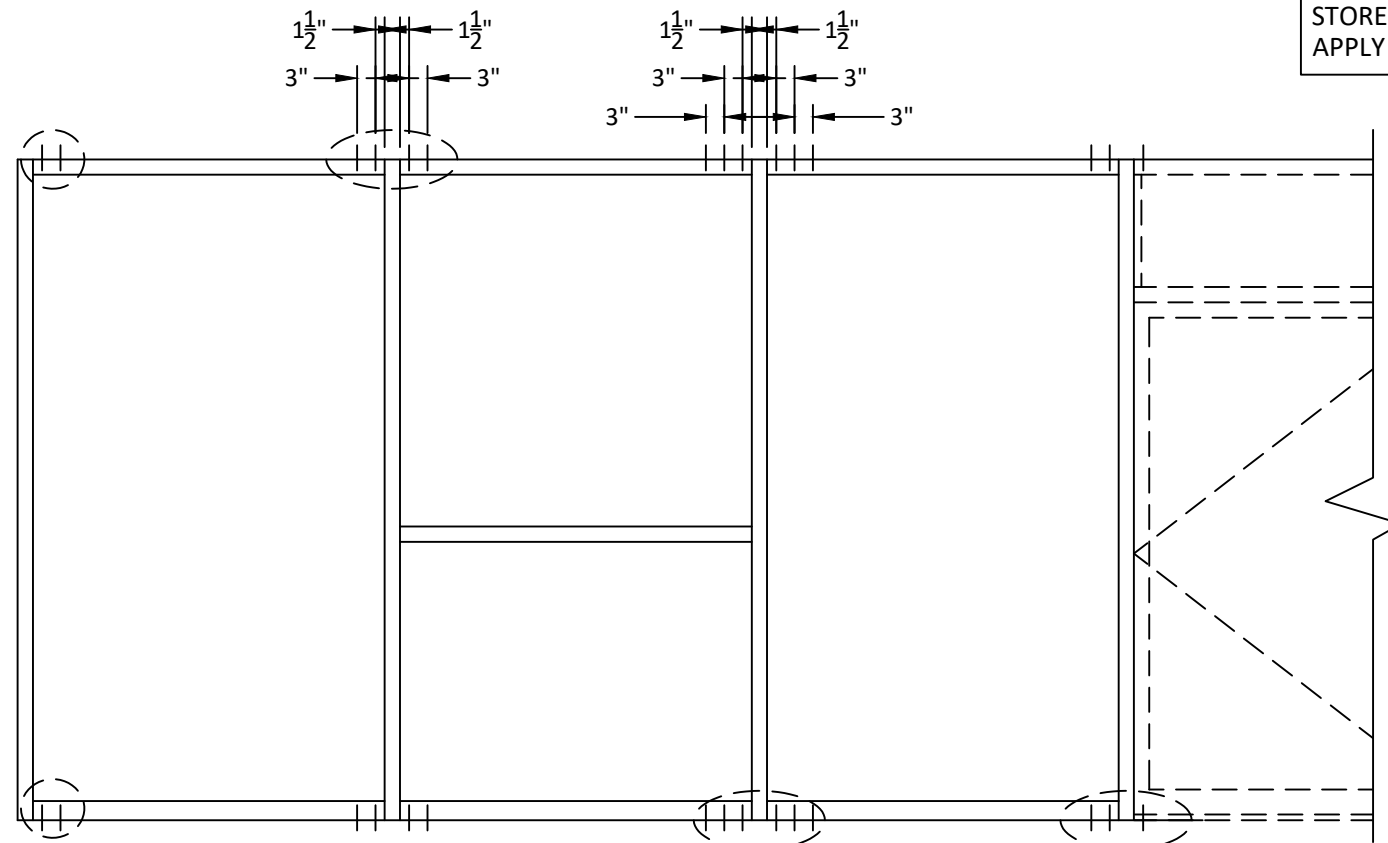

TYPICAL ANCHOR LAYOUT

FOR DOOR ADJACENT
MULLION ANCHOR
REQUIREMENTS SEE
SHEETS 8 & 9



YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
YHS 50 TU ALUMINUM STOREFRONT
SYSTEM - OUTSIDE GLAZED
(HVHZ) (IMPACT)
ELEVATION &
ANCHOR LAYOUT

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
PROFILE UPDATE	SH	07.03.24
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:
FL14218

DATE: **10.20.15**

DWG. BY: **SM** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **YKK161**

SHEET:


2

c:\users\sebastianh\documents\building drops, inc\building drops, inc\projects\ykk ap america, inc\fbc-26-0123 - fl14218 yns 50 tu pre-glazed storefront systems\dwgs\tu\ykk161.dwg 2/11/2026 9:22 AM

GLASS LOAD CAPACITY (PSF)		
NOMINAL DIMS. (in)		INSUL. LAM. GLASS
DLO WIDTH	DLO HEIGHT	EXT. (+) INT. (-)
27.5	54.375	70.0
33.5		70.0
39.5		70.0
45.5		70.0
51.5		70.0
57.5		70.0
63.5	60.375	70.0
69.5		68.4
27.5		70.0
33.5		70.0
39.5		70.0
45.5		70.0
51.5	66.375	70.0
57.5		70.0
63.5		70.0
69.5		70.0
27.5		70.0
33.5		70.0
39.5	72.375	70.0
45.5		70.0
51.5		70.0
57.5		70.0
63.5		63.4
69.5		57.9
27.5	78.375	70.0
33.5		70.0
39.5		70.0
45.5		70.0
51.5		70.0
57.5		70.0
63.5	84.375	70.0
69.5		63.4
27.5		70.0
33.5		70.0
39.5		70.0
45.5		70.0


GLASS LOAD CAPACITY (PSF)		
NOMINAL DIMS. (in)		INSUL. LAM. GLASS
DLO WIDTH	DLO HEIGHT	EXT. (+) INT. (-)
27.5	90.375	70.0
33.5		70.0
39.5		70.0
45.5		70.0
51.5		70.0
57.5		70.0
63.5	96.375	63.4
69.5		70.0
27.5		70.0
33.5		70.0
39.5		70.0
45.5		70.0
51.5	102.375	70.0
57.5		70.0
63.5		70.0
69.5		70.0
27.5		70.0
33.5		70.0
39.5	108.375	70.0
45.5		70.0
51.5		70.0
57.5		70.0
63.5		50.0
69.5		50.0
27.5	114.375	50.0
33.5		50.0
39.5		50.0
45.5		50.0

DAYLITE OPENING DIMENSIONS:
DAYLITE OPENING WIDTH:
• NOMINAL PANEL WIDTH - 2.500"
DAYLITE OPENING HEIGHT:
• FRAME HEIGHT - 5.625"

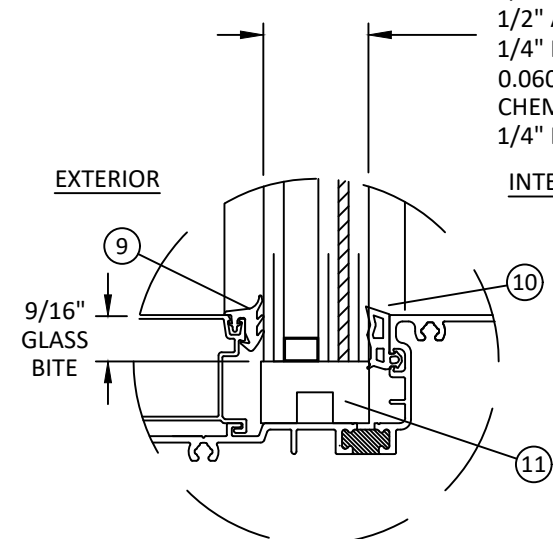

GLAZING DETAIL B
(DRY GLAZED)


DRY GLAZED GLASS TYPES LARGE & SMALL MISSILE IMPACT

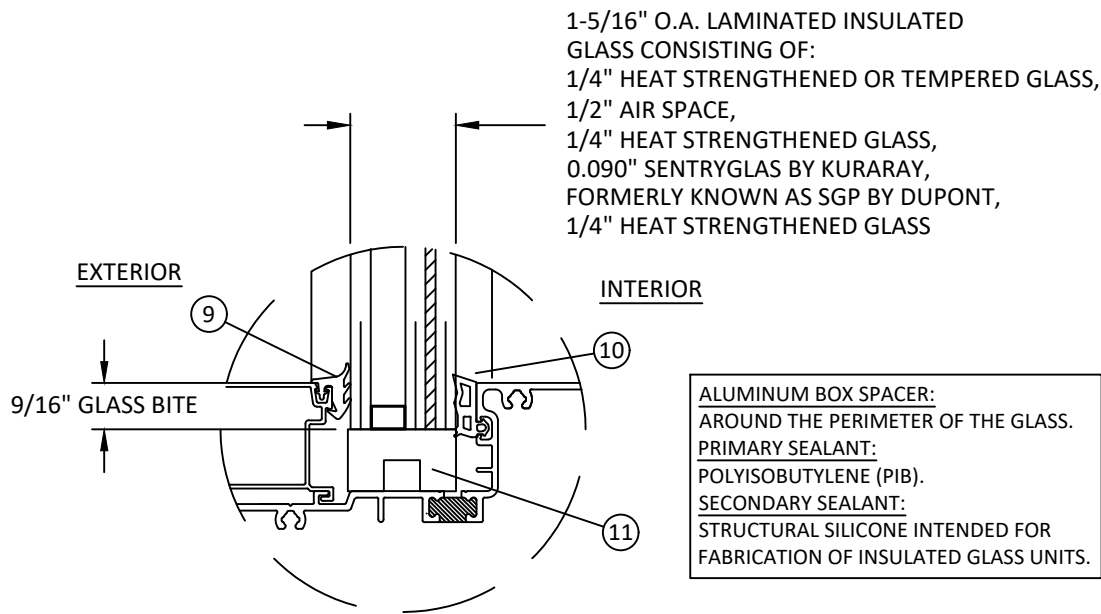


GLAZING DETAIL A
(DRY GLAZED)

ALUMINUM BOX SPACER:
AROUND THE PERIMETER OF THE GLASS.
PRIMARY SEALANT:
POLYISOBUTYLENE (PIB).
SECONDARY SEALANT:
STRUCTURAL SILICONE INTENDED FOR
FABRICATION OF INSULATED GLASS UNITS.


DRY GLAZED GLASS TYPES SMALL MISSILE IMPACT ONLY

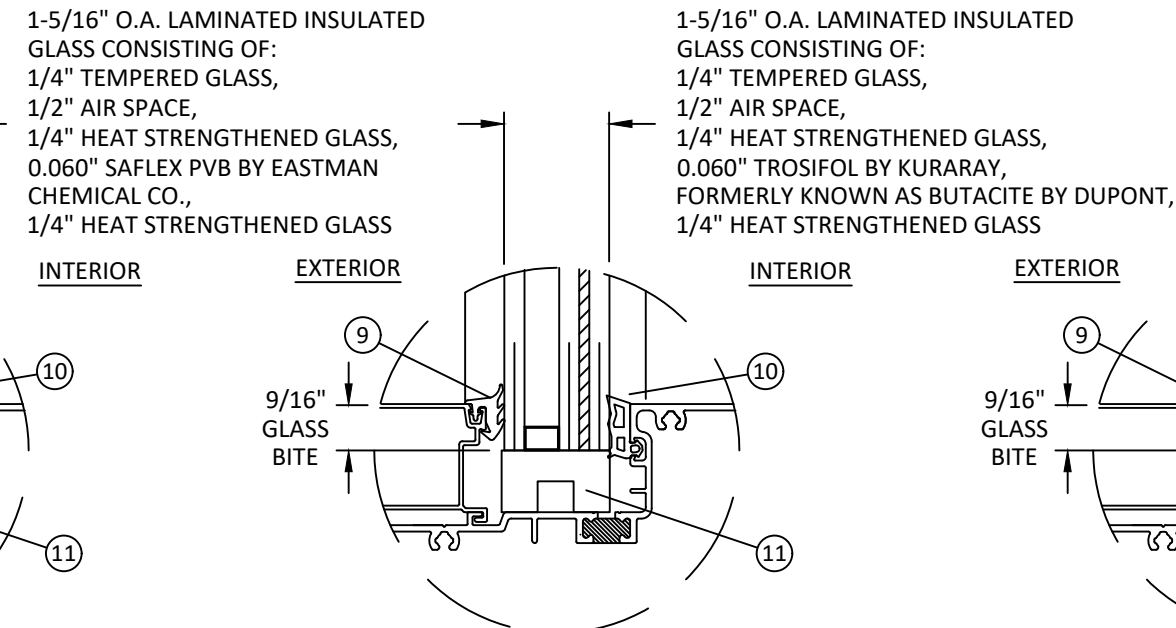

GLAZING DETAIL C
(DRY GLAZED)

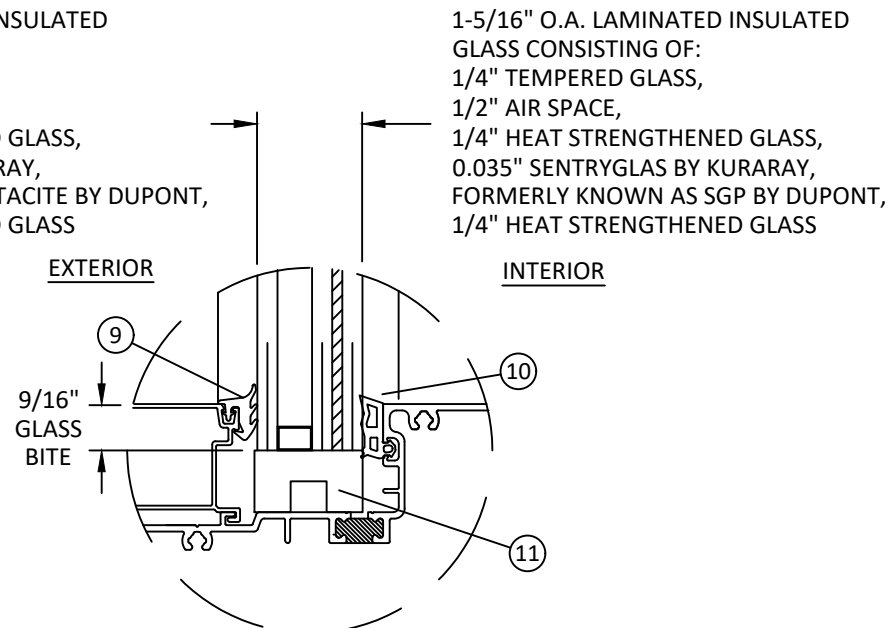

GLAZING DETAIL D
(DRY GLAZED)

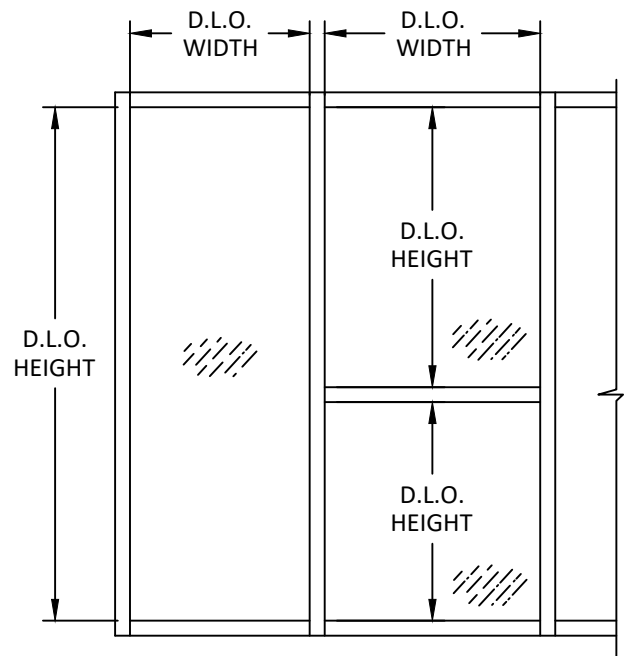

- * NOTE:
- GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300 (3 SEC. GUSTS) AND CHAPTER 17 OF THE CURRENT FBC FOR SIZES OTHER THAN TESTED.
 - SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN CHAPTER 24.
 - SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER CHAPTER 24.
 - D.L.O. MAY NOT EXCEED MAX DIMENSIONS IN GLASS CHARTS FOR GLASS TYPE.

YKK
ap

Quality
inspires™

YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
YHS 50 TU ALUMINUM STOREFRONT
SYSTEM - OUTSIDE GLAZED
(HVHZ) (IMPACT)
DRY GLAZING DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

BD
BUILDING DROPS

REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
PROFILE UPDATE	SH	07.03.24
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO
LICENSE
No. 73778
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL14218
DATE:	10.20.15
DWG. BY:	SM
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK161
SHEET:	


WET GLAZED GLASS TYPES
LARGE & SMALL MISSILE IMPACT

GLASS LOAD CAPACITY (PSF)			
NOMINAL DIMS. (in)		GLASS TYPE 'E'	GLASS TYPE 'F' & 'G'
DLO WIDTH	DLO HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)
27.5	54.375	70.0	50.0
33.5		70.0	50.0
39.5		70.0	50.0
45.5		70.0	50.0
51.5		70.0	44.2
57.5		70.0	44.2
63.5		70.0	48.7
69.5	60.375	68.4	41.8
27.5		70.0	50.0
33.5		70.0	50.0
39.5		70.0	50.0
45.5		70.0	50.0
51.5		70.0	44.2
57.5		70.0	39.6
63.5	66.375	70.0	39.6
69.5		70.0	43.4
27.5		70.0	50.0
33.5		70.0	50.0
39.5		70.0	50.0
45.5		70.0	50.0
51.5		70.0	44.2
57.5	72.375	70.0	39.6
63.5		63.4	35.8
69.5		63.5	35.9
27.5		70.0	50.0
33.5		70.0	50.0
39.5		70.0	50.0
45.5		70.0	50.0
51.5	78.375	70.0	44.2
57.5		70.0	39.6
63.5		63.4	-
69.5		57.9	-
27.5		70.0	50.0
33.5		70.0	50.0
39.5		70.0	50.0
45.5	84.375	70.0	50.0
51.5		70.0	44.2
57.5		70.0	-
63.5		63.4	-
69.5		57.9	-




GLASS LOAD CAPACITY (PSF)			
NOMINAL DIMS. (in)		GLASS TYPE 'E'	GLASS TYPE 'F' & 'G'
DLO WIDTH	DLO HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)
27.5	90.375	70.0	50.0
33.5		70.0	50.0
39.5		70.0	50.0
45.5		70.0	50.0
51.5		70.0	44.2
57.5		70.0	-
63.5		63.4	-
27.5	96.375	70.0	50.0
33.5		70.0	50.0
39.5		70.0	50.0
45.5		70.0	50.0
51.5		70.0	-
57.5		70.0	-
63.5	102.375	70.0	50.0
69.5		70.0	50.0
27.5		70.0	50.0
33.5		70.0	50.0
39.5		70.0	50.0
45.5		70.0	50.0
51.5	108.375	70.0	-
57.5		70.0	-
63.5		50.0	50.0
69.5		50.0	50.0
27.5		50.0	50.0
33.5		50.0	50.0
39.5	114.375	50.0	50.0
45.5		50.0	-
51.5		50.0	-
57.5		50.0	50.0
63.5		50.0	50.0
69.5		50.0	-

DAYLITE OPENING DIMENSIONS:
DAYLITE OPENING WIDTH:
• NOMINAL PANEL WIDTH - 2.500"
DAYLITE OPENING HEIGHT:
• FRAME HEIGHT - 5.625"

- * NOTE:
- GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300 (3 SEC. GUSTS) AND CHAPTER 17 OF THE CURRENT FBC FOR SIZES OTHER THAN TESTED.
 - SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN CHAPTER 24.
 - SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER CHAPTER 24.
 - D.L.O. MAY NOT EXCEED MAX DIMENSIONS IN GLASS CHARTS FOR GLASS TYPE.

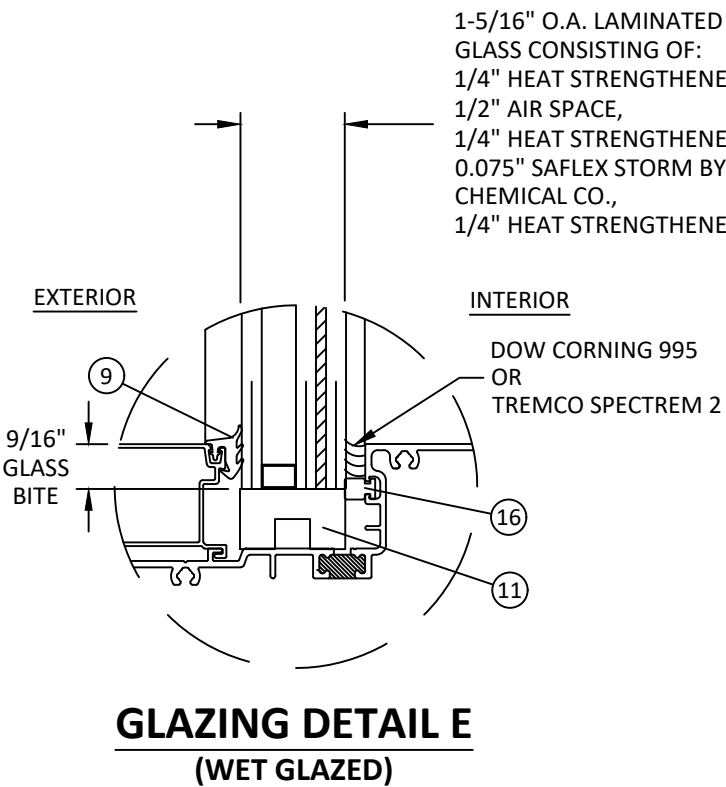

ALUMINUM BOX SPACER:
AROUND THE PERIMETER OF THE GLASS.
PRIMARY SEALANT:
POLYISOBUTYLENE (PIB).
SECONDARY SEALANT:
STRUCTURAL SILICONE INTENDED FOR FABRICATION OF INSULATED GLASS UNITS.

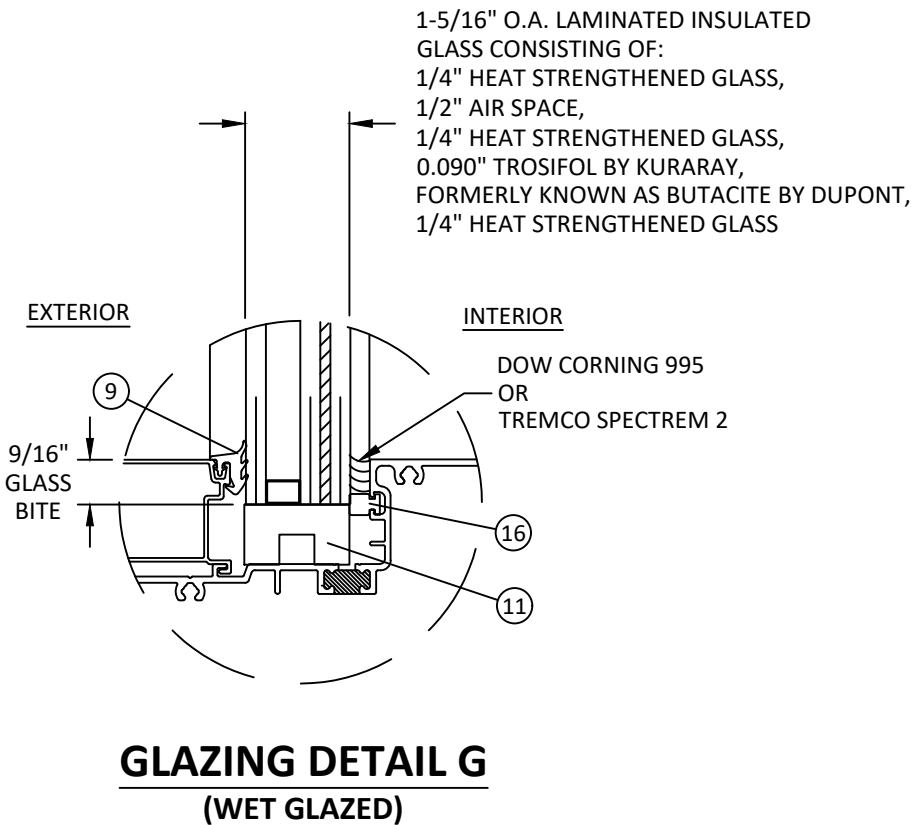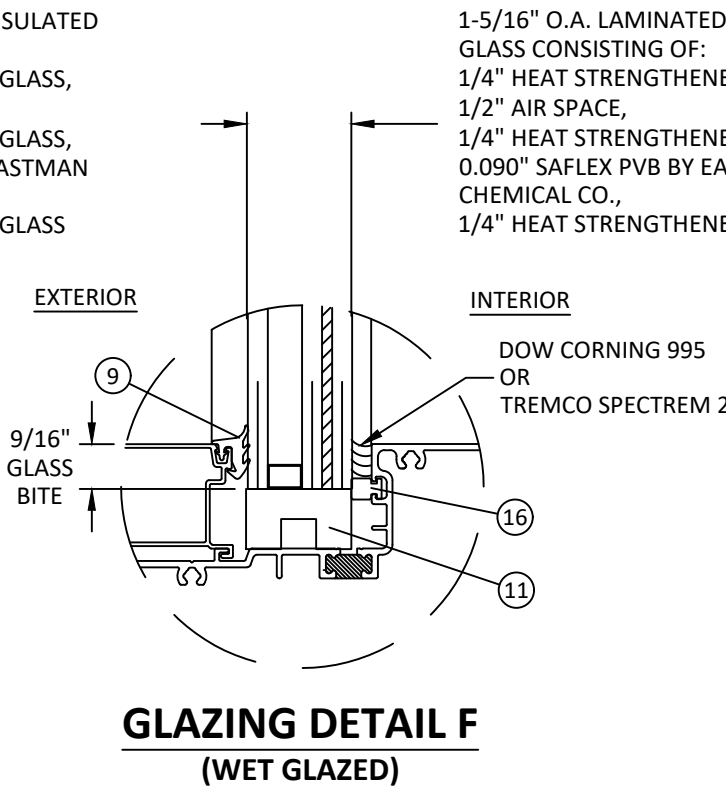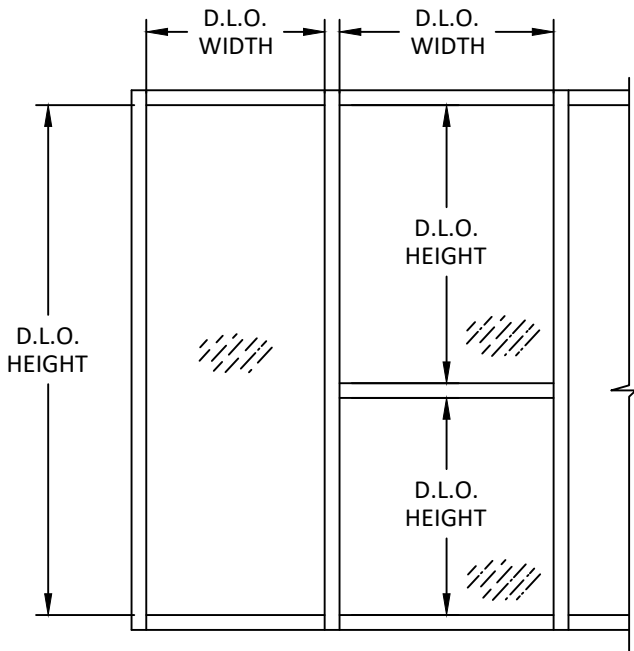



Quality
inspires™

YKK AP AMERICA, INC.


101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
YHS 50 TU ALUMINUM STOREFRONT
SYSTEM - OUTSIDE GLAZED
(HVHZ) (IMPACT)
WET GLAZING DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
PROFILE UPDATE	SH	07.03.24
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

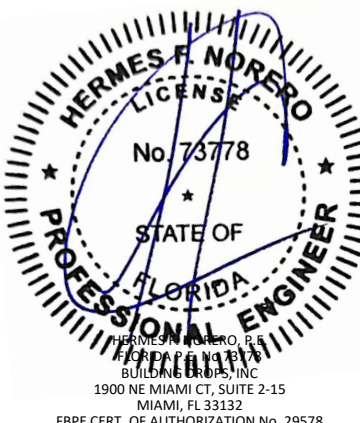

HERMES F. NORERO
LICENSE
No. 73778
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL14218

DATE:

10.20.15

DWG. BY:

CHK. BY:

SM

HFN

SCALE:

NTS

DWG. #:

YKK161

SHEET:


4

[Page 4 of 14]

MULLION LOAD TABLES


JAMB/MULLION LOAD CAPACITY - PSF WITH OR WITHOUT INTERMEDIATE HORIZONTALS				
NOMINAL DIMS.		STANDARD CONFIG.	HEAVY CONFIG.	EXP. MULLION
WIDTH (W)	FRAME HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
30	60	70.0	70.0	70.0
36		70.0	70.0	70.0
42		70.0	70.0	70.0
48		70.0	70.0	70.0
54		70.0	70.0	70.0
60		70.0	70.0	70.0
66		70.0	70.0	70.0
72	66	70.0	70.0	70.0
30		70.0	70.0	70.0
36		70.0	70.0	70.0
42		70.0	70.0	70.0
48		70.0	70.0	70.0
54		70.0	70.0	70.0
60		70.0	70.0	70.0
66	72	70.0	70.0	70.0
72		50.0	70.0	70.0
30		70.0	70.0	70.0
36		70.0	70.0	70.0
42		70.0	70.0	70.0
48		70.0	70.0	70.0
54		70.0	70.0	70.0
60	78	50.0	70.0	70.0
66		50.0	70.0	70.0
72		--	70.0	70.0
30		70.0	70.0	70.0
36		70.0	70.0	70.0
42		70.0	70.0	70.0
48		70.0	70.0	70.0
54	84	50.0	70.0	70.0
60		--	70.0	70.0
66		--	70.0	70.0
72		--	70.0	70.0
30		70.0	70.0	70.0
36		70.0	70.0	70.0
42		70.0	70.0	70.0
48	90	70.0	70.0	70.0
54		50.0	70.0	70.0
60		--	70.0	70.0
66		--	70.0	70.0
72		--	70.0	70.0

JAMB/MULLION LOAD CAPACITY - PSF WITH OR WITHOUT INTERMEDIATE HORIZONTALS				
NOMINAL DIMS.		STANDARD CONFIG.	HEAVY CONFIG.	EXP. MULLION
WIDTH (W)	FRAME HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
30	96	70.0	70.0	70.0
36		70.0	70.0	70.0
42		70.0	70.0	70.0
48		70.0	70.0	70.0
54		50.0	70.0	70.0
60		--	70.0	70.0
66		--	70.0	--
30	102	70.0	70.0	70.0
36		70.0	70.0	70.0
42		66.7	70.0	70.0
48		50.0	70.0	70.0
54		--	70.0	70.0
60		--	70.0	--
30	108	70.0	70.0	70.0
36		65.6	70.0	70.0
42		56.2	70.0	70.0
48		50.0	70.0	70.0
54		--	70.0	70.0
60		--	70.0	--
30	114	--	50.0	50.0
36		--	50.0	50.0
42		--	50.0	50.0
48		--	50.0	50.0
54		--	50.0	50.0
30	120	--	50.0	50.0
36		--	50.0	50.0
42		--	50.0	50.0
48		--	50.0	50.0
54		--	50.0	50.0

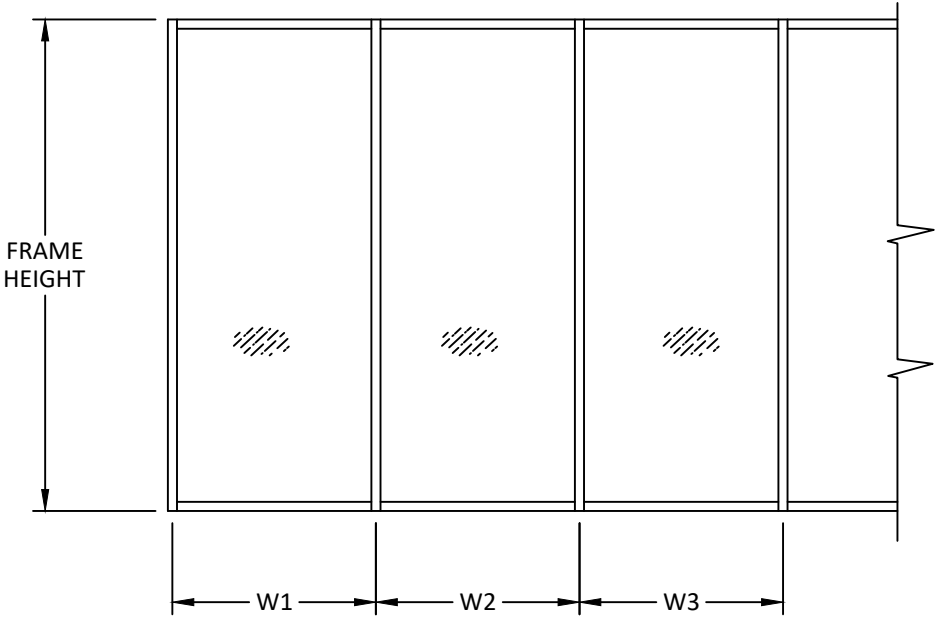


WIDTH (W) = W1 (JAMB)

WIDTH (W) = (W2 + W3) / 2 (MULLION)

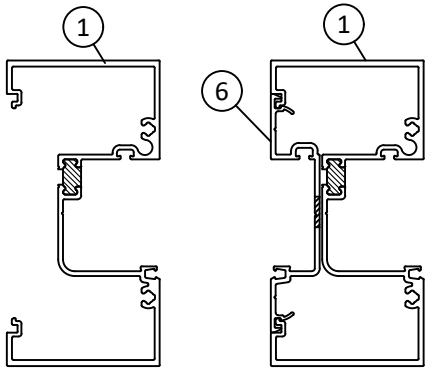

JAMB MULLION

STD. CONFIGURATION

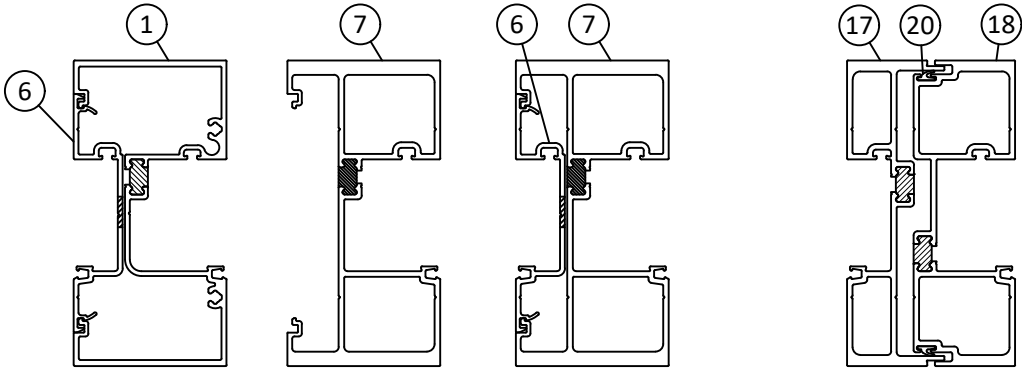

JAMB JAMB MULLION

EXPANSION
MULLION

HEAVY CONFIGURATION



YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
YHS 50 TU ALUMINUM STOREFRONT
SYSTEM - OUTSIDE GLAZED
(HVHZ) (IMPACT)
MULLION TABLES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
PROFILE UPDATE	SH	07.03.24
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:	FL14218
DATE:	10.20.15
DWG. BY:	CHK. BY:
SM	HFN
SCALE:	NTS
DWG. #:	YKK161
SHEET:	5


YKK
ap ®

Quality
inspires[®]

YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT. (-)					
NOMINAL DIMS.		ANCHOR TYPE 'A'		ANCHOR TYPE 'B'	
WIDTH (W)	FRAME HEIGHT	A2	A3	B2	B3
30	90	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0
54		70.0	70.0	70.0	70.0
60		70.0	70.0	70.0	70.0
66		70.0	70.0	70.0	70.0
72		70.0	70.0	65.5	70.0
30	96	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0
54		70.0	70.0	70.0	70.0
60		70.0	70.0	70.0	70.0
66		70.0	70.0	67.0	70.0
72		70.0	70.0	61.4	70.0
30	102	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0
54		70.0	70.0	70.0	70.0
60		70.0	70.0	69.4	70.0
66		70.0	70.0	63.1	70.0
72		70.0	70.0	57.8	70.0
30	108	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0
54		70.0	70.0	70.0	70.0
60		70.0	70.0	65.5	70.0
66		69.7	70.0	59.6	70.0
72		64.4	70.0	54.3	70.0
30	114	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0
54		70.0	70.0	69.0	70.0
60		70.0	70.0	62.1	70.0
66		70.0	70.0	56.8	70.0
72		61.5	70.0	51.5	70.0
30	120	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0
54		70.0	70.0	65.5	70.0
60		69.0	70.0	59.0	70.0
66		63.7	70.0	53.7	70.0
72		58.4	70.0	48.4	70.0

A2 = (2) ANCHORS TYPE 'A' AT JAMB OR EACH SIDE OF MULLION
A3 = (3) ANCHORS TYPE 'A' AT JAMB OR EACH SIDE OF MULLION
B2 = (2) ANCHORS TYPE 'B' AT JAMB OR EACH SIDE OF MULLION
B3 = (3) ANCHORS TYPE 'B' AT JAMB OR EACH SIDE OF MULLION

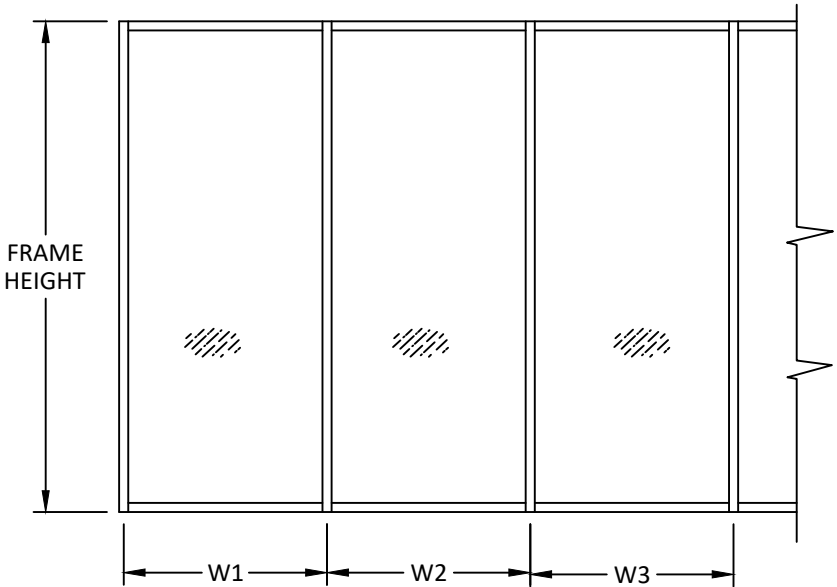

$$\text{WIDTH (W)} = \frac{W2 + W3}{2} \text{ (MULLION)}$$

REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
PROFILE UPDATE	SH	07.03.24
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: **FL14218**

DATE: 10.20.15

DWG. BY: SM	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS

DWG. #: YKK161

SHEET:

6

c:\users\sebastianherrerros\building drops, inc\building drops, inc\common\projects\ykk ap america, inc\fbc-26-0123 - fl14218 yns 50 tu pre-glazed storefront systems\dwgs\tu\ykk161.dwg 2/11/2026 9:23 AM

ANCHOR TYPE 'C & D' TABLES



ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT (-)						
NOMINAL DIMS.		ANCHOR TYPE 'C'		ANCHOR TYPE 'D'		
WIDTH (W)	FRAME HEIGHT	C2	C3	D2	D3	D4
30	60	70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0	70.0
54		70.0	70.0	70.0	70.0	70.0
60		70.0	70.0	64.0	70.0	70.0
66		70.0	70.0	58.2	70.0	70.0
72	66	70.0	70.0	53.3	70.0	70.0
30		70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	70.0	70.0
54		70.0	70.0	64.6	70.0	70.0
60		70.0	70.0	58.2	70.0	70.0
66	72	70.0	70.0	52.9	70.0	70.0
72		69.7	70.0	48.5	70.0	70.0
30		70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0	70.0
48		70.0	70.0	66.7	70.0	70.0
54		70.0	70.0	59.3	70.0	70.0
60	78	70.0	70.0	53.3	70.0	70.0
66		69.7	70.0	48.5	70.0	70.0
72		63.9	70.0	44.4	66.7	70.0
30		70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	70.0	70.0
48		70.0	70.0	61.5	70.0	70.0
54	84	70.0	70.0	54.7	70.0	70.0
60		70.0	70.0	49.2	70.0	70.0
66		64.4	70.0	44.8	67.1	70.0
72		59.0	70.0	41.0	61.5	70.0
30		70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	65.3	70.0	70.0
48	84	70.0	70.0	57.1	70.0	70.0
54		70.0	70.0	50.8	70.0	70.0
60		65.8	70.0	45.7	68.6	70.0
66		59.8	70.0	41.6	62.3	70.0
72		54.8	70.0	38.1	57.1	70.0

ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT (-)													
NOMINAL DIMS.		ANCHOR TYPE 'C'			ANCHOR TYPE 'D'								
WIDTH (W)	FRAME HEIGHT	C2	C3	C4	D2	D3	D4	D5	D5	D5	D5	D5	D5
30	90	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	61.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	53.3	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
54		68.2	70.0	70.0	47.4	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
60		61.4	70.0	70.0	42.7	64.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
66		55.8	70.0	70.0	38.8	58.2	70.0	70.0	70.0	70.0	70.0	70.0	70.0
72	96	51.1	70.0	70.0	35.6	53.3	70.0	70.0	70.0	70.0	70.0	70.0	70.0
30		70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	66.7	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	57.1	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
48		70.0	70.0	70.0	50.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
54		63.9	70.0	70.0	44.4	66.7	70.0	70.0	70.0	70.0	70.0	70.0	70.0
60		57.5	70.0	70.0	40.0	60.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
66	102	52.3	70.0	70.0	36.4	54.5	70.0	70.0	70.0	70.0	70.0	70.0	70.0
72		48.0	70.0	70.0	33.3	50.0	66.7	70.0	70.0	70.0	70.0	70.0	70.0
30		70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	62.7	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	53.8	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
48		67.7	70.0	70.0	47.1	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
54		60.2	70.0	70.0	41.8	62.7	70.0	70.0	70.0	70.0	70.0	70.0	70.0
60	108	54.2	70.0	70.0	37.6	56.5	70.0	70.0	70.0	70.0	70.0	70.0	70.0
66		49.2	70.0	70.0	34.2	51.3	68.4	70.0	70.0	70.0	70.0	70.0	70.0
30		70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	59.3	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
42		70.0	70.0	70.0	50.8	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
48		63.9	70.0	70.0	44.4	66.7	70.0	70.0	70.0	70.0	70.0	70.0	70.0
54		56.8	70.0	70.0	39.5	59.3	70.0	70.0	70.0	70.0	70.0	70.0	70.0
60	114	51.1	70.0	70.0	35.6	53.3	70.0	70.0	70.0	70.0	70.0	70.0	70.0
66		46.5	69.7	70.0	32.3	48.5	64.6	70.0	70.0	70.0	70.0	70.0	70.0
30		70.0	70.0	70.0	67.4	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	56.1	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
42		69.2	70.0	70.0	48.1	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
48		60.6	70.0	70.0	42.1	63.2	70.0	70.0	70.0	70.0	70.0	70.0	70.0
54		53.8	70.0	70.0	37.4	56.1	70.0	70.0	70.0	70.0	70.0	70.0	70.0
60	120	48.5	70.0	70.0	33.7	50.5	67.4	70.0	70.0	70.0	70.0	70.0	70.0
30		70.0	70.0	70.0	64.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	53.3	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
42		65.8	70.0	70.0	45.7	68.6	70.0	70.0	70.0	70.0	70.0	70.0	70.0
48		57.5	70.0	70.0	40.0	60.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
54		51.1	70.0	70.0	35.6	53.3	70.0	70.0	70.0	70.0	70.0	70.0	70.0
60		46.0	69.0	70.0	32.0	48.0	64.0	70.0	70.0	70.0	70.0	70.0	70.0

ANCHORS TYPES: SEE SHEET 10 FOR DESCRIPTION

- C2 = (2) ANCHORS TYPE 'C' AT JAMB OR EACH SIDE OF MULLION
- C3 = (3) ANCHORS TYPE 'C' AT JAMB OR EACH SIDE OF MULLION
- C4 = (4) ANCHORS TYPE 'C' AT JAMB OR EACH SIDE OF MULLION
- D2 = (2) ANCHORS TYPE 'D' AT JAMB OR EACH SIDE OF MULLION
- D3 = (3) ANCHORS TYPE 'D' AT JAMB OR EACH SIDE OF MULLION
- D4 = (4) ANCHORS TYPE 'D' AT JAMB OR EACH SIDE OF MULLION
- D5 = (5) ANCHORS TYPE 'D' AT JAMB OR EACH SIDE OF MULLION

ALL OTHER ANCHORS TO BE SPACED AS PER ELEVATION

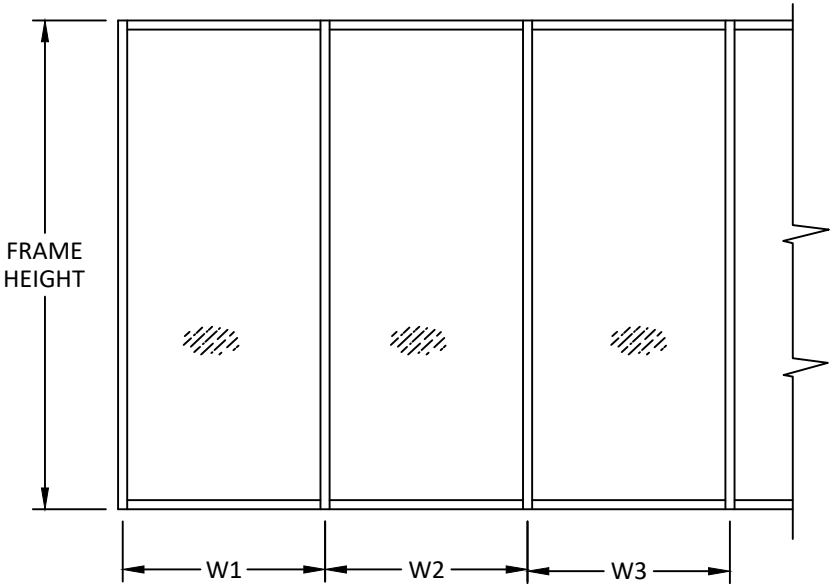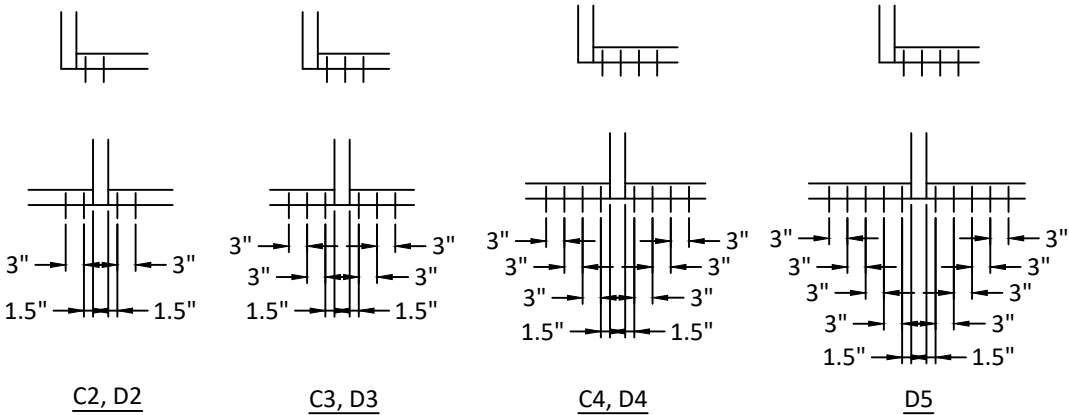

WIDTH (W) = W1 (JAMB)

WIDTH (W) = $\frac{W2 + W3}{2}$ (MULLION)

YKK

ap

Quality
inspires™

YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
YHS 50 TU ALUMINUM STOREFRONT
SYSTEM - OUTSIDE GLAZED
(HVHZ) (IMPACT)
TYPE C & D ANCHOR TABLES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

B.D.

BUILDING DROPS

REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
PROFILE UPDATE	SH	07.03.24
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO

LICENSE

No. 73778

STATE OF FLORIDA

PROFESSIONAL ENGINEER

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL14218

DATE: **10.20.15**

DWG. BY: **SM**CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **YKK161**

SHEET:
7

[Page 7 of 14]

c:\users\sebastianherrerros\building drops, inc\building drops, inc\common\projects\ykk ap america, inc\fb-26-0123 - fl14218 yns 50 tu pre-glazed storefront systems\dwg\tu\ykk161.dwg 2/11/2026 9:23 AM

ANCHOR TYPE 'E' TABLES


ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT (-)						
NOMINAL DIMS.		ANCHOR TYPE 'E'				
WIDTH (W)	FRAME HEIGHT	E2	E3	E4	E5	E6
30	60	70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0
42		66.2	70.0	70.0	70.0	70.0
48		57.9	70.0	70.0	70.0	70.0
54		51.5	70.0	70.0	70.0	70.0
60		46.3	69.5	70.0	70.0	70.0
66		42.1	63.2	70.0	70.0	70.0
72	66	38.6	57.9	70.0	70.0	70.0
30		70.0	70.0	70.0	70.0	70.0
36		70.0	70.0	70.0	70.0	70.0
42		60.2	70.0	70.0	70.0	70.0
48		52.7	70.0	70.0	70.0	70.0
54		46.8	70.0	70.0	70.0	70.0
60		42.1	63.2	70.0	70.0	70.0
66	72	38.3	57.4	70.0	70.0	70.0
72		35.1	52.7	70.0	70.0	70.0
30	78	70.0	70.0	70.0	70.0	70.0
36		64.4	70.0	70.0	70.0	70.0
42		55.2	70.0	70.0	70.0	70.0
48		48.3	70.0	70.0	70.0	70.0
54		42.9	64.4	70.0	70.0	70.0
60		38.6	57.9	70.0	70.0	70.0
66		35.1	52.7	70.0	70.0	70.0
72	84	32.2	48.3	64.4	70.0	70.0
30		70.0	70.0	70.0	70.0	70.0
36		59.4	70.0	70.0	70.0	70.0
42		50.9	70.0	70.0	70.0	70.0
48		44.6	66.8	70.0	70.0	70.0
54		39.6	59.4	70.0	70.0	70.0
60		35.6	53.5	70.0	70.0	70.0
66	90	32.4	48.6	64.8	70.0	70.0
72		29.7	44.6	59.4	70.0	70.0
30	96	66.2	70.0	70.0	70.0	70.0
36		55.2	70.0	70.0	70.0	70.0
42		47.3	70.0	70.0	70.0	70.0
48		41.4	62.1	70.0	70.0	70.0
54		36.8	55.2	70.0	70.0	70.0
60		33.1	49.6	66.2	70.0	70.0
66		30.1	45.1	60.2	70.0	70.0
72	96	27.6	41.4	55.2	69.0	70.0

ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT (-)						
NOMINAL DIMS.		ANCHOR TYPE 'E'				
WIDTH (W)	FRAME HEIGHT	E2	E3	E4	E5	E6
30	90	61.8	70.0	70.0	70.0	70.0
36		51.5	70.0	70.0	70.0	70.0
42		44.1	66.2	70.0	70.0	70.0
48		38.6	57.9	70.0	70.0	70.0
54		34.3	51.5	68.6	70.0	70.0
60		30.9	46.3	61.8	70.0	70.0
66		28.1	42.1	56.2	70.0	70.0
72	96	25.7	38.6	51.5	64.4	70.0
30		57.9	70.0	70.0	70.0	70.0
36		48.3	70.0	70.0	70.0	70.0
42		41.4	62.1	70.0	70.0	70.0
48		36.2	54.3	70.0	70.0	70.0
54		32.2	48.3	64.4	70.0	70.0
60		29.0	43.4	57.9	70.0	70.0
66	102	26.3	39.5	52.7	65.8	70.0
72		24.1	36.2	48.3	60.3	70.0
30	108	54.5	70.0	70.0	70.0	70.0
36		45.4	68.1	70.0	70.0	70.0
42		38.9	58.4	70.0	70.0	70.0
48		34.1	51.1	68.1	70.0	70.0
54		30.3	45.4	60.6	70.0	70.0
60		27.3	40.9	54.5	68.1	70.0
66		24.8	37.2	49.6	61.9	70.0
72	108	51.5	70.0	70.0	70.0	70.0
30		42.9	64.4	70.0	70.0	70.0
36		36.8	55.2	70.0	70.0	70.0
42		32.2	48.3	64.4	70.0	70.0
48		28.6	42.9	57.2	70.0	70.0
54		25.7	38.6	51.5	64.4	70.0
60		23.4	35.1	46.8	58.5	70.0
66	114	48.8	70.0	70.0	70.0	70.0
72		40.6	61.0	70.0	70.0	70.0
30		34.8	52.3	69.7	70.0	70.0
36		30.5	45.7	61.0	70.0	70.0
42		27.1	40.6	54.2	67.7	70.0
48		24.4	36.6	48.8	61.0	70.0
54		21.7	32.6	43.8	54.2	70.0
60	120	46.3	69.5	70.0	70.0	70.0
66		38.6	57.9	70.0	70.0	70.0
72		33.1	49.6	66.2	70.0	70.0
30		29.0	43.4	57.9	70.0	70.0
36		25.7	38.6	51.5	64.4	70.0
42		23.2	34.8	46.3	57.9	69.5

ANCHORS TYPES: SEE SHEET 10 FOR DESCRIPTION

- E2 = (2) ANCHORS TYPE 'E' AT JAMB OR EACH SIDE OF MULLION
E3 = (3) ANCHORS TYPE 'E' AT JAMB OR EACH SIDE OF MULLION
E4 = (4) ANCHORS TYPE 'E' AT JAMB OR EACH SIDE OF MULLION
E5 = (5) ANCHORS TYPE 'E' AT JAMB OR EACH SIDE OF MULLION
E6 = (6) ANCHORS TYPE 'E' AT JAMB OR EACH SIDE OF MULLION

ALL OTHER ANCHORS TO BE SPACED AS PER ELEVATION

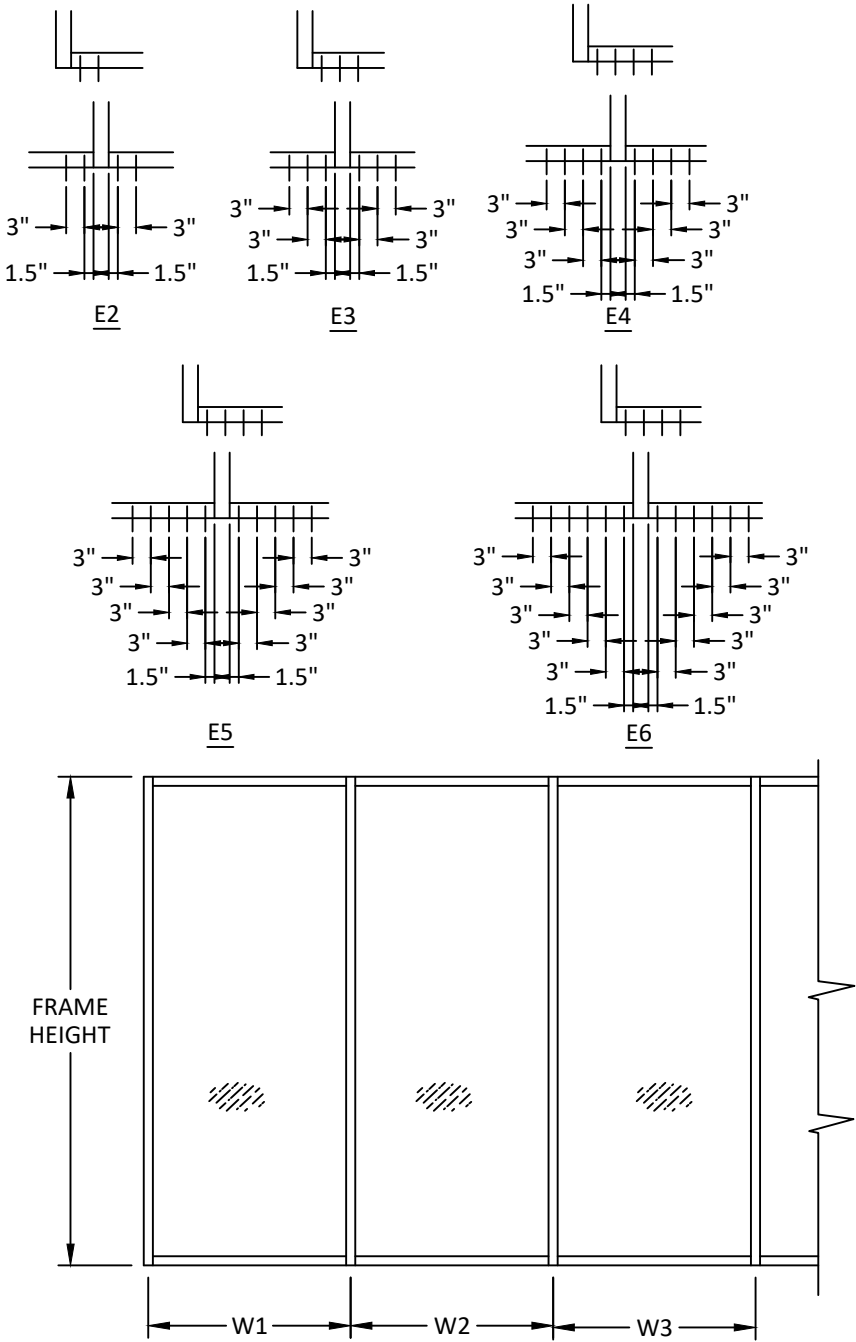

WIDTH (W) = W1 (JAMB)

WIDTH (W) = $\frac{W2 + W3}{2}$ (MULLION)

YKK
ap

Quality
inspires™

YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
YHS 50 TU ALUMINUM STOREFRONT
SYSTEM - OUTSIDE GLAZED
(HVHZ) (IMPACT)
TYPE E ANCHOR TABLES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
PROFILE UPDATE	SH	07.03.24
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO
LICENSE
No. 73778
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL14218

DATE: **10.20.15**

DWG. BY: **SM** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **YKK161**

SHEET:
7A

[Page 8 of 14]

ANCHOR TYPE	TOTAL NO. OF ANCHORS REQUIRED AT DOOR MULLION HEAD AND SILL BY DESIGN PRESSURE				
	70 PSF	60 PSF	50 PSF	40 PSF	30 PSF
A	4	4	3	3	2
B	5	4	4	3	2
C	6	5	4	4	3
D	8	7	6	5	4
E	11	10	8	7	5

YKK AP OUTSWING DOORS
SEE SEPARATE APPROVAL

FRAME HEIGHT

W2

W1

WIDTH (W) = $\frac{W1 + W2}{2}$

SINGLE DOOR

FRAME HEIGHT

W1

W2

WIDTH (W) = $\frac{W1}{2} + \frac{W2}{4}$

DOUBLE DOOR


YKK AP OUTSWING DOORS
SEE SEPARATE APPROVAL

FRAME HEIGHT

W1 W2


WIDTH (W) = $\frac{W1 + W2}{2}$

SINGLE DOOR WITH TRANSOM

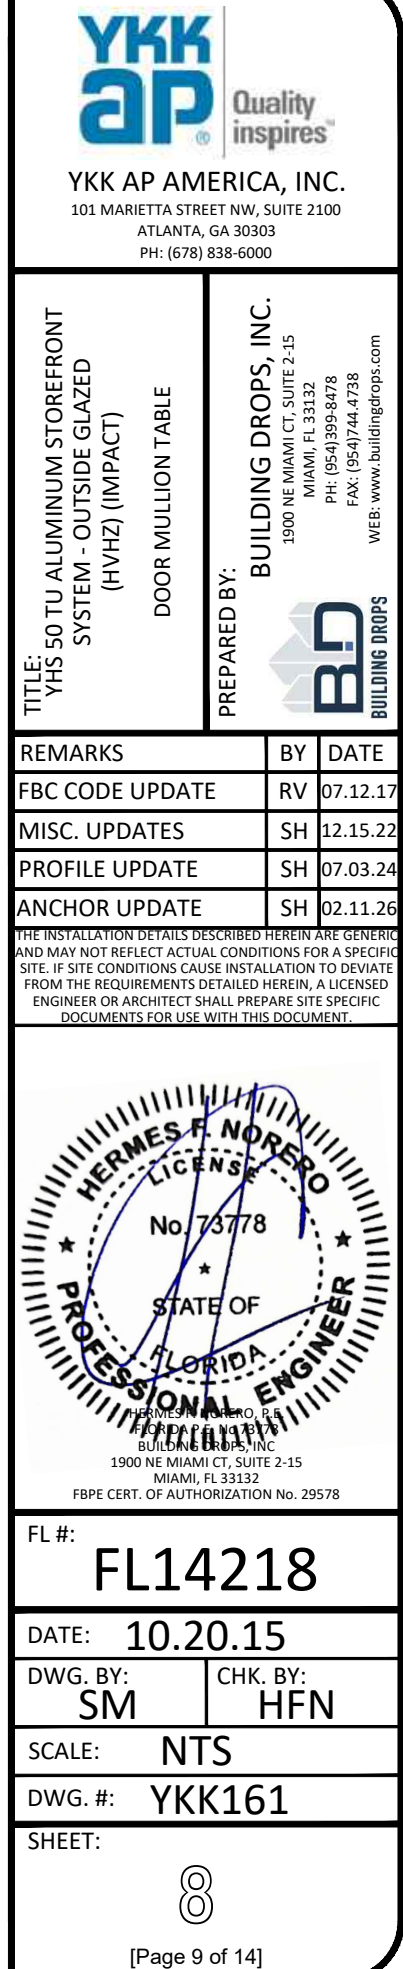


DOOR MULLION LOAD & ANCHOR TABLES

DOOR MULLION LOAD CAPACITY (PSF)						
NOMINAL DIMS.			WITHOUT STEEL REINF.		WITH STEEL REINF.	
FRAME HEIGHT (IN.)	DOOR PANEL WIDTH - W1 (IN.)	SIDELITE WIDTH - W2 (IN.)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
96	36	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
	42	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
	48	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
102	36	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
	42	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
	48	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
108	36	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
	42	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
	48	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	57.1	57.1	70.0	90.0

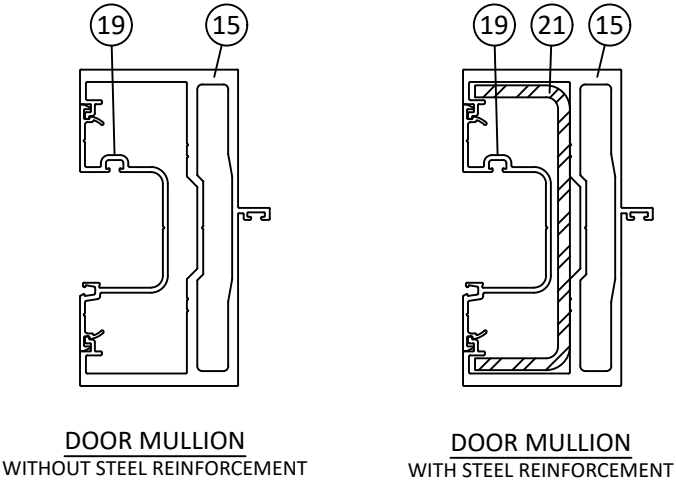

ANCHOR TYPE	TOTAL NO. OF ANCHORS REQUIRED AT DOOR MULLION HEAD AND SILL BY DESIGN PRESSURE				
	70 PSF	60 PSF	50 PSF	40 PSF	30 PSF
A	5	4	4	3	2
B	6	5	4	3	3
C	7	6	5	4	3
D	10	9	7	6	5
E	14	12	10	8	6

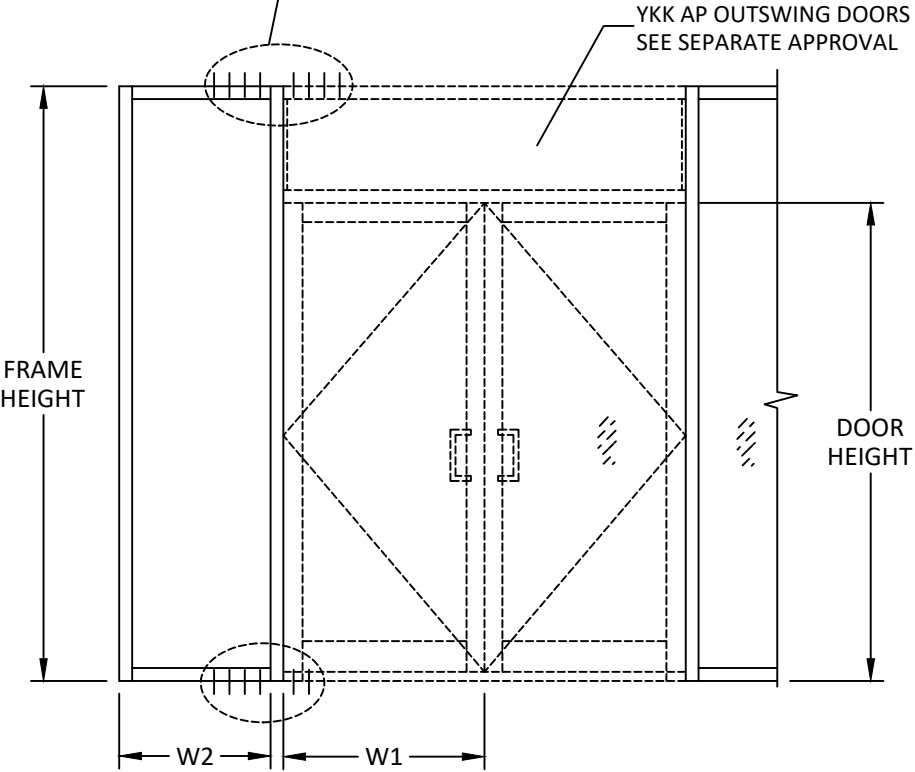

DOUBLE DOOR WITH TRANSOM

YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
YHS 50 TU ALUMINUM STOREFRONT
SYSTEM - OUTSIDE GLAZED
(HVHZ) (IMPACT)
DOOR MULLION TABLES (1)

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
PROFILE UPDATE	SH	07.03.24
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.


HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	
FL14218	
DATE: 10.20.15	
DWG. BY: SM	CHK. BY: HFN
SCALE: NTS	
DWG. #: YKK161	
SHEET:	
9	


[Page 10 of 14]

c:\users\sebastianherrerros\building drops, inc\building drops\york ap america, inc\fb-26-0123 - fl14218 yhs 50 tu pre-glazed storefront systems\dwgs\tu\york161.dwg 2/11/2026 9:23 AM


c:\Users\sebastianhereros\building drops, inc\building drops\york ap america, inc\fb-26-0123 - fl14218 yns 50 tu pre-glazed storefront systems\dwgs\tu\york161.dwg
2/11/2026 9:23 AM

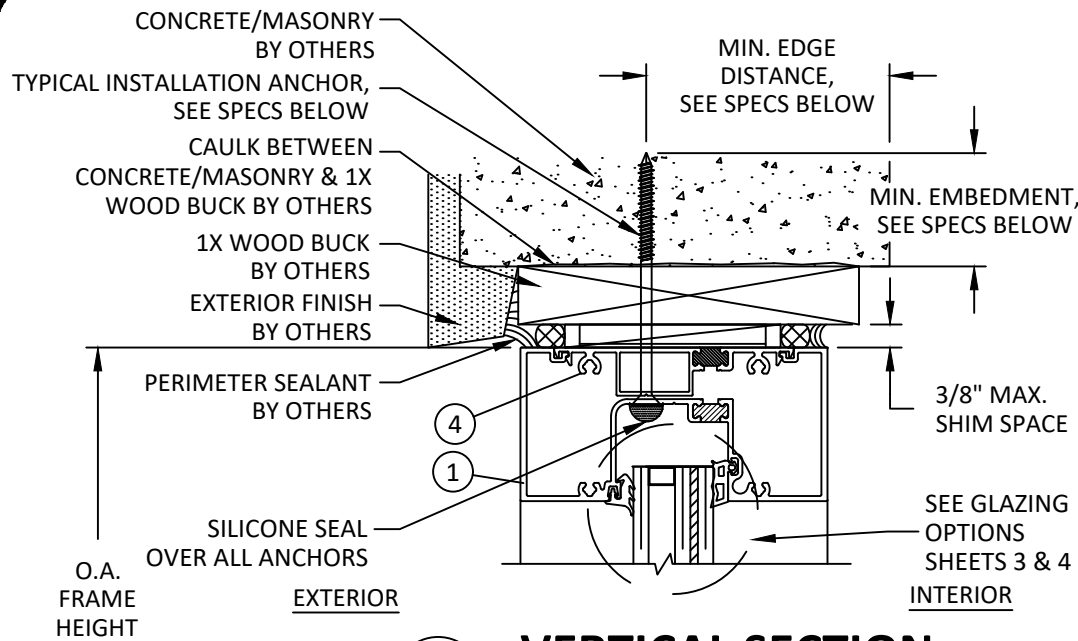


A
10 VERTICAL SECTION
HEAD - CONCRETE/MASONRY W/ 1X BUCK

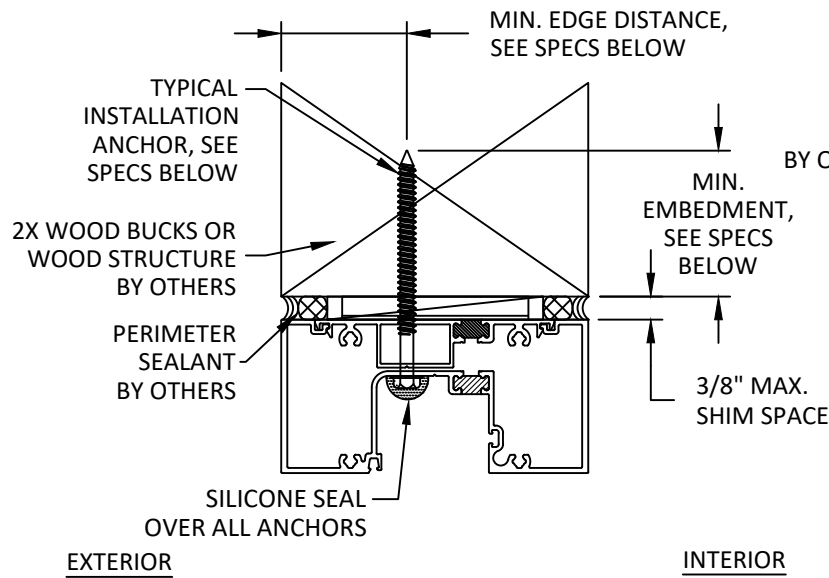


D
10 VERTICAL SECTION
HEAD - WOOD FRAMING
TYPICAL INSTALLATION

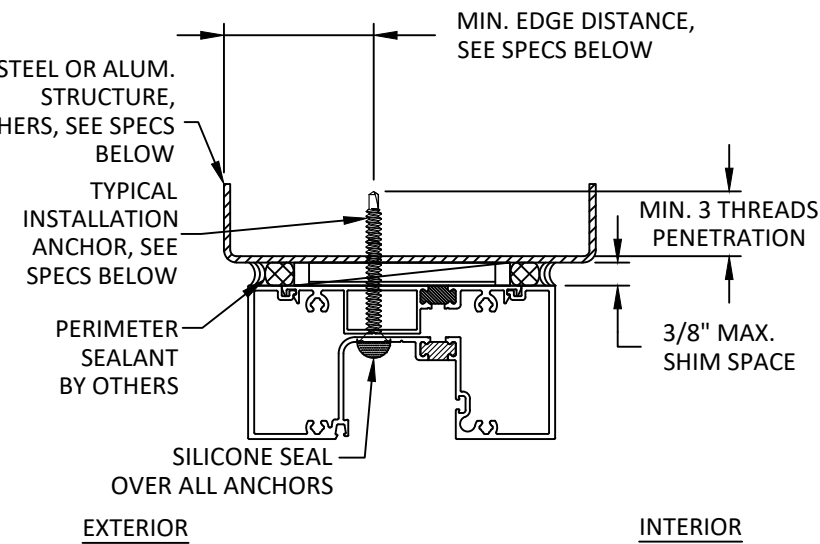

E
10 VERTICAL SECTION
HEAD - METAL SUBSTRATE
TYPICAL INSTALLATION

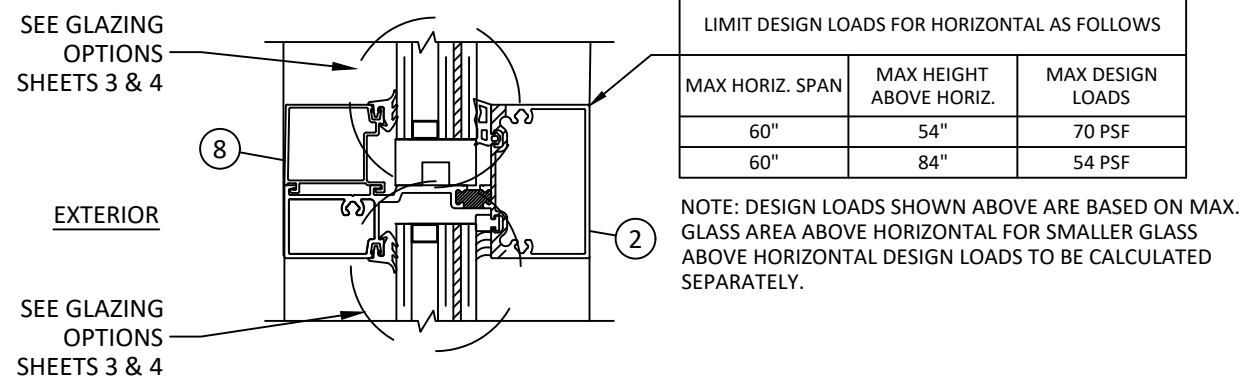

B
10 VERTICAL SECTION
HORIZONTAL MEMBER

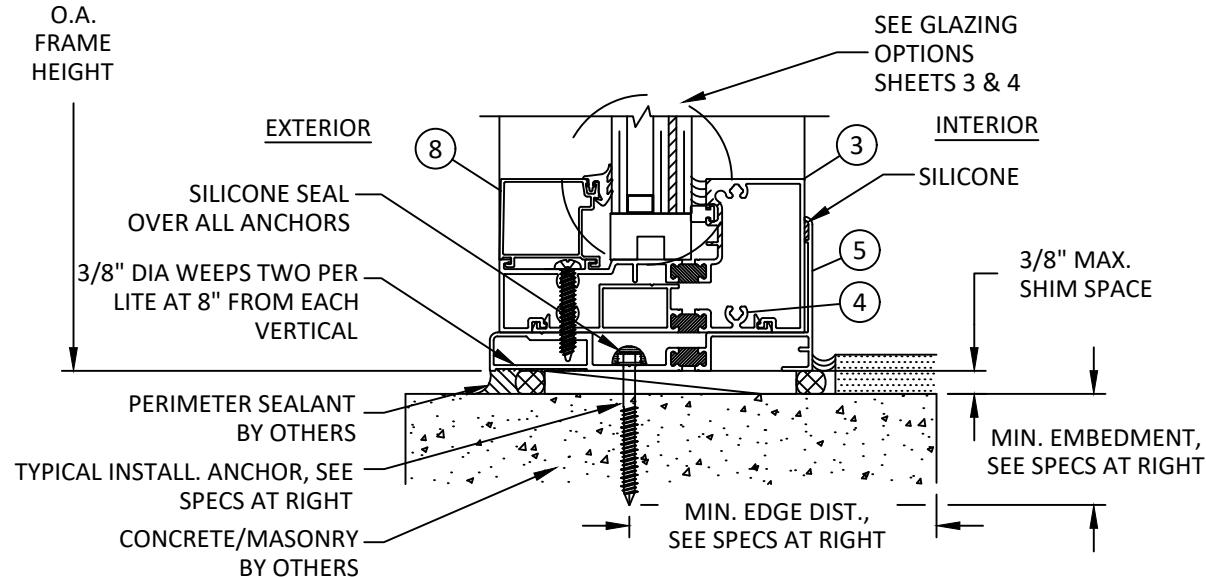

C
10 VERTICAL SECTION
SILL - DIRECT TO CONCRETE/MASONRY

LIMIT DESIGN LOADS FOR HORIZONTAL AS FOLLOWS		
MAX HORIZ. SPAN	MAX HEIGHT ABOVE HORIZ.	MAX DESIGN LOADS
60"	54"	70 PSF
60"	84"	54 PSF

NOTE: DESIGN LOADS SHOWN ABOVE ARE BASED ON MAX. GLASS AREA ABOVE HORIZONTAL FOR SMALLER GLASS ABOVE HORIZONTAL DESIGN LOADS TO BE CALCULATED SEPARATELY.

YHS 50 TU ANCHOR SCHEDULE				
ANCHOR TYPE	ANCHOR DESCRIPTION	SUBSTRATE REQUIREMENTS	MIN. EMBEDMENT	MIN. EDGE DISTANCE
A	5/16" DEWALT ULTRAICON	CONCRETE MIN. F'C = 3000 PSI	2"	3-1/8"
	5/16" ITW TAPCON+		1-1/4"	2-3/16"
	5/16" SELF-DRILLING SCREW (GRADE 5)	STEEL: MIN. 12 GA., MIN. Fy=36 KSI ALUM.: MIN. 1/8", MIN. 6063-T5"	3 THREADS PENETRATION PAST METAL STRUCTURE	3/4"
B	5/16" ITW TAPCON+	GROUT-FILLED BLOCK PER C-90, MIN. F'C = 2000 PSI	1-1/4"	3"
	5/16" DEWALT ULTRAICON	WOOD MIN. S.G. = 0.55	1-1/2"	1-9/16"
	5/16" DEWALT TAPPER+	CONCRETE MIN. F'C = 3000 PSI	1-3/4"	2-1/2"
C	1/4" SELF-DRILLING SCREW (GRADE 5)	STEEL: MIN. 12 GA., MIN. Fy=36 KSI ALUM.: MIN. 1/8", MIN. 6063-T5"	3 THREADS PENETRATION PAST METAL STRUCTURE	3/4"
D	1/4" ITW TAPCON	CONCRETE MIN. F'C = 3000 PSI	1-3/4"	1-1/2"
	1/4" DEWALT ULTRAICON+		1-3/4"	1-1/2"
	5/16" DEWALT ULTRAICON	GROUT-FILLED BLOCK PER C-90, MIN. F'C = 2000 PSI	1-3/4"	2-1/2"
	1/4" DEWALT TAPPER+		1-1/2"	3"
E	1/4" DEWALT ULTRAICON+	WOOD MIN. S.G. = 0.55	1-1/2"	1"
	1/4" DEWALT TAPPER+	CONCRETE MIN. F'C = 3000 PSI	1-3/4"	1-3/4"
	1/4" DEWALT ULTRAICON+	GROUT-FILLED BLOCK PER C-90, MIN. F'C = 2000 PSI	1-3/4"	1-1/2"
	1/4" ITW TAPCON		1"	2"

*NOTE: ANCHORS MAY BE EITHER HEX HEAD OR FLAT HEAD




YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE: YHS 50 TU ALUMINUM STOREFRONT
SYSTEM - OUTSIDE GLAZED
(HVHZ) (IMPACT)
VERTICAL SECTIONS
& ANCHOR DESCRIPTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
PROFILE UPDATE	SH	07.03.24
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

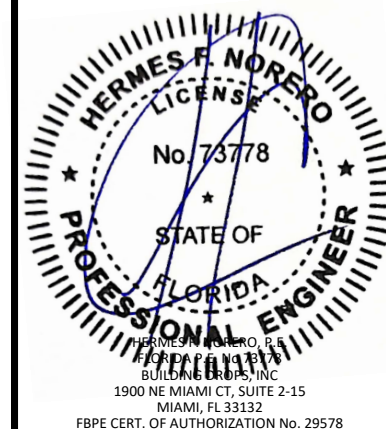

FL #:

FL14218

DATE: 10.20.15

DWG. BY:
SM

CHK. BY:
HFN

SCALE: NTS


DWG. #: YKK161

SHEET:


10

[Page 11 of 14]


c:\users\sebastianh\documents\building drops, inc\building drops, inc\projects\ykk ap america, inc\fb-26-0123 - fl14218 yns 50 tu pre-glazed storefront systems\dwgs\tu\ykk161.dwg
2/11/2026 9:23 AM
c:\users\sebastianh\documents\building drops, inc\building drops, inc\projects\ykk ap america, inc\fb-26-0123 - fl14218 yns 50 tu pre-glazed storefront systems\dwgs\tu\ykk161.dwg

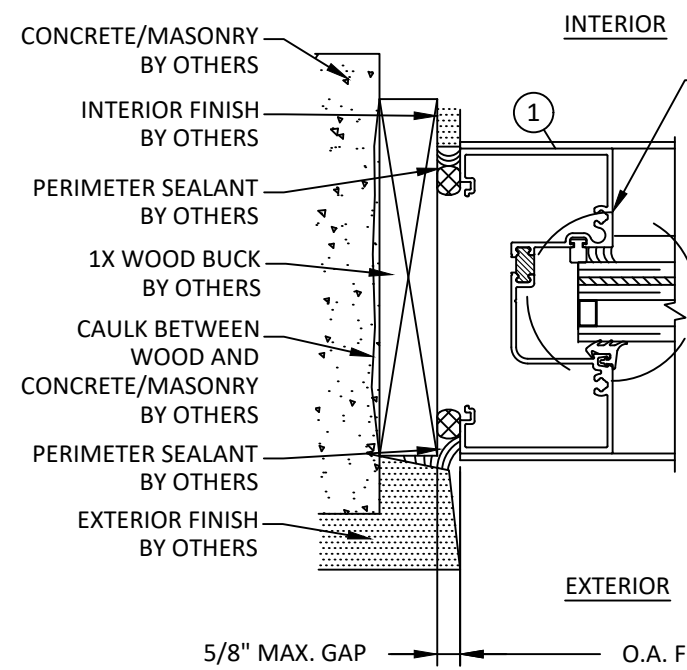

SEE GLAZING
OPTIONS
SHEETS 3 & 4

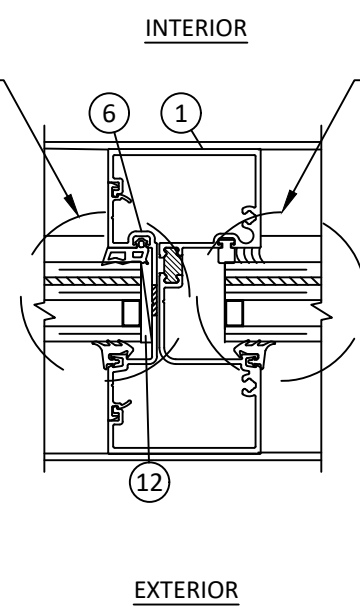


SEE GLAZING
OPTIONS
SHEETS 3 & 4

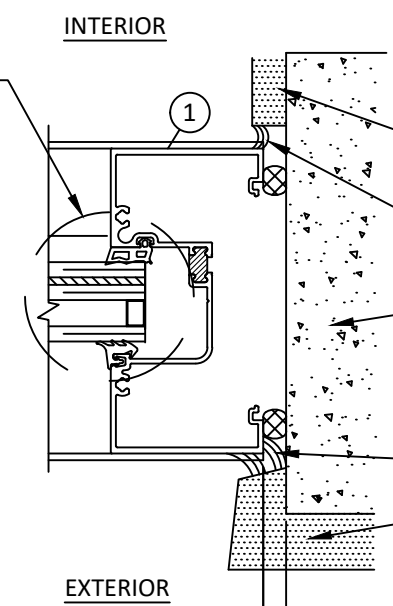

INTERIOR FINISH
BY OTHERS
PERIMETER SEALANT
BY OTHERS
CONCRETE/MASONRY
BY OTHERS
PERIMETER SEALANT
BY OTHERS
EXTERIOR FINISH
BY OTHERS

SEE GLAZING
OPTIONS
SHEETS 3 & 4

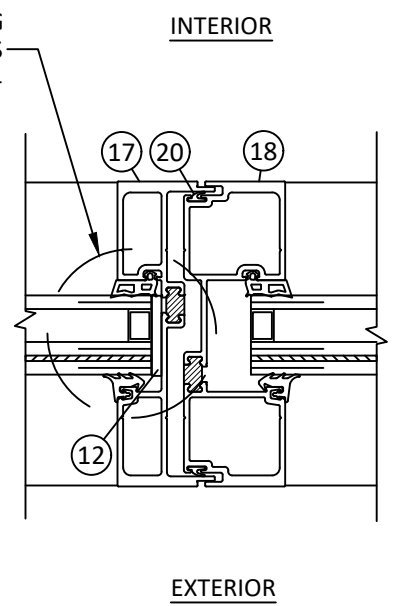


F **HORIZONTAL SECTION**
11 JAMB - CONCRETE/MASONRY W/ 1X BUCK
STANDARD CONFIGURATION


G **HORIZONTAL SECTION**
11 VERTICAL MULLION
STANDARD CONFIGURATION

H **HORIZONTAL SECTION**
11 JAMB - DIRECT TO CONCRETE/MASONRY
STANDARD CONFIGURATION


I **HORIZONTAL SECTION**
11 VERTICAL EXPANSION MULLION

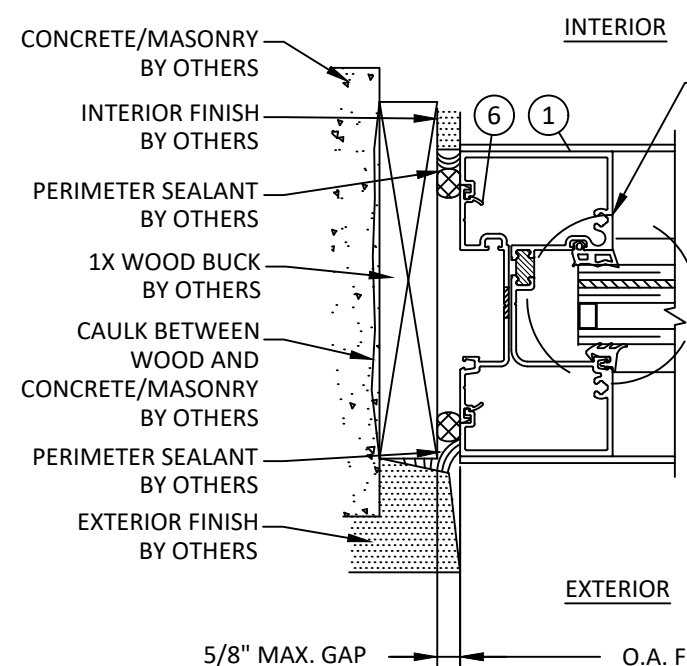

SEE GLAZING
OPTIONS
SHEETS 3 & 4

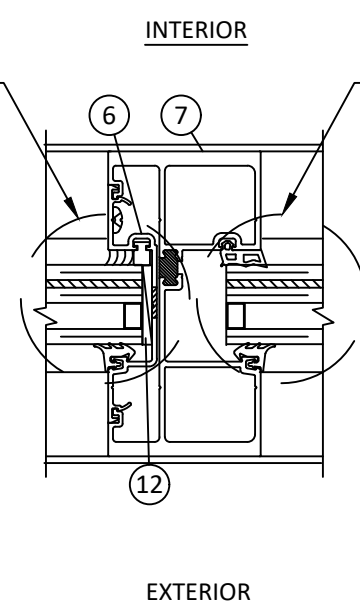


SEE GLAZING
OPTIONS
SHEETS 3 & 4

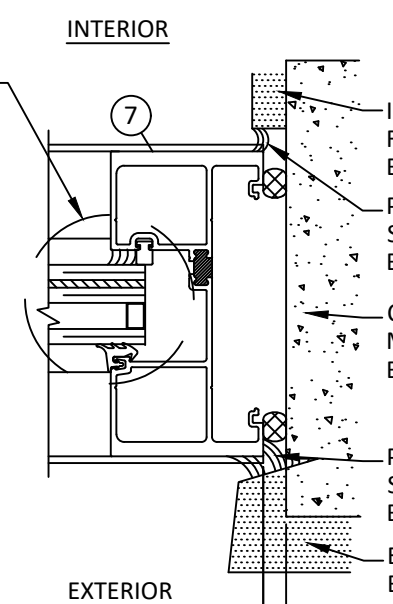

INTERIOR FINISH
BY OTHERS
PERIMETER SEALANT
BY OTHERS
CONCRETE OR
MASONRY
BY OTHERS
PERIMETER SEALANT
BY OTHERS
EXTERIOR FINISH
BY OTHERS

SEE GLAZING
OPTIONS
SHEETS 3 & 4

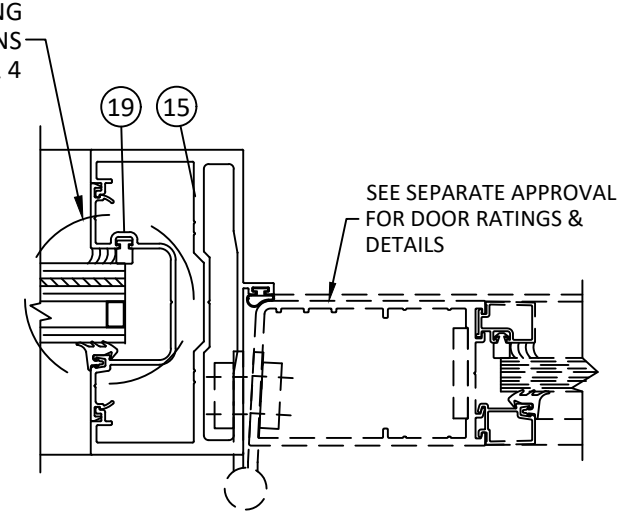

J **HORIZONTAL SECTION**
11 JAMB - CONCRETE/MASONRY W/ 1X BUCK
HEAVY CONFIGURATION

K **HORIZONTAL SECTION**
11 VERTICAL MULLION
HEAVY CONFIGURATION

L **HORIZONTAL SECTION**
11 JAMB - DIRECT TO CONCRETE/MASONRY
HEAVY CONFIGURATION

M **HORIZONTAL SECTION**
11 DOOR JAMB MULLION

YKK
ap Quality
inspires™

YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE: YHS 50 TU ALUMINUM STOREFRONT
SYSTEM - OUTSIDE GLAZED
(HVHZ) (IMPACT)

HORIZONTAL SECTIONS

PREPARED BY: **BUILDING DROPS, INC.**
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

B.D.
BUILDING DROPS

REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
PROFILE UPDATE	SH	07.03.24
ANCHOR UPDATE	SH	02.11.26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO
LICENSE
No. 73778
STATE OF
FLORIDA
PROFESSIONAL ENGINEER


HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL14218
DATE:	10.20.15
DWG. BY:	SM
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK161
SHEET:	11


ITEM	PART NO.	DESCRIPTION	MATERIAL
1	BE9-0681	HEAD / JAMB / VERTICAL	6063-T5
2	BE9-0683	HORIZONTAL	6063-T5
3	BE9-0682	SILL	6063-T5
4	E1-1060	ANCHOR FILLER	6063-T5
5	BE9-0687	SILL FLASHING	6063-T5
6	BE9-0655	SHALLOW POCKET FILLER	6063-T5
7	BE9-0684	HEAVY DUTY VERTICAL	6063-T5
8	E9-0658	GLASS STOP	6063-T5
9	E2-0083	EXTERIOR GLAZING GASKET	EPDM
10	E2-0088	INTERIOR GLAZING GASKET	EPDM
11	E2-0095	SETTING BLOCK	EPDM (85±5)
12	E2-0096	SIDE BLOCK	EPDM
13	PC-1220	#12 x 1-1/4" PHSMS Type AB	ZINC PLATED STEEL
14	PC-1424	#14 x 1-1/2" PHSMS Type AB	ZINC PLATED STEEL
15	E9-0504	DOOR JAMB O/P	6063-T6
16	E2-0084	INTERIOR SILICONE SPACER	SILICONE
17	BE9-0634	EXPANSION MULLION (MALE)	6063-T5
18	BE9-0635	EXPANSION MULLION (FEMALE)	6063-T5
19	E9-0656	DEEP POCKET FILLER	6063-T5
20	E2-0065	WEATHERING GASKET	EPDM
21	E1-1062	STEEL CHANNEL (1-1/2" X 4-1/2" X 3/16")	A36 STEEL

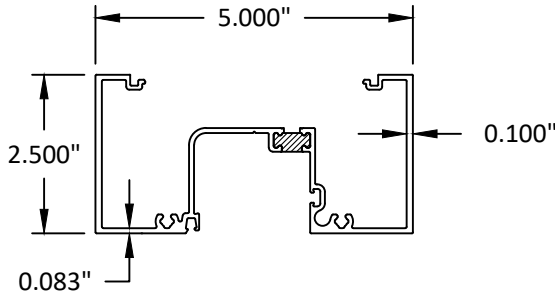


1 HEAD/JAMB/VERTICAL

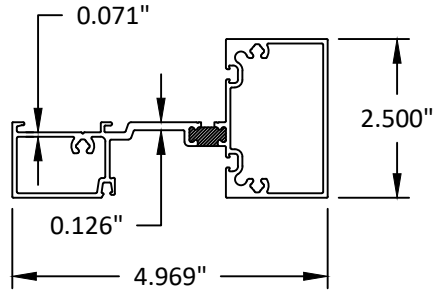


2 HORIZONTAL

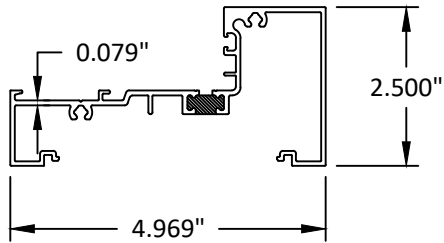


3 SILL

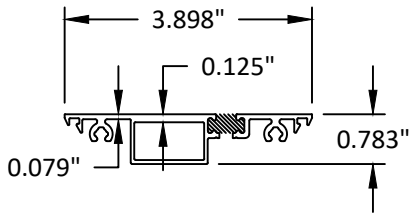


4 ANCHOR FILLER

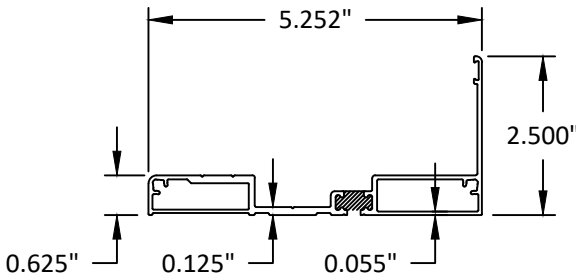


5 SILL FLASHING




6 SHALLOW POCKET FILLER

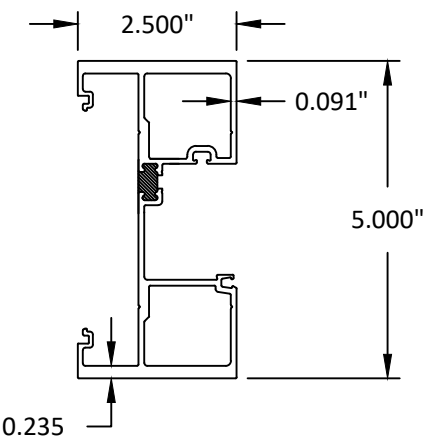


7 HEAVY DUTY VERTICAL



8 GLASS STOP

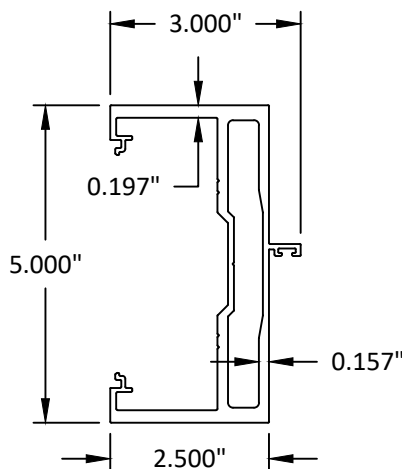

15 DOOR MULLION O/P

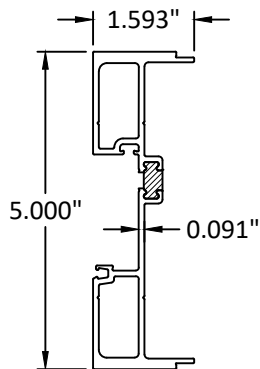

17 EXPANSION MULLION (MALE)



YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
YHS 50 TU ALUMINUM STOREFRONT
SYSTEM - OUTSIDE GLAZED
(HVHZ) (IMPACT)

COMPONENTS & BILL OF MATERIALS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15

MIAMI, FL 33132

PH: (954) 399-8478


FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
PROFILE UPDATE	SH	07.03.24
ANCHOR UPDATE	SH	02.11.26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

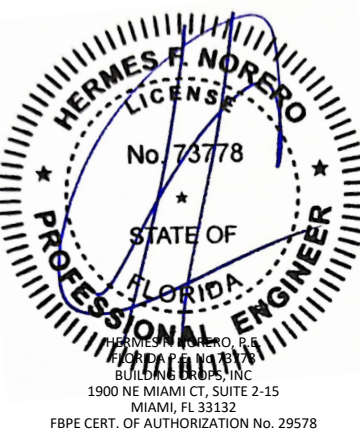


FL #:	FL14218
DATE:	10.20.15
DWG. BY:	CHK. BY:
SM	HFN
SCALE:	NTS
DWG. #:	YKK161
SHEET:	

12


c:\users\sebastianherrerros\building drops, inc\building drops, inc\building drops, inc\projects\ykk ap america, inc\fbc-26-012.3 - fl14218 yns 50 tu pre-glazed storefront systems\dwgs\tu\ykk161.dwg 2/11/2026 9:23 AM

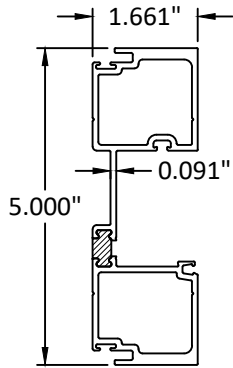

18 EXPANSION MULLION (FEMALE)

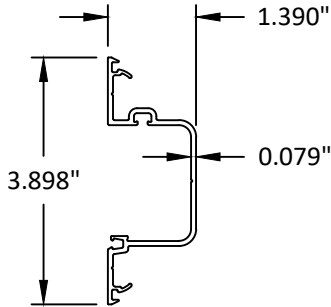

19 DEEP POCKET FILLER

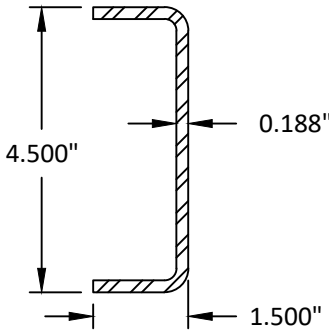

21 DOOR MULLION REINFORCEMENT



Quality
inspires™

YKK AP AMERICA, INC.

101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000


TITLE:
YHS 50 TU ALUMINUM STOREFRONT
SYSTEM - OUTSIDE GLAZED
(HVHZ) (IMPACT)
COMPONENTS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
PROFILE UPDATE	SH	07.03.24
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

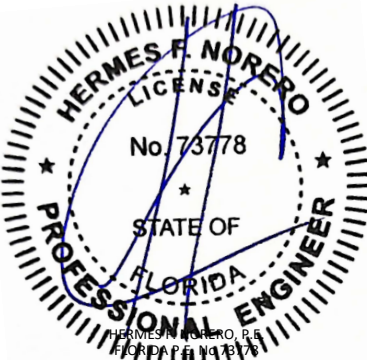

HERMES F. NORERO, P.E.

BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132

FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL14218

DATE:

10.20.15

DWG. BY:

CHK. BY:

SM

HFN

SCALE:

NTS

DWG. #:

YKK161

SHEET:

13

[Page 14 of 14]