

c:\users\sebastian\hereros\building drops, inc\building drops\ykk ap america, inc\fbc-26-0123 - fl14218 yhs 50 tu pre-glazed storefront systems\dwgs\fs\ykk168.dwg 2/11/2026 8:33 AM

YKK AP AMERICA, INC.

YHS 50 FS ALUMINUM STOREFRONT SYSTEM - INSIDE GLAZED (WZ3) (IMPACT)

INSTALLATION NOTES:

- SEE SHEET 14 FOR ANCHOR TYPE REQUIREMENTS, MINIMUM EMBEDMENTS, AND MINIMUM EDGE DISTANCES. ALL ANCHOR REQUIREMENTS MUST BE ADHERED TO. ANY DEVIATIONS FROM ANCHOR REQUIREMENTS REQUIRES SEPARATE EVALUATION AND APPROVAL.
- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - CONCRETE -MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
 - MASONRY - CMU UNIT STRENGTH CONFORMS TO ASTM C-90, WITH MIN. COMPRESSIVE STRENGTH OF 2000 PSI AND GROUT CONFORMS TO ASTM C 476, MIN. GROUT COMPRESSIVE STRENGTH OF 2000 PSI.
 - STEEL - MINIMUM YIELD STRENGTH OF 36 KSI. MINIMUM 12 GA. WALL THICKNESS.
 - STEEL - MINIMUM YIELD STRENGTH OF 36 KSI. MINIMUM 12 GA. WALL THICKNESS.
 - ALUMINUM - MINIMUM 1/8 INCH THICK 6063-T5 ALUMINUM.

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
 - AAMA 501-15
 - ASTM E1886-13a
 - ASTM E1996-17
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE IN WIND ZONES 3 OR LESS. SEE SHEETS 3 & 4 FOR LMI AND SMI GLASS TYPES.
- STOREFRONT FRAME MATERIAL: ALUMINUM 6063-T5
- ALL STRUCTURAL MATERIALS & DISSIMILAR METALS SHALL BE PROTECTED, TREATED, PAINTED, COATED, AND/OR ISOLATED AS REQUIRED IN THE APPLICABLE SECTIONS OF THE CURRENT FLORIDA BUILDING CODE AND REFERENCED DESIGN SPECIFICATIONS.
- GLASS SHALL MEET THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEETS 3 & 4 FOR GLAZING DETAILS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	ELEVATION & ANCHOR LAYOUT
3	SMI GLAZING DETAILS
4	LMI GLAZING DETAILS
5	LIGHT MULLION TABLES
6	MEDIUM MULLION TABLES
7	HEAVY MULLION TABLES
8	HEAVY MULLION TABLES S.M.I. ONLY
9	CORNER MULLION TABLES
10	TYPE A & B ANCHOR TABLES
11	TYPE C & D ANCHOR TABLES
11A	TYPE E ANCHOR TABLES
12	DOOR MULLION TABLE
13	DOOR MULLION TABLES (1)
14	VERTICAL SECTIONS & ANCHOR DESCRIPTIONS
15	HORIZONTAL SECTIONS
16	HORIZONTAL SECTIONS
17	COMPONENTS & BILL OF MATERIALS
18	COMPONENTS

INSTRUCTIONS FOR USE:

- DETERMINE DESIGN WIND LOAD REQUIREMENTS BASED ON WIND VELOCITY, BLDG, HEIGHT, WIND ZONE USING APPLICABLE ASCE 7 STANDARD.
- SEE CHARTS ON SHEETS 3 & 4 FOR DESIGN LOAD CAPACITY OF DESIRED GLASS SIZE.
- CHECK MULLION CAPACITY FOR A GIVEN SPACING AND HEIGHT USING CHARTS ON SHEET 5, 6, 7, 8, & 9 FOR STORE FRONT MULLION AND SHEETS 12 & 13 FOR DOOR MULLION, THE CAPACITY SHOULD EXCEED THE DESIGN LOAD.
- USING CHART ON SHEET 10, 11, & 11A SELECT ANCHOR OPTION WITH DESIGN RATING MORE THAN DESIGN LOAD SPECIFIED IN STEP 1 ABOVE.
- THE LOWEST VALUE RESULTING FROM STEP 2, 3 AND 4 SHALL APPLY TO ENTIRE SYSTEM.



Quality
inspires™


YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
YHS 50 FS IG ALUMINUM STOREFRONT
SYSTEM - INSIDE GLAZED
(WZ3) (IMPACT)

INSTALLATION & GENERAL NOTES


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

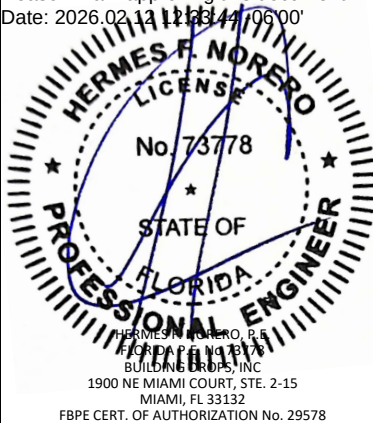

REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
ANCHOR UPDATE	SH	02.11.26
THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.		
Digitally signed by Hermes F. Norero, P.E. Reason: I am approving this document Date: 2026.02.11 11:34:19 -0500		
		
HERMES F. NORERO, P.E. BUILDING DROPS, INC. 1900 NE MIAMI COURT, STE. 2-15 MIAMI, FL 33132 FBPE CERT. OF AUTHORIZATION No. 29578		
FL #: FL14218		
DATE: 01.27.16		
DWG. BY: SM	CHK. BY: HFN	
SCALE: NTS		
DWG. #: YKK168		
SHEET: 1		


[Page 1 of 19]

c:\users\sebastianhereros\building drops, inc\building drops, inc\projects\ykh 50 tu pre-glazed storefront systems\dwgs\ykh168.dwg
2/11/2026 8:33 AM
c:\users\sebastianhereros\building drops, inc\building drops, inc\projects\ykh 50 tu pre-glazed storefront systems\dwgs\ykh168.dwg

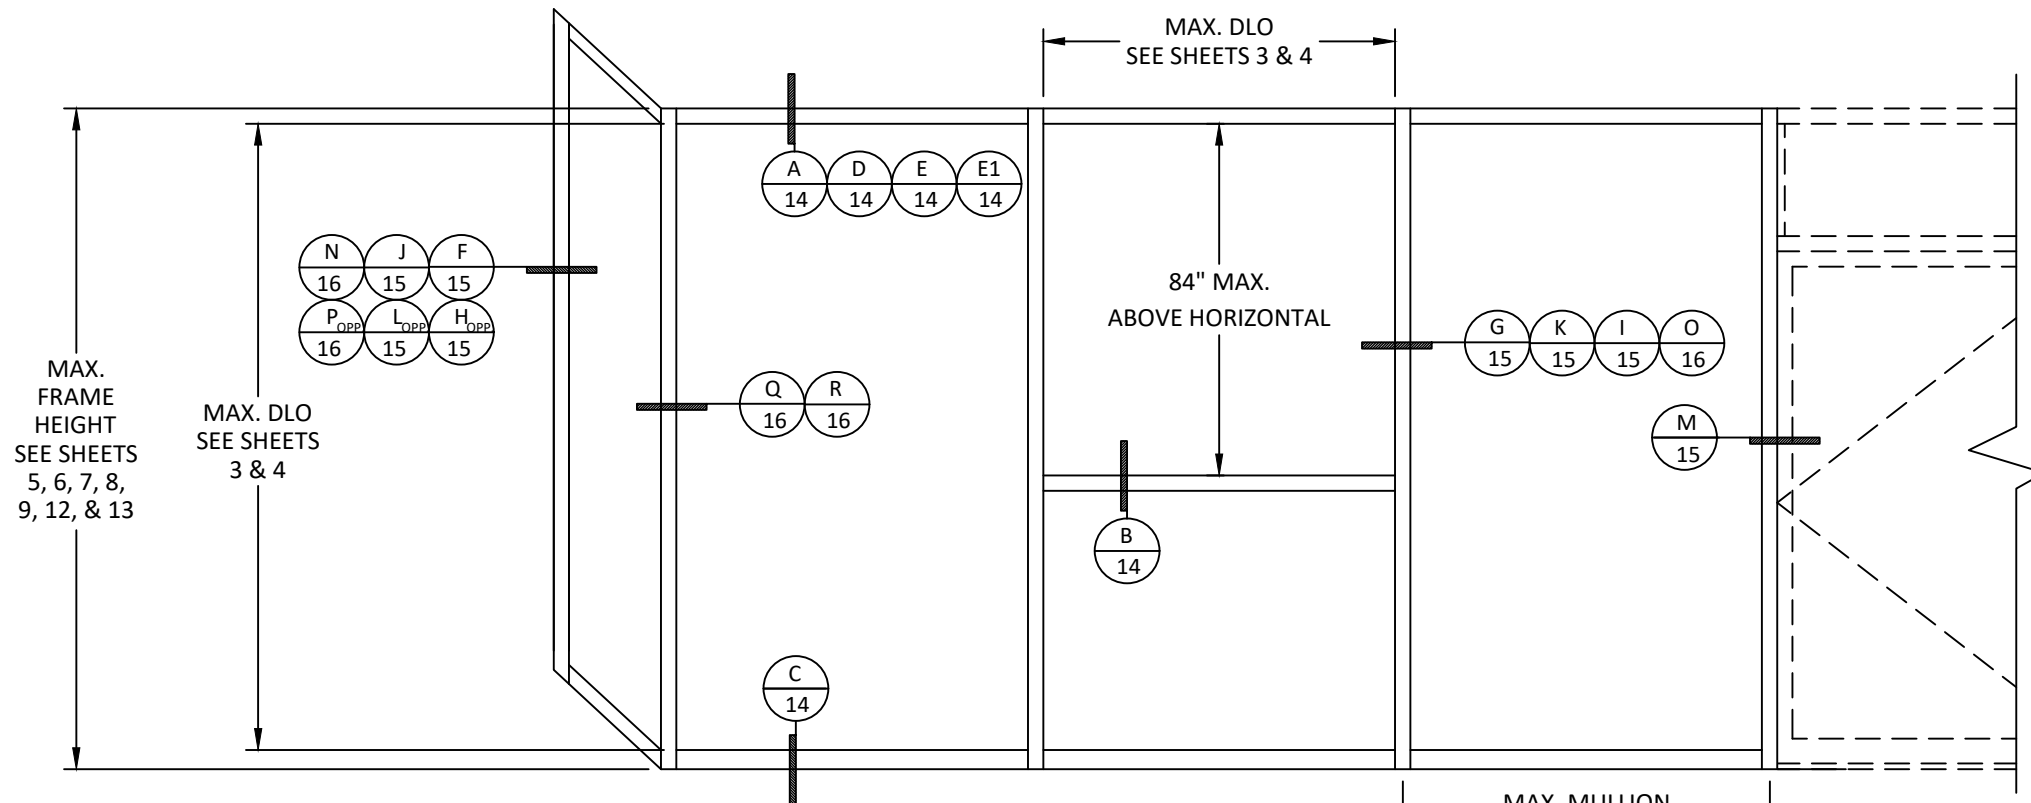

ELEVATION
TYPICAL YHS 50 FS STOREFRONT

SEE SEPARATE DOOR APPROVAL FOR DOOR RATING & DETAILS.
LOWER DESIGN PRESSURE FROM STOREFRONT OR DOOR APPROVAL WILL APPLY TO ENTIRE SYSTEM.

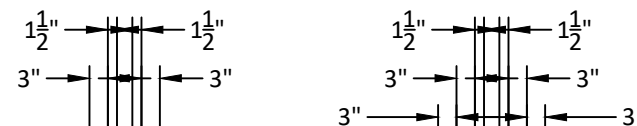

5 1/2" MAX.
FROM
CORNERS*


SEE TABLE
BELOW*

JAMB ANCHOR SPACING*		
ANCHOR TYPE	MAX. SPACING	MAX. DP
A OR B	18.75"	65 PSF
C, E OR D	13"	
A OR B	13.5"	90 PSF
C, E OR D	9.375"	


*NOTE: JAMB ANCHORS ARE ONLY REQUIRED WHEN USING "HEAVY" JAMB CONFIGURATIONS, SEE SHEETS 15 AND 16 FOR JAMB DETAILS

TYPICAL ANCHOR LAYOUT

FOR DOOR ADJACENT
MULLION ANCHOR
REQUIREMENTS SEE
SHEETS 10 & 11

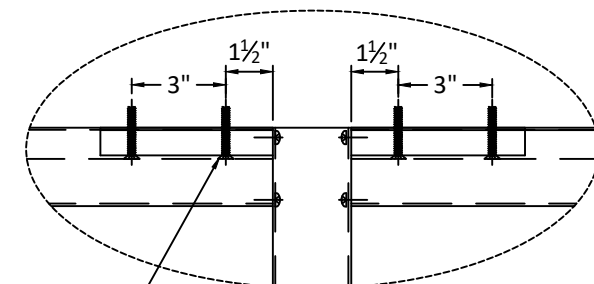

ANCHORS, TYPE A, B, C, D OR E
SEE SHEETS 10, 11, & 11A FOR QUANTITIES
AND SHEET 14 FOR DESCRIPTION

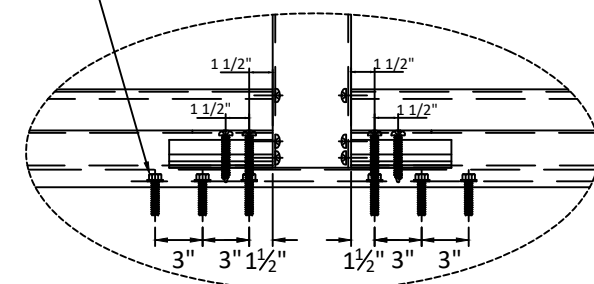

ANCHORS, TYPE A, B, C, D OR E
SEE SHEETS 10, 11, & 11A FOR QUANTITIES
AND SHEET 14 FOR DESCRIPTION



YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000


TITLE:
YHS 50 FS IG ALUMINUM STOREFRONT
SYSTEM - INSIDE GLAZED
(WZ3) (IMPACT)
ELEVATION &
ANCHOR LAYOUT

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

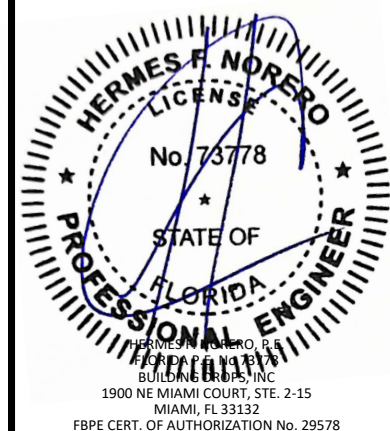

FL #:

FL14218

DATE: **01.27.16**

DWG. BY:
SM

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **YKK168**

SHEET:

2

GLASS TYPES
SMALL MISSILE IMPACT ONLY

GLASS LOAD CAPACITY (PSF)			GLASS LOAD CAPACITY (PSF)			GLASS LOAD CAPACITY (PSF)		
DAYLIGHT OPENING (IN)		GLASS TYPE A OR B	DAYLIGHT OPENING (IN)		GLASS TYPE A OR B	DAYLIGHT OPENING (IN)		GLASS TYPE A OR B
DLO WIDTH	DLO HEIGHT	EXT. (+) INT. (-)	DLO WIDTH	DLO HEIGHT	EXT. (+) INT. (-)	DLO WIDTH	DLO HEIGHT	EXT. (+) INT. (-)
27.5	54.375	90.0	27.5	78.375	90.0	27.5	102.375	90.0
33.5		90.0	33.5		90.0	33.5		90.0
39.5		90.0	39.5		90.0	39.5		90.0
45.5		90.0	45.5		90.0	45.5		90.0
51.5		90.0	51.5		90.0	51.5		90.0
57.5		90.0	57.5		90.0	57.5		90.0
63.5		90.0	63.5		81.5	63.5		81.5
69.5		90.0	69.5		74.5	27.5		108.375
27.5	60.375	90.0	27.5	90.0	33.5	90.0		
33.5		90.0	33.5	90.0	39.5	90.0		
39.5		90.0	39.5	90.0	45.5	90.0		
45.5		90.0	45.5	90.0	51.5	90.0		
51.5		90.0	51.5	90.0	57.5	90.0		
57.5		90.0	57.5	90.0	60.5	85.5		
63.5		90.0	63.5	81.5	27.5	114.375	90.0	
69.5		90.0	69.5	74.5	33.5		90.0	
27.5	66.375	90.0	27.5	90.0	39.5		90.0	
33.5		90.0	33.5	90.0	45.5		90.0	
39.5		90.0	39.5	90.0	51.5		90.0	
45.5		90.0	45.5	90.0	57.5		90.0	
51.5		90.0	51.5	90.0	27.5		120.375	90.0
57.5		90.0	57.5	90.0	33.5			90.0
63.5		81.5	63.5	81.5	38.5	90.0		
69.5		81.6	69.5	74.5	27.5	126.375		90.0
27.5	72.375	90.0	27.5	90.0	33.5		90.0	
33.5		90.0	33.5	90.0	36.5		90.0	
39.5		90.0	39.5	90.0	27.5		132.375	90.0
45.5		90.0	45.5	90.0	33.5	90.0		
51.5		90.0	51.5	90.0	34.5	90.0		
57.5		90.0	57.5	90.0	27.5	138.375		90.0
63.5		81.5	63.5	81.5	33.5		90.0	
69.5		74.5	66.5	77.8				


GLASS TYPES
LARGE & SMALL MISSILE IMPACT

GLASS LOAD CAPACITY (PSF)			GLASS LOAD CAPACITY (PSF)			GLASS LOAD CAPACITY (PSF)		
DAYLIGHT OPENING (IN)		GLASS TYPE C	DAYLIGHT OPENING (IN)		GLASS TYPE C	DAYLIGHT OPENING (IN)		GLASS TYPE C
DLO WIDTH	DLO HEIGHT	EXT. (+) INT. (-)	DLO WIDTH	DLO HEIGHT	EXT. (+) INT. (-)	DLO WIDTH	DLO HEIGHT	"EXT. (+) INT. (-)"
27.5	54.375	70.0	27.5	78.375	70.0	27.5	102.375	70.0
33.5		70.0	33.5		70.0	33.5		70.0
39.5		70.0	39.5		70.0	39.5		70.0
45.5		70.0	45.5		70.0	45.5		70.0
51.5		70.0	51.5		70.0	51.5		70.0
57.5		70.0	57.5		70.0	57.5		70.0
63.5	60.375	70.0	63.5	84.375	63.4	63.5	108.375	58.9
69.5		68.4	69.5		57.9	69.5		70.0
27.5		70.0	27.5		70.0	27.5		70.0
33.5		70.0	33.5		70.0	33.5		70.0
39.5		70.0	39.5		70.0	39.5		70.0
45.5		70.0	45.5		70.0	45.5		70.0
51.5	66.375	70.0	51.5	90.375	70.0	51.5	114.375	70.0
57.5		70.0	57.5		70.0	57.5		65.0
63.5		70.0	63.5		63.4	63.5		70.0
69.5		70.0	69.5		57.9	69.5		70.0
27.5		70.0	27.5		70.0	27.5		70.0
33.5		70.0	33.5		70.0	33.5		70.0
39.5	72.375	70.0	39.5	90.375	70.0	39.5	120.375	70.0
45.5		70.0	45.5		70.0	45.5		65.0
51.5		70.0	51.5		70.0	51.5		65.0
57.5		70.0	57.5		70.0	57.5		70.0
63.5		63.4	63.5		63.4	63.5		70.0
69.5		57.9	69.5		53.8	69.5		70.0
27.5		70.0	27.5	90.375	70.0	27.5	126.375	70.0
33.5		70.0	33.5		70.0	33.5		70.0
39.5		70.0	39.5		70.0	39.5		70.0
45.5		70.0	45.5		70.0	45.5		70.0
51.5		70.0	51.5		70.0	51.5		70.0
57.5		70.0	57.5		70.0	57.5		70.0
63.5		63.4	63.5		58.9	63.5	132.375	70.0
69.5		57.9	69.5		56.2	69.5		70.0
						33.5	138.375	70.0


DAYLITE OPENING DIMENSIONS:
DAYLITE OPENING WIDTH:
• NOMINAL PANEL WIDTH - 2.500"
DAYLITE OPENING HEIGHT:
• FRAME HEIGHT - 5.625"

- * NOTE:
- GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300 (3 SEC. GUSTS) AND CHAPTER 17 OF THE CURRENT FBC FOR SIZES OTHER THAN TESTED.
 - SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN CHAPTER 24.
 - SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER CHAPTER 24.
 - D.L.O. MAY NOT EXCEED MAX DIMENSIONS IN GLASS CHARTS FOR GLASS TYPE.

9/16" O.A. LAMINATED GLASS
CONSISTING OF:
1/4" HEAT STRENGTHENED GLASS,
0.090" SENTRYGLAS BY KURARAY,
FORMERLY KNOWN AS SGP BY DUPONT,
1/4" HEAT STRENGTHENED GLASS

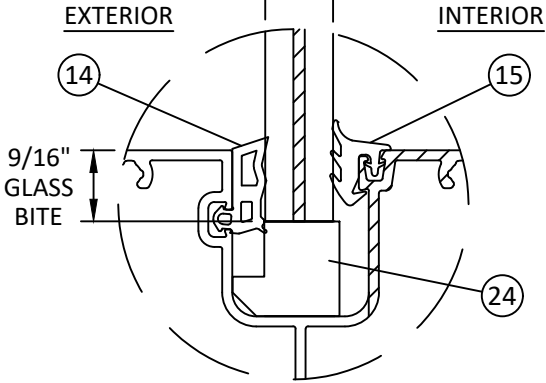

GLAZING DETAIL C
(DRY GLAZED)

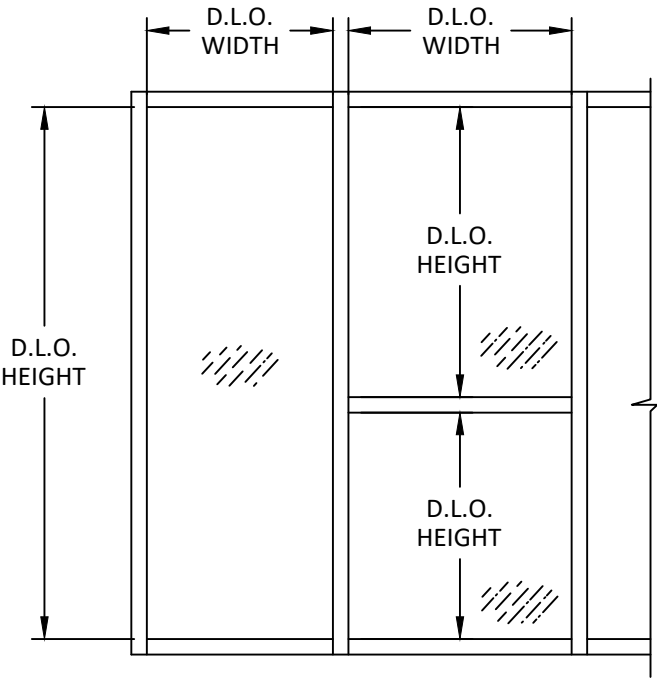

YKK
ap

Quality
inspires™

YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
YHS 50 FS IG ALUMINUM STOREFRONT
SYSTEM - INSIDE GLAZED
(WZ3) (IMPACT)

L.M.I. & S.M.I. GLAZING DETAILS

PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL14218

DATE:
01.27.16

DWG. BY:
SM

CHK. BY:
HFN

SCALE:
NTS

DWG. #:
YKK168

SHEET:


c:\users\sebastianherrerero\building drops - common\projects\ykk ap america, inc\fbc-26-0123 - fl14218 yhs 50 tu pre-glazed storefront systems\dwgs\6.ykk168.dwg 2/11/2026 8:33 AM

MULLION LOAD TABLES

LIGHT CONFIGURATION


DESIGN LOAD CAPACITY - PSF			
NOMINAL DIMS.		LIGHT JAMB - J1	LIGHT MULLION - M1
WIDTH (W)	FRAME HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)
30	72	50.0	50.0
33		50.0	50.0
36		50.0	50.0
39		50.0	50.0
42		50.0	50.0
45		50.0	50.0
48		50.0	50.0
51		50.0	50.0
54		50.0	50.0
57		50.0	50.0
60		50.0	50.0
63		50.0	50.0
66	78	50.0	50.0
69		50.0	50.0
72		50.0	50.0
30		50.0	50.0
33		50.0	50.0
36		50.0	50.0
39		50.0	50.0
42		50.0	50.0
45		50.0	50.0
48		50.0	50.0
51		50.0	50.0
54		50.0	50.0
57		50.0	50.0
60		50.0	50.0
63	84	50.0	50.0
30		50.0	50.0
33		50.0	50.0
36		50.0	50.0
39		50.0	50.0
42		50.0	50.0
45		50.0	50.0
48		50.0	50.0
51		50.0	50.0
54		50.0	50.0
57		50.0	50.0
60		50.0	50.0

DESIGN LOAD CAPACITY - PSF			
NOMINAL DIMS.		LIGHT JAMB - J1	LIGHT MULLION - M1
WIDTH (W)	FRAME HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)
30	90	50.0	50.0
33		50.0	50.0
36		50.0	50.0
39		50.0	50.0
42		50.0	50.0
45		50.0	50.0
48		50.0	50.0
51		50.0	50.0
54		50.0	50.0
57	96	50.0	47.6
30		50.0	50.0
33		50.0	50.0
36		50.0	50.0
39		50.0	50.0
42		50.0	50.0
45		50.0	50.0
48		50.0	49.7
51	102	50.0	46.8
54		50.0	44.2
30		50.0	50.0
33		50.0	50.0
36		50.0	50.0
39		50.0	50.0
42		50.0	50.0
45		50.0	47.0
48	108	50.0	44.0
51		50.0	41.5
30		50.0	50.0
33		50.0	50.0
36		50.0	50.0
39		50.0	48.4
42		50.0	44.9
45		50.0	41.9
48		50.0	39.3

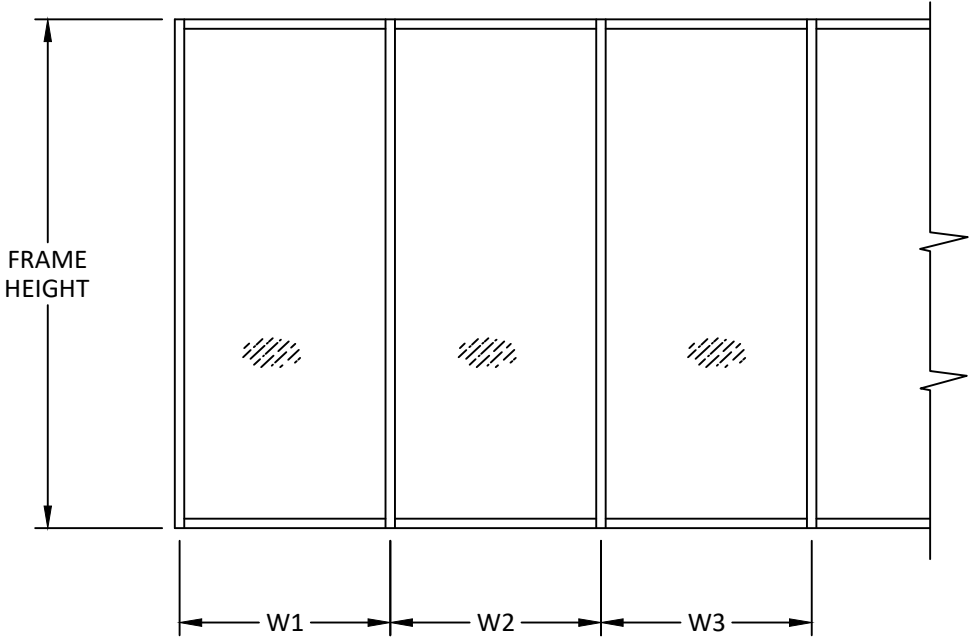

WIDTH (W) = W1 (JAMB)

WIDTH (W) = $\frac{W2 + W3}{2}$ (MULLION)

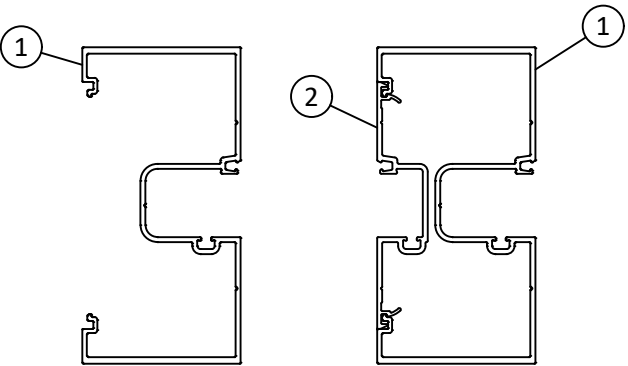

LIGHT JAMB - J1 LIGHT MULLION - M1

LIGHT CONFIGURATION



YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000


TITLE:
YHS 50 FS IG ALUMINUM STOREFRONT
SYSTEM - INSIDE GLAZED
(WZ3) (IMPACT)
LIGHT MULL TABLES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

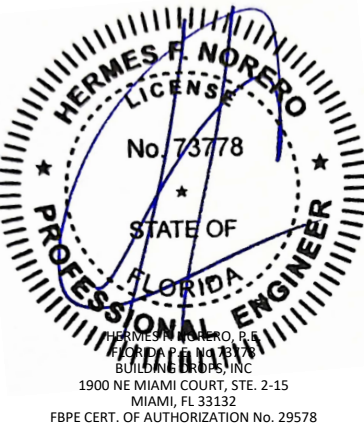

FL #:
FL14218

DATE: **01.27.16**

DWG. BY: SM	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**

DWG. #: **YKK168**

SHEET:
5


[Page 5 of 19]

c:\users\sebastianherrerros\building drops, inc\building drops, inc\projects\ykk ap america, inc\fb-2 6-0123 - fl14218 yhs 50 tu pre-glazed storefront systems\dwgs\ykk168.dwg 2/11/2026 8:33 AM

MULLION LOAD TABLES
MEDIUM CONFIGURATION


DESIGN LOAD CAPACITY - PSF				
NOMINAL DIMS.		MEDIUM JAMB - J2	MEDIUM JAMB - J3	MEDIUM MULLION - M2
WIDTH (W)	FRAME HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
30	72	70.0	70.0	70.0
33		70.0	70.0	70.0
36		70.0	70.0	70.0
39		70.0	70.0	70.0
42		70.0	70.0	70.0
45		70.0	70.0	70.0
48		70.0	70.0	70.0
51		70.0	70.0	70.0
54		70.0	70.0	70.0
57		70.0	70.0	70.0
60		70.0	70.0	70.0
63		70.0	70.0	70.0
66		70.0	70.0	70.0
69		70.0	70.0	70.0
72		70.0	70.0	70.0
30	78	70.0	70.0	70.0
33		70.0	70.0	70.0
36		70.0	70.0	70.0
39		70.0	70.0	70.0
42		70.0	70.0	70.0
45		70.0	70.0	70.0
48		70.0	70.0	70.0
51		70.0	70.0	70.0
54		70.0	70.0	70.0
57		70.0	70.0	70.0
60		70.0	70.0	70.0
63		70.0	70.0	70.0
66		70.0	70.0	70.0
69		70.0	70.0	70.0
72		70.0	70.0	70.0
30	84	70.0	70.0	70.0
33		70.0	70.0	70.0
36		70.0	70.0	70.0
39		70.0	70.0	70.0
42		70.0	70.0	70.0
45		70.0	70.0	70.0
48		70.0	70.0	70.0
51		70.0	70.0	70.0
54		70.0	70.0	70.0
57		70.0	70.0	70.0
60		70.0	70.0	70.0
63		70.0	70.0	70.0
66		70.0	70.0	70.0
69		70.0	70.0	70.0
72		70.0	70.0	70.0

DESIGN LOAD CAPACITY - PSF				
NOMINAL DIMS.		MEDIUM JAMB - J2	MEDIUM JAMB - J3	MEDIUM MULLION - M2
WIDTH (W)	FRAME HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
30	90	70.0	70.0	70.0
33		70.0	70.0	70.0
36		70.0	70.0	70.0
39		70.0	70.0	70.0
42		70.0	70.0	70.0
45		70.0	70.0	70.0
48		70.0	70.0	70.0
51		70.0	70.0	70.0
54		70.0	70.0	70.0
57		70.0	70.0	70.0
60		70.0	70.0	70.0
63		70.0	70.0	70.0
66		70.0	70.0	69.3
69		68.7	70.0	66.3
72		65.9	70.0	63.6
30	96	70.0	70.0	70.0
33		70.0	70.0	70.0
36		70.0	70.0	70.0
39		70.0	70.0	70.0
42		70.0	70.0	70.0
45		70.0	70.0	70.0
48		70.0	70.0	70.0
51		70.0	70.0	70.0
54		70.0	70.0	70.0
57		70.0	70.0	70.0
60		69.5	70.0	67.0
63		66.1	70.0	63.8
66		63.1	70.0	60.9
30	102	70.0	70.0	70.0
33		70.0	70.0	70.0
36		70.0	70.0	70.0
39		70.0	70.0	70.0
42		70.0	70.0	70.0
45		70.0	70.0	70.0
48		70.0	70.0	70.0
51		70.0	70.0	69.9
54		68.4	70.0	66.0
57		64.8	70.0	62.5
60		61.5	70.0	59.4
63		58.6	67.1	56.5
30	108	70.0	70.0	70.0
33		70.0	70.0	70.0
36		70.0	70.0	70.0
39		70.0	70.0	70.0
42		70.0	70.0	70.0
45		70.0	70.0	70.0
48		68.6	70.0	66.2
51		64.6	70.0	62.3
54		61.0	69.8	58.8
57		57.8	66.2	55.7
60		54.9	62.9	53.0

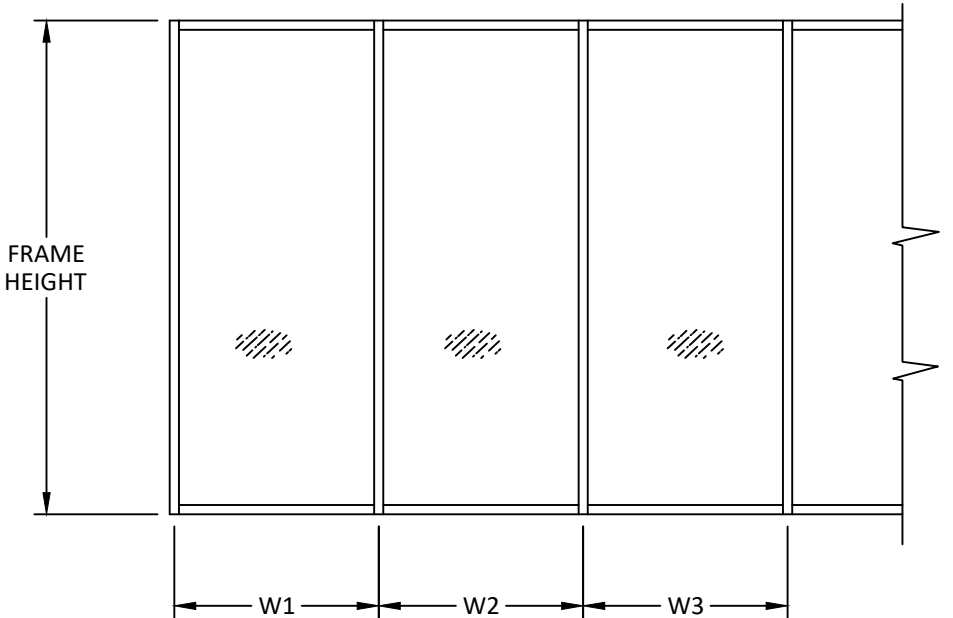


WIDTH (W) = W1 (JAMB)


WIDTH (W) = $\frac{W2 + W3}{2}$ (MULLION)

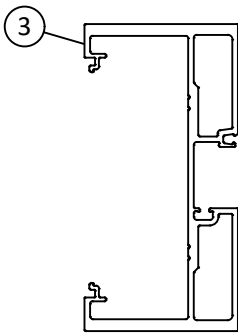

MEDIUM JAMB - J2

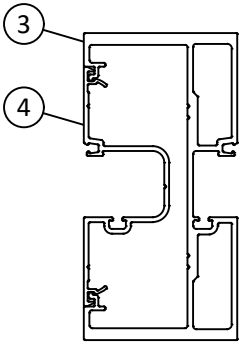

MEDIUM MULLION - M2

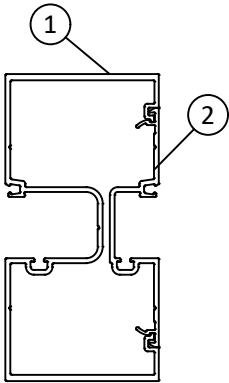

MEDIUM JAMB - J3

MEDIUM CONFIGURATION



Quality
inspires™

YKK AP AMERICA, INC.

101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000


TITLE:
YHS 50 FS IG ALUMINUM STOREFRONT
SYSTEM - INSIDE GLAZED
(WZ3) (IMPACT)
MEDIUM MULL TABLES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

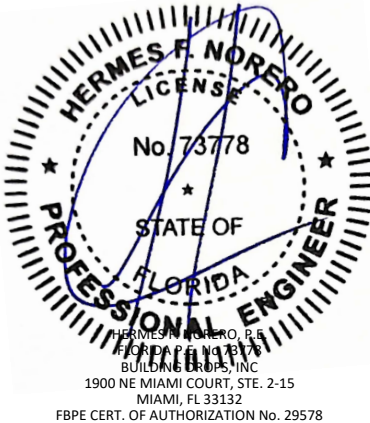

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL14218

DATE:

01.27.16

DWG. BY:

CHK. BY:

SM

HFN

SCALE:

NTS

DWG. #:

YKK168

SHEET:

6

[Page 6 of 19]


c:\users\sebastianherrerros\building drops, inc\building drops landing - common\projects\ykk ap america, inc\fbc-26-0123 - fl14218 yns 50 tu pre-glazed storefront systems\dwgs\sykk168.dwg 2/11/2026 8:33 AM

MULLION LOAD TABLES


HEAVY CONFIGURATION

DESIGN LOAD CAPACITY - PSF		
NOMINAL DIMS.		HEAVY MULLION - M3
WIDTH (W)	FRAME HEIGHT (H)	EXT. (+) INT. (-)
72	96	65.0
69	102	65.0
66	108	65.0
63	114	65.0
60	120	65.0
41	126	65.0
39	132	65.0
37	138	65.0
36	144	65.0


NOTE: HEAVY CONFIGURATION JAMBS ARE ANCHORED ALONG THEIR LENGTH AND THEREFORE DO NOT LIMIT DESIGN PRESSURE.

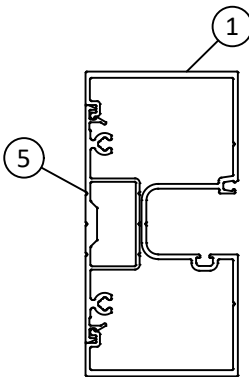

HEAVY JAMB - J4

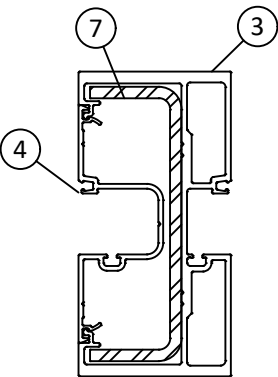


HEAVY MULLION - M3

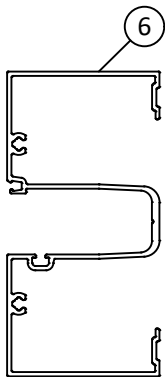

HEAVY JAMB - J5


HEAVY CONFIGURATION

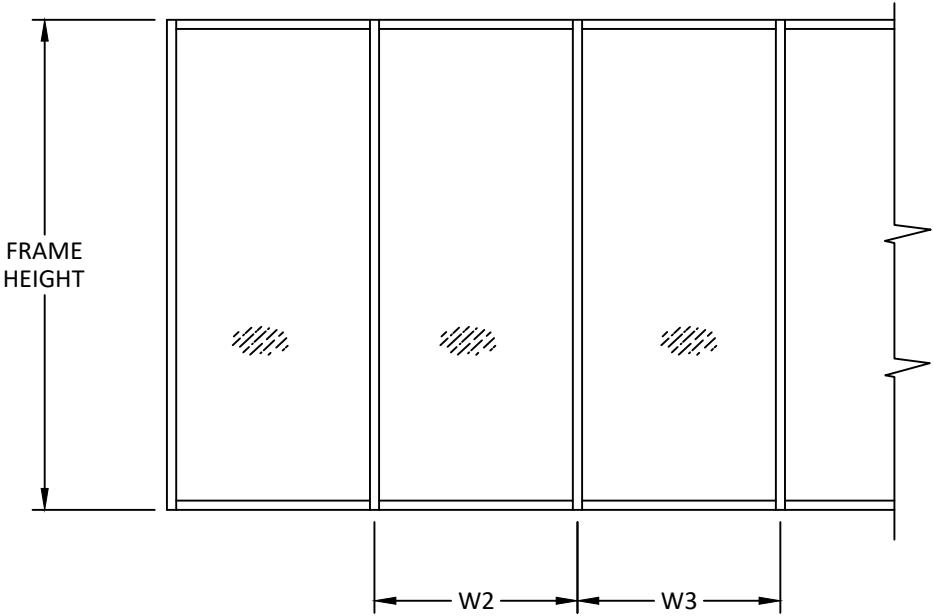

$$\text{WIDTH (W)} = \frac{W2 + W3}{2} \text{ (MULLION)}$$

DESIGN LOAD CAPACITY - PSF		
NOMINAL DIMS.		EXPANSION MULLION
WIDTH (W)	FRAME HEIGHT	EXT. (+) INT. (-)
72	96	65.0
69	102	65.0
66	108	65.0
63	114	65.0
60	120	65.0
41	126	65.0
39	132	65.0
37	138	65.0
36	144	65.0

NOTE: EXPANSION MULL MAY BE USED WITH ANY MULLION CONFIGURATION SUCH THAT ALLOWABLE SIZES AND PRESSURES ARE NOT EXCEEDED.

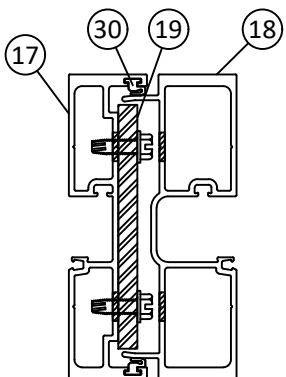

EXPANSION MULLION



Quality
inspires™

YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000


TITLE:
YHS 50 FS IG ALUMINUM STOREFRONT
SYSTEM - INSIDE GLAZED
(WZ3) (IMPACT)
HEAVY MULL TABLES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

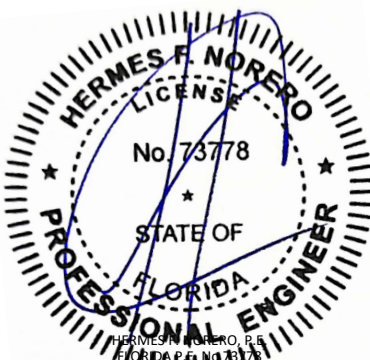

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL14218

DATE: **01.27.16**

DWG. BY:
SM

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **YKK168**

SHEET:
7

[Page 7 of 19]


c:\users\sebastianherrerros\building drops, inc\building drops landing - common\projects\ykk ap america, inc\fbc-26-0123 - fl14218 yhs 50 tu pre-glazed storefront systems\dwg\sy\ykk168.dwg 2/11/2026 8:33 AM

SMI MULLION LOAD TABLES


HEAVY CONFIGURATION FOR USE IN SMI IMPACT APPLICATIONS ONLY

DESIGN LOAD CAPACITY - PSF		
NOMINAL DIMS.		SMI HEAVY MULLION - M3
WIDTH (W)	FRAME HEIGHT	EXT. (+) INT. (-)
72	96	90.0
69	102	90.0
66	108	90.0
63	114	90.0
57	120	90.0
60		88.0
41	126	90.0
39	132	90.0
37	138	90.0
36	144	90.0


NOTE: HEAVY CONFIGURATION JAMBS ARE ANCHORED ALONG THEIR LENGTH AND THEREFORE DO NOT LIMIT DESIGN PRESSURE.

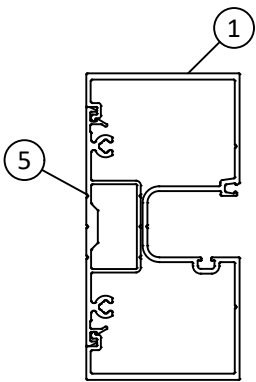

HEAVY JAMB - J4

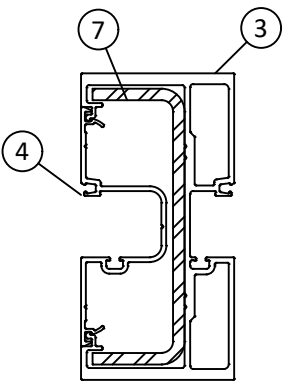


HEAVY MULLION - M3

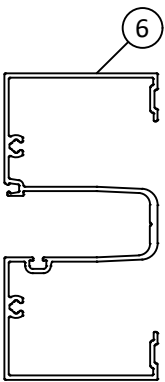

HEAVY JAMB - J5


HEAVY CONFIGURATION

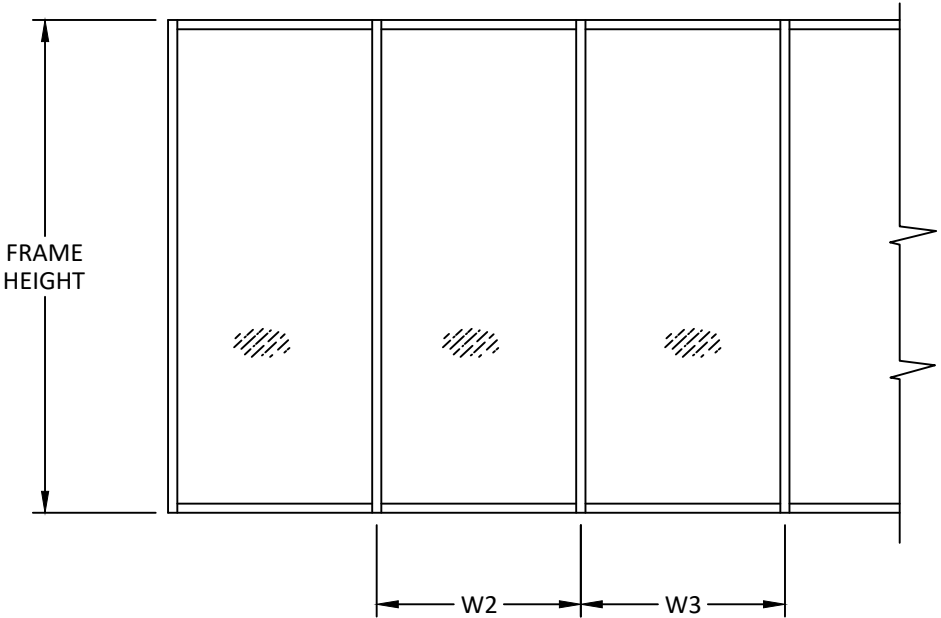

WIDTH (W) = $\frac{W2 + W3}{2}$ (MULLION)

DESIGN LOAD CAPACITY - PSF		
NOMINAL DIMS.		EXPANSION MULLION
WIDTH (W)	FRAME HEIGHT	EXT. (+) INT. (-)
72	96	65.0
69	102	65.0
66	108	65.0
63	114	65.0
60	120	65.0
41	126	65.0
39	132	65.0
37	138	65.0
36	144	65.0

NOTE: EXPANSION MULL MAY BE USED WITH ANY MULLION CONFIGURATION SUCH THAT ALLOWABLE SIZES AND PRESSURES ARE NOT EXCEEDED.

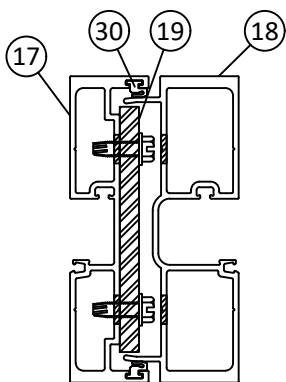

EXPANSION MULLION



Quality
inspires™

YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000


TITLE:
YHS 50 FS IG ALUMINUM STOREFRONT
SYSTEM - INSIDE GLAZED
(WZ3) (IMPACT)
SMI ONLY
HEAVY MULLION TABLES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

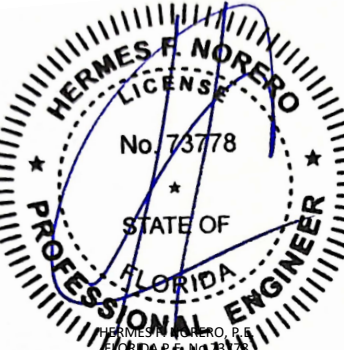

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL14218

DATE: **01.27.16**

DWG. BY:
SM

CHK. BY:
HFN

SCALE: **NTS**


DWG. #: **YKK168**

SHEET:
8

[Page 8 of 19]

CORNER MULLION LOAD TABLES

DESIGN LOAD CAPACITY - PSF				DESIGN LOAD CAPACITY - PSF				DESIGN LOAD CAPACITY - PSF			
NOMINAL DIMS.		90 DEGREE MULLION	135 DEGREE MULLION	NOMINAL DIMS.		90 DEGREE MULLION	135 DEGREE MULLION	NOMINAL DIMS.		90 DEGREE MULLION	135 DEGREE MULLION
WIDTH (W)	FRAME HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)	WIDTH (W)	FRAME HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)	WIDTH (W)	FRAME HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)
30	72	70.0	70.0	30	90	70.0	70.0	30	108	61.2	56.2
33		70.0	70.0	33		70.0	70.0	33		55.6	51.1
36		70.0	70.0	36		70.0	67.5	36		51.0	46.9
39		70.0	70.0	39		67.8	62.3	39		47.1	43.3
42		70.0	70.0	42		63.0	57.9	42		43.7	40.2
45		70.0	70.0	45		58.8	54.0	45		40.8	37.5
48		70.0	70.0	48		55.1	50.6	48		38.3	35.2
51		70.0	70.0	51		51.8	47.6	51		36.0	33.1
54		70.0	70.0	54		49.0	45.0	54		34.0	31.2
57		70.0	66.6	57		46.4	42.6	57		32.2	29.6
60		68.9	63.3	60		44.1	40.5	60		30.6	28.1
63		65.6	60.3	63		42.0	38.6	63		29.1	26.8
66	78	62.6	57.5	66	96	40.1	36.8	66	114	27.8	25.6
69		59.9	55.0	69		38.3	35.2	69		54.9	50.5
72		57.4	52.7	72		36.7	33.7	33		49.9	45.9
30		70.0	70.0	30		70.0	70.0	36		45.8	42.1
33		70.0	70.0	33		70.0	64.7	39		42.3	38.8
36		70.0	70.0	36		64.6	59.3	42		39.2	36.1
39		70.0	70.0	39		59.6	54.8	45		36.6	33.7
42		70.0	70.0	42		55.3	50.8	48		34.3	31.6
45		70.0	70.0	45		51.6	47.5	51		32.3	29.7
48		70.0	67.4	48		48.4	44.5	54		30.5	28.0
51		69.0	63.4	51		45.6	41.9	57		28.9	26.6
54		65.2	59.9	54		43.0	39.5	60		27.5	25.2
57	84	61.8	56.8	57	102	40.8	37.5	63	120	26.2	24.0
60		58.7	53.9	60		38.7	35.6	30		49.6	45.6
63		55.9	51.3	63		36.9	33.9	33		45.1	41.4
66		53.3	49.0	66		35.2	32.4	36		41.3	38.0
69		51.0	46.9	69		33.7	31.0	39		38.1	35.0
72		48.9	44.9	72		32.3	29.7	42		35.4	32.5
30		70.0	70.0	30		68.6	63.1	45		33.1	30.4
33		70.0	70.0	33		62.4	57.3	48		31.0	28.5
36		70.0	70.0	36		57.2	52.5	51		29.2	26.8
39		70.0	70.0	39		52.8	48.5	54		27.5	25.3
42		70.0	66.4	42		49.0	45.0	57		26.1	24.0
45		67.5	62.0	45		45.7	42.0	60		24.8	22.8
48	84	63.2	58.1	48	102	42.9	39.4	30	126	45.0	41.3
51		59.5	54.7	51		40.4	37.1	33		40.9	37.6
54		56.2	51.7	54		38.1	35.0	36		37.5	34.4
57		53.3	48.9	57		36.1	33.2	39		34.6	31.8
60		50.6	46.5	60		34.3	31.5	41	132	32.9	29.5
63		48.2	44.3	63		32.7	30.0	30		41.0	37.7
66		46.0	42.3	66		31.2	28.7	33		37.3	34.2
69		44.0	40.4	69		29.8	27.4	36		34.1	31.4
72	84	42.2	38.7					39	138	31.5	29.0
								30		37.5	34.4
								33		34.1	31.3
								37		30.4	27.2
								30	144	34.4	31.6
								33		31.3	28.8
								36		28.7	25.0

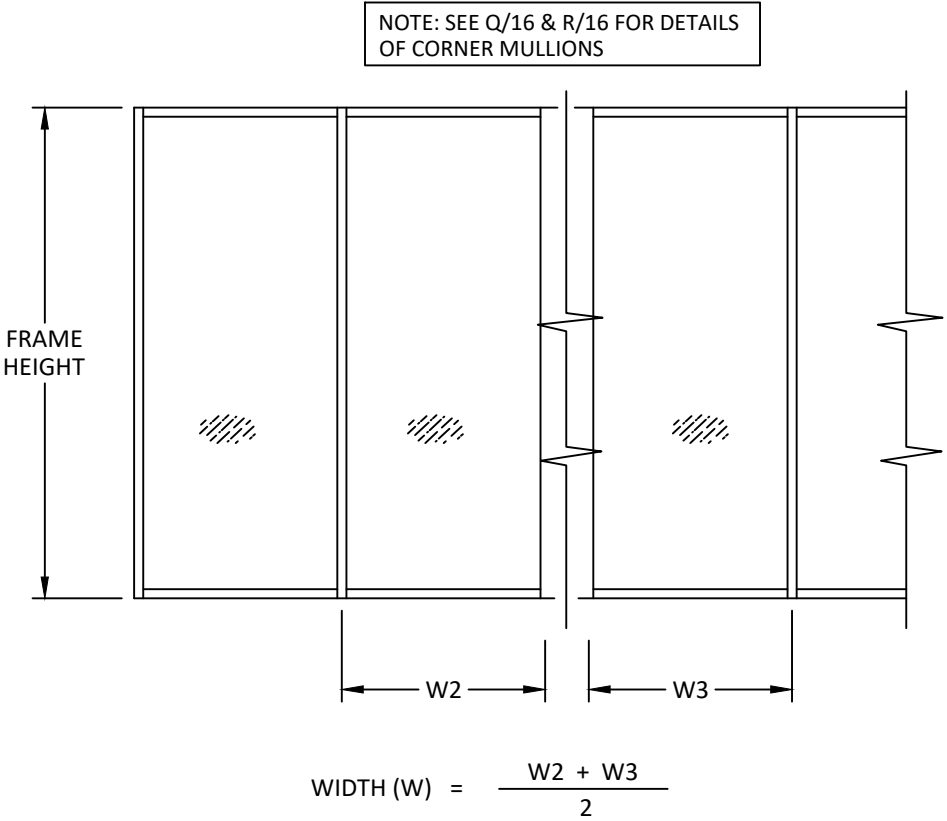

YKK

ap

Quality inspires™

YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
YHS 50 FS IG ALUMINUM STOREFRONT
SYSTEM - INSIDE GLAZED
(WZ3) (IMPACT)
CORNER MULLION TABLES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

BD

BUILDING DROPS

REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO

LICENSE

No. 73778

STATE OF FLORIDA

PROFESSIONAL ENGINEER

HERMES F. NORERO, P.E.

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL14218

DATE:
01.27.16

DWG. BY:
SM

CHK. BY:
HFN

SCALE:
NTS

DWG. #:
YKK168

SHEET:

9

[Page 9 of 19]

c:\users\sebastianherrerros\building drops, inc\building drops, inc\projects\ykk ap america, inc\fb-26-0123 - fl14218 yns 50 tu pre-glazed storefront systems\dwgs\sykk168.dwg
2/11/2026 8:33 AM

ANCHOR TYPE 'A & B' TABLES

ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT (-)					
NOMINAL DIMS. (IN)		ANCHOR TYPE 'A'		ANCHOR TYPE 'B'	
WIDTH (W)	FRAME HEIGHT	A2	A3	B2	B3
30	72	90.0	90.0	90.0	90.0
33		90.0	90.0	90.0	90.0
36		90.0	90.0	90.0	90.0
39		90.0	90.0	90.0	90.0
42		90.0	90.0	90.0	90.0
45		90.0	90.0	90.0	90.0
48		90.0	90.0	90.0	90.0
51		90.0	90.0	90.0	90.0
54		90.0	90.0	90.0	90.0
57		90.0	90.0	90.0	90.0
60		90.0	90.0	90.0	90.0
63		90.0	90.0	90.0	90.0
66		90.0	90.0	89.4	90.0
69		90.0	90.0	85.5	90.0
72		90.0	90.0	81.9	90.0
30	78	90.0	90.0	90.0	90.0
33		90.0	90.0	90.0	90.0
36		90.0	90.0	90.0	90.0
39		90.0	90.0	90.0	90.0
42		90.0	90.0	90.0	90.0
45		90.0	90.0	90.0	90.0
48		90.0	90.0	90.0	90.0
51		90.0	90.0	90.0	90.0
54		90.0	90.0	90.0	90.0
57		90.0	90.0	90.0	90.0
60		90.0	90.0	90.0	90.0
63		90.0	90.0	86.4	90.0
66		90.0	90.0	82.5	90.0
69		90.0	90.0	78.9	90.0
72		88.5	90.0	75.6	90.0
30	84	90.0	90.0	90.0	90.0
33		90.0	90.0	90.0	90.0
36		90.0	90.0	90.0	90.0
39		90.0	90.0	90.0	90.0
42		90.0	90.0	90.0	90.0
45		90.0	90.0	90.0	90.0
48		90.0	90.0	90.0	90.0
51		90.0	90.0	90.0	90.0
54		90.0	90.0	90.0	90.0
57		90.0	90.0	88.7	90.0
60		90.0	90.0	84.3	90.0
63		90.0	90.0	80.2	90.0
66		89.6	90.0	76.6	90.0
69		85.7	90.0	73.3	90.0
72		82.1	90.0	70.2	90.0



ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT (-)					
NOMINAL DIMS. (IN)		ANCHOR TYPE 'A'		ANCHOR TYPE 'B'	
WIDTH (W)	FRAME HEIGHT	A2	A3	B2	B3
30	90	90.0	90.0	90.0	90.0
33		90.0	90.0	90.0	90.0
36		90.0	90.0	90.0	90.0
39		90.0	90.0	90.0	90.0
42		90.0	90.0	90.0	90.0
45		90.0	90.0	90.0	90.0
48		90.0	90.0	90.0	90.0
51		90.0	90.0	90.0	90.0
54		90.0	90.0	87.4	90.0
57		90.0	90.0	82.8	90.0
60		90.0	90.0	78.6	90.0
63		87.6	90.0	74.9	90.0
66		83.6	90.0	71.5	90.0
69		80.0	90.0	68.4	90.0
72		76.7	90.0	65.5	90.0
30	96	90.0	90.0	90.0	90.0
33		90.0	90.0	90.0	90.0
36		90.0	90.0	90.0	90.0
39		90.0	90.0	90.0	90.0
42		90.0	90.0	90.0	90.0
45		90.0	90.0	90.0	90.0
48		90.0	90.0	90.0	90.0
51		90.0	90.0	86.7	90.0
54		90.0	90.0	81.9	90.0
57		90.0	90.0	77.6	90.0
60		86.3	90.0	73.7	90.0
63		82.1	90.0	70.2	90.0
66		78.4	90.0	67.0	90.0
69		75.0	90.0	64.1	90.0
72		71.9	90.0	61.4	90.0
30	102	90.0	90.0	90.0	90.0
33		90.0	90.0	90.0	90.0
36		90.0	90.0	90.0	90.0
39		90.0	90.0	90.0	90.0
42		90.0	90.0	90.0	90.0
45		90.0	90.0	90.0	90.0
48		90.0	90.0	86.7	90.0
51		90.0	90.0	81.6	90.0
54		90.0	90.0	77.1	90.0
57		85.4	90.0	73.0	90.0
60		81.2	90.0	69.4	90.0
63		77.3	90.0	66.1	90.0
66		73.8	90.0	63.1	90.0
69		70.6	90.0	60.3	90.0

ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT (-)					
NOMINAL DIMS. (IN)		ANCHOR TYPE 'A'		ANCHOR TYPE 'B'	
WIDTH (W)	FRAME HEIGHT	A2	A3	B2	B3
30	108	90.0	90.0	90.0	90.0
33		90.0	90.0	90.0	90.0
36		90.0	90.0	90.0	90.0
39		90.0	90.0	90.0	90.0
42		90.0	90.0	90.0	90.0
45		90.0	90.0	87.4	90.0
48		90.0	90.0	81.9	90.0
51		90.0	90.0	77.1	90.0
54		85.2	90.0	72.8	90.0
57		80.7	90.0	69.0	90.0
60		76.7	90.0	65.5	90.0
63		73.0	90.0	62.4	90.0
66		69.7	90.0	59.6	89.4
30	114	90.0	90.0	90.0	90.0
33		90.0	90.0	90.0	90.0
36		90.0	90.0	90.0	90.0
39		90.0	90.0	90.0	90.0
42		90.0	90.0	88.7	90.0
45		90.0	90.0	82.8	90.0
48		90.0	90.0	77.6	90.0
51		85.4	90.0	73.0	90.0
54		80.7	90.0	69.0	90.0
57		76.5	90.0	65.3	90.0
60		72.6	90.0	62.1	90.0
63		69.2	90.0	59.1	88.7
30	120	90.0	90.0	90.0	90.0
33		90.0	90.0	90.0	90.0
36		90.0	90.0	90.0	90.0
39		90.0	90.0	90.0	90.0
42		90.0	90.0	84.3	90.0
45		90.0	90.0	78.6	90.0
48		86.3	90.0	73.7	90.0
51		81.2	90.0	69.4	90.0
54		76.7	90.0	65.5	90.0
57		72.6	90.0	62.1	90.0
60		69.0	90.0	59.0	88.5
30	126	90.0	90.0	90.0	90.0
33		90.0	90.0	90.0	90.0
36		90.0	90.0	90.0	90.0
39		90.0	90.0	86.4	90.0
41		90.0	90.0	82.2	90.0
30	132	90.0	90.0	90.0	90.0
33		90.0	90.0	90.0	90.0
36		90.0	90.0	89.4	90.0
39		90.0	90.0	82.5	90.0
30	138	90.0	90.0	90.0	90.0
33		90.0	90.0	90.0	90.0
36		90.0	90.0	85.5	90.0
37		90.0	90.0	83.2	90.0
30	144	90.0	90.0	90.0	90.0
33		90.0	90.0	89.4	90.0
36		90.0	90.0	81.9	90.0

ANCHORS TYPES: SEE SHEET 14 FOR DESCRIPTION

- A2 = (2) ANCHORS TYPE 'A' AT JAMB OR EACH SIDE OF MULLION
A3 = (3) ANCHORS TYPE 'A' AT JAMB OR EACH SIDE OF MULLION
B2 = (2) ANCHORS TYPE 'B' AT JAMB OR EACH SIDE OF MULLION
B3 = (3) ANCHORS TYPE 'B' AT JAMB OR EACH SIDE OF MULLION
B4 = (4) ANCHORS TYPE 'B' AT JAMB OR EACH SIDE OF MULLION

ALL OTHER ANCHORS TO BE SPACED AS PER ELEVATION

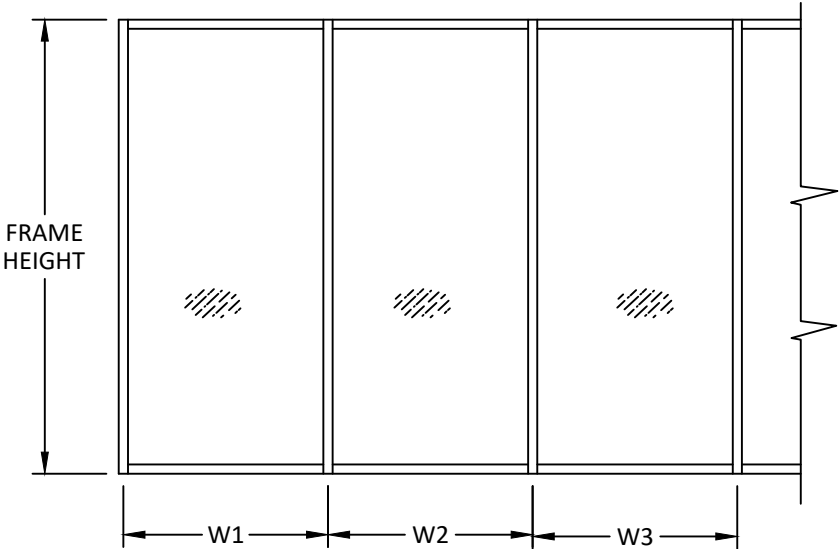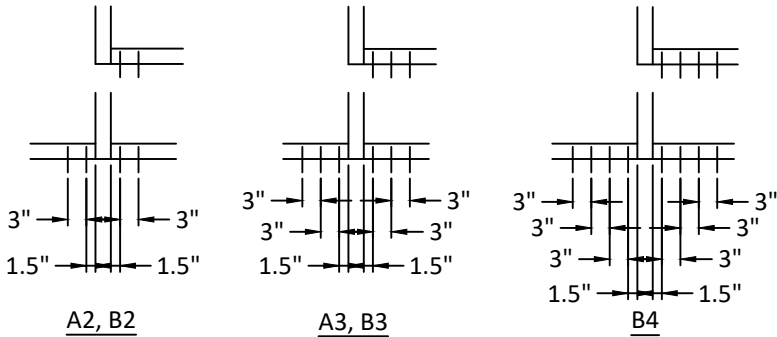

WIDTH (W) = W1 (JAMB)

WIDTH (W) = $\frac{W2 + W3}{2}$ (MULLION)



YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
YHS 50 FS IG ALUMINUM STOREFRONT
SYSTEM - INSIDE GLAZED
(WZ3) (IMPACT)


TYPE A & B ANCHOR TABLES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

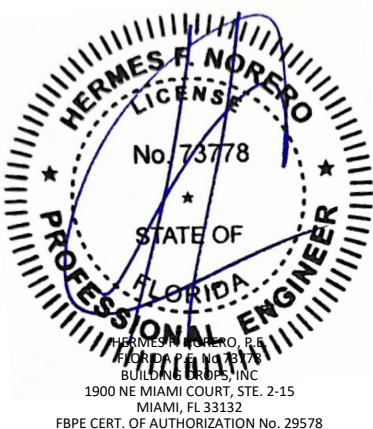

FL #:	FL14218
DATE:	01.27.16
DWG. BY:	CHK. BY:
SM	HFN
SCALE:	NTS
DWG. #:	YKK168
SHEET:	10

ANCHOR TYPE 'C & D' TABLES

ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT (-)								
NOMINAL DIMS. (IN)		ANCHOR TYPE 'C'			ANCHOR TYPE 'D'			
WIDTH (W)	FRAME HEIGHT	C2	C3	C4	D2	D3	D4	D5
30	72	90.0	90.0	90.0	90.0	90.0	90.0	90.0
33		90.0	90.0	90.0	90.0	90.0	90.0	90.0
36		90.0	90.0	90.0	88.9	90.0	90.0	90.0
39		90.0	90.0	90.0	82.1	90.0	90.0	90.0
42		90.0	90.0	90.0	76.2	90.0	90.0	90.0
45		90.0	90.0	90.0	71.1	90.0	90.0	90.0
48		90.0	90.0	90.0	66.7	90.0	90.0	90.0
51		90.0	90.0	90.0	62.7	90.0	90.0	90.0
54		85.2	90.0	90.0	59.3	88.9	90.0	90.0
57		80.8	90.0	90.0	56.1	84.2	90.0	90.0
60		76.7	90.0	90.0	53.3	80.0	90.0	90.0
63		73.1	90.0	90.0	50.8	76.2	90.0	90.0
66	78	69.7	90.0	90.0	48.5	72.7	90.0	90.0
69		66.7	90.0	90.0	46.4	69.6	90.0	90.0
72		63.9	90.0	90.0	44.4	66.7	88.9	90.0
30		90.0	90.0	90.0	90.0	90.0	90.0	90.0
33		90.0	90.0	90.0	89.5	90.0	90.0	90.0
36		90.0	90.0	90.0	82.1	90.0	90.0	90.0
39		90.0	90.0	90.0	75.7	90.0	90.0	90.0
42		90.0	90.0	90.0	70.3	90.0	90.0	90.0
45		90.0	90.0	90.0	65.6	90.0	90.0	90.0
48		88.5	90.0	90.0	61.5	90.0	90.0	90.0
51		83.3	90.0	90.0	57.9	86.9	90.0	90.0
54		78.7	90.0	90.0	54.7	82.1	90.0	90.0
57	84	74.5	90.0	90.0	51.8	77.7	90.0	90.0
60		70.8	90.0	90.0	49.2	73.8	90.0	90.0
63		67.4	90.0	90.0	46.9	70.3	90.0	90.0
66		64.4	90.0	90.0	44.8	67.1	89.5	90.0
69		61.6	90.0	90.0	42.8	64.2	85.6	90.0
72		59.0	88.5	90.0	41.0	61.5	82.1	90.0
30		90.0	90.0	90.0	90.0	90.0	90.0	90.0
33		90.0	90.0	90.0	83.1	90.0	90.0	90.0
36		90.0	90.0	90.0	76.2	90.0	90.0	90.0
39		90.0	90.0	90.0	70.3	90.0	90.0	90.0
42		90.0	90.0	90.0	65.3	90.0	90.0	90.0
45		87.7	90.0	90.0	61.0	90.0	90.0	90.0
48	90	82.2	90.0	90.0	57.1	85.7	90.0	90.0
51		77.4	90.0	90.0	53.8	80.7	90.0	90.0
54		73.1	90.0	90.0	50.8	76.2	90.0	90.0
57		69.2	90.0	90.0	48.1	72.2	90.0	90.0
60		65.8	90.0	90.0	45.7	68.6	90.0	90.0
63		62.6	90.0	90.0	43.5	65.3	87.1	90.0
66		59.8	89.7	90.0	41.6	62.3	83.1	90.0
69		57.2	85.8	90.0	39.8	59.6	79.5	90.0
72		54.8	82.2	90.0	38.1	57.1	76.2	90.0

ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT (-)									
NOMINAL DIMS. (IN)		ANCHOR TYPE 'C'			ANCHOR TYPE 'D'				
WIDTH (W)	FRAME HEIGHT	C2	C3	C4	D2	D3	D4	D5	D6
30	90	90.0	90.0	90.0	85.3	90.0	90.0	90.0	90.0
33		90.0	90.0	90.0	77.6	90.0	90.0	90.0	90.0
36		90.0	90.0	90.0	71.1	90.0	90.0	90.0	90.0
39		90.0	90.0	90.0	65.6	90.0	90.0	90.0	90.0
42		87.7	90.0	90.0	61.0	90.0	90.0	90.0	90.0
45		81.8	90.0	90.0	56.9	85.3	90.0	90.0	90.0
48		76.7	90.0	90.0	53.3	80.0	90.0	90.0	90.0
51		72.2	90.0	90.0	50.2	75.3	90.0	90.0	90.0
54		68.2	90.0	90.0	47.4	71.1	90.0	90.0	90.0
57		64.6	90.0	90.0	44.9	67.4	89.8	90.0	90.0
60		61.4	90.0	90.0	42.7	64.0	85.3	90.0	90.0
63		58.5	87.7	90.0	40.6	61.0	81.3	90.0	90.0
66	96	55.8	83.7	90.0	38.8	58.2	77.6	90.0	90.0
69		53.4	80.1	90.0	37.1	55.7	74.2	90.0	90.0
72		51.1	76.7	90.0	35.6	53.3	71.1	88.9	90.0
30		90.0	90.0	90.0	80.0	90.0	90.0	90.0	90.0
33		90.0	90.0	90.0	72.7	90.0	90.0	90.0	90.0
36		90.0	90.0	90.0	66.7	90.0	90.0	90.0	90.0
39		88.5	90.0	90.0	61.5	90.0	90.0	90.0	90.0
42		82.2	90.0	90.0	57.1	85.7	90.0	90.0	90.0
45		76.7	90.0	90.0	53.3	80.0	90.0	90.0	90.0
48		71.9	90.0	90.0	50.0	75.0	90.0	90.0	90.0
51		67.7	90.0	90.0	47.1	70.6	90.0	90.0	90.0
54		63.9	90.0	90.0	44.4	66.7	88.9	90.0	90.0
57	102	60.6	90.0	90.0	42.1	63.2	84.2	90.0	90.0
60		57.5	86.3	90.0	40.0	60.0	80.0	90.0	90.0
63		54.8	82.2	90.0	38.1	57.1	76.2	90.0	90.0
66		52.3	78.5	90.0	36.4	54.5	72.7	90.0	90.0
69		50.0	75.1	90.0	34.8	52.2	69.6	87.0	90.0
72		48.0	71.9	90.0	33.3	50.0	66.7	83.3	90.0
30		90.0	90.0	90.0	75.3	90.0	90.0	90.0	90.0
33		90.0	90.0	90.0	68.4	90.0	90.0	90.0	90.0
36		90.0	90.0	90.0	62.7	90.0	90.0	90.0	90.0
39		83.3	90.0	90.0	57.9	86.9	90.0	90.0	90.0
42		77.4	90.0	90.0	53.8	80.7	90.0	90.0	90.0
45		72.2	90.0	90.0	50.2	75.3	90.0	90.0	90.0
48	108	67.7	90.0	90.0	47.1	70.6	90.0	90.0	90.0
51		63.7	90.0	90.0	44.3	66.4	88.6	90.0	90.0
54		60.2	90.0	90.0	41.8	62.7	83.7	90.0	90.0
57		57.0	85.5	90.0	39.6	59.4	79.3	90.0	90.0
60		54.2	81.2	90.0	37.6	56.5	75.3	90.0	90.0
63		51.6	77.4	90.0	35.9	53.8	71.7	89.6	90.0
66		49.2	73.8	90.0	34.2	51.3	68.4	85.6	90.0
69		47.1	70.6	90.0	32.7	49.1	65.5	81.8	90.0

ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT (-)										
NOMINAL DIMS. (IN)		ANCHOR TYPE 'C'			ANCHOR TYPE 'D'					
WIDTH (W)	FRAME HEIGHT	C2	C3	C4	D2	D3	D4	D5	D6	
30	108	90.0	90.0	90.0	71.1	90.0	90.0	90.0	90.0	
33		90.0	90.0	90.0	64.6	90.0	90.0	90.0	90.0	
36		85.2	90.0	90.0	59.3	88.9	90.0	90.0	90.0	
39		78.7	90.0	90.0	54.7	82.1	90.0	90.0	90.0	
42		73.1	90.0	90.0	50.8	76.2	90.0	90.0	90.0	
45		68.2	90.0	90.0	47.4	71.1	90.0	90.0	90.0	
48		63.9	90.0	90.0	44.4	66.7	88.9	90.0	90.0	
51		60.2	90.0	90.0	41.8	62.7	83.7	90.0	90.0	
54		56.8	85.2	90.0	39.5	59.3	79.0	90.0	90.0	
57		53.8	80.8	90.0	37.4	56.1	74.9	90.0	90.0	
60		51.1	76.7	90.0	35.6	53.3	71.1	88.9	90.0	
63		48.7	73.1	90.0	33.9	50.8	67.7	84.7	90.0	
66	46.5	69.7	90.0	32.3	48.5	64.6	80.8	90.0		
30	114	90.0	90.0	90.0	67.4	90.0	90.0	90.0	90.0	
33		88.1	90.0	90.0	61.2	90.0	90.0	90.0	90.0	
36		80.8	90.0	90.0	56.1	84.2	90.0	90.0	90.0	
39		74.5	90.0	90.0	51.8	77.7	90.0	90.0	90.0	
42		69.2	90.0	90.0	48.1	72.2	90.0	90.0	90.0	
45		64.6	90.0	90.0	44.9	67.4	89.8	90.0	90.0	
48		60.6	90.0	90.0	42.1	63.2	84.2	90.0	90.0	
51		57.0	85.5	90.0	39.6	59.4	79.3	90.0	90.0	
54		53.8	80.8	90.0	37.4	56.1	74.9	90.0	90.0	
57		51.0	76.5	90.0	35.5	53.2	70.9	88.6	90.0	
60		48.5	72.7	90.0	33.7	50.5	67.4	84.2	90.0	
63		46.1	69.2	90.0	32.1	48.1	64.2	80.2	90.0	
30	120	90.0	90.0	90.0	64.0	90.0	90.0	90.0	90.0	
33		83.7	90.0	90.0	58.2	87.3	90.0	90.0	90.0	
36		76.7	90.0	90.0	53.3	80.0	90.0	90.0	90.0	
39		70.8	90.0	90.0	49.2	73.8	90.0	90.0	90.0	
42		65.8	90.0	90.0	45.7	68.6	90.0	90.0	90.0	
45		61.4	90.0	90.0	42.7	64.0	85.3	90.0	90.0	
48		57.5	86.3	90.0	40.0	60.0	80.0	90.0	90.0	
51		54.2	81.2	90.0	37.6	56.5	75.3	90.0	90.0	
54		51.1	76.7	90.0	35.6	53.3	71.1	88.9	90.0	
57		48.5	72.7	90.0	33.7	50.5	67.4	84.2	90.0	
60		46.0	69.0	90.0	32.0	48.0	64.0	80.0	90.0	
30		126	87.7	90.0	90.0	61.0	90.0	90.0	90.0	90.0
33	79.7		90.0	90.0	55.4	83.1	90.0	90.0	90.0	
36	73.1		90.0	90.0	50.8	76.2	90.0	90.0	90.0	
39	67.4		90.0	90.0	46.9	70.3	90.0	90.0	90.0	
41	64.2		90.0	90.0	44.6	66.9	89.2	90.0	90.0	
30	132		83.7	90.0	90.0	58.2	87.3	90.0	90.0	90.0
33			76.1	90.0	90.0	52.9	79.3	90.0	90.0	90.0
36			69.7	90.0	90.0	48.5	72.7	90.0	90.0	90.0
39			64.4	90.0	90.0	44.8	67.1	89.5	90.0	90.0
30	138		80.1	90.0	90.0	55.7	83.5	90.0	90.0	90.0
33			72.8	90.0	90.0	50.6	75.9	90.0	90.0	90.0
36			66.7	90.0	90.0	46.4	69.6	90.0	90.0	90.0
37		64.9	90.0	90.0	45.1	67.7	90.0	90.0	90.0	
30	144	76.7	90.0	90.0	53.3	80.0	90.0	90.0	90.0	
33		69.7	90.0	90.0	48.5	72.7	90.0	90.0	90.0	
36		63.9	90.0	90.0	44.4	66.7	88.9	90.0	90.0	

ANCHOR TYPE 'E' TABLES



ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT (-)							
NOMINAL DIMS. (IN)		ANCHOR TYPE 'E'					
WIDTH (W)	FRAME HEIGHT	E2	E3	E4	E5	E6	E7
30	72	77.2	90.0	90.0	90.0	90.0	90.0
33		70.2	90.0	90.0	90.0	90.0	90.0
36		64.4	90.0	90.0	90.0	90.0	90.0
39		59.4	89.1	90.0	90.0	90.0	90.0
42		55.2	82.7	90.0	90.0	90.0	90.0
45		51.5	77.2	90.0	90.0	90.0	90.0
48		48.3	72.4	90.0	90.0	90.0	90.0
51		45.4	68.1	90.0	90.0	90.0	90.0
54		42.9	64.4	85.8	90.0	90.0	90.0
57		40.6	61.0	81.3	90.0	90.0	90.0
60		38.6	57.9	77.2	90.0	90.0	90.0
63		36.8	55.2	73.5	90.0	90.0	90.0
66	78	35.1	52.7	70.2	87.8	90.0	90.0
69		33.6	50.4	67.2	83.9	90.0	90.0
72		32.2	48.3	64.4	80.4	90.0	90.0
30		71.3	90.0	90.0	90.0	90.0	90.0
33		64.8	90.0	90.0	90.0	90.0	90.0
36		59.4	89.1	90.0	90.0	90.0	90.0
39		54.8	82.3	90.0	90.0	90.0	90.0
42		50.9	76.4	90.0	90.0	90.0	90.0
45		47.5	71.3	90.0	90.0	90.0	90.0
48		44.6	66.8	89.1	90.0	90.0	90.0
51		41.9	62.9	83.9	90.0	90.0	90.0
54		39.6	59.4	79.2	90.0	90.0	90.0
57	84	37.5	56.3	75.0	90.0	90.0	90.0
60		35.6	53.5	71.3	89.1	90.0	90.0
63		33.9	50.9	67.9	84.9	90.0	90.0
66		32.4	48.6	64.8	81.0	90.0	90.0
69		31.0	46.5	62.0	77.5	90.0	90.0
72		29.7	44.6	59.4	74.3	89.1	90.0
30		66.2	90.0	90.0	90.0	90.0	90.0
33		60.2	90.0	90.0	90.0	90.0	90.0
36		55.2	82.7	90.0	90.0	90.0	90.0
39		50.9	76.4	90.0	90.0	90.0	90.0
42		47.3	70.9	90.0	90.0	90.0	90.0
45		44.1	66.2	88.3	90.0	90.0	90.0
48	90	41.4	62.1	82.7	90.0	90.0	90.0
51		38.9	58.4	77.9	90.0	90.0	90.0
54		36.8	55.2	73.5	90.0	90.0	90.0
57		34.8	52.3	69.7	87.1	90.0	90.0
60		33.1	49.6	66.2	82.7	90.0	90.0
63		31.5	47.3	63.0	78.8	90.0	90.0
66		30.1	45.1	60.2	75.2	90.0	90.0
69		28.8	43.2	57.6	72.0	86.3	90.0
72		27.6	41.4	55.2	69.0	82.7	90.0

ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT (-)							
NOMINAL DIMS. (IN)		ANCHOR TYPE 'E'					
WIDTH (W)	FRAME HEIGHT	E2	E3	E4	E5	E6	E7
30	90	61.8	90.0	90.0	90.0	90.0	90.0
33		56.2	84.2	90.0	90.0	90.0	90.0
36		51.5	77.2	90.0	90.0	90.0	90.0
39		47.5	71.3	90.0	90.0	90.0	90.0
42		44.1	66.2	88.3	90.0	90.0	90.0
45		41.2	61.8	82.4	90.0	90.0	90.0
48		38.6	57.9	77.2	90.0	90.0	90.0
51		36.3	54.5	72.7	90.0	90.0	90.0
54		34.3	51.5	68.6	85.8	90.0	90.0
57		32.5	48.8	65.0	81.3	90.0	90.0
60		30.9	46.3	61.8	77.2	90.0	90.0
63		29.4	44.1	58.8	73.5	88.3	90.0
66	96	28.1	42.1	56.2	70.2	84.2	90.0
69		26.9	40.3	53.7	67.2	80.6	90.0
72		25.7	38.6	51.5	64.4	77.2	90.0
30		57.9	86.9	90.0	90.0	90.0	90.0
33		52.7	79.0	90.0	90.0	90.0	90.0
36		48.3	72.4	90.0	90.0	90.0	90.0
39		44.6	66.8	89.1	90.0	90.0	90.0
42		41.4	62.1	82.7	90.0	90.0	90.0
45		38.6	57.9	77.2	90.0	90.0	90.0
48		36.2	54.3	72.4	90.0	90.0	90.0
51		34.1	51.1	68.1	85.2	90.0	90.0
54		32.2	48.3	64.4	80.4	90.0	90.0
57	102	30.5	45.7	61.0	76.2	90.0	90.0
60		29.0	43.4	57.9	72.4	86.9	90.0
63		27.6	41.4	55.2	69.0	82.7	90.0
66		26.3	39.5	52.7	65.8	79.0	90.0
69		25.2	37.8	50.4	63.0	75.5	88.1
72		24.1	36.2	48.3	60.3	72.4	84.5
30		54.5	81.8	90.0	90.0	90.0	90.0
33		49.6	74.3	90.0	90.0	90.0	90.0
36		45.4	68.1	90.0	90.0	90.0	90.0
39		41.9	62.9	83.9	90.0	90.0	90.0
42		38.9	58.4	77.9	90.0	90.0	90.0
45		36.3	54.5	72.7	90.0	90.0	90.0
48	108	34.1	51.1	68.1	85.2	90.0	90.0
51		32.1	48.1	64.1	80.2	90.0	90.0
54		30.3	45.4	60.6	75.7	90.0	90.0
57		28.7	43.0	57.4	71.7	86.1	90.0
60		27.3	40.9	54.5	68.1	81.8	90.0
63		26.0	38.9	51.9	64.9	77.9	90.0
66		24.8	37.2	49.6	61.9	74.3	86.7
69		23.7	35.6	47.4	59.3	71.1	83.0

c:\users\sebastianh\documents\building drops, inc\building drops, inc\projects\ykk ap america, inc\fb-26-0123 - fl14218 yns 50 tu pre-glazed storefront systems\dwgs\y\ykk168.dwg 2/11/2026 8:33 AM

DOOR MULLION LOAD CAPACITY (PSF)					
NOMINAL DIMS.		WITHOUT STEEL REINF.		WITH STEEL REINF.	
WIDTH (W)	FRAME HEIGHT	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
24	102	70.0	70.0	70.0	90.0
30		70.0	70.0	70.0	90.0
36		70.0	70.0	70.0	90.0
42		70.0	70.0	70.0	90.0
48		70.0	70.0	70.0	90.0
54		70.0	70.0	70.0	90.0
60		70.0	70.0	70.0	90.0
24	108	70.0	70.0	70.0	90.0
30		70.0	70.0	70.0	90.0
36		70.0	70.0	70.0	90.0
42		70.0	70.0	70.0	90.0
48		70.0	70.0	70.0	90.0
54		70.0	70.0	70.0	90.0
60		70.0	70.0	70.0	90.0
24	114	70.0	70.0	70.0	90.0
30		70.0	70.0	70.0	90.0
36		70.0	70.0	70.0	90.0
42		70.0	70.0	70.0	90.0
48		70.0	70.0	70.0	90.0
54		70.0	70.0	70.0	90.0
60		70.0	70.0	70.0	90.0
24	120	70.0	70.0	70.0	90.0
30		70.0	70.0	70.0	90.0
36		70.0	70.0	70.0	90.0
42		70.0	70.0	70.0	90.0
48		70.0	70.0	70.0	90.0
54		69.2	69.2	70.0	90.0
60		62.3	62.3	70.0	90.0
24	126	70.0	70.0	70.0	90.0
30		70.0	70.0	70.0	90.0
36		70.0	70.0	70.0	90.0
42		70.0	70.0	70.0	90.0
48		67.3	67.3	70.0	90.0
54		59.8	59.8	70.0	90.0
60		57.1	57.1	70.0	90.0
24	132	70.0	70.0	70.0	90.0
30		70.0	70.0	70.0	90.0
36		70.0	70.0	70.0	90.0
42		66.9	66.9	70.0	90.0
48		58.5	58.5	70.0	90.0
54		57.1	57.1	70.0	90.0
60		52.4	52.4	64.2	82.6
24	138	70.0	70.0	70.0	90.0
30		70.0	70.0	70.0	90.0
36		68.3	68.3	70.0	90.0
42		58.5	58.5	70.0	90.0
48		57.1	57.1	70.0	90.0
54		50.9	50.9	62.4	80.3
60		45.8	45.8	56.2	72.2
24	144	70.0	70.0	70.0	90.0
30		70.0	70.0	70.0	90.0
36		60.1	60.1	70.0	90.0
42		57.1	57.1	70.0	90.0
48		50.4	50.4	61.8	79.5
54		44.8	44.8	55.0	70.7
60		40.3	40.3	49.5	63.6

DOOR MULLION LOAD & ANCHOR TABLES

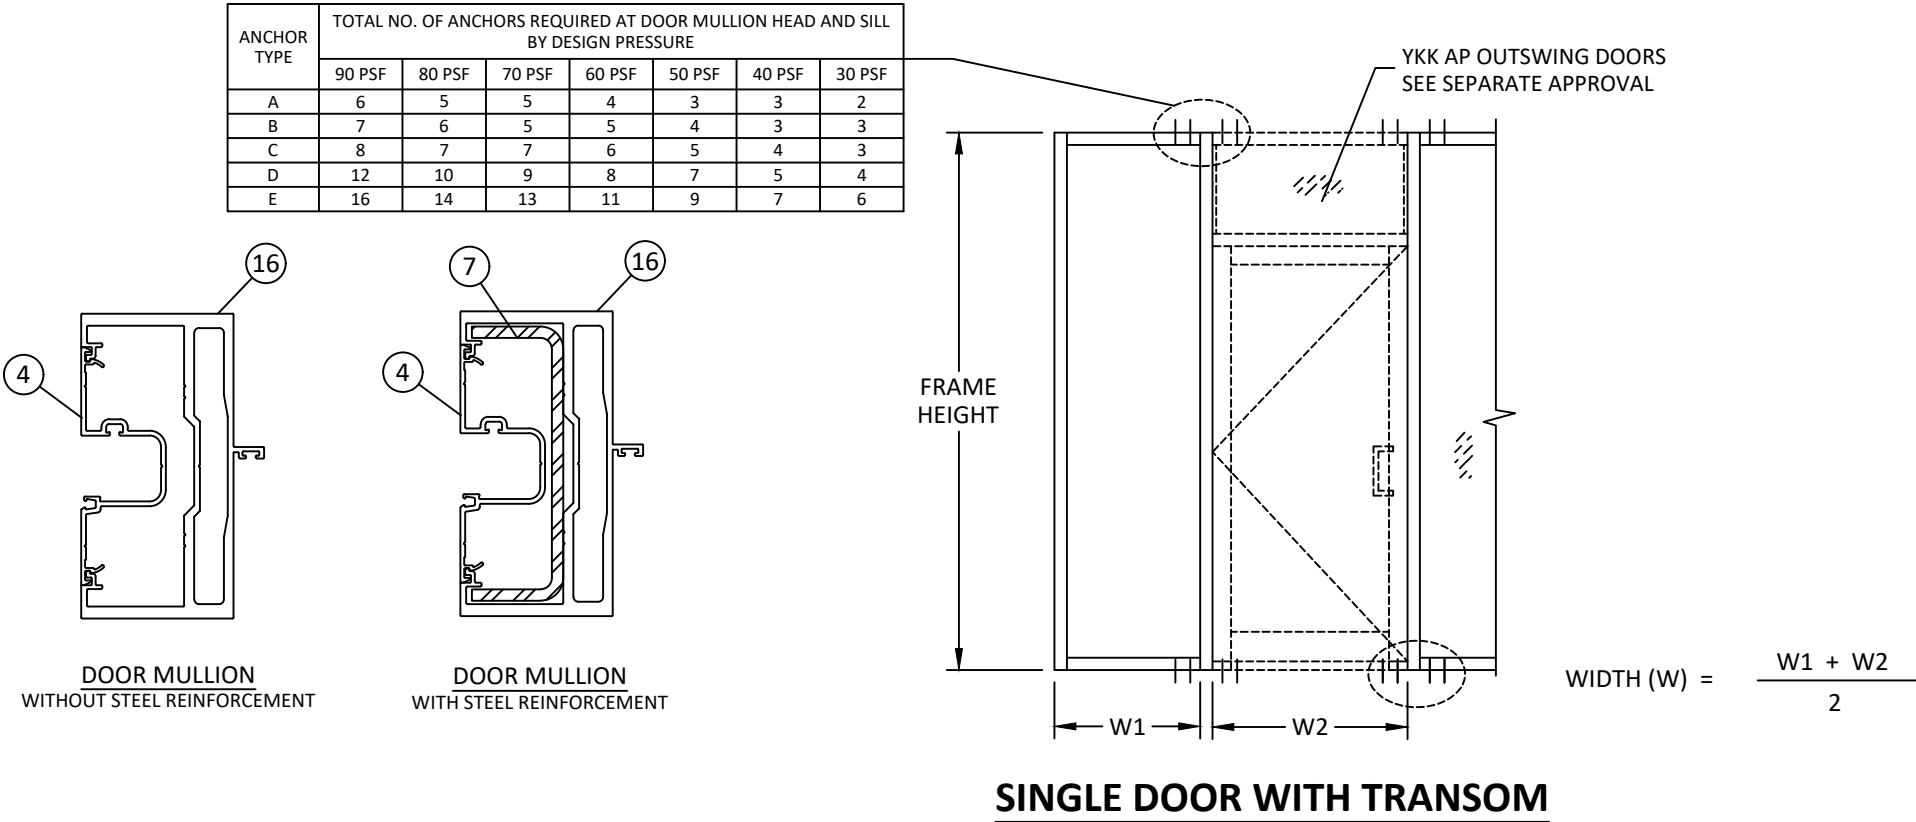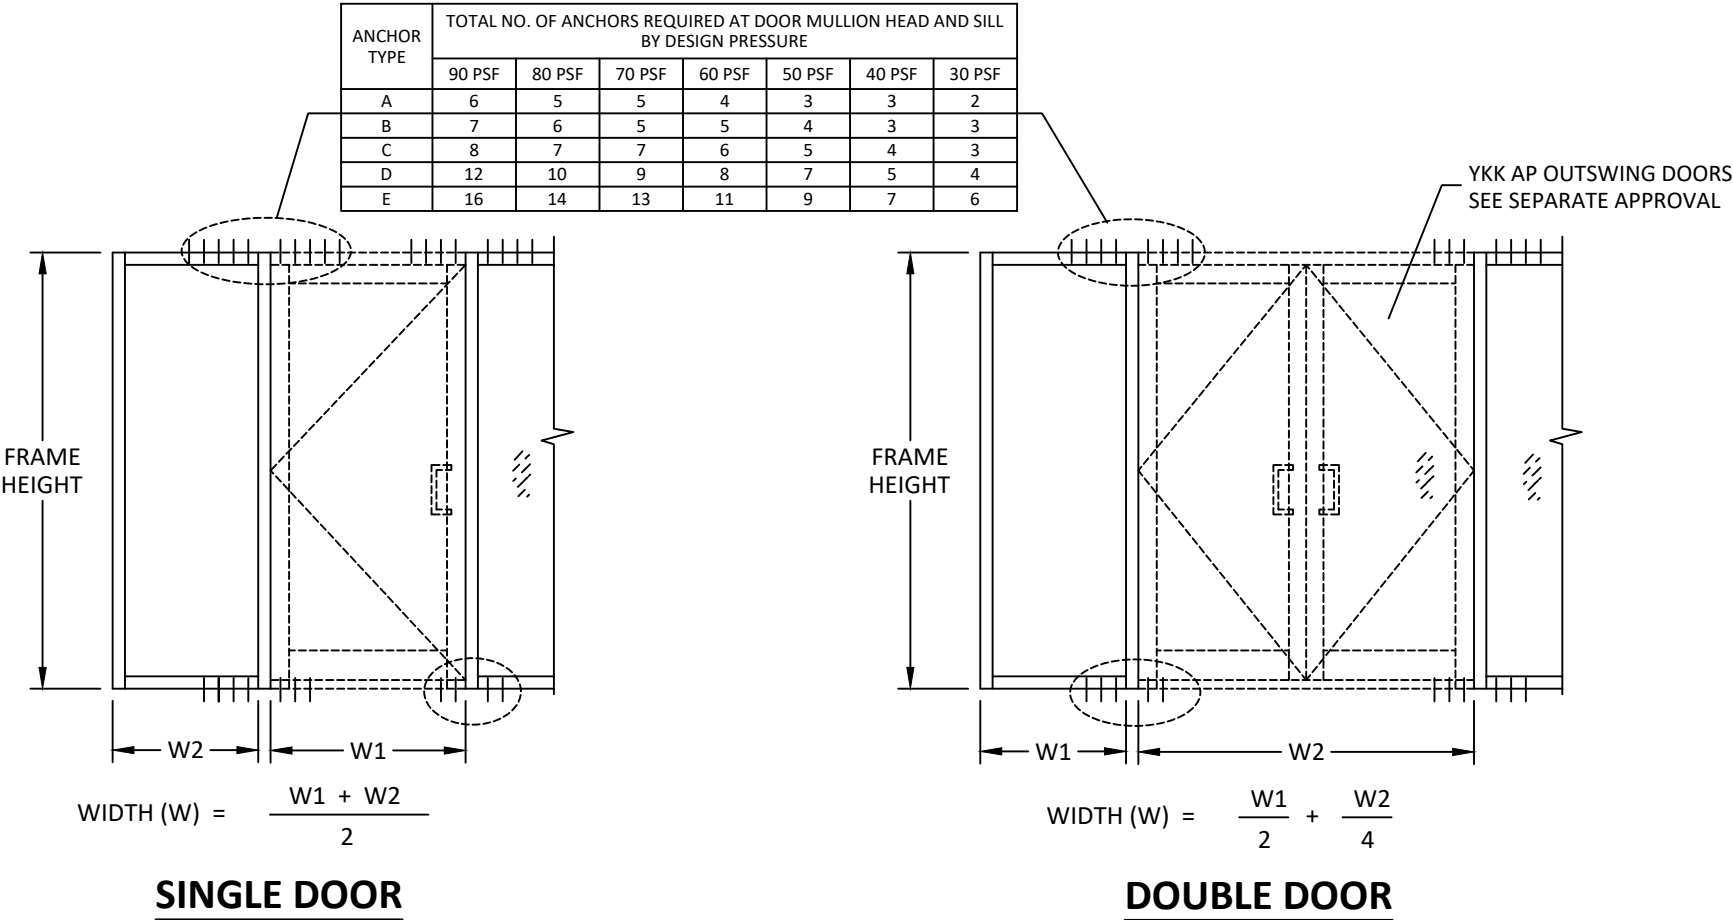

YKK

ap

Quality
inspires™

YKK AP AMERICA, INC.

101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
YHS 50 FS IG ALUMINUM STOREFRONT
SYSTEM - INSIDE GLAZED
(WZ3) (IMPACT)
DOOR MULLION TABLES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO
LICENSE
No. 73778
STATE OF
FLORIDA
PROFESSIONAL ENGINEER


HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL14218
DATE:	01.27.16
DWG. BY:	CHK. BY:
SM	HFN
SCALE:	NTS
DWG. #:	YKK168
SHEET:	

DOOR MULLION LOAD & ANCHOR TABLES

DOOR MULLION LOAD CAPACITY (PSF)						
NOMINAL DIMS.			WITHOUT STEEL REINF.		WITH STEEL REINF.	
FRAME HEIGHT (IN.)	DOOR PANEL WIDTH - W1 (IN.)	SIDELITE WIDTH - W2 (IN.)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
96	36	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
	42	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
	48	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
102	36	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
	42	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
	48	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
	36	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
108	36	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
	42	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
	48	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	57.1	57.1	70.0	90.0
114	36	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	69.8	69.8	70.0	90.0
	42	30	70.0	70.0	70.0	90.0
		36	69.8	69.8	70.0	90.0
		42	66.6	66.6	70.0	90.0
		48	63.6	63.6	70.0	90.0
	48	30	66.6	66.6	70.0	90.0
		36	63.6	63.6	70.0	90.0
		42	57.1	57.1	70.0	90.0
		48	57.1	57.1	70.0	90.0

DOOR MULLION LOAD CAPACITY (PSF)						
NOMINAL DIMS.			WITHOUT STEEL REINF.		WITH STEEL REINF.	
FRAME HEIGHT (IN.)	DOOR PANEL WIDTH - W1 (IN.)	SIDELITE WIDTH - W2 (IN.)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
120	36	30	69.9	69.9	70.0	90.0
		36	66.2	66.2	70.0	90.0
		42	62.8	62.8	70.0	90.0
		48	59.8	59.8	70.0	90.0
	42	30	62.8	62.8	70.0	90.0
		36	59.8	59.8	70.0	90.0
		42	57.1	57.1	70.0	90.0
		48	57.1	57.1	70.0	90.0
	48	30	57.1	57.1	70.0	90.0
		36	57.1	57.1	70.0	90.0
		42	57.1	57.1	70.0	90.0
		44	57.1	57.1	70.0	90.0
126	36	30	60.4	60.4	70.0	90.0
		36	57.2	57.2	70.0	90.0
		42	57.1	57.1	70.0	90.0
		48	57.1	57.1	70.0	90.0
	42	30	57.1	57.1	70.0	90.0
		36	57.1	57.1	70.0	90.0
		42	55.2	55.2	67.6	86.9
		48	52.7	52.7	64.7	83.1
	48	30	55.2	55.2	67.6	86.9
		36	52.7	52.7	64.7	83.1
		38	52.0	52.0	63.7	81.9
		30	57.1	57.1	70.0	90.0
132	36	36	55.6	55.6	68.2	87.7
		42	52.8	52.8	64.7	83.2
		48	50.3	50.3	61.6	79.2
	42	30	52.8	52.8	64.7	83.2
		36	50.3	50.3	61.6	79.2
		42	48.0	48.0	58.8	75.6
		44	47.3	47.3	57.9	74.5
	48	30	48.0	48.0	58.8	75.6
		32	47.3	47.3	57.9	74.5
	36	30	51.4	51.4	63.0	81.0
		36	48.7	48.7	59.7	76.7
		42	46.2	46.2	56.7	72.9
138	36	48	44.0	44.0	53.9	69.4
	42	30	46.2	46.2	56.7	72.9
		36	44.0	44.0	53.9	69.4
		38	43.3	43.3	53.1	68.3
	48	26	43.3	43.3	53.1	68.3
	36	30	45.2	45.2	55.5	71.3
		36	42.8	42.8	52.5	67.5
		42	40.7	40.7	49.9	64.1
		44	40.0	40.0	49.0	63.1
144	42	30	40.7	40.7	49.9	64.1
		32	40.0	40.0	49.0	63.1
	48	20	40.0	40.0	49.0	63.1

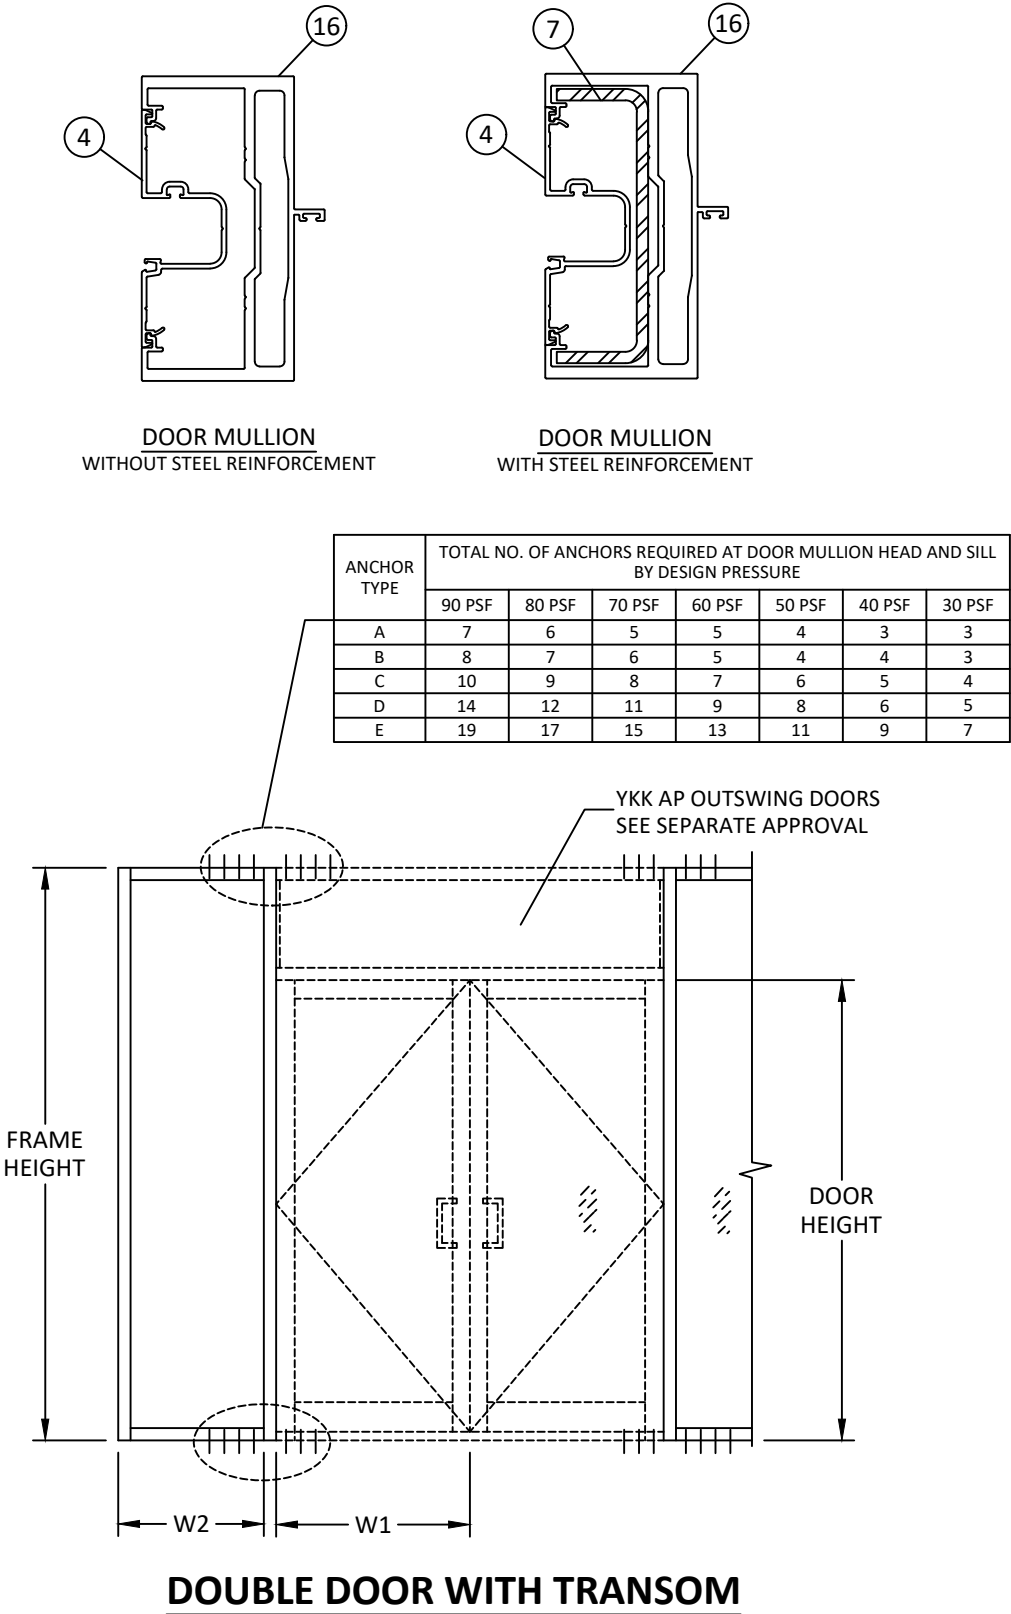

YKK

ap

Quality
inspires™

YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
YHS 50 FS IG ALUMINUM STOREFRONT
SYSTEM - INSIDE GLAZED
(W3) (IMPACT)
DOOR MULLION TABLES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
ANCHOR UPDATE	SH	02.11.26
THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.		

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL14218

DATE: 01.27.16

DWG. BY: SM
CHK. BY: HFN


SCALE: NTS

DWG. #: YKK168


SHEET:

2/11/2026 8:33 AM

c:\users\sebastianhereros\building drops - common\projects\ykk ap america, inc\fb-26-0123 - fl14218 yns 50 tu pre-glazed storefront systems\dwgs\sykk168.dwg

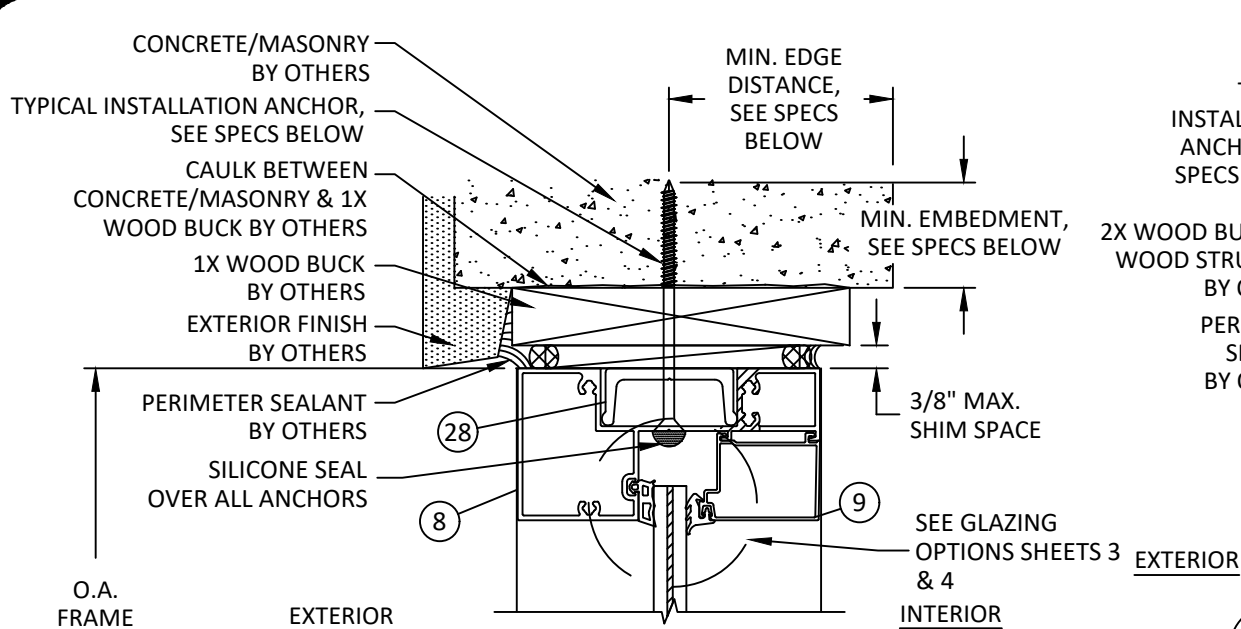


A
14 VERTICAL SECTION
HEAD - CONCRETE/MASONRY W/ 1X BUCK

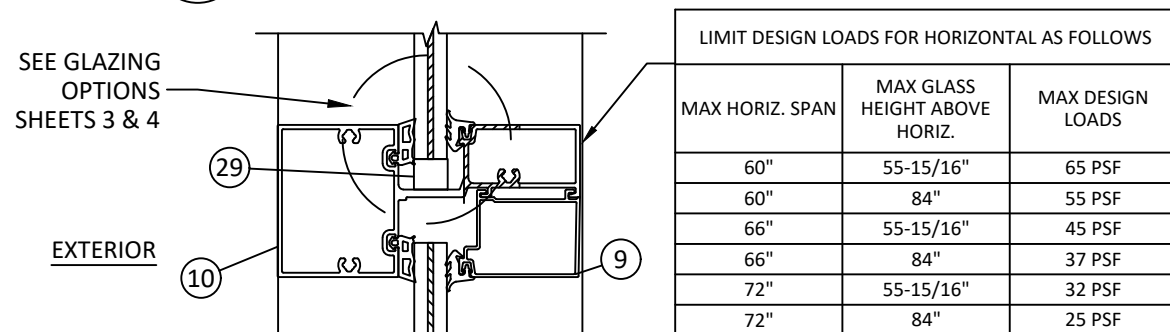


DESIGN LOADS SHOWN ABOVE ARE BASED ON MAX. GLASS AREA ABOVE HORIZONTAL, FOR SIZES SMALLER THAN SHOWN ABOVE, ALLOWABLE DESIGN LOADS MAY BE CALCULATED SEPARATELY.

B
14 VERTICAL SECTION
HORIZONTAL MEMBER

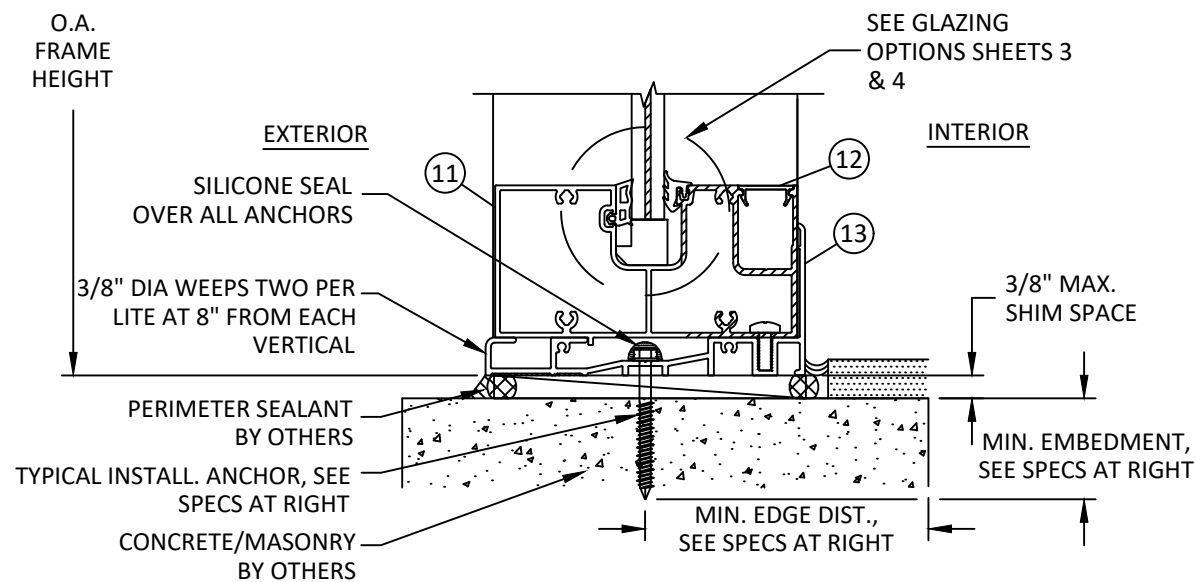


C
14 VERTICAL SECTION
SILL - DIRECT TO CONCRETE/MASONRY

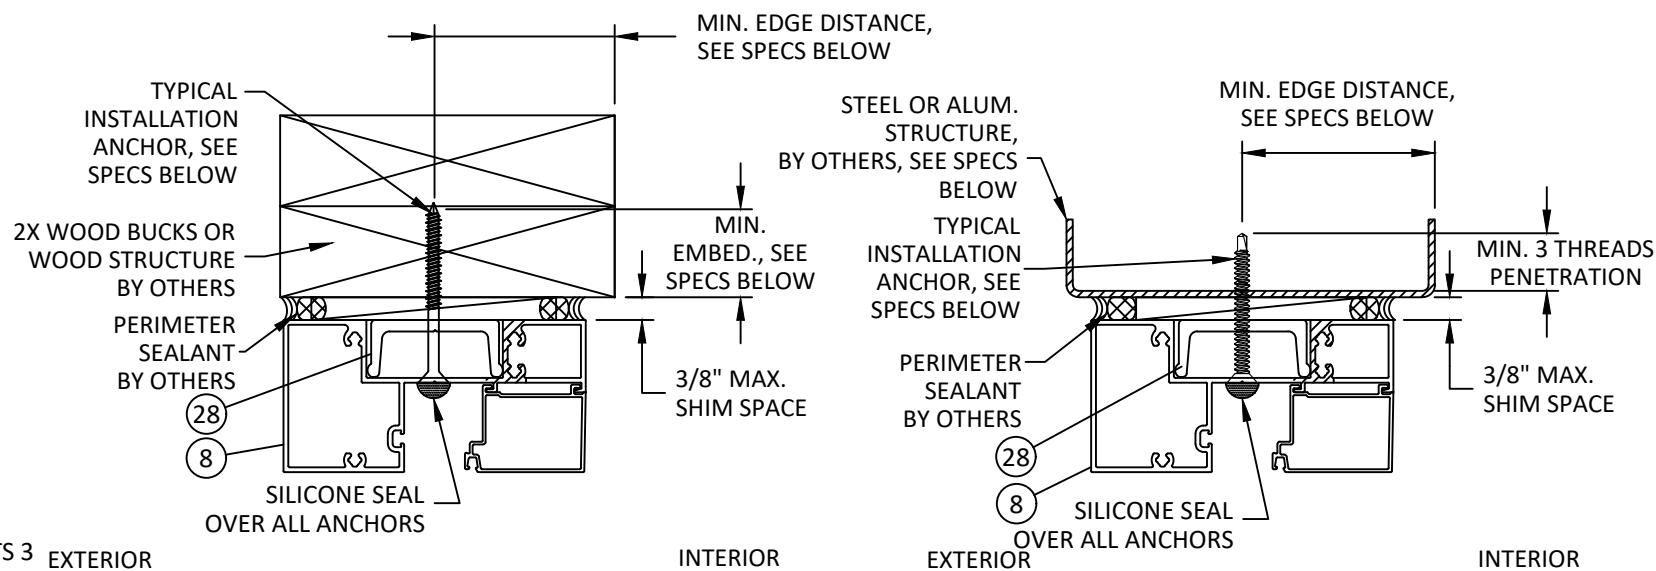

D
14 VERTICAL SECTION
HEAD - WOOD FRAMING
TYPICAL INSTALLATION

E
14 VERTICAL SECTION
HEAD - METAL SUBSTRATE
TYPICAL INSTALLATION

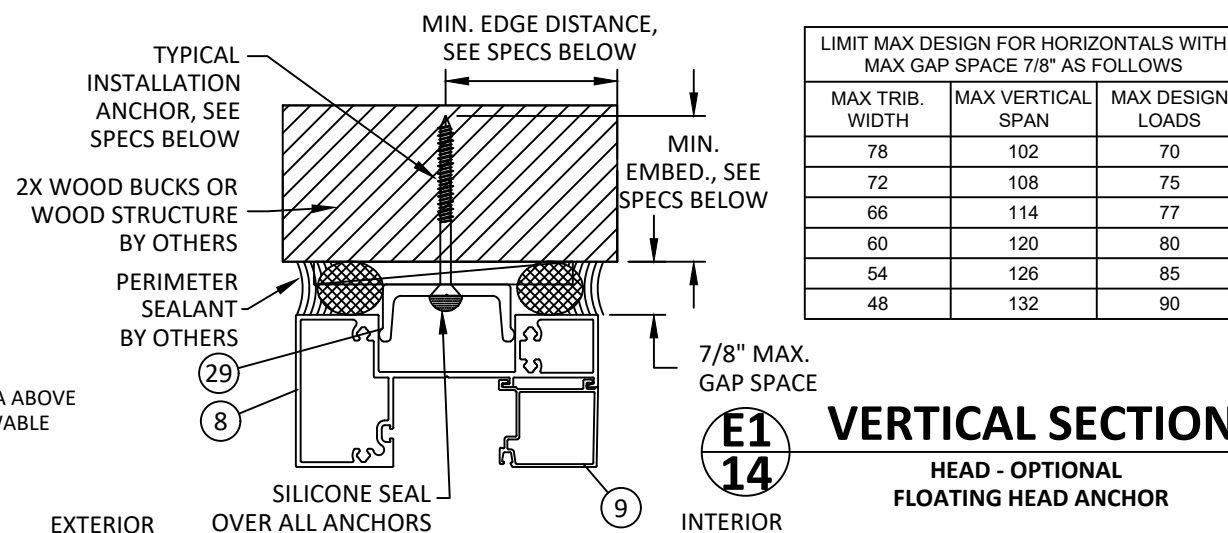

LIMIT MAX DESIGN FOR HORIZONTALS WITH MAX GAP SPACE 7/8" AS FOLLOWS		
MAX TRIB. WIDTH	MAX VERTICAL SPAN	MAX DESIGN LOADS
78	102	70
72	108	75
66	114	77
60	120	80
54	126	85
48	132	90

E1
14 VERTICAL SECTION
HEAD - OPTIONAL
FLOATING HEAD ANCHOR

YHS 50 FS ANCHOR SCHEDULE				
ANCHOR TYPE	ANCHOR DESCRIPTION	SUBSTRATE REQUIREMENTS	MIN. EMBEDMENT	MIN. EDGE DISTANCE
A	5/16" DEWALT ULTRAICON	CONCRETE	2"	3-1/8"
	5/16" ITW TAPCON+	MIN. F'C = 3000 PSI	1-1/4"	2-3/16"
	5/16" SELF-DRILLING SCREW (GRADE 5)	STEEL: MIN. 12 GA., MIN. Fy=36 KSI ALUM.: MIN. 1/8", MIN. 6063-T5"	3 THREADS PENETRATION PAST METAL STRUCTURE	3/4"
B	5/16" ITW TAPCON+	GROUT-FILLED BLOCK PER C-90, MIN. F'C = 2000 PSI	1-1/4"	3"
	5/16" DEWALT ULTRAICON	WOOD MIN. S.G. = 0.55	1-1/2"	1-9/16"
	5/16" DEWALT TAPPER+	CONCRETE	1-3/4"	2-1/2"
C	1/4" SELF-DRILLING SCREW (GRADE 5)	STEEL: MIN. 12 GA., MIN. Fy=36 KSI ALUM.: MIN. 1/8", MIN. 6063-T5"	3 THREADS PENETRATION PAST METAL STRUCTURE	3/4"
	1/4" ITW TAPCON	CONCRETE	1-3/4"	1-1/2"
	1/4" DEWALT ULTRAICON+	MIN. F'C = 3000 PSI	1-3/4"	1-1/2"
D	5/16" DEWALT ULTRAICON	GROUT-FILLED BLOCK PER C-90, MIN. F'C = 2000 PSI	1-3/4"	2-1/2"
	1/4" DEWALT TAPPER+	WOOD MIN. S.G. = 0.55	1-1/2"	3"
	1/4" DEWALT ULTRAICON+	CONCRETE	1-1/2"	1"
E	1/4" DEWALT TAPPER+	CONCRETE	1-3/4"	1-3/4"
	1/4" DEWALT ULTRAICON+	MIN. F'C = 3000 PSI	1-3/4"	1-3/4"
	1/4" ITW TAPCON	GROUT-FILLED BLOCK PER C-90, MIN. F'C = 2000 PSI	1"	2"



YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
YHS 50 FS IG ALUMINUM STOREFRONT
SYSTEM - INSIDE GLAZED
(WZ3) (IMPACT)

VERTICAL SECTIONS
& ANCHOR DESCRIPTIONS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132


PH: (954) 399-8478
FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

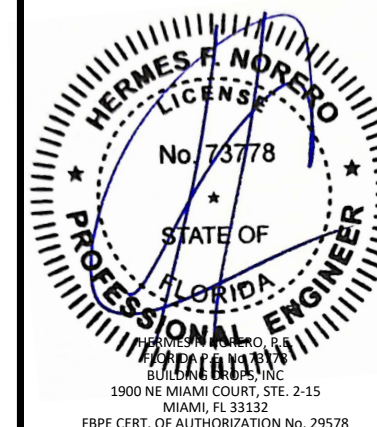

FL #:

FL14218

DATE: 01.27.16

DWG. BY:
SM

CHK. BY:
HFN


SCALE: NTS

DWG. #: YKK168


SHEET:

14


c:\users\sebastianhereros\building drops, inc\building drops, inc\projects\ykhk ap america, inc\fbc-26-m123 - fl14218 yhs 50 tu pre-glazed storefront systems\dwgs\16 ykhk168.dwg
2/11/2026 8:33 AM
c:\users\sebastianhereros\building drops, inc\building drops, inc\projects\ykhk ap america, inc\fbc-26-m123 - fl14218 yhs 50 tu pre-glazed storefront systems\dwgs\16 ykhk168.dwg

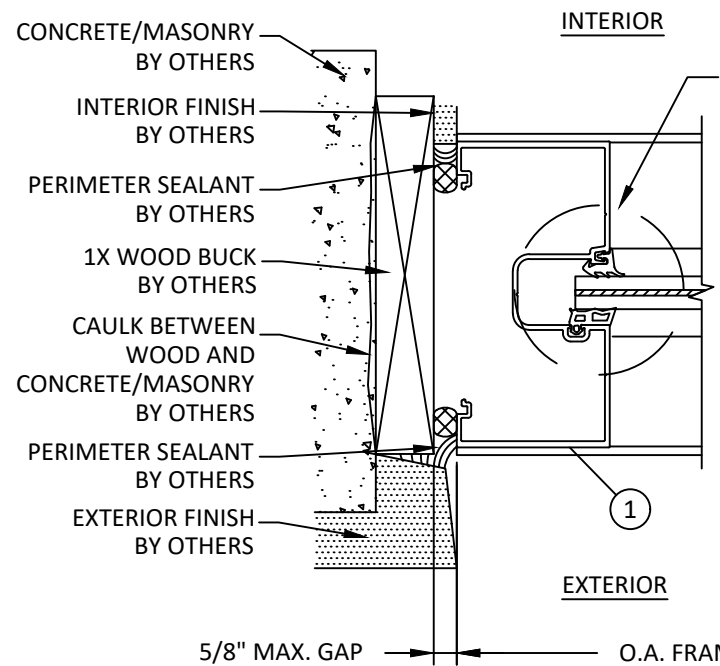


F **HORIZONTAL SECTION**
15 JAMB - CONCRETE/MASONRY W/ 1X BUCK
LIGHT CONFIGURATION

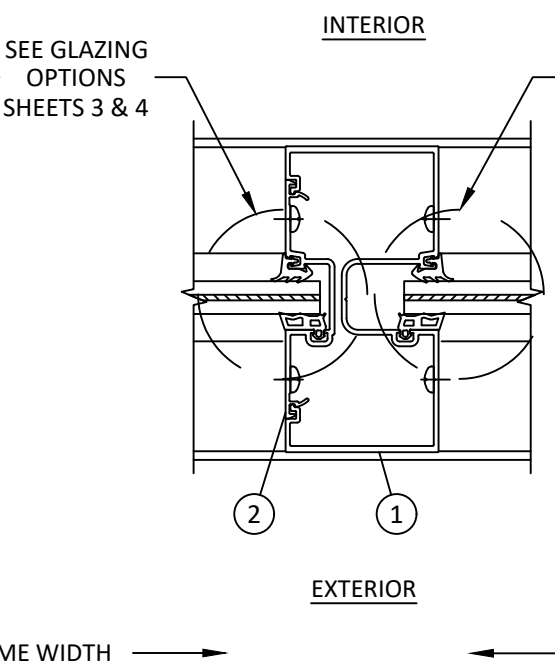


G **HORIZONTAL SECTION**
15 VERTICAL MULLION
LIGHT CONFIGURATION

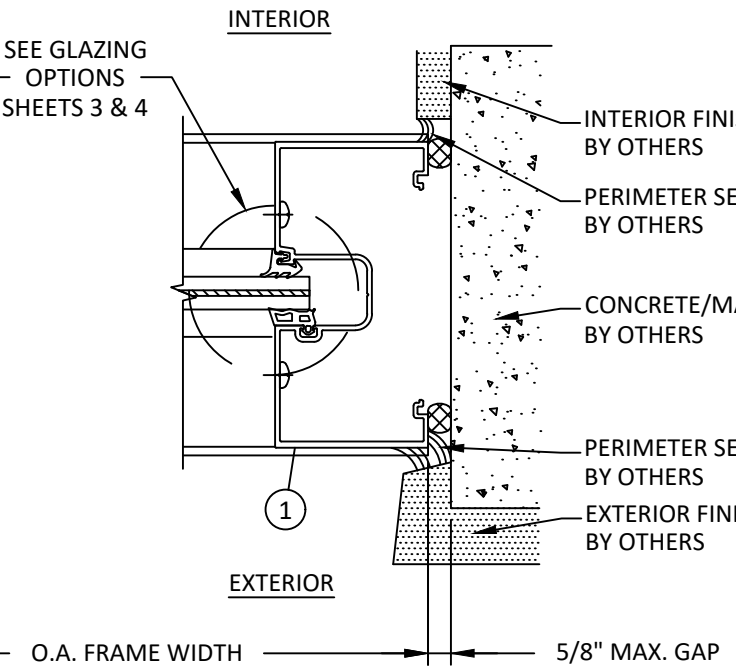


H **HORIZONTAL SECTION**
15 JAMB - DIRECT TO CONCRETE/MASONRY
LIGHT CONFIGURATION

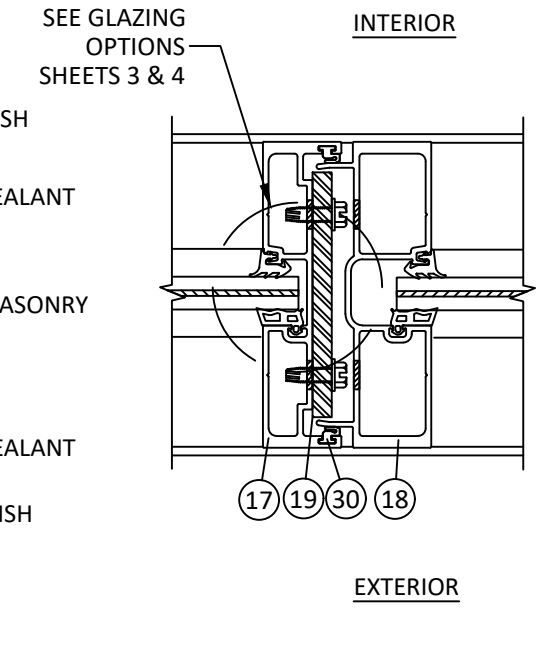


I **HORIZONTAL SECTION**
15 VERTICAL EXPANSION MULLION

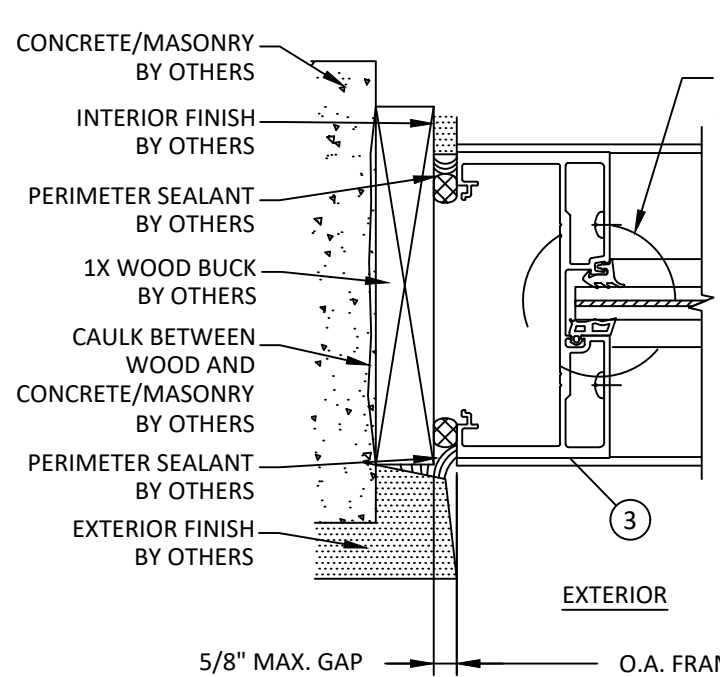


J **HORIZONTAL SECTION**
15 JAMB - CONCRETE/MASONRY W/ 1X BUCK
MEDIUM CONFIGURATION

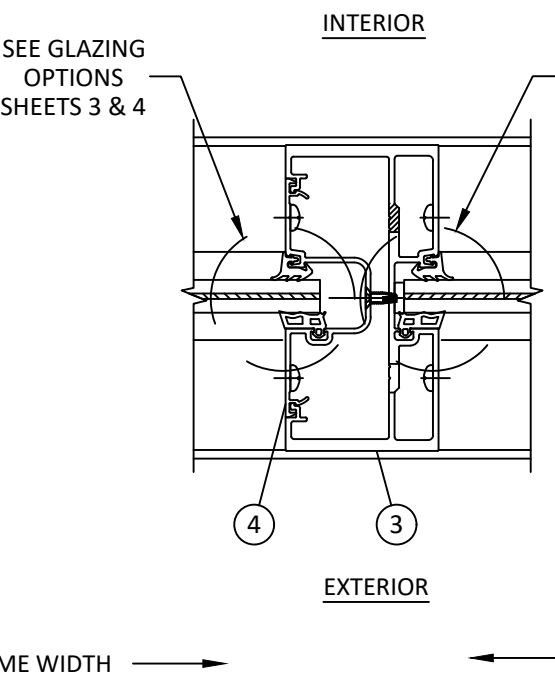

K **HORIZONTAL SECTION**
15 VERTICAL MULLION
MEDIUM CONFIGURATION

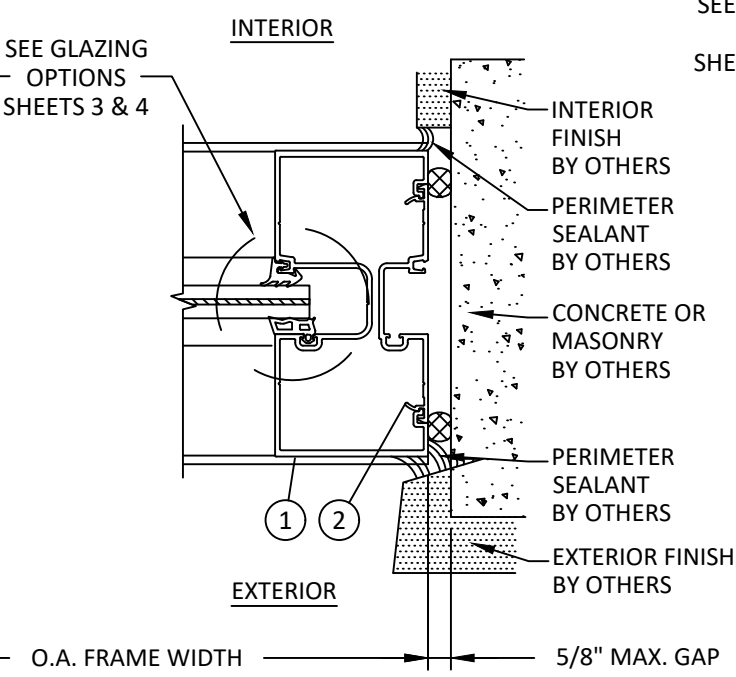

L **HORIZONTAL SECTION**
15 JAMB - DIRECT TO CONCRETE/MASONRY
MEDIUM CONFIGURATION

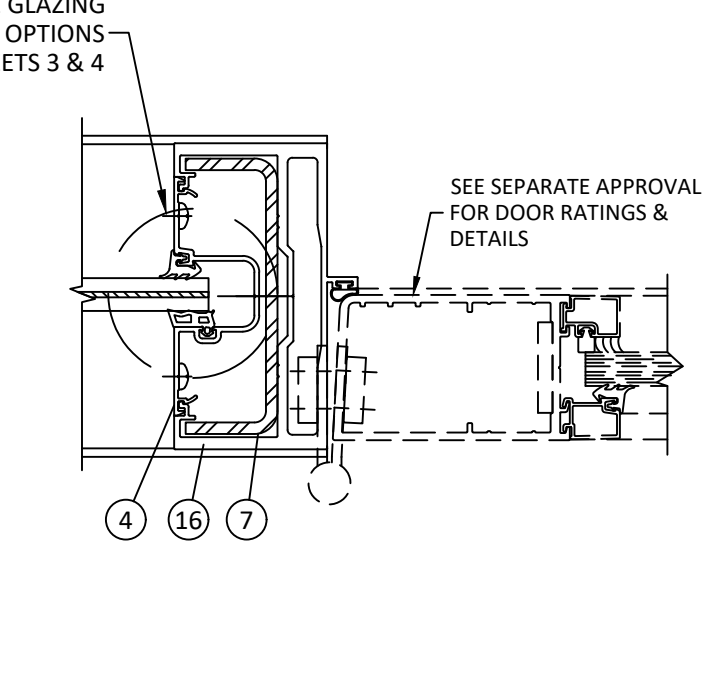

M **HORIZONTAL SECTION**
15 DOOR JAMB MULLION

Quality
inspires™

YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
YHS 50 FS IG ALUMINUM STOREFRONT
SYSTEM - INSIDE GLAZED
(WZ3) (IMPACT)

HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.
B.S. in Mechanical Engineering
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL14218

DATE: **01.27.16**

DWG. BY:

SM

CHK. BY:

HFN

SCALE: **NTS**


DWG. #: **YKK168**

SHEET:

15

[Page 16 of 19]


c:\users\sebastianherrerros\building drops, inc\building drops\york ap america, inc\fb-26-0123 - fl14218 yns 50 tu pre-glazed storefront systems\dwgs\york168.dwg
2/11/2026 8:33 AM
c:\users\sebastianherrerros\building drops, inc\building drops\york ap america, inc\fb-26-0123 - fl14218 yns 50 tu pre-glazed storefront systems\dwgs\york168.dwg

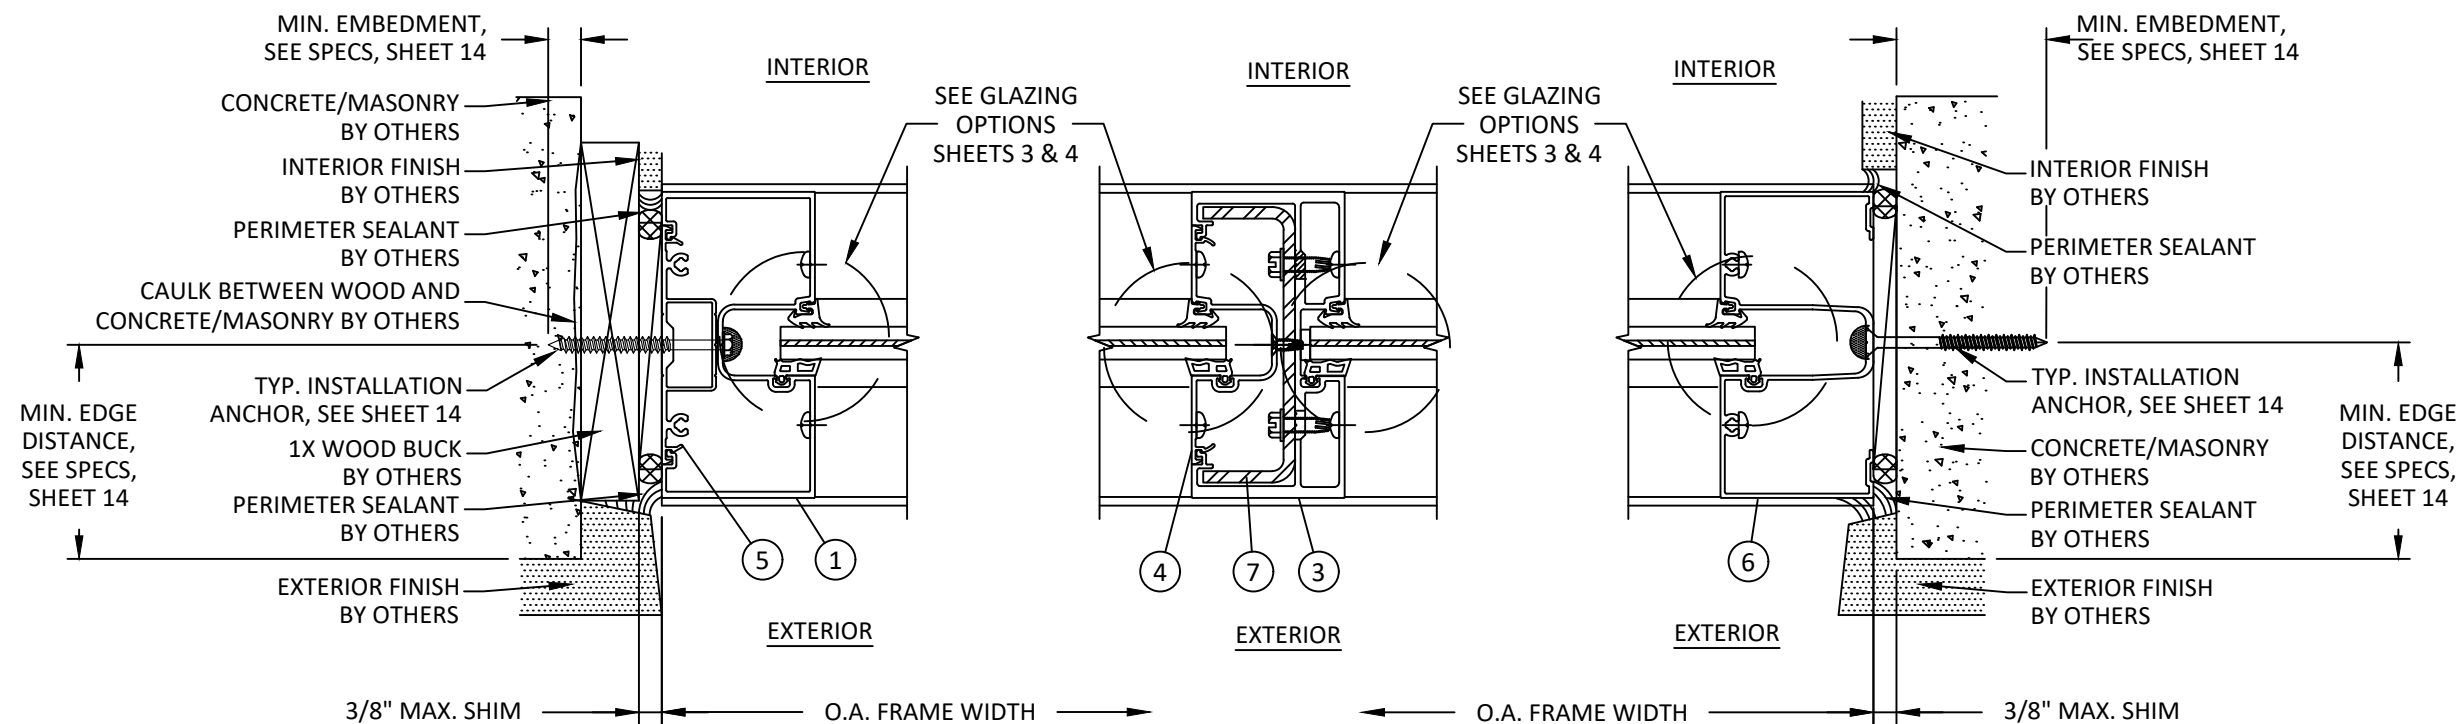

N
16 **HORIZONTAL SECTION**
JAMB - CONCRETE/MASONRY W/ 1X BUCK
HEAVY CONFIGURATION


O
16 **HORIZONTAL SECTION**
VERTICAL MULLION
HEAVY CONFIGURATION

P
16 **HORIZONTAL SECTION**
JAMB - DIRECT TO CONCRETE/MASONRY
HEAVY CONFIGURATION

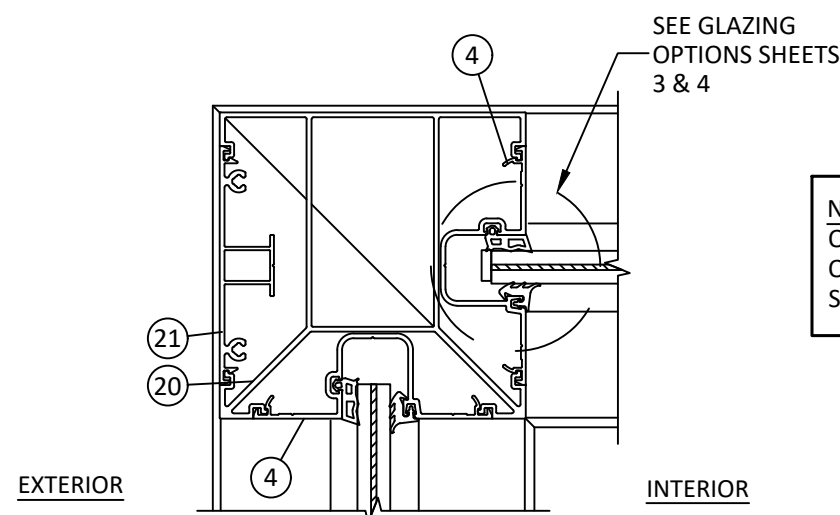

Q
16 **HORIZONTAL SECTION**
90 DEGREE CORNER MULLION

NOTE: CORNER MULLIONS MAY BE ORIENTED TO EXTERIOR (AS SHOWN ON 90° DETAIL) OR TO INTERIOR (AS SHOWN ON 135° DETAIL).

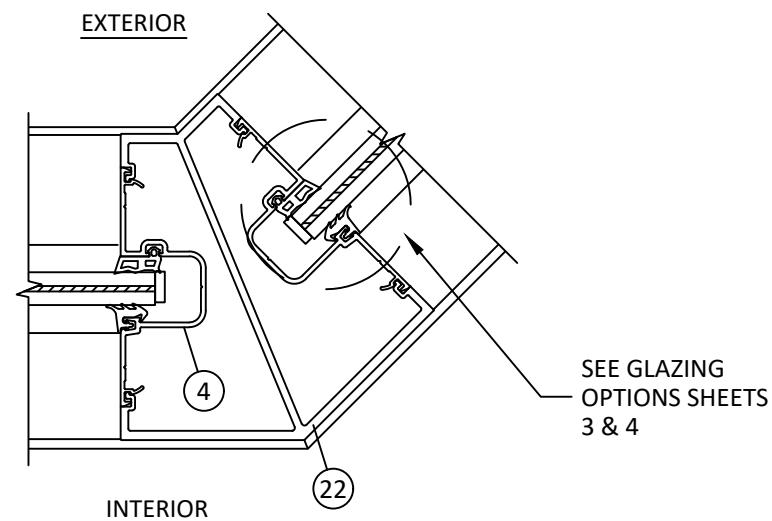

R
16 **HORIZONTAL SECTION**
135 DEGREE CORNER MULLION



YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
YHS 50 FS IG ALUMINUM STOREFRONT
SYSTEM - INSIDE GLAZED
(WZ3) (IMPACT)

HORIZONTAL SECTIONS

PREPARED BY:


BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
ANCHOR UPDATE	SH	02.11.26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

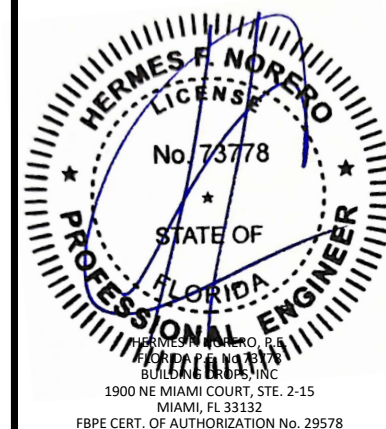


FL #:	FL14218
DATE:	01.27.16
DWG. BY:	CHK. BY:
SM	HFN
SCALE:	NTS
DWG. #:	YKK168
SHEET:	

16


ITEM	PART NO.	DESCRIPTION	MATERIAL
1	E9-0623	JAMB / VERTICAL	6063-T5
2	E9-0617	SHALLOW POCKET FILLER	6063-T5
3	E9-0605	HEAVY DUTY VERTICAL	6063-T6
4	E9-0606	DEEP POCKET FILLER	6063-T5
5	E1-1068	FLAT FILLER AT PERIMETER ANCHOR	6063-T5
6	E9-0622	HEAD / JAMB	6063-T5
7	E1-1062	STEEL CHANNEL (1-1/2" X 4-1/2" X 3/16")	A36 STEEL
8	E9-8649	HEAD	6063-T5
9	E9-0608	GLASS STOP	6063-T5
10	E9-0603	HORIZONTAL	6063-T5
11	E9-8646	SILL	6063-T5
12	E9-8647	SILL HOLE SNAP COVER	6063-T5
13	E9-7993	SILL FLASHING	6063-T5
14	E2-0088	INTERIOR GLAZING GASKET	EPDM
15	E2-0083	EXTERIOR GLAZING GASKET	EPDM
16	E9-0504	DOOR JAMB O/P	6063-T6
17	E9-0518	EXPANSION MULLION (FEMALE)	6063-T6
18	E9-0519	EXPANSION MULLION (MALE)	6063-T6
19	---	EXPANSION MULLION REINFORCEMENT	A36 STEEL
20	E9-0659	90° CORNER MULLION	6063-T5
21	E9-0657	CORNER MULLION FILLER	6063-T5
22	E9-0660	135° CORNER MULLION	6063-T5
24	E2-0080	SETTING BLOCK	EPDM (85±5)
28	E9-8650	HEAD ANCHOR	6063-T5
29	E2-0019	SETTING BLOCK	EPDM (85±5)
30	K2-2441	WEATHERING GASKET	EPDM

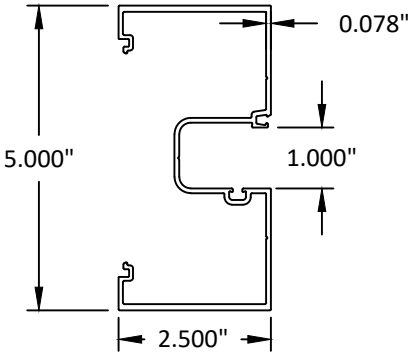


1 JAMB/VERTICAL

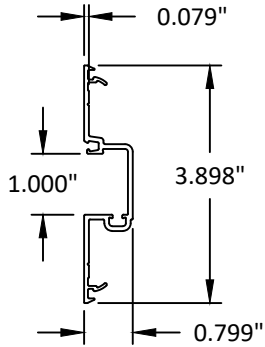


2 SHALLOW POCKET FILLER

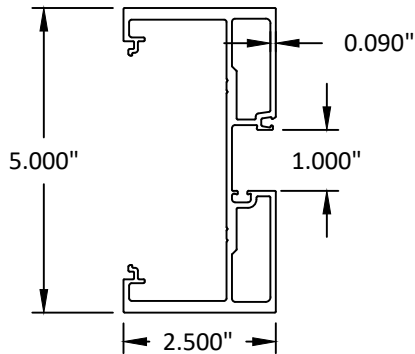


3 HEAVY DUTY VERTICAL

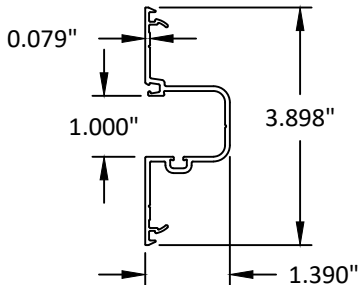


4 DEEP POCKET FILLER

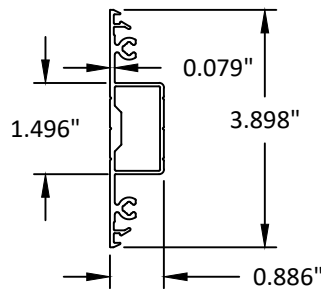


5 FLAT FILLER AT PERIMETER ANCHOR

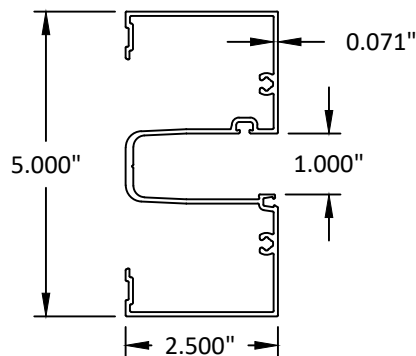

6 HEAD/JAMB

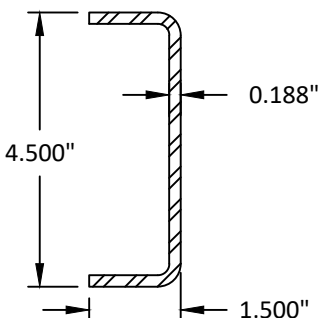

7 STEEL CHANNEL (1-1/2" X 4-1/2" X 3/16")

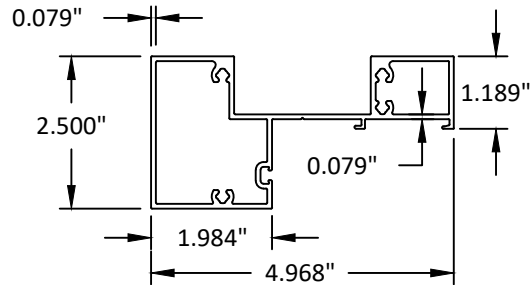

8 HEAD



YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
YHS 50 FS IG ALUMINUM STOREFRONT
SYSTEM - INSIDE GLAZED
(WZ3) (IMPACT)

COMPONENTS & BILL OF MATERIALS

PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.




FL #:	FL14218
DATE:	01.27.16
DWG. BY:	CHK. BY:
SM	HFN
SCALE:	NTS
DWG. #:	YKK168


SHEET:

17


c:\users\sebastianhereros\building drops, inc\building drops, inc\projects\ykk ap america, inc\fb-26-0123 - fl14218 yhs 50 tu pre-glazed storefront systems\dwgs\y\ykk168.dwg 2/11/2026 8:33 AM

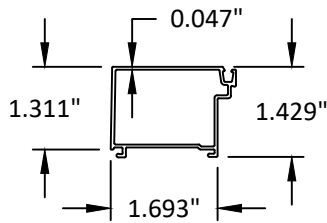


9 GLASS STOP

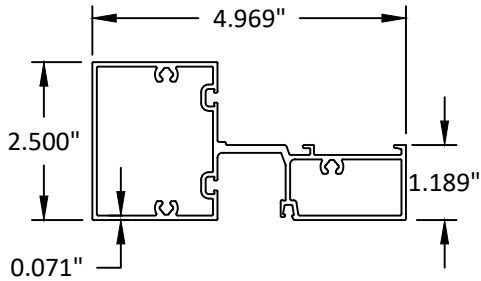


10 HORIZONTAL

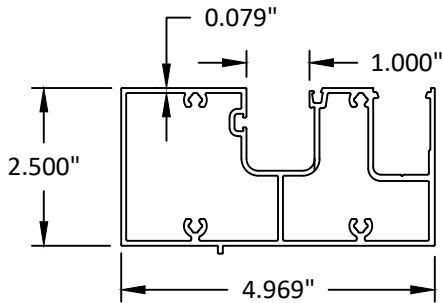


11 SILL

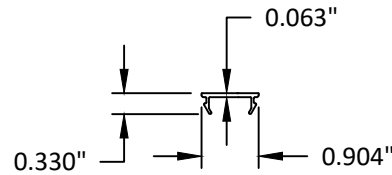


12 SILL HOLE COVER

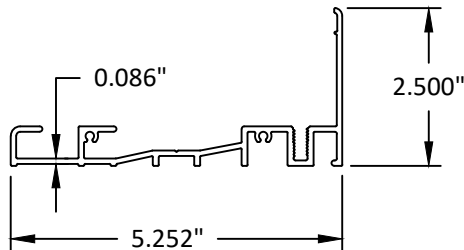


13 SILL FLASHING

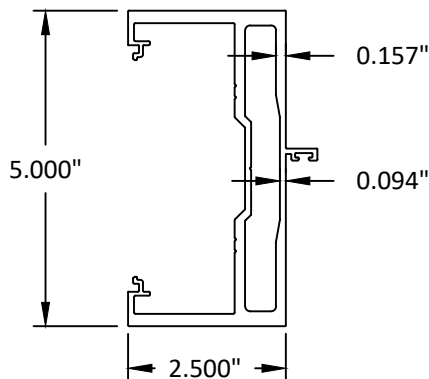


16 DOOR JAMB O/P

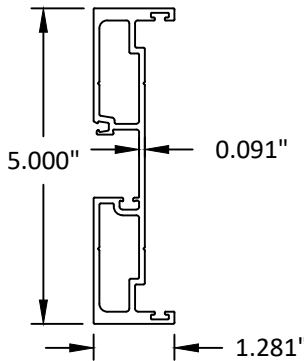


17 EXPANSION MULLION (FEMALE)

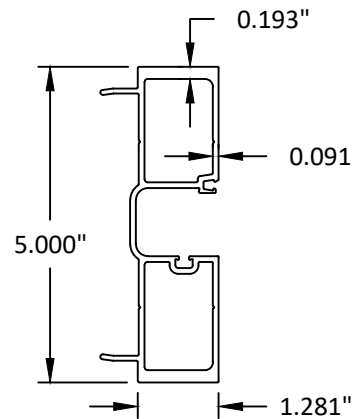


18 EXPANSION MULLION (MALE)




19 STEEL REINFORCEMENT BAR

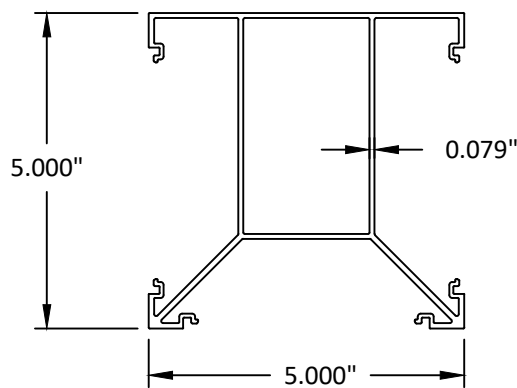


20 90 DEGREE CORNER MULLION

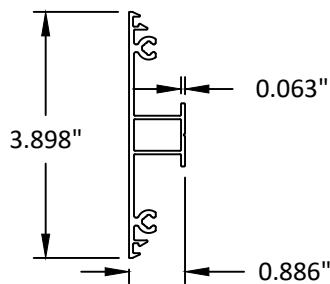

21 CORNER MULLION FILLER

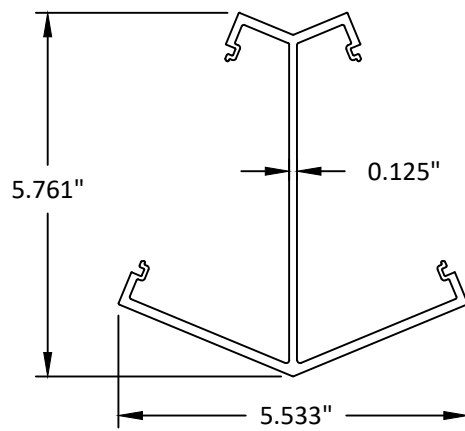

22 135 DEGREE CORNER MULLION

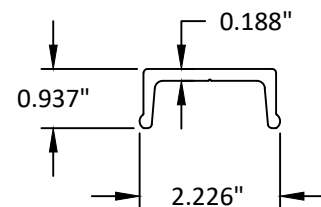

28 HEAD ANCHOR



YKK AP AMERICA, INC.
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
YHS 50 FS IG ALUMINUM STOREFRONT
SYSTEM - INSIDE GLAZED
(WZ3) (IMPACT)


COMPONENTS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE UPDATE	RV	07.12.17
MISC. UPDATES	SH	12.15.22
ANCHOR UPDATE	SH	02.11.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

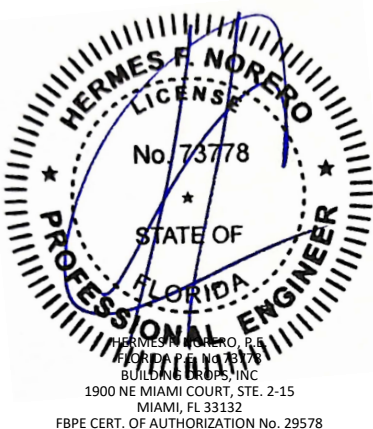

FL #:
FL14218

DATE: **01.27.16**

DWG. BY: **SM** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **YKK168**

SHEET:

18