

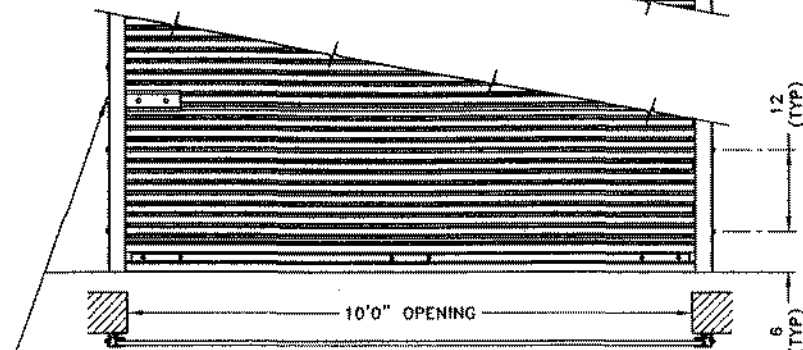
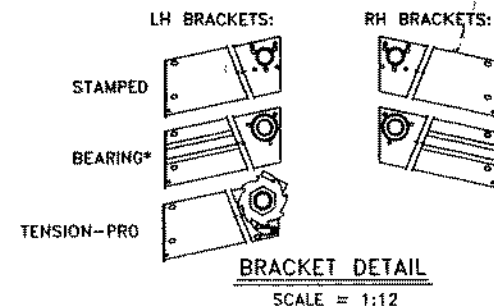


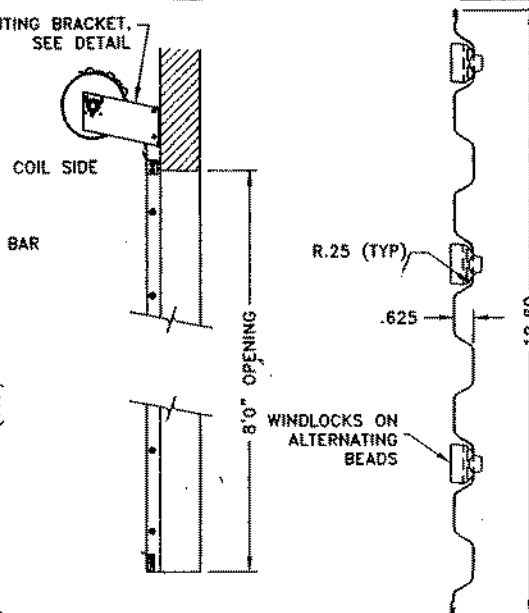

CURTAIN LOCK, LEFT HAND SIDE,
ENGAGED DURING TESTS


COILSIDE ELEVATION

SCALE = NONE

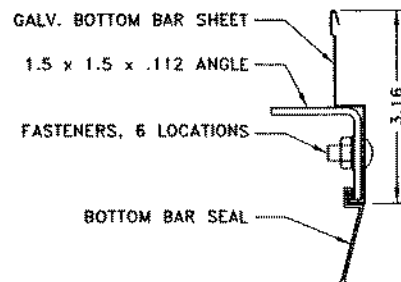

DS-75 BOTTOM BAR DETAIL

SCALE = 1:2

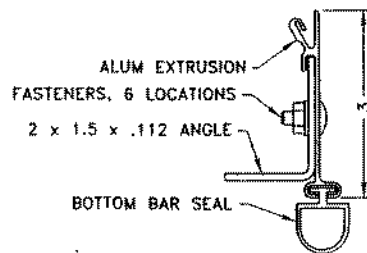

DS-100 BOTTOM BAR DETAIL*

SCALE = 1:2



Test sample complies with these details.
Deviations are noted.

Report# 01-46384.01

Date 10-31-03 Tech SBK


NOTES:

1. UNIFORM STATIC AIR PRESSURE TEST PERFORMED PER ASTM E 330
2. TENSILE TEST PERFORMED ON CURTAIN PER ASTM E 8
3. TESTED BY ARCHITECTURAL TESTING, INC.
4. CURTAIN IS .018 MIN STEEL PER ASTM A 653, GR.40
5. SEE 035-0008 FOR COMPONENT DETAILS


TEST	DATE	TEST REPORT NUMBER	RESULTS
UNIFORM STATIC AIR PRESSURE	.	.	.
TENSILE	.	.	.

*DENOTES UNTESTED CONFIGURATIONS APPROVED BY COMPARATIVE ANALYSIS


PART NUMBER	WEIGHT (LB.)	TITLE	DRAWN BY	CHECKED BY	APPVD. BY	TOLERANCES (UNLESS OTHERWISE SPECIFIED)	 Wayne Dalton Rolling Door Division 14512 Lincoln Way Dallas, Ohio 44111	
REFERENCE		WINDLOAD TEST, DS-75/DS-100, 10' x 8', SQUARE PROFILE PANEL, ±34 PSF DESIGN (±51 PSF TEST)	M. DAUS 10/15/2003			LINEAR .X ± .060 LINEAR .XX ± .030 LINEAR .XXX ± .010 ANGULAR ± .50°		
		MATERIAL AS SHOWN	SCALE - WHEN THIS D.W. IS .50" HIGH	ORIGINAL RELEASE		DIMENSIONS IN INCHES		
THIS DRAWING IS THE PROPERTY OF WAYNE DALTON AND IS LOANED WITH THE EXPRESSED AGREEMENT THAT THE DRAWINGS AND INFORMATION THEREIN CONTAINED ARE THE PROPERTY OF WAYNE DALTON AND WILL NOT BE REPRODUCED, COPIED, OR OTHERWISE DISPOSED OF, DIRECTLY OR INDIRECTLY, AND WILL NOT BE USED IN WHOLE OR IN PART TO ASSIST IN MARKING OR TO FURNISH ANY INFORMATION FOR THE MAKING OF DRAWINGS, PRINTS, OR OTHER REPRODUCTIONS, EXCEPT AS MAY BE AUTHORIZED BY THE WRITTEN PERMISSION OF WAYNE DALTON. THIS PERMISSION IS NOT TO BE USED IN ANY MANNER THAT WOULD BE IN VIOLATION OF THE PATENT RIGHTS OF WAYNE DALTON. THE ACCEPTANCE OF THIS DRAWING WILL BE CONSIDERED AS AN ACCEPTANCE OF THE FOREGOING AGREEMENT.							SIZE B 035-0007	DRAWING NO. REVISION



STEEL JAMB
#5/16-12 x 1 SELFDRILLING SCREW




MASONRY JAMB #1
GROUT FILLED BLOCK, 3000PSI MIN GROUT
#3/8 x 3 KINGPIN WEDGE ANCHOR




MASONRY JAMB #2*
CONCRETE, 3000PSI MIN
#3/8 x 3 KINGPIN WEDGE ANCHOR




JAMB DETAIL
SCALE = NONE

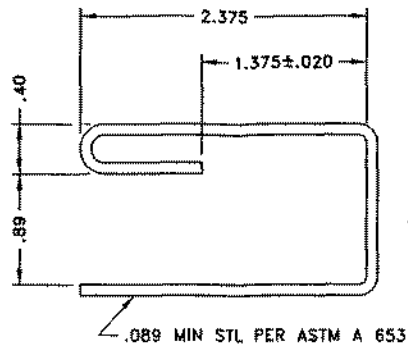


G-GUIDE DETAIL
SCALE = FULL

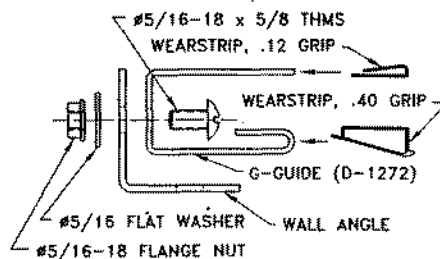

GUIDE ASSEMBLY DETAIL
SCALE = 1:2

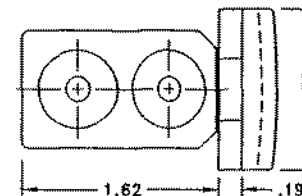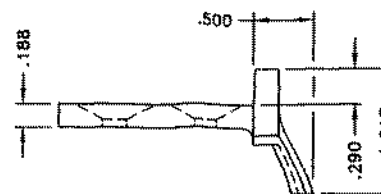

WINDLOCK DETAIL
SCALE = FULL

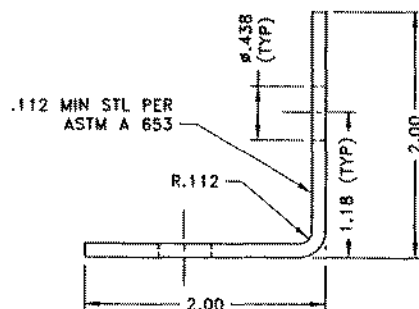

WALL ANGLE DETAIL
SCALE = FULL



Test sample complies with these details.
Deviations are noted.

Report# 01-46384.01

Date 10-31-03 Tech SAK

NOTE:

1. UNIFORM STATIC AIR PRESSURE TEST PERFORMED PER ASTM E 330
2. TENSILE TEST PERFORMED PER ASTM E 8
3. TESTED BY ARCHITECTURAL TESTING, INC.
4. SEE 035-0007 FOR TEST DETAILS

TEST	DATE	TEST REPORT NUMBER	RESULTS
UNIFORM STATIC AIR PRESSURE			
TENSILE			

*DENOTES UNTESTED CONFIGURATIONS APPROVED BY COMPARATIVE ANALYSIS

PART NUMBER	WEIGHT (LB.)	TITLE	DRAWN BY	CHECKED BY	APPVD. BY	TOLERANCES (UNLESS OTHERWISE SPECIFIED)
REFERENCE		WINDLOAD TEST, DS-75/DS-100, SQUARE PROFILE PANEL, COMPONENT DETAILS	M. DAUS			LINEAR .X ± .060
		MATERIAL AS SHOWN	10/15/2003			LINEAR .XX ± .030
			SCALE - WHEN THIS BOX IS .50" HIGH	ORIGINAL RELEASE		LINEAR .XXX ± .010
			AS SHOWN			ANGULAR ± .50°
						DIMENSIONS IN INCHES



Wayne Dalton
Rolling Door Division
4512 Lincoln Way E.
Dalton, Ohio 44618

THIS DRAWING IS THE PROPERTY OF WAYNE DALTON AND IS LOANED WITH THE EXPRESSED AGREEMENT THAT THE DRAWINGS AND INFORMATION THEREIN CONTAINED ARE THE PROPERTY OF WAYNE DALTON AND WILL NOT BE REPRODUCED, COPIED, OR OTHERWISE DISPOSED OF, DIRECTLY OR INDIRECTLY, AND WILL NOT BE USED IN WHOLE OR IN PART TO ASSIST IN MAKING OR TO FURNISH ANY INFORMATION FOR THE MAKING OF DRAWINGS, PATENTS, OR OTHER REPRODUCTION THEREOF, OR FOR THE MAKING OF APPARATUS OR PARTS THEREOF, EXCEPT BY WRITTEN PERMISSION OF WAYNE DALTON FIRST OBTAINED AND SPECIFIC AS TO EACH CASE. THE ACCEPTANCE OF THIS DRAWING WILL BE CONSIDERED AS AN ACCEPTANCE OF THE FOREGOING AGREEMENT.

REV.	REV. BY	APPVD. BY	RELEASE	DESCRIPTION
				REVISIONS

SIZE	DRAWING NO.	REVISION
B	035-0008	