

| REVISIONS |                 |          |          |
|-----------|-----------------|----------|----------|
| REV       | DESCRIPTION     | DATE     | APPROVED |
| D         | REVISED DETAILS | 05/05/26 | R.L.     |

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.

2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.

3. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.

4. BUCKS SHALL EXTEND BEYOND UNIT FRAME INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.

5. ALLOWABLE STRESS INCREASE OF 1/3 WAS NOT USED IN THE DESIGN OF THE PRODUCT SHOWN HEREIN. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.

6. FRAME MATERIAL: ALUMINUM 6063-T6 AND 6005A-T5.

7. UNITS MUST BE GLAZED PER ASTM E1300, WITH SAFETY GLAZING.

8. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.

9. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8".
10. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #14 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 3/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

11. FOR ANCHORING INTO MASONRY/CONCRETE USE 1/4" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

12. FOR ANCHORING INTO METAL STRUCTURE USE #14 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

13. ALL FASTENERS TO BE CORROSION RESISTANT.

14. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:

14.1. WOOD – MINIMUM SPECIFIC GRAVITY OF G=0.42

14.2. CONCRETE – MINIMUM COMPRESSIVE STRENGTH OF 3,000 PSI.

14.3. MASONRY – STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).

14.4. METAL STRUCTURE: STEEL 18GA, 33KSI OR ALUMINUM 6063-T5 .125" THICK MINIMUM

| TABLE OF CONTENTS |                                             |
|-------------------|---------------------------------------------|
| SHEET NO.         | DESCRIPTION                                 |
| 1                 | NOTES                                       |
| 2                 | ELEVATIONS                                  |
| 3                 | ANCHORING LAYOUT AND DESIGN PRESSURE CHARTS |
| 4 – 7             | CROSS SECTIONS                              |
| 8 – 9             | INSTALLATION DETAILS                        |
| 10                | WEEP DETAILS                                |
| 11                | COMPONENTS                                  |

SOLAR INNOVATIONS, INC.

31 ROBERTS RD  
PINE GROVE, PA 17963

SERIES SI3000 STANDARD INFOLD ALUMINUM FGW  
NON-IMPACT  
NOTES

DRAWN:  
V.L.

DWG NO.  
08-01960

REV  
D


SCALE NTS

DATE 04/22/13


SHEET 1 OF 11

L. ROBERTO LOMAS P.E.  
208 7th Ave, INDIALANTIC, FL 32903  
434-688-0609 rllomas@lrlomaspe.com


SIGNED: 05/05/2026

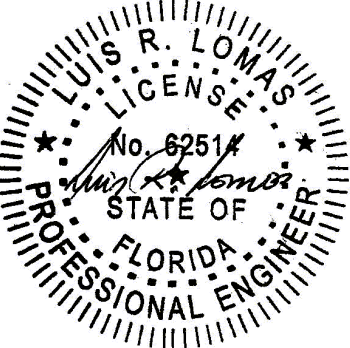

Luis R. Lomas P.E.  
FL No.: 62514

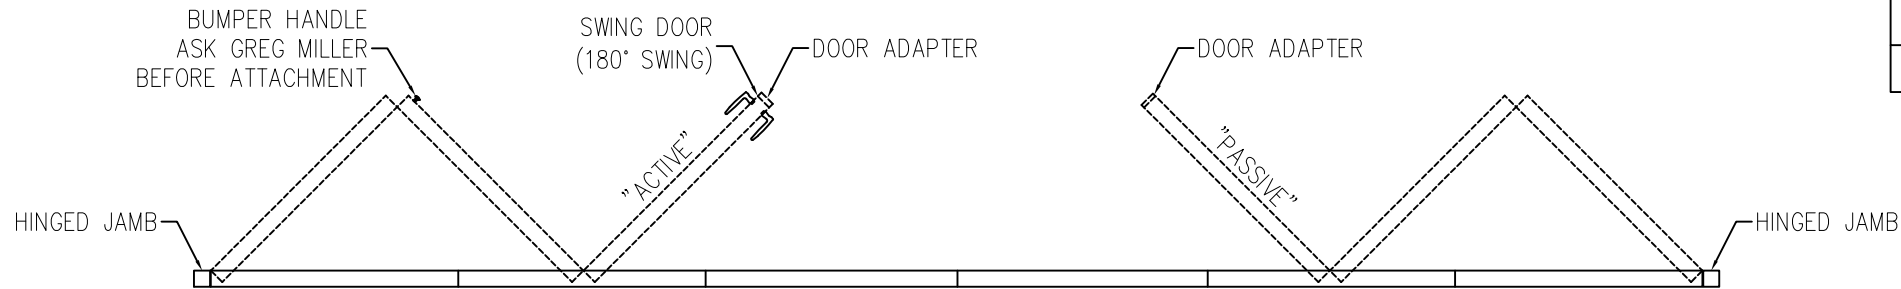

| REVISIONS |                 |          |          |
|-----------|-----------------|----------|----------|
| REV       | DESCRIPTION     | DATE     | APPROVED |
| D         | REVISED DETAILS | 05/05/26 | R.L.     |

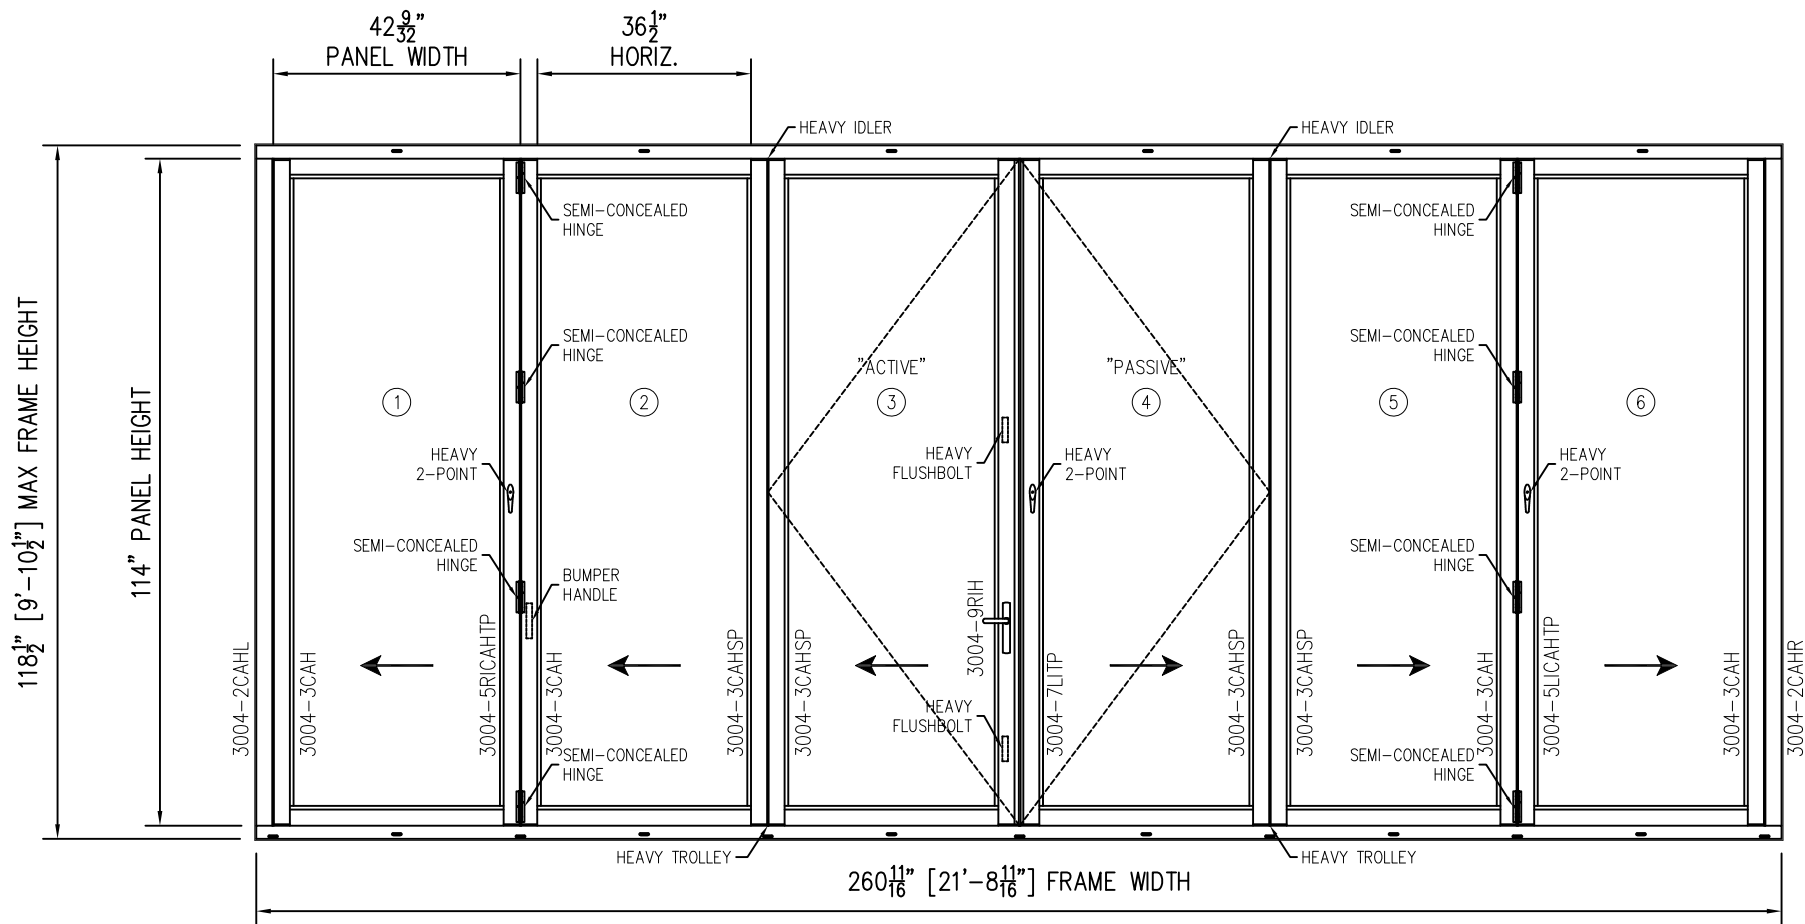

| DESIGN PRESSURE RATING | IMPACT RATING |
|------------------------|---------------|
| +60.0/-70.0psf         | NONE          |

WHERE WATER RESISTANCE IS REQUIRED  
SEE CHART #1, SHEET 3

| DESIGN PRESSURE RATING | IMPACT RATING |
|------------------------|---------------|
| ±70.0psf               | NONE          |

WHERE WATER RESISTANCE IS NOT REQUIRED  
SEE CHART #2, SHEET 3

| DESIGN PRESSURE RATING | IMPACT RATING |
|------------------------|---------------|
| ±55.0PSF               | NONE          |

UNITS WITH FLUSH SILL  
SEE CHART #3, SHEET 3

**SERIES SI3000 STANDARD INFOLD ALUMINUM FGW NON-IMPACT**  
**EXTERIOR VIEW**

UNLIMITED NUMBER OF PANELS IN UNLIMITED CONFIGURATION ARE APPROVED  
AS LONG AS INDIVIDUAL PANEL AREA DOES NOT EXCEED 33.32 FT² AND USES VERTICAL CONDITIONS AS SHOWN.

- NOTES:
- PANEL SIZE: 42 9/32" x 114"
  - D.L.O. SIZE: 35 9/32" x 107 1/4"

**HARDWARE SCHEDULE**

|                                                          |
|----------------------------------------------------------|
| A. SEMI-CONCEALED HINGE BY SOLAR INNOVATIONS             |
| B 2 POINT HANDLE & LOCK MS000487-XX BY SOLAR INNOVATIONS |
| C 3 POINT HANDLE & LOCK BY SOLAR INNOVATIONS             |
| D HEAVY FLUSH BOLTS MS000442-00-XX BY SOLAR INNOVATIONS  |
| E SURFACE MOUNT HINGE BY SOLAR INNOVATIONS               |

**SOLAR INNOVATIONS, INC.**


31 ROBERTS RD  
PINE GROVE, PA 17963

SERIES SI3000 STANDARD INFOLD ALUMINUM FGW  
NON-IMPACT  
ELEVATION

|                |                     |                  |
|----------------|---------------------|------------------|
| DRAWN:<br>V.L. | DWG NO.<br>08-01960 | REV<br>D         |
| SCALE<br>NTS   | DATE<br>04/22/13    | SHEET<br>2 OF 11 |

L. ROBERTO LOMAS P.E.  
208 7th Ave, INDIALANTIC, FL 32903  
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 05/05/2026

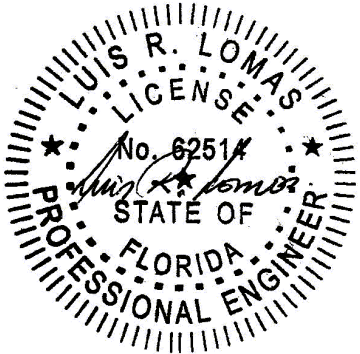

Luis R. Lomas P.E.  
FL No.: 62514

| REVISIONS |                 |          |          |
|-----------|-----------------|----------|----------|
| REV       | DESCRIPTION     | DATE     | APPROVED |
| D         | REVISED DETAILS | 05/05/26 | R.L.     |

Chart #1

| Maximum Design pressure (psf) |                         |       |      |       |      |       |       |       |      |      |
|-------------------------------|-------------------------|-------|------|-------|------|-------|-------|-------|------|------|
| Panel Height (in)             | Single Panel Width (in) |       |      |       |      |       |       |       |      |      |
|                               | 24.0                    |       | 30.0 |       | 36.0 |       | 42.28 |       | 48.0 |      |
|                               | Pos                     | Neg   | Pos  | Neg   | Pos  | Neg   | Pos   | Neg   | Pos  | Neg  |
| 78.0                          | 60.0                    | 105.0 | 60.0 | 105.0 | 60.0 | 105.0 | 60.0  | 102.3 | 60.0 | 90.1 |
| 84.0                          | 60.0                    | 105.0 | 60.0 | 105.0 | 60.0 | 105.0 | 60.0  | 95.0  | 60.0 | 83.7 |
| 90.0                          | 60.0                    | 105.0 | 60.0 | 105.0 | 60.0 | 104.1 | 60.0  | 88.7  | 60.0 | 78.1 |
| 96.0                          | 60.0                    | 105.0 | 60.0 | 105.0 | 60.0 | 97.6  | 60.0  | 83.1  | 60.0 | 73.2 |
| 102.0                         | 60.0                    | 105.0 | 60.0 | 105.0 | 60.0 | 90.9  | 60.0  | 78.2  | -    | -    |
| 108.0                         | 60.0                    | 105.0 | 60.0 | 98.5  | 60.0 | 84.8  | 60.0  | 73.9  | -    | -    |
| 114.0                         | 60.0                    | 105.0 | 60.0 | 92.5  | 60.0 | 79.5  | 60.0  | 70.0  | -    | -    |
| 120.0                         | 60.0                    | 101.6 | 60.0 | 82.0  | 60.0 | 69.1  | -     | -     | -    | -    |
| 126.0                         | 60.0                    | 87.6  | 60.0 | 70.7  | 59.5 | 59.5  | -     | -     | -    | -    |
| 132.0                         | 60.0                    | 76.1  | 60.0 | 61.4  | 51.6 | 51.6  | -     | -     | -    | -    |
| 138.0                         | 60.0                    | 66.6  | 53.6 | 53.6  | -    | -     | -     | -     | -    | -    |
| 144.0                         | 58.5                    | 58.5  | 47.1 | 47.1  | -    | -     | -     | -     | -    | -    |
| 150.0                         | 51.7                    | 51.7  | 41.6 | 41.6  | -    | -     | -     | -     | -    | -    |
| 156.0                         | 45.9                    | 45.9  | 37.0 | 37.0  | -    | -     | -     | -     | -    | -    |

Chart #2

| Maximum Design pressure (psf) |                         |       |       |       |       |       |       |       |      |      |
|-------------------------------|-------------------------|-------|-------|-------|-------|-------|-------|-------|------|------|
| Panel Height (in)             | Single Panel Width (in) |       |       |       |       |       |       |       |      |      |
|                               | 24.0                    |       | 30.0  |       | 36.0  |       | 42.28 |       | 48.0 |      |
|                               | Pos                     | Neg   | Pos   | Neg   | Pos   | Neg   | Pos   | Neg   | Pos  | Neg  |
| 78.0                          | 105.0                   | 105.0 | 105.0 | 105.0 | 105.0 | 105.0 | 102.3 | 102.3 | 90.1 | 90.1 |
| 84.0                          | 105.0                   | 105.0 | 105.0 | 105.0 | 105.0 | 105.0 | 95.0  | 95.0  | 83.7 | 83.7 |
| 90.0                          | 105.0                   | 105.0 | 105.0 | 105.0 | 104.1 | 104.1 | 88.7  | 88.7  | 78.1 | 78.1 |
| 96.0                          | 105.0                   | 105.0 | 105.0 | 105.0 | 97.6  | 97.6  | 83.1  | 83.1  | 73.2 | 73.2 |
| 102.0                         | 105.0                   | 105.0 | 105.0 | 105.0 | 90.9  | 90.9  | 78.2  | 78.2  | -    | -    |
| 108.0                         | 105.0                   | 105.0 | 98.5  | 98.5  | 84.8  | 84.8  | 73.9  | 73.9  | -    | -    |
| 114.0                         | 105.0                   | 105.0 | 92.5  | 92.5  | 79.5  | 79.5  | 70.0  | 70.0  | -    | -    |
| 120.0                         | 101.6                   | 101.6 | 82.0  | 82.0  | 69.1  | 69.1  | -     | -     | -    | -    |
| 126.0                         | 87.6                    | 87.6  | 70.7  | 70.7  | 59.5  | 59.5  | -     | -     | -    | -    |
| 132.0                         | 76.1                    | 76.1  | 61.4  | 61.4  | 51.6  | 51.6  | -     | -     | -    | -    |
| 138.0                         | 66.6                    | 66.6  | 53.6  | 53.6  | -     | -     | -     | -     | -    | -    |
| 144.0                         | 58.5                    | 58.5  | 47.1  | 47.1  | -     | -     | -     | -     | -    | -    |
| 150.0                         | 51.7                    | 51.7  | 41.6  | 41.6  | -     | -     | -     | -     | -    | -    |
| 156.0                         | 45.9                    | 45.9  | 37.0  | 37.0  | -     | -     | -     | -     | -    | -    |

Chart #3

| Maximum Design pressure (psf) |                         |      |      |      |      |      |       |      |      |      |
|-------------------------------|-------------------------|------|------|------|------|------|-------|------|------|------|
| Panel Height (in)             | Single Panel Width (in) |      |      |      |      |      |       |      |      |      |
|                               | 24.0                    |      | 30.0 |      | 36.0 |      | 42.28 |      | 48.0 |      |
|                               | Pos                     | Neg  | Pos  | Neg  | Pos  | Neg  | Pos   | Neg  | Pos  | Neg  |
| 78.0                          | 60.0                    | 82.5 | 60.0 | 82.5 | 60.0 | 82.5 | 60.0  | 80.4 | 60.0 | 70.8 |
| 84.0                          | 60.0                    | 82.5 | 60.0 | 82.5 | 60.0 | 82.5 | 60.0  | 74.6 | 60.0 | 65.7 |
| 90.0                          | 60.0                    | 82.5 | 60.0 | 82.5 | 60.0 | 81.8 | 60.0  | 69.7 | 60.0 | 61.4 |
| 96.0                          | 60.0                    | 82.5 | 60.0 | 82.5 | 60.0 | 76.7 | 60.0  | 65.3 | 57.5 | 57.5 |
| 102.0                         | 60.0                    | 82.5 | 60.0 | 82.5 | 60.0 | 71.4 | 60.0  | 61.5 | -    | -    |
| 108.0                         | 60.0                    | 82.5 | 60.0 | 77.4 | 60.0 | 66.6 | 58.1  | 58.1 | -    | -    |
| 114.0                         | 60.0                    | 82.5 | 60.0 | 72.7 | 60.0 | 62.5 | 55.0  | 55.0 | -    | -    |
| 120.0                         | 60.0                    | 79.8 | 60.0 | 64.5 | 54.3 | 54.3 | -     | -    | -    | -    |
| 126.0                         | 60.0                    | 68.9 | 55.5 | 55.5 | 46.8 | 46.8 | -     | -    | -    | -    |
| 132.0                         | 59.8                    | 59.8 | 48.2 | 48.2 | 40.5 | 40.5 | -     | -    | -    | -    |
| 138.0                         | 52.3                    | 52.3 | 42.1 | 42.1 | -    | -    | -     | -    | -    | -    |
| 144.0                         | 46.0                    | 46.0 | 37.0 | 37.0 | -    | -    | -     | -    | -    | -    |
| 150.0                         | 40.6                    | 40.6 | 32.7 | 32.7 | -    | -    | -     | -    | -    | -    |
| 156.0                         | 36.1                    | 36.1 | 29.0 | 29.0 | -    | -    | -     | -    | -    | -    |

SIILL AND HEAD  
END DETAILS

SIILL AND HEAD  
CLUSTER DETAILS

ANCHOR LAYOUT  
APPLICABLE TO ALL CONFIGURATION

SOLAR INNOVATIONS, INC.


31 ROBERTS RD  
PINE GROVE, PA 17963

SERIES SI3000 STANDARD INFOLD ALUMINUM FGW  
NON-IMPACT  
ANCHORING LAYOUT AND DESIGN PRESSURE CHARTS

DRAWN: V.L. DWG NO. 08-01960 REV D  
SCALE NTS DATE 04/22/13 SHEET 3 OF 11

L. ROBERTO LOMAS P.E.  
208 7th Ave, INDIALANTIC, FL 32903  
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 05/05/2026

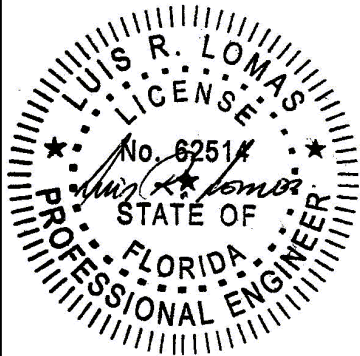

Luis R. Lomas P.E.  
FL No.: 62514

(1) WEEP THRU HOLES LOCATED  
SPACED EVENLY ON EACH PANEL

DUAL WHEEL TROLLEY COVER  
WITH #8-32 X  $\frac{3}{8}$ " C.S.M.S.  
COVER 5 $\frac{1}{2}$ " ON ENDS

DOOR SWEEP GASKET  
GA000384

PANEL FRAME (49070)

EXTERIOR

GEN. 3 DUAL WHEEL HEAD  
(12495 & 12496) WITH MEDIUM  
BULB GASKET (GA000032-00-02)

5 $\frac{1}{4}$ " GEN. 2 SEMI-CONCEALED HINGE

#10-32 X  $\frac{5}{8}$ " S.S. C.S.  
M.S. (ATTACH HINGES)

INTERIOR

SEE GLAZING DETAILS  
SHEET 6

PANEL FRAME (49070)

#10-32 X  $\frac{1}{2}$ " S.S. C.S.  
M.S. (ATTACH HINGES)

5 $\frac{1}{4}$ " GEN. 2  
SEMI-CONCEALED HINGE

GEN. 3 DUAL WHEEL SILL  
(12495 & 12496) WITH MEDIUM  
BULB GASKET (GA000032-00-02)

REFER TO SHEET #10 FOR  
WEEP HOLE LOCATIONS

VERTICAL CROSS SECTION  
STANDARD

(1) WEEP THRU HOLES LOCATED  
SPACED EVENLY ON EACH PANEL

GEN. 3 DUAL WHEEL HEAD  
(12495 & 12496) WITH MEDIUM  
BULB GASKET (GA000032-00-02)

#10-32 X  $\frac{5}{8}$ " S.S. C.S.  
M.S. (ATTACH HINGES)

5 $\frac{1}{4}$ " GEN. 2  
SEMI-CONCEALED HINGE

EXTERIOR

GEN. 3 DUAL WHEEL TROLLEY  
CARRIAGE ASSEMBLY UPPER  
(TOP LOAD)

PANEL FRAME (49070)

INTERIOR

SEE GLAZING DETAILS  
SHEET 6

PANEL FRAME (49070)

#10-32 X  $\frac{1}{2}$ " S.S. C.S.  
M.S. (ATTACH HINGES)

5 $\frac{1}{4}$ " GEN. 2  
SEMI-CONCEALED HINGE

GEN. 3 DUAL WHEEL SILL  
(12495 & 12496) WITH MEDIUM  
BULB GASKET (GA000032-00-02)

REFER TO SHEET #10 FOR  
WEEP HOLE LOCATIONS

VERTICAL CROSS SECTION  
TOP LOAD

SOLAR INNOVATIONS, INC.

31 ROBERTS RD  
PINE GROVE, PA 17963

SERIES SI3000 STANDARD INFOLD ALUMINUM FGW  
NON-IMPACT  
CROSS SECTIONS

DRAWN:  
V.L.

DWG NO.  
08-01960

REV  
D


SCALE NTS

DATE 04/22/13

SHEET 4 OF 11





L. ROBERTO LOMAS P.E.  
208 7th Ave, INDIALANTIC, FL 32903  
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 05/05/2026

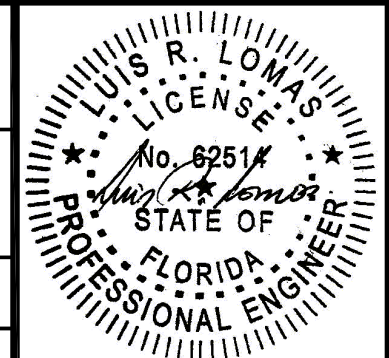

Luis R. Lomas P.E.  
FL No.: 62514

| REVISIONS |                 |          |          |
|-----------|-----------------|----------|----------|
| REV       | DESCRIPTION     | DATE     | APPROVED |
| D         | REVISED DETAILS | 05/05/26 | R.L.     |

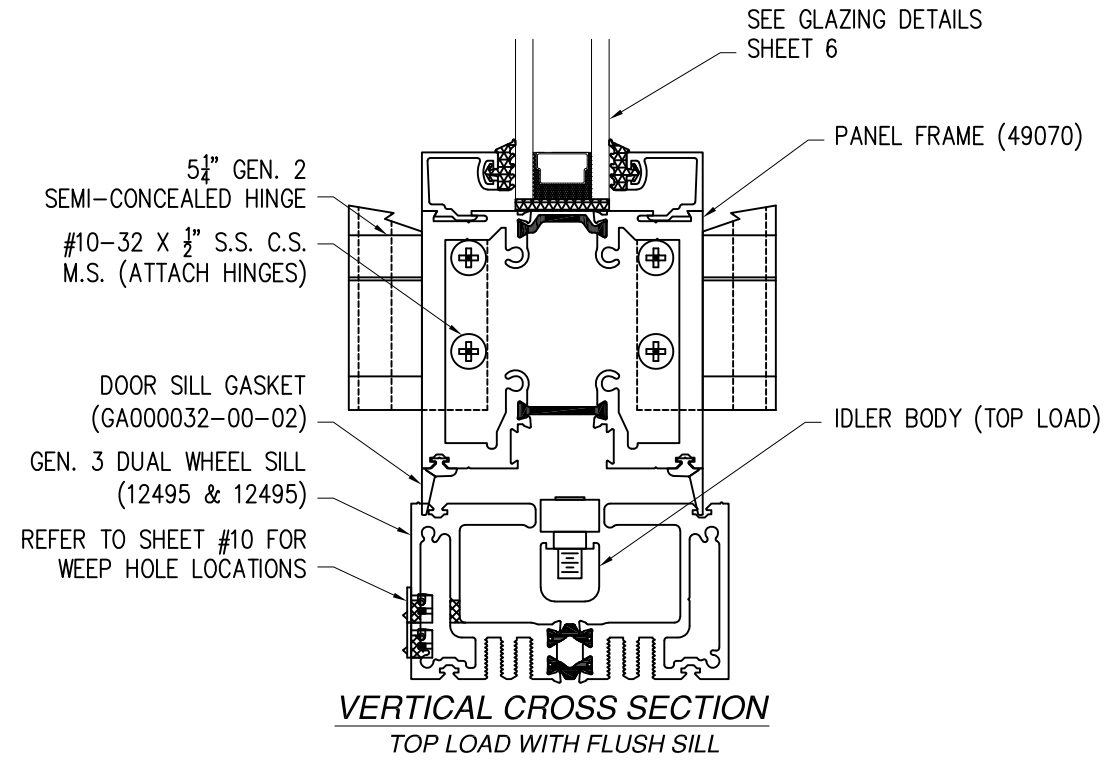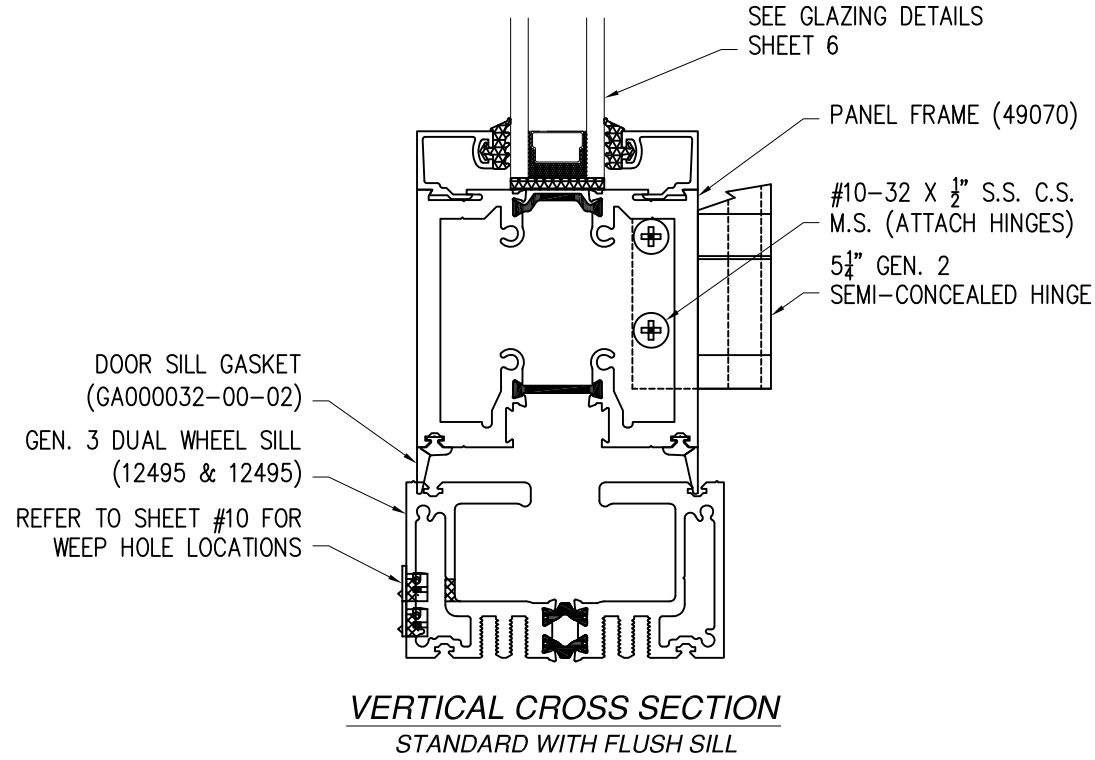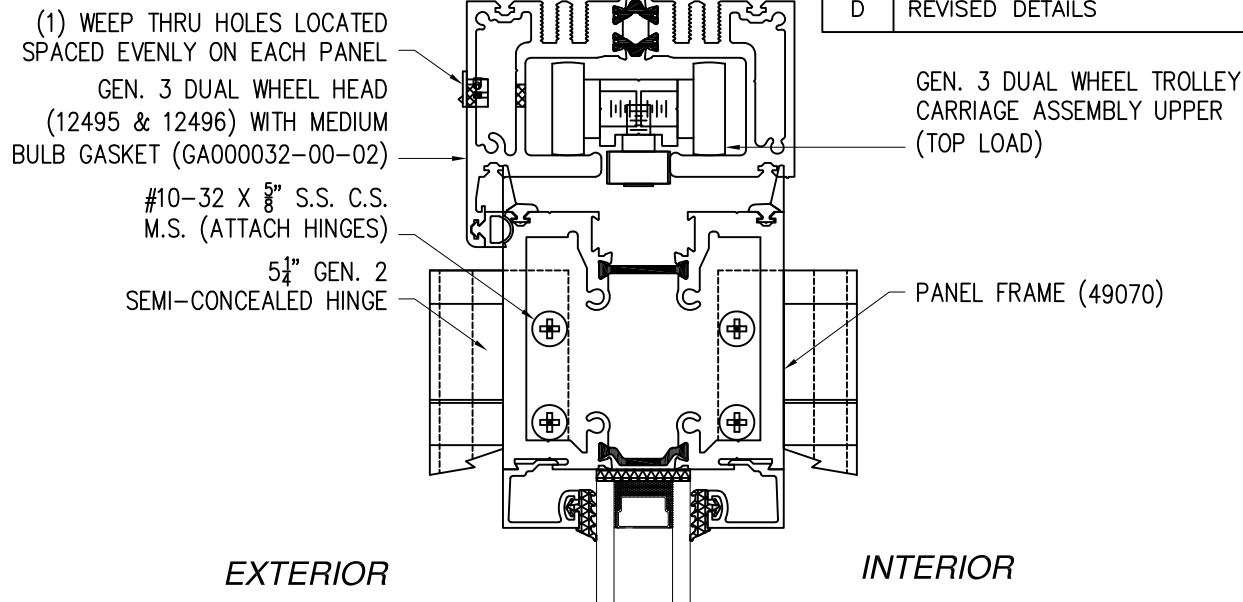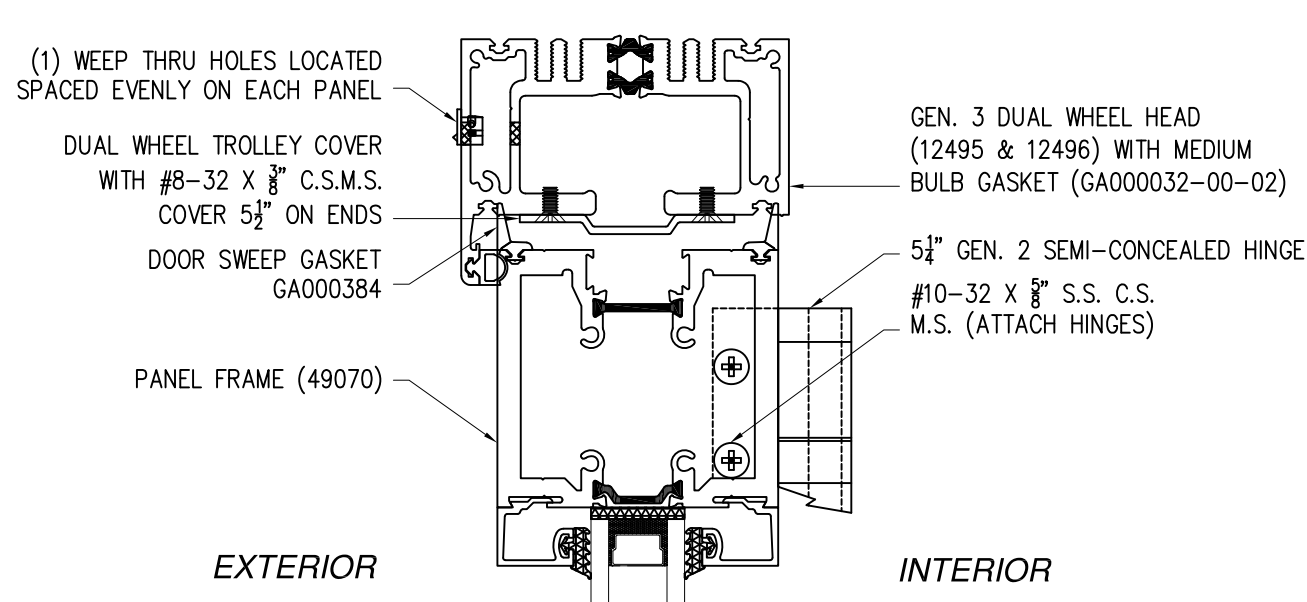

SOLAR INNOVATIONS, INC.

31 ROBERTS RD  
PINE GROVE, PA 17963

SERIES SI3000 STANDARD INFOLD ALUMINUM FGW  
NON-IMPACT  
CROSS SECTIONS

DRAWN:  
V.L.

DWG NO.  
08-01960

REV  
D

SCALE  
NTS

DATE  
04/22/13



SHEET  
5 OF 11

L. ROBERTO LOMAS P.E.  
208 7th Ave, INDIALANTIC, FL 32903  
434-688-0609 rllomas@lrlomaspe.com


SIGNED: 05/05/2026

Luis R. Lomas P.E.  
FL No.: 62514


| REVISIONS |                 |          |          |
|-----------|-----------------|----------|----------|
| REV       | DESCRIPTION     | DATE     | APPROVED |
| D         | REVISED DETAILS | 05/05/26 | R.L.     |

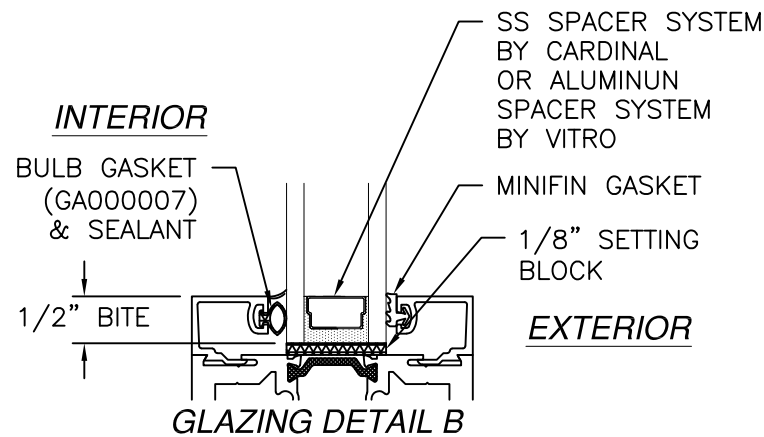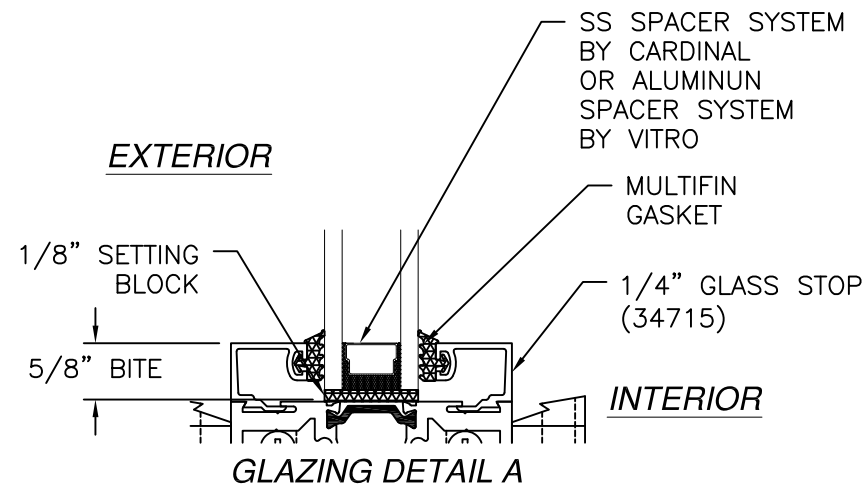


NOTE:  
GLASS FOR ALL CONFIGURATIONS MUST BE  
SAFETY GLASS

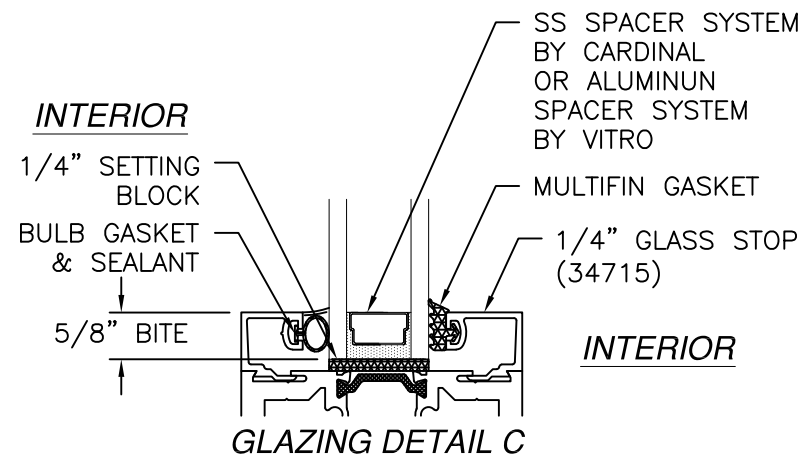


SIGNED: 05/05/2026
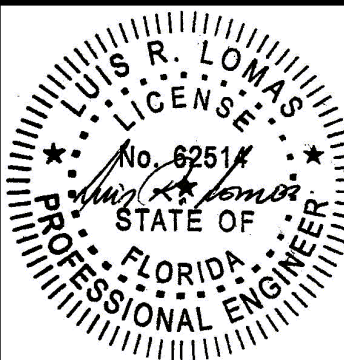
|                                                                                                   |                     |               |                                                                                       |
|---------------------------------------------------------------------------------------------------|---------------------|---------------|---------------------------------------------------------------------------------------|
| <b>SOLAR INNOVATIONS, INC.</b><br>31 ROBERTS RD<br>PINE GROVE, PA 17963                           |                     |               |  |
| SERIES SI3000 STANDARD INFOLD ALUMINUM FGW<br>NON-IMPACT<br>GLAZING DETAILS                       |                     |               |                                                                                       |
| DRAWN:<br>V.L.                                                                                    | DWG NO.<br>08-01960 | REV<br>D      |                                                                                       |
| SCALE NTS                                                                                         | DATE 04/22/13       | SHEET 6 OF 11 |                                                                                       |
| L. ROBERTO LOMAS P.E.<br>208 7th Ave, INDIALANTIC, FL 32903<br>434-688-0609 rllomas@lrlomaspe.com |                     |               | Luis R. Lomas P.E.<br>FL No.: 62514                                                   |

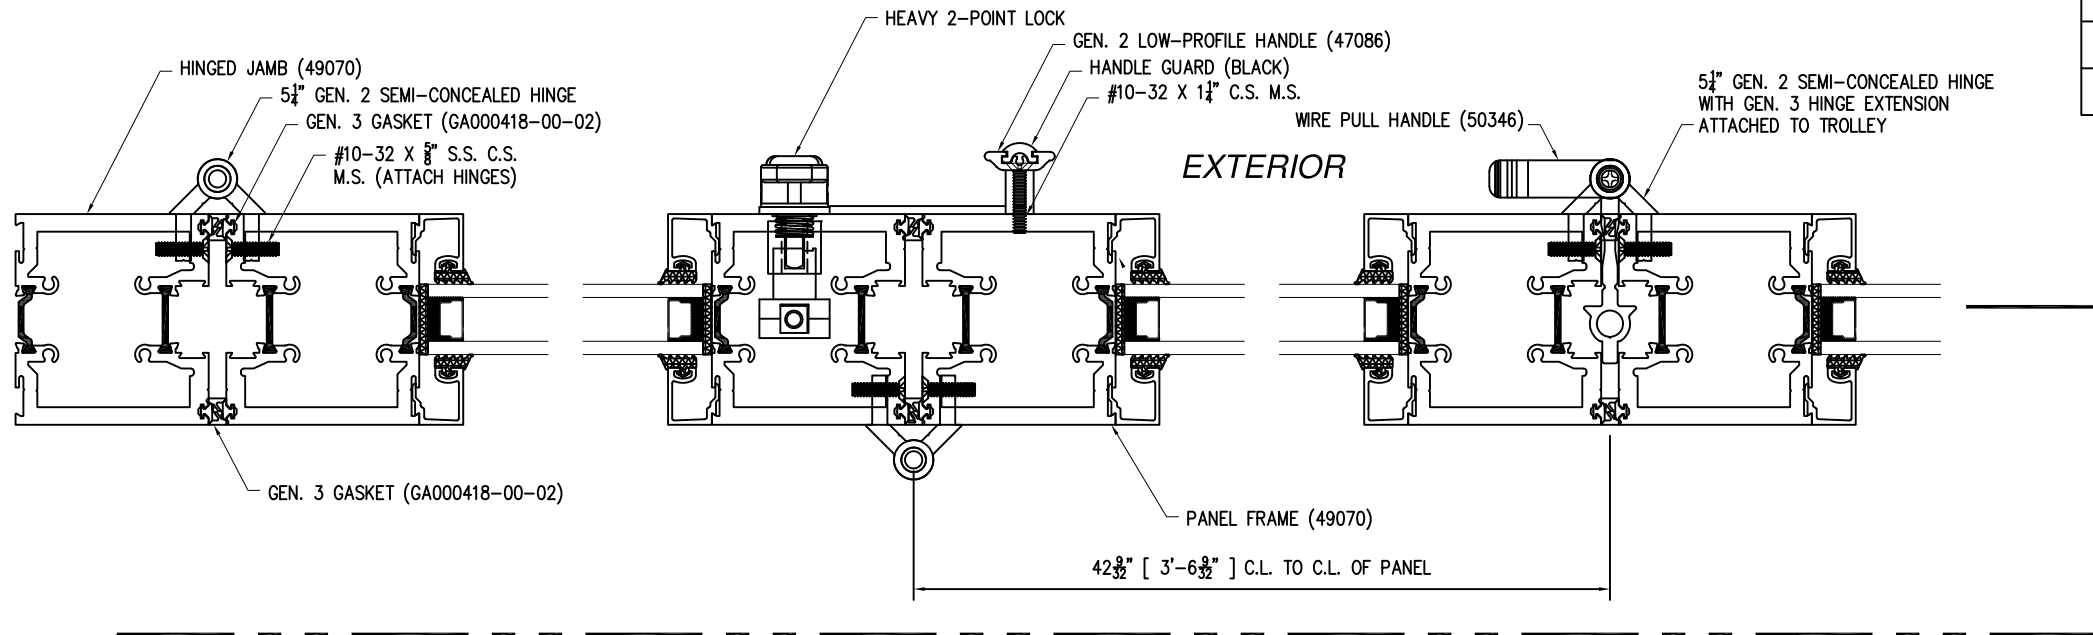

| REVISIONS |                 |          |          |
|-----------|-----------------|----------|----------|
| REV       | DESCRIPTION     | DATE     | APPROVED |
| D         | REVISED DETAILS | 05/05/26 | R.L.     |

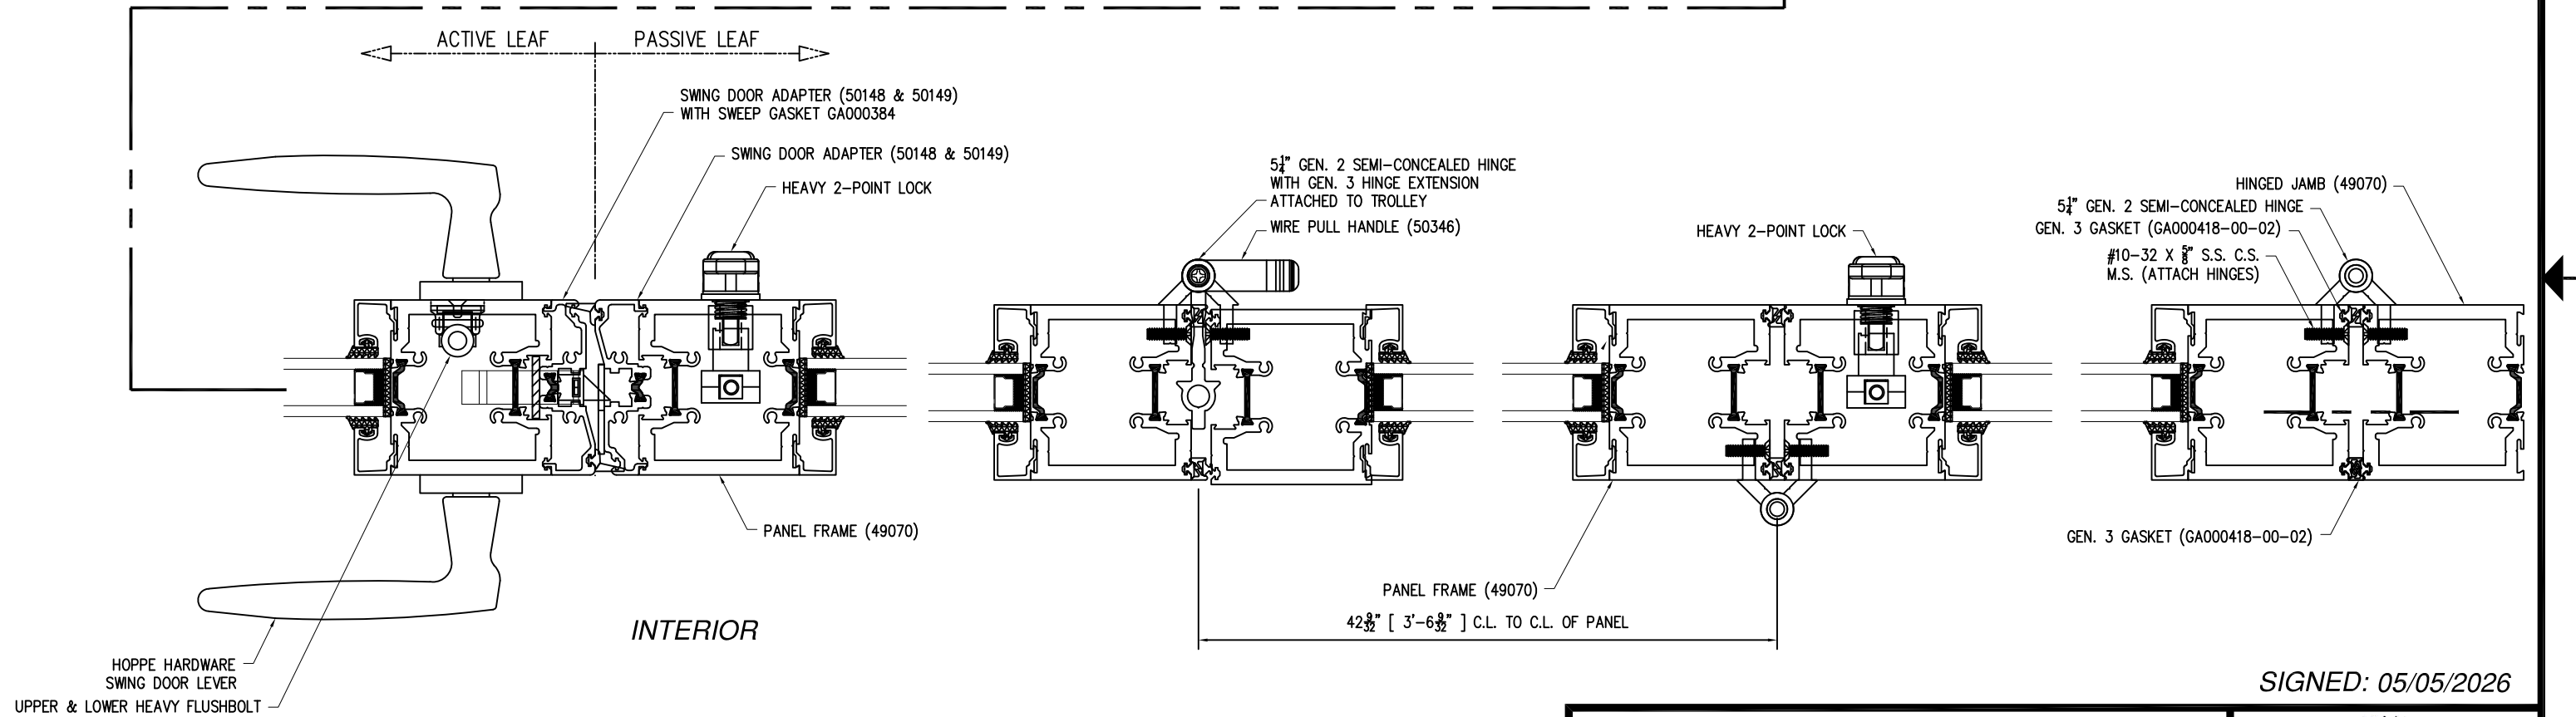

HORIZONTAL CROSS SECTION

SOLAR INNOVATIONS, INC.


31 ROBERTS RD  
PINE GROVE, PA 17963

SERIES SI3000 STANDARD INFOLD ALUMINUM FGW  
NON-IMPACT  
CROSS SECTIONS

|                |                     |               |
|----------------|---------------------|---------------|
| DRAWN:<br>V.L. | DWG NO.<br>08-01960 | REV<br>D      |
| SCALE NTS      | DATE 04/22/13       | SHEET 7 OF 11 |


L. ROBERTO LOMAS P.E.  
208 7th Ave, INDIALANTIC, FL 32903  
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 05/05/2026

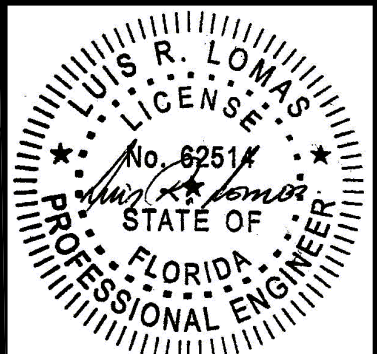


Luis R. Lomas P.E.  
FL No.: 62514

| REVISIONS |                 |          |          |
|-----------|-----------------|----------|----------|
| REV       | DESCRIPTION     | DATE     | APPROVED |
| D         | REVISED DETAILS | 05/05/26 | R.L.     |

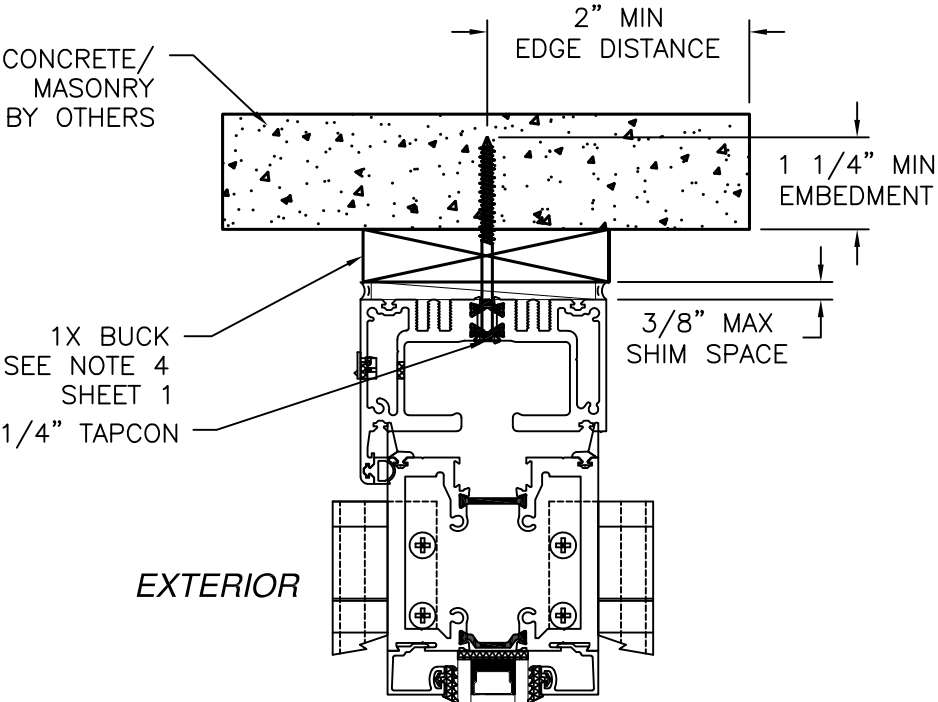


EXTERIOR

INTERIOR

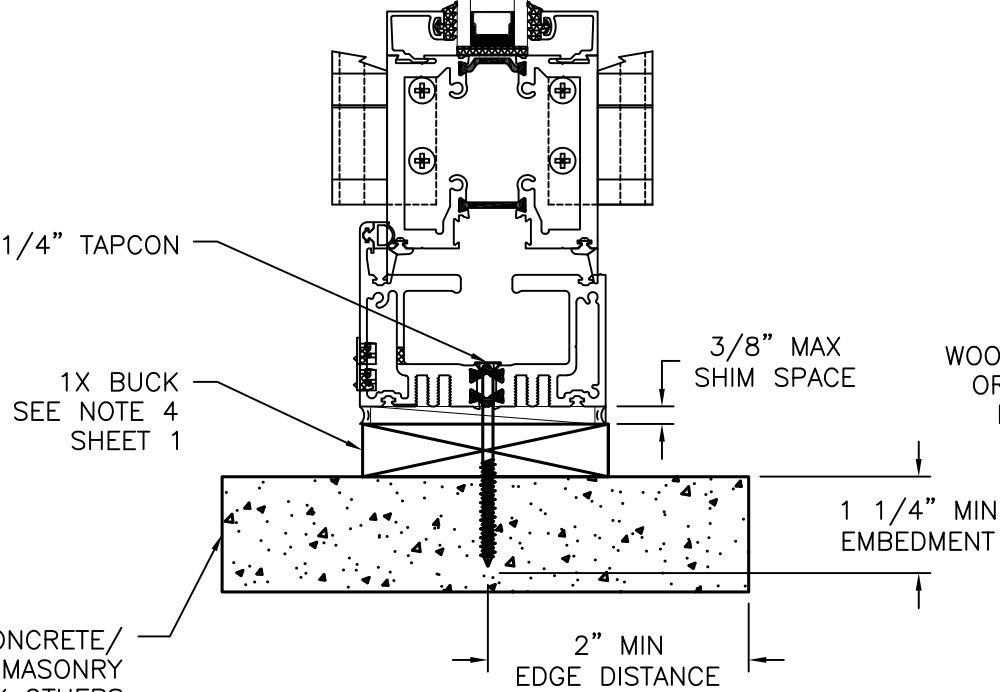


VERTICAL CROSS SECTION  
CONCRETE/MASONRY INSTALLATION

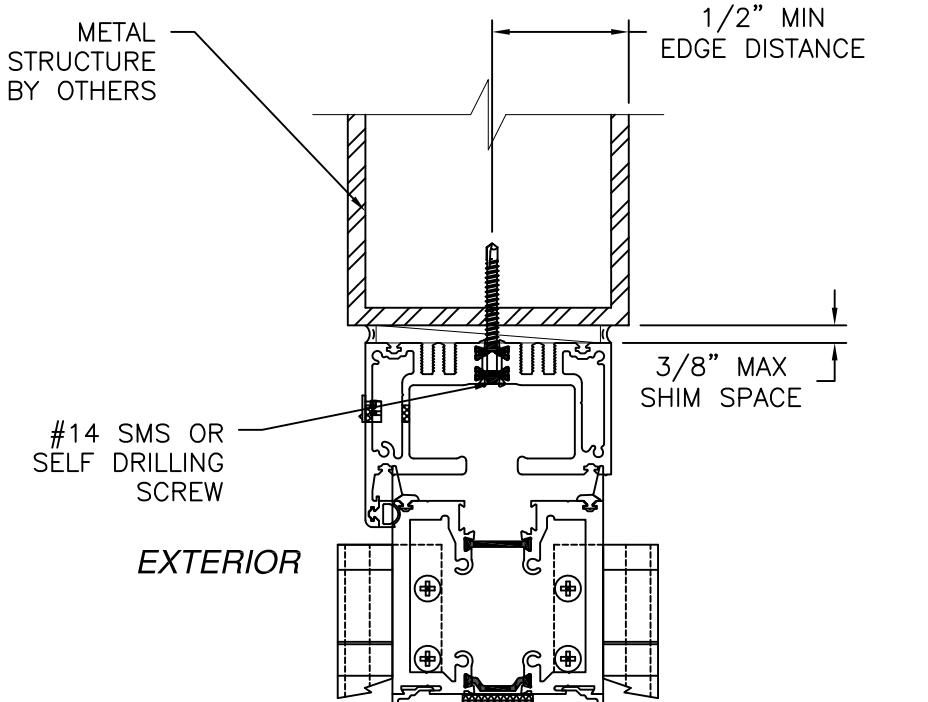

EXTERIOR

INTERIOR

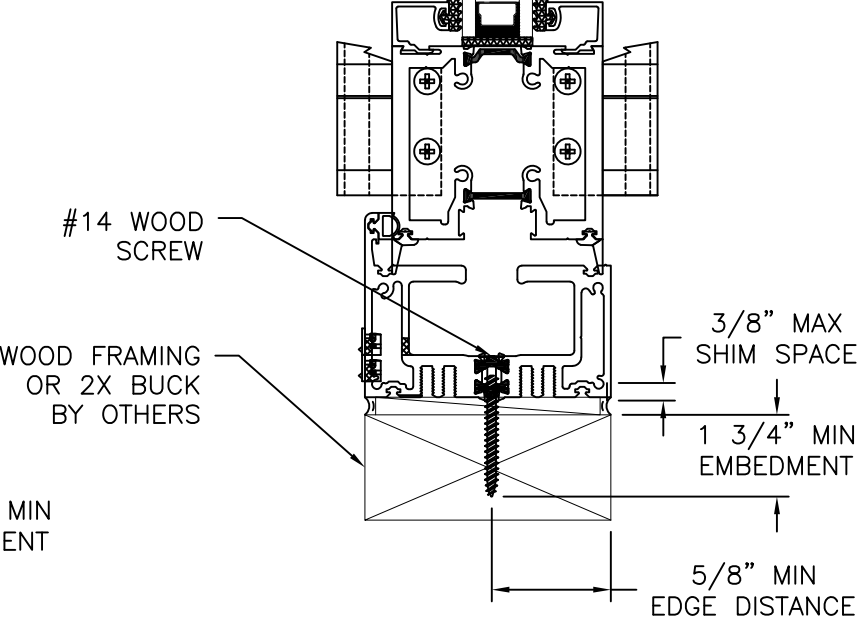

VERTICAL CROSS SECTION  
WOOD FRAMING OR 2X BUCK  
OR METAL STRUCTURE INSTALLATION

- NOTES:
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
  - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SOLAR INNOVATIONS, INC.

31 ROBERTS RD  
PINE GROVE, PA 17963

SERIES SI3000 STANDARD INFOLD ALUMINUM FGW  
NON-IMPACT  
INSTALLATION DETAILS

DRAWN: V.L.

DWG NO. 08-01960

REV D

SCALE NTS

DATE 04/22/13


SHEET 8 OF 11

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903


434-688-0609 rllomas@lrlomaspe.com

SIGNED: 05/05/2026

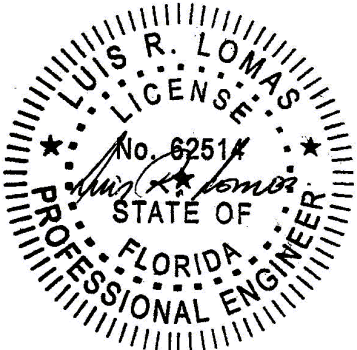


Luis R. Lomas P.E.  
FL No.: 62514


| REVISIONS |                 |          |          |
|-----------|-----------------|----------|----------|
| REV       | DESCRIPTION     | DATE     | APPROVED |
| D         | REVISED DETAILS | 05/05/26 | R.L.     |

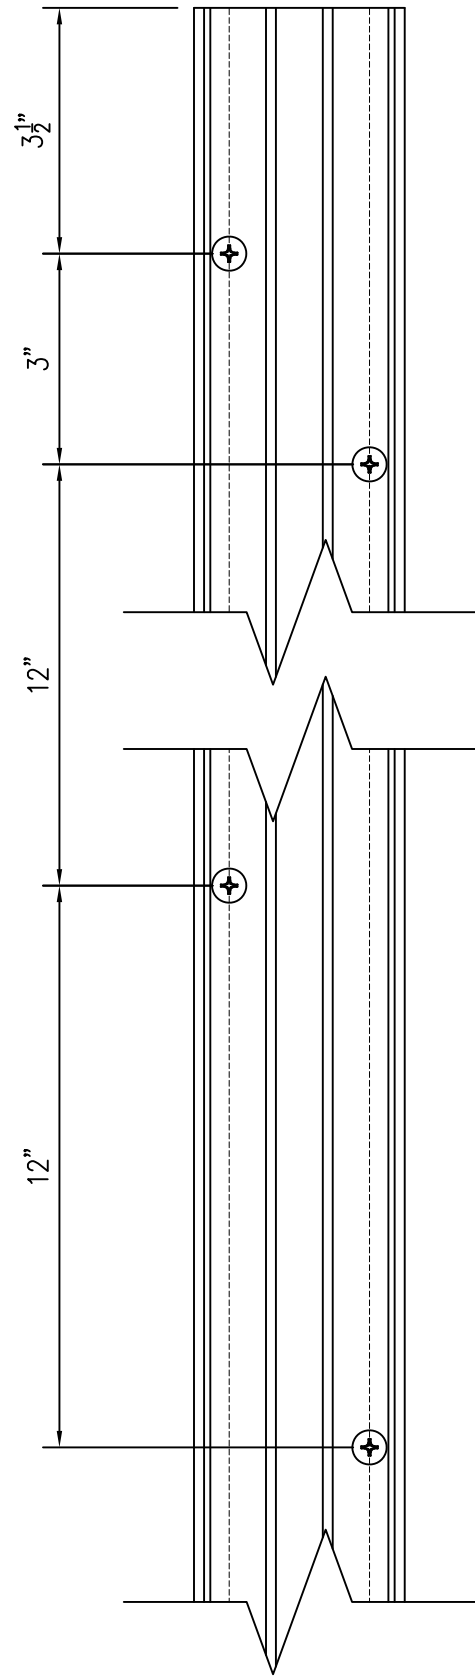


JAMB ANCHOR LOCATIONS  
DETAIL

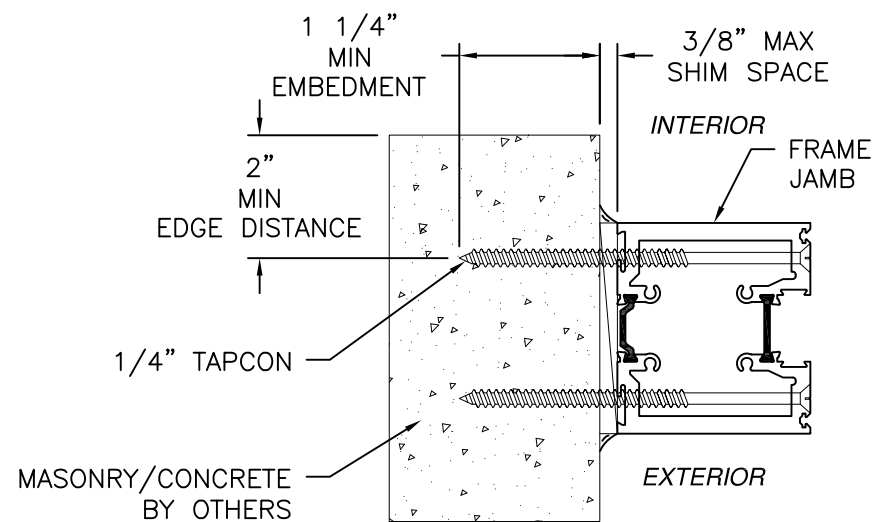

JAMB INSTALLATION DETAIL  
MASONRY/CONCRETE

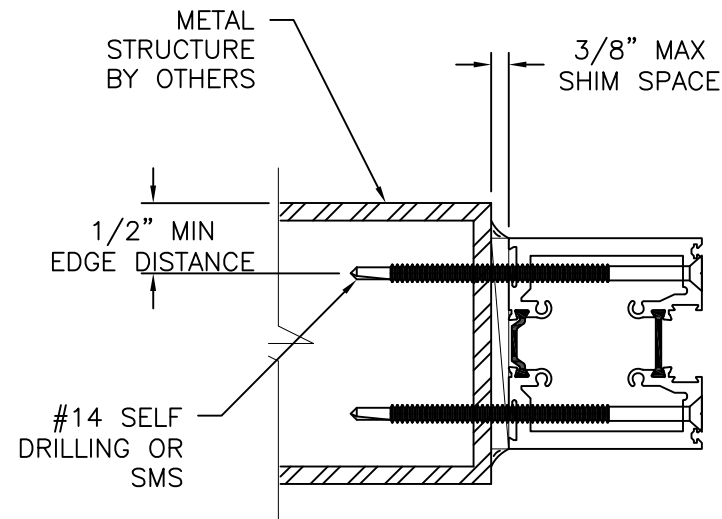

JAMB INSTALLATION DETAIL  
METAL STRUCTURE

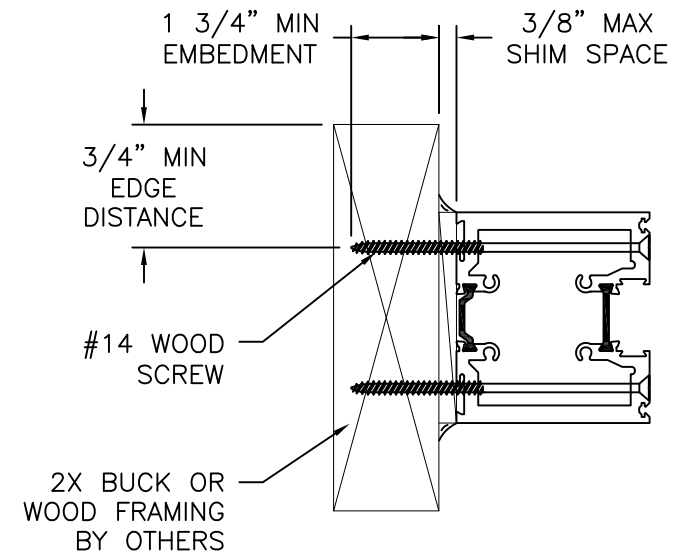

JAMB INSTALLATION DETAIL  
2X BUCK OR WOOD FRAMING

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
  2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 05/05/2026













|                                                                                                   |                     |                  |
|---------------------------------------------------------------------------------------------------|---------------------|------------------|
| <b>SOLAR INNOVATIONS, INC.</b><br>31 ROBERTS RD<br>PINE GROVE, PA 17963                           |                     |                  |
| SERIES SI3000 STANDARD INFOLD ALUMINUM FGW<br>NON-IMPACT<br>INSTALLATION DETAILS                  |                     |                  |
| DRAWN:<br>V.L.                                                                                    | DWG NO.<br>08-01960 | REV<br>D         |
| SCALE<br>NTS                                                                                      | DATE<br>04/22/13    | SHEET<br>9 OF 11 |
| L. ROBERTO LOMAS P.E.<br>208 7th Ave, INDIALANTIC, FL 32903<br>434-688-0609 rllomas@lrlomaspe.com |                     |                  |

LUIS R. LOMAS  
P.E.  
No. 62514  
STATE OF  
FLORIDA  
PROFESSIONAL ENGINEER

Luis R. Lomas P.E.  
FL No.: 62514



| REVISIONS |                 |          |          |
|-----------|-----------------|----------|----------|
| REV       | DESCRIPTION     | DATE     | APPROVED |
| D         | REVISED DETAILS | 05/05/26 | R.L.     |

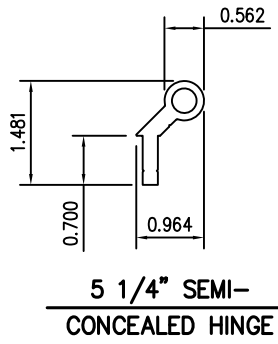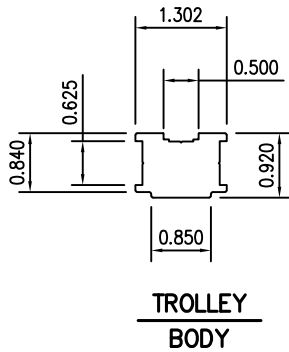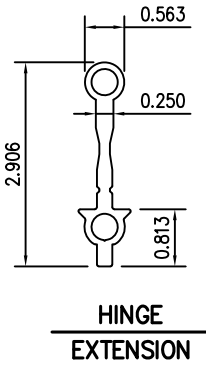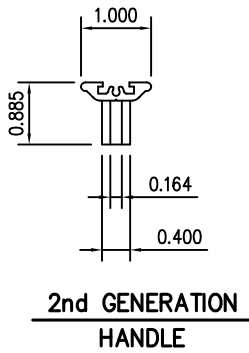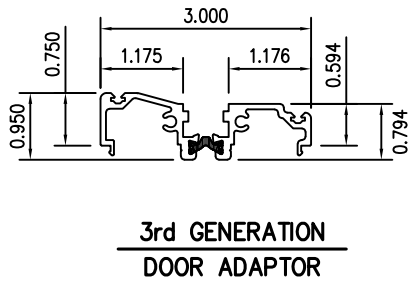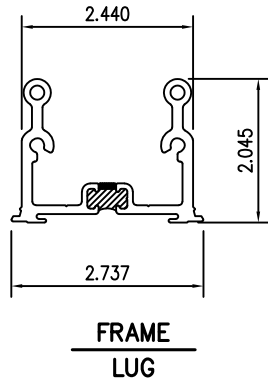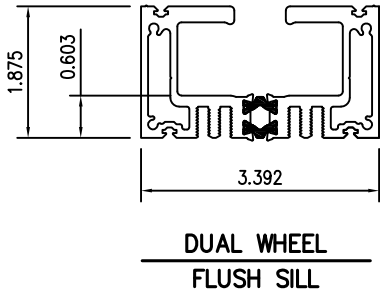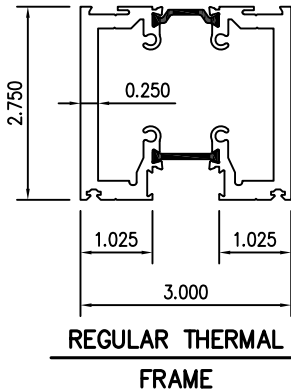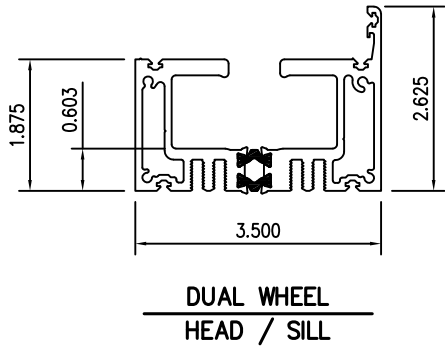

SIGNED: 05/05/2026

SOLAR INNOVATIONS, INC.

31 ROBERTS RD  
PINE GROVE, PA 17963

SERIES SI3000 STANDARD INFOLD ALUMINUM FGW  
NON-IMPACT  
COMPONENTS

DRAWN:  
V.L.

DWG NO.  
08-01960


REV  
D

SCALE NTS

DATE 04/22/13

SHEET 11 OF 11

L. ROBERTO LOMAS P.E.  
208 7th Ave, INDIALANTIC, FL 32903  
434-688-0609 rllomas@lrlomaspe.com

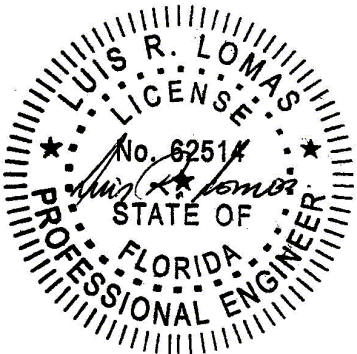

Luis R. Lomas P.E.  
FL No.: 62514