




TABLE 1: FRAME INSTALLATION REQUIREMENTS TABLE			
SUBSTRATE TYPE	ANCHOR TYPE	MIN. EMBED.	MIN. EDGE DIST.
CONCRETE (2.0 KSI MIN)	3/16" ITW TAPCON	1-1/2"	1-1/8"
HOLLOW OR GROUT-FILLED CMU (117 PCF MIN.)	3/16" ITW TAPCON	1"	2"
16 GAUGE (0.060") MIN. STEEL STUD, 33 KSI YIELD MIN., OR 1/8" ALUM. 6063-T5 MIN	#10-16 HILTI KWIK-FLEX OR ITW TEKS SELF-DRILLING SCREW	3 THREADS BEYOND METAL WALL	1/2"

Lucas Turner
2026.09.25
14:16:25
-05'00'

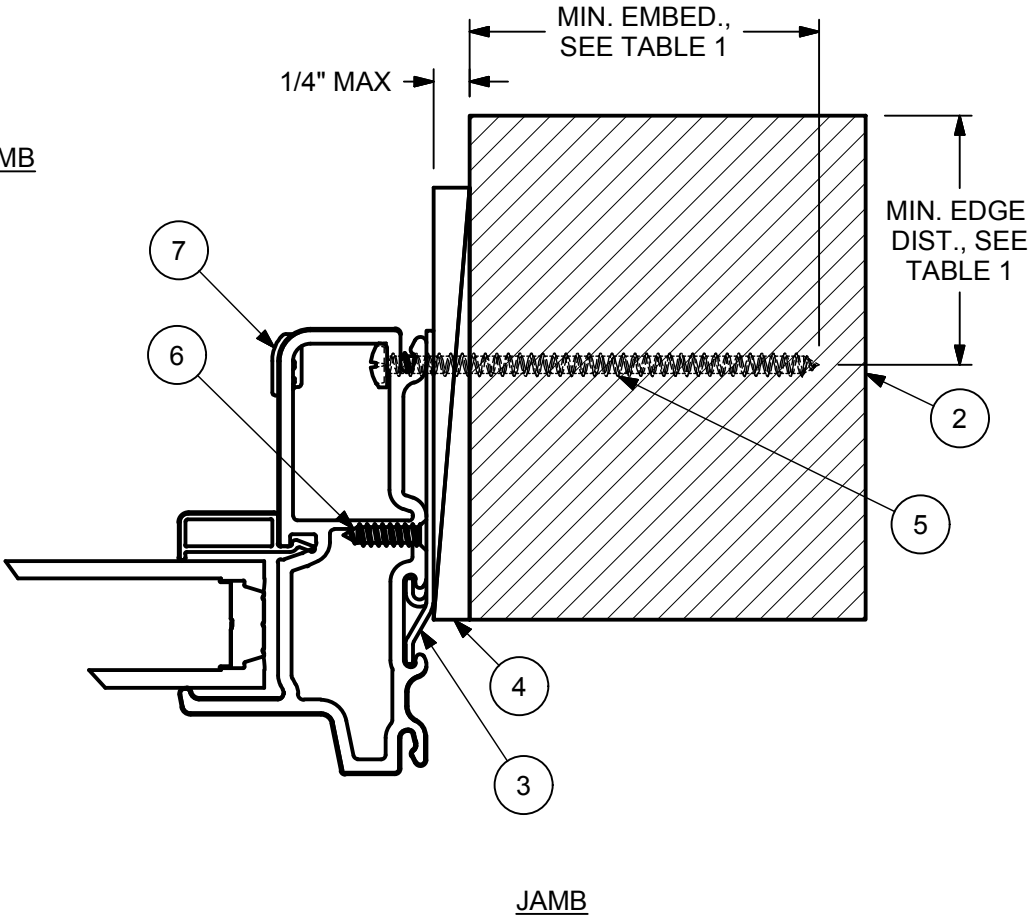

9/25/2026
LUCAS TURNER
FL PE 58201
TURNER ENGINEERING &
CONSULTING, INC.
2428 OLD NATCHEZ TRACE
TRL. CAMDEN, TN, 38320
PH 941-380-1574

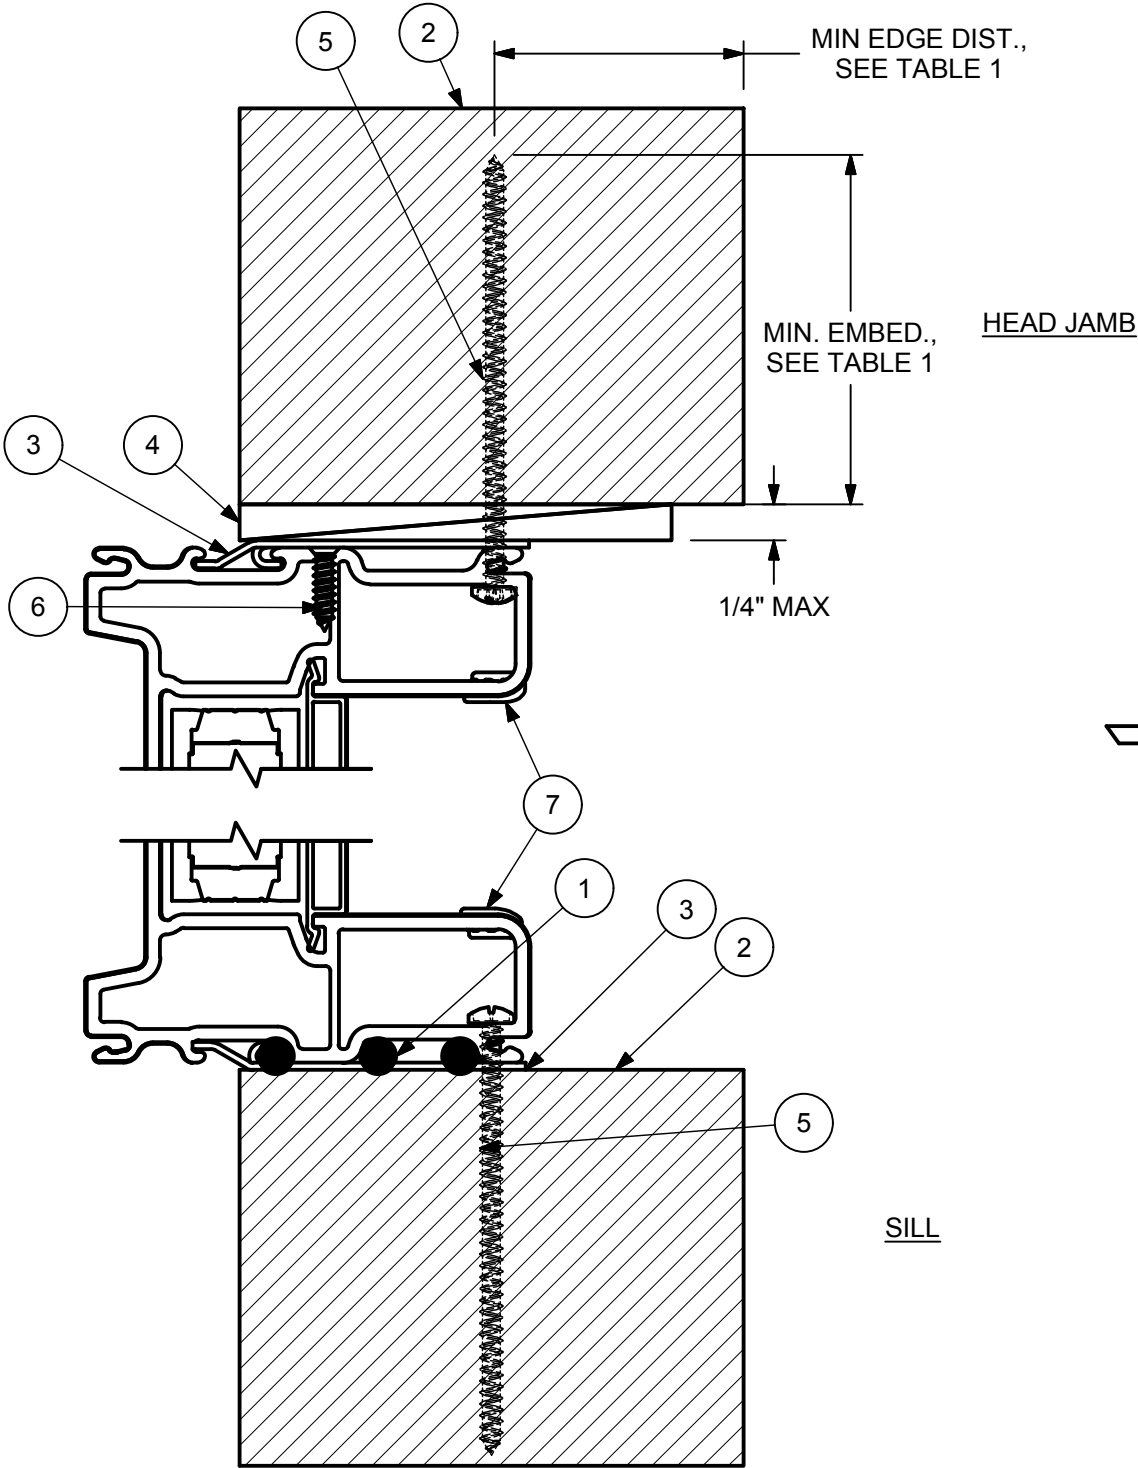

THROUGH JAMB INSTALLATION:
- ATTACH INSTALLATION BRACKET AT EACH THROUGH JAMB HOLE LOCATION WITH TWO #7 X 5/8" SCREWS PER BRACKET
- SECURE UNIT TO FRAMING AT EACH LOCATION WITH ONE FASTENER PER TABLE 1
- PLACE THREE 3/8" DIAMETER BEADS OF ASTM C920 GRADE NS CLASS 25 SEALANT ON THE SILL FRAMING UNDER THE WINDOW

7	00059340	JAMB HOLE PLUG
6	00035739	#7-19 X .625" AB/TEK-2,PH,UC,FH,FULL THREAD
5	NA	INSTALLATION FASTENER, SEE TABLE 1
4	NA	SHIM
3	00058843	INSTALLATION BRACKET, THOUGH JAMB
2	NA	FRAMING MATERIAL, SEE TABLE 1
1	NA	ASTM C920 GRADE NS CLASS 25 SEALANT
ITEM	DWG NO	DESCRIPTION
PARTS LIST		



RESEARCH & DEVELOPMENT
WARROAD, MN, USA, (218) 386-4021

PRODUCT: ESSENTIAL
CATEGORY:
UNIT TYPE: ESRT

DWG TYPE: INSTALLATION
DESCRIPTION: METHOD, THROUGH JAMB, NON-WOOD

CHK: SAL 07/16/18 SIZE: B CLASS: MISC DWG NO: 00113490

APP: JMD 07/16/18 SCALE: 3:4 DATE: 06/11/18 DWG BY: SMITH, BRENDAN SHEET: 1 OF 1

- NOTES:**
1. FOR GENERAL SPECIFICATIONS, REFER TO DOC 00003952
2. FLORIDA PRODUCT APPROVAL: FL14407
3. MAX 0.250" GAP AT HEADER AND JAMBS
4. FOR ELEVATIONS AND ADDITIONAL REQUIREMENTS, REFER TO DOC 00113697
5. FOR FBC 1711 COASTAL COMPLIANCE SEE EVAL. REPORT.

0.1	ADDED SILL INSTALLATION SCREW	22832	07/16/18	BGS
0.0	ORIGINAL ISSUE	22832	06/11/18	BGS
REV	DESCRIPTION / REQUESTOR	ECN NO	DATE	REV BY