REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
А	REVISED INSTALLATION DETAILS	06/22/15	R.L.

NOTES:

- 1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE
- 2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
- 3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
- 4. ALLOWABLE STRESS INCREASE OF 1/3 WAS NOT USED IN THE DESIGN OF THE PRODUCT SHOWN HEREIN. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
- 5. FRAME MATERIAL: EXTRUDED RIGID PVC.
- 6. UNITS MUST BE GLAZED PER ASTM E1300-04, SEE SHEET 2 FOR GLASS DETAILS.
- 7. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
- 8. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
- 9. FOR NAILING FIN INSTALLATION INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS OR EQUIVALENT WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/2" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 10. FOR FRAME INSTALLATION INTO WOOD FRAMING OR 2X BUCK USE #12 WOOD SCREWS OR EQUIVALENT WITH SUFFICIENT LENGTH TO ACHIEVE A 1 5/8" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 11. FOR FRAME INSTALLATION INTO MASONRY/CONCRETE USE 1/4" TAPCONS OR EQUIVALENT WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 12. FOR FRAME INSTALLATION INTO METAL STRUCTURE USE #12 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 13. ALL FASTENERS TO BE CORROSION RESISTANT.


- 14. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - A. WOOD MINIMUM SPECIFIC GRAVITY OF G=0.42
 - B. CONCRETE MINIMUM COMPRESSIVE STRENGTH OF 3,192 PSI.
 - C. MASONRY STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).
 - D. METAL STRUCTURE: STEEL 18GA, 33KSI OR ALUMINUM 6063-T5 1/8" THICK MINIMUM
- 15. APPROVED CONFIGURATIONS: OX, XO, OXO


SIGNED: 06/23/2015


	TABLE OF CONTENTS	ARCHITE	EASTERN ARCHITECTURAL SY: A DIVISION OF EASTERN METAL SYPPLY 16341 DOMESTIC AVE FORT MYERS, FLORIDA 33912 800-432-2204		ILIUIS R. LONG
SHEET NO.	. DESCRIPTION	SERIES 6	SERIES 623 VINYL SLIDING GLASS DOOR		= *: No. 6251# *
1	NOTES		144" x 96" IMPACT NOTES		
2	NAIL FIN ELEVATION	DRAWN:	DWG NO.	REV	TORIDA :
3	FLANGE ELEVATION	R.L.	08-01671	А	MONAL ENGLIS
4 - 6	INSTALLATION DETAILS	SCALE NTS DATE	07/13/12 SHEET 1 OF 6	-	Millimin





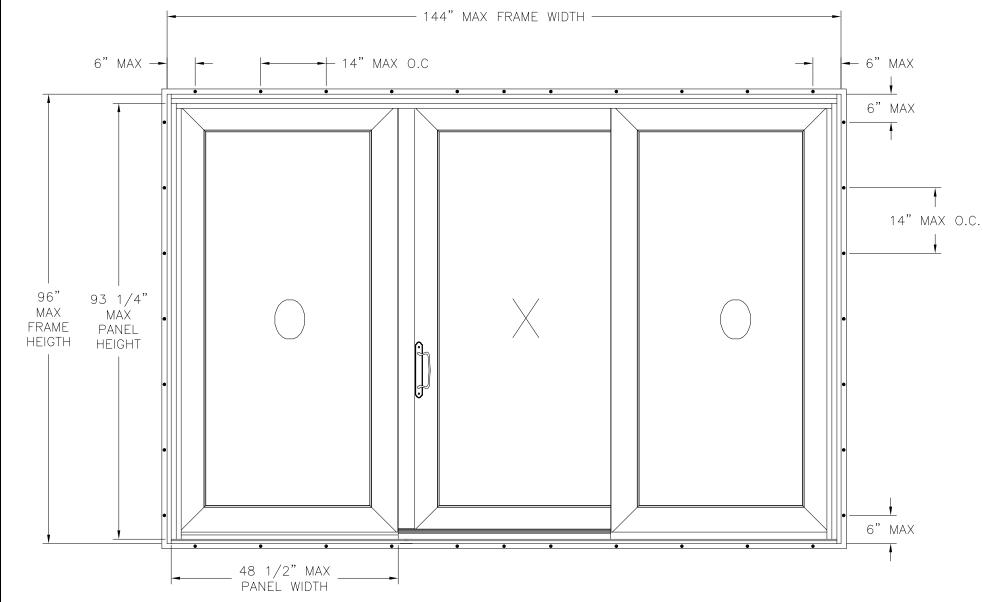

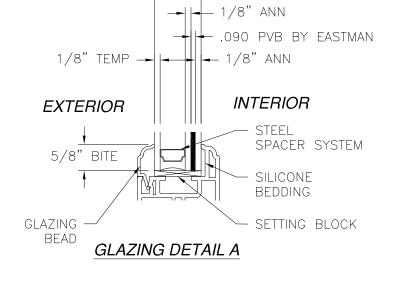

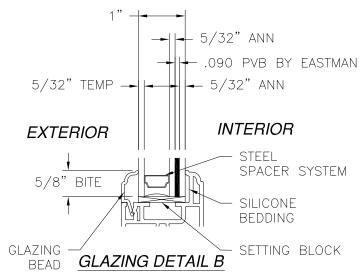


SIGNED: 06/23/2015

EASTERN ARCHITECTURAL SYSTEMS A DIVISION OF EASTERN METAL SYPPLY

SERIES 623 VINYL SLIDING GLASS DOOR 144" x 96" IMPACT NAIL FIN ELEVATION

DRAWN: DWG NO. R.L. 08-01671 SCALE NTS SHEET 2 OF 6 DATE 07/13/12






SERIES 623 VINYL SGD EXTERIOR VIEW NAIL FIN INSTALLATION

DESIGN PRESSURE RATING IMPACT RATING

> LARGE AND SMALL ±50.0PSF MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 4

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
Α	REVISED INSTALLATION DETAILS	06/22/15	R.L.

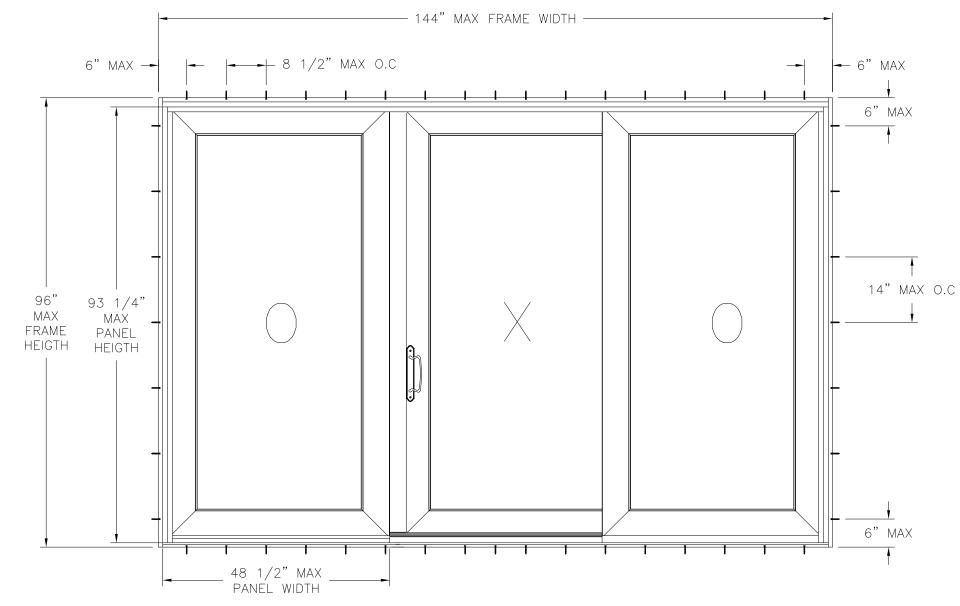

SERIES 623 VINYL SGD EXTERIOR VIEW FLANGE INSTALLATION

DESIGN PRESSURE RATING	IMPACT RATING		
±50.0PSF	LARGE AND SMALL MISSILE IMPACT		

MISSILE LEVEL D, WIND ZONE 4




EASTERN ARCHITECTURAL SYSTEMS A DIVISION OF EASTERN METAL SYPPLY


16341 DOMESTIC AVE FORT MYERS, FLORIDA 33912 800-432-2204


SERIES 623 VINYL SLIDING GLASS DOOR 144" x 96" IMPACT FLANGE ELEVATION

DRAWN: DWG NO. R.L. 08-01671 SCALE NTS SHEET 3 OF 6


DATE 07/13/12



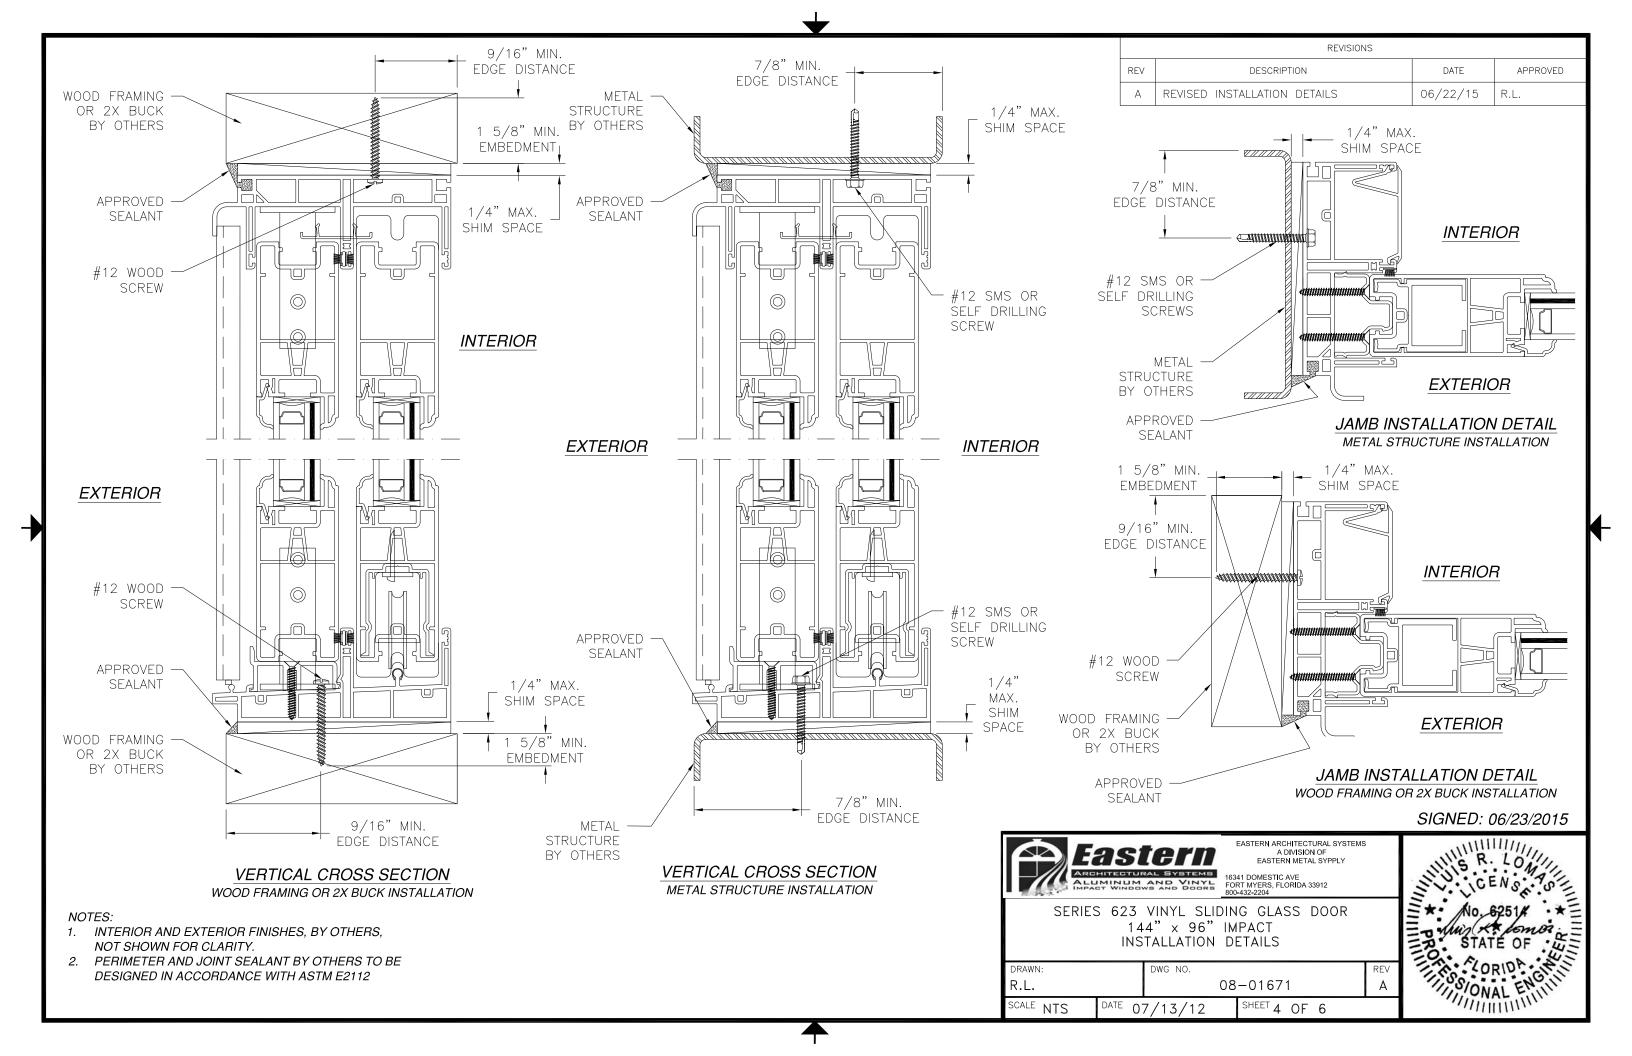

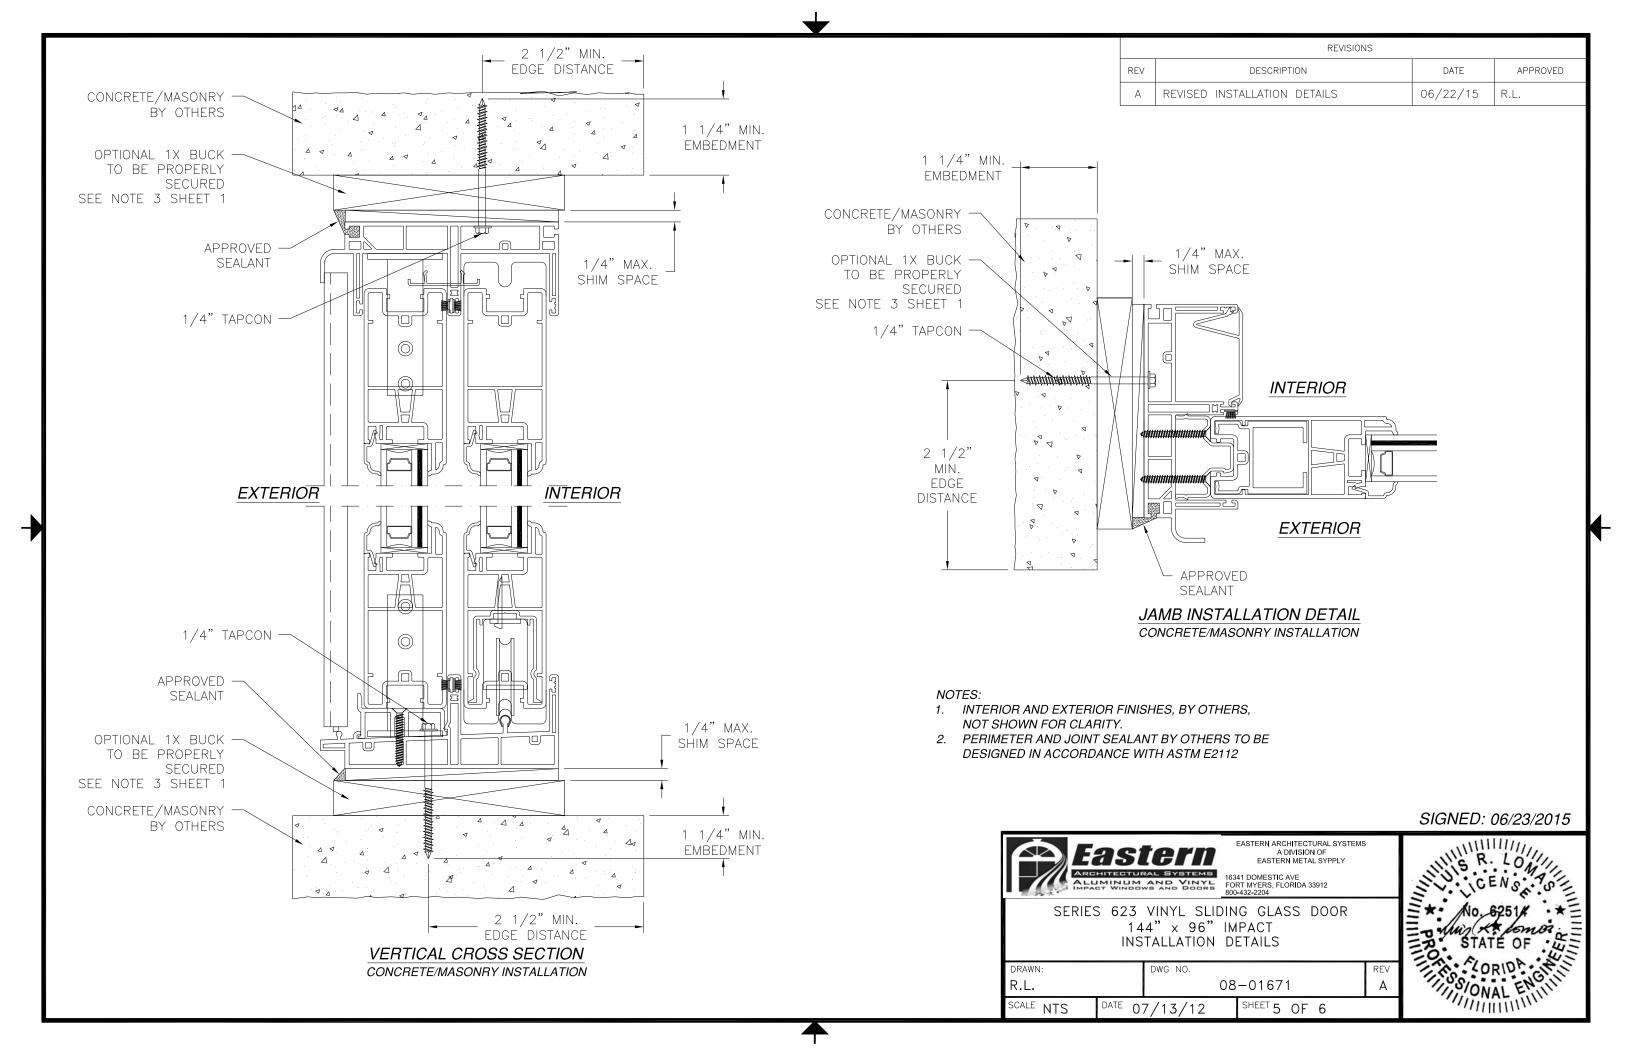

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
А	REVISED INSTALLATION DETAILS	06/22/15	R.L.

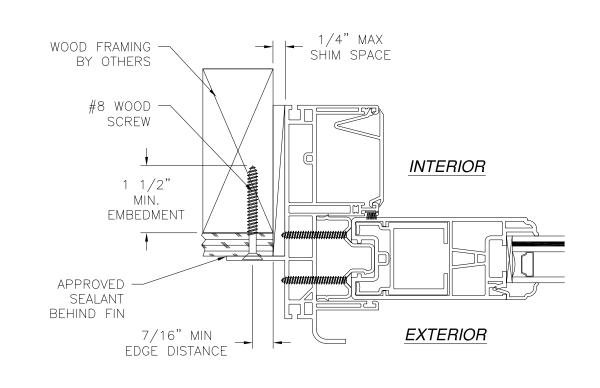

JAMB INSTALLATION DETAIL WOOD FRAMING OR 2X BUCK INSTALLATION

NOTES:

- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
- 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 06/23/2015



