


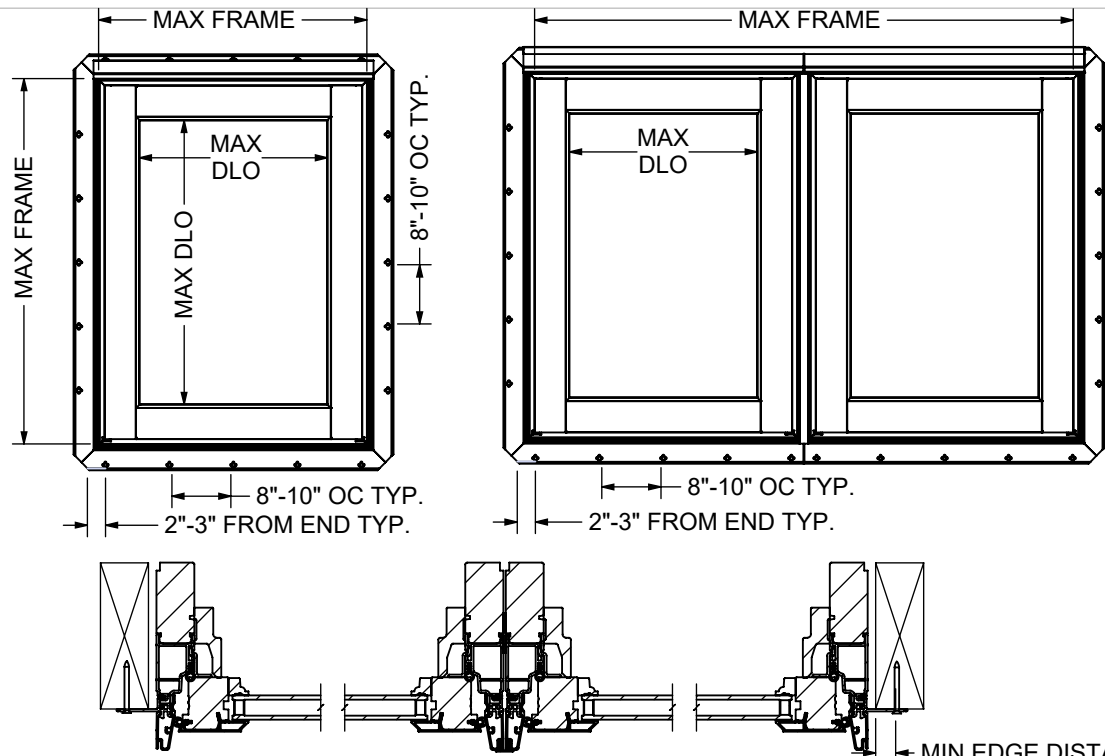


8211 Twin Casement Picture
NAILING FIN
INSTALLATION

#6 X (1-5/8") NON-CORROSIVE
SCREW 1-1/2" MIN PENETRATION
INTO FRAMING MEMBER
8-10" ON CENTER THROUGH
NAILING FIN AROUND THE UNITS
ENTIRE PERIMETER TYP

.750 MIN EDGE
DISTANCE TYP.

USE SILICONE SEALANT
AROUND ENTIRE PERIMETER
BETWEEN NAILING FIN &
WOOD BUCK BY OTHERS TYP

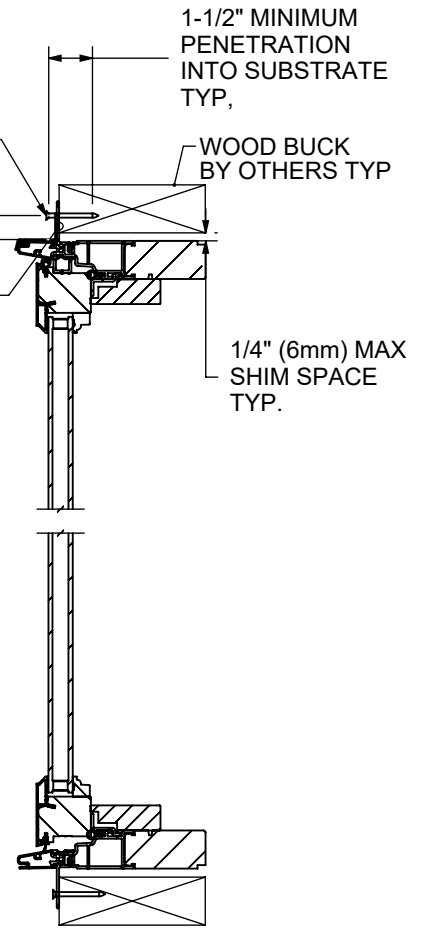

Description	Max Frame Size		Max Daylight Opening		Design Pressure (psf)	Frame Material	Installation Method
	Width (IN)	Height (IN)	Width (IN)	Height (IN)			
8211 TWIN CASEMENT PICTURE	71.5	95.5	66.490	89.750	+/-45	ALUM/WOOD/VINYL	THRU NAIL FIN

GENERAL NOTE(S):

1. THESE UNITS HAVE BEEN TESTED, ANALYZED, HALLMARK CERTIFIED AND FBC APPROVED.
2. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ. THE PRODUCT HAS BEEN EVALUATED TO THE FOLLOWING.
 1. AAMA/WDMA/CSA 101/I.S.2/A440-17
 2. AAMA/WDMA/CSA 101/I.S.2/A440-22
3. THIS SCHEDULE ADDRESSES ONLY THE FASTENERS REQUIRED TO ANCHOR THE WINDOW(S) TO ACHIEVE THE RATED DESIGN PRESSURE. THOROUGHLY READ AND FOLLOW MANUFACTURERS INSTALLATION INSTRUCTIONS RECEIVED WITH UNIT. THIS GUIDE DOES NOT ADDRESS THE SEALING CONSIDERATIONS THAT MAY ARISE IN DIFFERENT WALL CONDITIONS.
4. FASTENERS, ANCHORS, AND CONNECTORS SHALL COMPLY WITH THE CORROSION RESISTANCE REQUIREMENTS OF THE 2026 FLORIDA BUILDING CODE, SECTION 1711, BASED ON EXPOSURE CONDITIONS AND PROXIMITY TO A SALTWATER SHORELINE AND NOT ALL THE ONES SHOWN HERE NECESSARILY APPLY.

TOLERANCES UNLESS SPECIFIED:	
INCHES	ANGLE
.X ± .1"	XX ± 1°
.XX ± .03"	XX.X ± .5° (1/2°)
.XXX ± .015"	XX.XX ± .25° (1/4°)

Weather Shield
Windows & Doors

PRODUCTS: 8211 TWIN CASEMENT PICTURE		
DRAWN BY: JK/JB	DATE: 11-16-12	TITLE: INSTALLATION INSTRUCTIONS
DWG NO.: 85-7438-29		REV L
SCALE: 1:12 SHEET NAME: Sheet1 SHEET 1 OF 1		

REV	DATE	DESCRIPTION	PCR NO.	ENG	PDR #:	PROFILE #: