


G:\ENDURA\FL-14823 R14\FL-14823.11-13,16-18.dwg

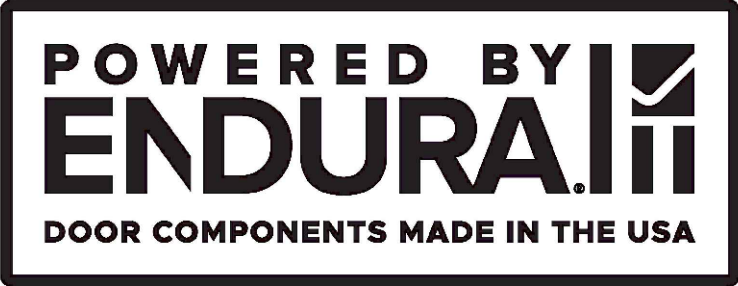

Ultimate Flip Lever Astragal
INSWING / OUTSWING
"NON-IMPACT"

GENERAL NOTES


- 1. This product has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
- 2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
- 3. When used in areas requiring wind borne debris protection this product is required to be protected with an impact resistant covering that complies with FBC Sections 1609.1.2 & R301.2.1.2.
- 4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
- 5. This product has been tested and is approved for use in the door panels as specified in this approval. Substitution into a similar product that possess a comparable current Florida Statewide product approval may be approved for use by the local Authority Having Jurisdiction.
- 6. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS	
SHEET#	DESCRIPTION
1	Typical elevations, design pressures and general notes
2	Astragal details
3	Door panel details
4	Horizontal and vertical cross sections
5	Threshold details
6	Buck and frame anchoring



Ultimate Flip Lever Astragal


ULTIMATE FLIP LEVER ASTRAGAL by ENDURA				
MAXIMUM FRAME SIZE			DESIGN PRESSURE RATING (PSF)	
			POSITIVE	NEGATIVE
JELD-WEN Insert Glazed (Fiberglass)	INSWING	75" X 98"	+40.0	-45.0
	OUTSWING	75" X 96.5"	+40.0	-40.0

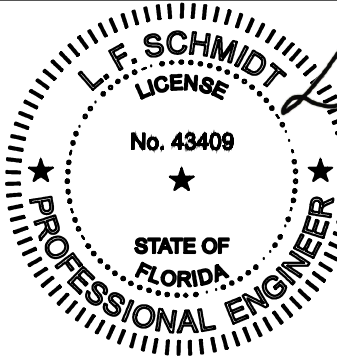

L.F. Schmidt
Digitally signed by Lyndon F Schmidt
Date: 2026.07.19 11:41:47 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

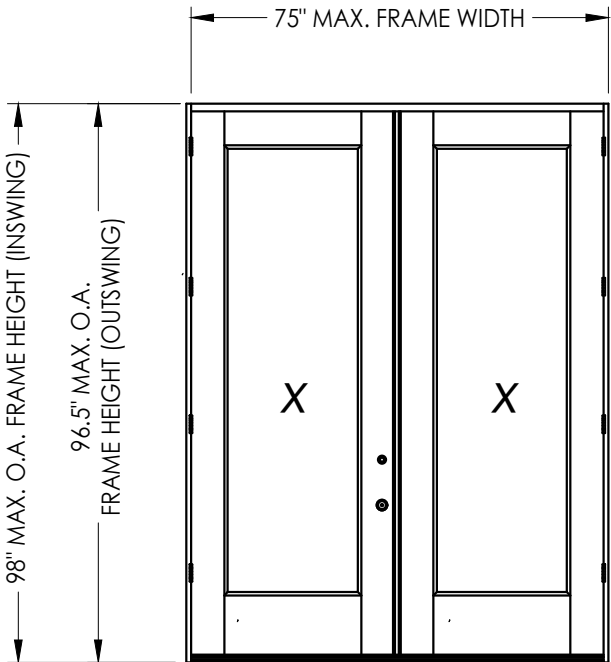

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

ENDURA

PART OR ASSEMBLY:
TYPICAL ELEVATIONS, DESIGN
PRESSURES & GENERAL NOTES

8	7/03/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
7	4/16/24	ADD MODERN ASTRAGAL PROFILE		LFS
6	7/07/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
NO.	DATE			BY

REVISIONS

DATE: 8/30/11

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS




DRAWING NO.: FL-14823.16

SHEET 1 OF 6

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2011 R.W. BUILDING CONSULTANTS INC.

G:\ENDURA\FL-14823 R14\FL-14823.11-13,16-18.dwg

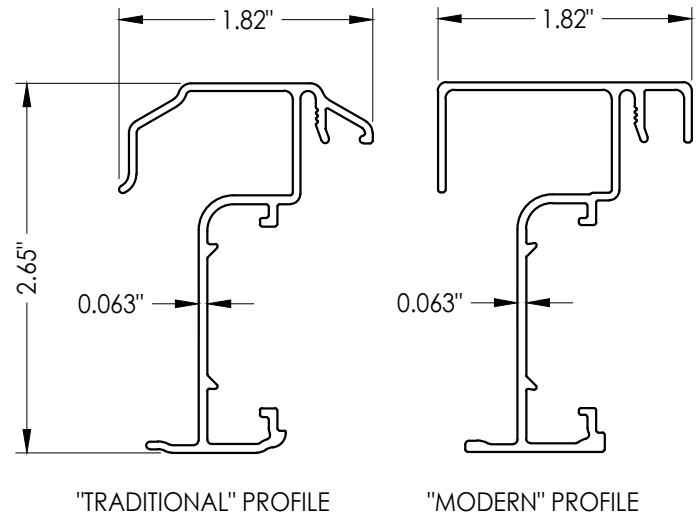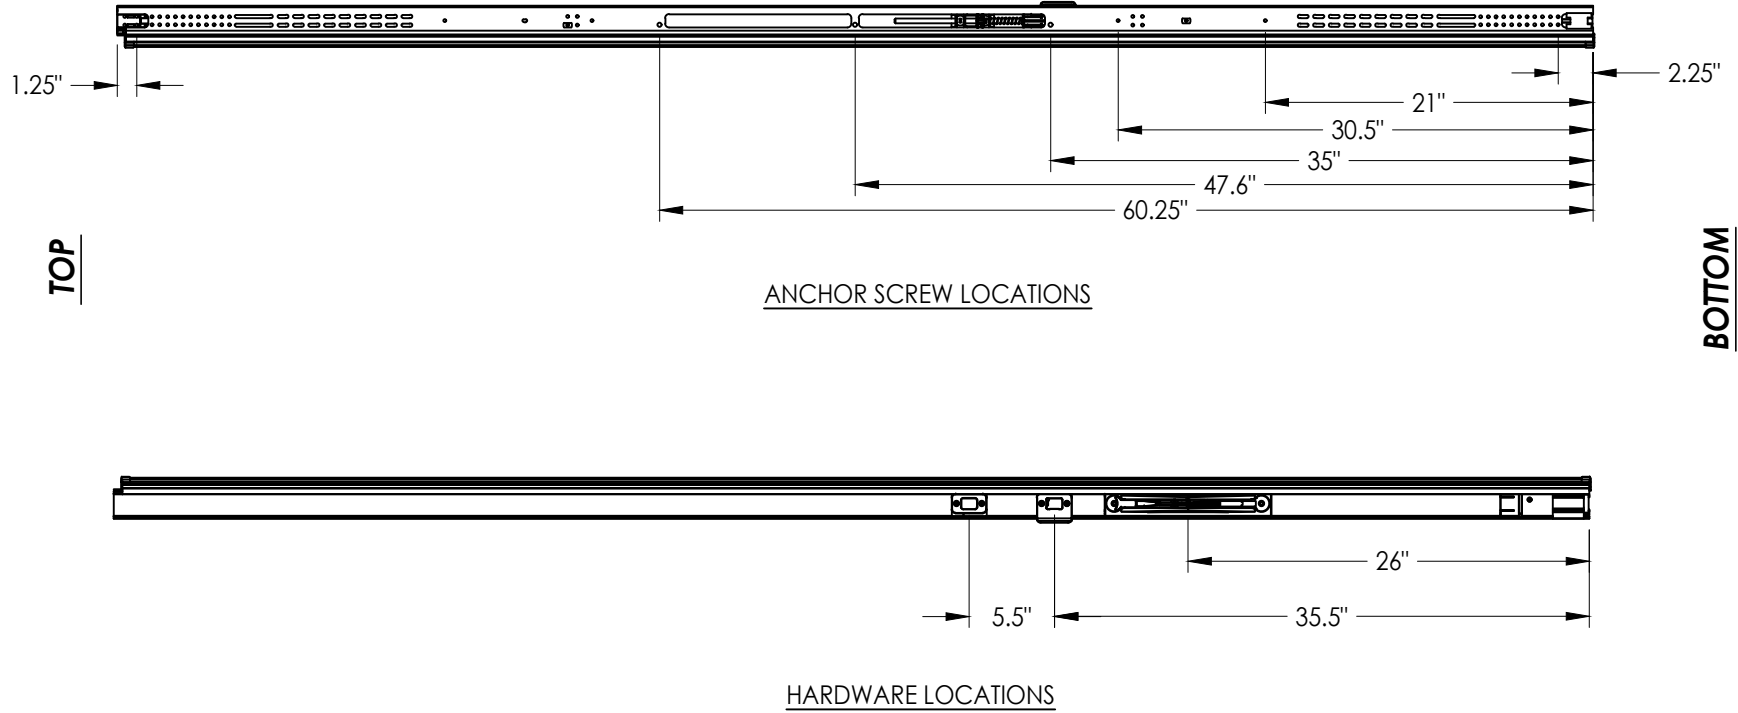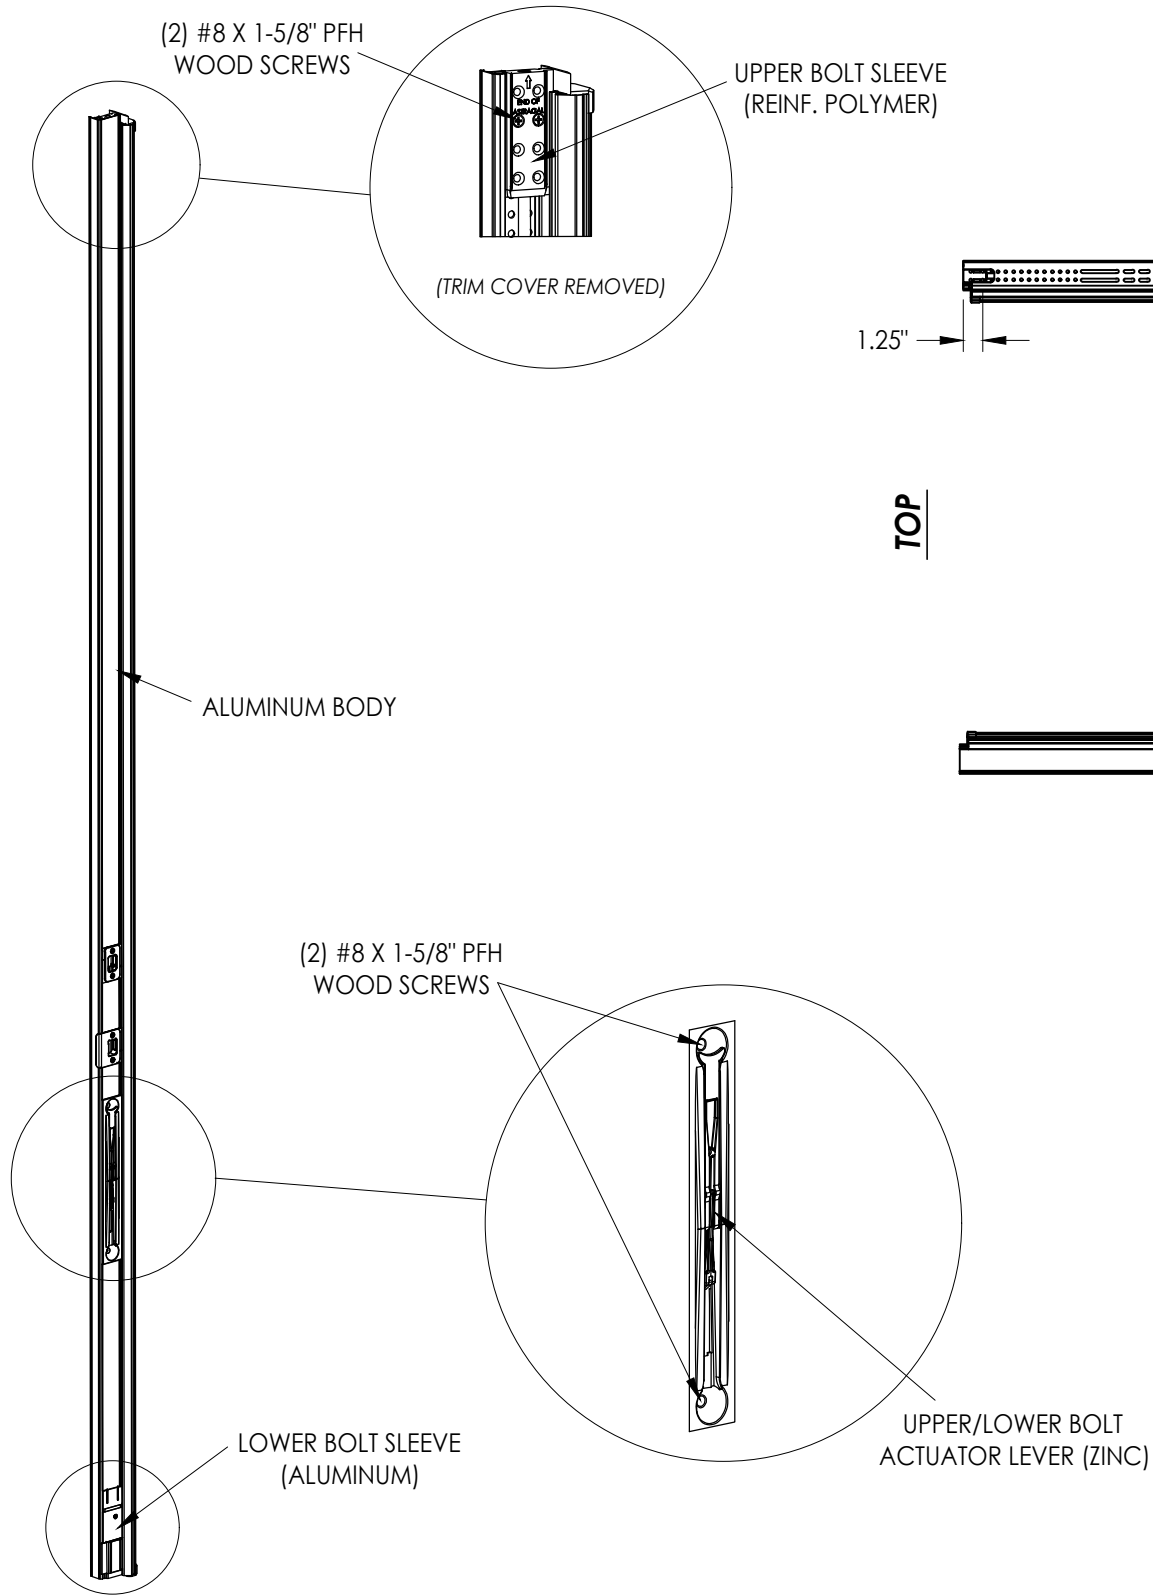


ULTIMATE FLIP LEVER ASTRAGAL

ASTRAGAL SECTIONS



PRODUCT:		PART OR ASSEMBLY:	
ENDURA		ASTRAGAL DETAILS	
NO.	DATE	REVISIONS	BY
8	7/03/26	UPDATE TO 9TH ED. (2026) FBC	LFS
7	4/16/24	ADD MODERN ASTRAGAL PROFILE	LFS
6	7/07/23	UPDATE TO 8TH ED. (2023) FBC	LFS
DATE: 8/30/11			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-14823.16			
SHEET 2 OF 6			

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

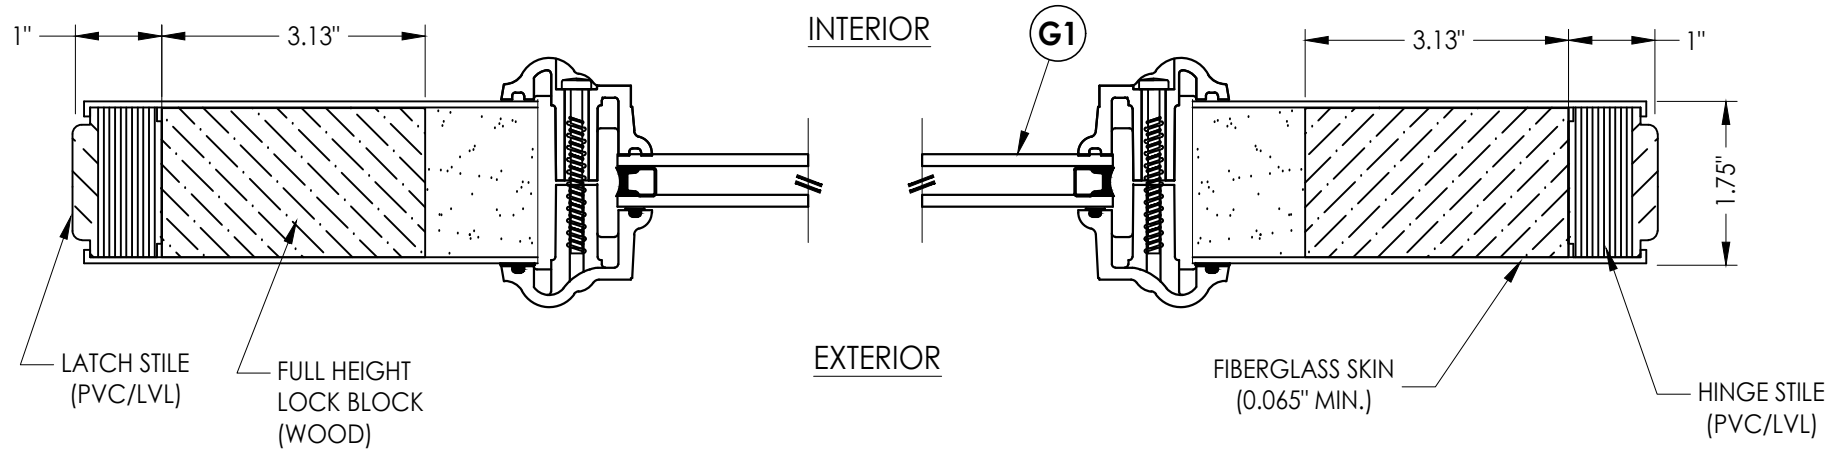

1
3 **HORIZONTAL CROSS SECTION**

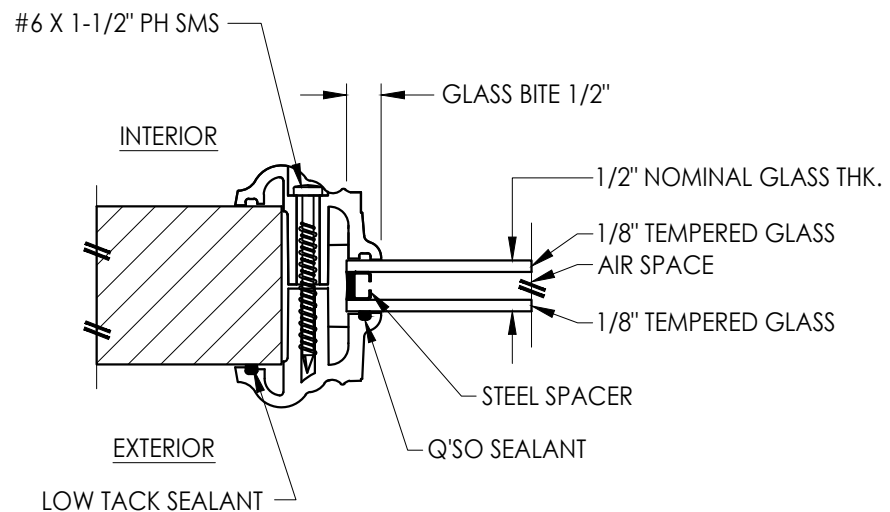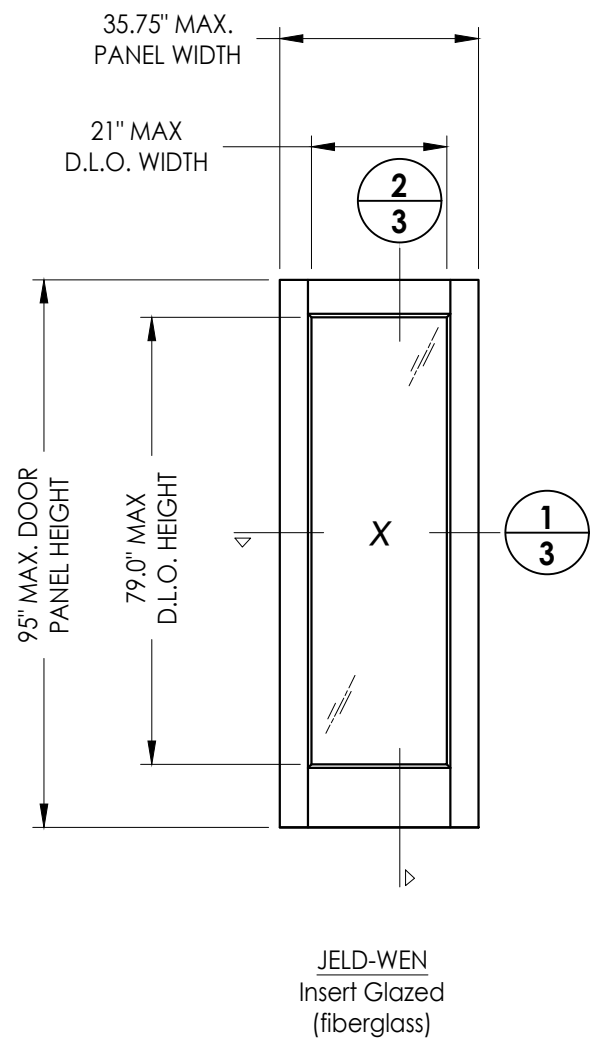

G1 **GLAZING DETAIL**
Lip Life Insert Glazing

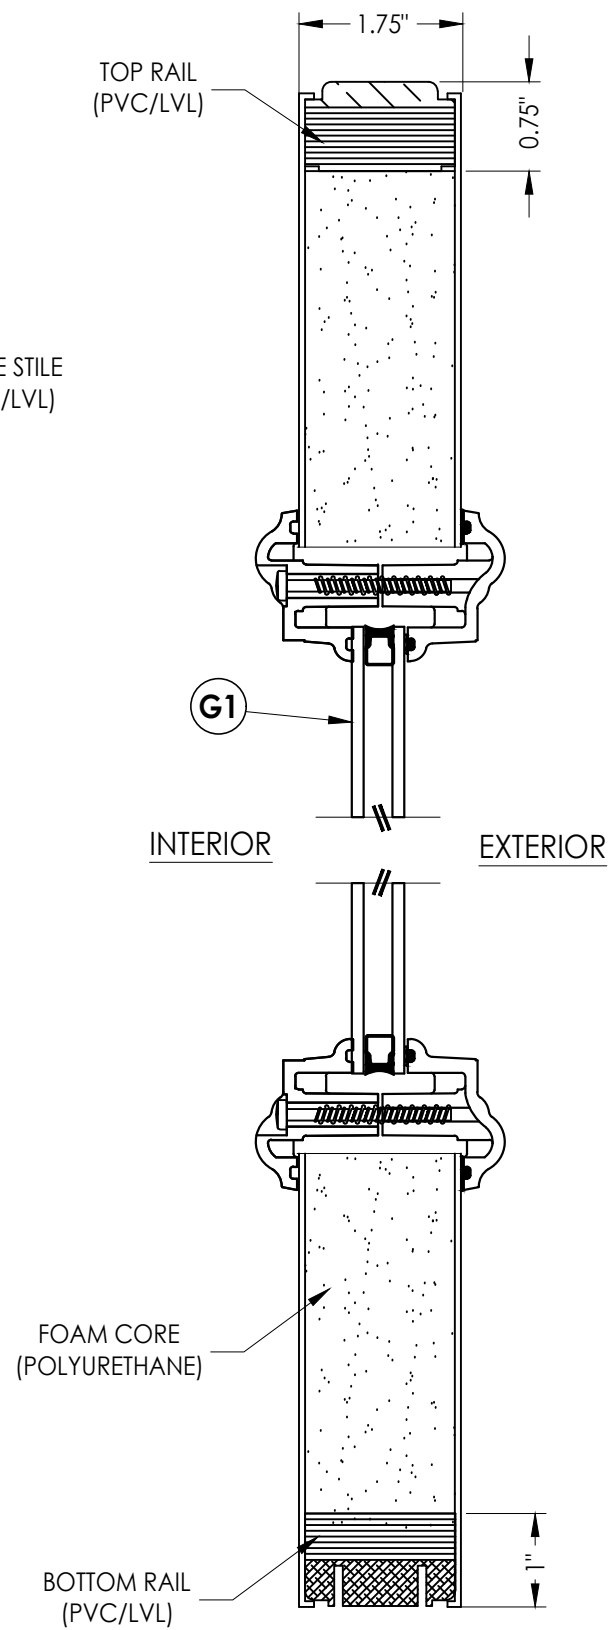

2
3 **VERTICAL CROSS SECTION**


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813







PRODUCT:		ENDURA	
PART OR ASSEMBLY:		DOOR PANEL DETAILS & GLAZING DETAIL	
NO.	DATE	REVISIONS	
		BY	
8	7/03/26	UPDATE TO 9TH ED. (2026) FBC	LFS
7	4/16/24	ADD MODERN ASTRAGAL PROFILE	LFS
6	7/07/23	UPDATE TO 8TH ED. (2023) FBC	LFS

DATE:	8/30/11
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-14823.16
SHEET	3 OF 6

G:\ENDURA\FL-14823 R14\FL-14823.11-13,16-18.dwg

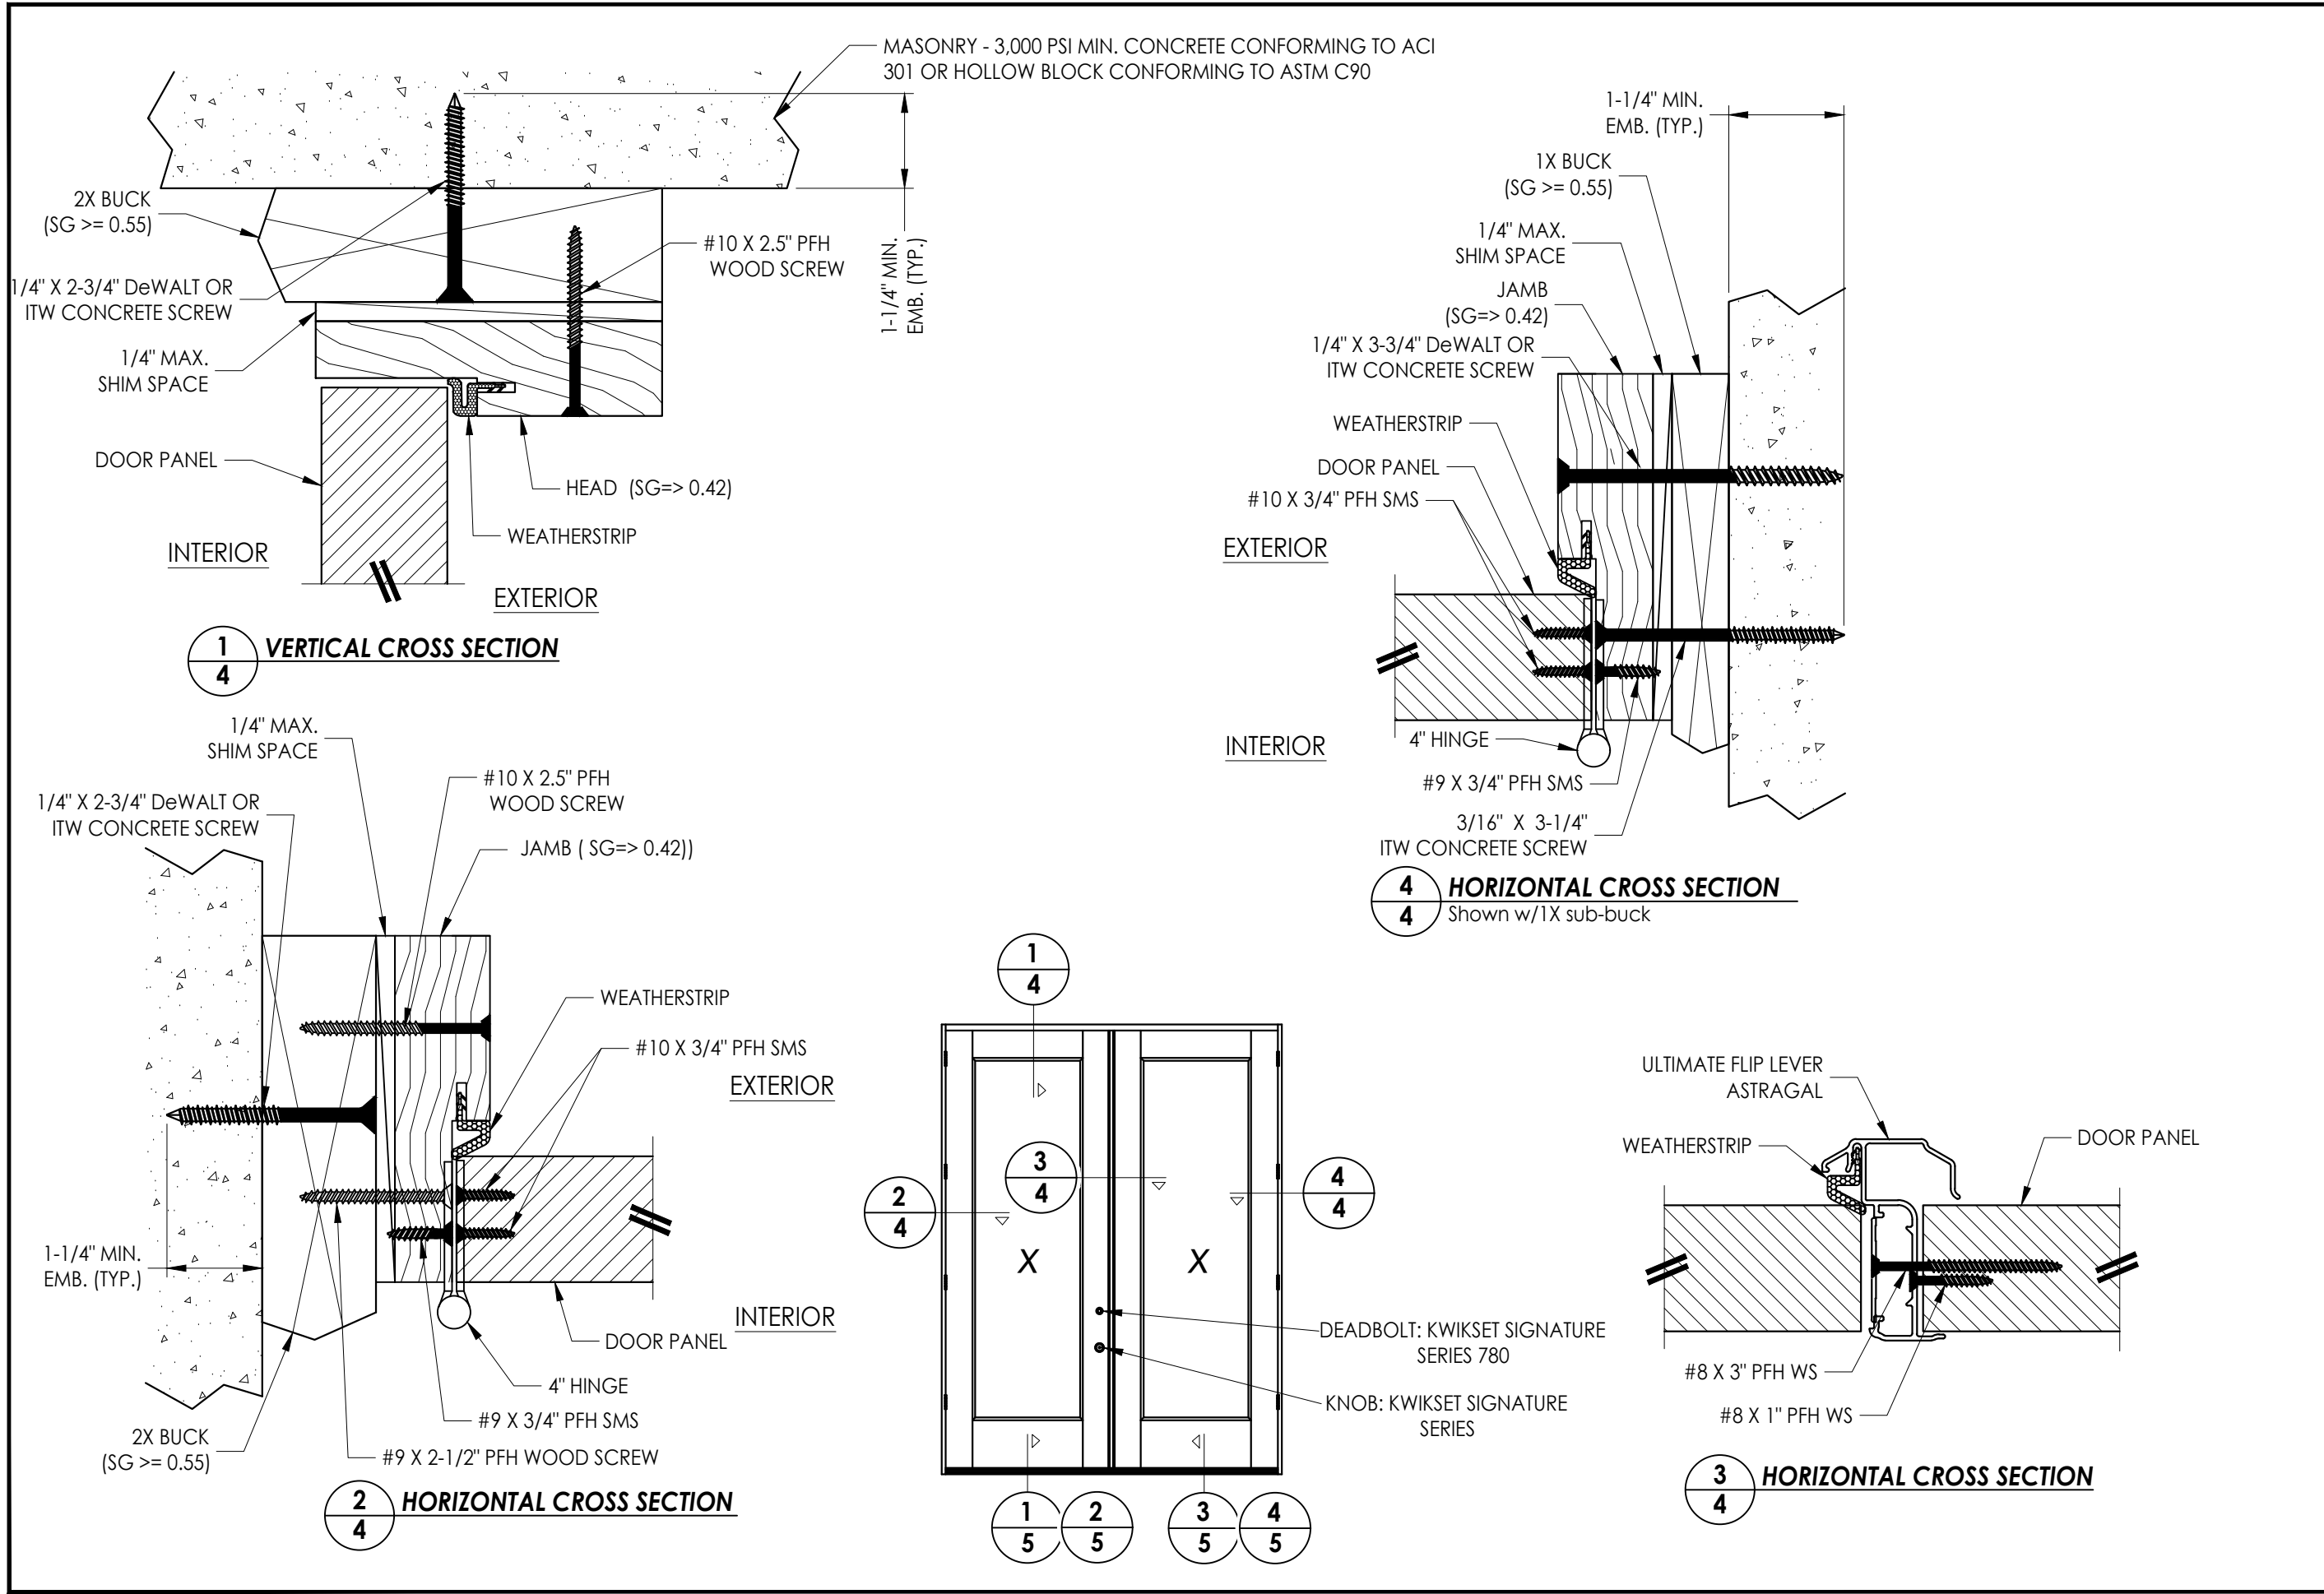

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: ENDURA		PART OR ASSEMBLY: HORIZONTAL AND VERTICAL CROSS SECTIONS	
		LFS	BY
		UPDATE TO 9TH ED. (2026) FBC	
		ADD MODERN ASTRAGAL PROFILE	
		UPDATE TO 8TH ED. (2023) FBC	
		NO.	DATE
REVISIONS			
DATE: 8/30/11			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-14823.16			
SHEET 4 OF 6			

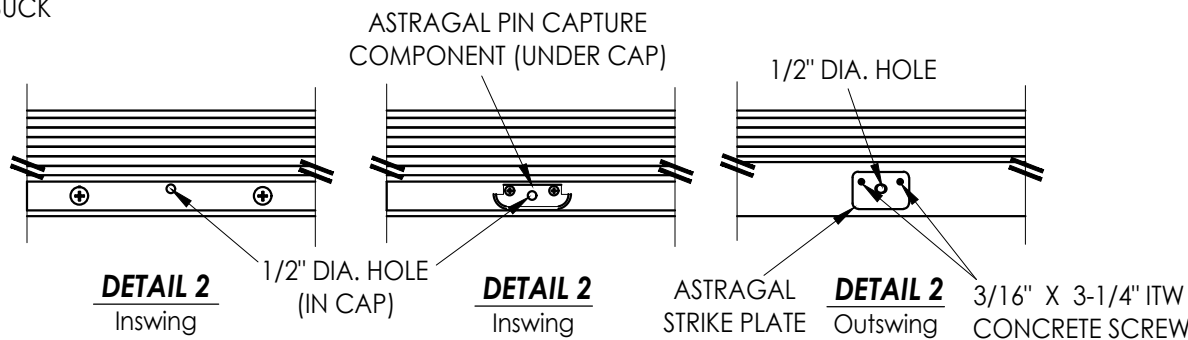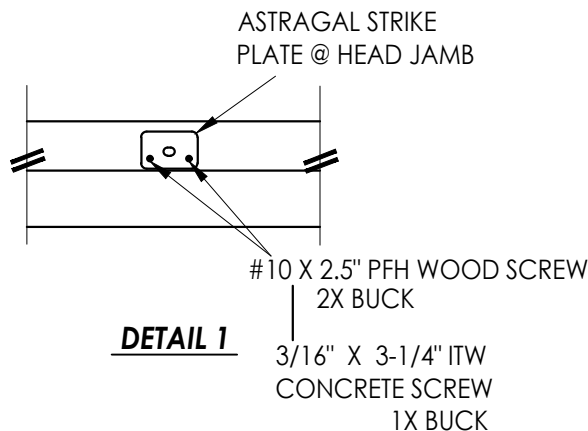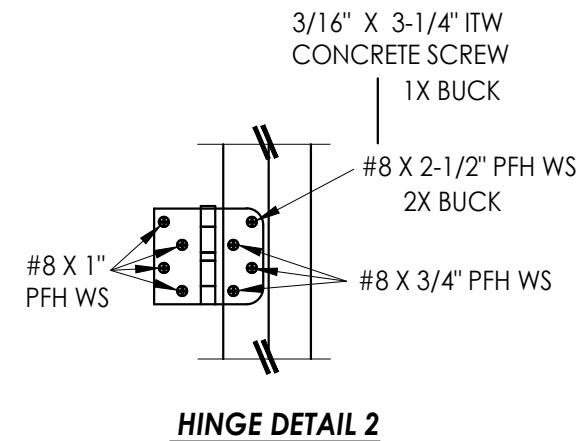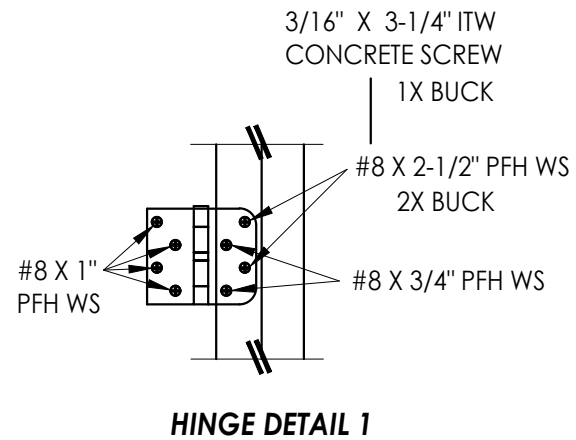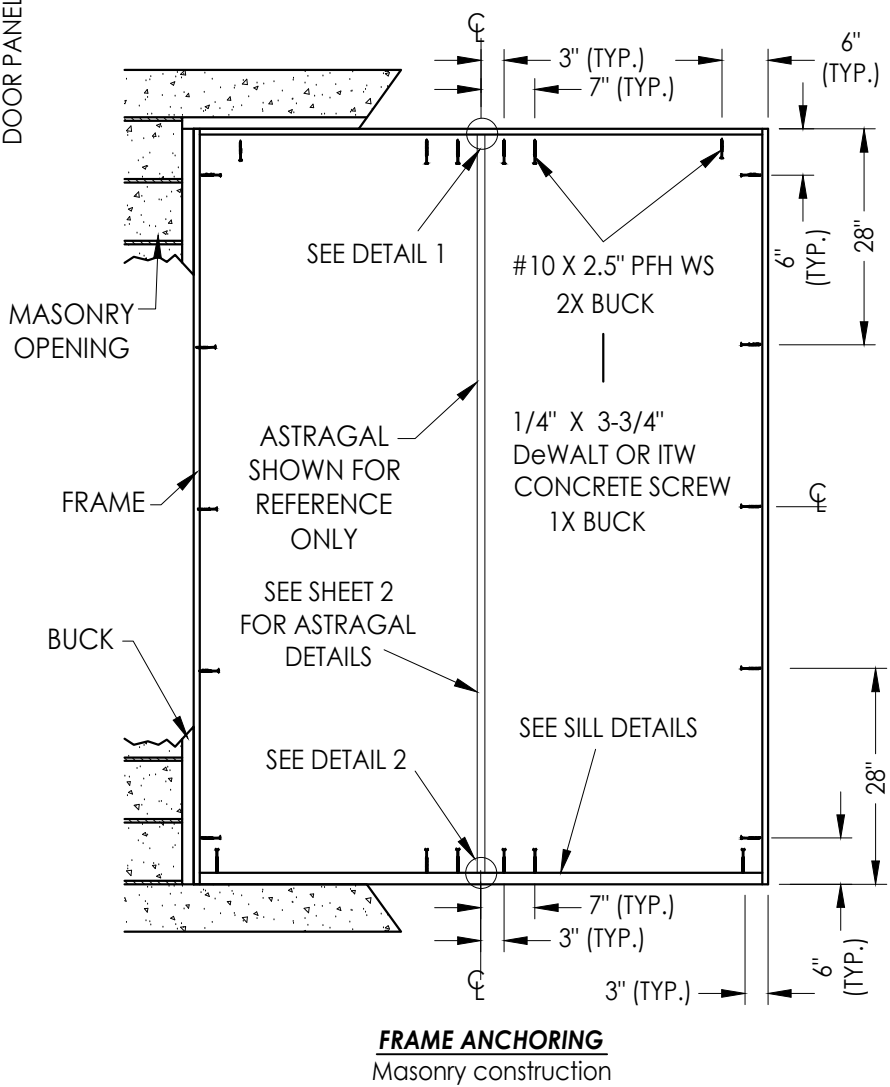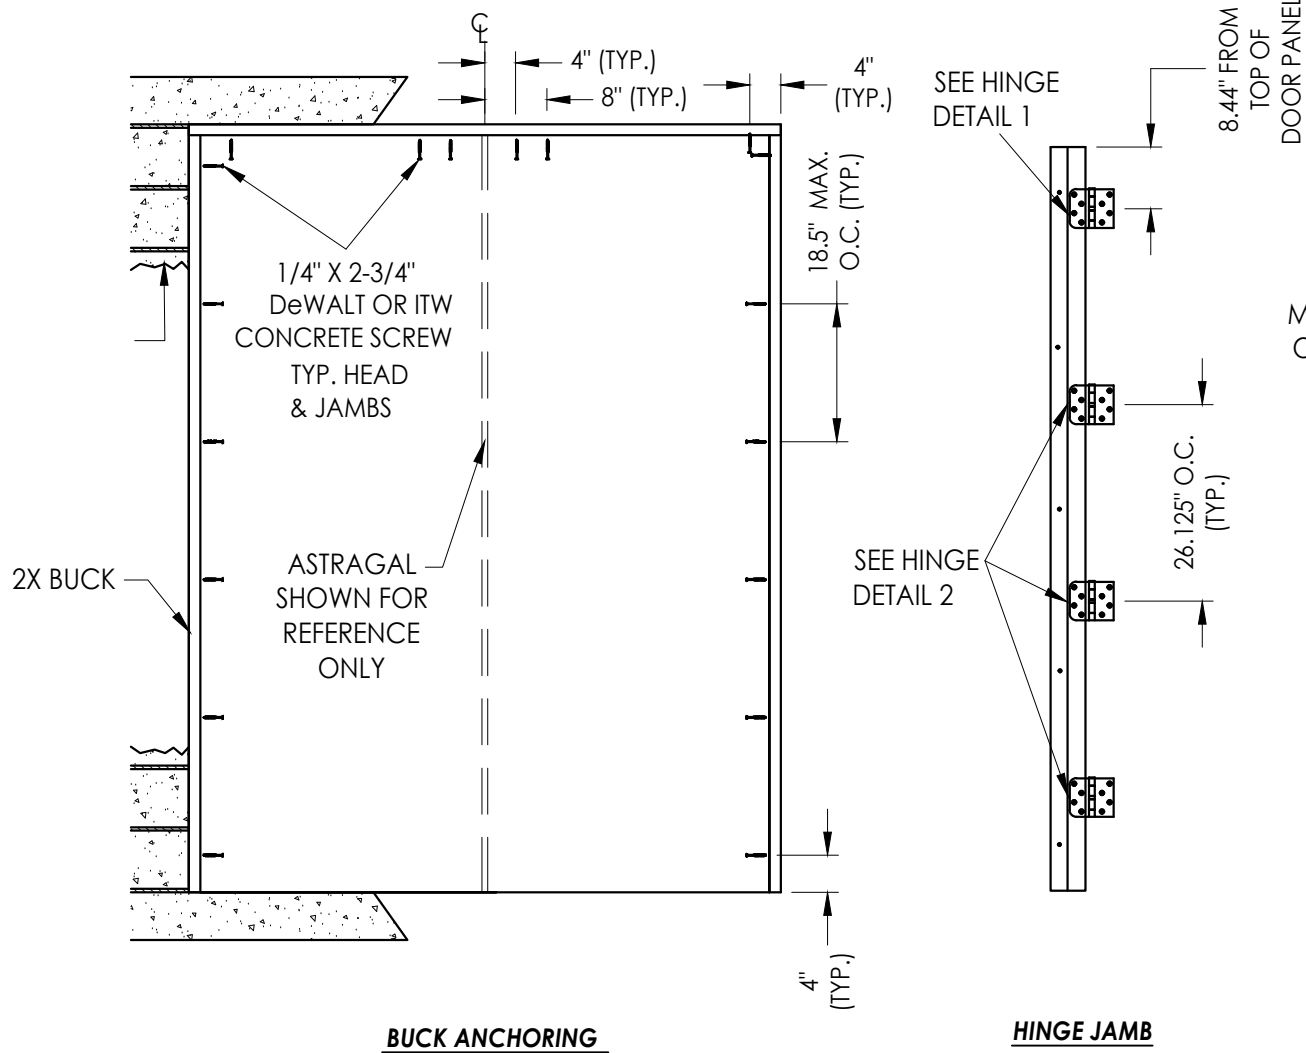

CORROSION RESISTANCE - SALTWATER ENVIRONMENT

Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or R332.1.

CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	3/16"	1-1/4"	3"	1-1/2"
	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: ENDURA

PART OR ASSEMBLY:
BUCK & FRAME ANCHORING

NO.	DATE	REVISIONS
8	7/03/26	UPDATE TO 9TH ED. (2026) FBC
7	4/16/24	ADD MODERN ASTRAGAL PROFILE
6	7/07/23	UPDATE TO 8TH ED. (2023) FBC
5		
4		
3		
2		
1		

DATE: 8/30/11

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-14823.16

SHEET 6 OF 6