

AMERICAN CRAFTSMAN WINDOWS

SILVER LINE WINDOWS AND DOORS

70 SERIES / V1 SERIES / (2907/4907)

SINGLE-HUNG WINDOWS


(NON-HVHZ)(NON-IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-17
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. WINDOW FRAME MATERIAL: PVC
7. GLASS SHALL MEET THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAILS.

DESIGN PRESSURE TABLE			
SIZE	CONFIGURATION	DESIGN PRESSURE	MISSILE IMPACT RATING
40" X 68"	O/X	+35/-35 PSF	NON-IMPACT
44" X 60"	O/X	+35/-35 PSF	NON-IMPACT
48" X 84"	O/X	+20/-20 PSF	NON-IMPACT
80" X 84"	O/X-O/X	+15/-15 PSF	NON-IMPACT
64" X 68"	O/X-O/X	+35/-35 PSF	NON-IMPACT
80" X 62"	O/X-O/X	+20/-20 PSF	NON-IMPACT
90" X 74"	O/X-O/X	+15/-15 PSF	NON-IMPACT
71-1/2" X 60"	O/X-O/X	+35/-35 PSF	NON-IMPACT
107" X 62"	O/X-O/X-O/X	+35/-35 PSF	NON-IMPACT
107" X 74"	O/X-O/X-O/X	+20/-20 PSF	NON-IMPACT

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES & GLAZING DETAILS
2	ELEVATION & ANCHOR LAYOUTS
3	ELEVATION & ANCHOR LAYOUTS
4	ELEVATION & ANCHOR LAYOUTS
5	VERTICAL SECTIONS
6	HORIZONTAL SECTIONS
7	ANCHOR DETAILS
8	ANCHOR STRAP DETAIL, INSTALLATION NOTES AND ANCHOR SCHEDULE

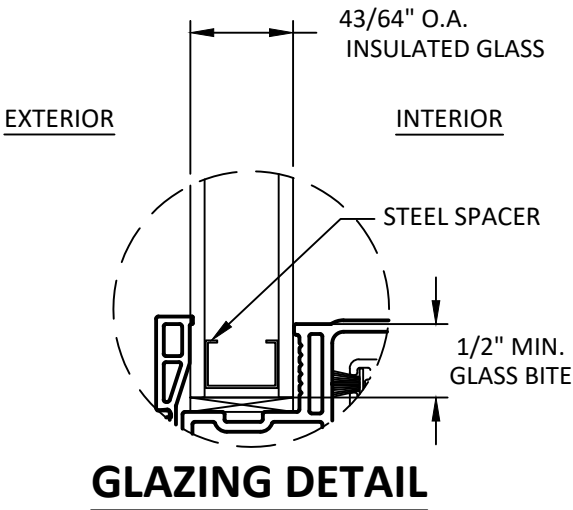

- GLAZING NOTES:
1. GLASS TYPE & THICKNESS SHALL COMPLY WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
3. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
4. D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES IN GLASS CHARTS.

AMERICAN CRAFTSMAN WINDOWS
SILVER LINE WINDOWS AND DOORS

ONE SILVER LINE DRIVE
NORTH BRUNSWICK, NJ 08902
PH: (888) 741-0354

TITLE:
70 SERIES/ V1 SERIES/(2907/4907)
SINGLE-HUNG WINDOWS
(NON-HVHZ)(NON-IMPACT)

GENERAL NOTES & GLAZING DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
6TH FBC EDITION	FM	10/17
7TH FBC EDITION	NUS	10/14/20
8th FBC EDITION	LH	09/23
Current FBC & EC24-100	LH	04/25

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2025.06.06 17:24:50 -0400



HERMES F. NORERO
FLORIDA PROFESSIONAL ENGINEER
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION NO. 29578

FL #:
FL14911

DATE: **07.02.2018**

DWG. BY: JA	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**

DWG. #: **SWD053**

SHEET:

1

OF 8

TITLE:
70 SERIES/ V1 SERIES/(2907/4907)
SINGLE-HUNG WINDOWS
(NON-HVHZ)(NON-IMPACT)


ELEVATION & ANCHOR LAYOUTS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
6TH FBC EDITION	FM	10/17
7TH FBC EDITION	NUS	10/14/20
8th FBC EDITION	LH	09/23
Current FBC & EC24-100	LH	04/25

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

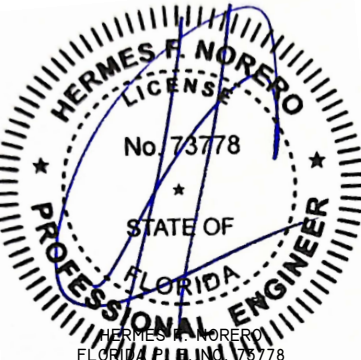


HERMES F. NORERO
FLORIDA PROFESSIONAL ENGINEER
No. 73778
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION NO. 29578

FL #:	FL14911
DATE:	07.02.2018
DWG. BY:	JA
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	SWD053
SHEET:	

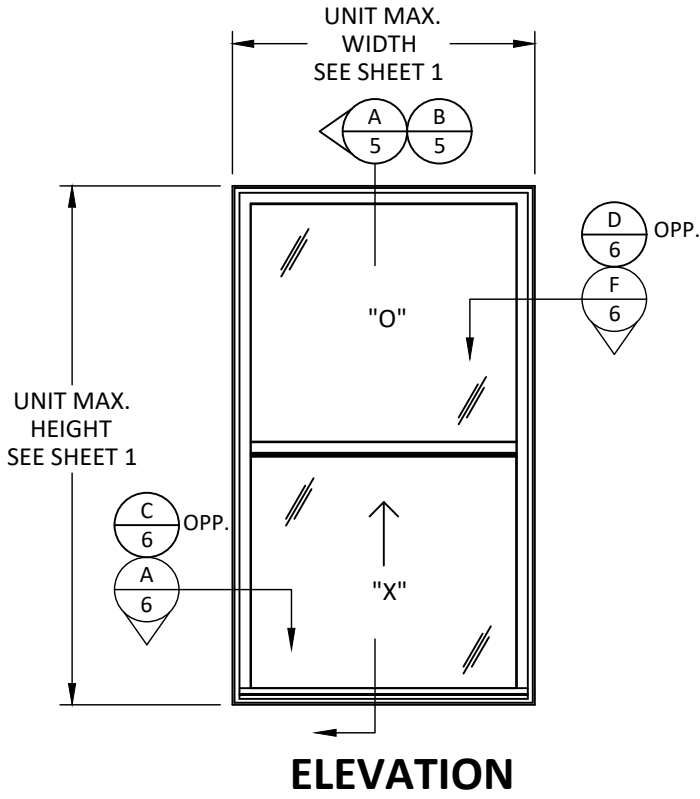


QUALIFIED CONFIGURATIONS

ARCH TOP CONFIGURATIONS FOR ALL 2907-4907
RATINGS, SINGLE UNIT CONFIGURATIONS

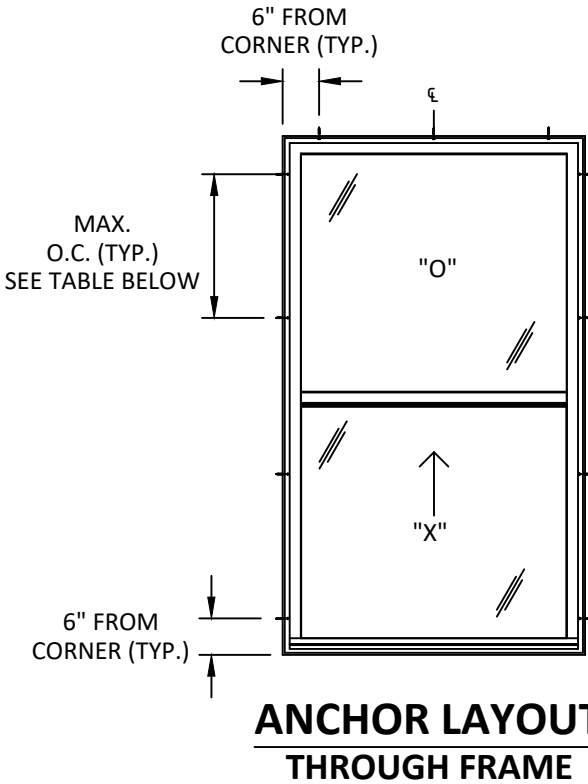

ANCHOR SCHEDULE			
PRODUCT SIZE	FROM CORNERS	MAX. O.C. AT HEAD	MAX. O.C. AT JAMBS
40" X 68"	6"	14"	18-1/2"
44" X 60"	6"	16"	16"
48" X 84"	6"	18"	24"

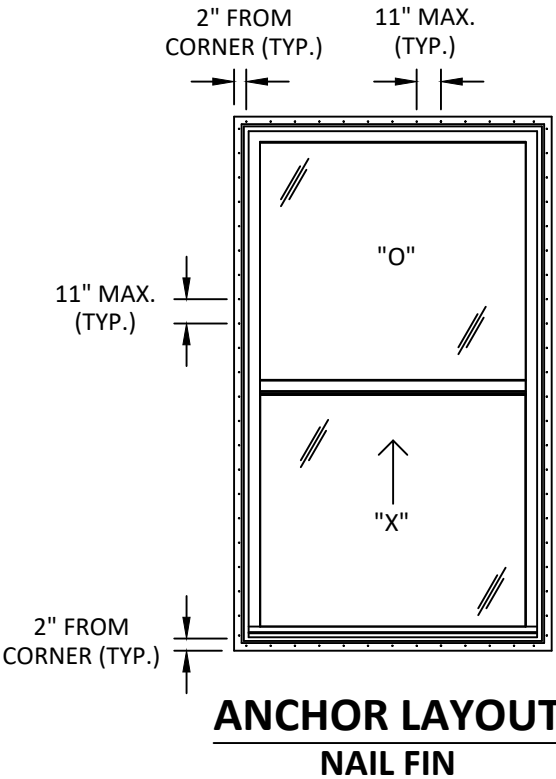

TITLE:
70 SERIES/ V1 SERIES/(2907/4907)
SINGLE-HUNG WINDOWS
(NON-HVHZ)(NON-IMPACT)


ELEVATION & ANCHOR LAYOUTS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
6TH FBC EDITION	FM	10/17
7TH FBC EDITION	NUS	10/14/20
8th FBC EDITION	LH	09/23
Current FBC & EC24-100	LH	04/25


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

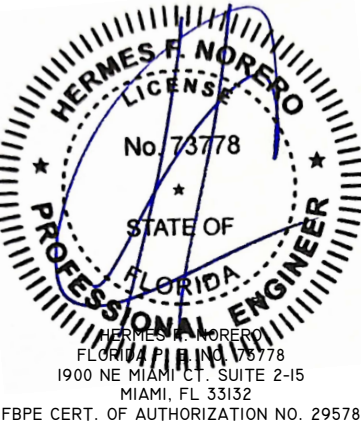

FL #:	FL14911
DATE:	07.02.2018
DWG. BY:	JA
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	SWD053
SHEET:	

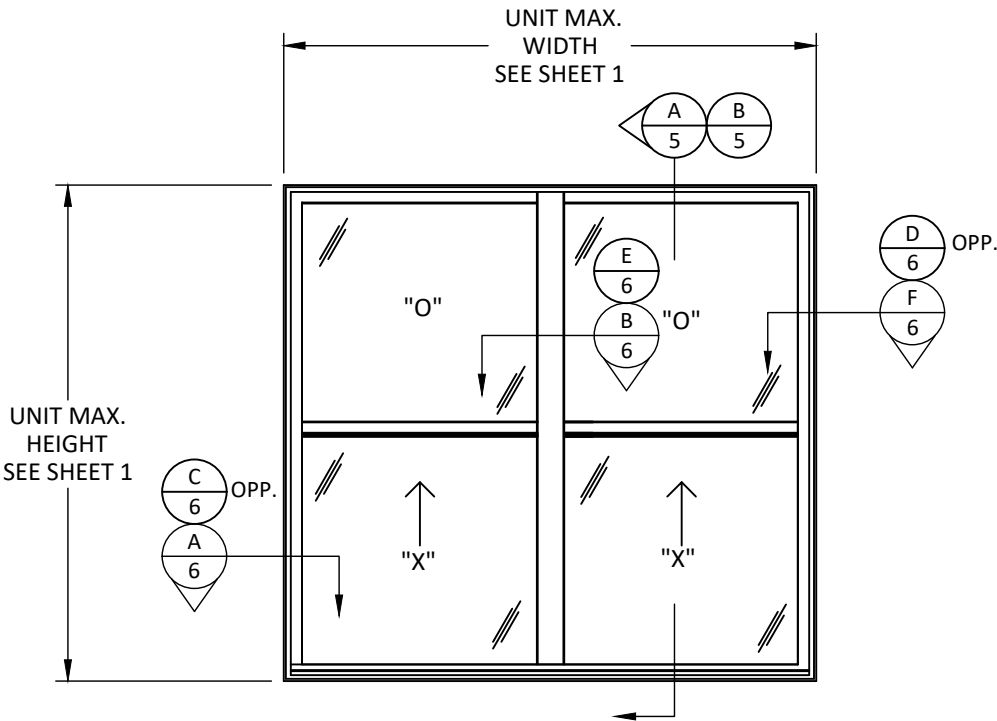


ELEVATION

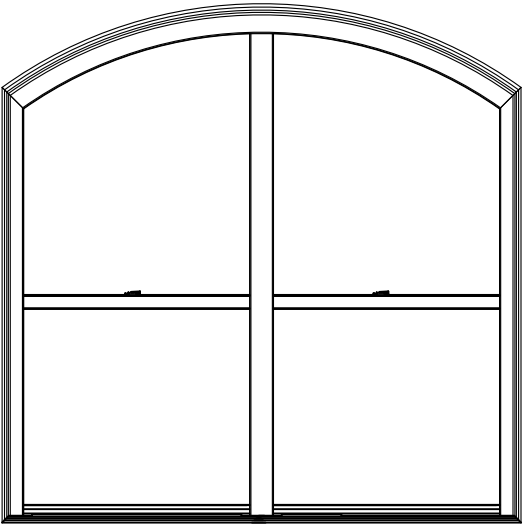


QUALIFIED CONFIGURATIONS

ARCH TOP CONFIGURATIONS FOR ALL 2907-4907
RATINGS, TWIN UNIT CONFIGURATIONS

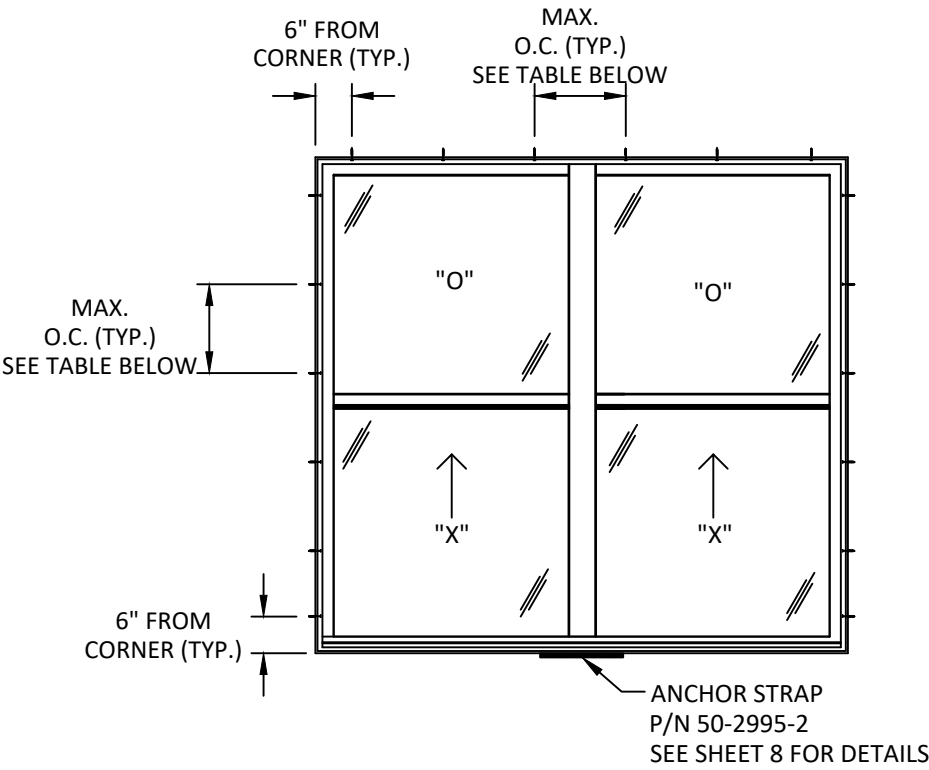

ANCHOR LAYOUT
THROUGH FRAME

ANCHOR SCHEDULE			
PRODUCT SIZE	FROM CORNERS	MAX. O.C. AT HEAD	MAX. O.C. AT JAMBS
80" X 84"	6"	22-1/2"	24"
64" X 68"	6"	17-1/4"	11"
80" X 82"	6"	22-1/2"	17-1/2"
90" X 84"	6"	19-1/2"	24"
71-1/2" X 60"	6"	19-3/4"	12"

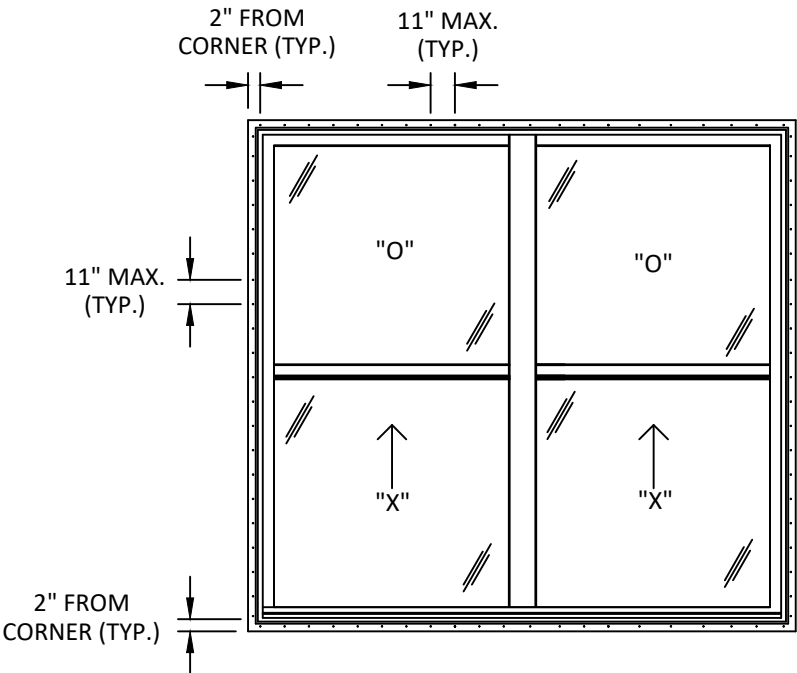

ANCHOR LAYOUT
NAIL FIN

TITLE:
70 SERIES/ V1 SERIES/(2907/4907)
SINGLE-HUNG WINDOWS
(NON-HVHZ)(NON-IMPACT)

ELEVATION & ANCHOR LAYOUTS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT. SUITE 2-15

MIAMI, FL 33132

PH: (954)399-8478


FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
6TH FBC EDITION	FM	10/17
7TH FBC EDITION	NUS	10/14/20
8th FBC EDITION	LH	09/23
Current FBC & EC24-100	LH	04/25

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

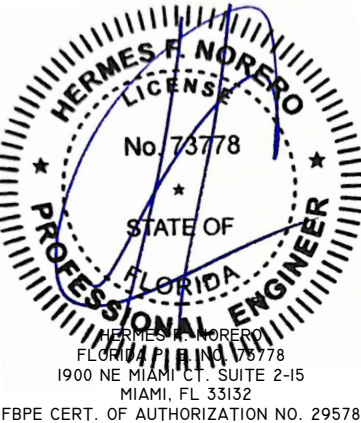

FLPE CERT. OF AUTHORIZATION NO. 29578

FL #:
FL14911

DATE: **07.02.2018**

DWG. BY: **JA** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **SWD053**


SHEET:

4

OF 8

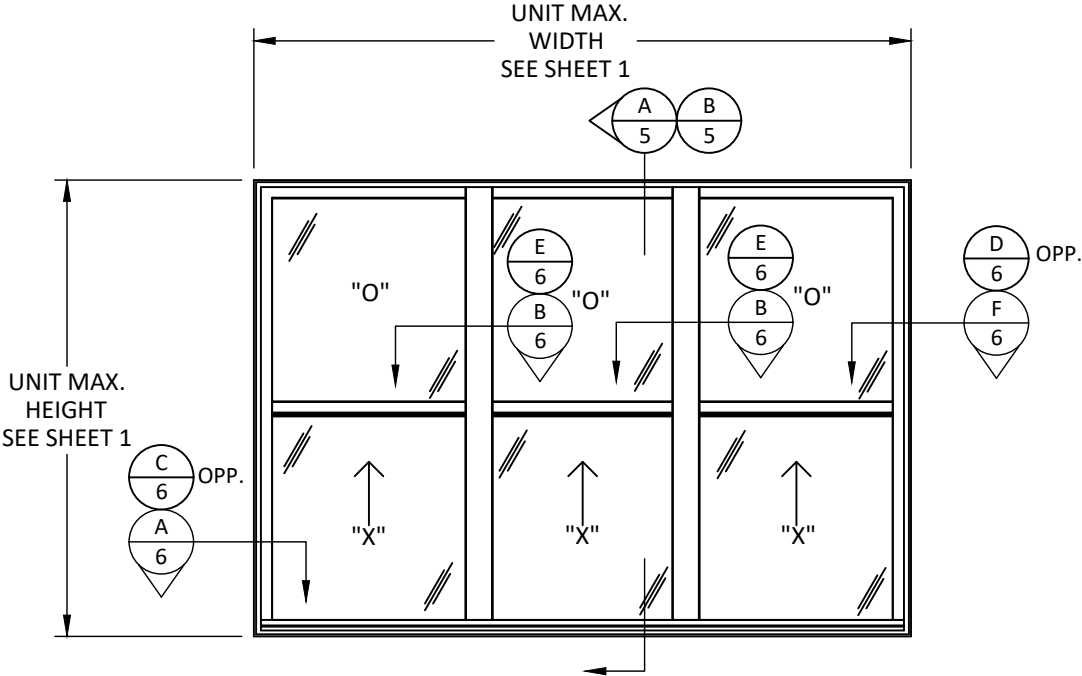


ELEVATION

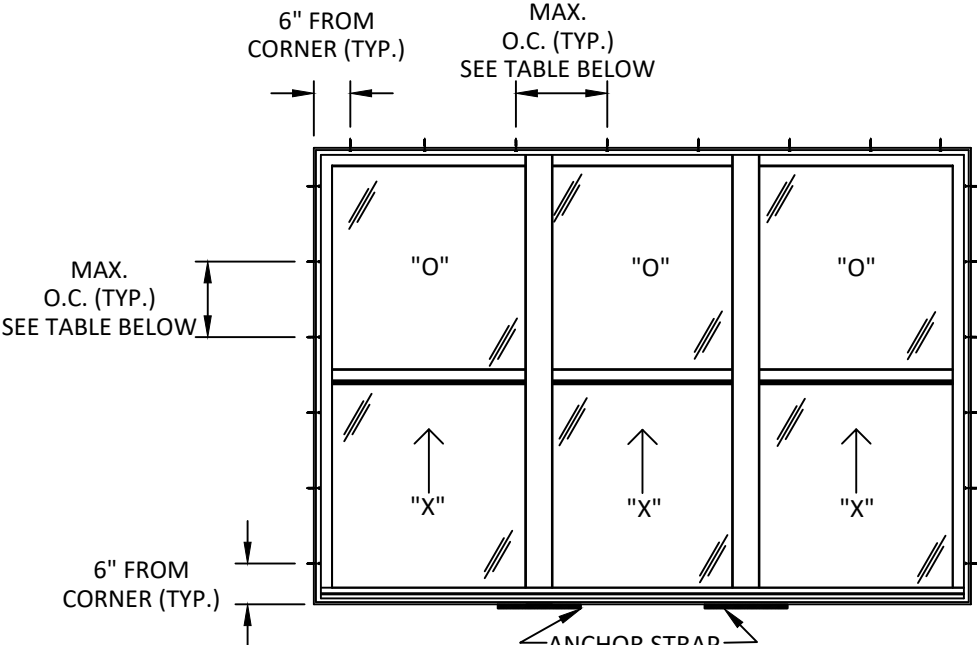


**ANCHOR LAYOUT
THROUGH FRAME**


ANCHOR SCHEDULE			
PRODUCT SIZE	FROM CORNERS	MAX. O.C. AT HEAD	MAX. O.C. AT JAMBS
107" X 62"	6"	24"	7"
107" X 74"	6"	24"	12-1/4"

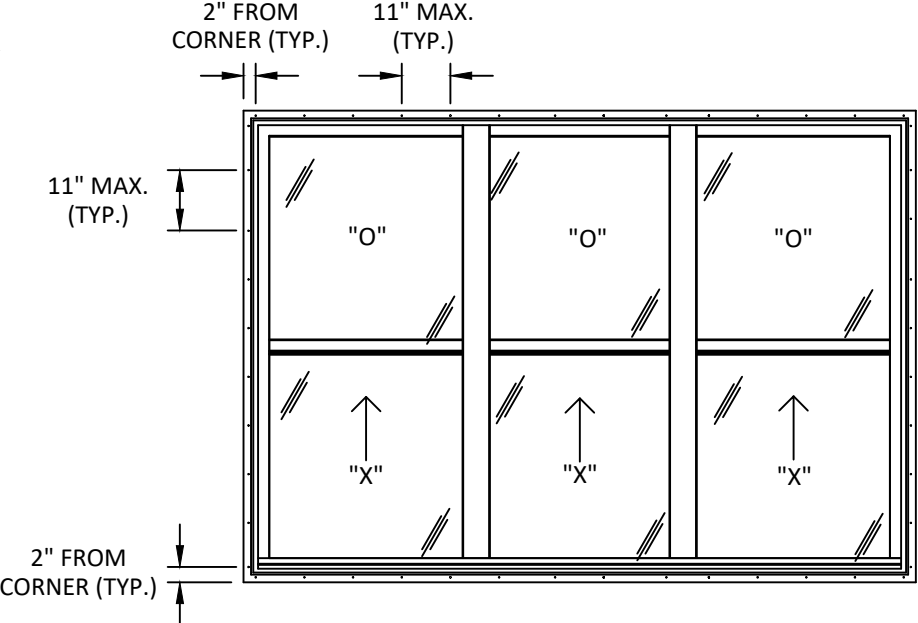

**ANCHOR LAYOUT
NAIL FIN**

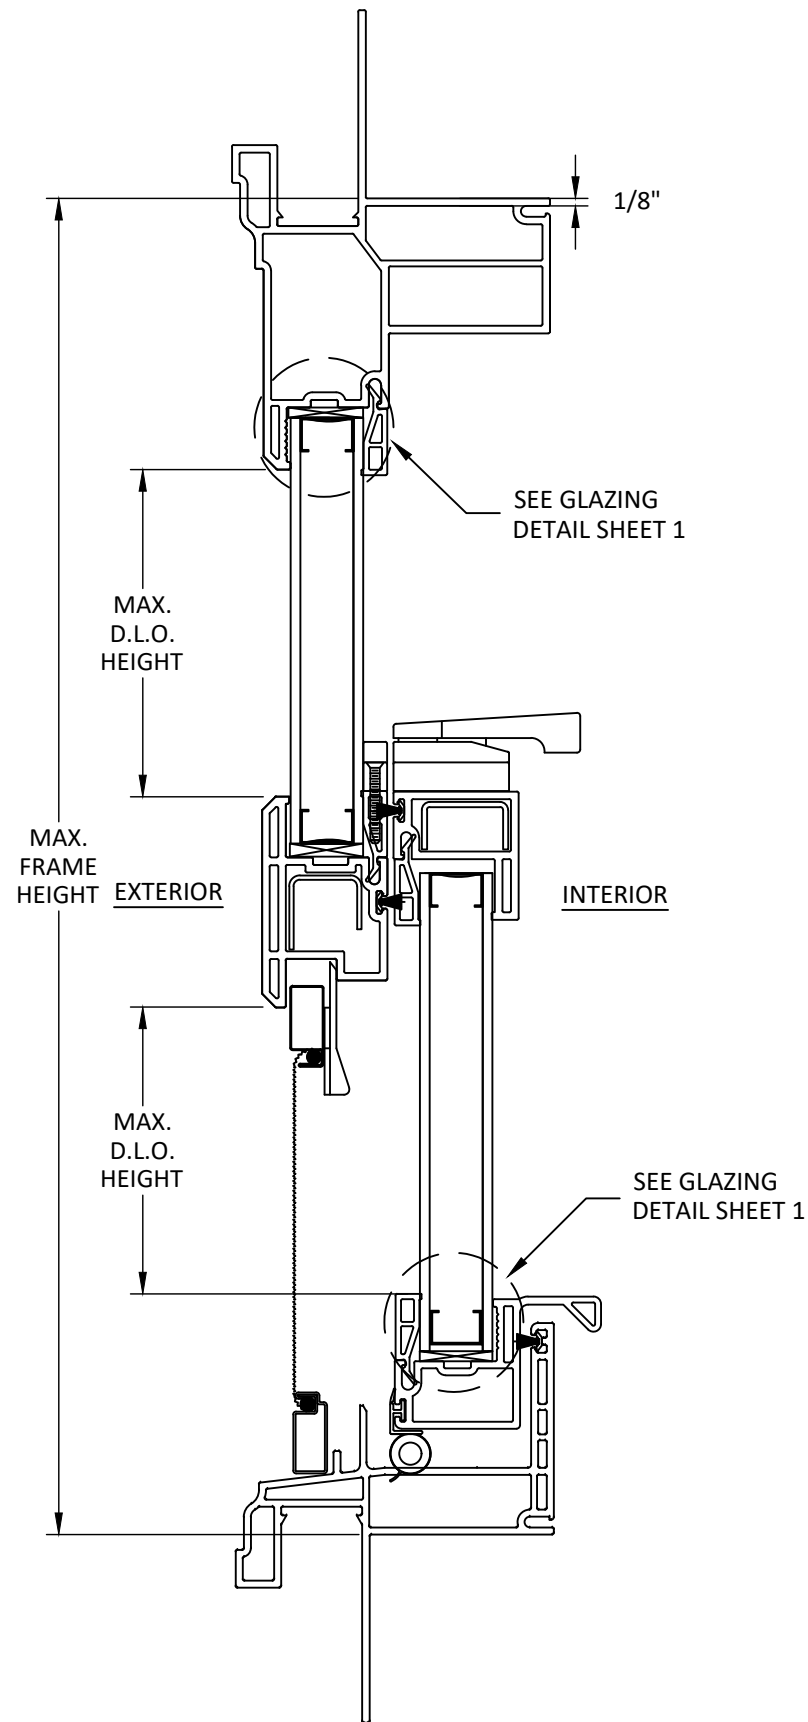

A
5 **VERTICAL SECTION**
NAIL FIN INSTALLATION

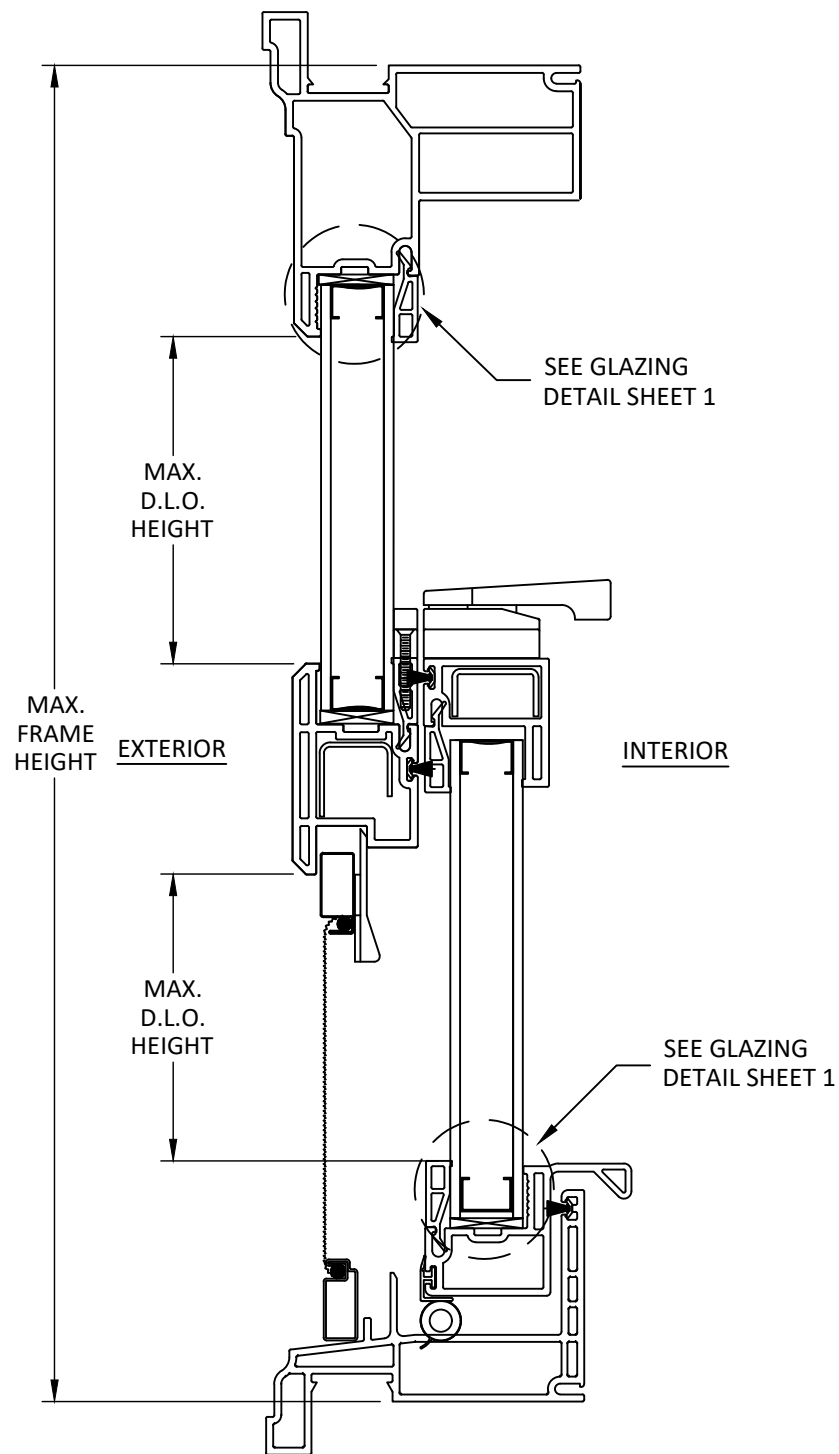

B
5 **VERTICAL SECTION**
THROUGH FRAME INSTALLATION

AMERICAN CRAFTSMAN WINDOWS
SILVER LINE WINDOWS AND DOORS

ONE SILVER LINE DRIVE
NORTH BRUNSWICK, NJ 08902
PH: (888) 741-0354

TITLE: 70 SERIES/ V1 SERIES/(2907/4907)
SINGLE-HUNG WINDOWS
(NON-HVHZ)(NON-IMPACT)

VERTICAL SECTIONS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
6TH FBC EDITION	FM	10/17
7TH FBC EDITION	NUS	10/14/20
8th FBC EDITION	LH	09/23
Current FBC & EC24-100	LH	04/25


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

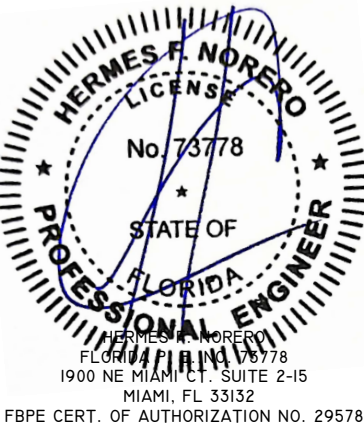

FL #:	FL14911
DATE:	07.02.2018
DWG. BY:	CHK. BY:
JA	HFN
SCALE:	NTS
DWG. #:	SWD053
SHEET:	

5


OF 8

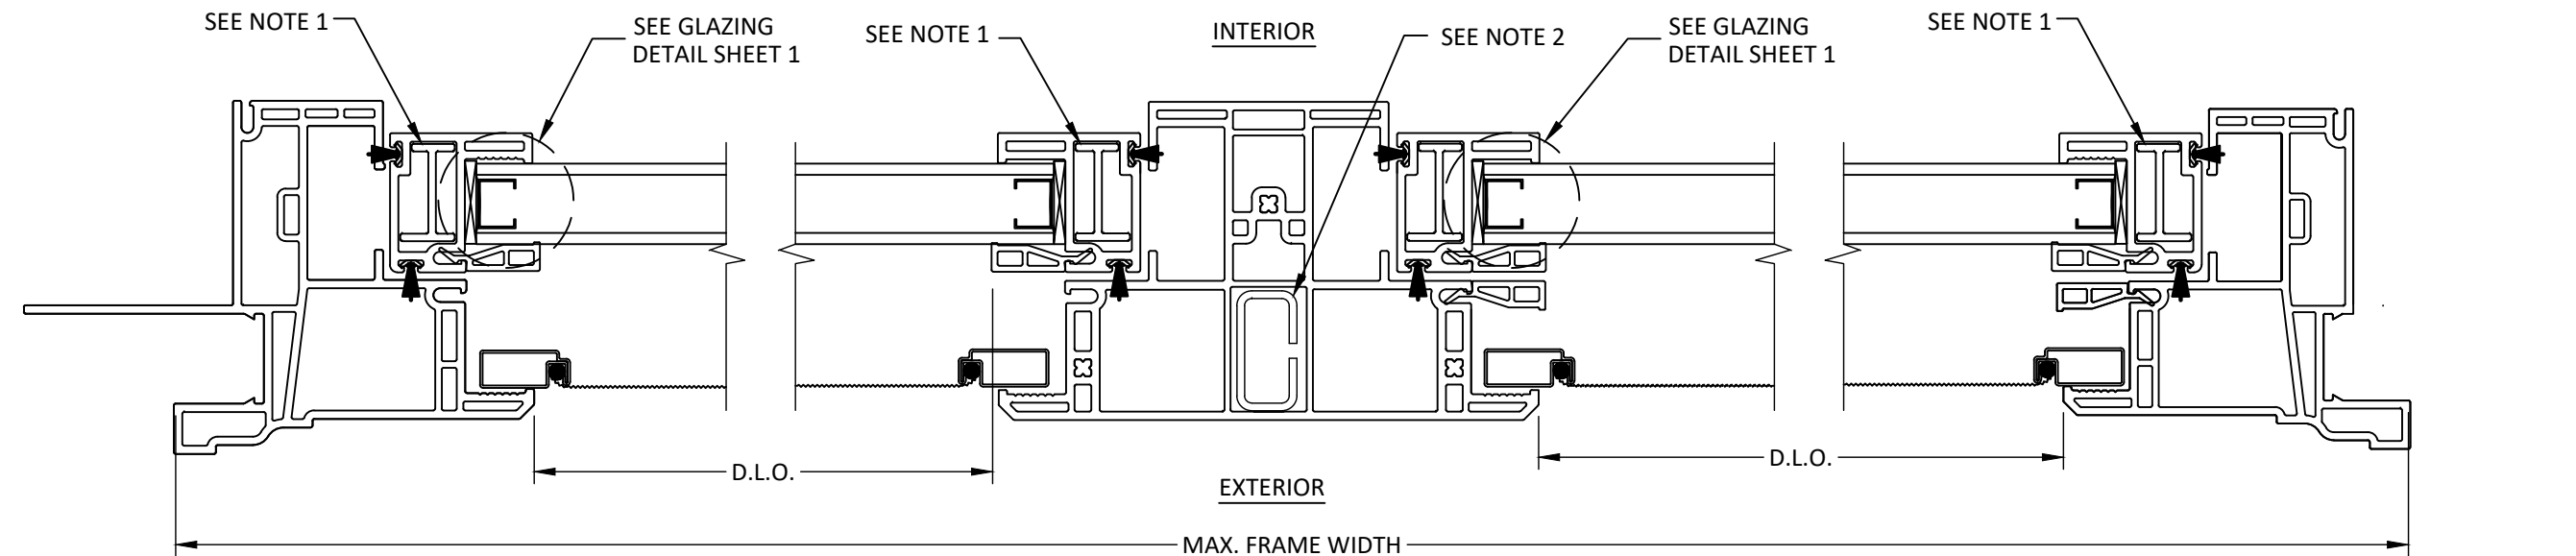

A
6 **HORIZONTAL SECTION**
LOWER SASH
NAIL FIN INSTALLATION

B
6 **HORIZONTAL SECTION**
MULLION

C
6 **HORIZONTAL SECTION**
LOWER SASH
THROUGH FRAME INSTALLATION

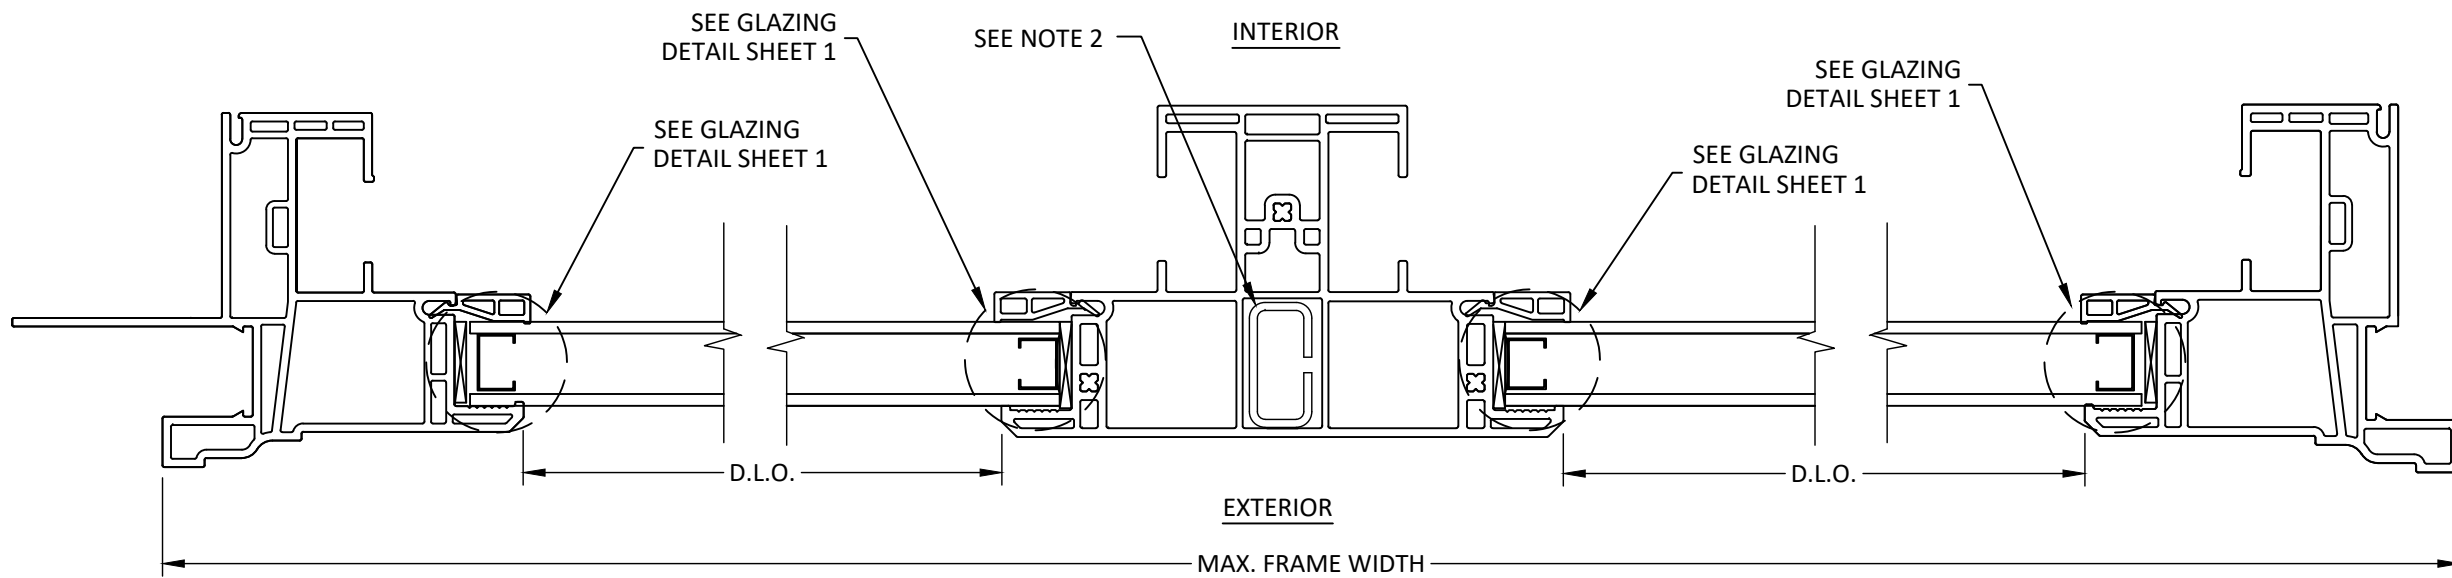

D
6 **HORIZONTAL SECTION**
UPPER SASH
NAIL FIN INSTALLATION

E
6 **HORIZONTAL SECTION**
MULLION

F
6 **HORIZONTAL SECTION**
UPPER SASH
THROUGH FRAME INSTALLATION

NOTES:
1. REINFORCEMENT REQUIRED FOR:
48.0" X 84.0", O/X, DESIGN PRESSURE +20/-20
80.0" X 84.0", O/X-OX, DESIGN PRESSURE +15/-15
2. REINFORCEMENT NOT REQUIRED FOR:
80.0" X 62.0", O/X-OX, DESIGN PRESSURE +20/-20

AMERICAN CRAFTSMAN WINDOWS
SILVER LINE WINDOWS AND DOORS

ONE SILVER LINE DRIVE
NORTH BRUNSWICK, NJ 08902
PH: (888) 741-0354

TITLE: 70 SERIES/V1 SERIES/(2907/4907)
SINGLE-HUNG WINDOWS
(NON-HVHZ)(NON-IMPACT)


HORIZONTAL SECTION

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com


BUILDING DROPS

REMARKS	BY	DATE
6TH FBC EDITION	FM	10/17
7TH FBC EDITION	NUS	10/14/20
8th FBC EDITION	LH	09/23
Current FBC & EC24-100	LH	04/25


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

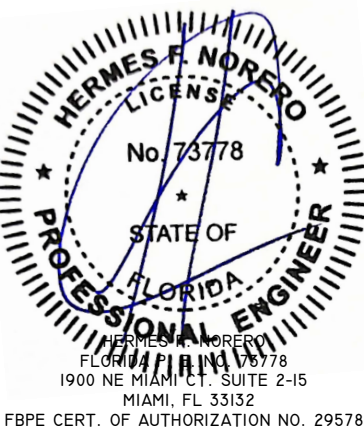


FL #:	FL14911
DATE:	07.02.2018
DWG. BY:	JA
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	SWD053
SHEET:	

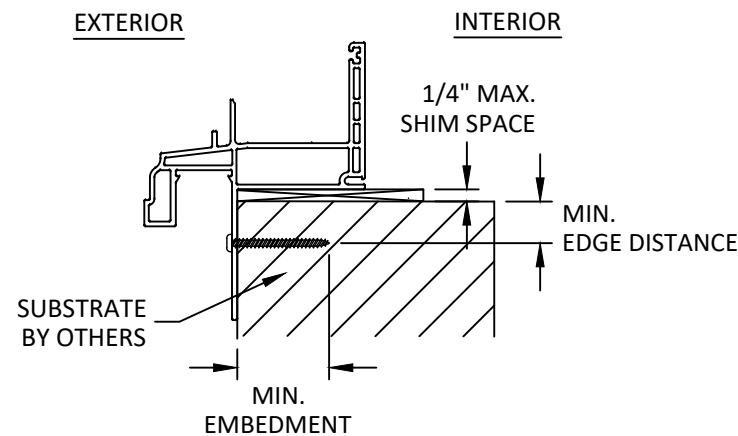


A
7 **ANCHOR DETAIL**
NAIL FIN (SILL)

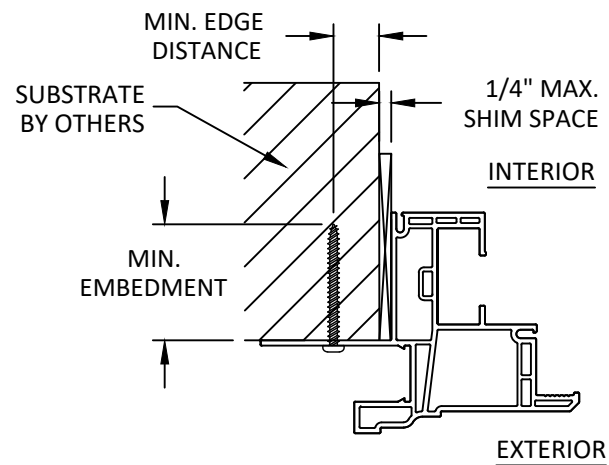


B
7 **ANCHOR DETAIL**
NAIL FIN (JAMB)

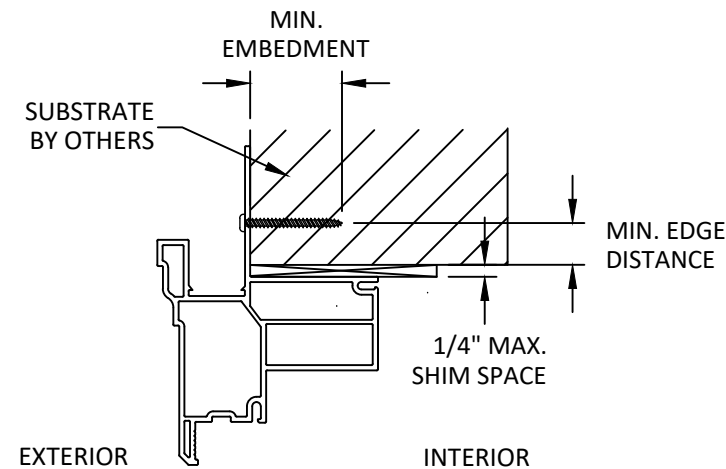

C
7 **ANCHOR DETAIL**
NAIL FIN (HEAD)

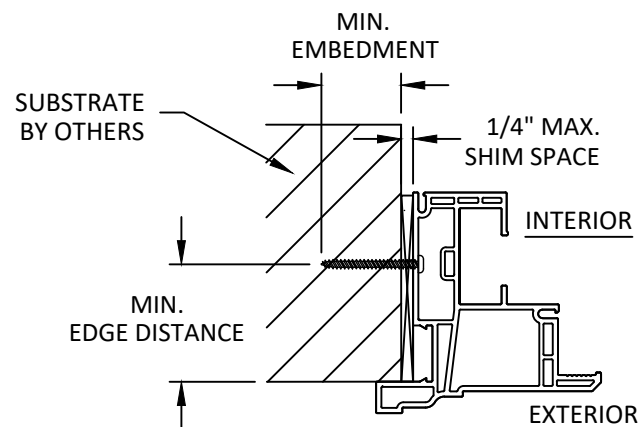

D
7 **ANCHOR DETAIL**
THROUGH FRAME (JAMB)

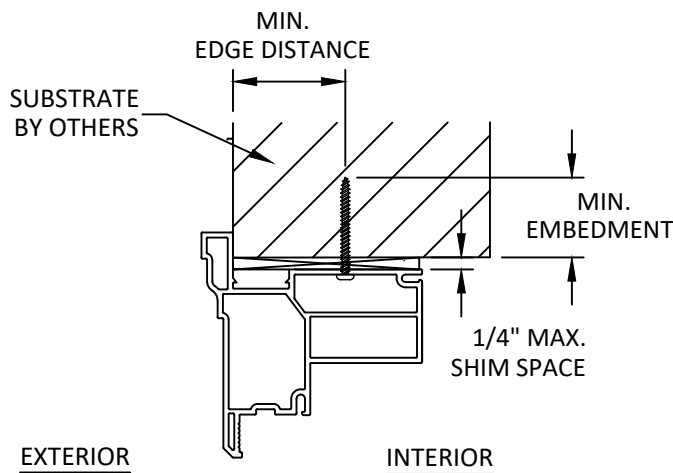

E
7 **ANCHOR DETAIL**
THROUGH FRAME (HEAD)

AMERICAN CRAFTSMAN WINDOWS
SILVER LINE WINDOWS AND DOORS

ONE SILVER LINE DRIVE
NORTH BRUNSWICK, NJ 08902
PH: (888) 741-0354


TITLE: 70 SERIES/ V1 SERIES/(2907/4907) SINGLE-HUNG WINDOWS (NON-HVHZ)/(NON-IMPACT)	ANCHOR DETAILS
	PREPARED BY: BUILDING DROPS, INC. 1900 NE MIAMI CT. SUITE 2-15 MIAMI, FL 33132 PH: (954)399-8478 FAX: (954)744-4738 WEB: www.buildingdrops.com

REMARKS	BY	DATE
6TH FBC EDITION	FM	10/17
7TH FBC EDITION	NUS	10/14/20
8th FBC EDITION	LH	09/23
Current FBC & EC24-100	LH	04/25

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO
LICENSE
No. 73778
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
HERMES F. NORERO
FLORIDA LICENSE NO. 73778
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION NO. 29578

FL #:	FL14911
DATE:	07.02.2018
DWG. BY:	CHK. BY:
JA	HFN
SCALE:	NTS
DWG. #:	SWD053
SHEET:	

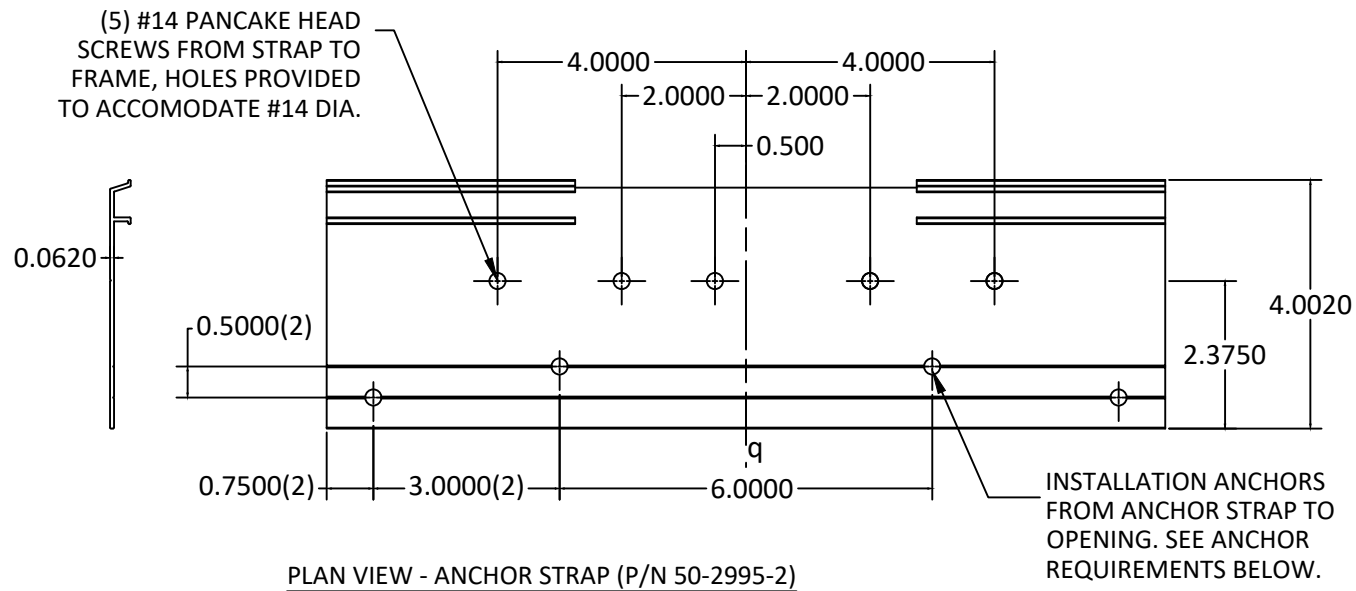

ANCHOR STRAP ANCHORING REQUIREMENTS:

- A. FOR INSTALLATION TO CONCRETE/MASONRY, USE (4) 3/16" ITW TAPCONS PER STRAP, MIN. 1-1/4" EMBEDMENT, MIN. 1-3/4" EDGE DISTANCE.
- B. FOR INSTALLATION TO METAL STUD, USE (4) #10 SELF-DRILLING SCREWS, GR. 5, PER STRAP. MIN. 3 THREADS PENETRATION, MIN. 3/4" EDGE DISTANCE.
- C. FOR INSTALLATION TO WOOD, USE (4) #10 WOOD SCREWS PER STRAP. MIN. 1-1/2" EMBEDMENT, MIN. 1" EDGE DISTANCE.

INSTALLATION NOTES:

1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
5. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
6. FOR MASONRY OF CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE, SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
7. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
8. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
9. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR SCHEDULE	MIN EMBEDMENT	MIN. EDGE DISTANCE
THROUGH FRAME	WOOD: MIN. SG=0.55	#10 WOOD SCREW FLAT HEAD	1-1/2"	3/4"
	METAL: 18 GAUGE Steel, MIN. Fy = 33KSI	#10 TEK SCREW FLAT HEAD	3 THREADS MIN PENETRATION BEYOND METAL	1/2"
	CONCRETE: f'c=3000PSI	3/16" ITW TAPCON PAN HEAD OR HEX HEAD	1-1/2"	2-1/4"
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI	3/16" ITW TAPCON PAN HEAD OR HEX HEAD	1-1/2"	2"
NAIL FIN	WOOD: MIN. SG = 0.55	#8 WOOD SCREW	1-1/2"	3/4"
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI	#8 TEK SCREW	3 THREADS MIN PENETRATION BEYOND METAL	1/2"

AMERICAN CRAFTSMAN WINDOWS
SILVER LINE WINDOWS AND DOORS

ONE SILVER LINE DRIVE
NORTH BRUNSWICK, NJ 08902
PH: (888) 741-0354


TITLE:
70 SERIES/ V1 SERIES/(2907/4907)
SINGLE-HUNG WINDOWS
(NON-HVHZ)/(NON-IMPACT)
ANCHOR STRAP, INSTALLATION NOTES
AND ANCHOR SCHEDULE

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

BD
BUILDING DROPS

REMARKS	BY	DATE
6TH FBC EDITION	FM	10/17
7TH FBC EDITION	NUS	10/14/20
8th FBC EDITION	LH	09/23
Current FBC & EC24-100	LH	04/25

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

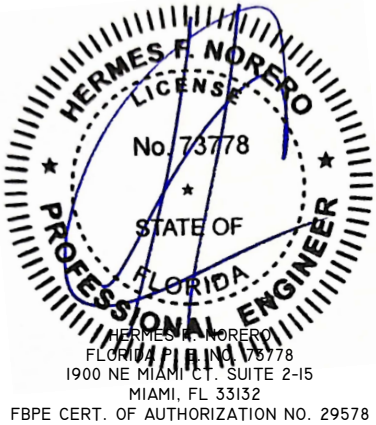

FL #:
FL14911

DATE: **07.02.2018**

DWG. BY: **JA** | CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **SWD053**

SHEET:
8

OF 8