



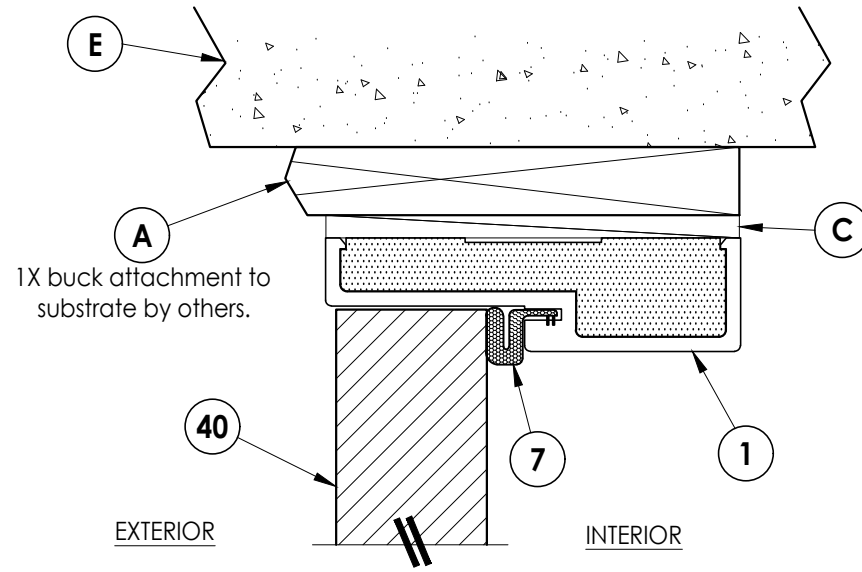


3 **VERTICAL CROSS SECTION**
3 Outswing Shown (Inswing Similar)
 Shown w/ 1X Buck

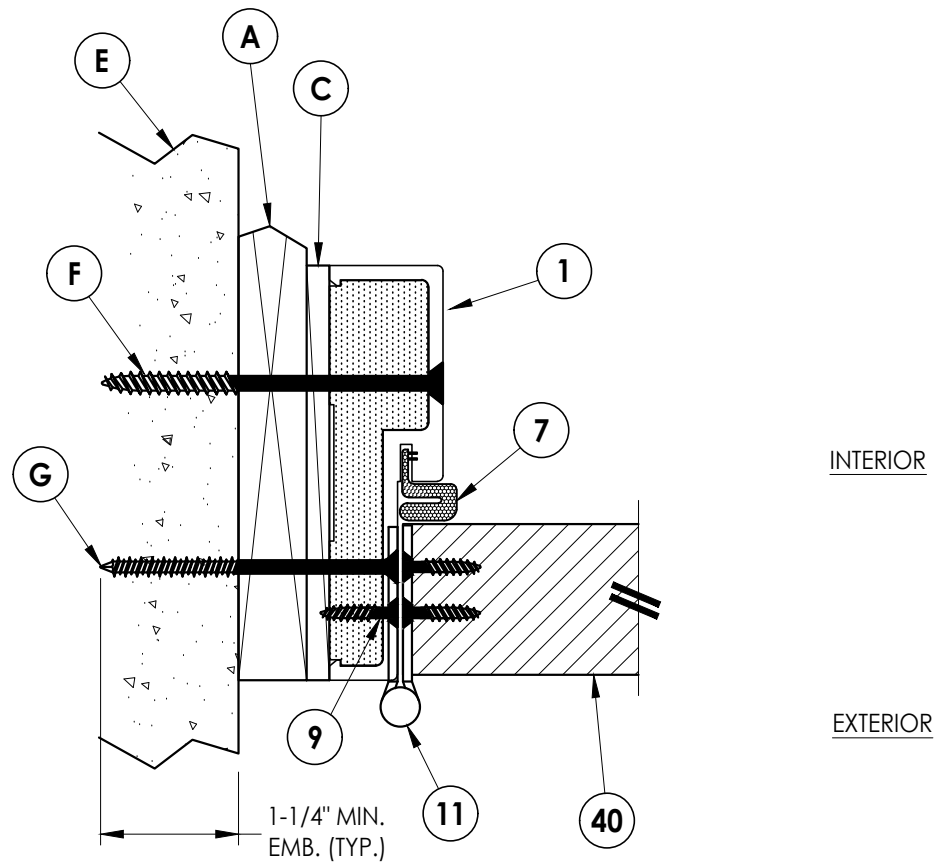

1 **HORIZONTAL CROSS SECTION**

3 Outswing Shown (Inswing Similar)
Shown w/ 1X Buck

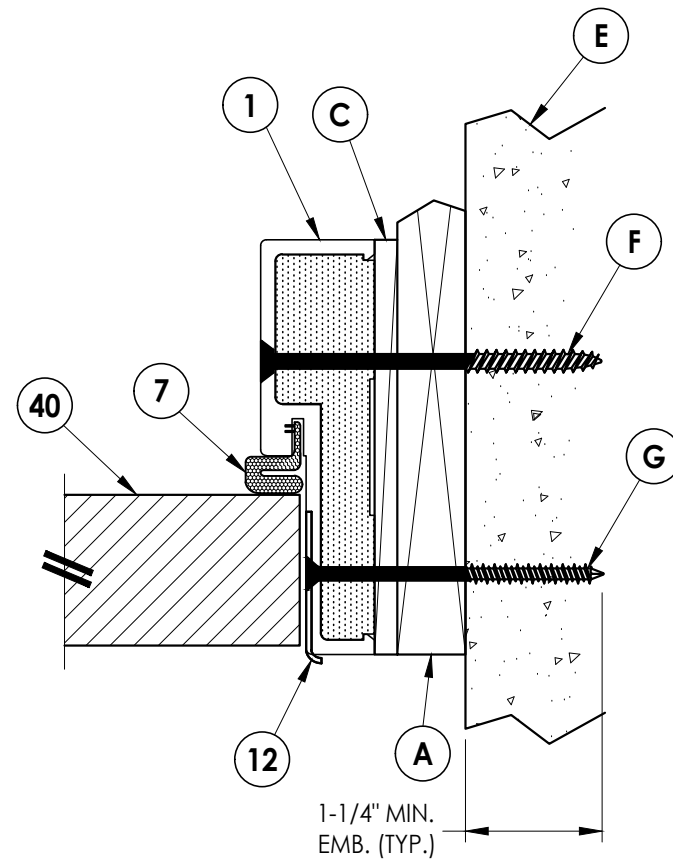

2 **HORIZONTAL CROSS SECTION**

3 Outswing Shown (Inswing Similar) Shown w/ 1X Buck

Documents Prepared By:

RW BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL. 33595
Phone No.: 813.659.9197


Florida Board of Professional Engineers
Certificate Of Authorization No. 9813

PRODUCT:
WORLDWIDE DOOR COMPONENTS
FIBERGLASS DOOR


PART OR ASSEMBLY:
**HORIZONTAL & VERTICAL
CROSS SECTIONS (1X BUCK)**

[illegible]


Z:\2023 FBC Drawings\Worldwide Door Components\FL-14969 R13\FL-14969.9.dwg

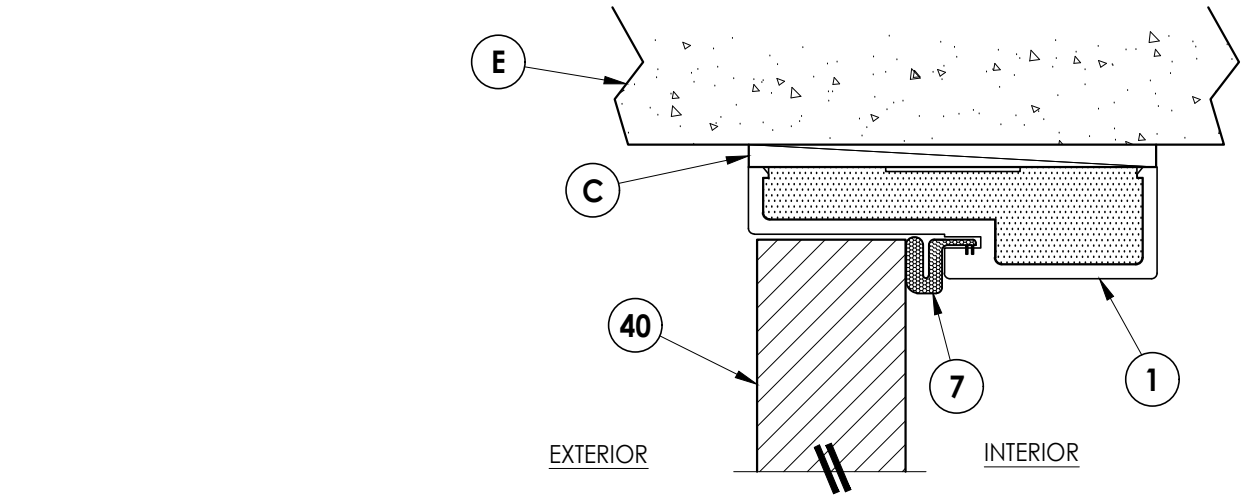

3 VERTICAL CROSS SECTION
4 Outswing Shown (Inswing Similar)
Shown Direct to Masonry

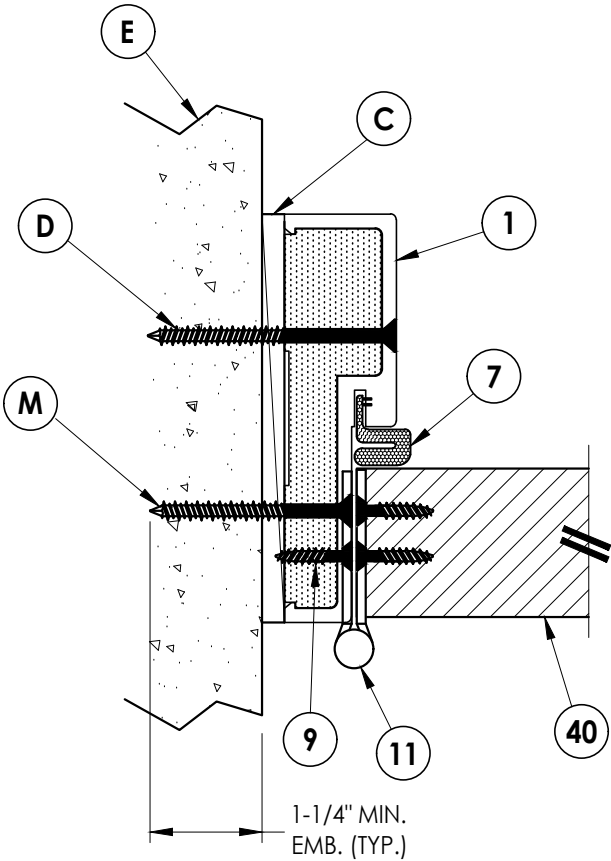




1 HORIZONTAL CROSS SECTION
4 Outswing Shown (Inswing Similar)
Shown Direct to Masonry

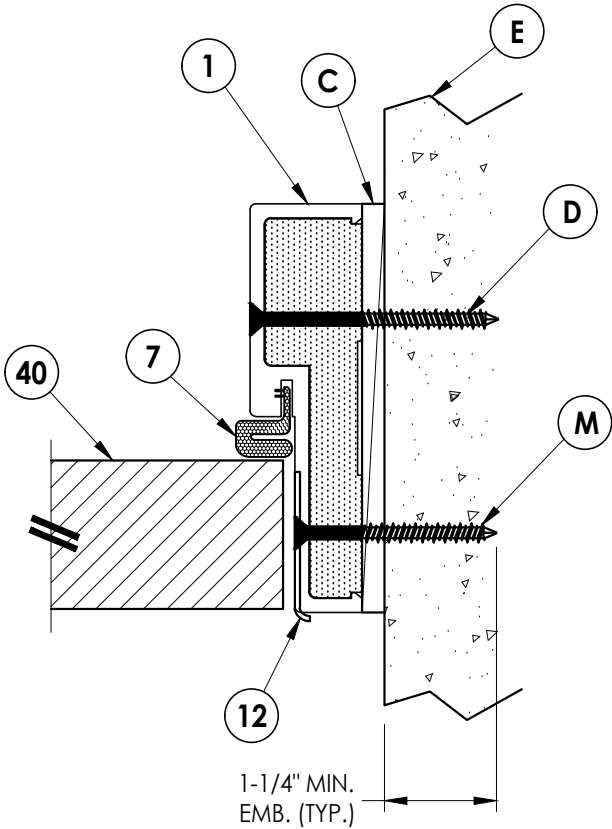




2 HORIZONTAL CROSS SECTION
4 Outswing Shown (Inswing Similar)
Shown Direct to Masonry

PRODUCT:		WORLDWIDE DOOR COMPONENTS	
		FIBERGLASS DOOR	
PART OR ASSEMBLY:		HORIZONTAL & VERTICAL CROSS SECTIONS (DIRECT TO MASONRY)	
		BY	
		NO.	
		DATE	
		REVISIONS	
DATE:		8/13/25	
SCALE:		N.T.S.	
DWG. BY:		LFS	
CHK. BY:		RW	
DRAWING NO.:		FL-14969.9	
SHEET		4 OF 6	

Documents Prepared By:
RW
BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197
Florida Board of Professional Engineers
Certificate Of Authorization No. 9813

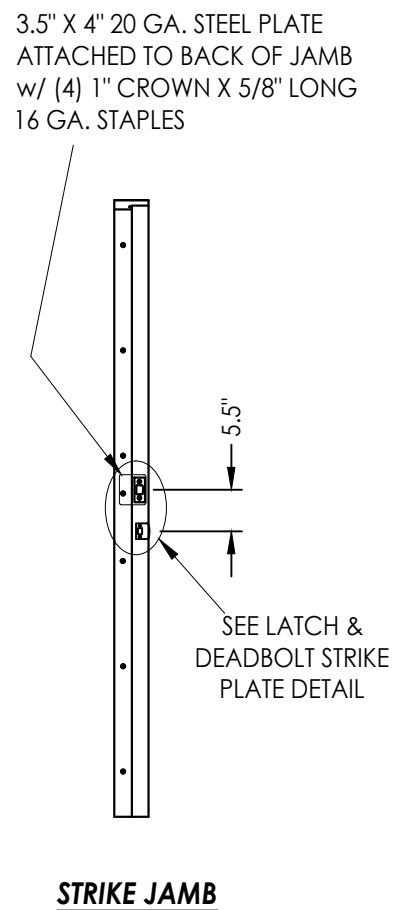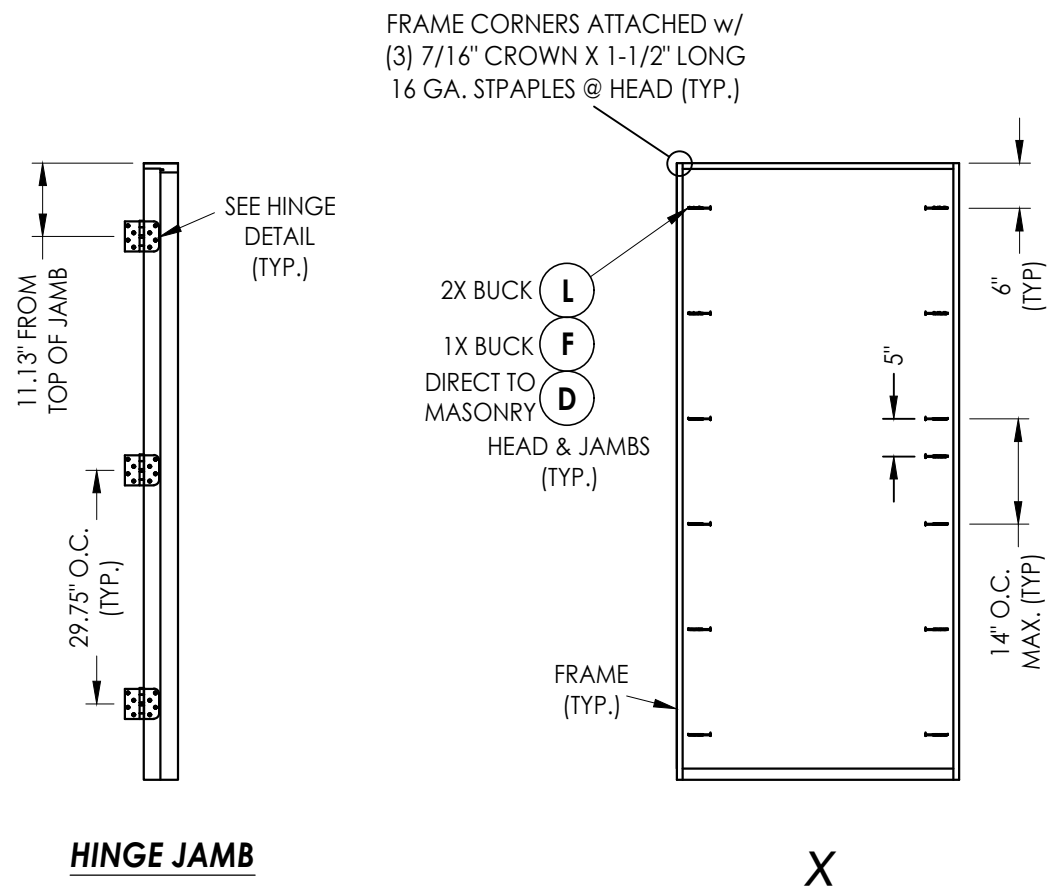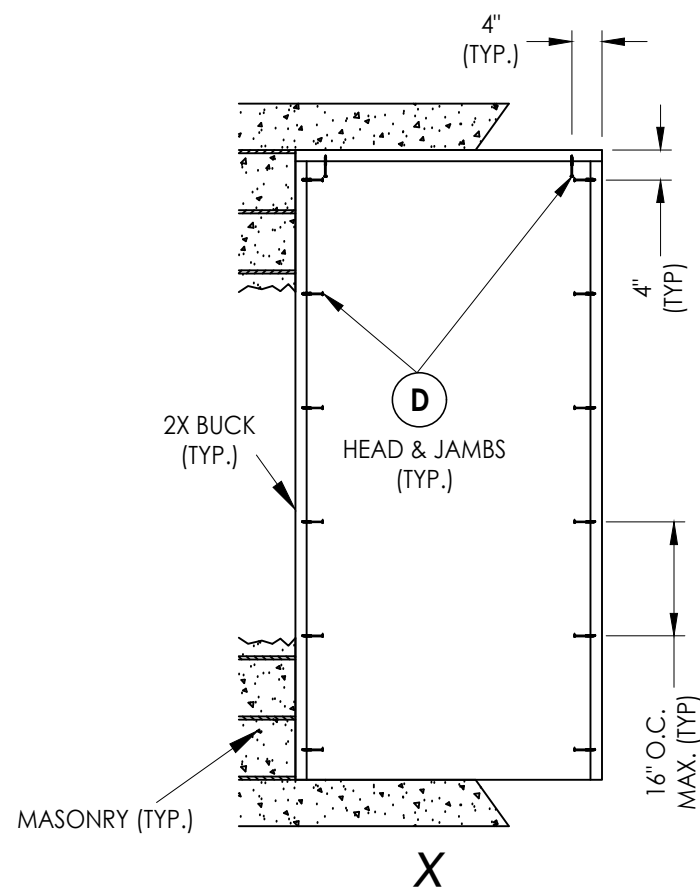

NOTE:
See separate side-hinged door product approval for door construction details not shown, including lock hardware, hinge, frame corner, & threshold connections.

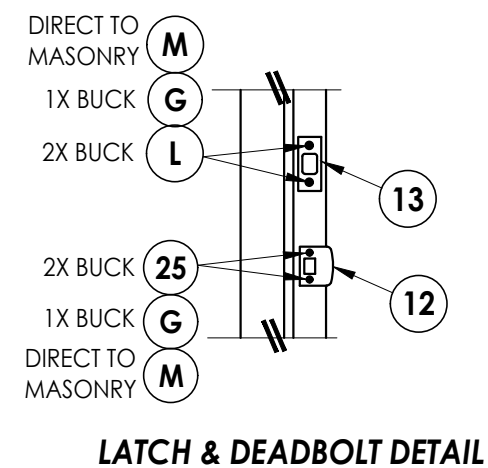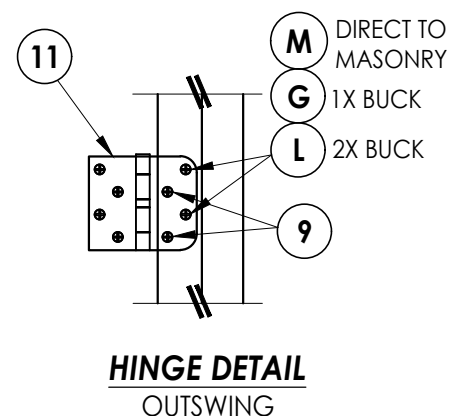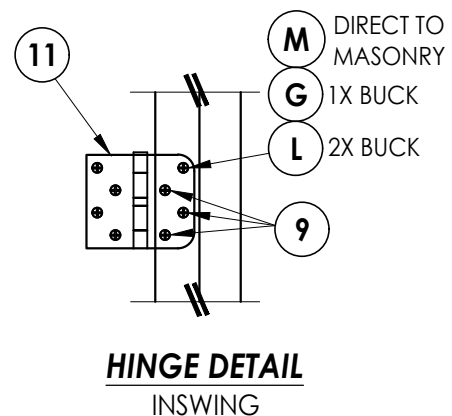[illegible]

Documents Prepared By: **RW** BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813-659.9197
Florida Board of Professional Engineers
Certificate Of Authorization No. 9813

Z:\2023 FBC Drawings\Worldwide Door Components\FL-14969 R13\FL-14969.9.dwg

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (G >= 0.42)	WOOD
B	2X BUCK (G >= 0.42)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
G	3/16" X 3-1/4" PFH ITW CONCRETE SCREW	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1" MIN. EMB.)	STEEL
M	3/16" X 2-1/4" PFH ITW CONCRETE SCREW	STEEL
1	COMPOSITE JAMB	COMP
7	WEATHERSTRIP	FOAM
9	#9 X 3/4" PFH WOOD SCREW	STEEL
11	4" X 4" HINGE	STEEL
12	LATCH STRIKE PLATE	STEEL
13	DEADBOLT STRIKE PLATE	STEEL
25	#8 X 2-1/2" PFH WOOD SCREW	STEEL
40	DOOR PANEL	-


CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW BUILDEX TAPCON®	3/16"	1-1/4"	3"	1-1/2"
	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

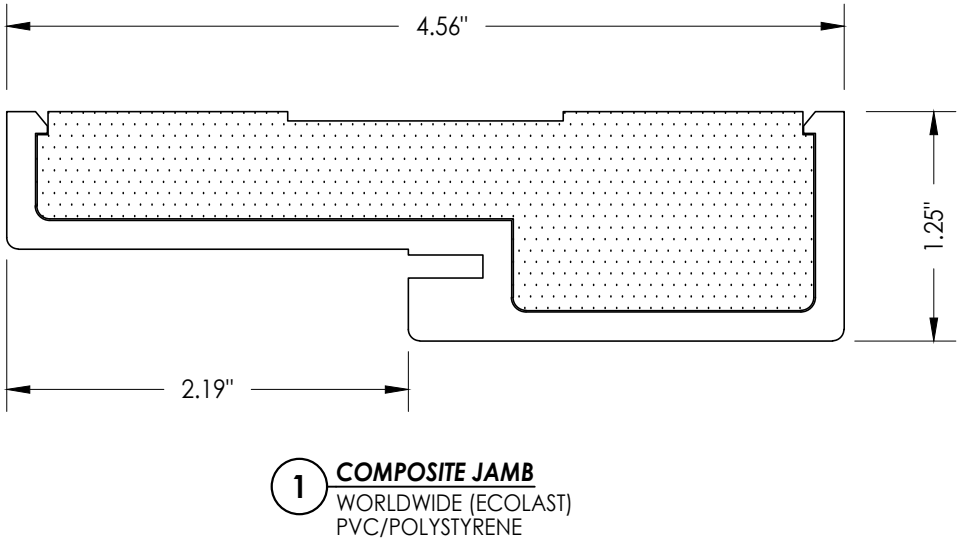

PRODUCT:		PART OR ASSEMBLY:	
WORLDWIDE DOOR COMPONENTS FIBERGLASS DOOR		BILL OF MATERIALS & COMPONENTS	
		NO.	BY
		DATE	
REVISIONS			
DATE: 8/13/25			
SCALE: N.T.S.			
DWG. BY: LFS			
CHK. BY: RW			
DRAWING NO.: FL-14969.9			
SHEET 6 OF 6			

Documents Prepared By:

RW

BUILDING CONSULTANTS, INC.
P.O. Box 230 Valrico FL 33595
Phone No.: 813.659.9197

Florida Board of Professional Engineers
Certificate Of Authorization No. 9813