


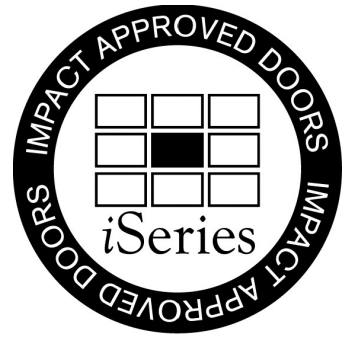

## Supplemental Wind Load Instructions

### Sandwich Doors: Residential

#### CAUTION

**Higher wind pressures and larger doors require additional reinforcement.**

**Premature failure of door system may result from improper application.**

**See chart in lower left corner of drawing sheet one for the approved wind pressures and door sizes.**

#### WARNING

**These instructions do not contain basic door installation steps and related safety information.**



**Failure to follow basic installation steps and related safety information may result in injury or death.**

**Door installers must follow a primary instruction manual for basic door installation steps and related safety information.**

The correct selection of door and framing materials in adherence with local building code directives is the responsibility of the building owner/designer. Use of a reinforced garage door does not constitute automatic compliance with any building code. Local building code officials determine compliance criteria.

A locking system must be installed if the door is not electrically operated.

See drawing for stop molding requirements, when door is not more than 1" wider than opening. When using stop molding, secure molding with minimum 8d nails or 2-1/2" long screws.



Digitally signed by John E Scates  
Date: 2026.08.13 14:07:50 -05'00'

John E. Scates, P.E.  
PO Box 5175  
Frisco, TX 75035  
FL PE 51737  
TX PE 56308 / F-2203

Professional Engineer's seal  
provided only for verification of  
windload construction details


For Use With Drawing Number  
Z9-09-02303

Strut Placement

| Section Number | Door Height    |                |                |                 |                  |                  |                  |                  |                  |                  |
|----------------|----------------|----------------|----------------|-----------------|------------------|------------------|------------------|------------------|------------------|------------------|
|                | 6'-6" to 7'-0" | 7'-6" to 8'-0" | 8'-3" to 8'-9" | 9'-0" to 10'-6" | 10'-9" to 12'-3" | 12'-6" to 14'-0" | 14'-3" to 15'-9" | 16'-0" to 17'-6" | 17'-9" to 19'-3" | 19'-6" to 20'-0" |
| 12             | N/A            | N/A            | N/A            | N/A             | N/A              | N/A              | N/A              | N/A              | N/A              | 1 at Detail A    |
| 11             | N/A            | N/A            | N/A            | N/A             | N/A              | N/A              | N/A              | N/A              | 1 at Detail A    | 0                |
| 10             | N/A            | N/A            | N/A            | N/A             | N/A              | N/A              | N/A              | 1 at Detail A    | 1 at Detail B    | 1 at Detail B    |
| 9              | N/A            | N/A            | N/A            | N/A             | N/A              | N/A              | 1 at Detail A    | 1 at Detail C    | 1 at Detail C    | 1 at Detail C    |
| 8              | N/A            | N/A            | N/A            | N/A             | N/A              | 1 at Detail A    | 1 at Detail A    | 1 at Detail A    | 1 at Detail A    | 1 at Detail A    |
| 7              | N/A            | N/A            | N/A            | N/A             | 1 at Detail A    | 0                | 0                | 0                | 0                | 0                |
| 6              | N/A            | N/A            | N/A            | 1 at Detail A   | 1 at Detail B    | 1 at Detail B    | 1 at Detail B    | 1 at Detail B    | 1 at Detail B    | 1 at Detail B    |
| 5              | N/A            | 1 at Detail A  | 1 at Detail A  | 1 at Detail C   | 1 at Detail C    | 1 at Detail C    | 1 at Detail C    | 1 at Detail C    | 1 at Detail C    | 1 at Detail C    |
| 4              | 1 at Detail A  | 1 at Detail A  | 1 at Detail A  | 1 at Detail A   | 1 at Detail A    | 1 at Detail A    | 1 at Detail A    | 1 at Detail A    | 1 at Detail A    | 1 at Detail A    |
| 3              | 0              | 0              | 0              | 0               | 0                | 0                | 0                | 0                | 0                | 0                |
| 2              | 1 at Detail B  | 1 at Detail B  | 1 at Detail B  | 1 at Detail B   | 1 at Detail B    | 1 at Detail B    | 1 at Detail B    | 1 at Detail B    | 1 at Detail B    | 1 at Detail B    |
| 1              | 1 at Detail C  | 1 at Detail C  | 1 at Detail C  | 1 at Detail C   | 1 at Detail C    | 1 at Detail C    | 1 at Detail C    | 1 at Detail C    | 1 at Detail C    | 1 at Detail C    |

Push Nut Detail (use on all rollers)

use 3/8" I. D. on bottom fixture roller stem  
use 7/16" I. D. on end hinge and top fixture roller stems

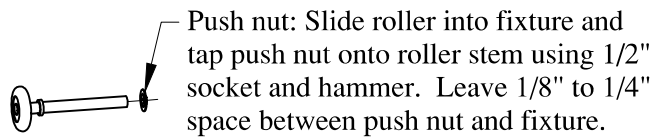


Track Bracket Spacing

Track bracket spacing shown for doors up to four sections high. Additional door sections may be added for maximum door height depicted on line drawing. Track brackets must be added (per track) for each section and spaced at a distance not greater than the corresponding section height (see line drawing for required quantities).


Strut Placement Concerning Windows

Where a strut crosses a window, it is acceptable to move the strut from a position of "Strut above hinge" down to "Strut on top half of the hinge". It is also acceptable to move teks screws from the upper leg of the strut down to the lower leg of the strut (shown below) if needed to keep both teks embedded in the section. Both applications may be used at the same time as required.




| Nominal Spacing |     |
|-----------------|-----|
| D               | 10" |
| C               | 28" |
| B               | 28" |
| A               | 10" |

+/- 3" tolerance

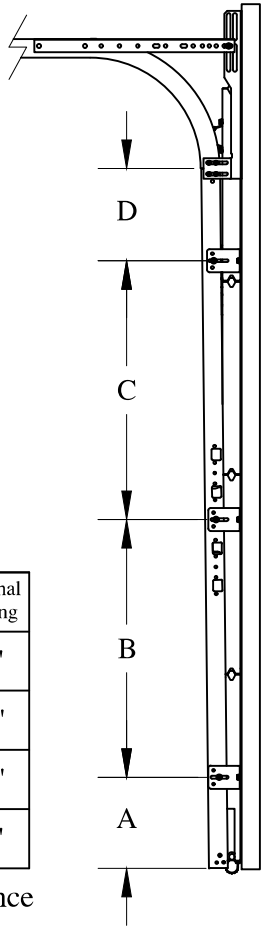


Strut Placement Detail

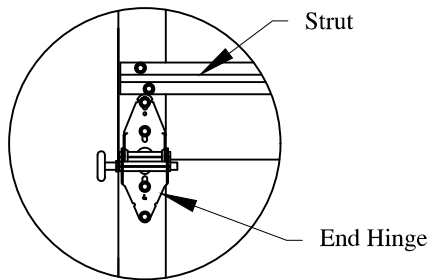


Strut above hinge

Detail A

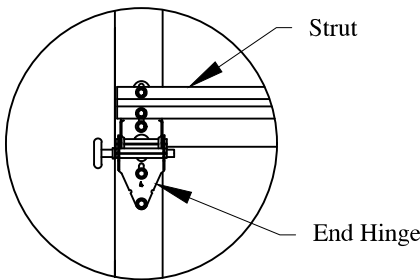


Strut on top half of hinge

Detail A  
(optional placement)

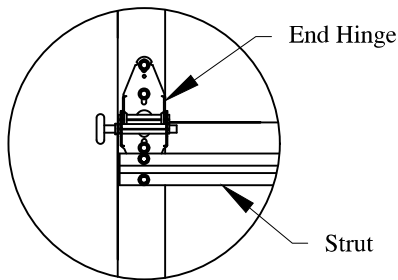


Strut on bottom half of hinge

Detail B

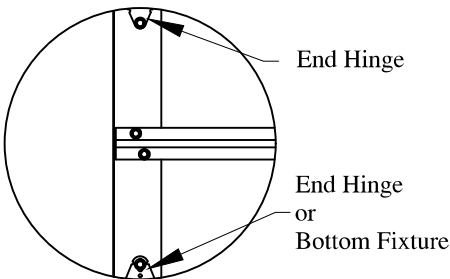


Strut in center of section

Detail C

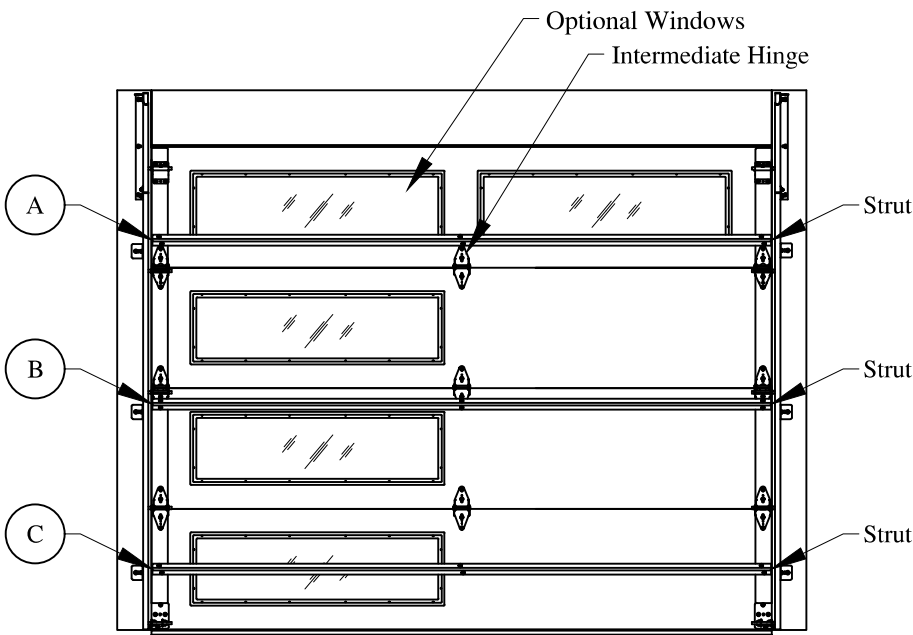

Glazing Options: (max daylight opening 39-3/8" x 12-1/2")  
◦1/8" DSB or Polycarbonate  
◦1/4" Tempered Glass  
◦7/16" Insulated Glass w/opt for Tempered


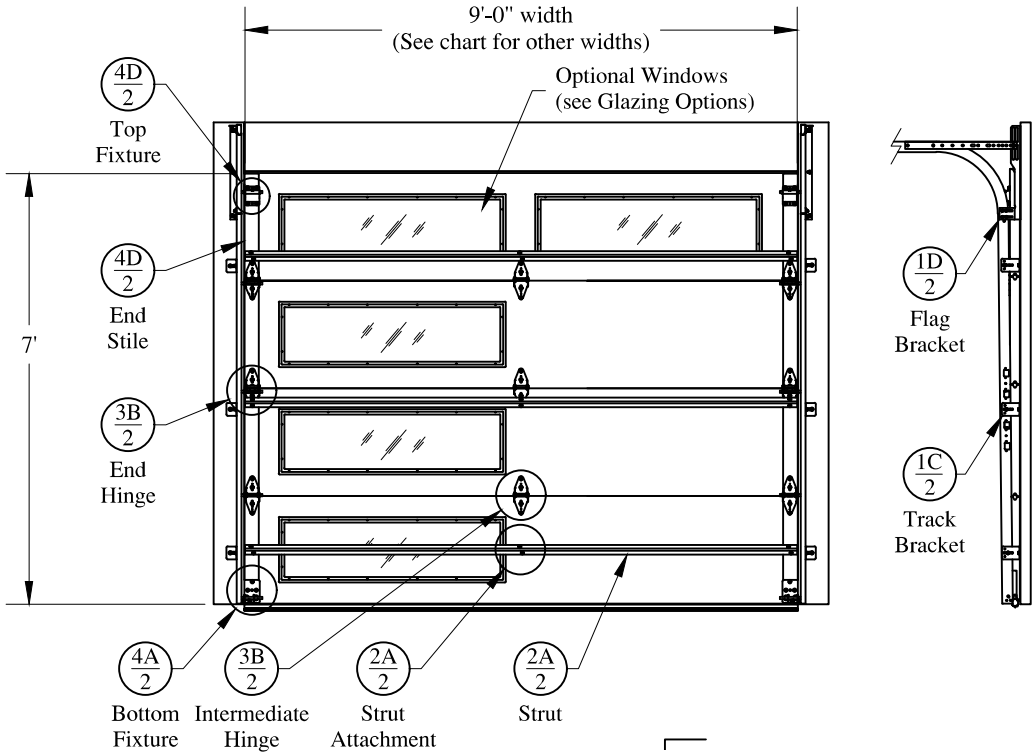


| door height      | section quantity | strut quantity | trk brkt per side |
|------------------|------------------|----------------|-------------------|
| 6'-6" to 7'-0"   | 4                | 3              | 3                 |
| 7'-6" to 8'-0"   | 5                | 4              | 4                 |
| 8'-3" to 8'-9"   | 5                | 4              | 4                 |
| 9'-0" to 10'-6"  | 6                | 5              | 5                 |
| 10'-9" to 12'-3" | 7                | 6              | 6                 |
| 12'-6" to 14'-0" | 8                | 6              | 7                 |
| 14'-3" to 15'-9" | 9                | 7              | 8                 |
| 16'-0" to 17'-6" | 10               | 8              | 9                 |
| 17'-9" to 19'-3" | 11               | 9              | 10                |
| 19'-6" to 20'-0" | 12               | 9              | 11                |

Track bracket quantities shown are for use with grade 2 or better Southern Yellow Pine. Refer to Jamb Attachment Detail supplemental instructions for usage of alternate jamb materials.  
Supporting structural elements shall be designed by a registered professional engineer for wind loads shown on this drawing. If door is not electrically operated, a lock must be installed.

| Width    | Design Pressure (PSF) | Stile Qty. |
|----------|-----------------------|------------|
| <=8'-00" | +49.8 / -57.9         | 1          |
| 9'-00"   | +44.3 / -51.5         | 1          |

Complies with current FBC (See Eval Report)  
Complies with IBC/IRC 2018/2021/2024 (Texas)  
Tested per ANSI/DASMA 108  
Maximum door height: 20'-00"  
Glazing and door have not been tested for windborne debris.






Professional Engineer's seal provided only for verification of windload construction details


John E. Scates, P.E.  
PO Box 5175  
Frisco, TX 75035  
FL PE 51737  
TX PE 56308 / F-2203

C.H.I. Drawing: Z9-09-02303  
Model Series: Sandwich Doors, Residential  
SCALE: nts  
DATE: 09-28-2020  
page 4 of 5







Details on some views may have been omitted for clarity.

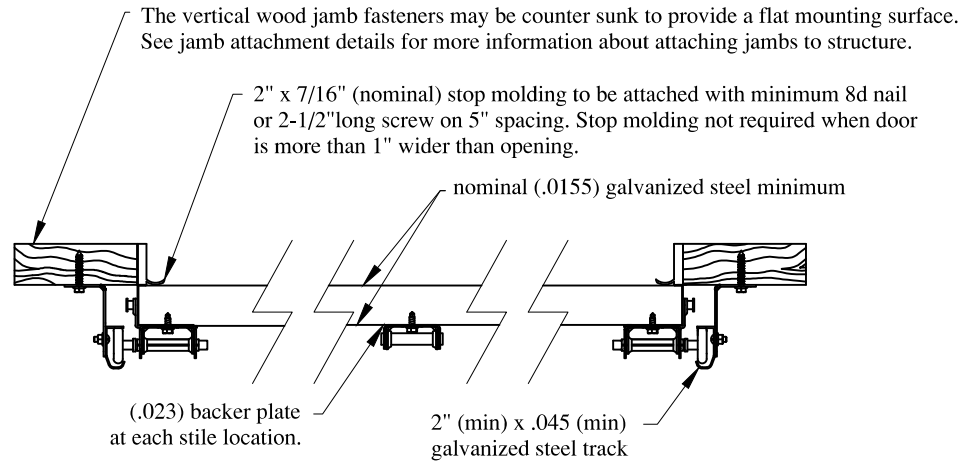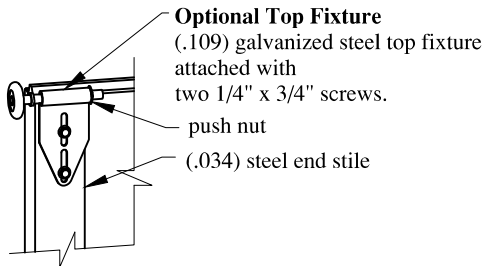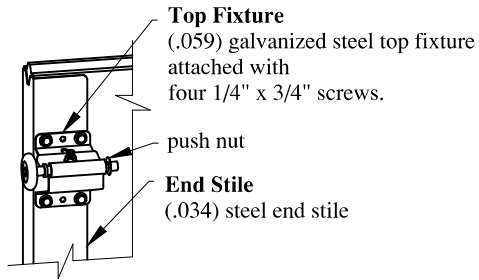

**Flag Bracket**  
(.086) galvanized steel flag bracket attached to wood jamb with three 5/16" x 1-5/8" wood lag screws, to horizontal track with two 1/4" x 5/8" track bolts and nuts and to vertical track with two 1/4" x 5/8" track bolts and nuts.


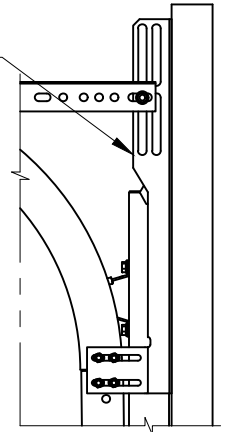


**Track Bracket**  
(.102) galvanized steel track bracket attached to wood jamb with one 5/16" x 1-5/8" wood lag screw per bracket and attached to vertical track with one 1/4" x 5/8" track bolt and nut or two 1/4" x 11/32" rivets.

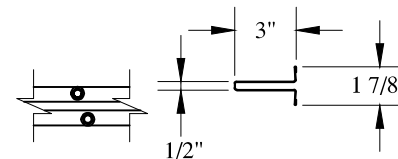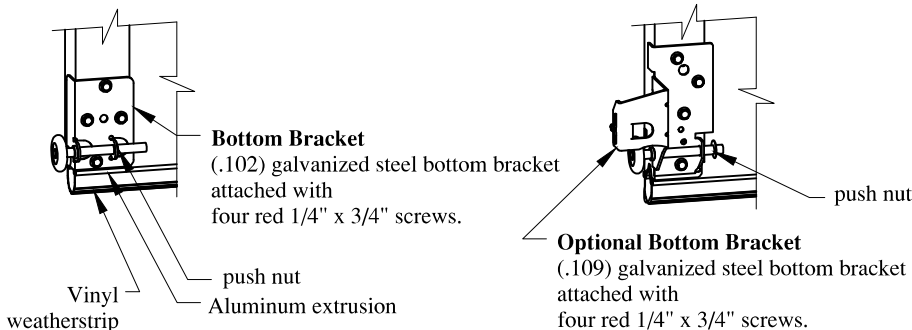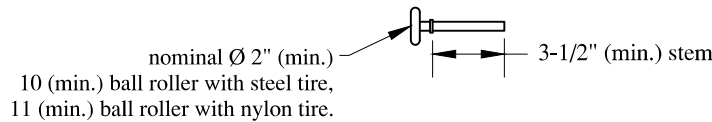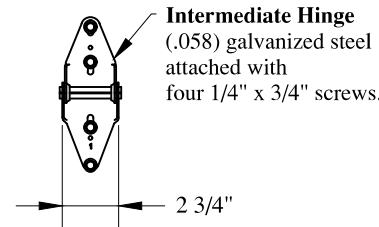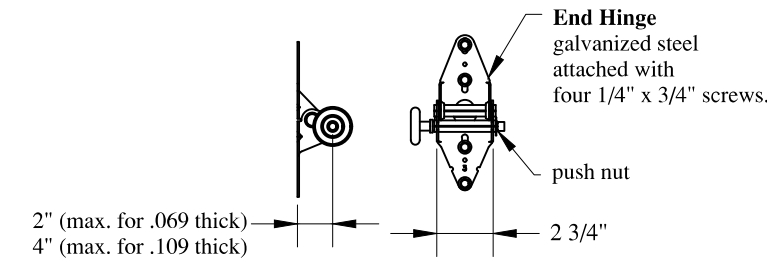

**Strut and Strut Attachment**  
(.051) 50 ksi galvanized steel 3" strut attached with two 1/4" x 3/4" screws per stile.

John E. Scates, P.E.  
PO Box 5175  
Frisco, TX 75035  
FL PE 51737  
TX PE 56308 / F-2203



Professional Engineer's seal provided only for verification of windload construction details

|                                              |       |            |
|----------------------------------------------|-------|------------|
| C.H.I. Drawing                               | SCALE | nts        |
|                                              | DATE  | 09-28-2020 |
| Model Series:<br>Sandwich Doors, Residential |       |            |
| C.H.I. Drawing: Z9-09-02303                  |       |            |
| page 5 of 5                                  |       |            |