


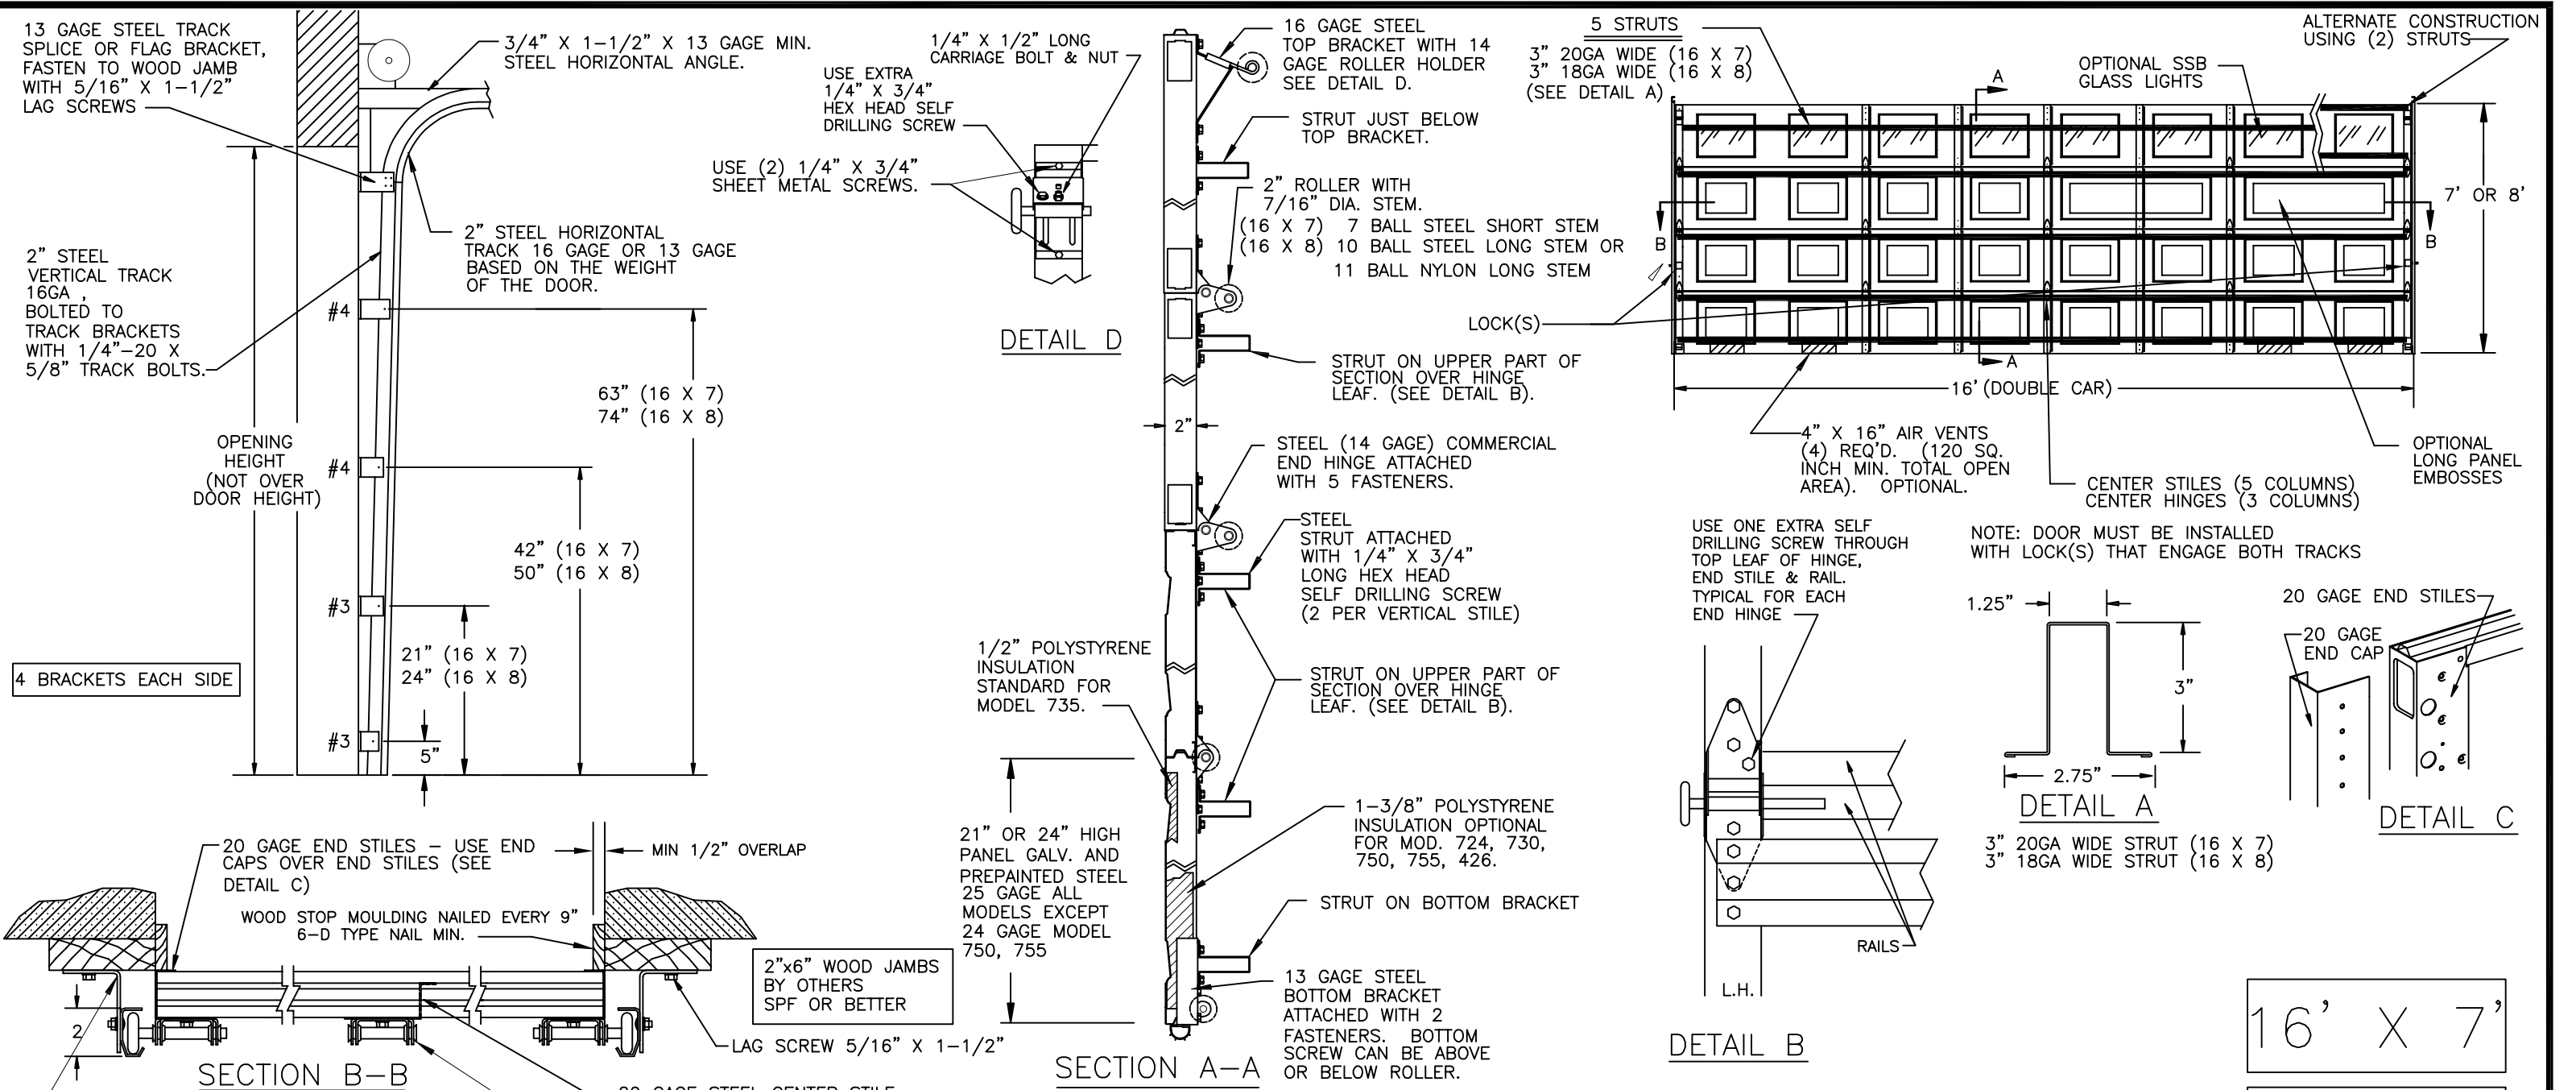

P.S.F. TABLE					
DOOR SIZE		DESIGN PRESSURE		TEST PRESSURE	
WIDTH	HEIGHT	POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
16'-0"	7'-0"	+18.7	-20.8	+28.1	-31.2
16'-0"	8'-0"	+18.7	-20.8	+28.1	-31.2

DOORS SHOWN ON THIS DRAWING HAVE BEEN DEMONSTRATED TO WITHSTAND THE PRESSURES LISTED IN THE TABLE ABOVE VIA TESTING TO ANSI/DASMA 108-05/12/17.

DETERMINATION OF SUITABILITY FOR SPECIFIC SITES IS THE RESPONSIBILITY OF OTHERS.

John E Scates PE
2560 King Arthur Blvd #124-54
Lewisville, TX 75056
TX-PE 56308, F-2203
FL-PE-51737


Professional Engineer's seal
provided only for verification of
windload construction details.

NOTE: ALL NON-DESCRIPTIVE FASTENERS SHOWN TO BE
1/4"-20 X 5/8" HEX BOLTS & NUTS OR
1/4" X 3/4" LONG HEX HEAD SHEET METAL SCREWS.

USE COATED LAG SCREWS
FOR TREATED LUMBER

TRACK BRACKETS MUST BE MOUNTED
DIRECTLY TO A WOOD SURFACE

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED
SIGNED AND SEALED AND THE SIGNATURE MUST BE
VERIFIED ON ANY ELECTRONIC COPIES.

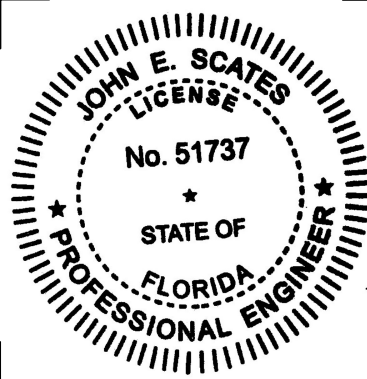

NOTE: GLAZING DOES NOT SATISFY IMPACT
DEBRIS REQUIREMENTS IN FBC

D	ROLLER NOTES, PE ADDRESS	5/27/20
C	REV LOGO & ADDRESS	1/28/13
B	12/15/11	RLB
A	2866 3/10/08	RLB
	2848 11/1/07	RLB
REV.	E.C.N.	DATE: APPROV.

FL 15080



5800 SCOTT
HAMILTON DR.
LITTLE ROCK, AR
72209
(501) 562-1872

MODELS:
724, 426, 730, 735, 750, 755

PART NAME: WINDLOAD RESIDENTIAL PAN DOOR W1 B		DWG. NO. 99-B-079	
TOLERANCE FRAC. ± 1/64" DEC. ± .015 ANG. ± 1°	NEXT LEVEL	DATE: 11/1/07	SHT 2 OF 3
SCALE NONE	PLOT SCALE	DRN. BY BH	

