



AMERICA'S DOORMAKER  
631 N. FIRST ST. WEST BRANCH, MI 48661


WOOD EDGE OPAQUE DOUBLE DOOR  
with SIDELITES  
INSWING / OUTSWING  
"IMPACT"

GENERAL NOTES

1. This product has been evaluated and is in compliance with the 8th Edition (2023) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E1996 and FBC Sections 1609.1.2.2 & R301.2.1.2.1.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS


| SHEET# | DESCRIPTION                                          |
|--------|------------------------------------------------------|
| 1      | Typical elevations, design pressures & general notes |
| 2      | Door panel details                                   |
| 3      | Sidelite panel details                               |
| 4      | Elevation                                            |
| 5      | Horizontal cross sections                            |
| 6      | Vertical cross sections                              |
| 7      | Buck anchoring                                       |
| 8      | Frame anchoring                                      |
| 9      | Astragal details                                     |
| 10     | Bill of materials and components                     |

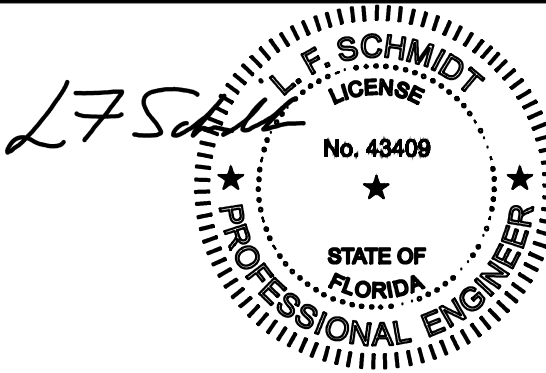

Digitally signed by Lyndon F Schmidt  
Date: 2023.07.18 10:57:32 -04'00'

This item has been digitally signed and sealed by L. F. Schmidt, P.E. on the date adjacent to the seal.  
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID  
ONLY FOR THE STATE OF FLORIDA

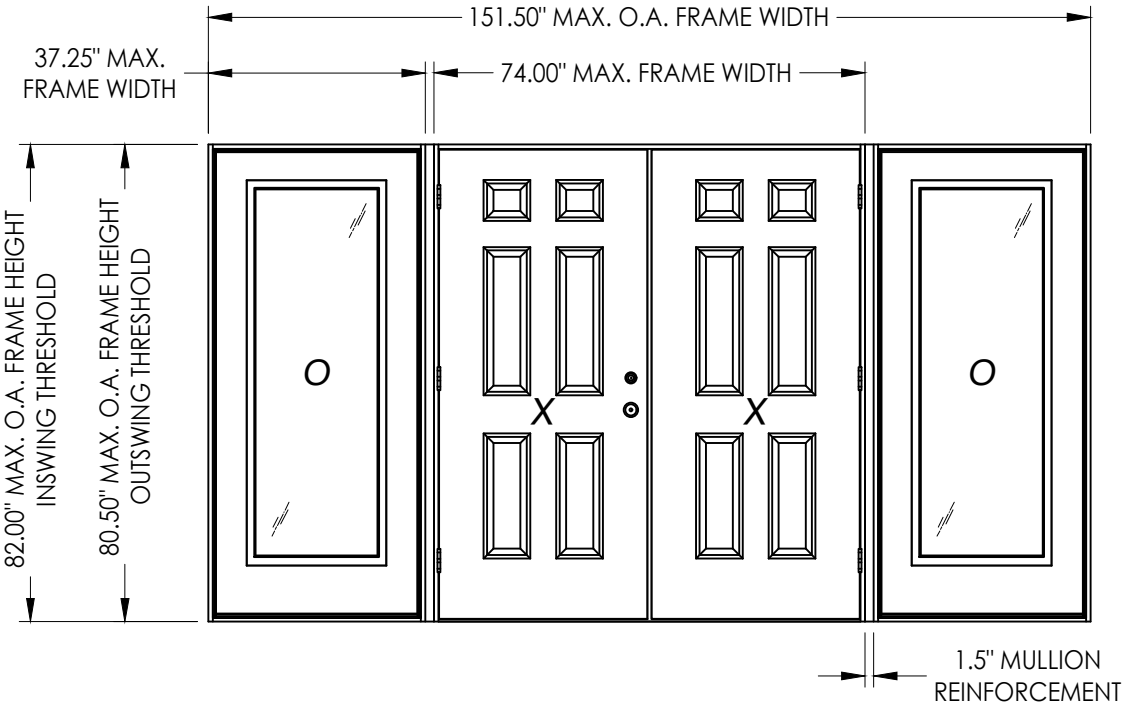

| MAX. FRAME DIMENSION | MAX. D.L.O. DIMENSION | DESIGN PRESSURE (PSF) INSWING |          | DESIGN PRESSURE (PSF) OUTSWING |          |
|----------------------|-----------------------|-------------------------------|----------|--------------------------------|----------|
|                      |                       | POSITIVE                      | NEGATIVE | POSITIVE                       | NEGATIVE |
| 151.5\" x 82.0\"     | 20.5\" x 62.5\"       | +47.0                         | -47.0    | +47.0                          | -47.0    |

Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409

BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813


PRODUCT: TAYLOR DOORS

PART OR ASSEMBLY:  
TYPICAL ELEVATION, DESIGN  
PRESSURES & GENERAL NOTES

| NO. | DATE    | REVISIONS                                                 |    |     |     |
|-----|---------|-----------------------------------------------------------|----|-----|-----|
|     |         | BY                                                        | JK | LFS | LFS |
| 4   | 7/06/23 | UPDATE TO 8TH ED. (2023) FBC & REVISE ALUMINUM LITE FRAME |    |     |     |
| 3   | 7/20/20 | UPDATE TO 7th ED (2020) FBC                               |    |     |     |
| 2   | 7/17/17 | UPDATE TO 6TH ED. (2017) FBC                              |    |     |     |
| 1   | 3/9/15  | UPDATE TO 5TH ED. (2014) FBC                              |    |     |     |


DATE: 1/12/12  
SCALE: N.T.S.  
DWG. BY: JK  
CHK. BY: LFS  
DRAWING NO.: FL-15135.11  
SHEET 1 OF 10

G:\2023 FBC DRAWINGS\Taylor Entrance Systems\FL-15135 R4\FL-15135.10-11.dwg

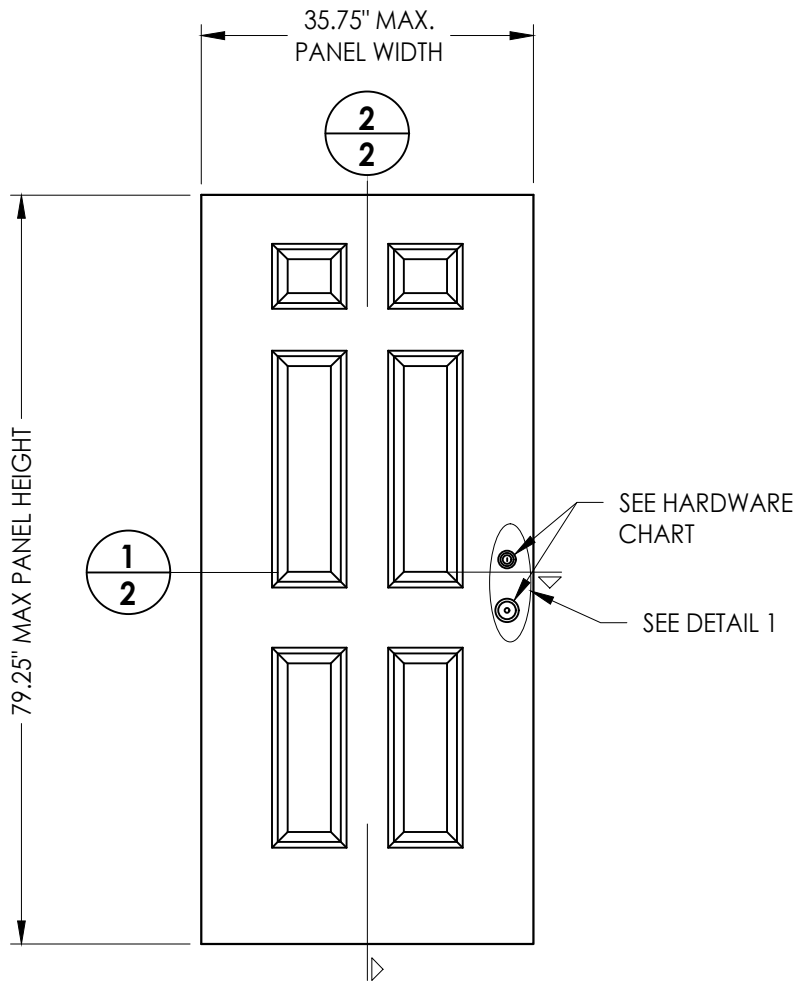


40 DOOR PANEL  
Wood Edge  
Steel Door


DOOR SKIN: 0.019" MIN. THK. STEEL  
CORE MATERIAL: POLYURETHANE FOAM

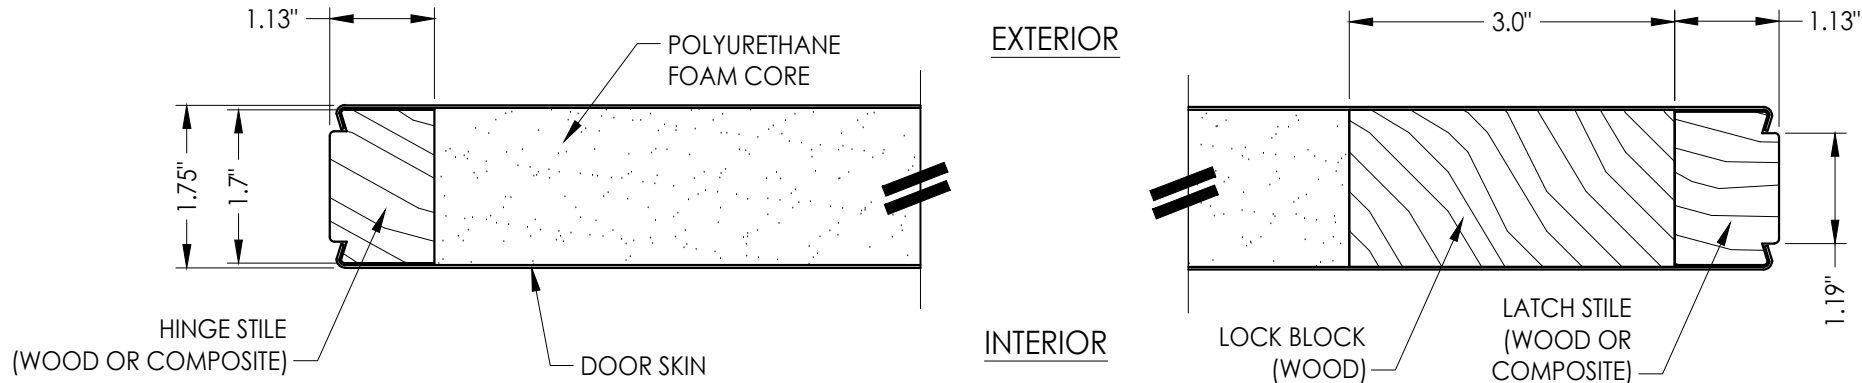

1  
2 HORIZONTAL CROSS SECTION

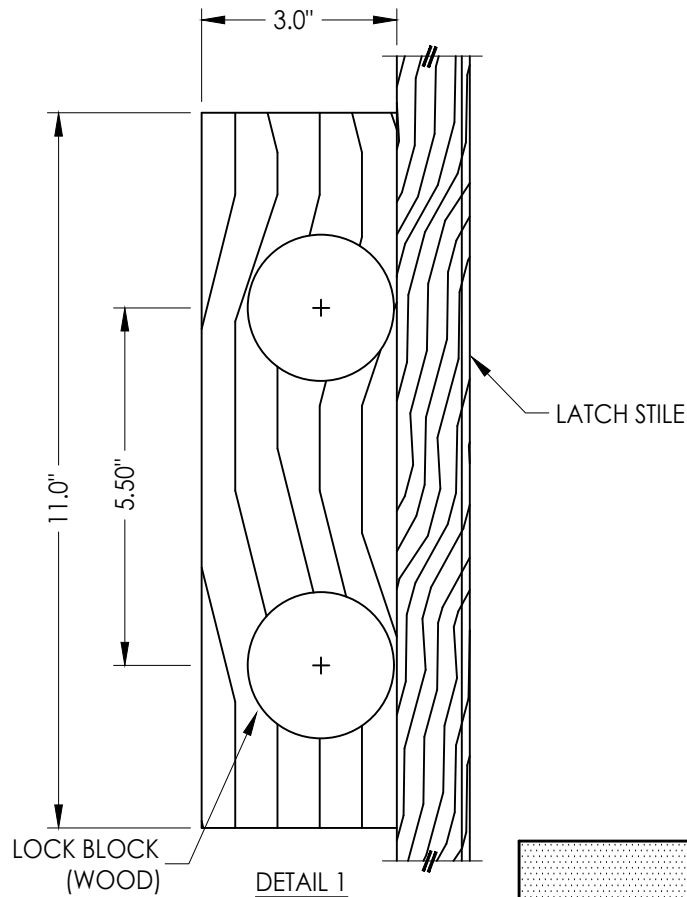

| HARDWARE CHART |             |                             |
|----------------|-------------|-----------------------------|
| MANUFACTURER   | MODEL       |                             |
| YALE           | Knob:       | NEW TRADITIONS              |
|                | Deadbolt:   | NEW TRADITIONS (800 SERIES) |
| SCHLAGE        | Knob/Lever: | "F" SERIES                  |
|                | Deadbolt:   | B60/62                      |
| KWIKSET        | Knob:       | SIGNATURE SERIES            |
|                | Deadbolt:   | SIGNATURE SERIES (980)      |

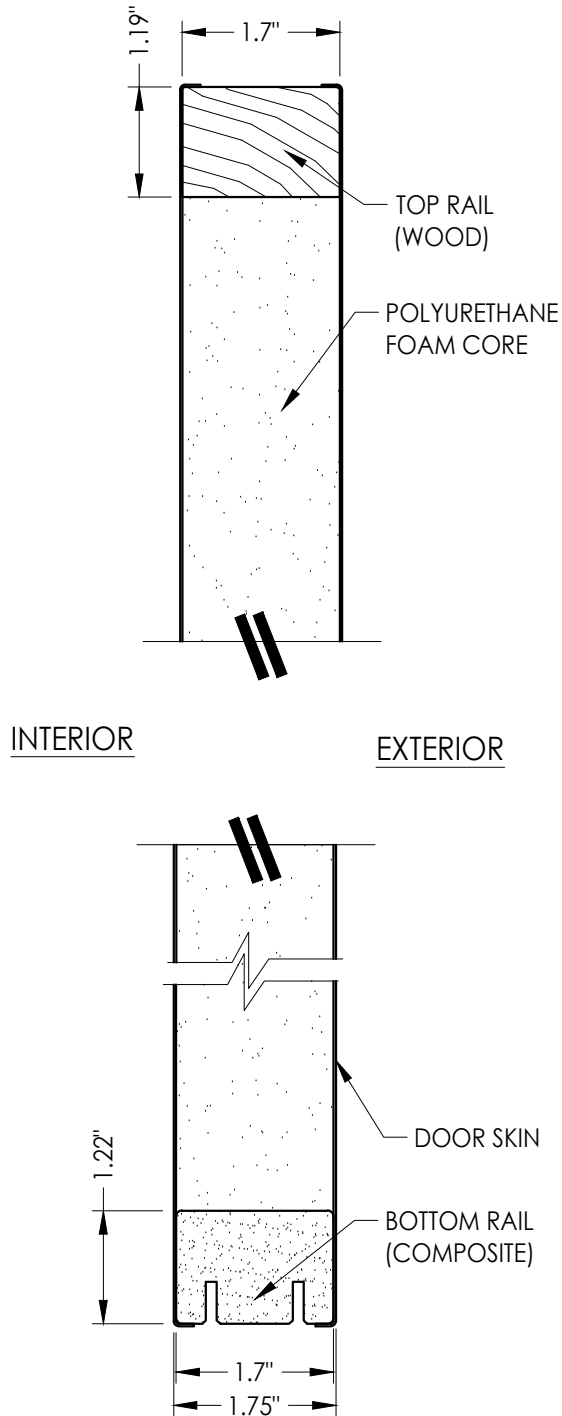


2  
2 VERTICAL CROSS SECTION

| NO. | DATE    | REVISIONS                                                 |     |    |    |
|-----|---------|-----------------------------------------------------------|-----|----|----|
|     |         | BY                                                        | JK  | JK | BY |
| 4   | 7/06/23 | UPDATE TO 8TH ED. (2023) FBC & REVISE ALUMINUM LITE FRAME | LFS |    |    |
| 3   | 7/20/20 | UPDATE TO 7th ED (2020) FBC                               | LFS |    |    |
| 2   | 7/17/17 | UPDATE TO 6TH ED. (2017) FBC                              | JK  |    |    |
| 1   | 3/9/15  | UPDATE TO 5TH ED. (2014) FBC                              | JK  |    |    |


DATE: 1/12/12  
SCALE: N.T.S.  
DWG. BY: JK  
CHK. BY: LFS  
DRAWING NO.: FL-15135.11  
SHEET 2 OF 10

Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409  
  
BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813


G:\2023 FBC DRAWINGS\Taylor Entrance Systems\FL-15135 R4\FL-15135.10-11.dwg

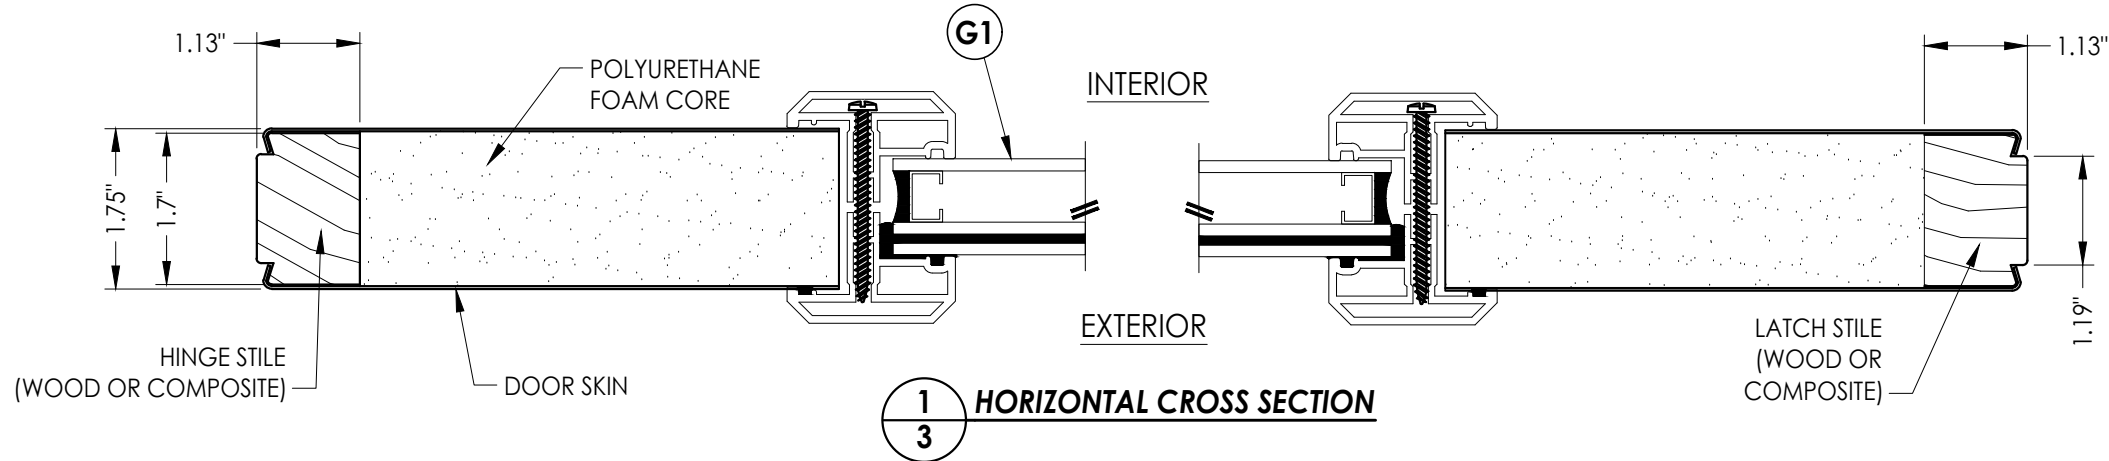


1  
3 HORIZONTAL CROSS SECTION

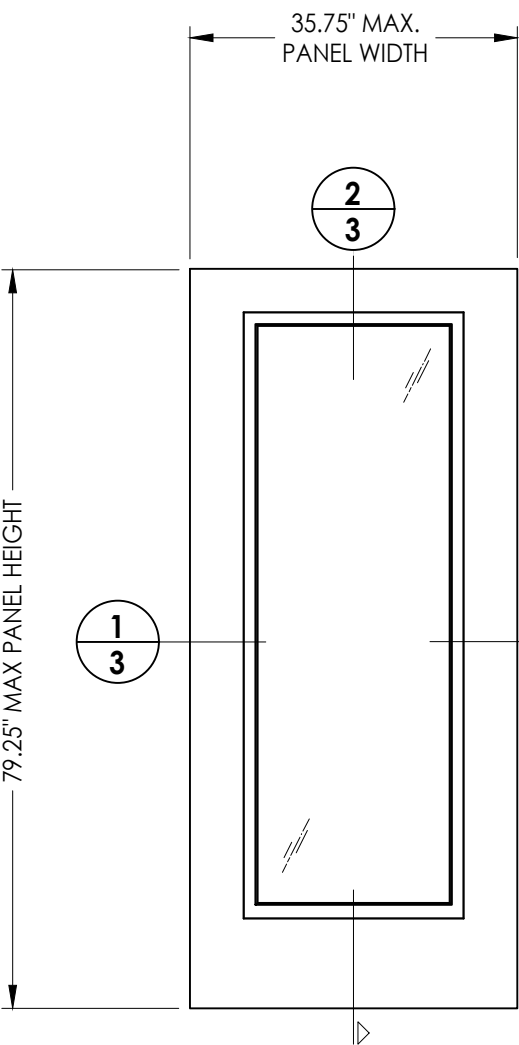


41 SIDELITE PANEL  
Wood Edge

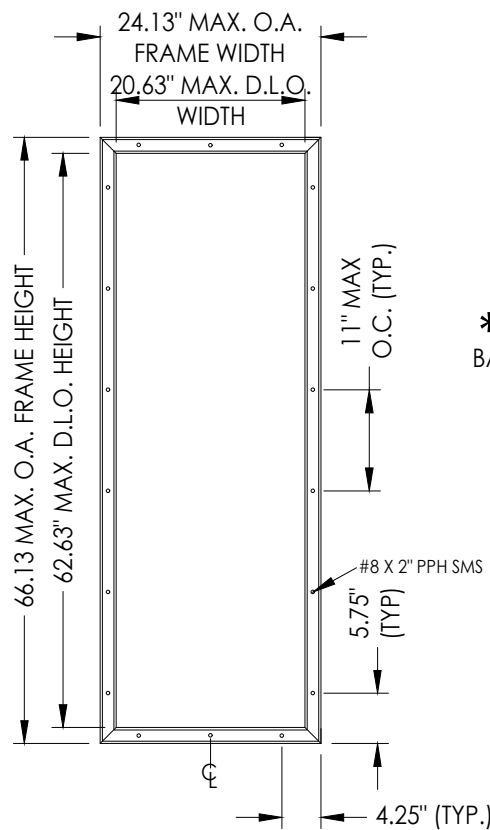


ODL LITE FRAME DETAIL  
"FLAT FRAME" PROFILE

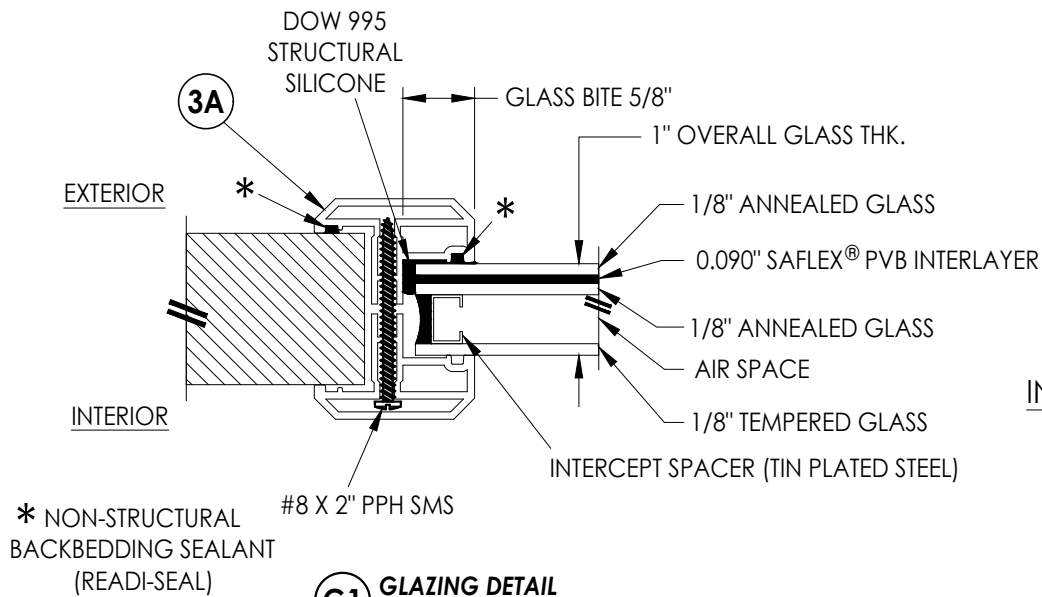

G1 GLAZING DETAIL  
ODL "FLAT FRAME"

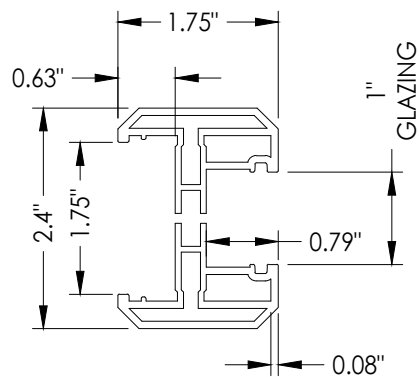

3A ODL LITE FRAME  
"FLAT FRAME" PROFILE  
(6063-T5 ALUM)

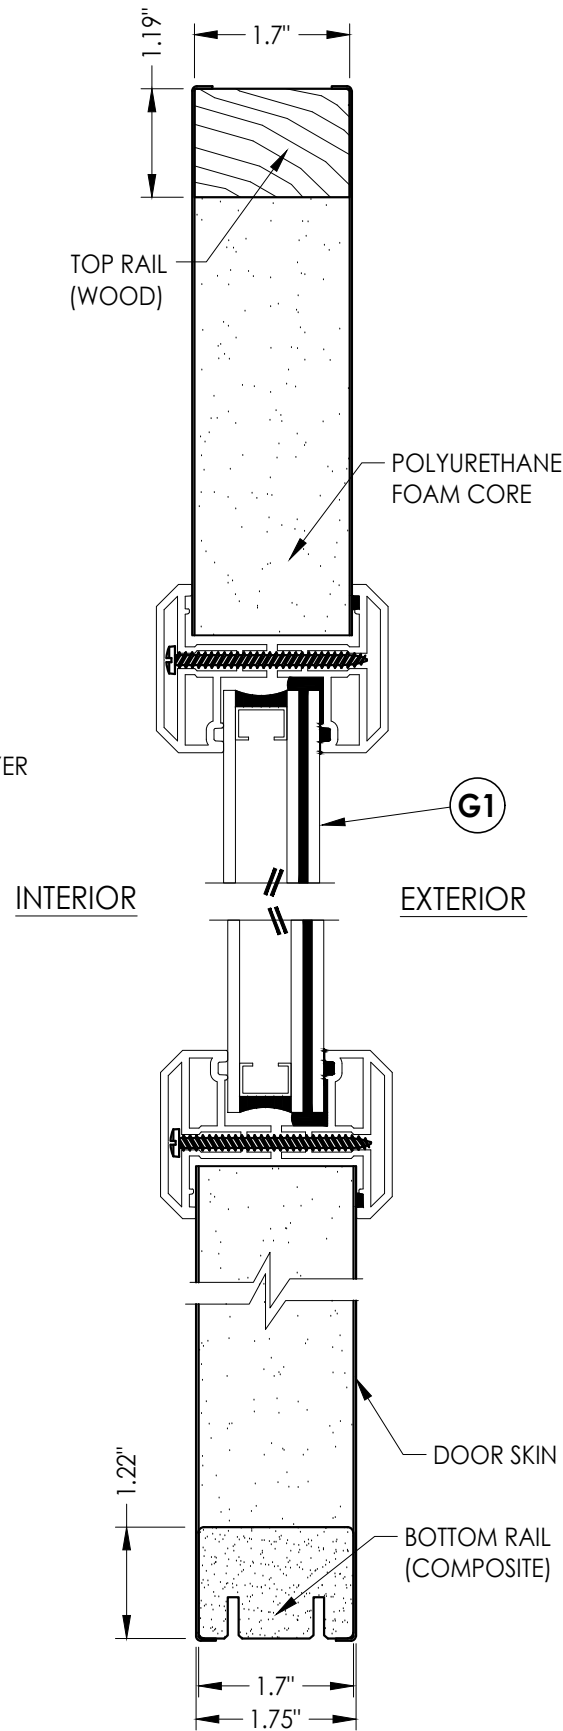

2  
3 VERTICAL CROSS SECTION

DOOR SKIN: 0.019" MIN. THK. STEEL  
CORE MATERIAL: POLYURETHANE FOAM

Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409


BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813

PRODUCT: TAYLOR DOORS

PART OR ASSEMBLY:  
SIDELITE PANEL DETAILS

| NO. | DATE    | REVISIONS                                                 |     |     |     |
|-----|---------|-----------------------------------------------------------|-----|-----|-----|
|     |         | BY                                                        | JK  | LFS | LFS |
| 4   | 7/06/23 | UPDATE TO 8TH ED. (2023) FBC & REVISE ALUMINUM LITE FRAME | FBC | LFS |     |
| 3   | 7/20/20 | UPDATE TO 7th ED (2020) FBC                               | FBC | LFS |     |
| 2   | 7/17/17 | UPDATE TO 6TH ED. (2017) FBC                              | FBC | JK  |     |
| 1   | 3/9/15  | UPDATE TO 5TH ED. (2014) FBC                              | FBC | JK  |     |

DATE: 1/12/12  
SCALE: N.T.S.  
DWG. BY: JK  
CHK. BY: LFS  
DRAWING NO.: FL-15135.11  
SHEET 3 OF 10

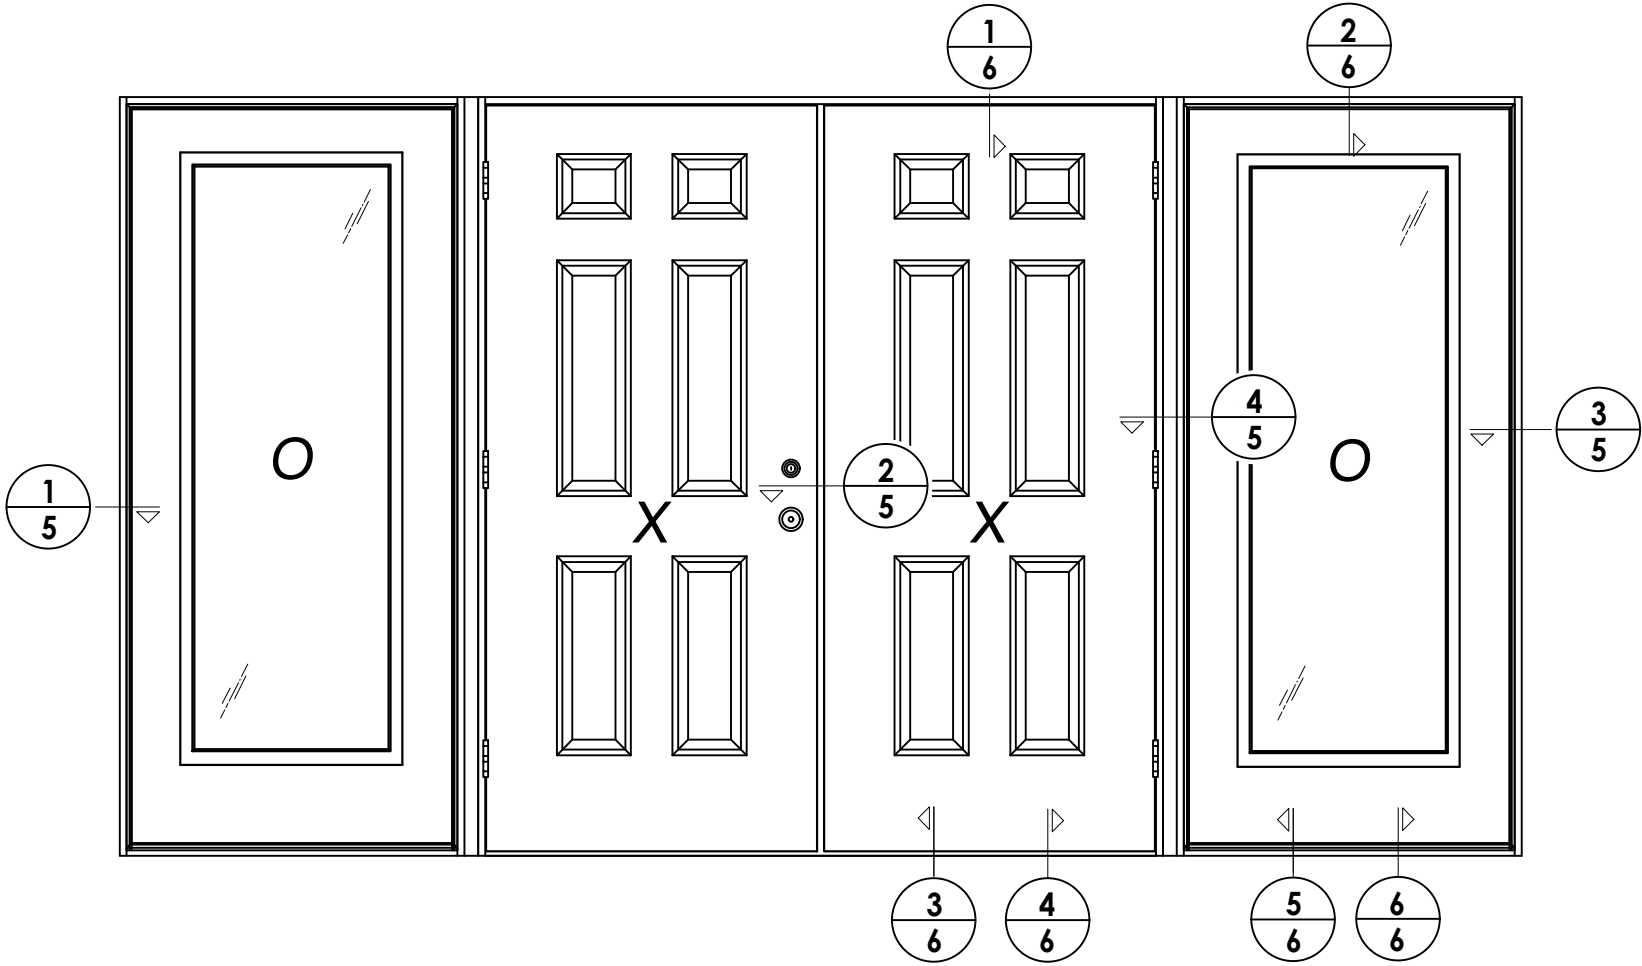


| NO. | DATE    | REVISIONS                                                 |
|-----|---------|-----------------------------------------------------------|
| 4   | 7/06/23 | UPDATE TO 8TH ED. (2023) FBC & REVISE ALUMINUM LITE FRAME |
| 3   | 7/20/20 | UPDATE TO 7th ED (2020) FBC                               |
| 2   | 7/17/17 | UPDATE TO 6TH ED. (2017) FBC                              |
| 1   | 3/9/15  | UPDATE TO 5TH ED. (2014) FBC                              |
|     |         | BY JK                                                     |

DATE: 1/12/12  
SCALE: N.T.S.  
DWG. BY: JK  
CHK. BY: LFS  
DRAWING NO.: FL-15135.11  
SHEET 4 OF 10

PRODUCT: TAYLOR DOORS  
PART OR ASSEMBLY: ELEVATION


Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409  
BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813

G:\2023 FBC DRAWINGS\Taylor Entrance Systems\FL-15135 R4\FL-15135.10-11.dwg

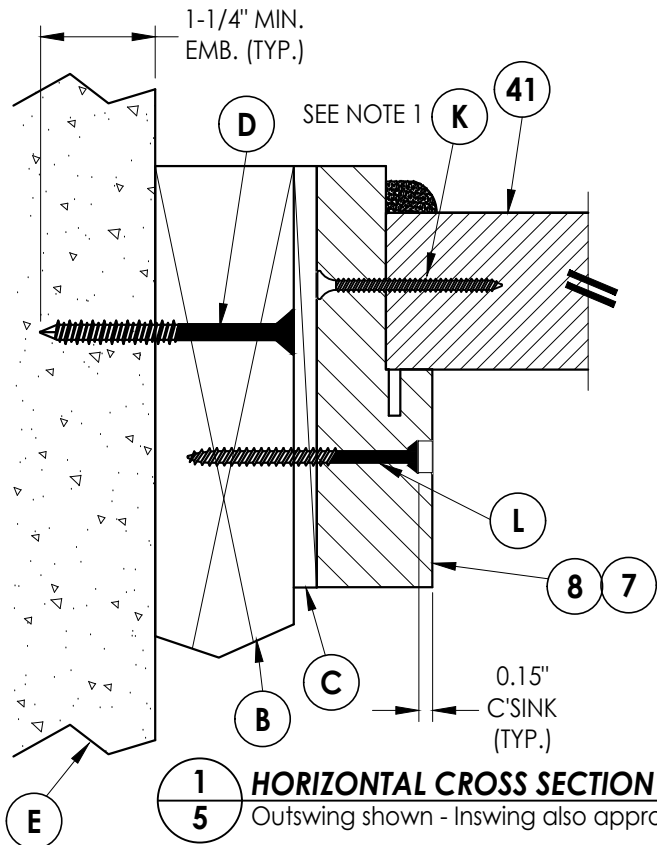


INTERIOR

EXTERIOR

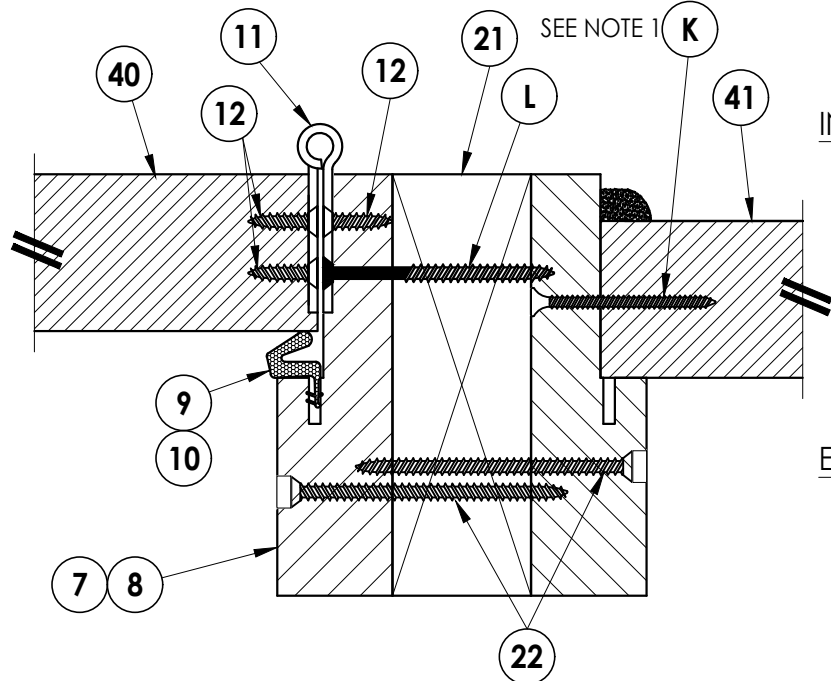


INTERIOR

EXTERIOR

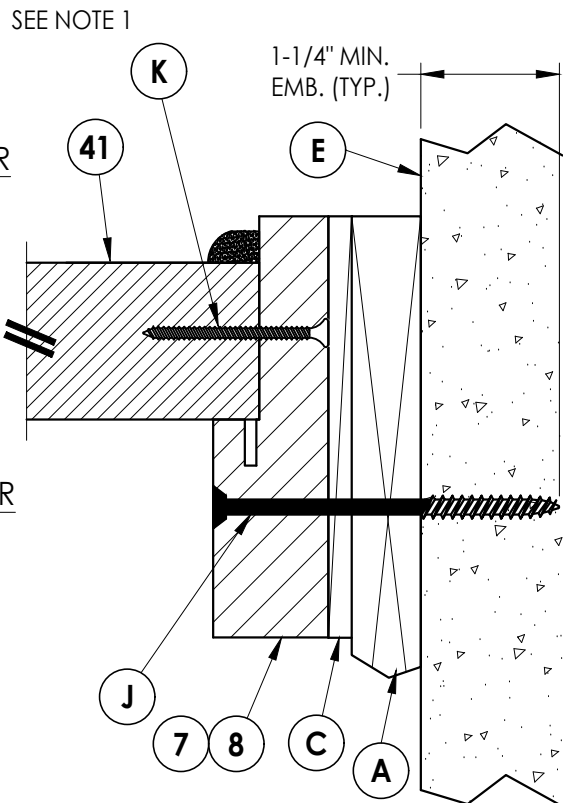

EXTERIOR

INTERIOR

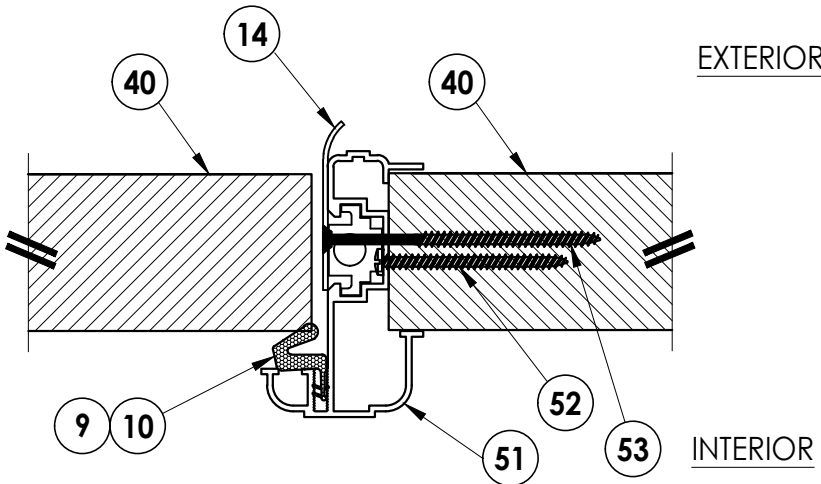

NOTE:

1. SIDELITE PANELS ANCHORED TO FRAME 6" FROM TOP OF FRAME THEN 10" O.C. (TYP.), 8 SCREWS TOTAL EACH JAMB.

Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409

**RW** BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813

PRODUCT: TAYLOR DOORS

PART OR ASSEMBLY:  
HORIZONTAL  
CROSS SECTIONS

| NO. | DATE    | REVISIONS                                                 |
|-----|---------|-----------------------------------------------------------|
| 4   | 7/06/23 | UPDATE TO 8TH ED. (2023) FBC & REVISE ALUMINUM LITE FRAME |
| 3   | 7/20/20 | UPDATE TO 7th ED (2020) FBC                               |
| 2   | 7/17/17 | UPDATE TO 6TH ED. (2017) FBC                              |
| 1   | 3/9/15  | UPDATE TO 5TH ED. (2014) FBC                              |

DATE: 1/12/12


SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:  
FL-15135.11

SHEET 5 OF 10

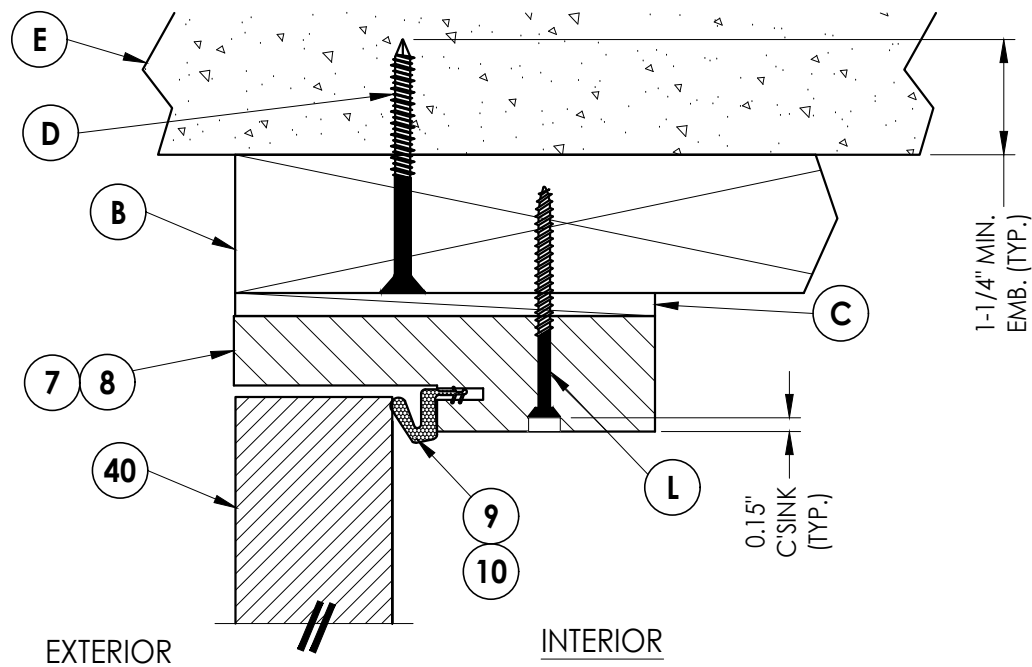


**1**  
**6** **VERTICAL CROSS SECTION**  
Outswing shown - Inswing also approved

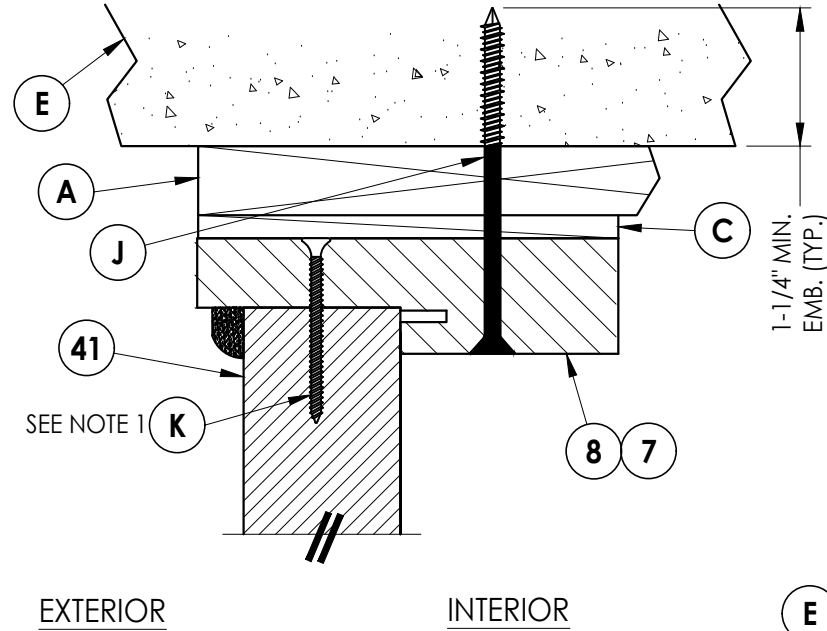


**2**  
**6** **VERTICAL CROSS SECTION**  
Shown w/1X sub-buck


NOTE  
1. SCREWS THRU FRAME & THRESHOLD INTO  
SIDELITE PANEL LOCATED 6" FROM CORNERS  
OF SIDELITE AND @ CENTER LINE OF SIDELITE.

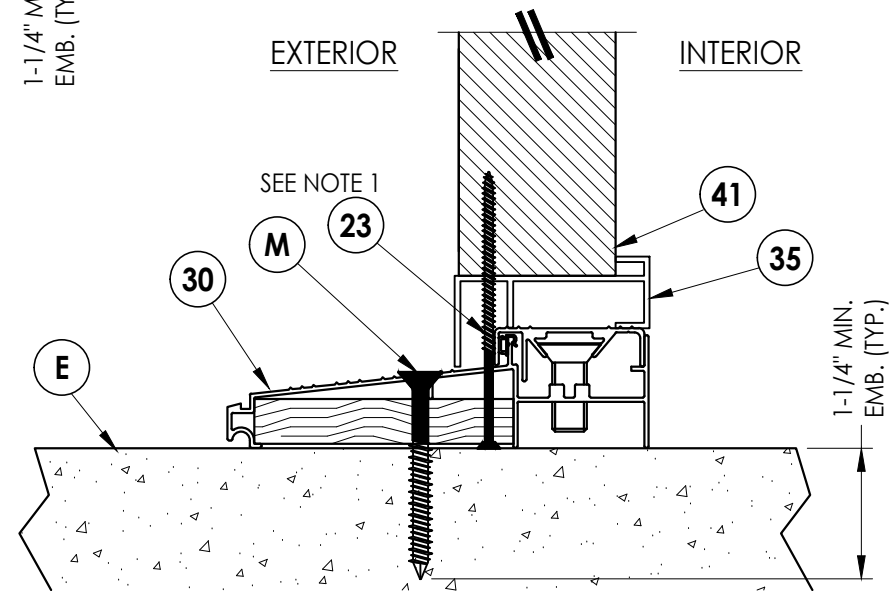


**5**  
**6** **VERTICAL CROSS SECTION**  
Inswing configuration

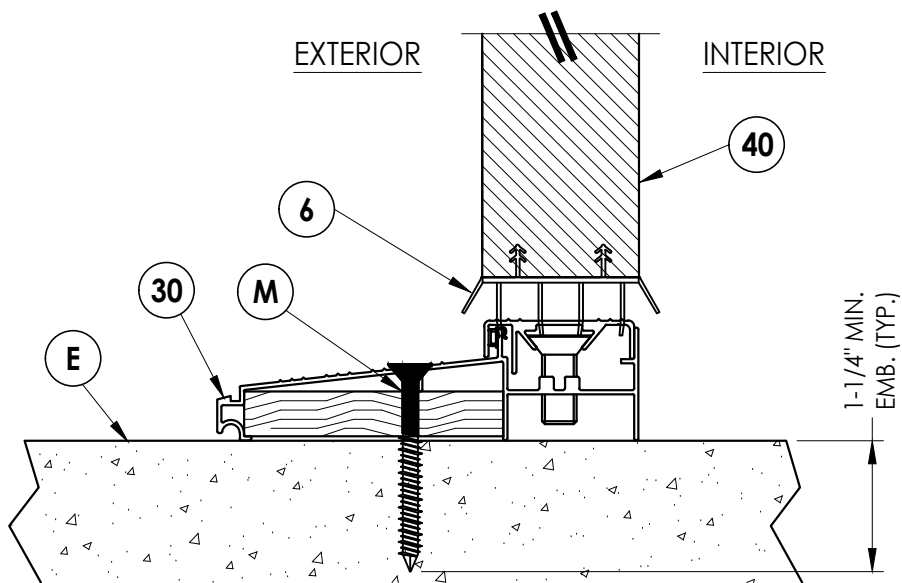

**3**  
**6** **VERTICAL CROSS SECTION**  
Inswing configuration

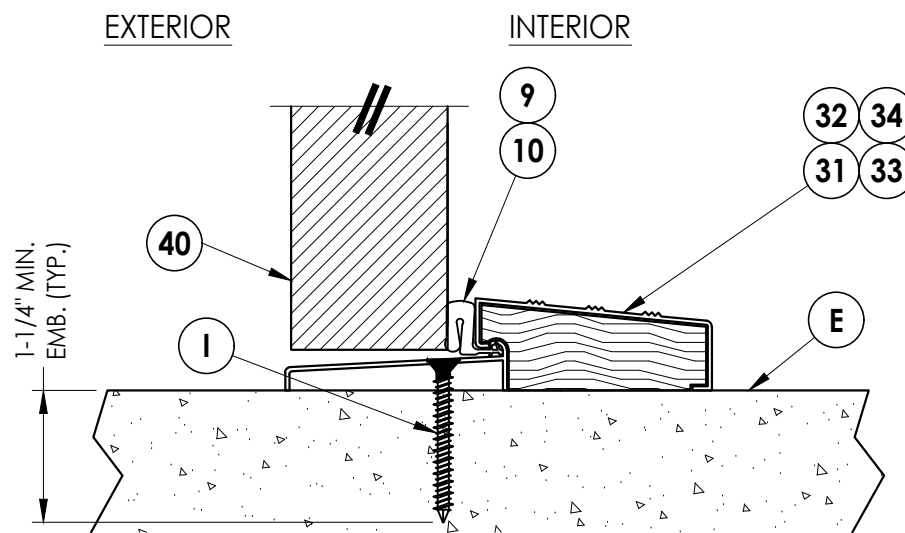

**4**  
**6** **VERTICAL CROSS SECTION**  
Outswing configuration

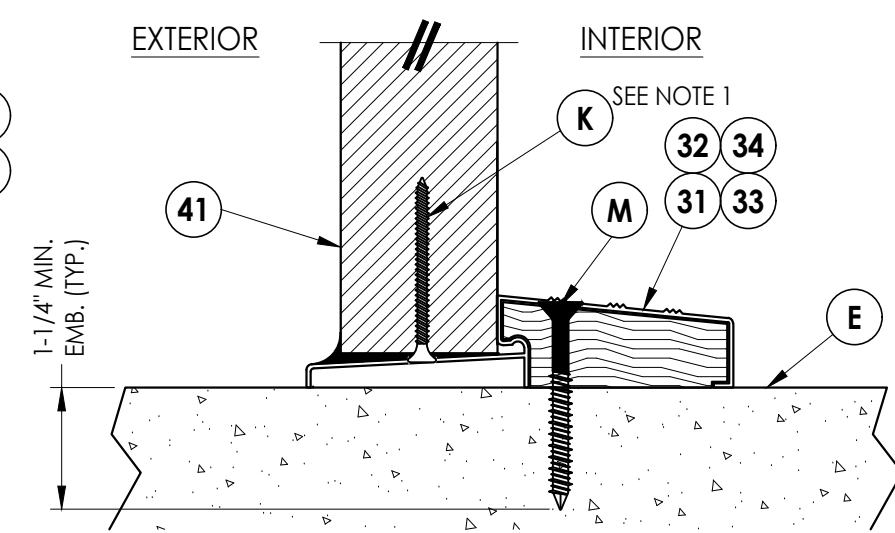

**6**  
**6** **VERTICAL CROSS SECTION**  
Outswing configuration

Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409

**RW** BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813

PRODUCT: TAYLOR DOORS

PART OR ASSEMBLY:  
VERTICAL  
CROSS SECTIONS

| NO. | DATE    | REVISIONS                        |
|-----|---------|----------------------------------|
| 4   | 7/06/23 | UPDATE TO 8TH ED. (2023) FBC LFS |
| 3   | 7/20/20 | & REVISE ALUMINUM LITE FRAME LFS |
| 2   | 7/17/17 | UPDATE TO 7TH ED. (2020) FBC JK  |
| 1   | 3/9/15  | UPDATE TO 6TH ED. (2017) FBC JK  |
|     |         | UPDATE TO 5TH ED. (2014) FBC BY  |


DATE: 1/12/12  
SCALE: N.T.S.  
DWG. BY: JK  
CHK. BY: LFS  
DRAWING NO.: FL-15135.11  
SHEET 6 OF 10

G:\2023 FBC Drawings\Taylor Entrance Systems\FL-15135 R4\FL-15135.10-11.dwg

CONCRETE ANCHOR NOTES:

- 1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- 2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- 3. Concrete anchor table:

| ANCHOR TYPE       | ANCHOR SIZE | MIN. EMBEDMENT | MIN. CLEARANCE TO MASONRY EDGE | MIN. CLEARANCE TO ADJACENT ANCHOR |
|-------------------|-------------|----------------|--------------------------------|-----------------------------------|
| ITW TAPCON®       | 1/4"        | 1-1/4"         | 2"                             | 4"                                |
| DeWALT ULTRACON+® | 1/4"        | 1-1/4"         | 1"                             | 4"                                |

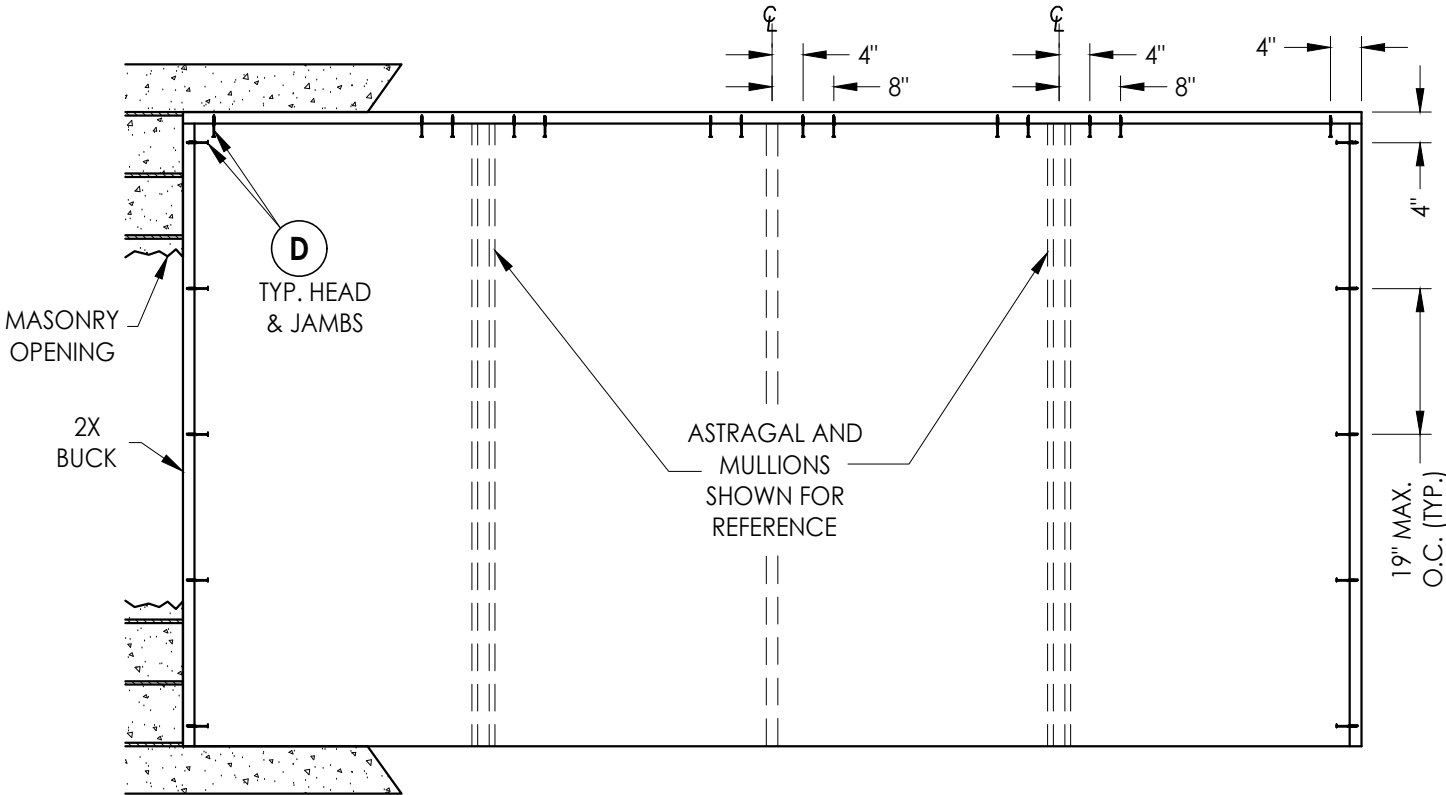

BUCK ANCHORING

| NO. | DATE    | REVISIONS                                                 |     |    |     |
|-----|---------|-----------------------------------------------------------|-----|----|-----|
|     |         | DATE                                                      | BY  | JK | LFS |
| 4   | 7/06/23 | UPDATE TO 8TH ED. (2023) FBC & REVISE ALUMINUM LITE FRAME | LFS |    |     |
| 3   | 7/20/20 | UPDATE TO 7th ED (2020) FBC                               | LFS |    |     |
| 2   | 7/17/17 | UPDATE TO 6TH ED. (2017) FBC                              | JK  |    |     |
| 1   | 3/9/15  | UPDATE TO 5TH ED. (2014) FBC                              | JK  |    |     |



|              |             |
|--------------|-------------|
| DATE:        | 1/12/12     |
| SCALE:       | N.T.S.      |
| DWG. BY:     | JK          |
| CHK. BY:     | LFS         |
| DRAWING NO.: | FL-15135.11 |
| SHEET        | 7 OF 10     |

|                   |                |
|-------------------|----------------|
| PRODUCT:          | TAYLOR DOORS   |
| PART OR ASSEMBLY: | BUCK ANCHORING |

Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409

BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813

G:\2023 FBC DRAWINGS\Taylor Entrance Systems\FL-15135 R4\FL-15135.10-11.dwg

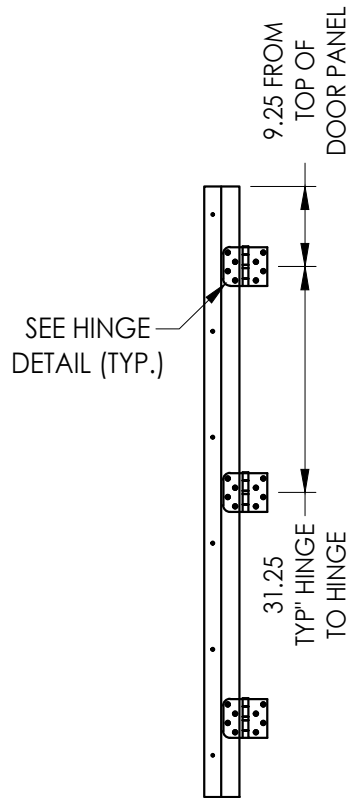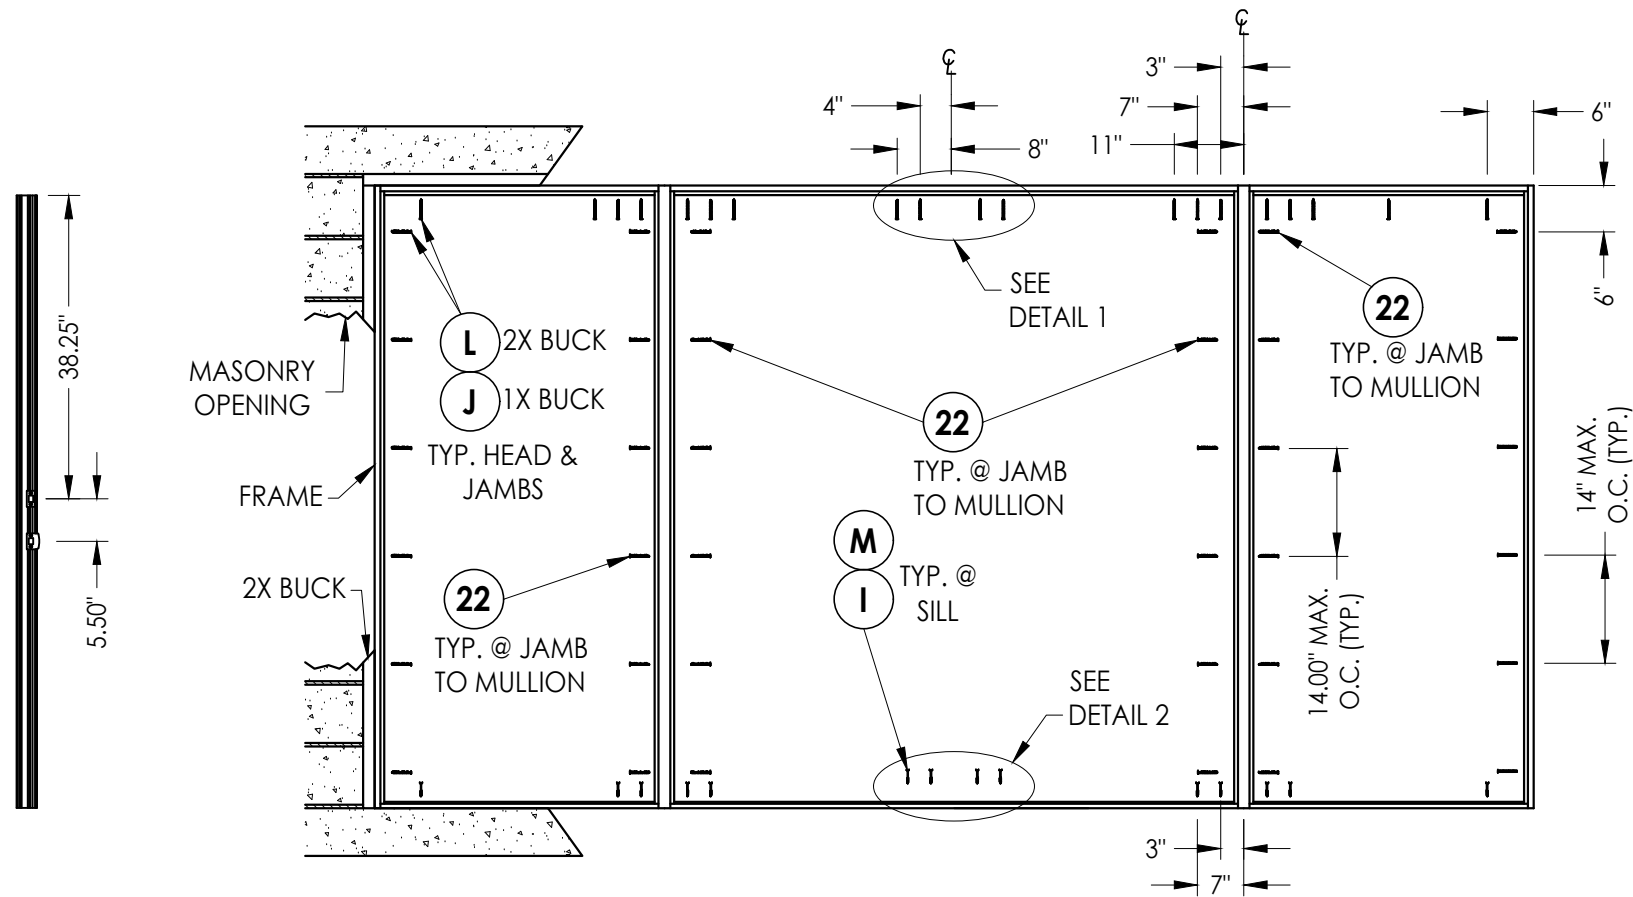

ASTRAGAL STRIKE

FRAME ANCHORING

HINGE JAMB


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:


| ANCHOR TYPE      | ANCHOR SIZE | MIN. EMBEDMENT | MIN. CLEARANCE TO MASONRY EDGE | MIN. CLEARANCE TO ADJACENT ANCHOR |
|------------------|-------------|----------------|--------------------------------|-----------------------------------|
| ITW TAPCON®      | 1/4"        | 1-1/4"         | 2"                             | 4"                                |
| DeWALT ULTRACON® | 1/4"        | 1-1/4"         | 1"                             | 4"                                |
| ITW TAPCON®      | 3/16"       | 1-1/4"         | 3"                             | 1-1/2"                            |

WOOD SCREW INSTALLATION NOTES:


- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

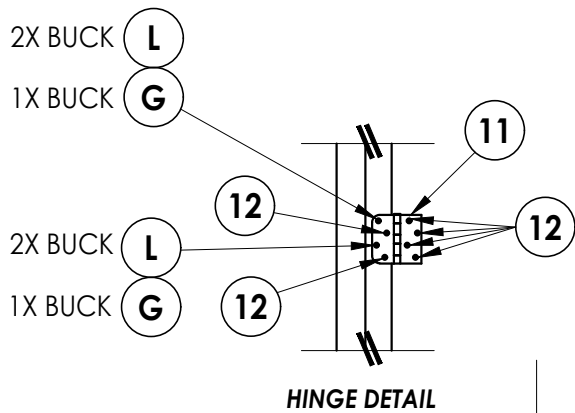


HINGE DETAIL

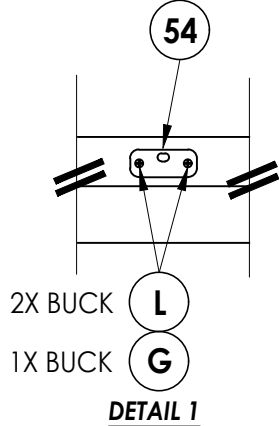


DETAIL 1

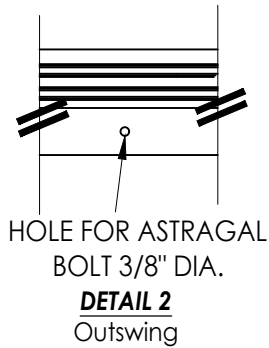

DETAIL 2  
Outswing

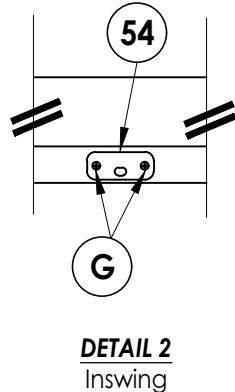

DETAIL 2  
Inswing

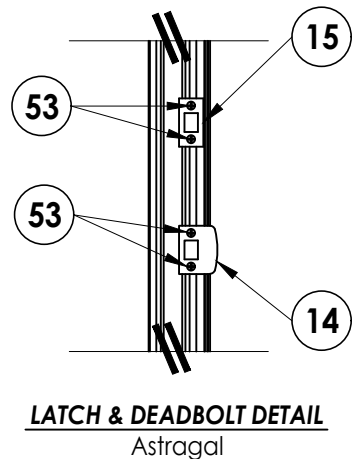

LATCH & DEADBOLT DETAIL  
Astragal

Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409

BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE Registry No. 9813

PRODUCT: TAYLOR DOORS

PART OR ASSEMBLY:  
FRAME ANCHORING

| NO. | DATE    | REVISIONS                                                 |
|-----|---------|-----------------------------------------------------------|
| 4   | 7/06/23 | UPDATE TO 8TH ED. (2023) FBC & REVISE ALUMINUM LITE FRAME |
| 3   | 7/20/20 | UPDATE TO 7TH ED (2020) FBC                               |
| 2   | 7/17/17 | UPDATE TO 6TH ED. (2017) FBC                              |
| 1   | 3/9/15  | UPDATE TO 5TH ED. (2014) FBC                              |

DATE: 1/12/12

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-15135.11

SHEET 8 OF 10




G:\2023 FBC DRAWINGS\Taylor Entrance Systems\FL-15135 RA\FL-15135.10-11.dwg

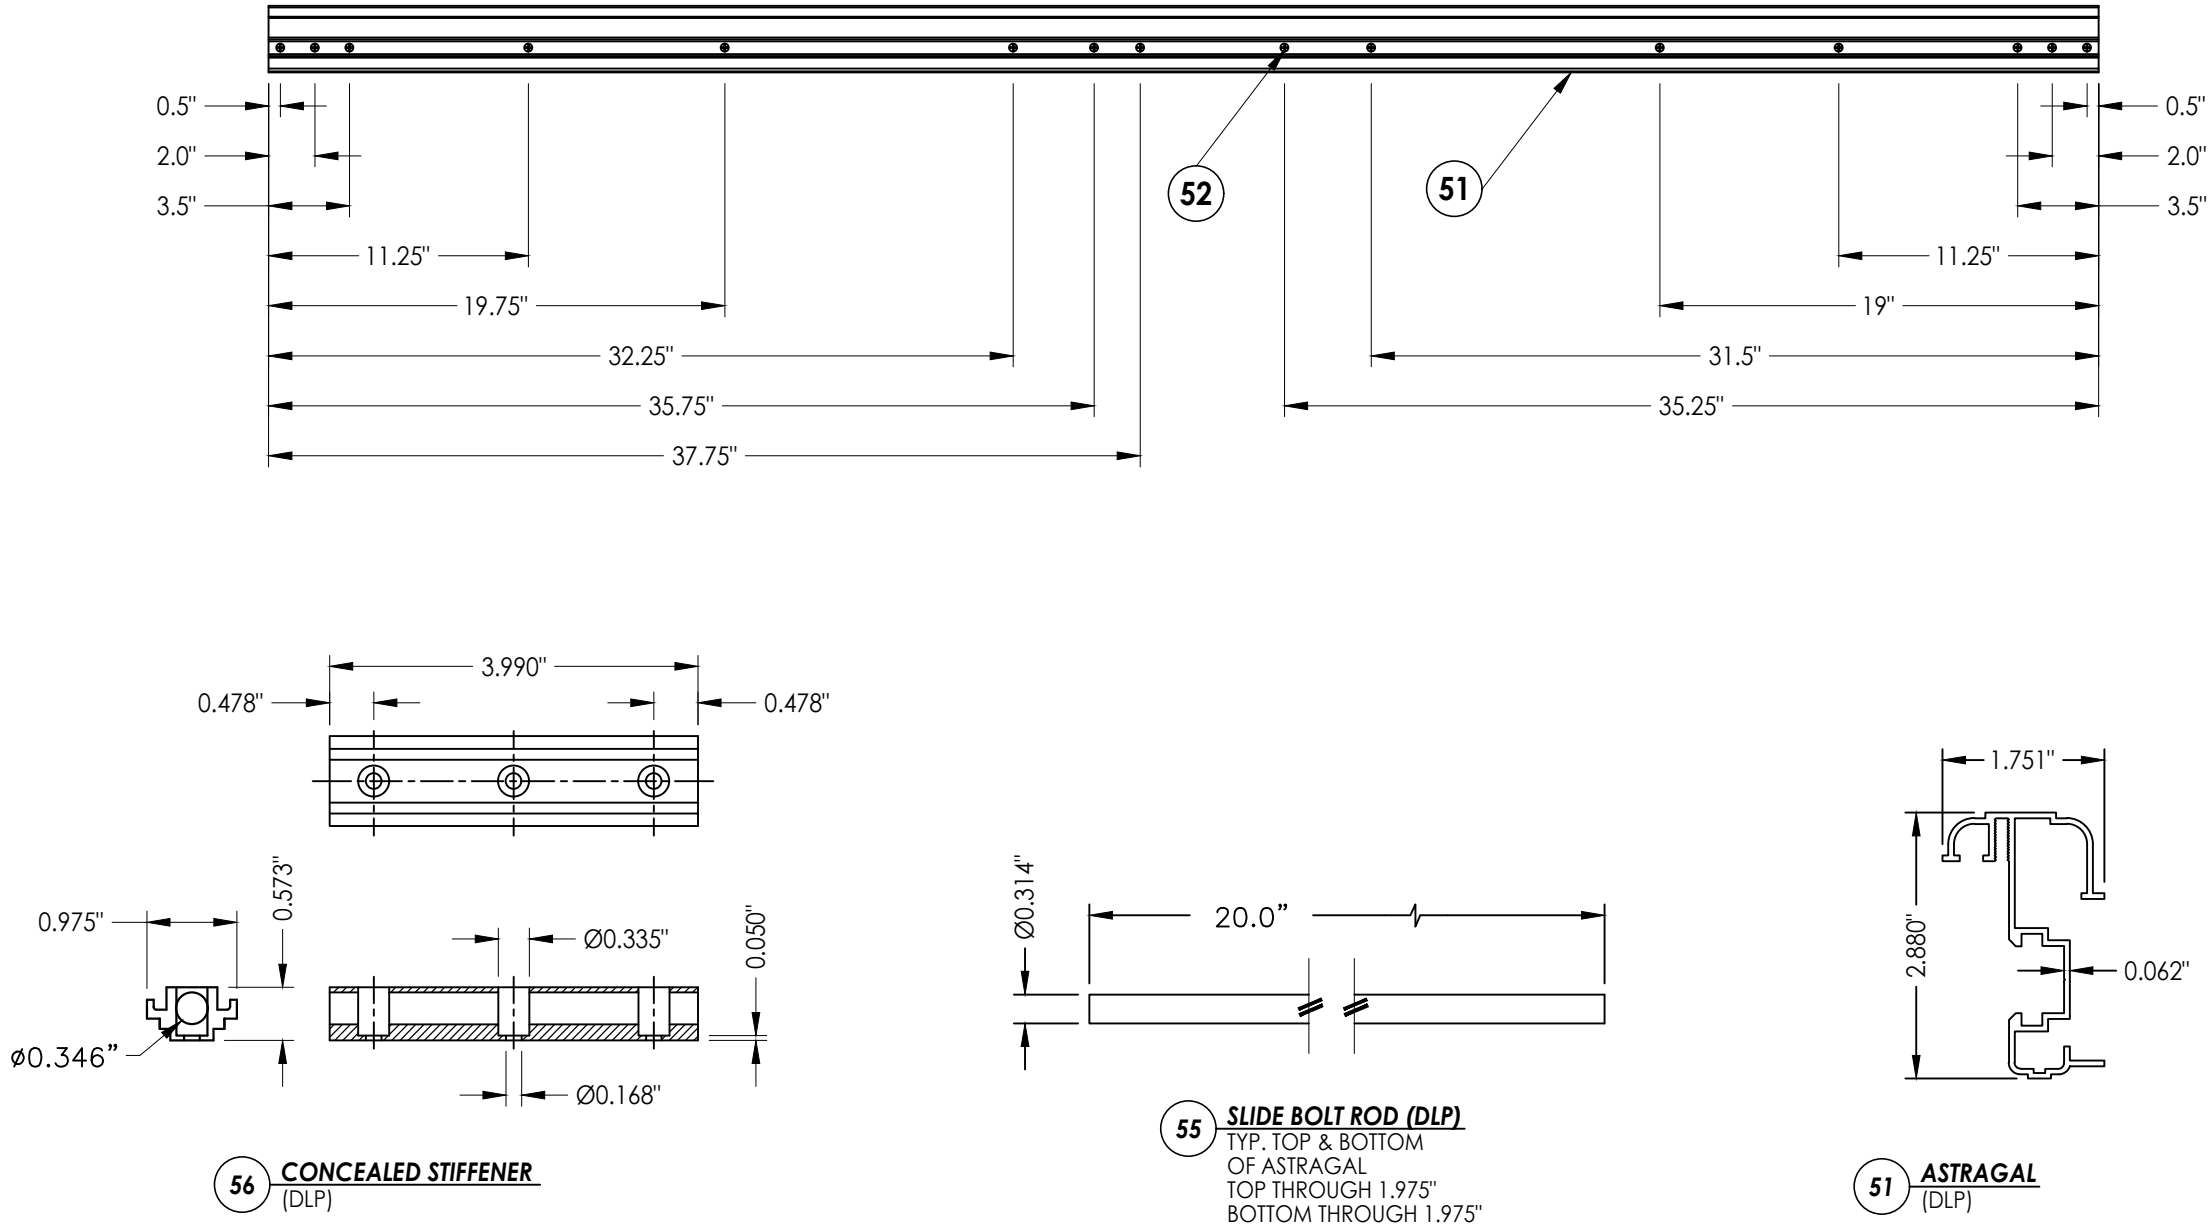


|                                                               |         |                                                                                                                    |     |
|---------------------------------------------------------------|---------|--------------------------------------------------------------------------------------------------------------------|-----|
| Documents Prepared By:<br>Lyndon F. Schmidt<br>P.E. No. 43409 |         | BUILDING CONSULTANTS, INC.<br>P.O. Box 230, Valrico, FL 33595<br>Phone No.: 813.659.9197<br>FBPE Registry No. 9813 |     |
| PRODUCT:<br>TAYLOR DOORS                                      |         | PART OR ASSEMBLY:<br>ASTRAGAL DETAILS                                                                              |     |
|                                                               |         |                                                                                                                    |     |
| 4                                                             | 7/06/23 | UPDATE TO 8TH ED. (2023) FBC<br>& REVISE ALUMINUM LITE FRAME                                                       | LFS |
| 3                                                             | 7/20/20 | UPDATE TO 7th ED (2020) FBC                                                                                        | LFS |
| 2                                                             | 7/17/17 | UPDATE TO 6TH ED. (2017) FBC                                                                                       | JK  |
| 1                                                             | 3/9/15  | UPDATE TO 5TH ED. (2014) FBC                                                                                       | JK  |
| NO.                                                           | DATE    |                                                                                                                    | BY  |
| REVISIONS                                                     |         |                                                                                                                    |     |
| DATE: 1/12/12                                                 |         |                                                                                                                    |     |
| SCALE: N.T.S.                                                 |         |                                                                                                                    |     |
| DWG. BY: JK                                                   |         |                                                                                                                    |     |
| CHK. BY: LFS                                                  |         |                                                                                                                    |     |
| DRAWING NO.:<br>FL-15135.11                                   |         |                                                                                                                    |     |
| SHEET 9 of 10                                                 |         |                                                                                                                    |     |

G:\2023 FBC Drawings\Taylor Entrance Systems\FL-15135 RA\FL-15135.10-11.dwg


| BILL OF MATERIALS |                                                                                                |            |
|-------------------|------------------------------------------------------------------------------------------------|------------|
| ITEM #            | DESCRIPTION                                                                                    | MATERIAL   |
| A                 | 1X BUCK SG >= 0.55                                                                             | WOOD       |
| B                 | 2X BUCK SG >= 0.55                                                                             | WOOD       |
| C                 | 1/4" MAX. SHIM SPACE                                                                           | -          |
| D                 | 1/4" X 2-3/4" DeWALT OR ITW CONCRETE SCREW                                                     | STEEL      |
| E                 | MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90 | CONCRETE   |
| G                 | 3/16" X 3-1/4" PFH ITW CONCRETE SCREW                                                          | STEEL      |
| I                 | 1/4" X 1-3/4" PFH ITW CONCRETE SCREW                                                           | STEEL      |
| J                 | 1/4" X 3-3/4" PFH ITW CONCRETE SCREW                                                           | STEEL      |
| K                 | #7 X 2" PFH DRYWALL SCREW                                                                      | STEEL      |
| L                 | #10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)                                             | STEEL      |
| M                 | 1/4" X 2-1/4" PFH ITW CONCRETE SCREW                                                           | STEEL      |
| 6                 | DOOR BOTTOM SWEEP                                                                              | VINYL      |
| 7                 | JAMB (POLYFIBER)                                                                               | COMP       |
| 8                 | JAMB (PINE)                                                                                    | WOOD       |
| 9                 | MEDIUM REACH COMPRESSION WEATHERSTRIP (TAYLOR DOORS)                                           | FOAM       |
| 10                | LONG REACH COMPRESSION WEATHERSTRIP (TAYLOR DOORS)                                             | FOAM       |
| 11                | HINGE                                                                                          | STEEL      |
| 12                | #10 X 3/4" PFH WOOD SCREW                                                                      | STEEL      |
| 14                | LATCH STRIKE PLATE                                                                             | STEEL      |
| 15                | DEADBOLT STRIKE PLATE                                                                          | STEEL      |
| 21                | 2X MULLION REINFORCEMENT SG >= 0.42                                                            | WOOD       |
| 22                | #10 X 3" PFH WOOD SCREW                                                                        | STEEL      |
| 23                | #6 X 3" PFH WOOD SCREW                                                                         | STEEL      |
| 30                | INSWING THRESHOLD (BY DLP)                                                                     | ALUM./WOOD |
| 31                | OUTSWING THRESHOLD (QOS BY DLP)                                                                | ALUM./WOOD |
| 32                | OUTSWING THRESHOLD (QOSH BY DLP)                                                               | ALUM./WOOD |
| 33                | OUTSWING THRESHOLD (BY COMBO)                                                                  | ALUM./WOOD |
| 34                | OUTSWING THRESHOLD (OSHC BY DLP)                                                               | ALUMINUM   |
| 35                | INSWING SIDELITE ADAPTER                                                                       | PVC        |
| 40                | DOOR - SEE DOOR PANEL DETAIL SHEET FOR DETAILS                                                 | -          |
| 41                | SIDELITE - SEE SIDELITE PANEL DETAIL SHEET FOR DETAILS                                         | -          |
| 51                | ASTRAGAL 6063-T5 ALUMINUM BY DLP                                                               | ALUMINUM   |
| 52                | #8 X 2" PPH SCREW                                                                              | STEEL      |
| 53                | #8 X 3" PPH SCREW                                                                              | STEEL      |
| 54                | ASTRAGAL STRIKE PLATE @ HEAD                                                                   | STEEL      |
| 55                | SLIDE BOLT ROD                                                                                 | STEEL      |
| 56                | CONCEALED STIFFENER 6063-T6 ALUMINUM BY DLP                                                    | ALUMINUM   |

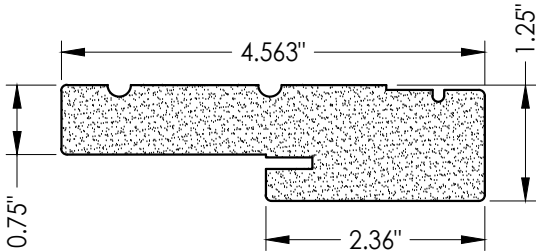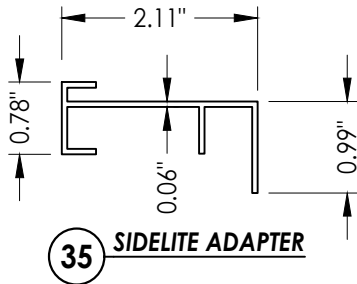


7 HEAD & SIDE  
Jamb (Polyfiber)

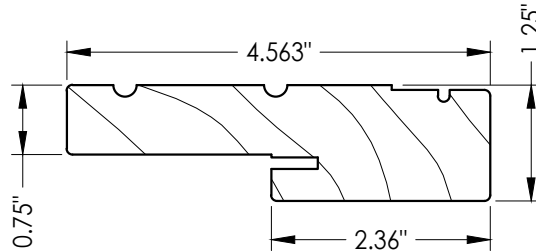


8 HEAD & SIDE  
Jamb (wood)

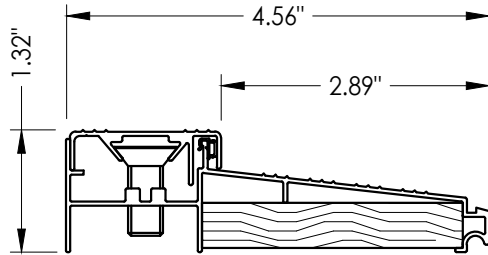


30 INSWING THRESHOLD

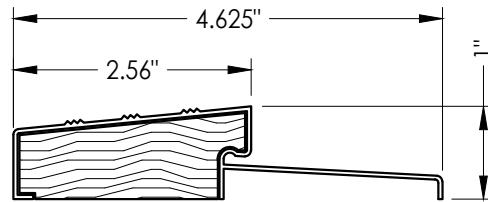


31 OUTSWING THRESHOLD  
QOS

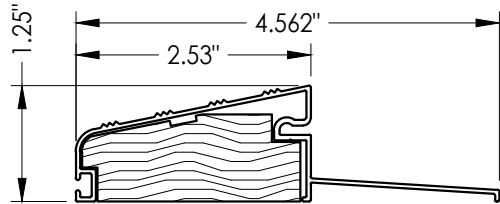

32 OUTSWING THRESHOLD  
QOSH

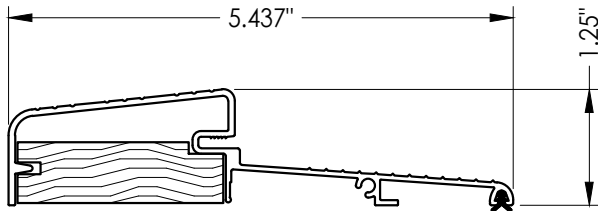

33 OUTSWING THRESHOLD  
By Combo

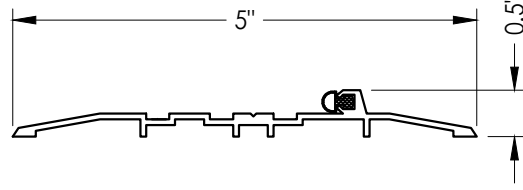

34 OUTSWING THRESHOLD  
OSHC

|                                                               |         |                                                                                                                    |     |
|---------------------------------------------------------------|---------|--------------------------------------------------------------------------------------------------------------------|-----|
| Documents Prepared By:<br>Lyndon F. Schmidt<br>P.E. No. 43409 |         | BUILDING CONSULTANTS, INC.<br>P.O. Box 230, Valrico, FL 33595<br>Phone No.: 813.659.9197<br>FBPE Registry No. 9813 |     |
| PRODUCT: TAYLOR DOORS                                         |         | PART OR ASSEMBLY: BILL OF MATERIALS & COMPONENTS                                                                   |     |
| 4                                                             | 7/06/23 | UPDATE TO 8TH ED. (2023) FBC & REVISE ALUMINUM LITE FRAME                                                          | LFS |
| 3                                                             | 7/20/20 | UPDATE TO 7th ED (2020) FBC                                                                                        | LFS |
| 2                                                             | 7/17/17 | UPDATE TO 6TH ED. (2017) FBC                                                                                       | JK  |
| 1                                                             | 3/9/15  | UPDATE TO 5TH ED. (2014) FBC                                                                                       | JK  |
| NO.                                                           | DATE    |                                                                                                                    | BY  |
| REVISIONS                                                     |         |                                                                                                                    |     |
| DATE: 1/12/12                                                 |         |                                                                                                                    |     |
| SCALE: N.T.S.                                                 |         |                                                                                                                    |     |
| DWG. BY: JK                                                   |         |                                                                                                                    |     |
| CHK. BY: LFS                                                  |         |                                                                                                                    |     |
| DRAWING NO.: FL-15135.11                                      |         |                                                                                                                    |     |
| SHEET 10 OF 10                                                |         |                                                                                                                    |     |