



5200 W. CENTURY BLVD.
LOS ANGELES, CA 90045

Smooth / Wood Grain / Mahogany / Rustic Series Fiberglass Door

INSWING / OUTSWING "NON-IMPACT"

GENERAL NOTES

1. This product has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product is required to be protected with an impact resistant covering that complies with Section 1609.1.2 & R301.2.1.2 of the FBC.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.



TABLE OF CONTENTS	
SHEET#	DESCRIPTION
1	Typical elevations, design pressures & general notes
2	Door panel details
3	Sidelite panel details and glazing detail
4	Elevations
5	Horizontal and vertical cross sections (2X BUCK)
6	Horizontal and vertical cross sections (1X BUCK)
7	Horizontal and vertical cross sections (Direct to Masonry)
8	Horizontal and vertical cross sections (Direct to Masonry)
9	Vertical cross sections
10	Buck and frame anchoring
11	Buck anchoring
12	Frame anchoring
13	Bill of materials and components

Digitally signed by Lyndon F Schmidt
Date: 2026.07.28 13:29:14 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.

Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

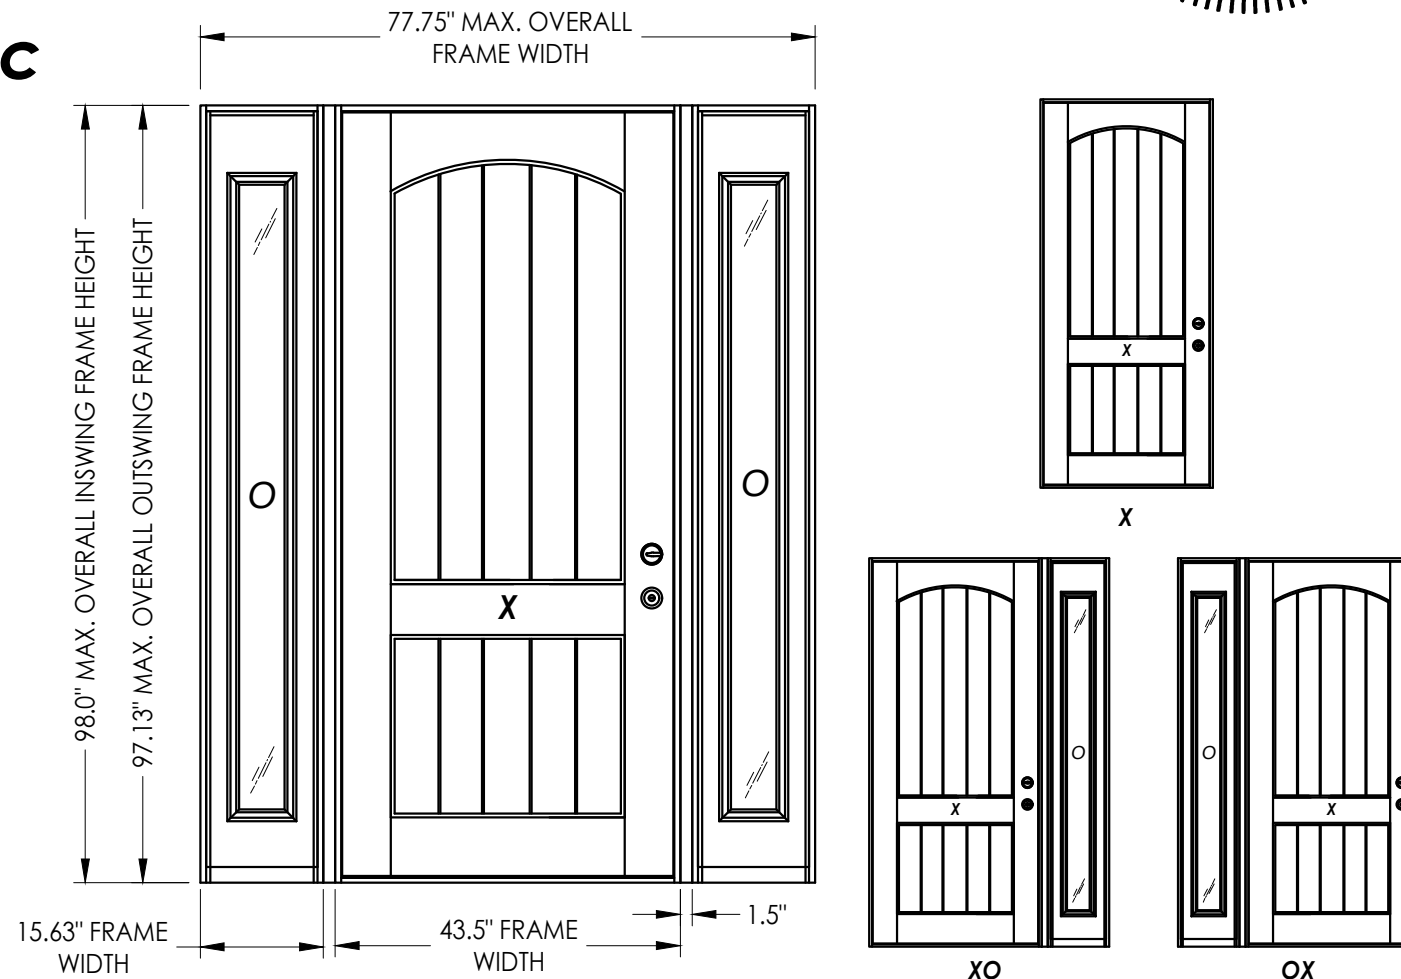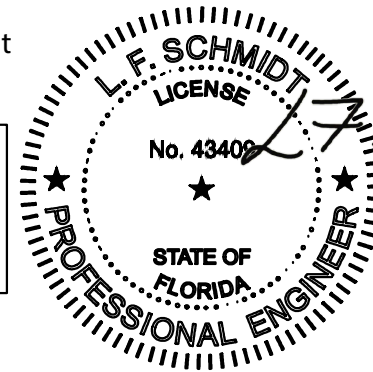

CONFIGURATION	MAX. FRAME DIMENSION	MAX. SIDELITE D.L.O. DIMENSION	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
			POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
X	43.50" x 98.0"	N/A	+60.0	-65.0	+60.0	-60.0
OX or XO (Back to Back Jambs)	59.13" x 98.0"	7.0" X 79.0"	+30.0	-30.0	+30.0	-30.0
OX or XO (1X Reinforcement)	59.88" x 98.0"	7.0" X 79.0"	+40.0	-40.0	+40.0	-40.0
OX or XO (2X Reinforcement)	60.63" x 98.0"	7.0" X 79.0"	+55.0	-55.0	+55.0	-55.0
OXO (Back to Back Jambs)	74.75" x 98.0"	7.0" X 79.0"	+30.0	-30.0	+30.0	-30.0
OXO (1X Reinforcement)	76.25" x 98.0"	7.0" X 79.0"	+40.0	-40.0	+40.0	-40.0
OXO (2X Reinforcement)	77.75" x 98.0"	7.0" X 79.0"	+55.0	-55.0	+55.0	-55.0

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT: PLASTPRO INC
FIBERGLASS DOOR

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

DATE: 02/15/12

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-15209.1

SHEET 1 OF 13

REVISIONS

6 7/01/26 UPDATE TO 9TH ED. (2026) FBC LFS


5 8/14/23 UPDATE TO 8TH ED. (2023) FBC LFS

4 8/16/22 REVISE DOOR PANEL LFS

NO. DATE BY

© 2012 R.W. BUILDING CONSULTANTS INC.

G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-15209 R7\FL-15209.1-2.dwg

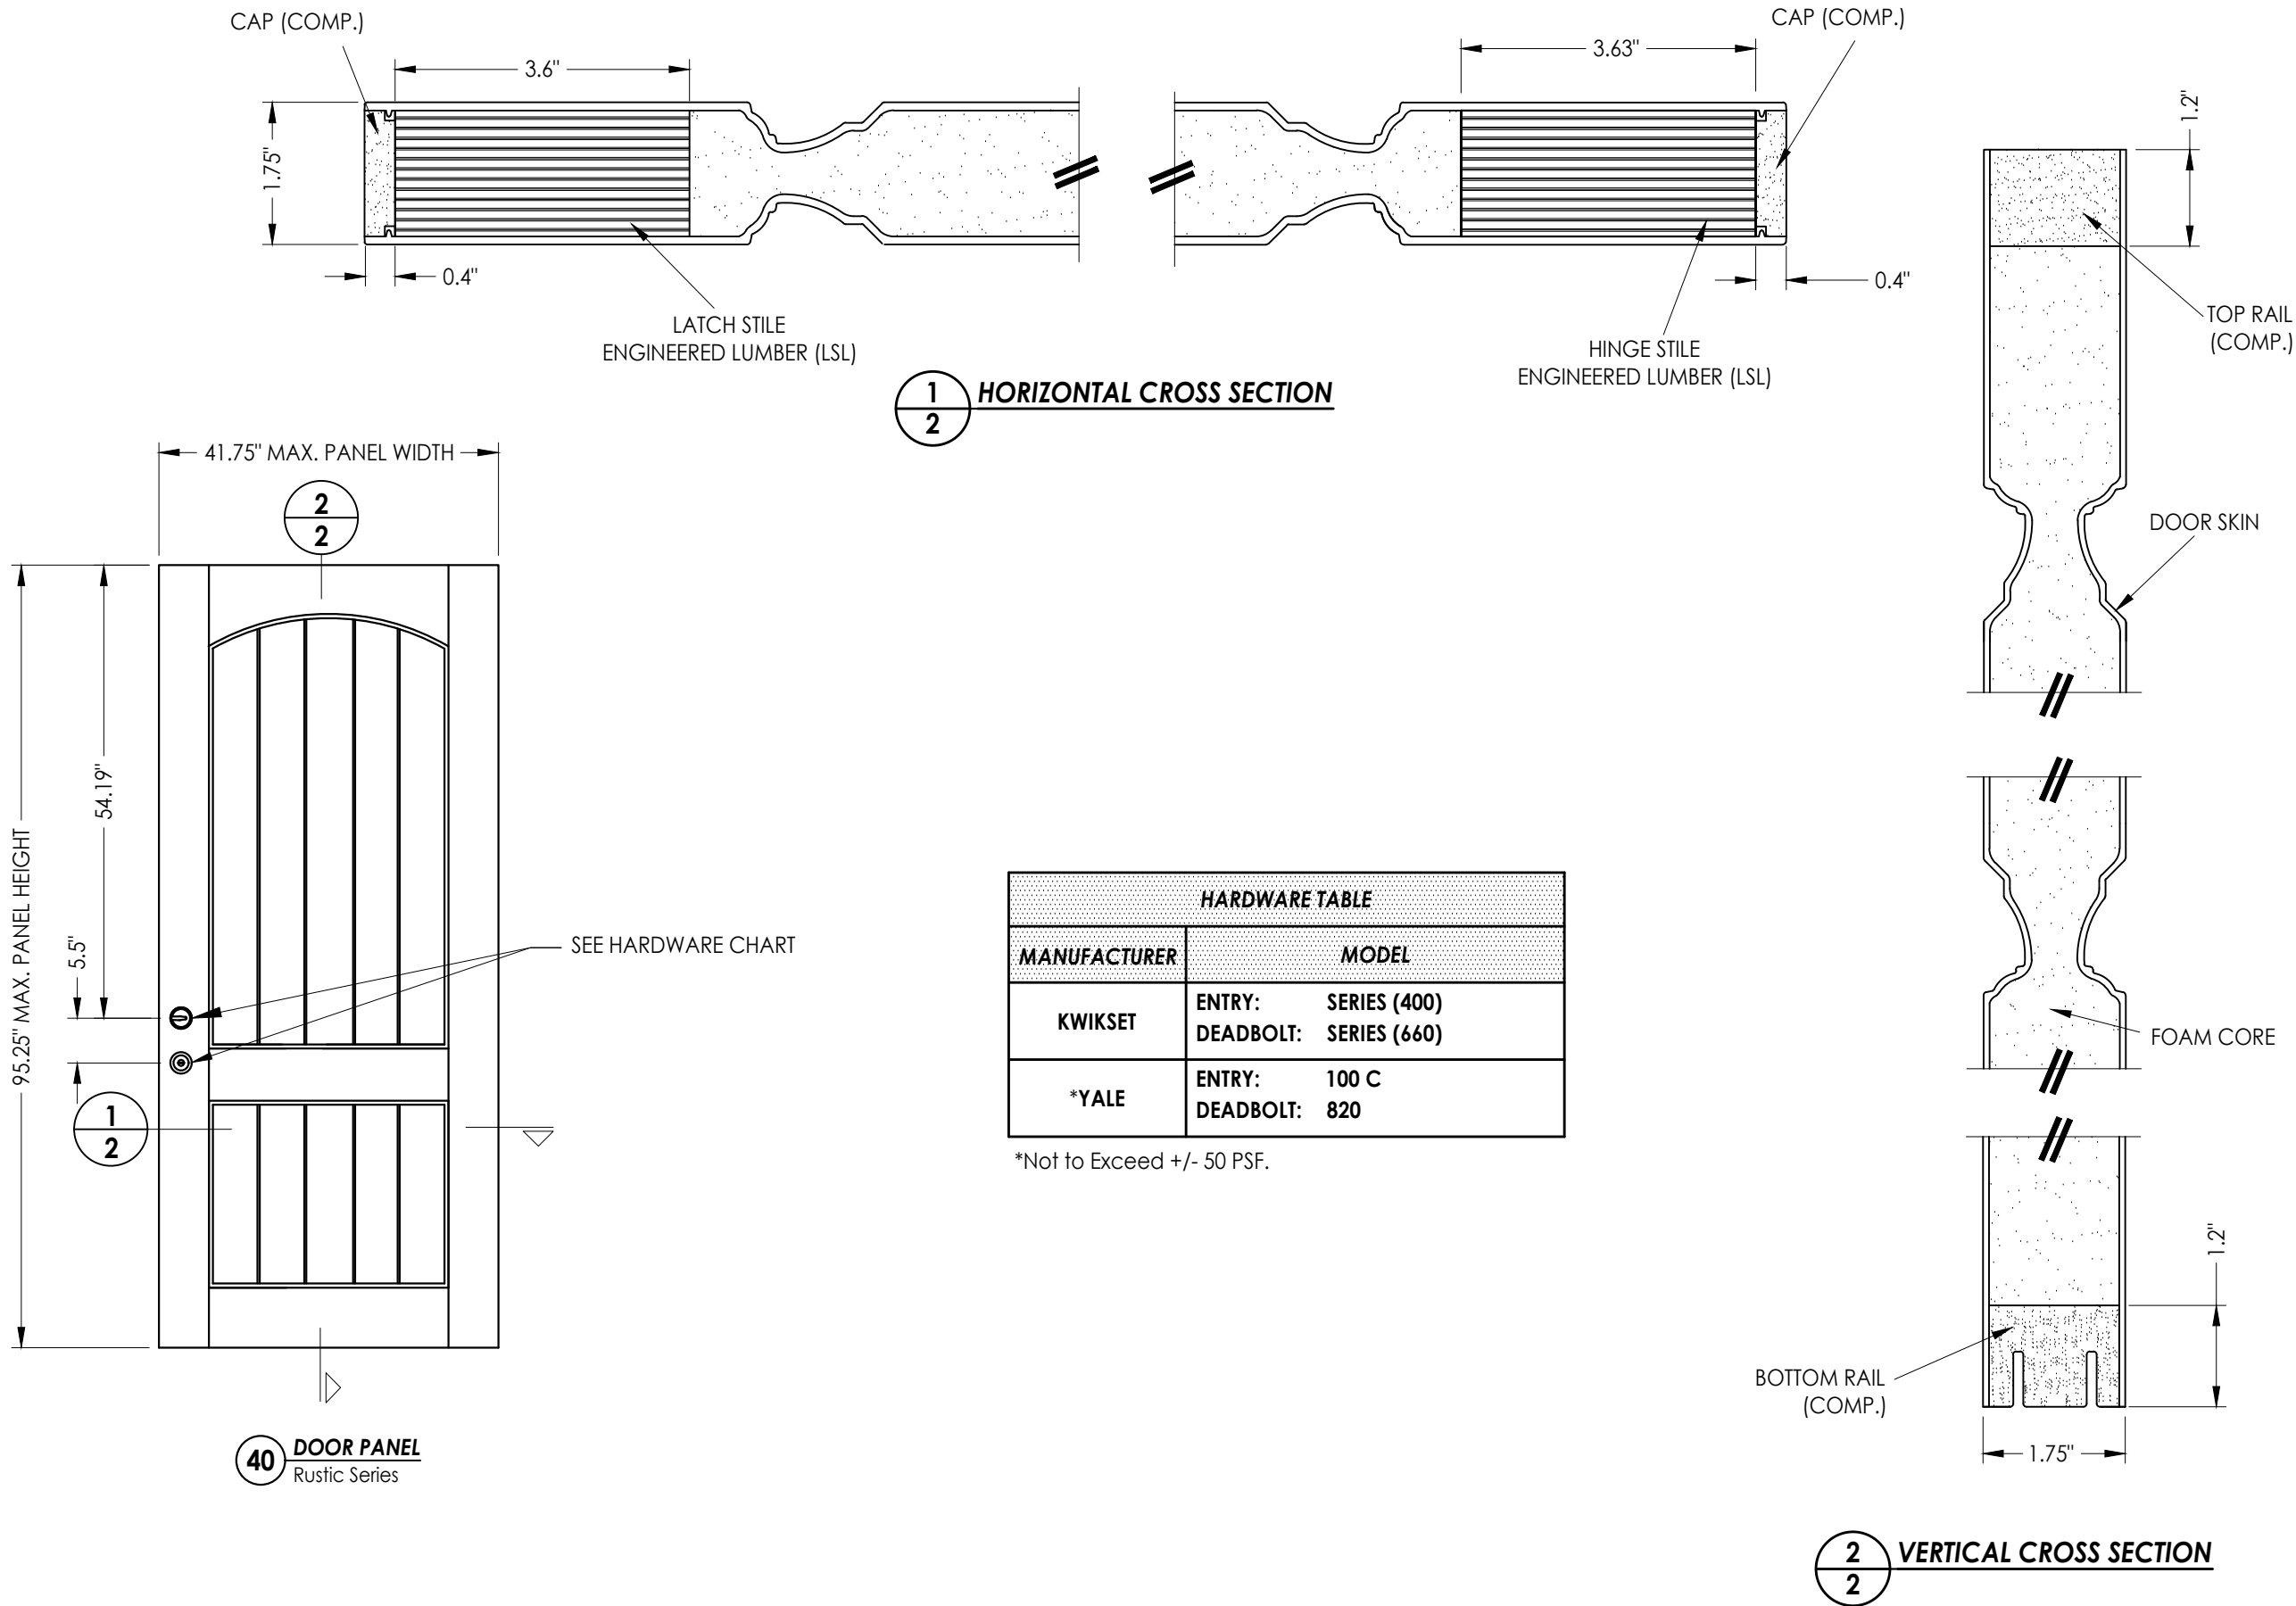

FIBERGLASS DOOR SKIN: MIN. 0.100" THK.
CORE MATERIAL: POLYURETHANE FOAM (1.9 PCF MIN.)

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409				BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
PRODUCT: PLASTPRO INC FIBERGLASS DOOR				PART OR ASSEMBLY: DOOR PANEL DETAILS			
			LFS				BY
		6	7/01/26	UPDATE TO 9TH ED. (2026)	FBC		
		5	8/14/23	UPDATE TO 8TH ED. (2023)	FBC		
		4	8/16/22	REVISE DOOR PANEL			
		NO.	DATE				
				REVISIONS			
DATE: 02/15/12							
SCALE: N.T.S.							
DWG. BY: JK							
CHK. BY: LFS							
DRAWING NO.: FL-15209.1							
SHEET 2 OF 13							

EXTERIOR

STILE (LVL)

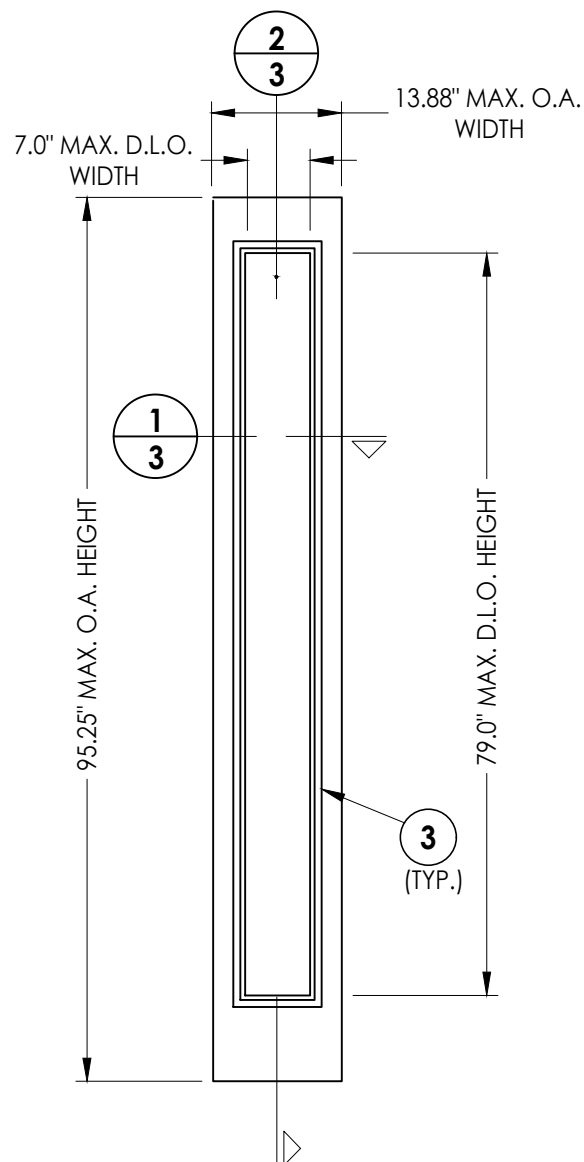


Diagram illustrating the cross-section of a window assembly, showing the exterior and interior views.

Exterior View:


- GLASS BITE 1/2"
- 1/2" GLASS THICKNESS
- 1/8" TEMPERED GLASS
- AIR SPACE
- 1/8" TEMPERED GLASS
- ALUM. GLAZING SPACER

Interior View:

- NON-STRUCTURAL BACKBEDDING SEALANT
- #8 x 1-1/2" PFH LITE FRAME SCREW


NON-STRUCTURAL BACKBEDDING SEALANT

G2 GLAZING DETAIL
RSL Lite Frame
(PVC)

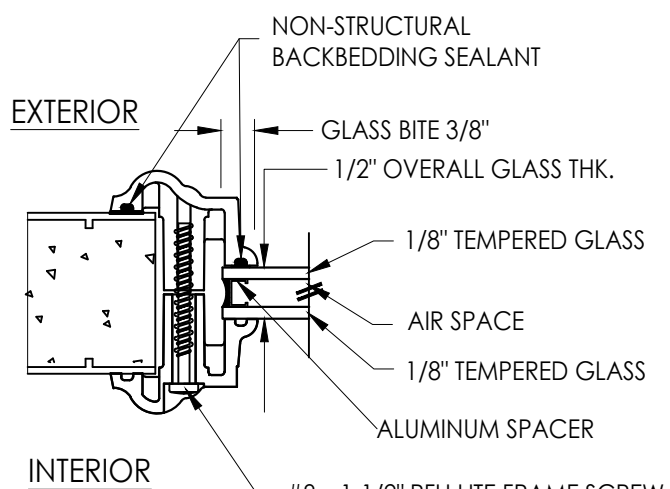RSL Lite Frame
(PVC)


G1 GLAZING DETAIL
ODL Lite Frame
(HP Polypro)

ODL Lite Frame
(HP Polypro)

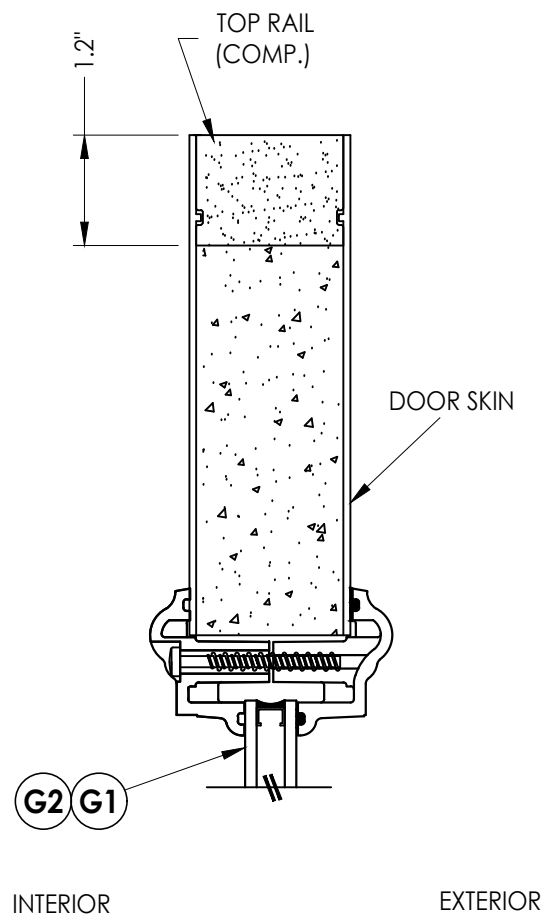

INTERIOR

EXTERIOR

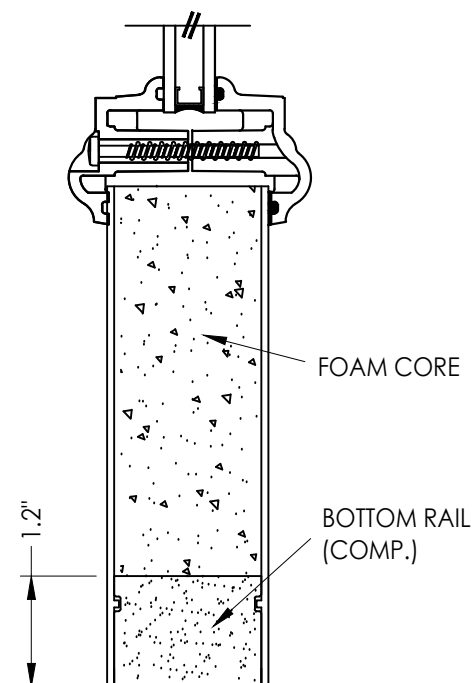

2 VERTICAL CROSS SECTION

FIBERGLASS DOOR SKIN: MIN. 0.075" THK.
CORE MATERIAL: POLYURETHANE FOAM (1.9 PCF MIN.)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R^W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: PLASTPRO INC
FIBERGLASS DOOR

PART OR ASSEMBLY:
**SIDELITE PANEL DETAILS
& GLAZING DETAIL**

6	7/01/26	UPDATE TO 9TH ED. (2026)	FBC	LFS	
5	8/14/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	
4	8/16/22	REVISE DOOR PANEL		LFS	
NO.	DATE			BY	
					REVISIONS

DATE: 02/15/12

SCALE: *N.T.S.*

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:


FL-15209.1

© 2012 R.W. BUILDING CONSULTANTS INC.


G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-15209 R7\FL-15209.1-2.dwg

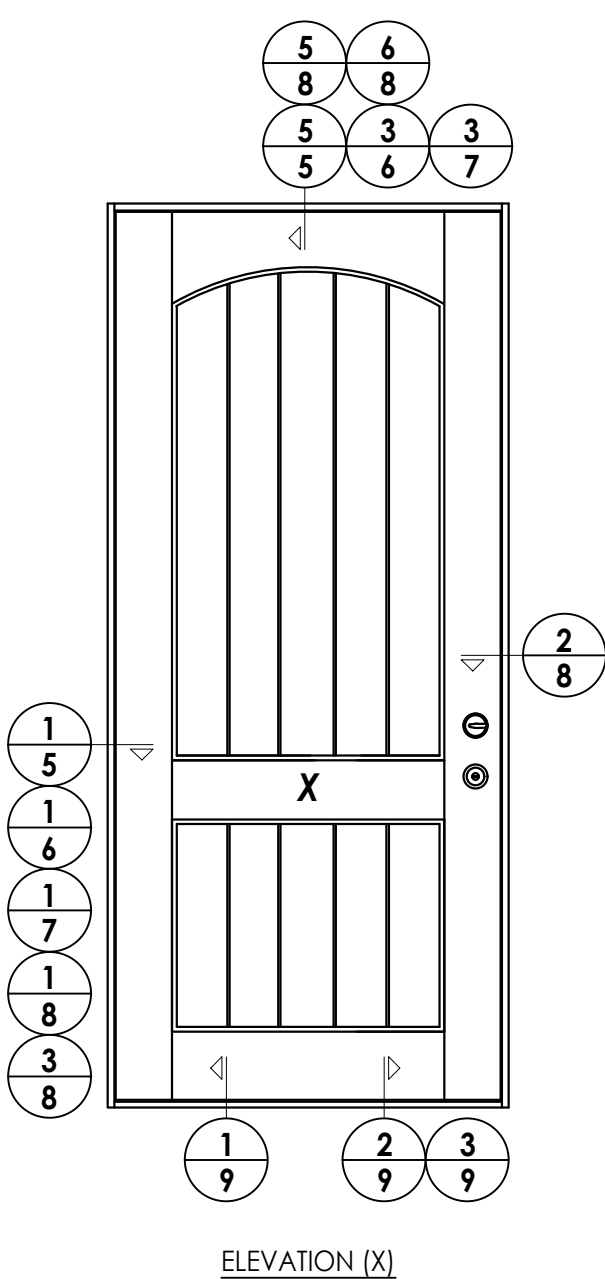

ELEVATION (X)

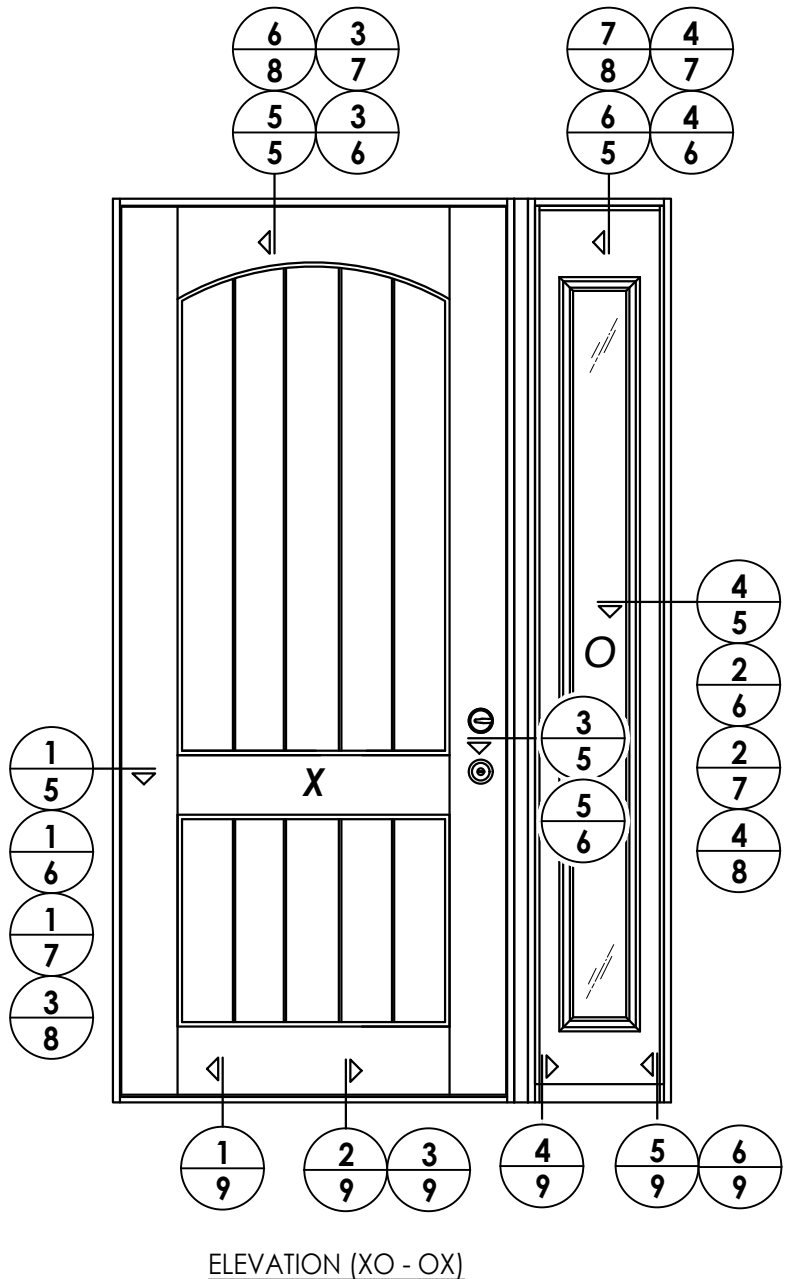

ELEVATION (XO - OX)

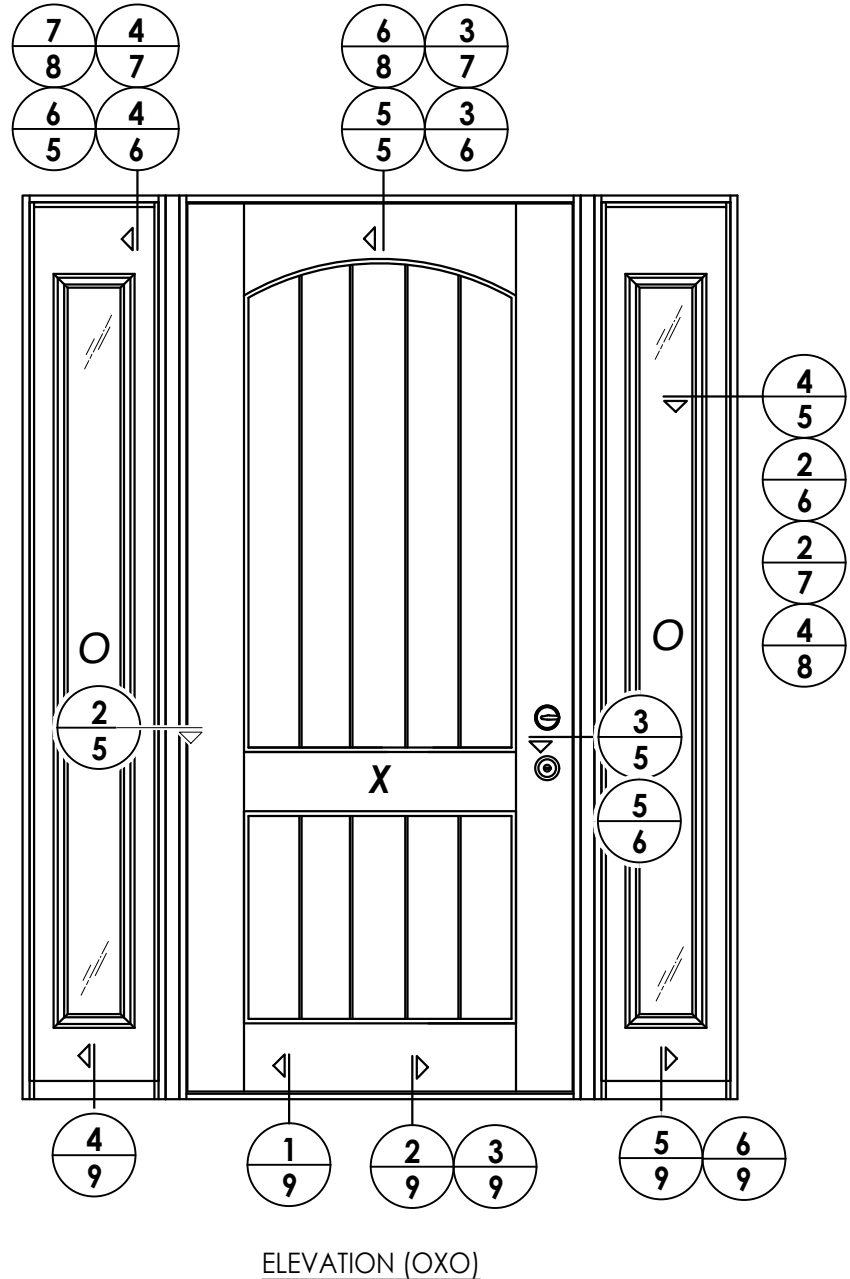

ELEVATION (OXO)

NO.	DATE	REVISIONS	BY
6	7/01/26	UPDATE TO 9TH ED. (2026) FBC	LFS
5	8/14/23	UPDATE TO 8TH ED. (2023) FBC	LFS
4	8/16/22	REVISE DOOR PANEL	LFS

DATE: 02/15/12

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-15209.1

SHEET 4 OF 13


PRODUCT: PLASTPRO INC
FIBERGLASS DOOR

PART OR ASSEMBLY:
ELEVATIONS


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-15209 R7\FL-15209.1-2.dwg

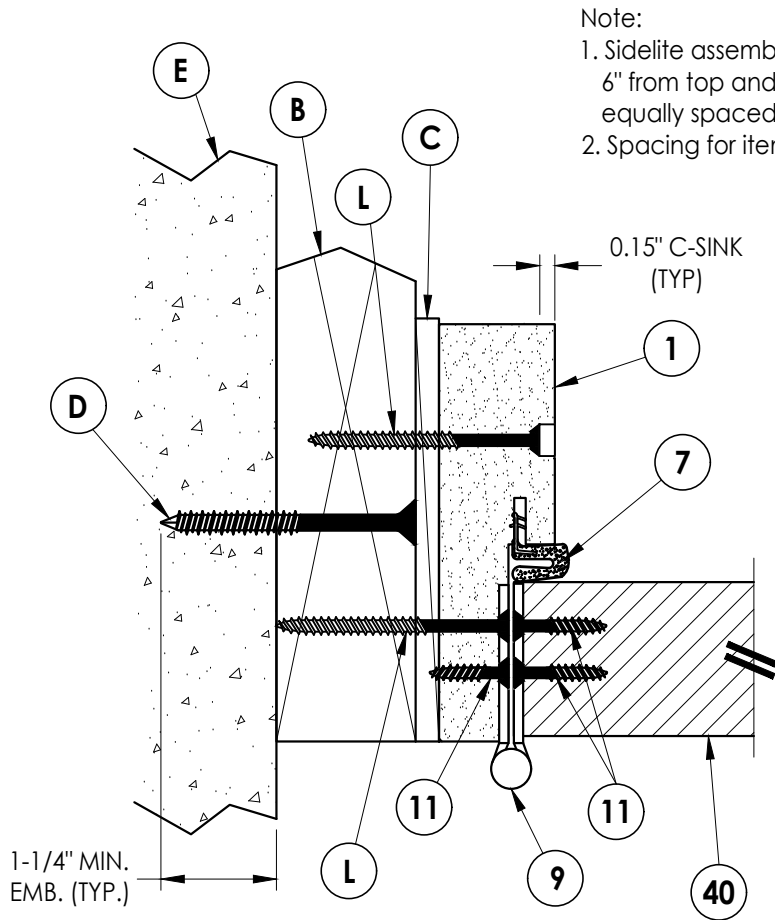


1 **HORIZONTAL CROSS SECTION**
5 Outswing shown (Inswing similar)

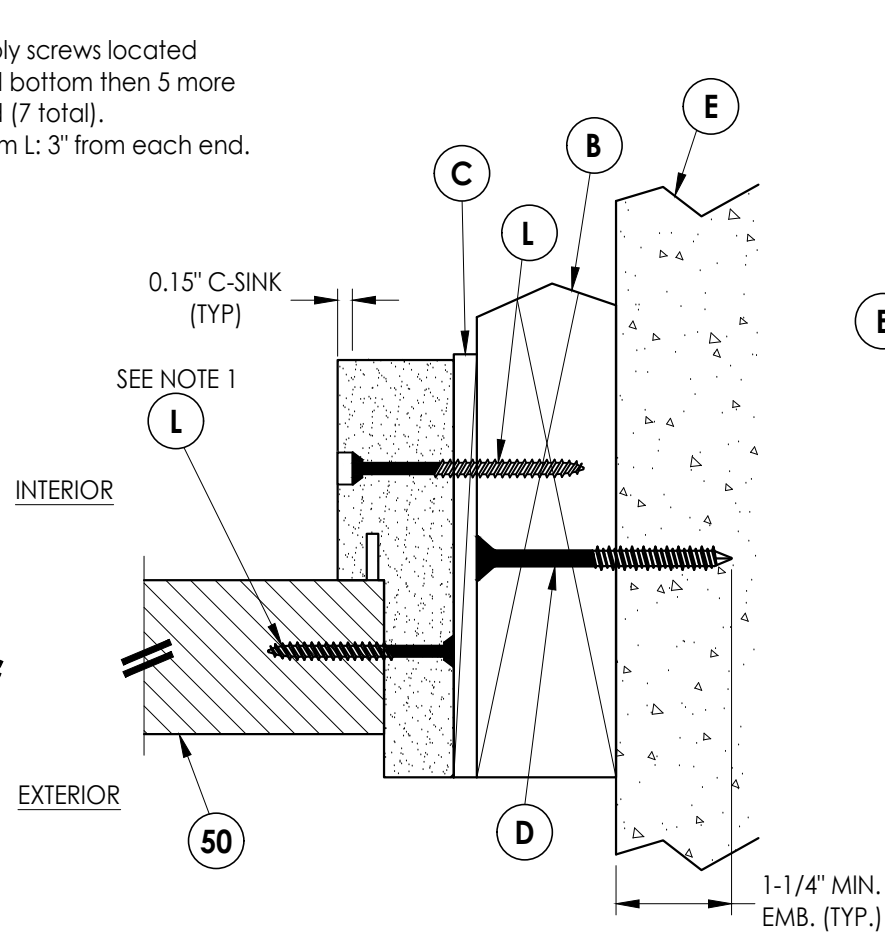


4 **HORIZONTAL CROSS SECTION**
5 Outswing shown (Inswing similar)

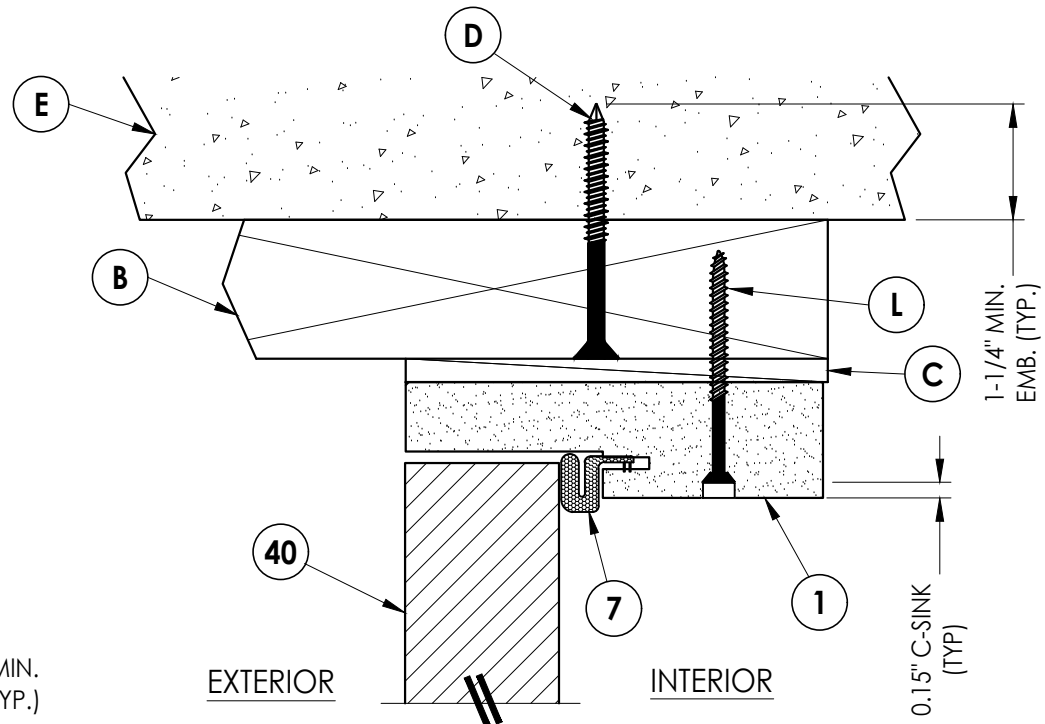


5 **VERTICAL CROSS SECTION**
5 Outswing shown (Inswing similar)

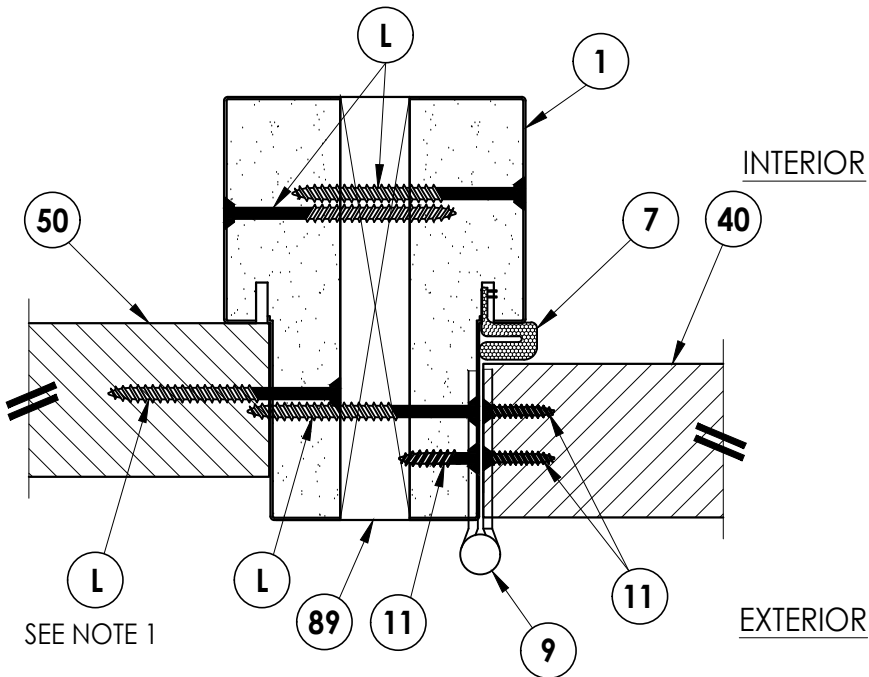

2 **HORIZONTAL CROSS SECTION**
5 Outswing shown - Inswing also approved
Shown with 1X reinforcement

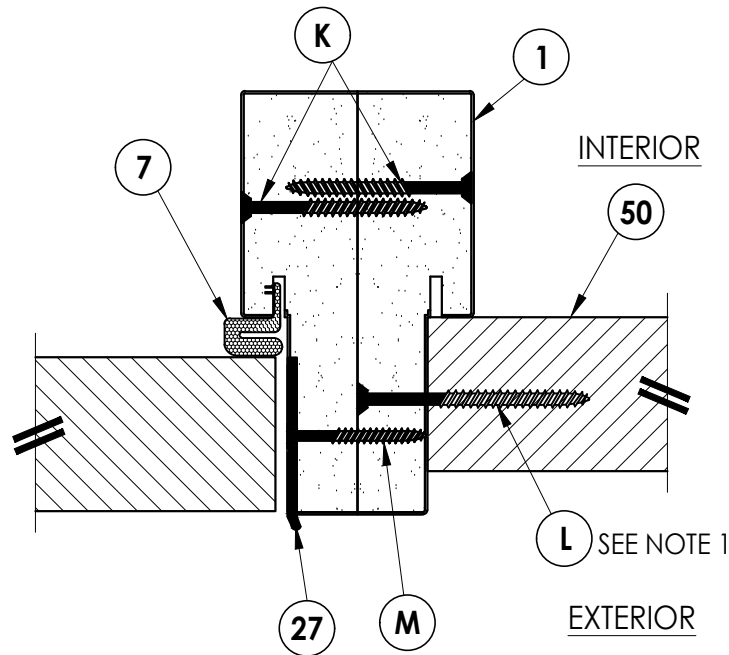

3 **HORIZONTAL CROSS SECTION**
5 Outswing shown - Inswing also approved
Shown with back-to-back jambs

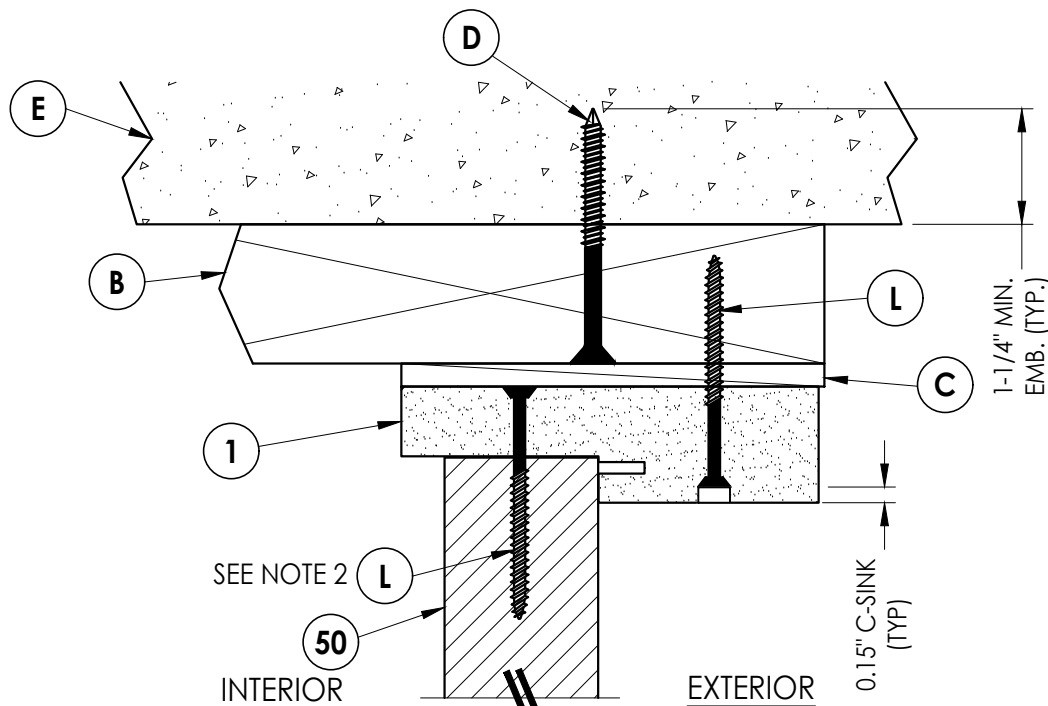

6 **VERTICAL CROSS SECTION**
5 Outswing shown (Inswing similar)

Note:
1. Sidelite assembly screws located
6" from top and bottom then 5 more
equally spaced (7 total).
2. Spacing for item L: 3" from each end.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
PLASTPRO INC
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (2X BUCK)

NO.	DATE	REVISIONS
6	7/01/26	UPDATE TO 9TH ED. (2026) FBC LFS
5	8/14/23	UPDATE TO 8TH ED. (2023) FBC LFS
4	8/16/22	REVISE DOOR PANEL LFS
3		
2		
1		

DATE: 02/15/12

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:

FL-15209.1


SHEET 5 OF 13

G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-15209 R7\FL-15209.1-2.dwg

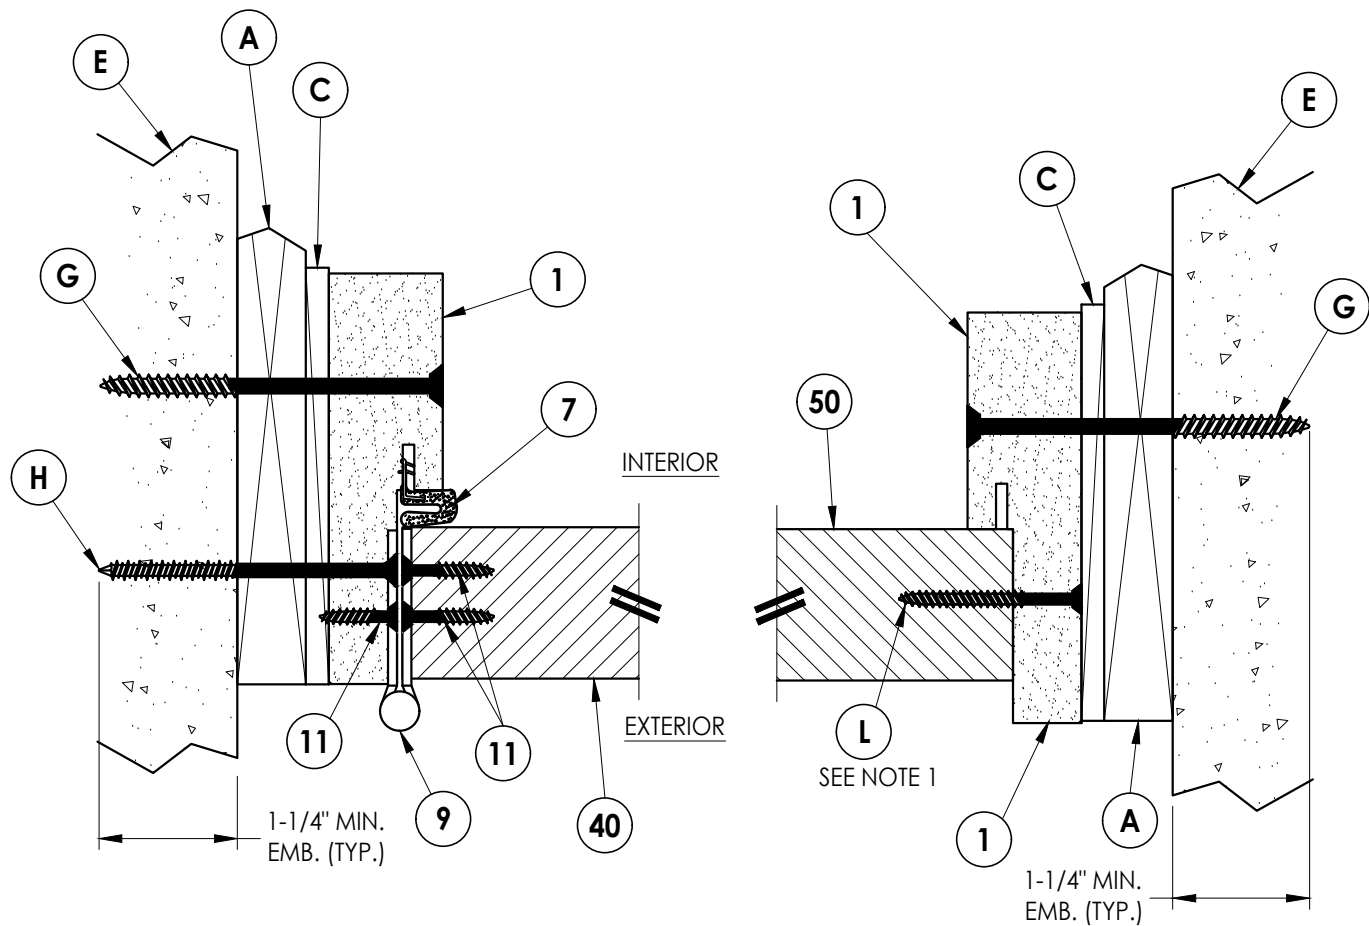


1
6 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

2
6 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

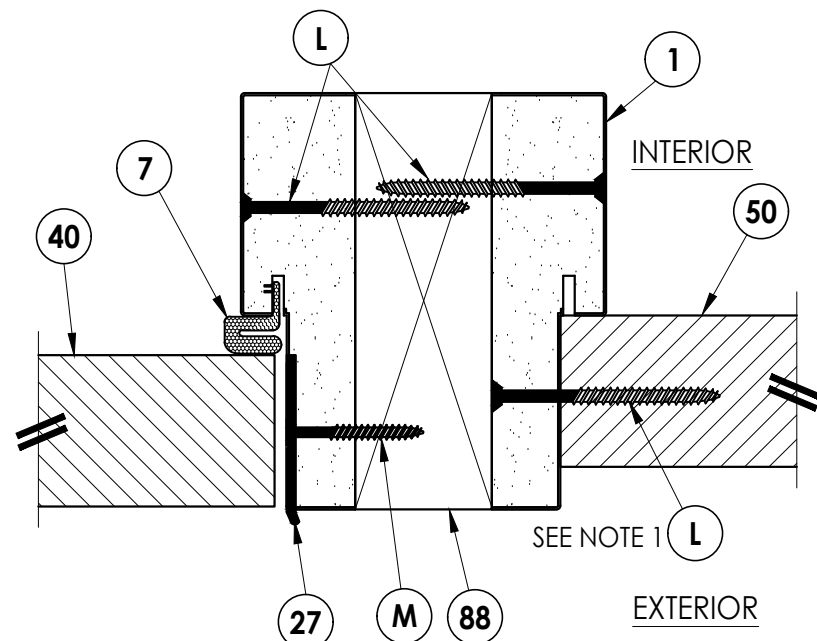


5
6 **HORIZONTAL CROSS SECTION**
Outswing shown - Inswing also approved
Shown with 2X reinforcement

- Note:
- Sidelite assembly screws located 6" from top and bottom then 5 more equally spaced (7 total).
 - Spacing for item L: 3" from each end.

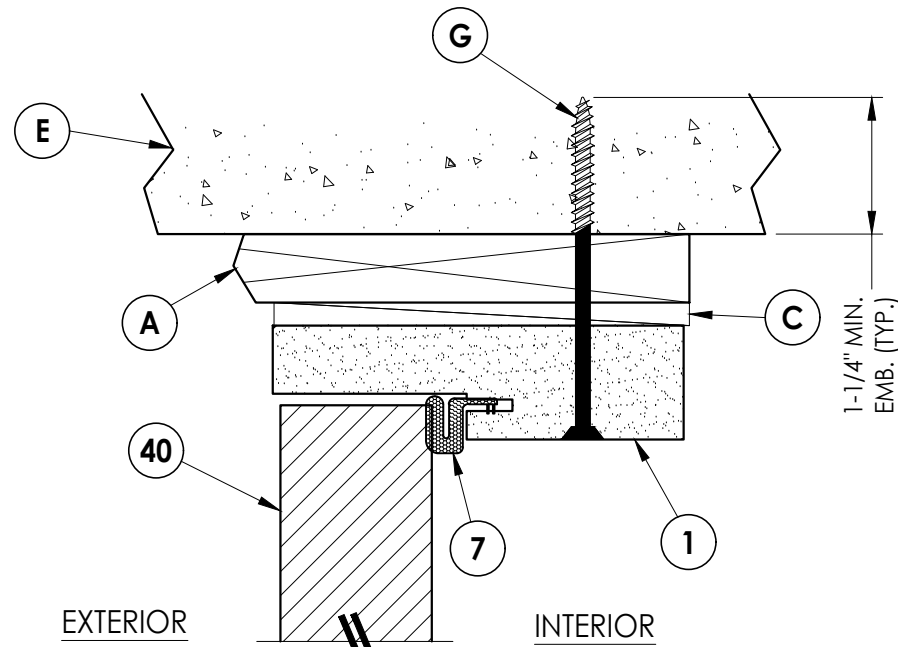

3
6 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

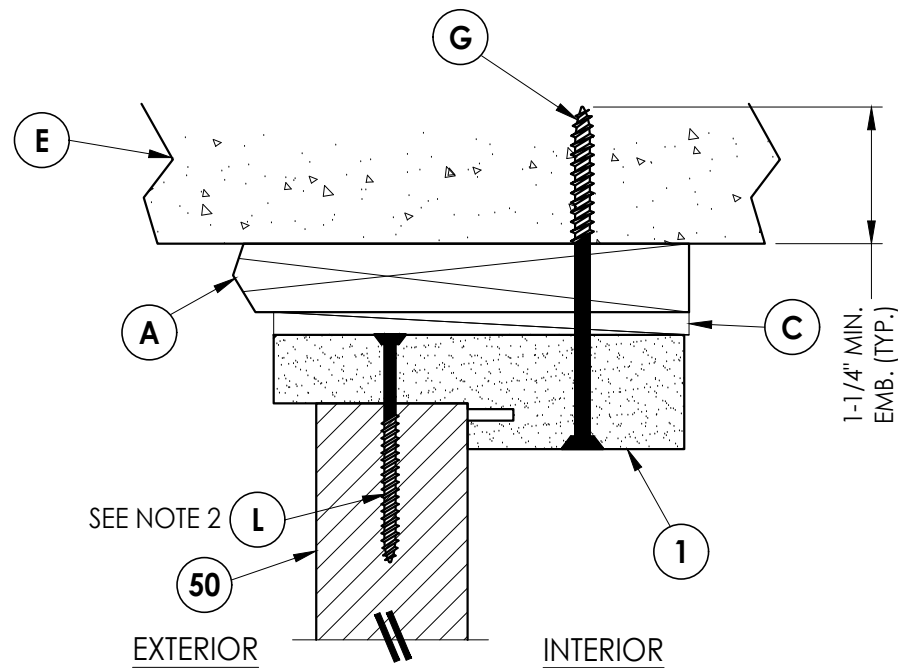

4
6 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: PLASTPRO INC
FIBERGLASS DOOR


PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (1X BUCK)

NO.	DATE	REVISIONS	BY
6	7/01/26	UPDATE TO 9TH ED. (2026)	FBC
5	8/14/23	UPDATE TO 8TH ED. (2023)	FBC
4	8/16/22	REVISE DOOR PANEL	LFS

DATE: 02/15/12
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-15209.1
SHEET 6 OF 13

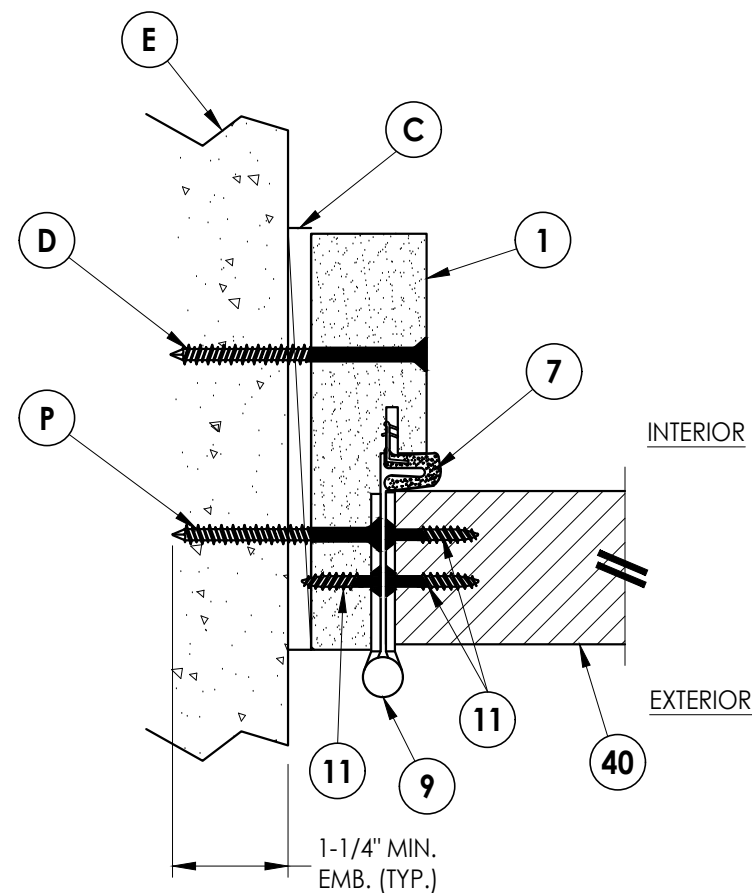

1 **HORIZONTAL CROSS SECTION**
7 Shown Direct to Masonry
 Outswing shown (Inswing similar)

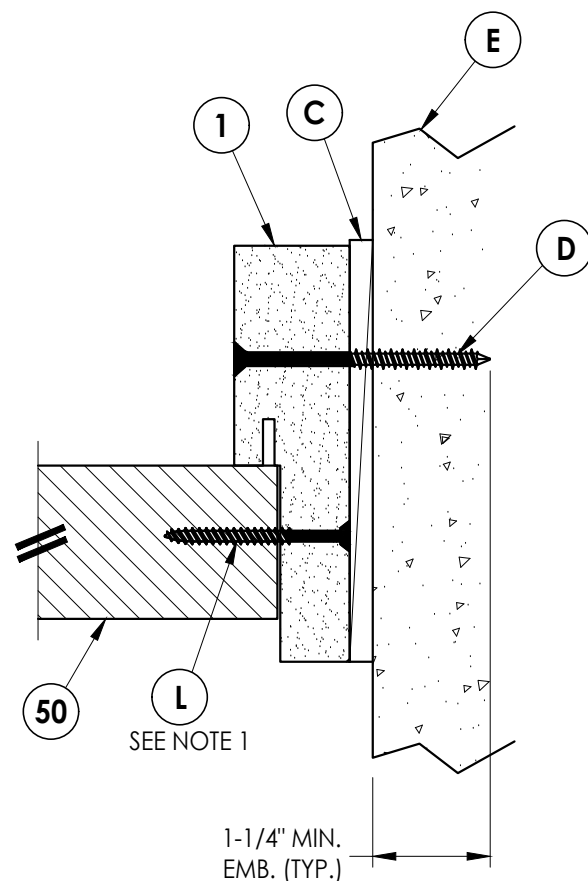


2 7 **HORIZONTAL CROSS SECTION**


Shown Direct to Masonry
Outswing shown (Inswing similar)

Note:

1. Sidelite assembly screws located 6" from top and bottom then 5 more equally spaced (7 total).
2. Spacing for item L: 3" from each end.

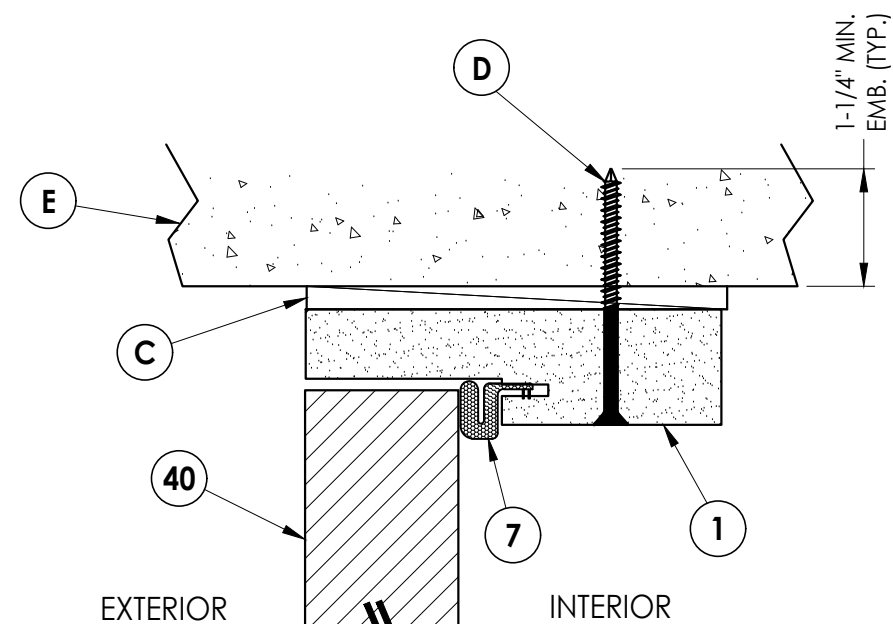


3 **VERTICAL CROSS SECTION**
7 Shown Direct to Masonry
 Outswing shown (Inswing similar)

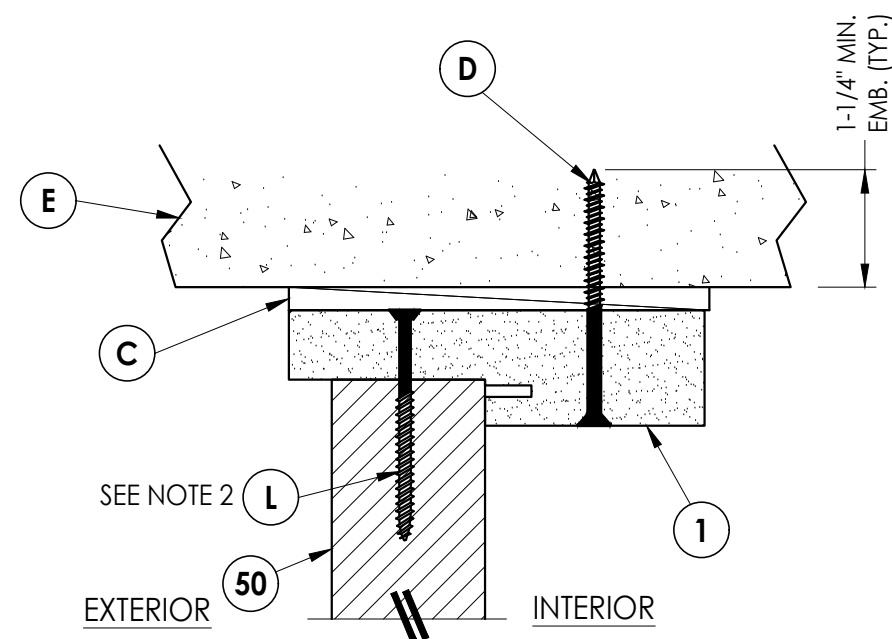


4 **VERTICAL CROSS SECTION**
7 Shown Direct to Masonry
 Outswing shown (Inswing similar)


[illegible]

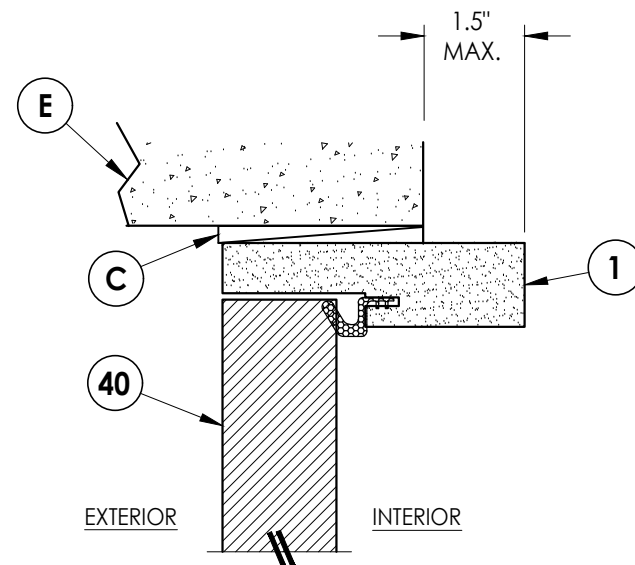

5 **VERTICAL CROSS SECTION**
8 Shown Direct to Masonry
 Outswing only w/ 4-9/16" jamb
 Single Door Only (N/A w/ Sidelites)

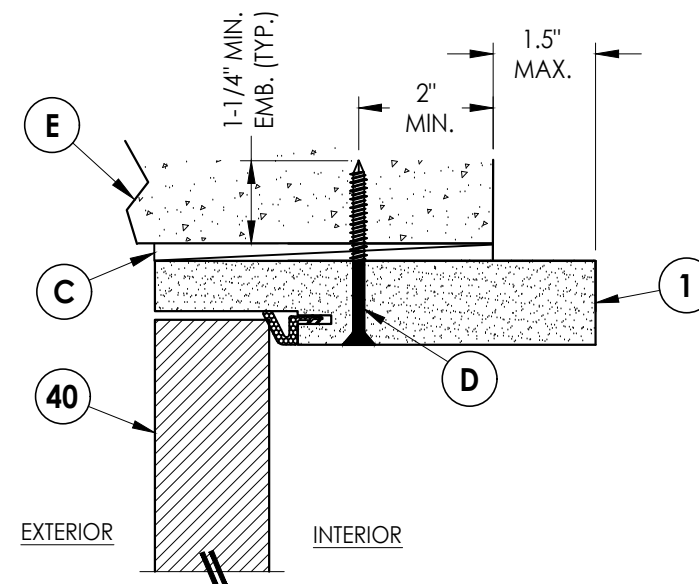


6 **VERTICAL CROSS SECTION**
8 Shown Direct to Masonry
 Outswing only w/ 6-9/16" jamb

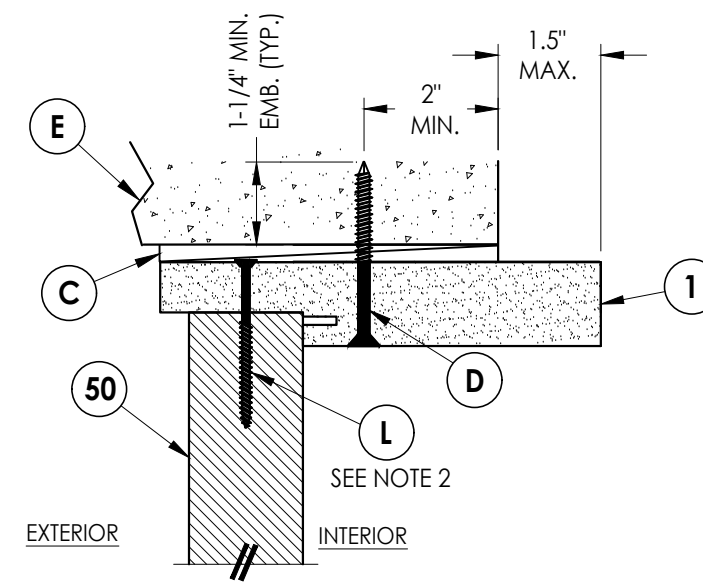

7 VERTICAL CROSS SECTION
8 Shown Direct to Masonry
 Outswing only w/ 6-9/16" jamb


Notes:

1. Spacing for item L: 6" from ends and 5 more equally spaced along sidelite (7 total).
2. Spacing for item L: 3" from each end.

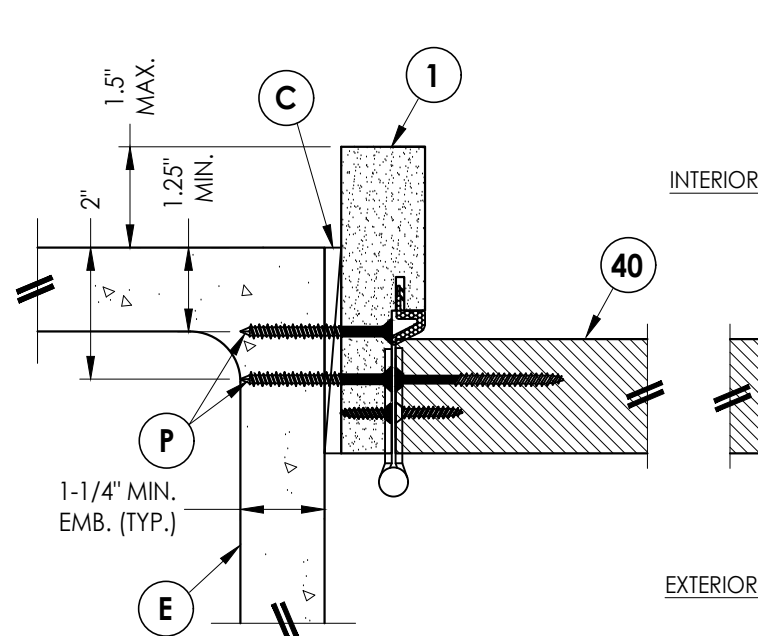


1 8 **HORIZONTAL CROSS SECTION**

Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb
Single Door Only (N/A w/ Sidelites)

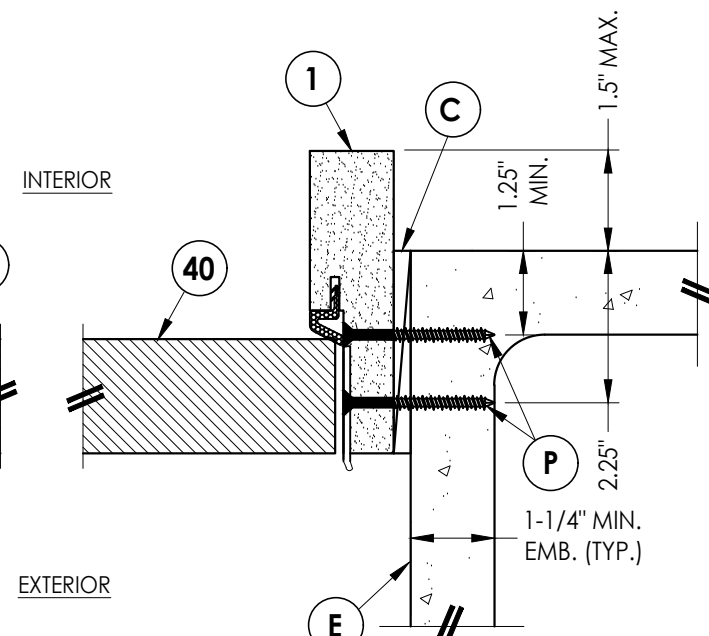


2 8 **HORIZONTAL CROSS SECTION**

Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb
Single Door Only (N/A w/ Sidelites)

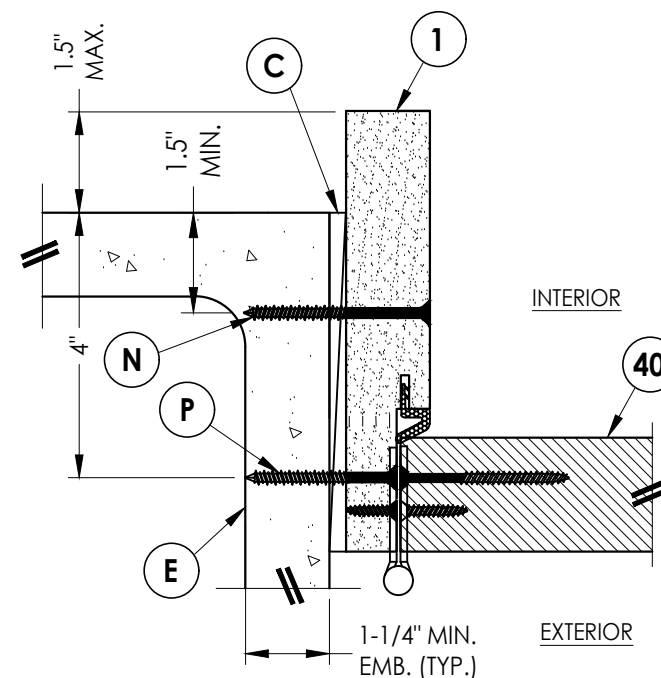


3 **HORIZONTAL CROSS SECTION**
8 Shown Direct to Masonry
 Outswing only w/ 6-9/16" jamb

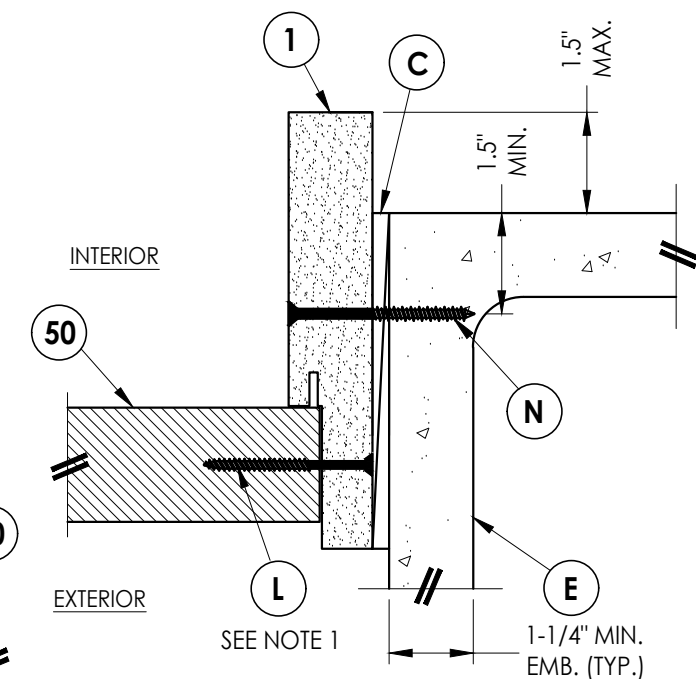


4 **HORIZONTAL CROSS SECTION**
8 Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

[illegible]


G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-15209 R7\FL-15209.1-2.dwg

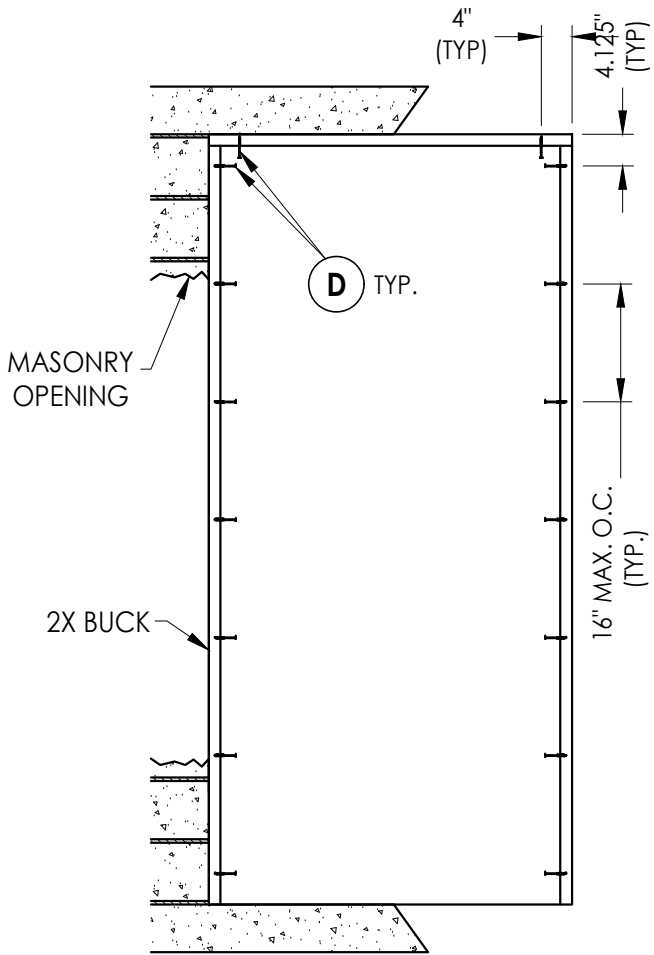


BUCK ANCHORING
(X)

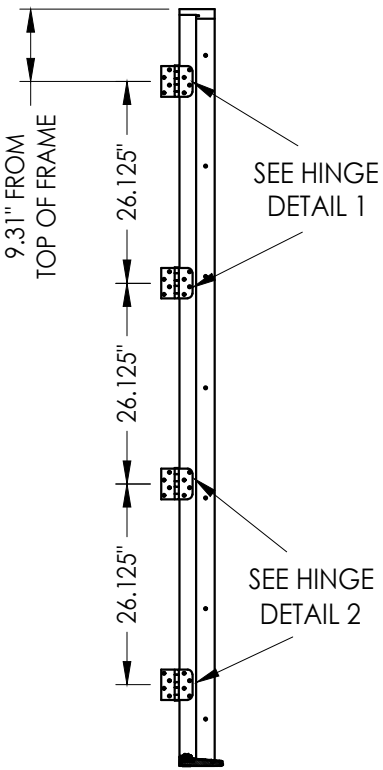

STRIKE JAMB

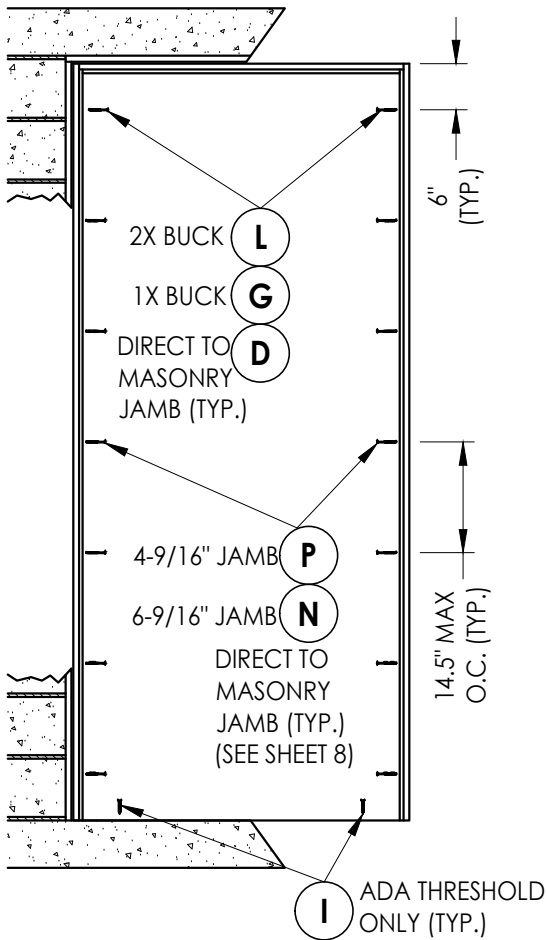

FRAME ANCHORING
(X)

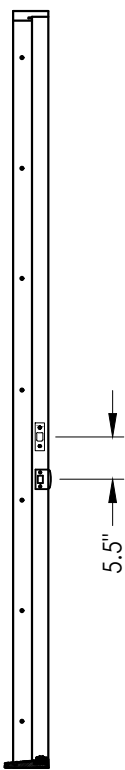

HINGE JAMB

CORROSION RESISTANCE - SALTWATER ENVIRONMENT

Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or R332.1.


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:


- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

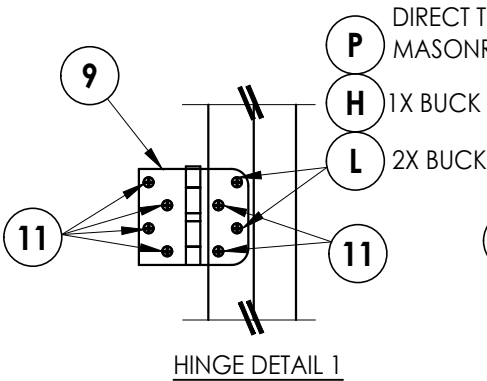

HINGE DETAIL 1

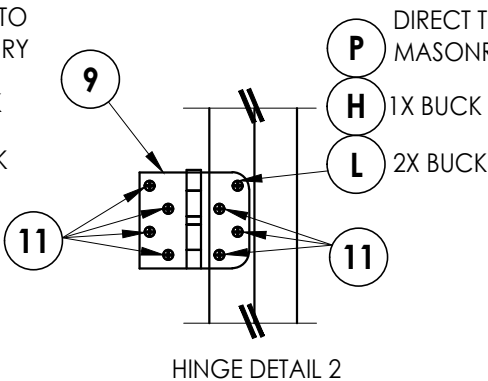

HINGE DETAIL 2

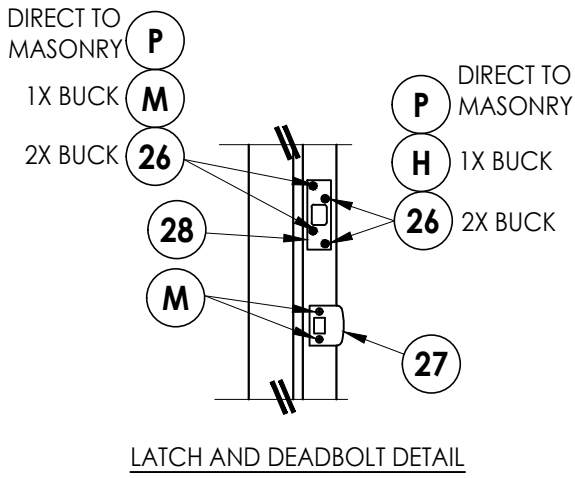

LATCH AND DEADBOLT DETAIL

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: **PLASTPRO INC FIBERGLASS DOOR**

PART OR ASSEMBLY:
BUCK AND FRAME ANCHORING

NO.	DATE	REVISIONS
6	7/01/26	UPDATE TO 9TH ED. (2026) FBC
5	8/14/23	UPDATE TO 8TH ED. (2023) FBC
4	8/16/22	REVISE DOOR PANEL
3		
2		
1		

DATE: 02/15/12

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS


DRAWING NO.:

FL-15209.1

SHEET 10 OF 13

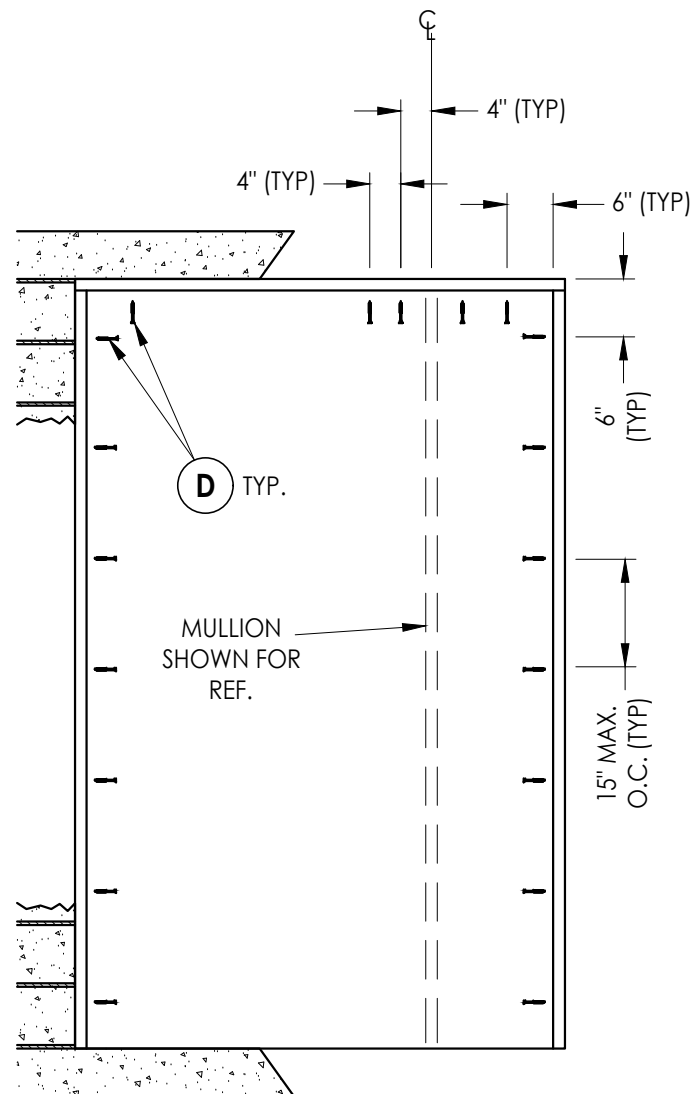

BUCK ANCHORING
OX

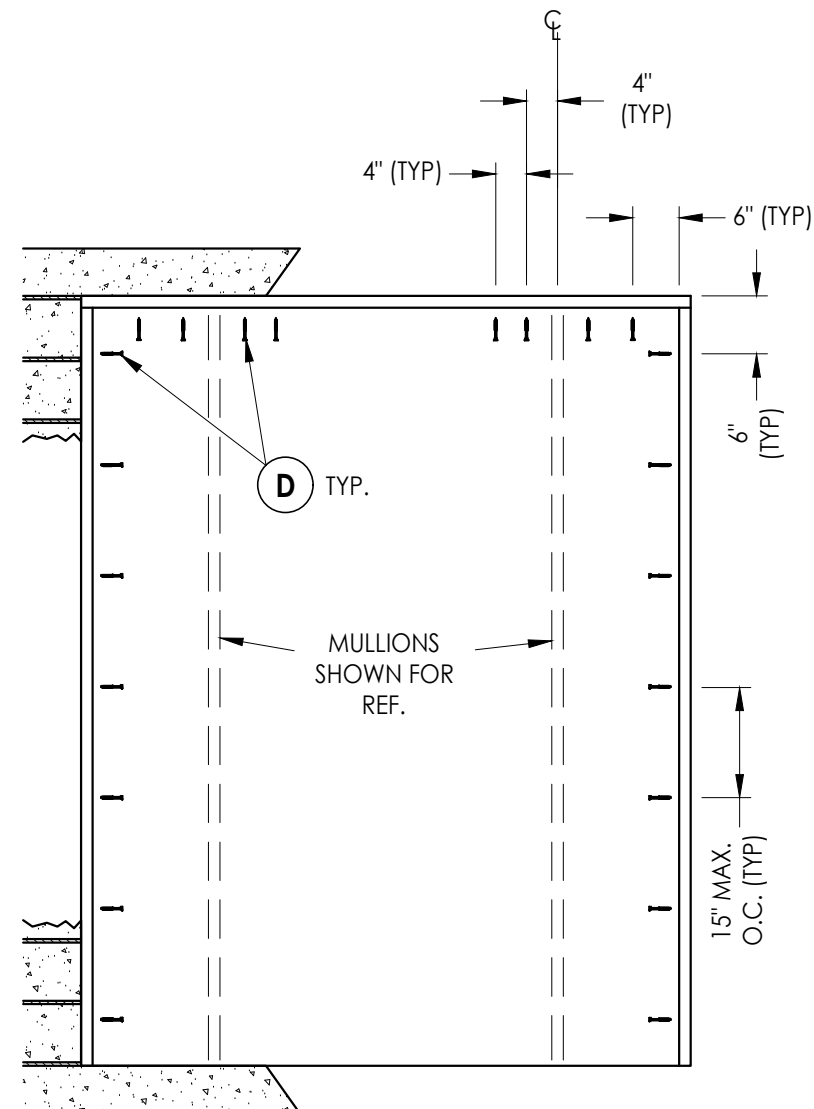

BUCK ANCHORING
OXO

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRA-CON®	1/4"	1-1/4"	1"	4"

6	7/01/26	UPDATE TO 9TH ED.	(2026)	FBC	LFS
5	8/14/23	UPDATE TO 8TH ED.	(2023)	FBC	LFS
4	8/16/22	REVISE DOOR PANEL			LFS
NO.	DATE				BY
REVISIONS					

DATE: 02/15/12

SCALE: *N.T.S.*

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:


FL-15209.1

SHEET 11 OF 13

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-15209 R7\FL-15209.1-2.dwg

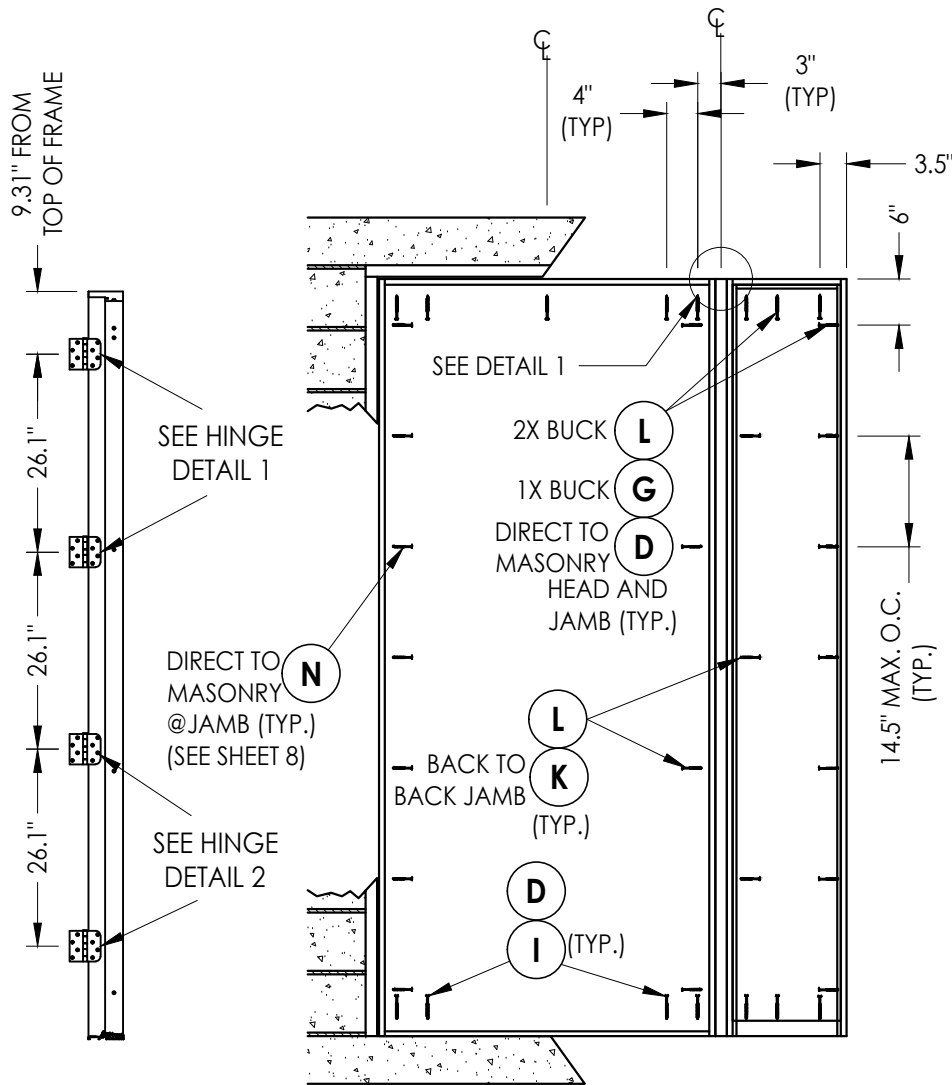

HINGE JAMB

FRAME ANCHORING
OX

CORROSION RESISTANCE - SALTWATER ENVIRONMENT

Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or R332.1.


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRA-CON®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	3"	1-1/2"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

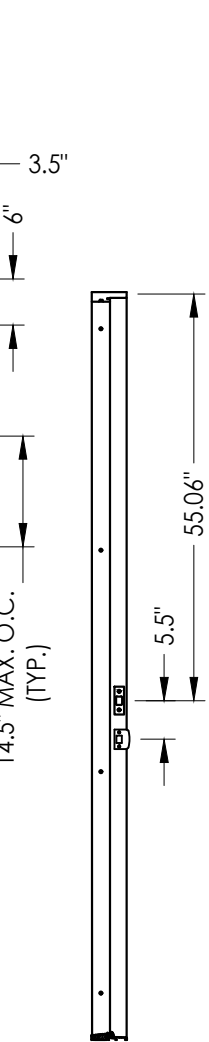


STRIKE MULLION


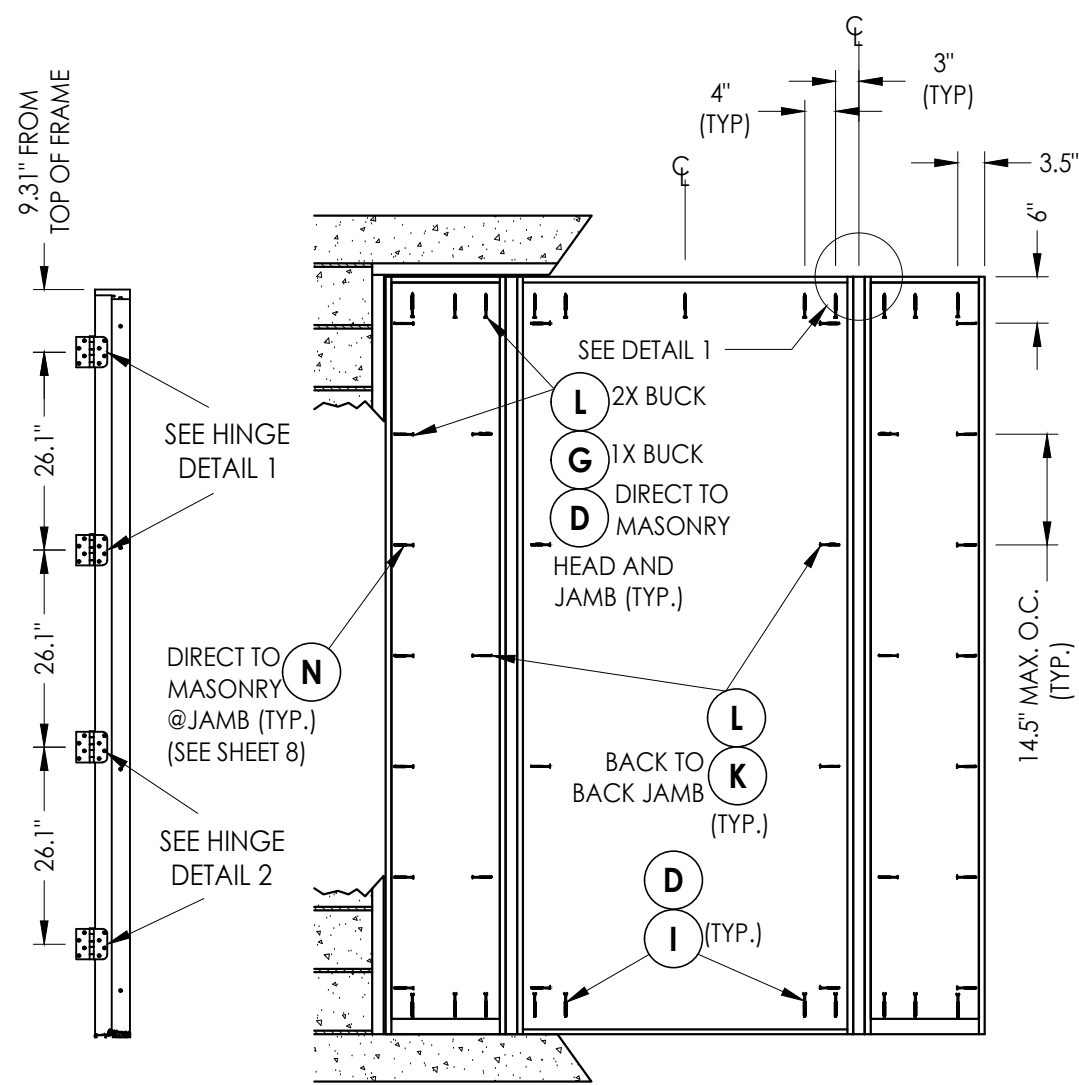


HINGE MULLION

FRAME ANCHORING
OXO

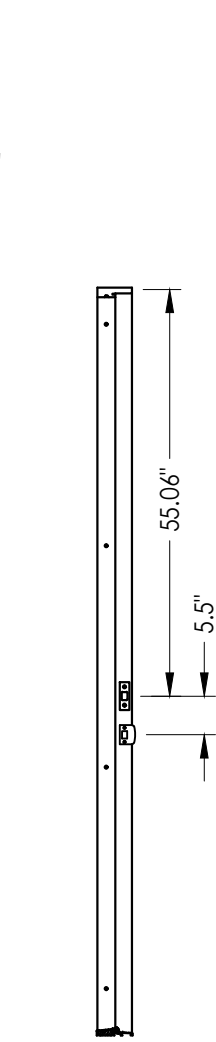

STRIKE MULLION

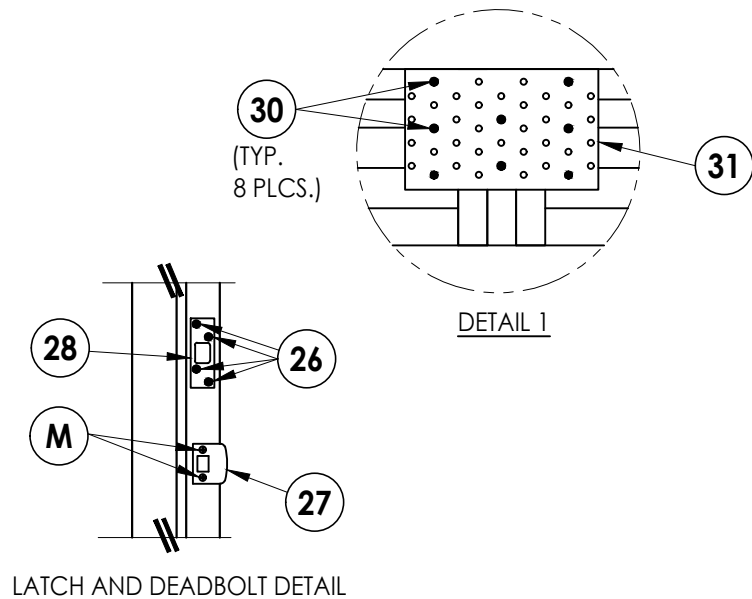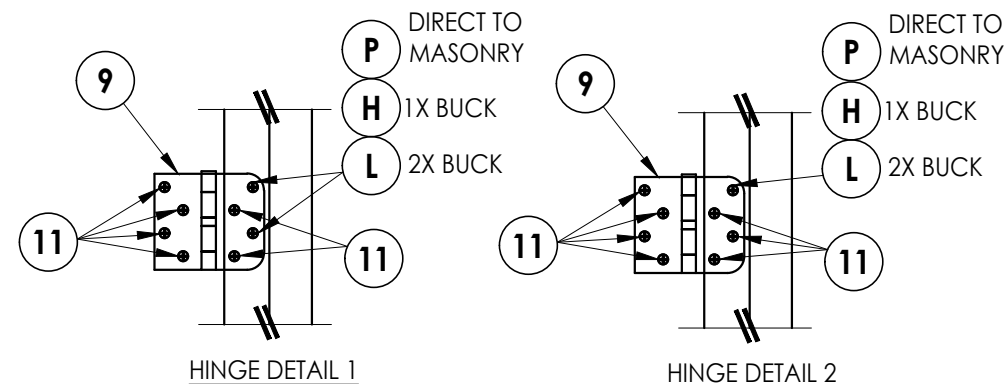

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
PLASTPRO INC
FIBERGLASS DOOR

PART OR ASSEMBLY:
FRAME ANCHORING

NO.	DATE	REVISIONS
6	7/01/26	UPDATE TO 9TH ED. (2026) FBC
5	8/14/23	UPDATE TO 8TH ED. (2023) FBC
4	8/16/22	REVISE DOOR PANEL
3		
2		
1		

DATE: 02/15/12

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:


FL-15209.1

SHEET 12 OF 13


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-15209 R7\FL-15209.1-2.dwg


BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK SG >= 0.55	WOOD
B	2X BUCK SG >= 0.55	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
G	1/4" x 3-1/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
H	3/16" x 3-1/4" PFH ITW CONCRETE SCREW	STEEL
I	1/4" X 2-1/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
K	#10 X 2" PFH WOOD SCREW	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL
M	#8 X 1-1/2" PFH WOOD SCREW	STEEL
N	3/16" X 2-3/4" ITW CONCRETE SCREW	STEEL
P	3/16" X 2-1/4" ITW CONCRETE SCREW	STEEL
1	POLY FIBER JAMB	POLY FIBER
7	WEATHERSTRIP	FOAM
8	DOOR BOTTOM SWEEP	VINYL
9	4" X 4" BUTT HINGE	STEEL
11	#9 X 3/4" PFH WOOD SCREW	STEEL
26	#8 X 3" PFH WOOD SCREW	STEEL
27	LATCH STRIKE PLATE	STEEL
28	DEADBOLT STRIKE PLATE (SECURITY)	STEEL
30	#6 X 3/4" PFH WOOD SCREW	STEEL
31	TIE PLATE (7" X 3.125" X 0.09" THICK)	STEEL
33	OUTSWING THRESHOLD	ALUM / COMP
34	INSWING ADJUSTABLE THRESHOLD	ALUM / COMP
35	INSWING SIDELITE ADAPTER	PVC
36	OUTSWING SIDELITE ADAPTER	PVC
40	DOOR PANEL - SEE DOOR PANEL DETAIL SHEET FOR CONSTRUCTION DETAILS	-
46	ADA THRESHOLD	ALUM
50	SIDELITE PANEL - SEE SIDELITE PANEL DETAIL SHEET FOR CONSTRUCTION DETAILS	-
88	2X REINFORCEMENT SG >= 0.55	WOOD
89	1X REINFORCEMENT SG >= 0.55	WOOD

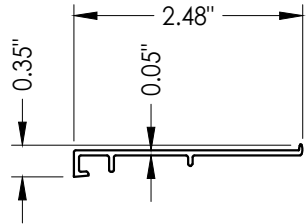


36 **OUTSWING SIDELITE SPACER**
Endura (Z-Series)

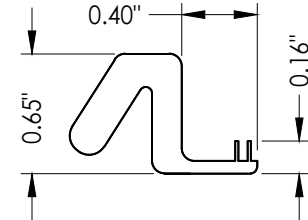


7 **WEATHERSTRIP**
Endura Force 5




8 **DOOR BOTTOM SWEEP**

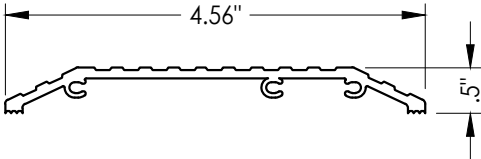


46 **ADA THRESHOLD**
DLP




35 **INSWING SIDELITE SPACER**

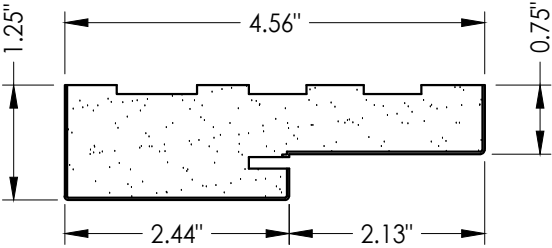

1 **HEAD & SIDE**
Poly fiber jamb

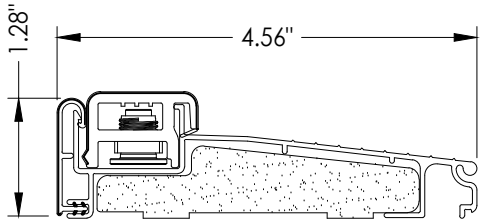

34 **ADJUSTABLE INSWING THRESHOLD**
Endura

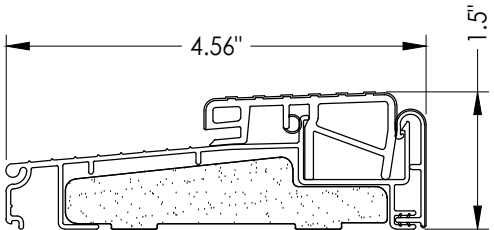

33 **OUTSWING THRESHOLD**
Endura (Z-Series)

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: PLASTPRO INC FIBERGLASS DOOR		PART OR ASSEMBLY: BILL OF MATERIALS AND COMPONENTS	
		LFS	REVISIONS
		FBC	
	7/01/26	UPDATE TO 9TH ED. (2026)	
	5	8/14/23	UPDATE TO 8TH ED. (2023)
	4	8/16/22	REVISE DOOR PANEL
	NO.	DATE	BY
DATE: 02/15/12			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-15209.1			
SHEET 13 OF 13			