


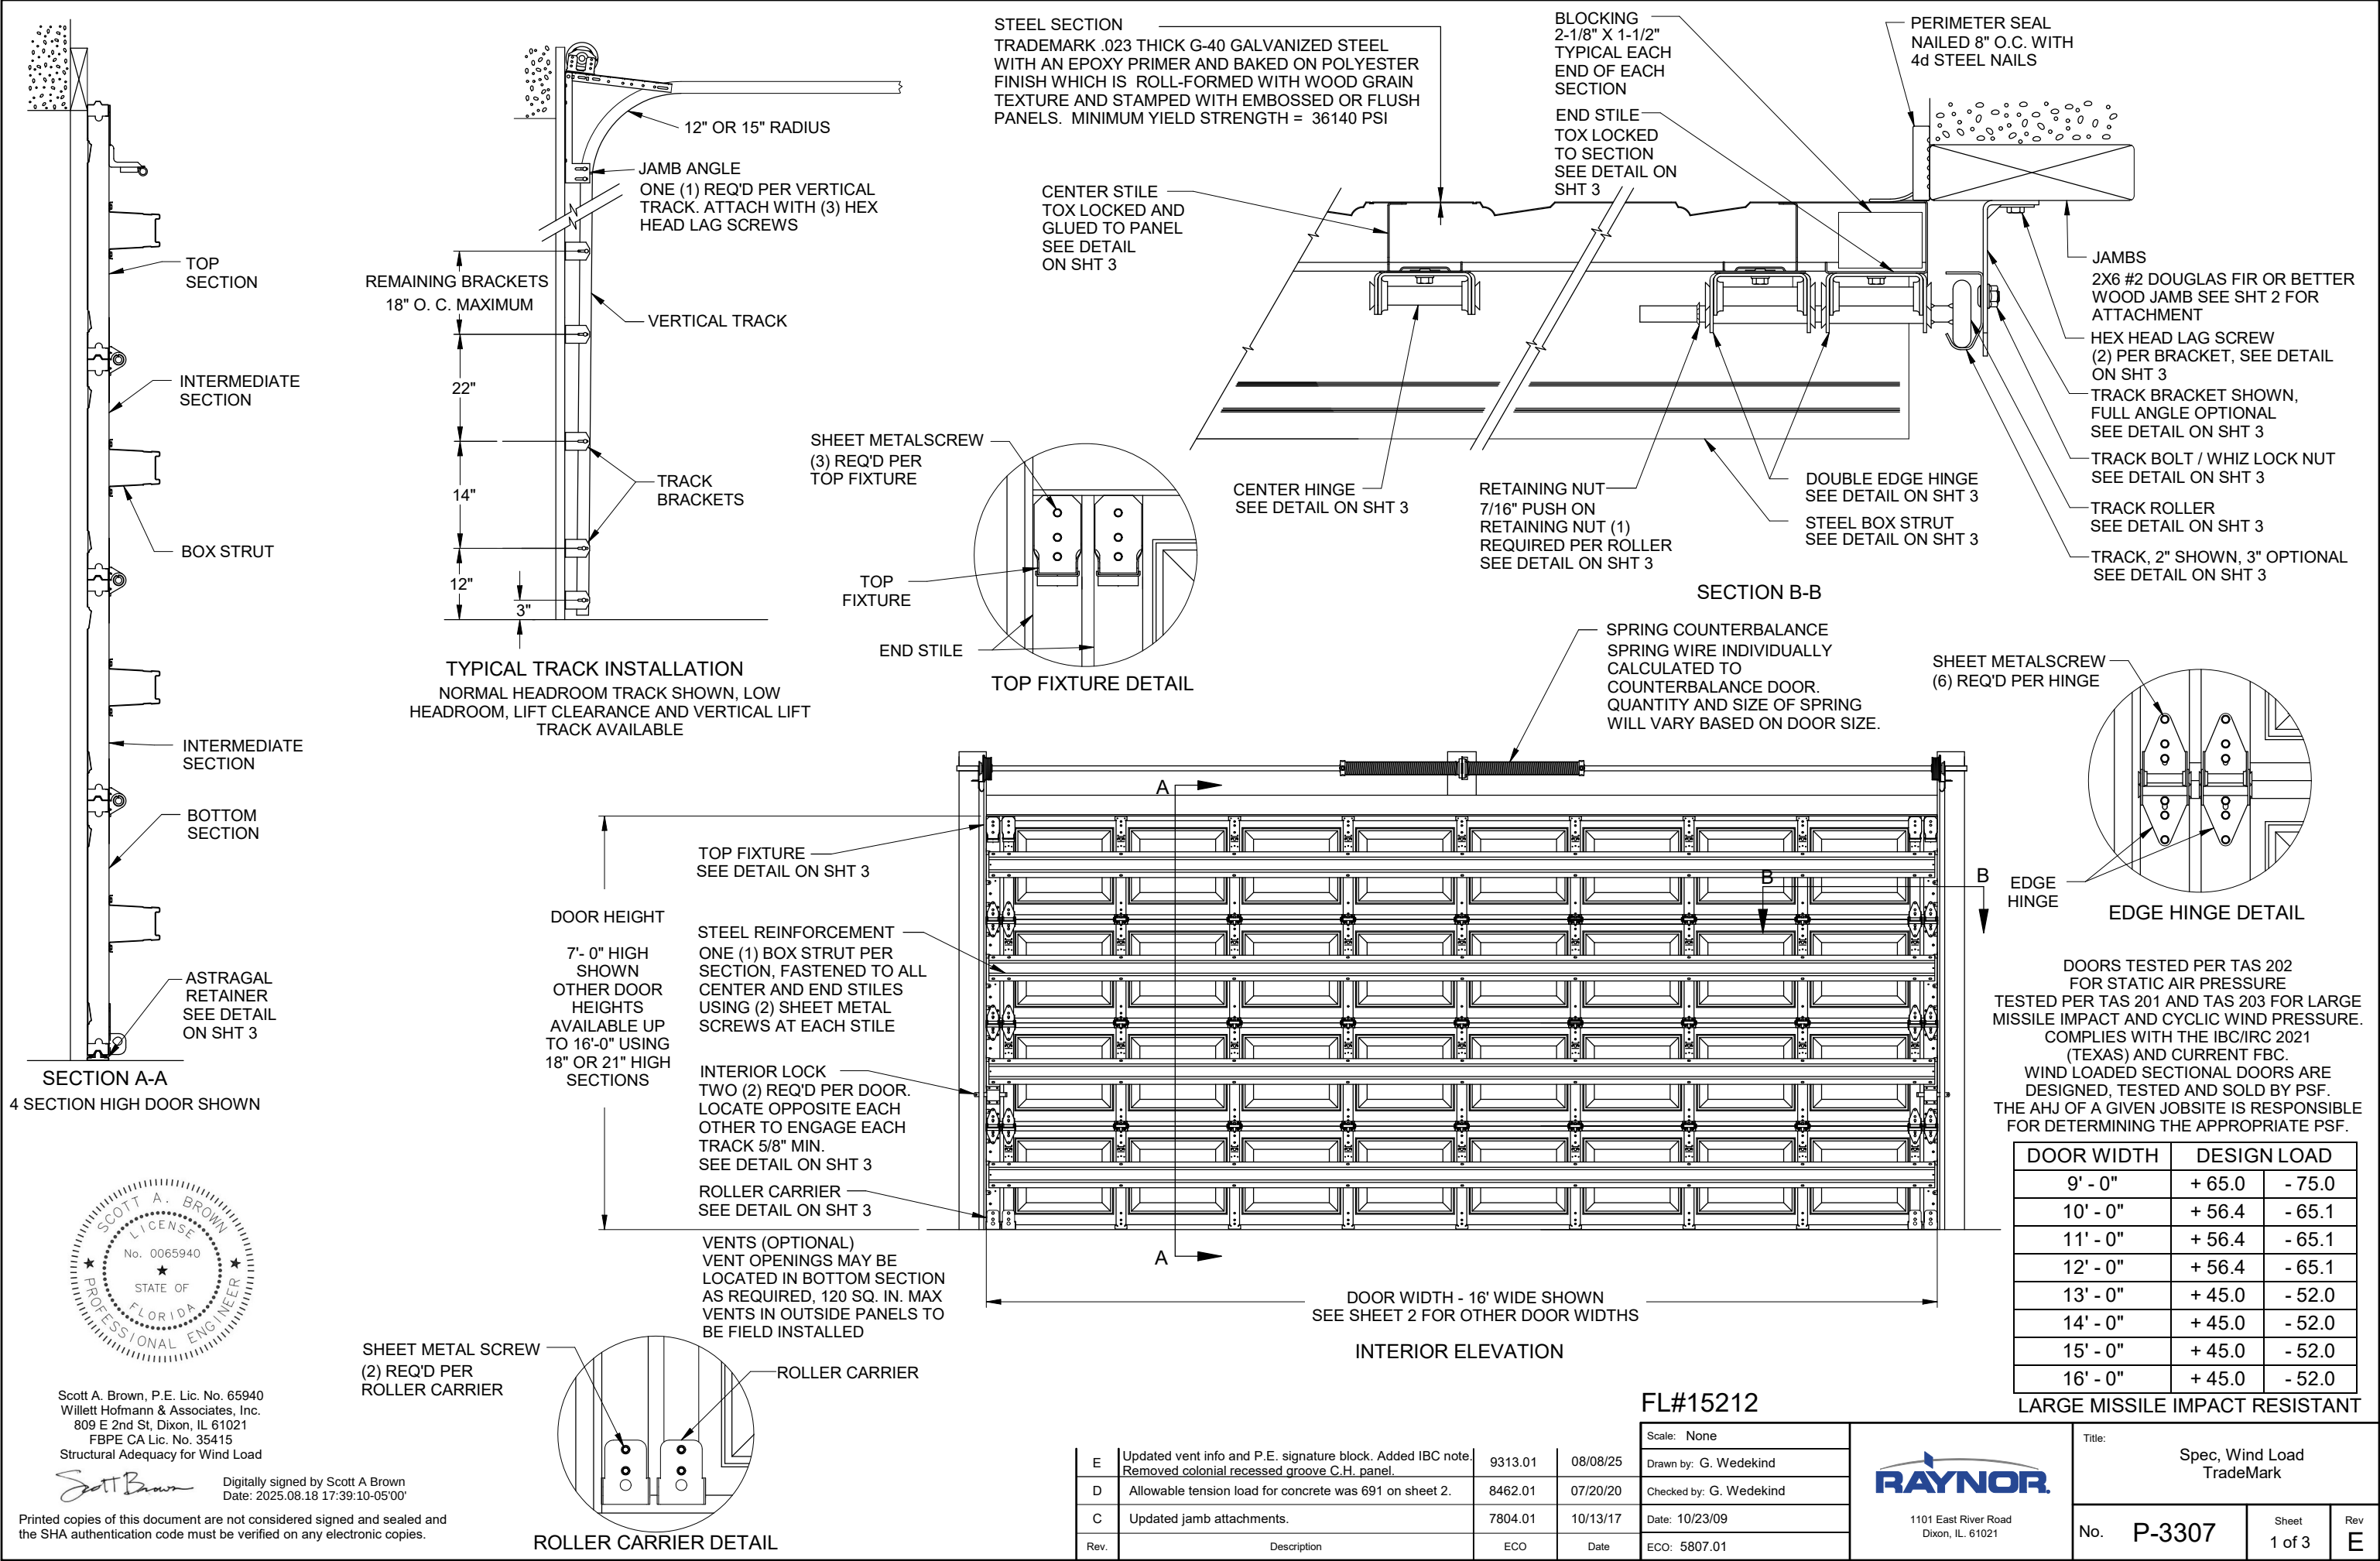


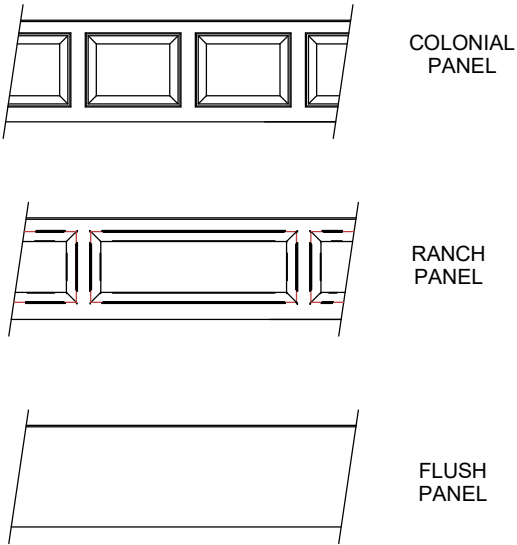

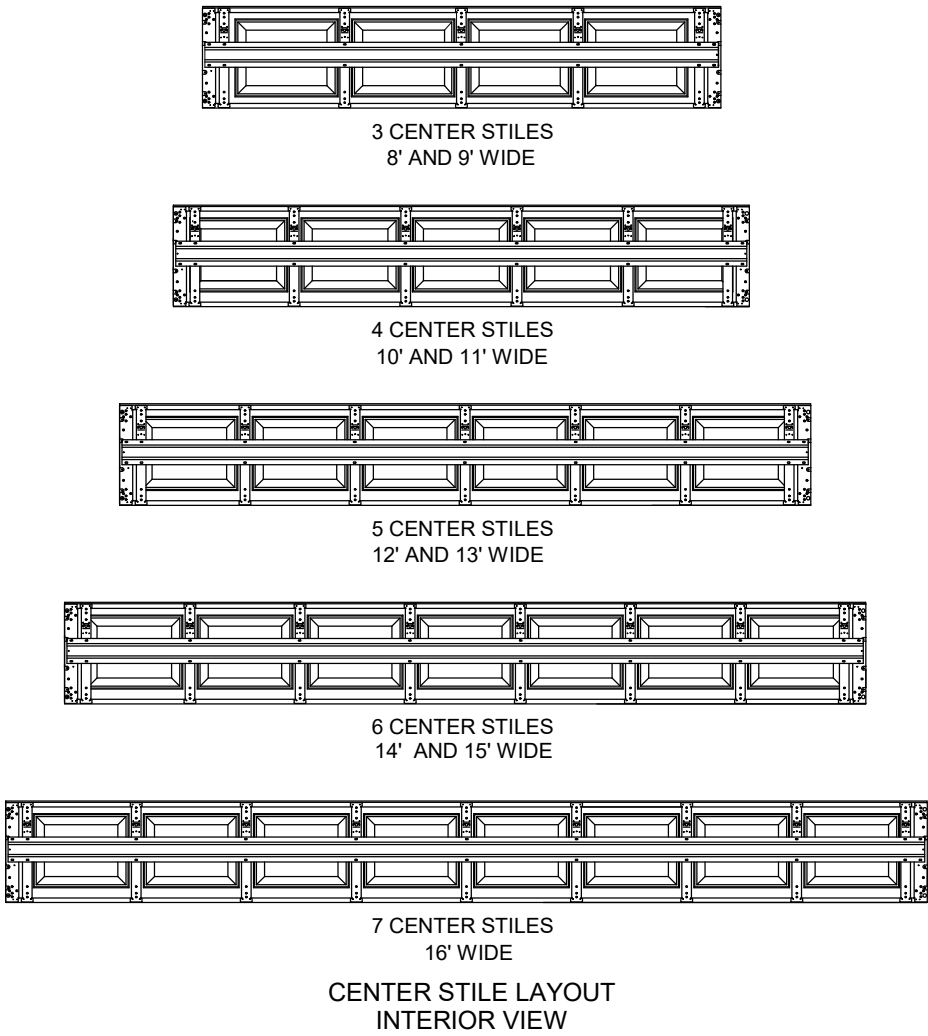


PANEL OPTIONS
EXTERIOR VIEW

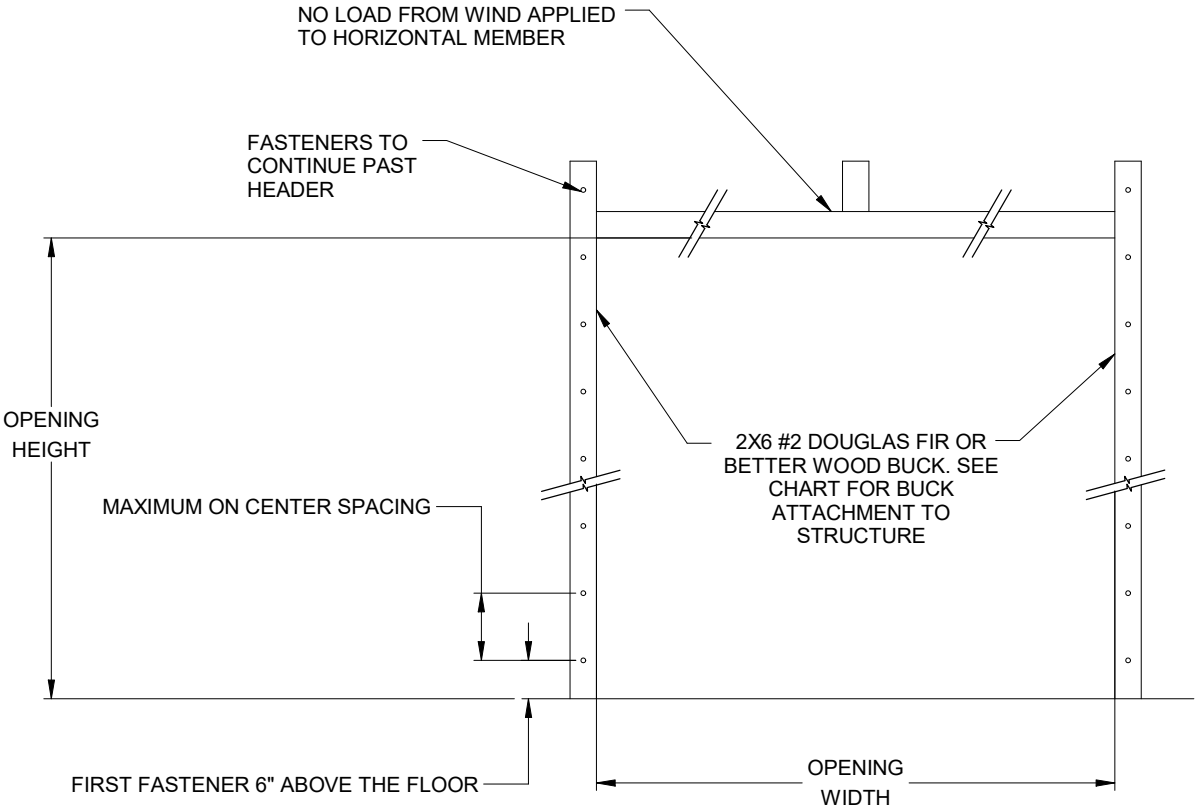

- JAMB ATTACHMENT NOTES:
1. MAXIMUM POSITIVE LOAD PER JAMB = (16'-0" X 45.0 PSF) / 2 = 360 LBS PER FOOT
 2. MAXIMUM NEGATIVE LOAD PER JAMB = (16' -0" X -52.0 PSF) / 2 = 416 LBS PER FOOT.
 3. DESIGN OF THE SUPPORTING STRUCTURE SHALL BE THE SOLE RESPONSIBILITY OF THE BUILDING DESIGNER AND SHALL BE DESIGNED FOR THE JAMB LOADS LISTED IN NOTES 1 AND 2.
 4. ALTERNATE JAMB ATTACHMENTS MAY BE USED IF APPROVED BY A REGISTERED PROFESSIONAL ENGINEER.
 5. DASMA TECHNICAL DATA SHEET TDS-161 MAY BE USED FOR ALTERNATE JAMB ATTACHMENTS.
 6. 3/8" DIAMETER LAG SCREWS REQUIRED 1/16" PILOT HOLE AND 1-1/2" MINIMUM EDGE DISTANCE.

2X6 ATTACHMENT TO STRUCTURE						
STRUCTURE TYPE	FASTENER TYPE	MINIMUM EMBEDMENT	MINIMUM EDGE DISTANCE	MINIMUM ON CENTER SPACING	DIMENSION A (MAXIMUM ON CENTER SPACING)	ALLOWABLE TENSION LOAD
2500 PSI MIN. CONCRETE	1/4" TAPCON+ (PLUS) WITH 1-1/8" OD WASHER	2"	2.5	6"	16"	526
SOUTHERN PINE	3/8" X 3" LAG WITH 1-1/8" OD WASHER	1.50"	1.50"	1.50"	21"	655
SPRUCE PINE FIR	3/8" X 3" LAG WITH 1-1/8" OD WASHER	1.50"	1.50"	1.50"	16"	482



Scott A. Brown, P.E. Lic. No. 65940
Willett Hofmann & Associates, Inc.
809 E 2nd St, Dixon, IL 61021
FBPE CA Lic. No. 35415
Structural Adequacy for Wind Load

Scott A. Brown
Digitally signed by Scott A Brown
Date: 2025.08.18 17:40:08-05'00'

Printed copies of this document are not considered signed and sealed and the SHA authentication code must be verified on any electronic copies.

Scale: None	 1101 East River Road Dixon, IL. 61021	Title: Spec, Wind Load TradeMark		
Drawn by: G. Wedekind				
Checked by: G. Wedekind				
Date: 10/23/09				
ECO: 5807.01		No. P-3307	Sheet 2	Rev E

