




5200 W. CENTURY BLVD.
LOS ANGELES, CA 90045

ONELITE SERIES
FLUSH GLAZED FIBERGLASS DOOR
w/ SIDELITES
INSWING / OUTSWING
"IMPACT"


GENERAL NOTES

1. This product has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E1996.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	Typical elevation, design pressures, & general notes
2	Door/Sidelite panel details
3	Sidelite panel details
4	Elevations
5	Horizontal cross section
6	Vertical cross sections
7	Vertical cross sections
8	Buck anchoring
9	Frame anchoring
10	Frame anchoring
11	Bill of materials and components

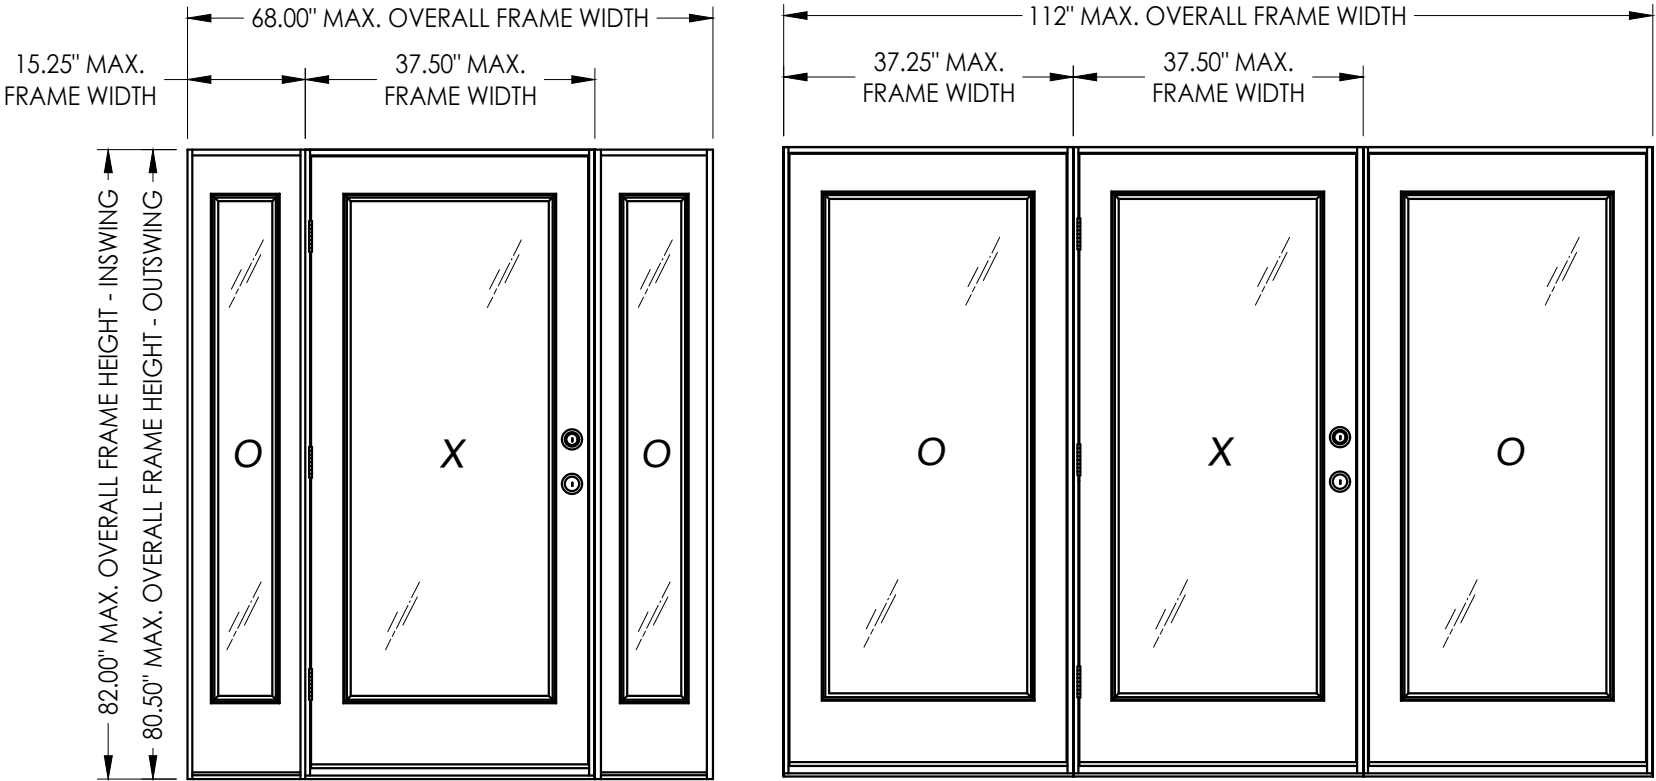

SWING	OVERALL FRAME DIMENSION	DOOR D.L.O. DIMENSION	SIDELITE D.L.O. DIMENSION	GLASS TYPE	DESIGN PRESSURE (PSF)	
					POSITIVE	NEGATIVE
INSWING	68.00" x 82.00"	26.25" x 65.93"	7.00" x 65.93"	G1	+50.0	-50.0
OUTSWING	68.00" x 80.50"	26.25" x 65.93"	7.00" x 65.93"		+50.0	-50.0
INSWING	112.00" x 82.00"	26.25" x 65.93"	26.25" x 65.93"		+50.0	-50.0
OUTSWING	112.00" x 80.50"	26.25" x 65.93"	26.25" x 65.93"		+50.0	-50.0

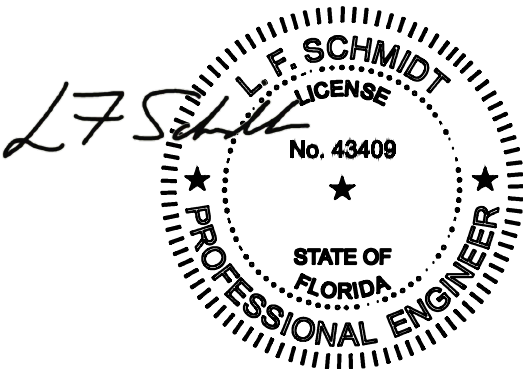

Digitally signed by Lyndon F Schmidt
Date: 2026.08.10 16:57:07 -04'00'

This item has been digitally signed and sealed by L. F. Schmidt, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID ONLY FOR THE STATE OF FLORIDA

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PLASTPRO INC.
FIBERGLASS DOOR


DATE: 02/15/12
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-15215.13
SHEET 1 OF 11

Part or Assembly:
TYPICAL ELEVATION, DESIGN PRESSURES & GENERAL NOTES


REVISIONS

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Plastpro\FL-15215 R8\FL-15215.11-20.dwg

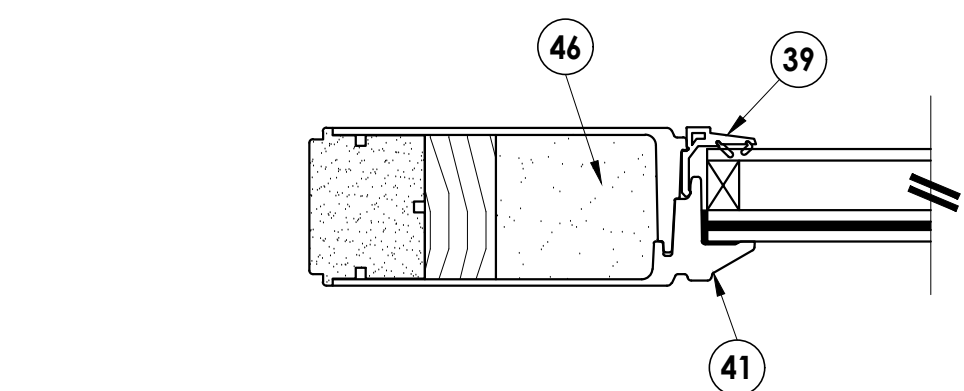


1
2 **HORIZONTAL CROSS SECTION**

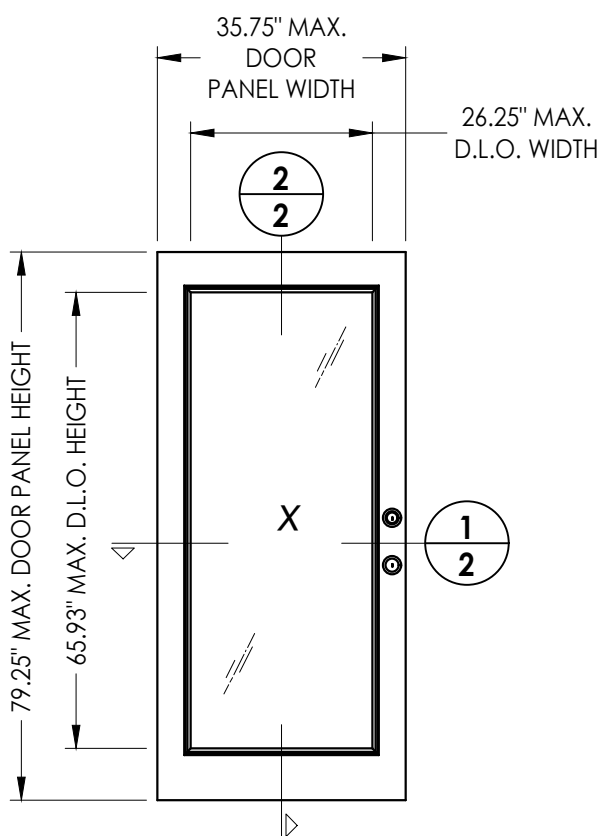


40 **DOOR / SIDELITE PANEL**




42 **TOP RAIL**
Cellular PVC




43 **LATCH & HINGE STILE**
Cellular PVC




44 **LOCK REINFORCEMENT**
Wood




45 **BOTTOM RAIL**
Cellular PVC



47 **LATCH & HINGE STILE**
Wood reinforcement

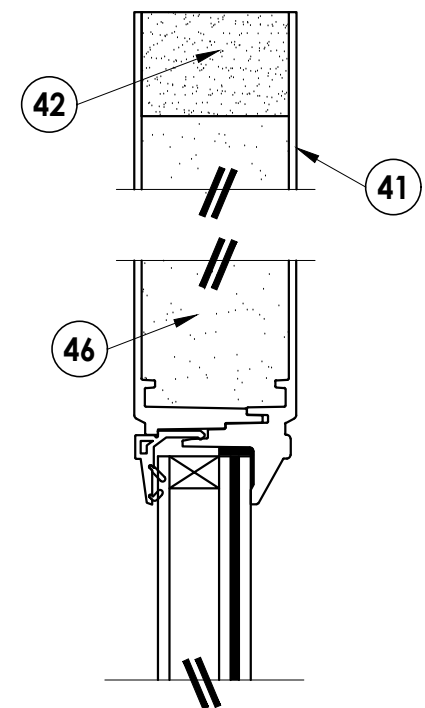

INTERIOR EXTERIOR

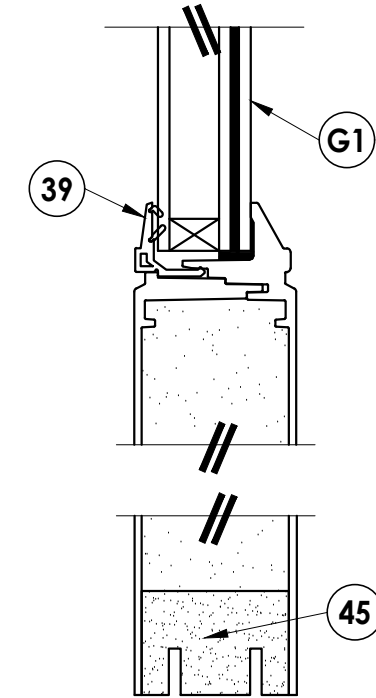

2
2 **VERTICAL CROSS SECTION**

NO.	DATE	REVISIONS
6	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
5	8/15/23	UPDATE TO 8TH ED. (2023) FBC LFS
4	8/05/20	UPDATE TO 7TH ED. (2020) FBC DAC
3	7/25/17	UPDATE TO 6TH ED. (2017) FBC JK
2	04/22/15	UPDATE TO 5TH ED. (2014) FBC JK
1	2/27/13	REVISED GLAZING DETAIL RW








DATE:	02/15/12
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-15215.13
SHEET	2 OF 11

PRODUCT:	PLASTPRO INC. FIBERGLASS DOOR
PART OR ASSEMBLY:	DOOR / SIDELITE PANEL DETAILS



Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Vairico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Plastpro\FL-15215 R8\FL-15215.11-20.dwg

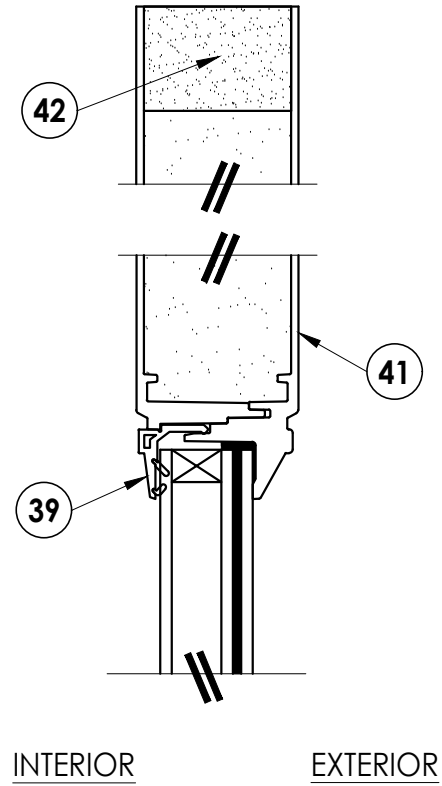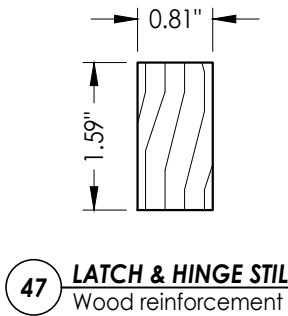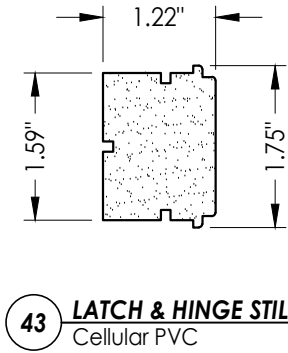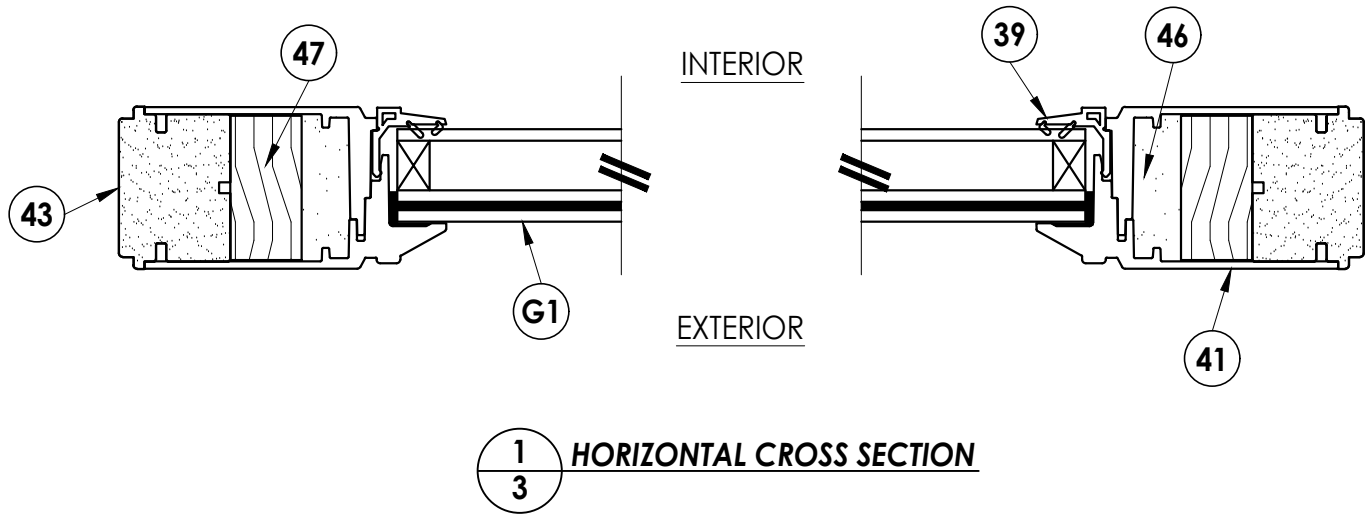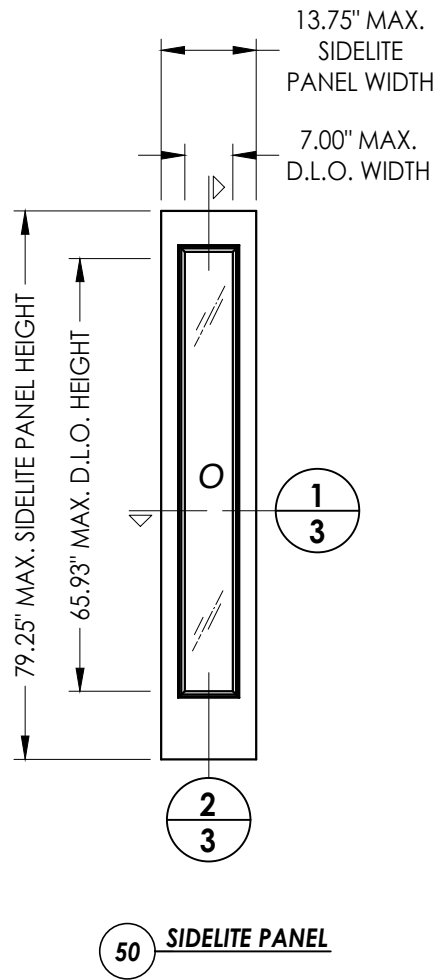

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409										BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813									
PRODUCT: PLASTPRO INC. FIBERGLASS DOOR										PART OR ASSEMBLY: SIDELITE PANEL DETAILS									
6	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS	REVISIONS														
5	8/15/23	UPDATE TO 8TH ED. (2023)	FBC	LFS															
4	8/05/20	UPDATE TO 7TH ED. (2020)	FBC	DAC															
3	7/25/17	UPDATE TO 6TH ED. (2017)	FBC	JK															
2	04/22/15	UPDATE TO 5TH ED. (2014)	FBC	JK															
1	2/27/13	REVISED GLAZING DETAIL		RW															
NO.		DATE		BY															
DATE: 02/15/12																			
SCALE: N.T.S.																			
DWG. BY: JK																			
CHK. BY: LFS																			
DRAWING NO.: FL-15215.13																			
SHEET 3 OF 11																			

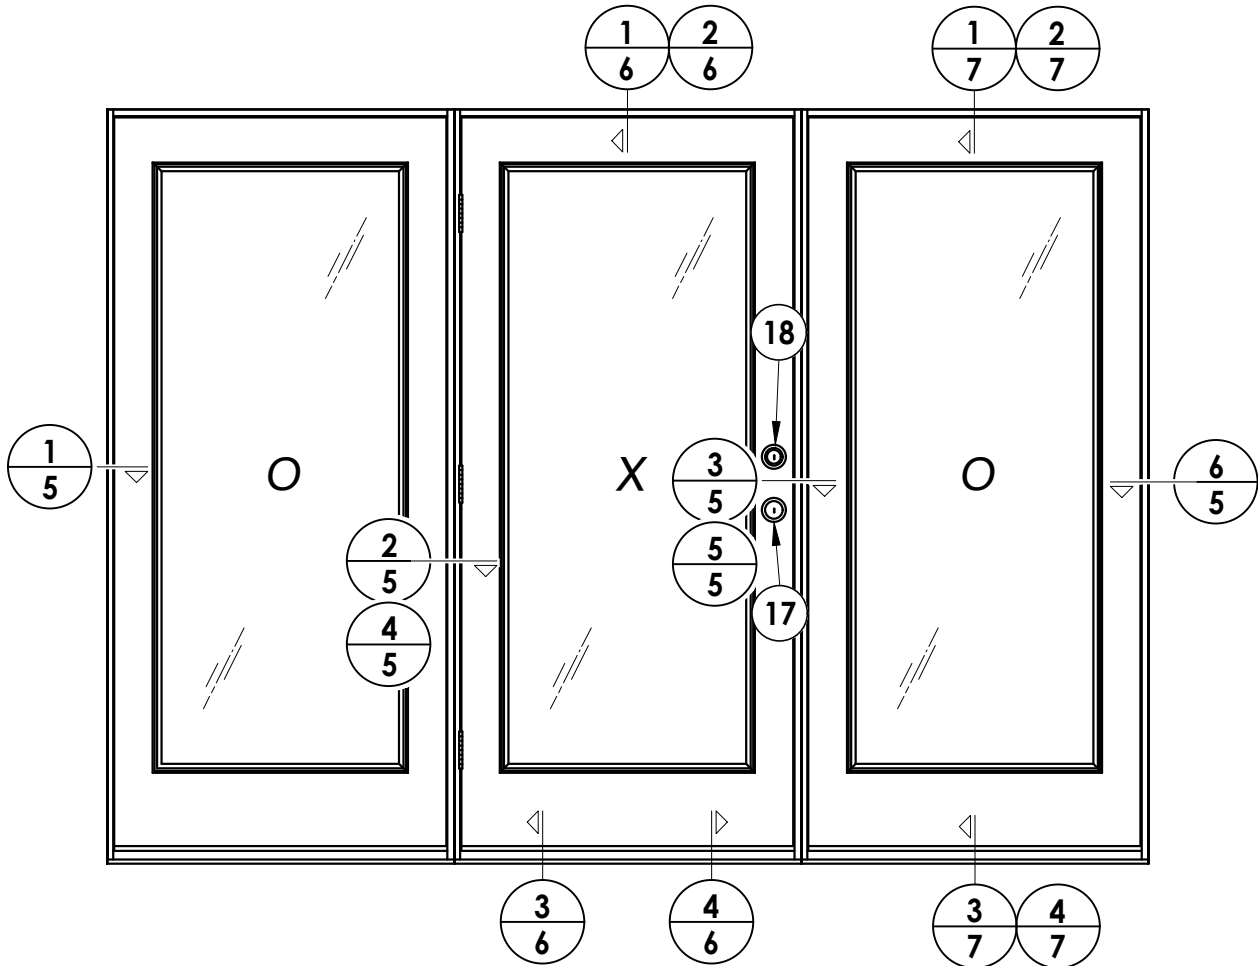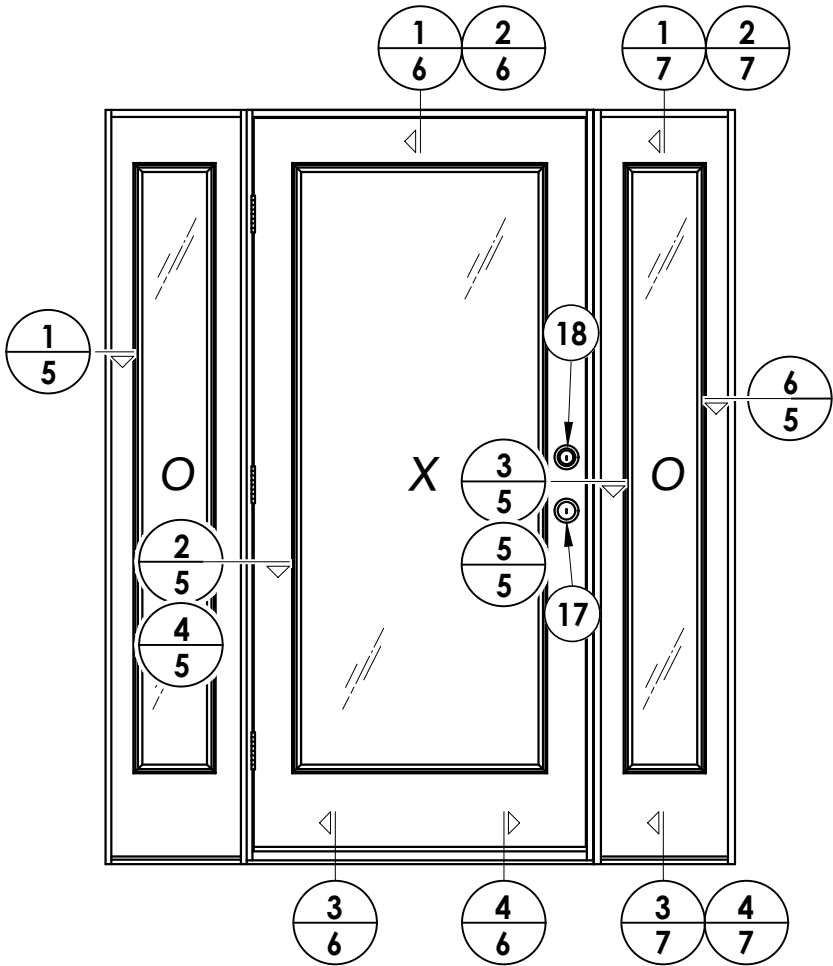


DATE: 02/15/12		SCALE: N.T.S.		DWG. BY: JK		CHK. BY: LFS		DRAWING NO.: FL-15215.13		SHEET 4 OF 11	
6	7/02/26	UPDATE TO 9TH ED.	(2026)	FBC	LFS	REVISIONS					
5	8/15/23	UPDATE TO 8TH ED.	(2023)	FBC	LFS						
4	8/05/20	UPDATE TO 7TH ED.	(2020)	FBC	DAC						
3	7/25/17	UPDATE TO 6TH ED.	(2017)	FBC	JK						
2	04/22/15	UPDATE TO 5TH ED.	(2014)	FBC	JK						
1	2/27/13	REVISED GLAZING DETAIL				RW					
NO.	DATE										

PRODUCT:	PLASTPRO INC.	
	FIBERGLASS DOOR	
PART OR ASSEMBLY:	ELEVATIONS	

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Plastpro\FL-15215 R8\FL-15215.11-20.dwg

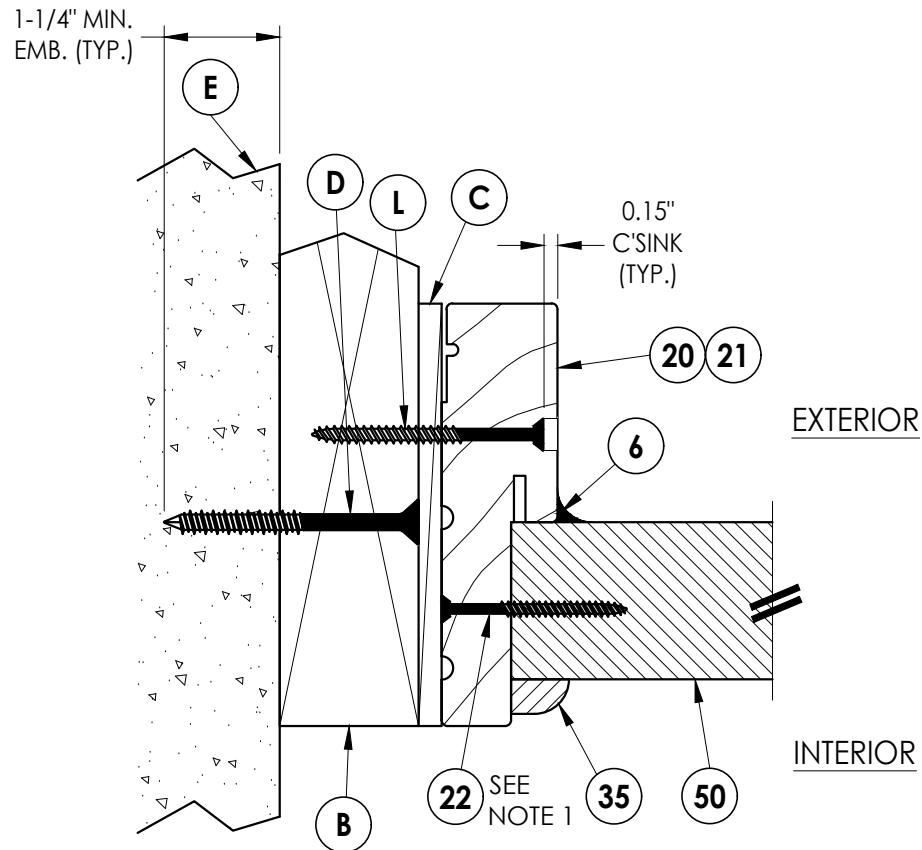


1 **HORIZONTAL CROSS SECTION**
5 Inswing shown - outswing also approved


NOTE:
1. Sidelite panel secured to the sidelite frame as follows:
14" nom. panel: (4) of item #22 located 10" from each end and 2 more equally spaced.
36" nom. panel: (6) of item #22 located 6" from each end and 4 more equally spaced.

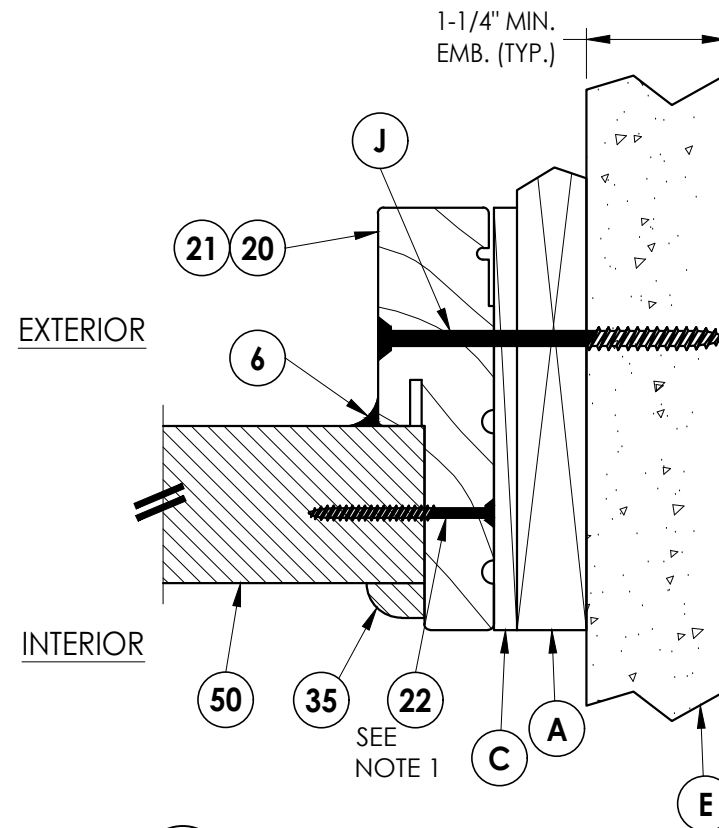


6 **HORIZONTAL CROSS SECTION**
5 Shown w/ 1X sub-buck
Inswing shown - outswing also approved

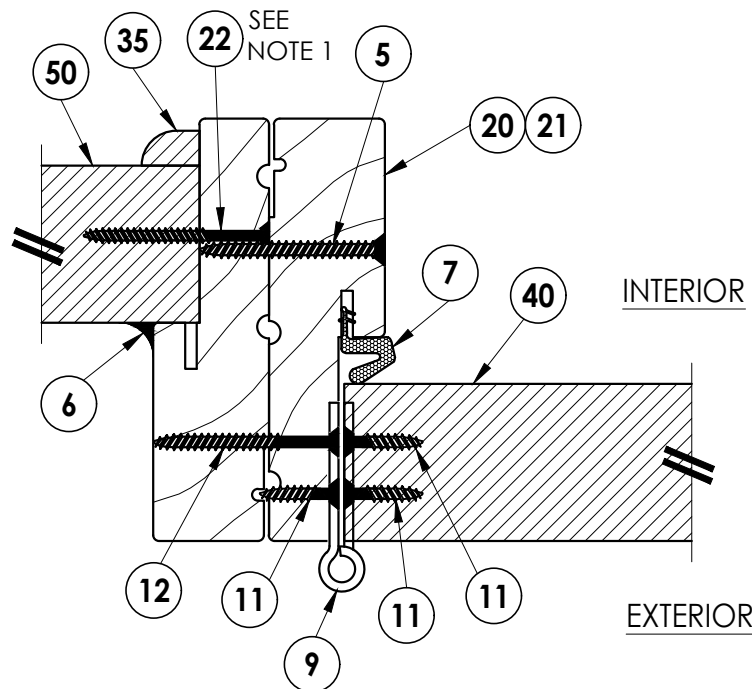


2 **HORIZONTAL CROSS SECTION**
5 Alternate outswing configuration shown

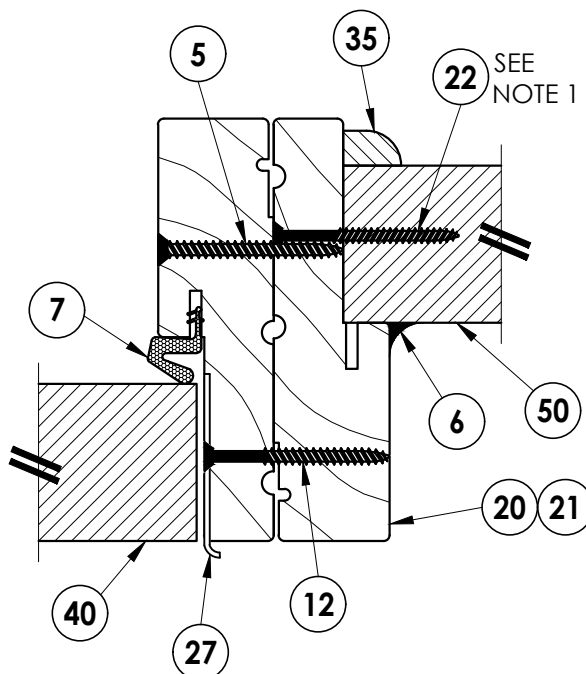

3 **HORIZONTAL CROSS SECTION**
5 Alternate outswing configuration shown

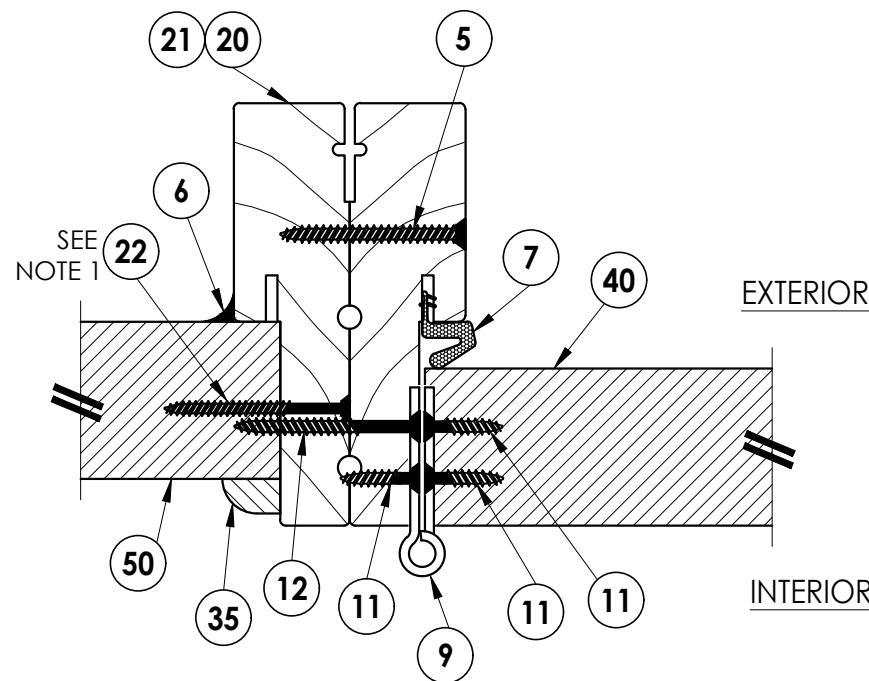

4 **HORIZONTAL CROSS SECTION**
5 Inswing shown - outswing also approved

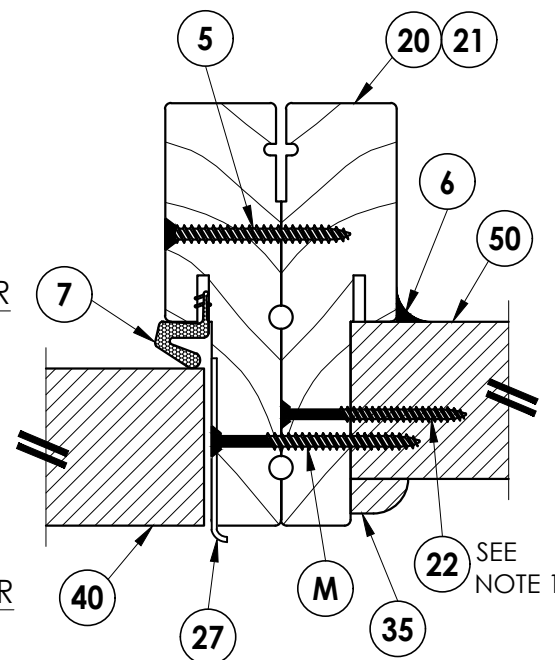

5 **HORIZONTAL CROSS SECTION**
5 Inswing shown - outswing also approved

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
PLASTPRO INC.
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL CROSS SECTIONS

LFS	FBC	(2026)	9TH ED.	UPDATE TO
6	7/02/26	UPDATE TO	9TH ED.	(2026)
5	8/15/23	UPDATE TO	8TH ED.	(2023)
4	8/05/20	UPDATE TO	7TH ED.	(2020)
3	7/25/17	UPDATE TO	6TH ED.	(2017)
2	04/22/15	UPDATE TO	5TH ED.	(2014)
1	2/27/13	REVISED GLAZING DETAIL		
NO.	DATE	BY	REVISIONS	

DATE: 02/15/12

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS


DRAWING NO.: FL-15215.13

SHEET 5 OF 11


Z:\2023 FBC Drawings\Plastpro\FL-15215 R8\FL-15215.11-20.dwg

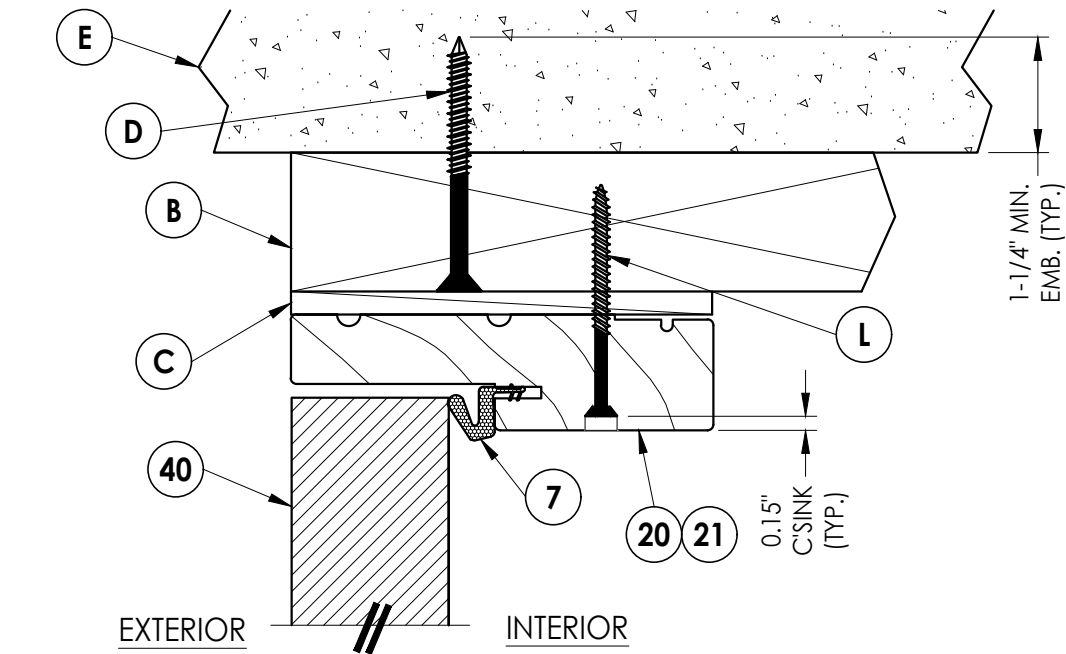


1
6 **VERTICAL CROSS SECTION**
Outswing shown - inswing
also approved

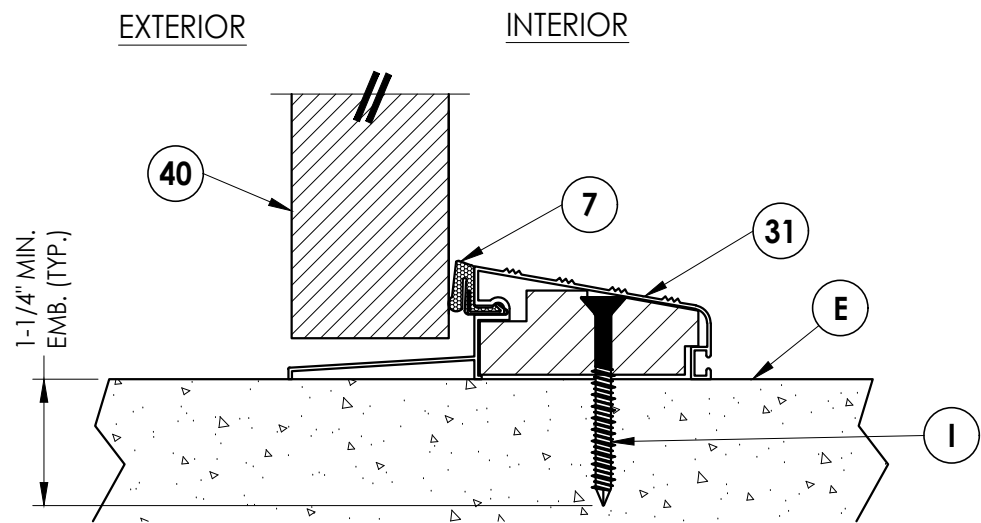

3
6 **VERTICAL CROSS SECTION**
Outswing configuration

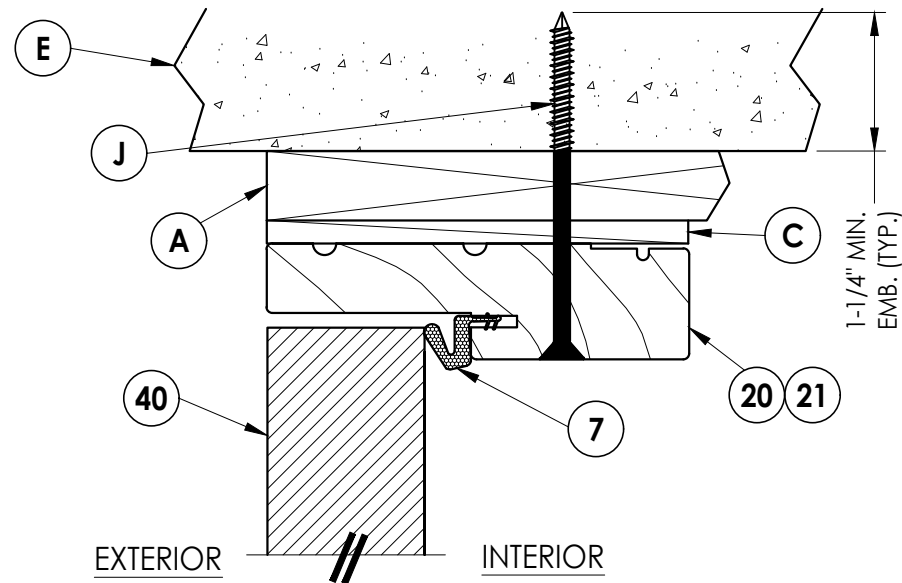

2
6 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown - inswing also approved

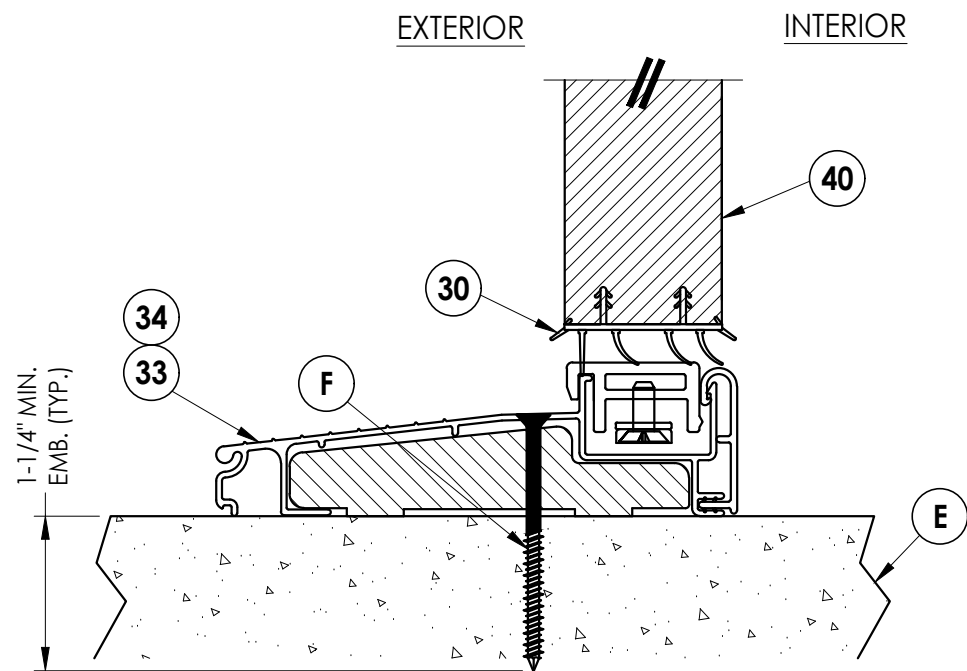

4
6 **VERTICAL CROSS SECTION**
Inswing configuration

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
PLASTPRO INC.
FIBERGLASS DOOR

PART OR ASSEMBLY:
VERTICAL CROSS SECTIONS

LFS	FBC	(2026)	FBC	(2023)	FBC	DAC	JK	JK	RW	BY
6	7/02/26	UPDATE TO 9TH ED.	(2026)	FBC	(2023)	FBC	DAC	JK	RW	BY
5	8/15/23	UPDATE TO 8TH ED.	(2023)	FBC	(2020)	FBC	DAC	JK	RW	BY
4	8/05/20	UPDATE TO 7TH ED.	(2020)	FBC	(2017)	FBC	DAC	JK	RW	BY
3	7/25/17	UPDATE TO 6TH ED.	(2017)	FBC	(2014)	FBC	DAC	JK	RW	BY
2	04/22/15	UPDATE TO 5TH ED.	(2014)	FBC	(2014)	FBC	DAC	JK	RW	BY
1	2/27/13	REVISED GLAZING DETAIL								
NO.	DATE	REVISIONS								

DATE: 02/15/12

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-15215.13


SHEET 6 OF 11

Z:\2023 FBC Drawings\Plastpro\FL-15215 R8\FL-15215.11-20.dwg

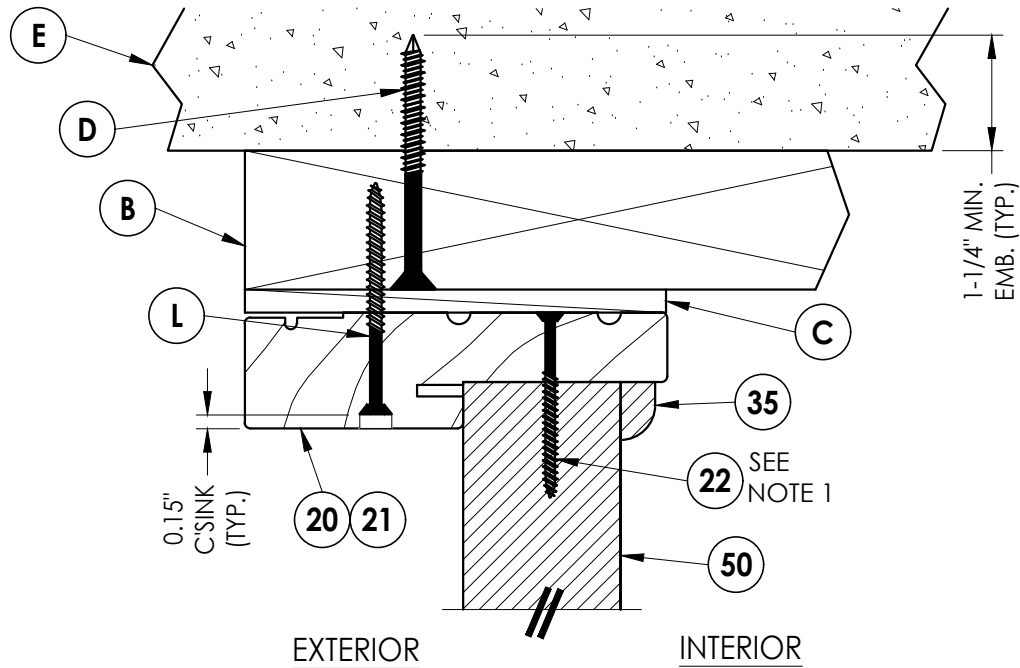


1 **VERTICAL CROSS SECTION**
7 Inswing shown - outswing also approved


NOTE:
1. Sidelite panel secured to the sidelite frame as follows:
14" nom. panel: (2) of item #22 located 3" from each end.
36" nom. panel: (2) of item #22 located 6" from each end.

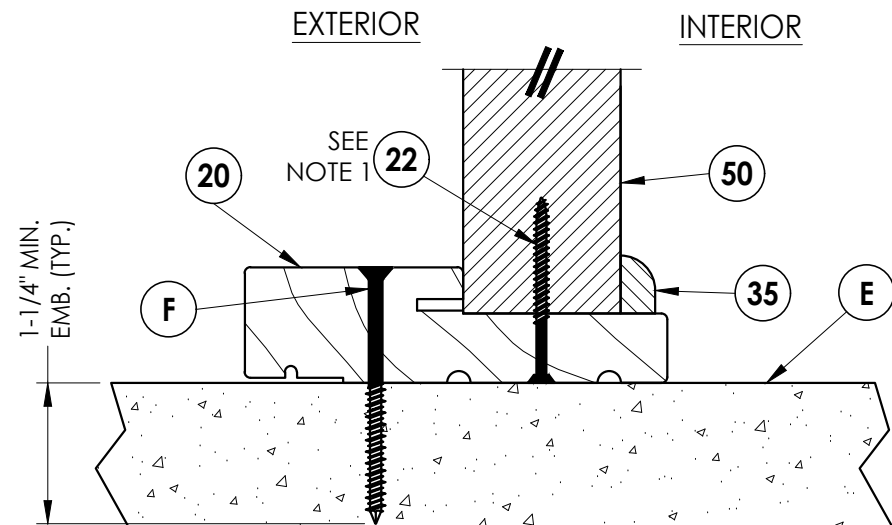

3 **VERTICAL CROSS SECTION**
7 Inswing shown - outswing also approved

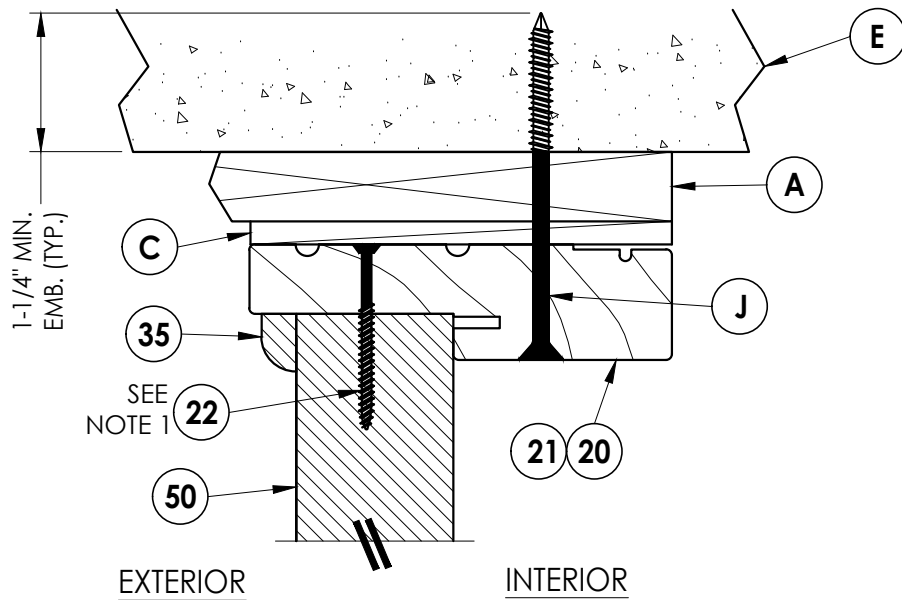

2 **VERTICAL CROSS SECTION**
7 Shown w/ 1X sub-buck
Outswing shown - inswing also approved

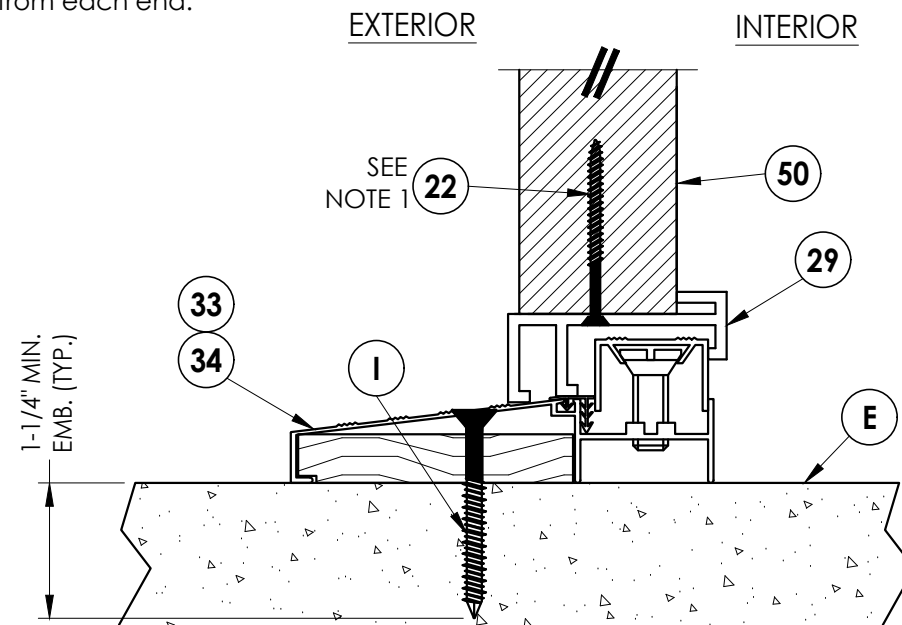

4 **VERTICAL CROSS SECTION**
7 Inswing configuration

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
PLASTPRO INC.
FIBERGLASS DOOR

PART OR ASSEMBLY:
VERTICAL CROSS SECTIONS

LFS	FBC	(2026)	DATE	NO.	DATE	BY
6	7/02/26	UPDATE TO 9TH ED.	02/15/12	1	2/27/13	RW
5	8/15/23	UPDATE TO 8TH ED.		2	04/22/15	JK
4	8/05/20	UPDATE TO 7TH ED.		3	7/25/17	JK
3	7/25/17	UPDATE TO 6TH ED.		4	04/22/15	JK
2	04/22/15	UPDATE TO 5TH ED.		5	04/22/15	JK
1	2/27/13	REVISED GLAZING DETAIL		6	7/02/26	JK
REVISIONS						

DATE: 02/15/12

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-15215.13

SHEET 7 OF 11

Z:\2023 FBC Drawings\Plastpro\FL-15215 R8\FL-15215.11-20.dwg

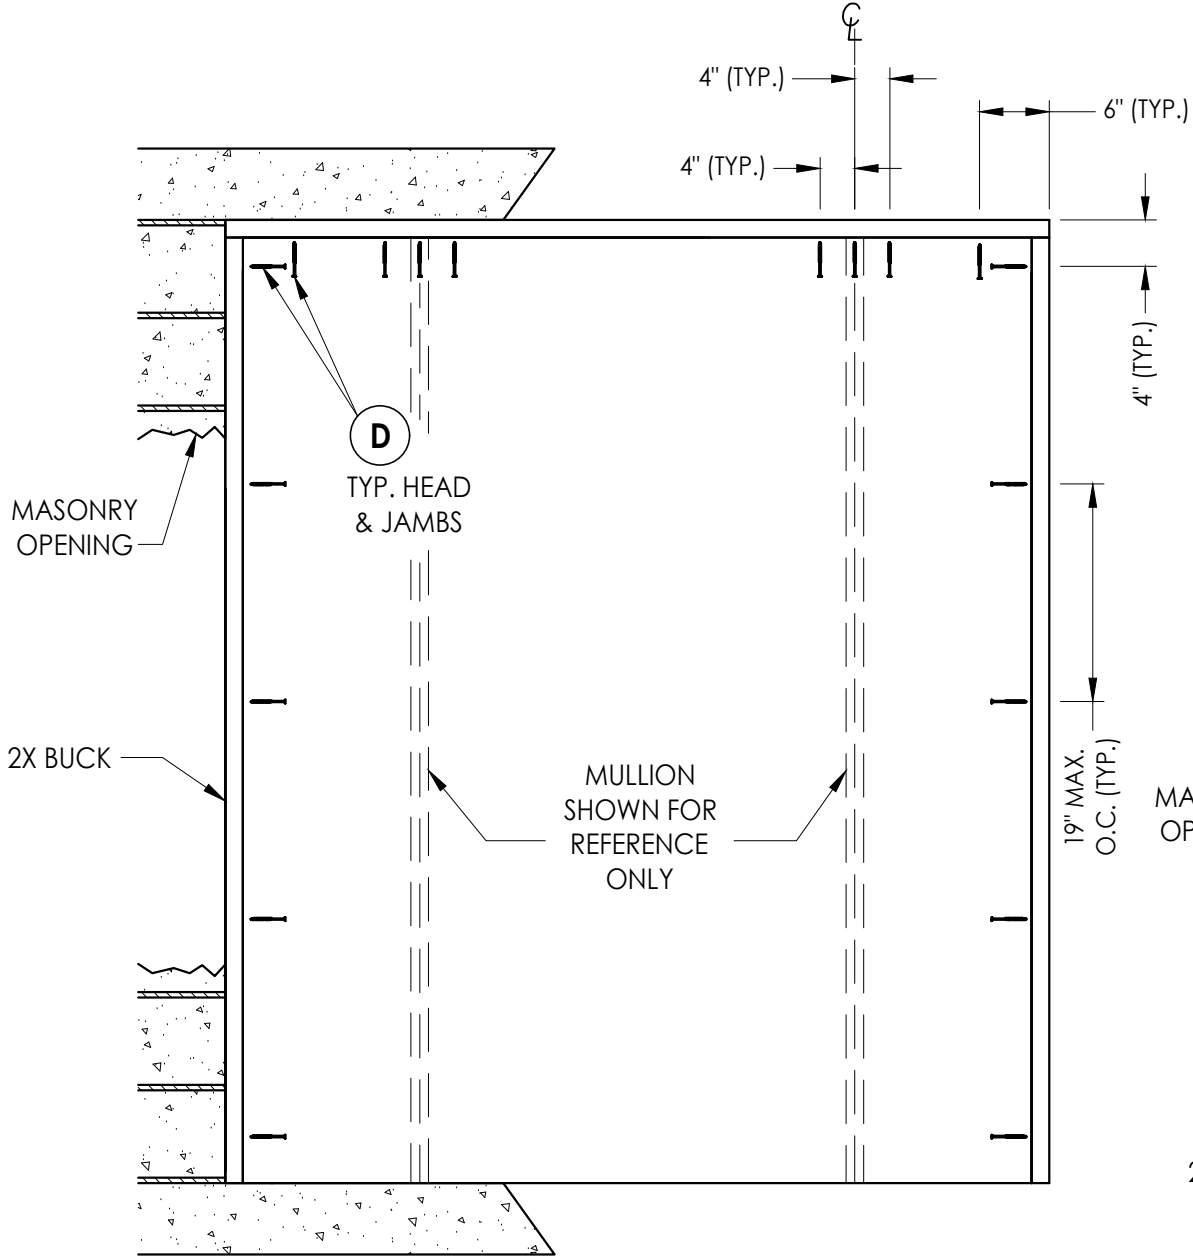

BUCK ANCHORING


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

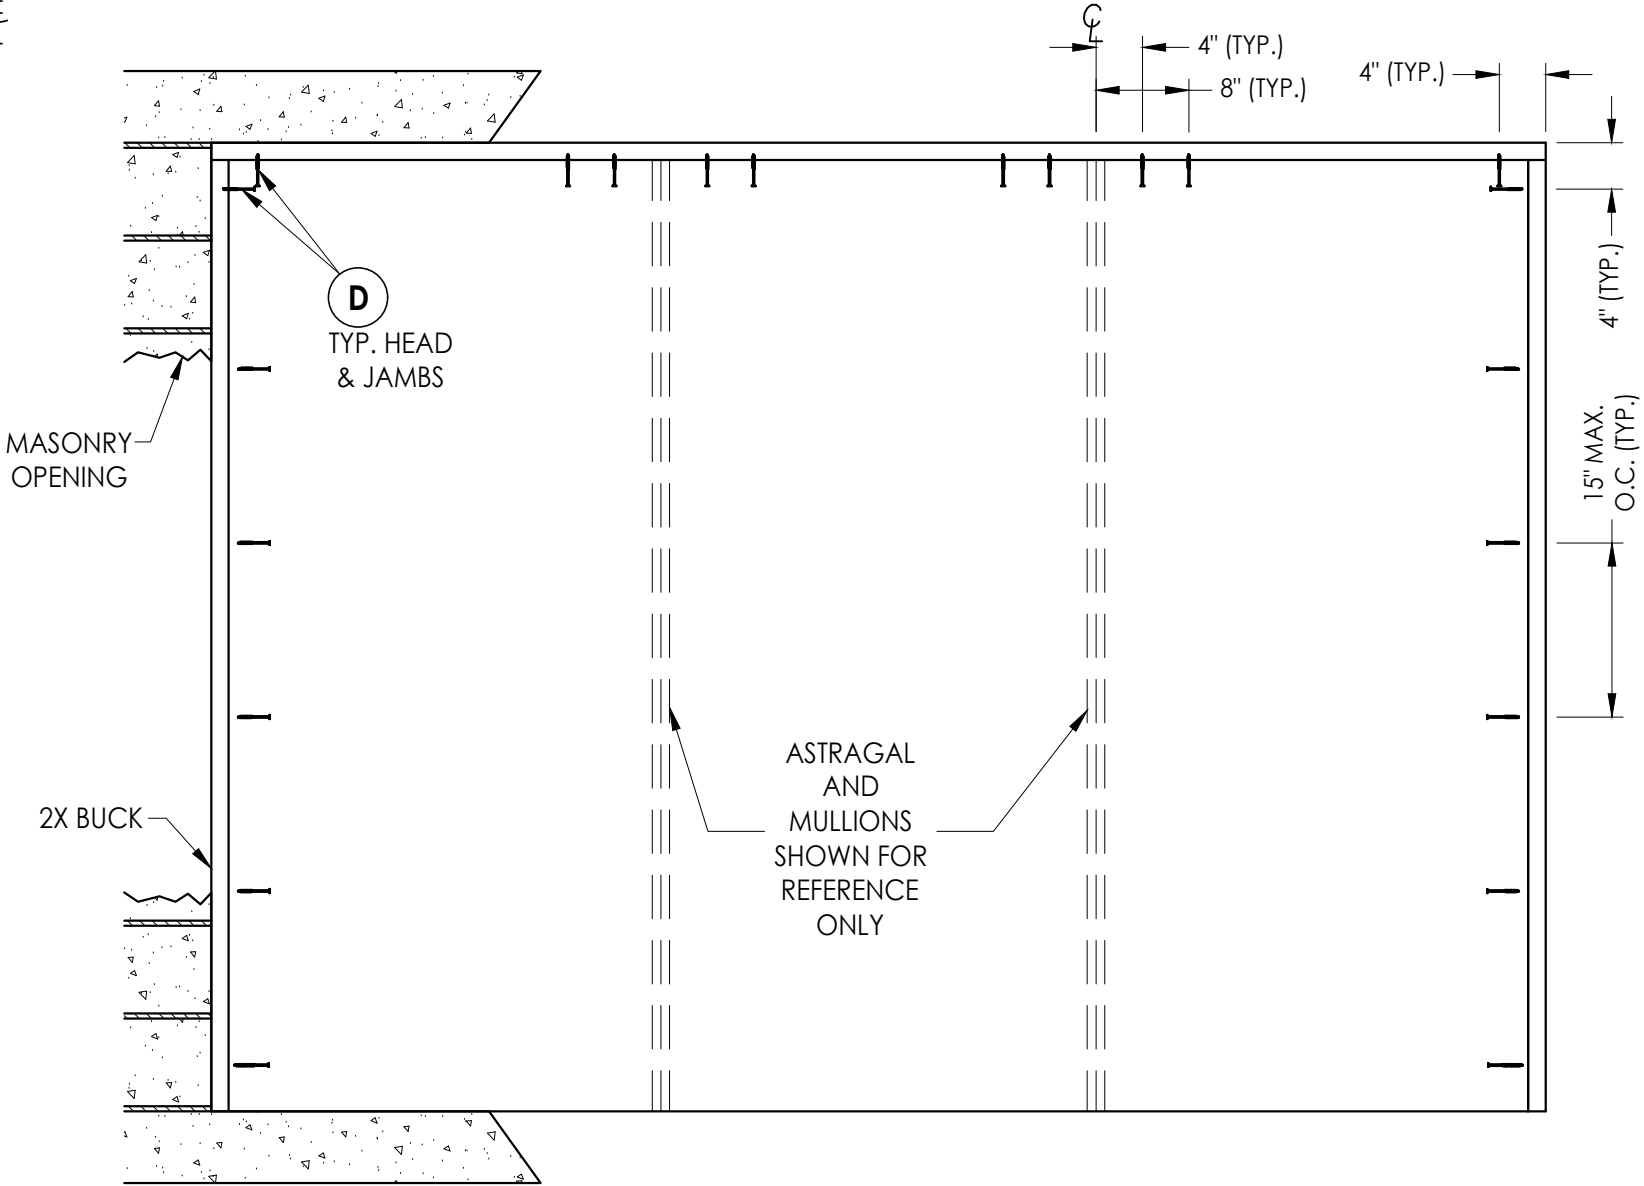

BUCK ANCHORING

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
PLASTPRO INC.
FIBERGLASS DOOR

RW BUILDING CONSULTANTS, INC.


P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PART OR ASSEMBLY:
BUCK ANCHORING

NO.	DATE	REVISIONS
6	7/02/26	UPDATE TO 9TH ED. (2026) FBC
5	8/15/23	UPDATE TO 8TH ED. (2023) FBC
4	8/05/20	UPDATE TO 7TH ED. (2020) FBC
3	7/25/17	UPDATE TO 6TH ED. (2017) FBC
2	04/22/15	UPDATE TO 5TH ED. (2014) FBC
1	2/27/13	REVISED GLAZING DETAIL
NO.	DATE	BY


DATE: 02/15/12
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-15215.13
SHEET 8 OF 11

Z:\2023 FBC Drawings\Plastpro\FL-15215 R8\FL-15215.11-20.dwg

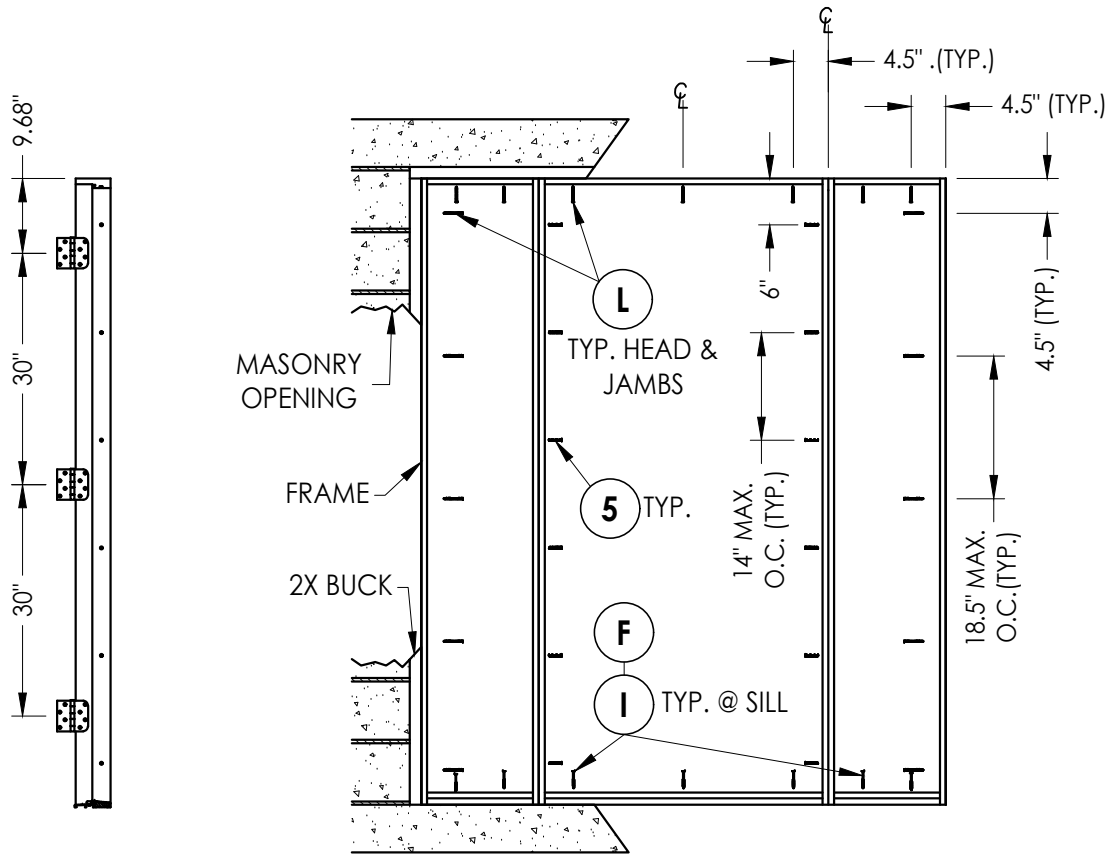

HINGE JAMB

FRAME ANCHORING
Masonry 2X buck construction

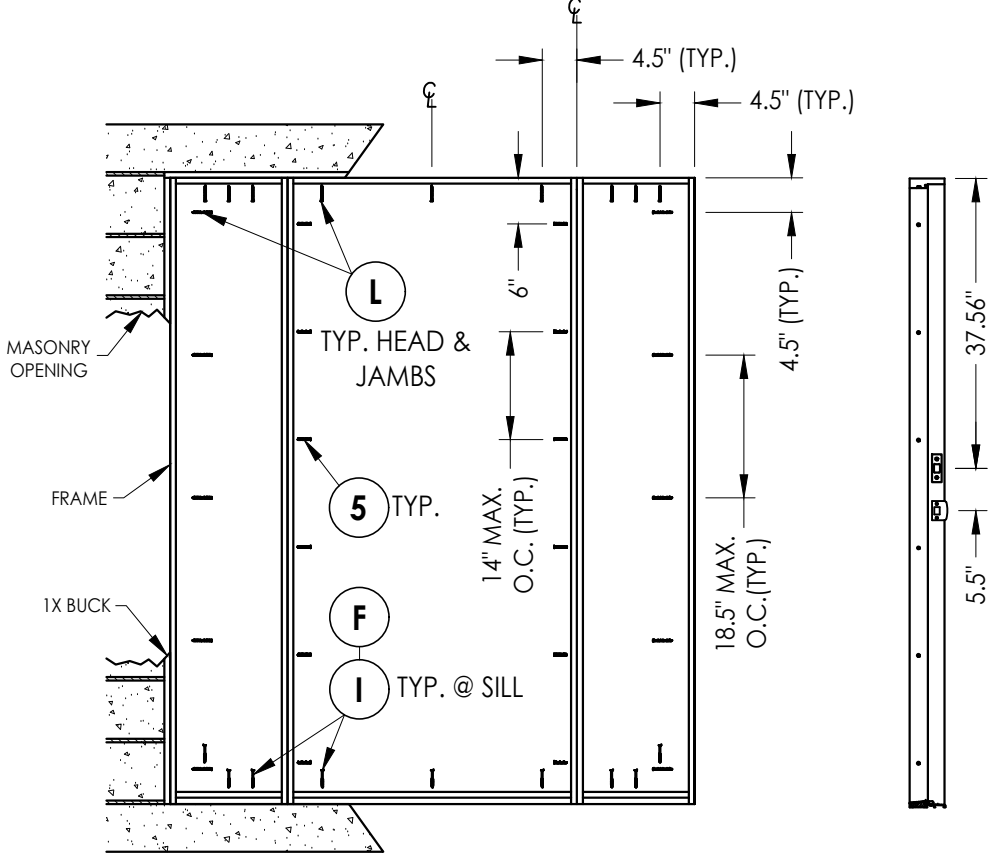

FRAME ANCHORING
Masonry 1X buck construction

STRIKE JAMB


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

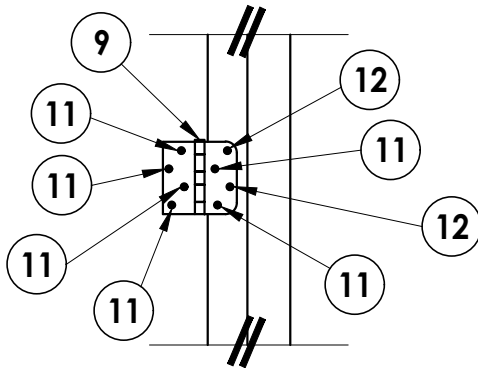

HINGE DETAIL

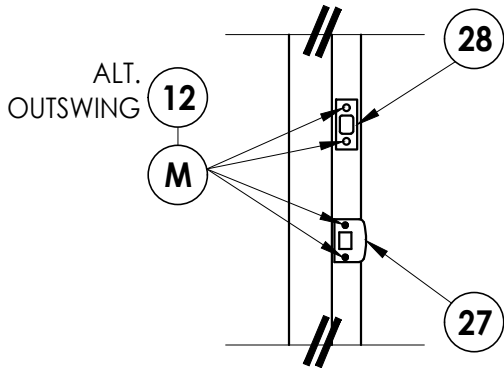

LATCH & DEADBOLT DETAIL

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
PLASTPRO INC.
FIBERGLASS DOOR

PART OR ASSEMBLY:
FRAME ANCHORING

LFS	FBC	(2026)	9TH ED.	7/02/26	6
LFS	FBC	(2023)	8TH ED.	8/15/23	5
DAC	FBC	(2020)	7TH ED.	8/05/20	4
JK	FBC	(2017)	6TH ED.	7/25/17	3
JK	FBC	(2014)	5TH ED.	04/22/15	2
RW	REVISED GLAZING DETAIL			2/27/13	1
BY	DATE				

REVISIONS

DATE: 02/15/12

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-15215.13

SHEET 9 OF 11

Z:\2023 FBC Drawings\Plastpro\FL-15215 R8\FL-15215.11-20.dwg

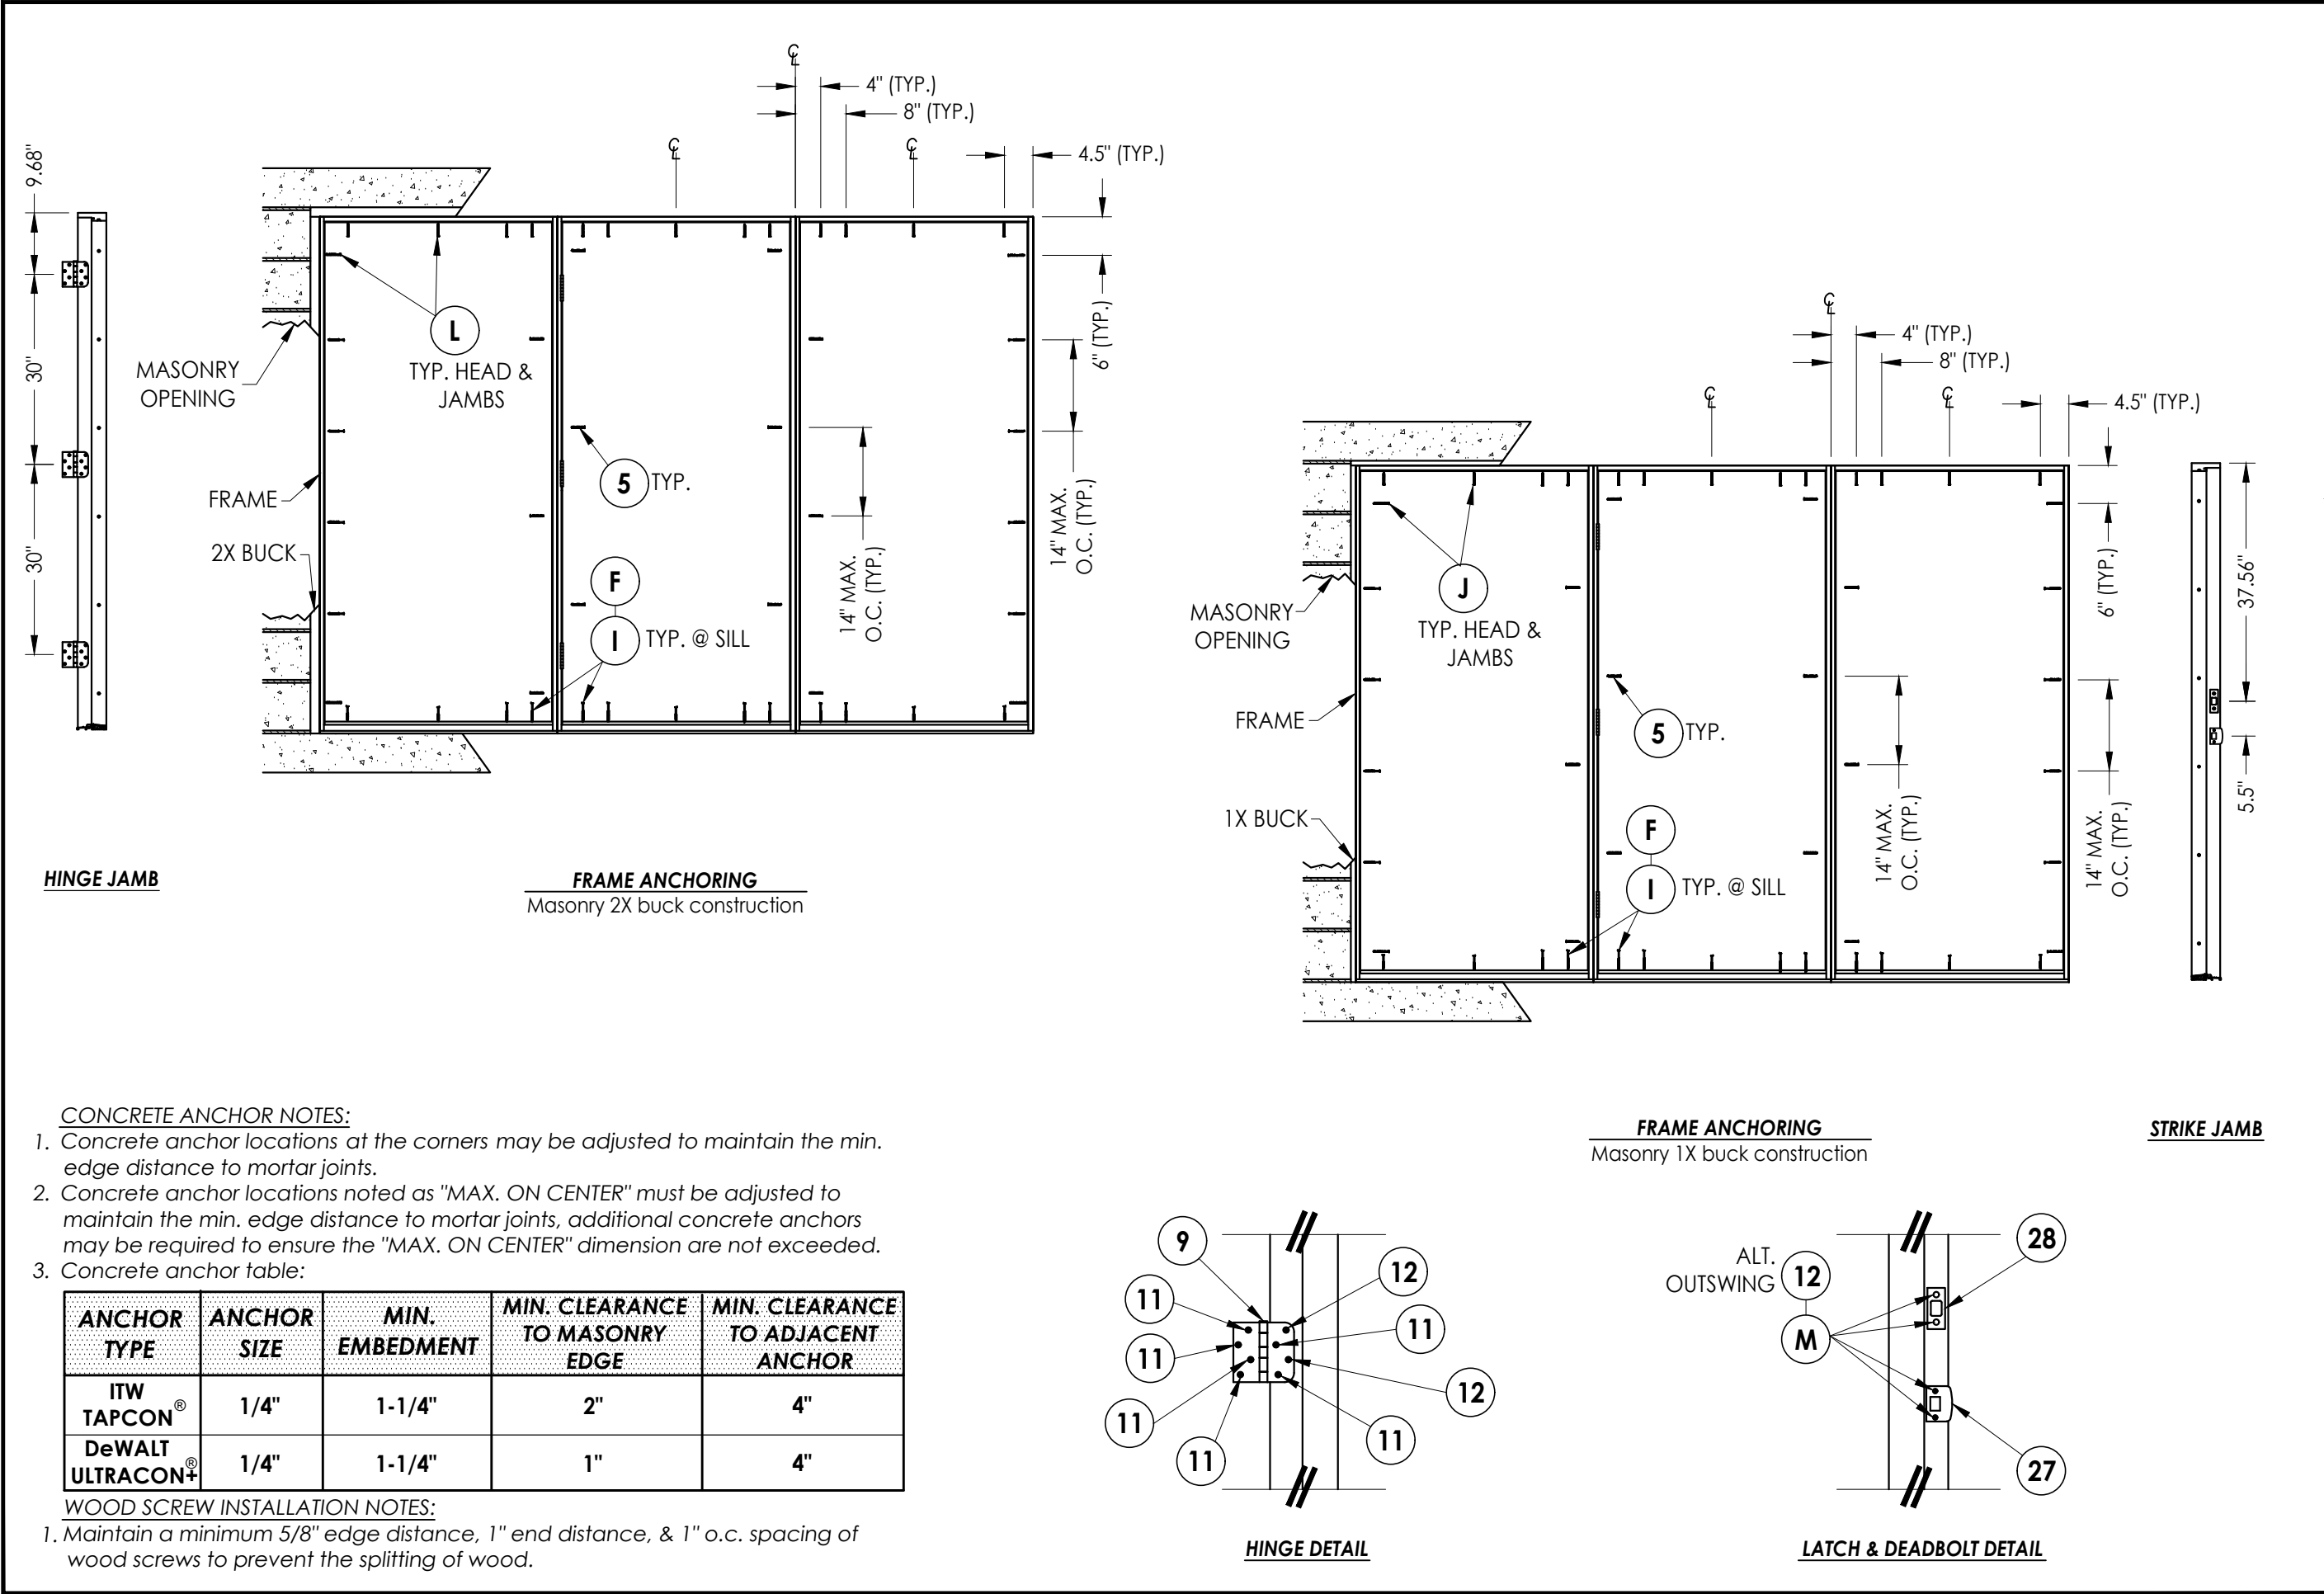

HINGE JAMB

FRAME ANCHORING
Masonry 2X buck construction

FRAME ANCHORING
Masonry 1X buck construction

STRIKE JAMB

HINGE DETAIL

LATCH & DEADBOLT DETAIL

- CONCRETE ANCHOR NOTES:**
- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
 - Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
 - Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"

- WOOD SCREW INSTALLATION NOTES:**
- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PLASTPRO INC.
FIBERGLASS DOOR

PART OR ASSEMBLY:
FRAME ANCHORING

REVISIONS

NO.	DATE	REVISIONS
6	7/02/26	UPDATE TO 9TH ED. (2026) FBC
5	8/15/23	UPDATE TO 8TH ED. (2023) FBC
4	8/05/20	UPDATE TO 7TH ED. (2020) FBC
3	7/25/17	UPDATE TO 6TH ED. (2017) FBC
2	04/22/15	UPDATE TO 5TH ED. (2014) FBC
1	2/27/13	REVISED GLAZING DETAIL


DATE: 02/15/12
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-15215.13
SHEET 10 OF 11

Building Consultants, Inc.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


BILL OF MATERIALS		
ITEM	DESCRIPTION	MATERIAL
A	1X BUCK SG >= 0.55	WOOD
B	2X BUCK SG >= 0.55	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	1/4" X 2-3/4" PFH ITW CONCRETE SCREW	STEEL
H	3/16" x 3-1/4" PFH ITW CONCRETE SCREW	STEEL
I	1/4" X 2-1/4" PFH ITW CONCRETE SCREW	STEEL
J	1/4" X 3-3/4" PFH ITW CONCRETE SCREW	STEEL
K	#9 X 2-1/2" PFH WOOD SCREW	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL
M	#9 X 2-1/4" PFH WOOD SCREW	STEEL
5	#10 X 2" PFH SCREW	STEEL
6	SEALANT	SILICONE
7	Q-LON 650 WEATHER STRIP SCHLEGEL	FOAM
9	4" X 4" BUTT HINGE	STEEL
10	NOT USED	-
11	#9 X 3/4" PFH WOOD SCREW	STEEL
12	#9 X 2" PFH WOOD SCREW	STEEL
17	KWIKSET KEYED ENTRY - SIGNATURE SERIES	STEEL
18	KWIKSET DEADBOLT - SIGNATURE SERIES (780)	STEEL
20	FINGER JOINTED PINE JAMB	WOOD
21	POLY FIBER JAMB	COMP.
22	#10 X 2" PFH WOOD SCREW	STEEL
27	LATCH STRIKE PLATE	STEEL
28	DEADBOLT STRIKE PLATE	STEEL
29	SIDELITE SPACER	PVC
30	WEATHER-STOP 3647 HOLM INDUSTRIES	VINYL
31	OUTSWING BUMP THRESHOLD	ALUM. / WOOD
33	INSWING ADJUSTABLE THRESHOLD BY ENDURA	ALUM. / WOOD
34	INSWING ADJUSTABLE ALUMINUM THRESHOLD BY DLP	ALUM. / WOOD
35	SHOE MOULD 5/8" X 3/8"	WOOD
38	GLAZING SPACER	ALUM.
39	GLAZING BEAD	PVC
40	DOOR PANEL - SEE DOOR PANEL DETAIL SHEET FOR CONSTRUCTION DETAILS	-
41	DOOR SKIN (MIN. 0.075" THICK)	FIBERGLASS
42	TOP RAIL	CELLULAR PVC
43	LATCH & HINGE STILE	CELLULAR PVC
44	LOCK REINFORCEMENT	WOOD
45	BOTTOM RAIL	CELLULAR PVC
46	POLYURETHANE FOAM	POLYURETHANE
47	CONTINUOUS LATCH & HINGE STILE REINFORCEMENT	WOOD
49	GLAZING COMPOUND DOW 995	SILICONE
50	SIDELITE PANEL - SEE SIDELITE PANEL DETAIL SHEET FOR CONSTRUCTION DETAILS	-

CORROSION RESISTANCE - SALTWATER ENVIRONMENT


Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or R332.1.

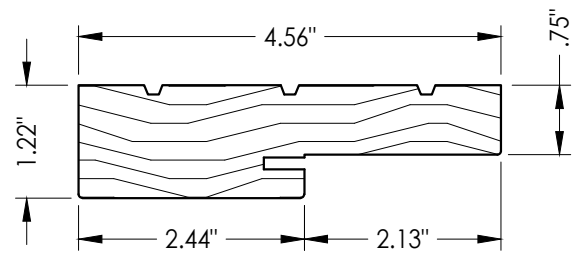


20 WOOD JAMB

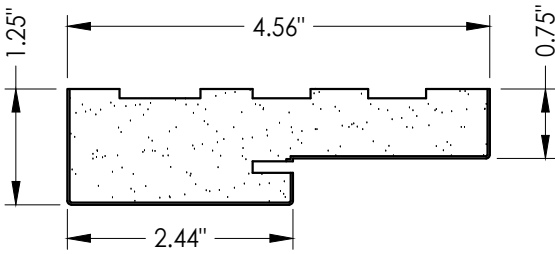


21 POLY FIBER JAMB

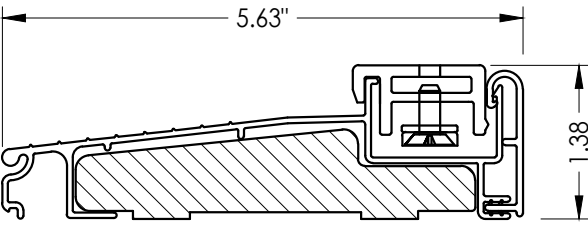


33 ADJUSTABLE INSWING THRESHOLD

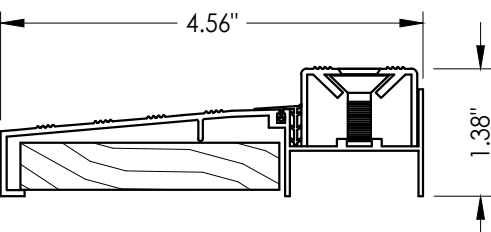


34 ADJUSTABLE INSWING THRESHOLD

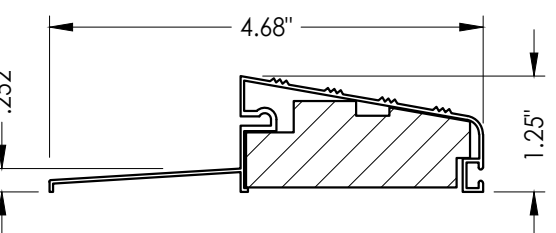

31 OUTSWING BUMP THRESHOLD



29 SIDELITE SPACER

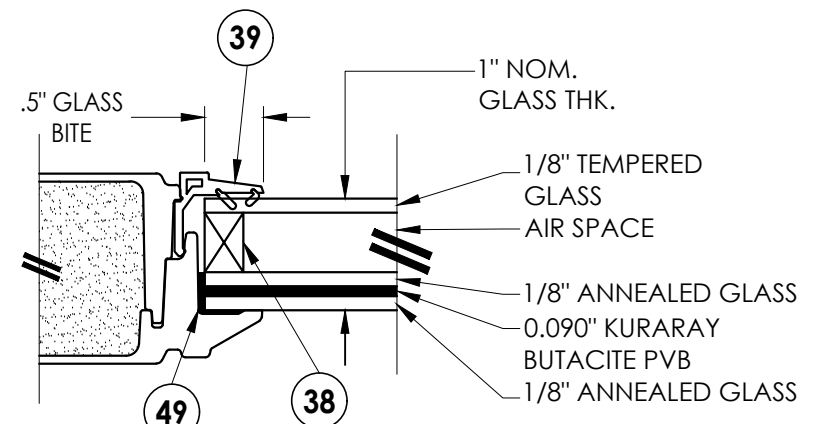

G1 GLAZING DETAIL

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: <u>PLASTPRO INC.</u> <u>FIBERGLASS DOOR</u>		PART OR ASSEMBLY: <u>BILL OF MATERIALS, GLAZING</u> <u>DETAIL & COMPONENTS</u>	
6	7/02/26	UPDATE TO 9TH ED. (2026)	FBC
5	8/15/23	UPDATE TO 8TH ED. (2023)	FBC
4	8/05/20	UPDATE TO 7TH ED. (2020)	FBC
3	7/25/17	UPDATE TO 6TH ED. (2017)	JK
2	04/22/15	UPDATE TO 5TH ED. (2014)	JK
1	2/27/13	REVISED GLAZING DETAIL	RW
NO.	DATE		BY
			REVISIONS
DATE: 02/15/12			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-15215.13			
SHEET 11 OF 11			