
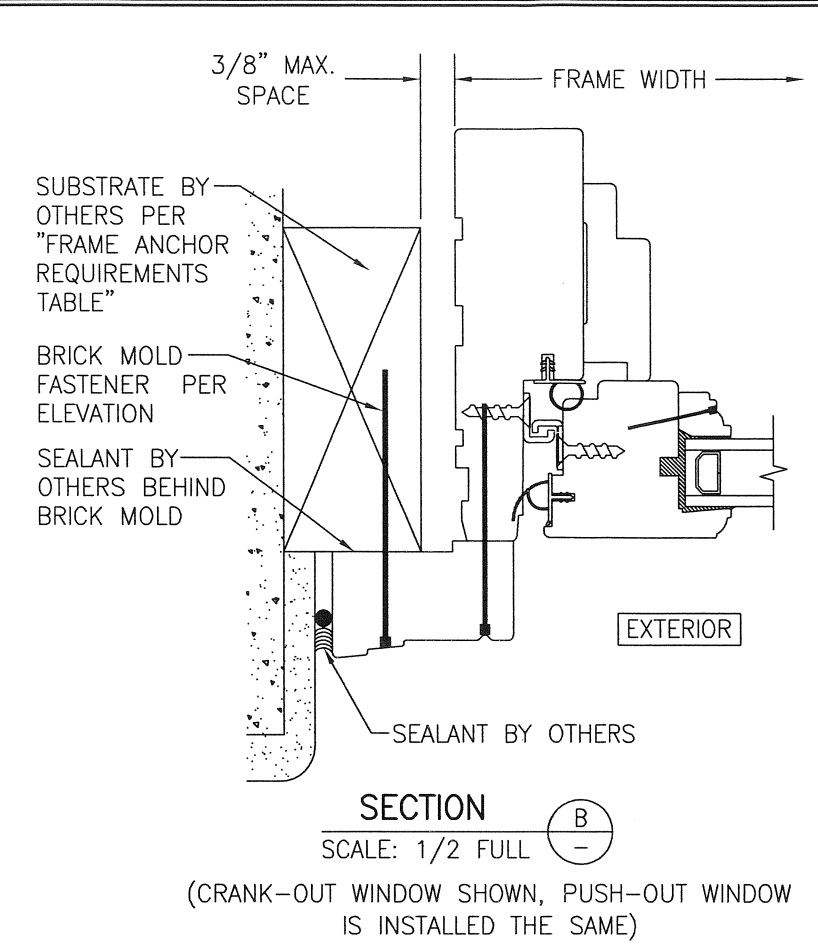


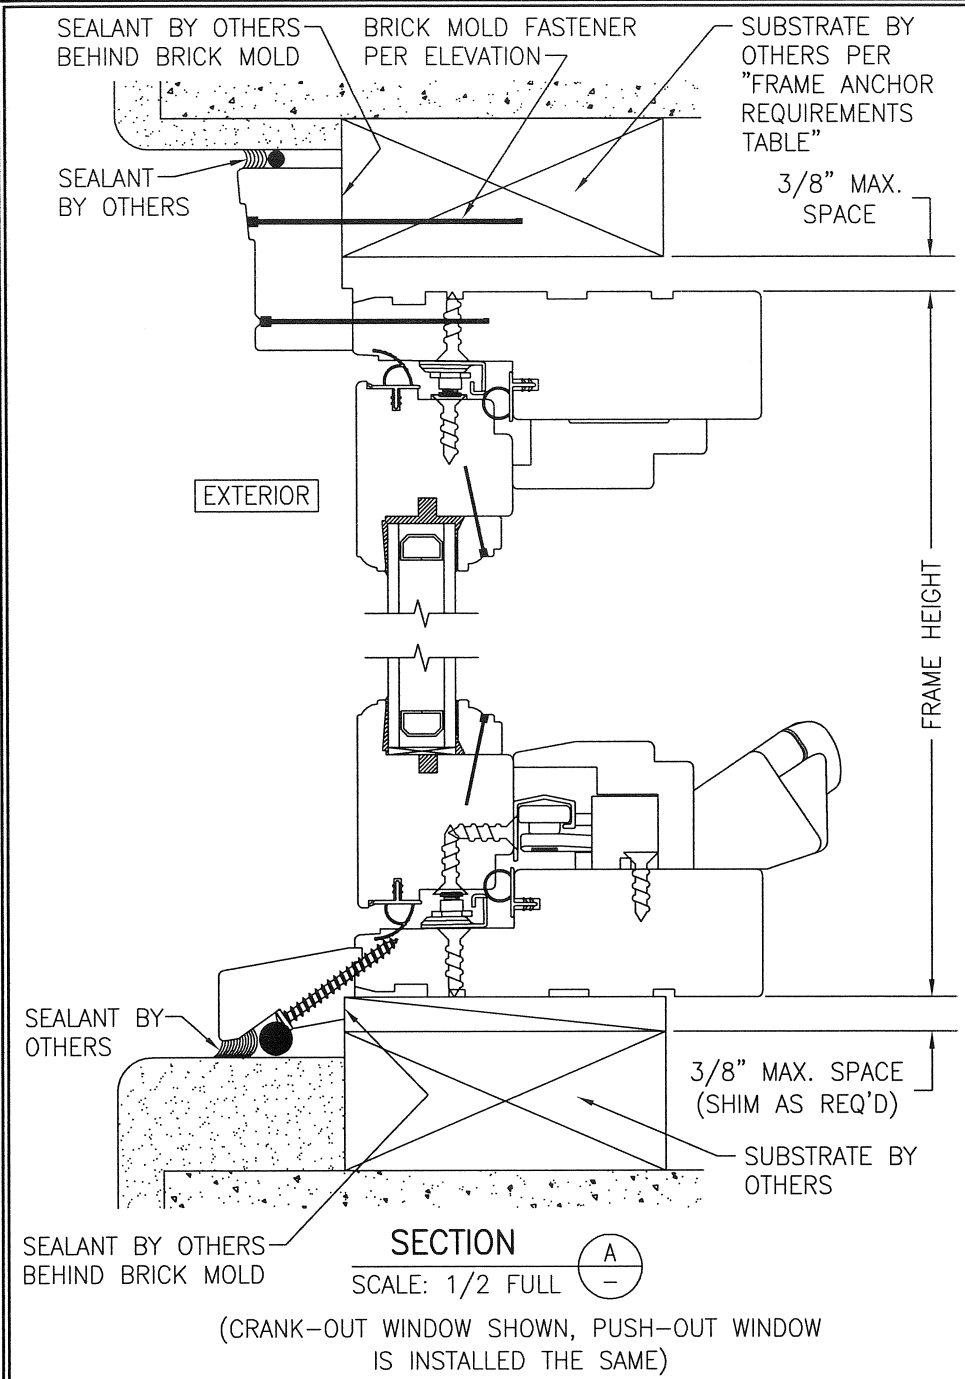


SECTION A
SCALE: 1/2 FULL
(CRANK-OUT WINDOW SHOWN, PUSH-OUT WINDOW IS INSTALLED THE SAME)

- GENERAL NOTES:**
1. ALL FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS. SPECIFIED ANCHOR EMBED TO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.
 2. OPENINGS, BUCKING & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE.
 3. THESE NON-IMPACT RATED WINDOW SYSTEM INSTALLATIONS ARE IN ACCORDANCE WITH AND MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (FBC).
 4. ALL ANCHORS SECURING WINDOW FRAME TO PRESSURE TREATED BUCKS OR WOOD FRAMING SHALL BE CAPABLE OF RESISTING CORROSION CAUSED BY THE PRESSURE TREATING CHEMICALS IN THE WOOD.
 5. MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF FLORIDA BUILDING CODE CHAPTER 20.

FRAME ANCHOR REQUIREMENTS TABLE			
BRICK MOLD FASTENERS			
OPENING TYPE (SUBSTRATE)	BRICK MOLD TO OPENING FASTENER TYPE	MINIMUM EMBED	MINIMUM EDGE DIST.
MIN. 2X4 WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	9 GA. CASING NAIL	2"	1/2"

THESE DRAWINGS ARE APPLICABLE ONLY TO THE PRODUCT SPECIFIED. THEY MAY NOT BE USED FOR THE ASSEMBLY AND/OR INSTALLATION OF ANY OTHER PRODUCT NOR MAY THEY BE USED FOR RATIONAL AND/OR LOCAL APPROVAL OF ANY PRODUCT NOT PRODUCED BY THE MANUFACTURER STATED ON THESE DRAWINGS.

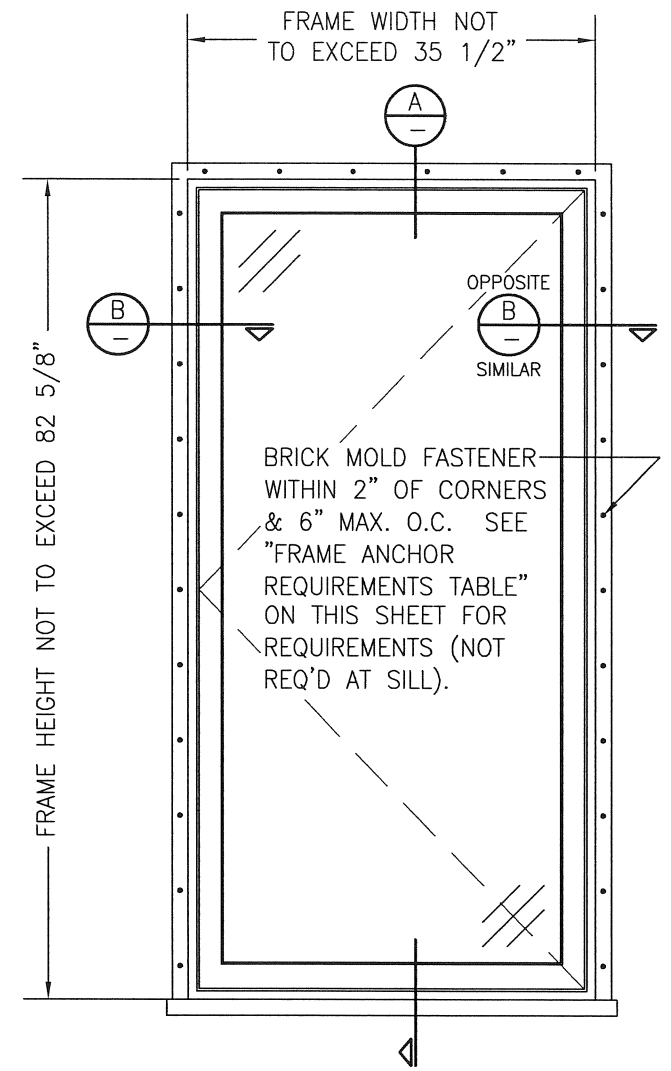

EXTERIOR ELEVATION:
SINGLE WINDOW
SCALE: 3/4" = 1'-0"

DRAWN BY: W.R.M.	
PLOT: 1=16	DATE: 02/28/12
DATE	BY
REVISION DESCRIPTION	NO.
WOOD NON-IMPACT CASEMENT WINDOW	
C.P. LOEWEN ENTERPRISES 77 HWY 52 WEST STEINBACH, MB, CANADA R5G 1B2 204-326-6446	
DRAWING NO. 1797	REV.
SHEET NO. 1	OF 1