




868 MURRAY ROAD, DOTHAN, AL 36303

"REDIFLEX"
TWO-PIECE STEEL FRAME SYSTEM
UTILIZING A
MASONITE DOUBLE OPAQUE STEEL DOOR
"IMPACT"


GENERAL NOTES

- This product has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) structural requirements including the "High Velocity Hurricane Zone" (HVHZ).
- Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
- When used in the "HVHZ" this product complies with Section 1626 of the FBC and does not require an impact resistant covering.
- When used in areas outside of the "HVHZ" requiring wind borne debris protection this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E1996 and FBC Sections 1609.1.2.2 & R301.2.1.2.1.
- For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
- Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.
- Outswing configurations using item #72 meet water infiltration requirements for "HVHZ".
- Configurations using item #70 and #71 do not meet the water infiltration requirements for the "HVHZ" and shall be installed only in non-habitable areas or at habitable locations protected by an overhang or canopy such that the angle between the edge of canopy or overhang to sill is less than 45 degrees.
- When used in the "HVHZ", all steel shall be protected as specified in Section 2222.6 of the FBC.

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	Typical elevation, design pressures & general notes
2	Steel frame cross sections & details
3	Door panel details
4	Horizontal & vertical cross sections
5	Horizontal & vertical cross sections
6	Buck & frame anchoring - masonry 2x buck
7	Buck & frame anchoring - steel/2x stud
8	Astragal details
9	Bill of materials and components

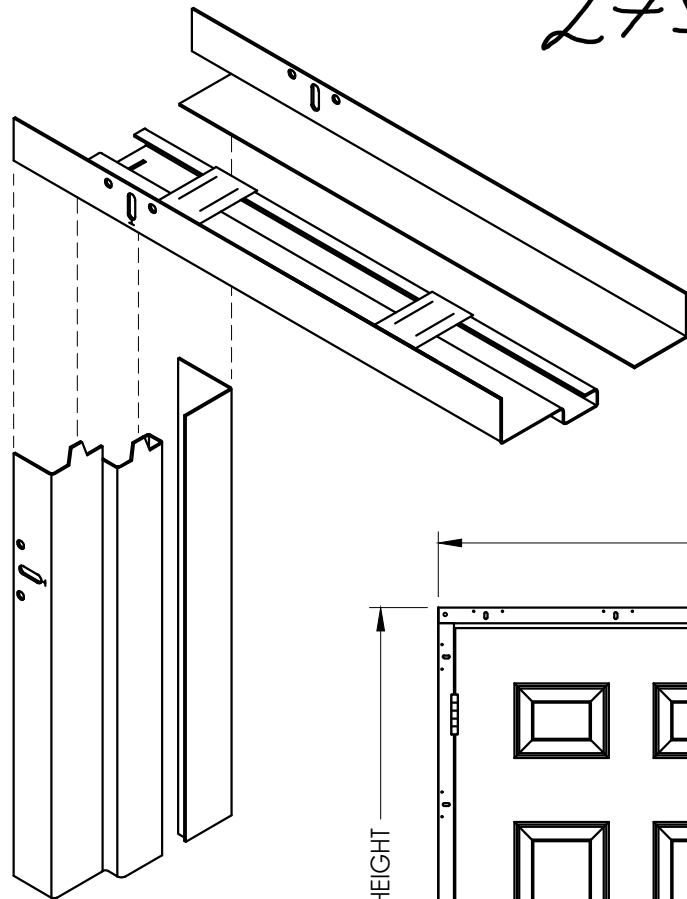


REDIFLEX TWO-PIECE

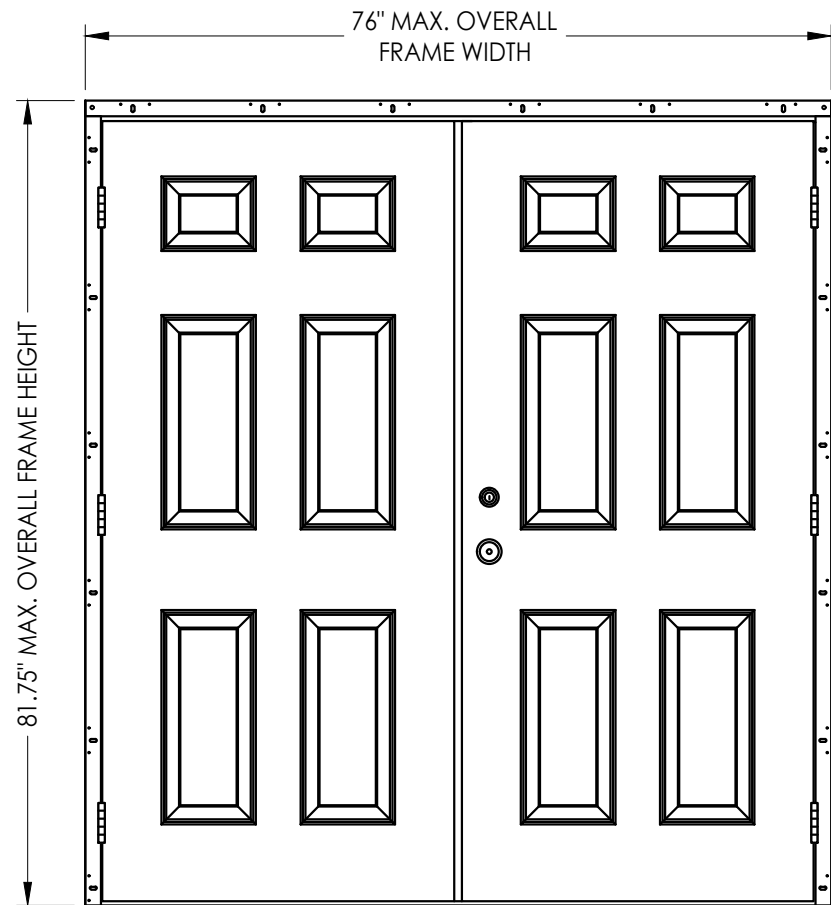

OUTSWING

OVERALL FRAME DIMENSION	THRESHOLD TYPE	DESIGN PRESSURE (PSF) NON-HVHZ		DESIGN PRESSURE (PSF) HVHZ	
		POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
76.0" X 81.75"	ADA	+ 55.0	- 55.0	+ 55.0*	- 55.0*
76.0" X 81.75"	STANDARD BUMP	+ 55.0	- 55.0	+ 50.0	- 50.0
76.0" X 81.75"	HIGH DAM	+ 55.0	- 55.0	+ 55.0	- 55.0

*See General Note #8

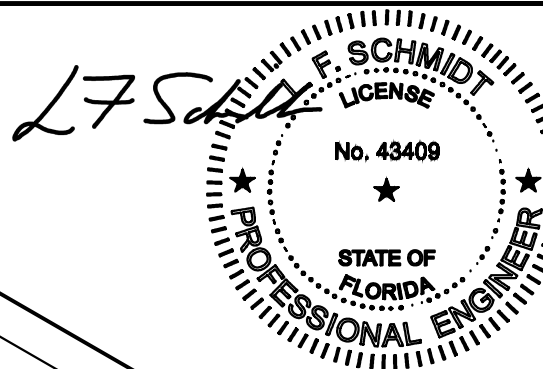

Digitally signed
by Lyndon F
Schmidt
Date:
2026.07.01
12:39:18 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
DUNBARTON REDIFLEX
TWO-PIECE STEEL FRAME

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

NO.	DATE	REVISIONS				
		5	4	3	2	1
5	7/01/26	UPDATE TO 9TH ED. (2026) FBC	LFS			
4	7/06/23	UPDATE TO 8TH ED. (2023) FBC	LFS			
3	8/11/20	UPDATE TO 7TH ED. (2020) FBC	DAC			
2	9/30/17	UPDATE TO 6TH ED. (2017) FBC	LFS			
1	3/23/15	UPDATE TO 5TH ED. (2014) FBC	JK			

DATE: 6/3/13

SCALE: N.T.S.



DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:
FL-15341.7

SHEET 1 OF 9

G:\2023 FBC Drawings 1.26.26\Dunbarton Corp\FL-15341 R10 Rediflex\FL-15341.5-8.dwg

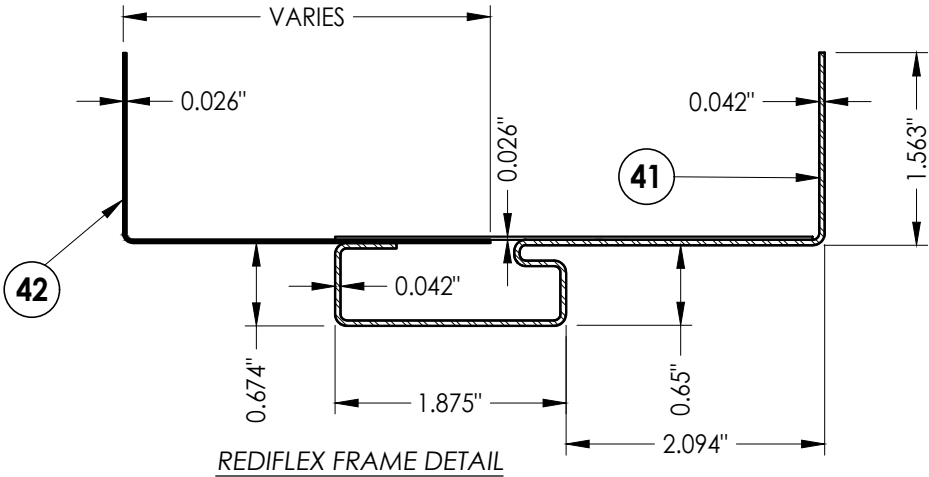
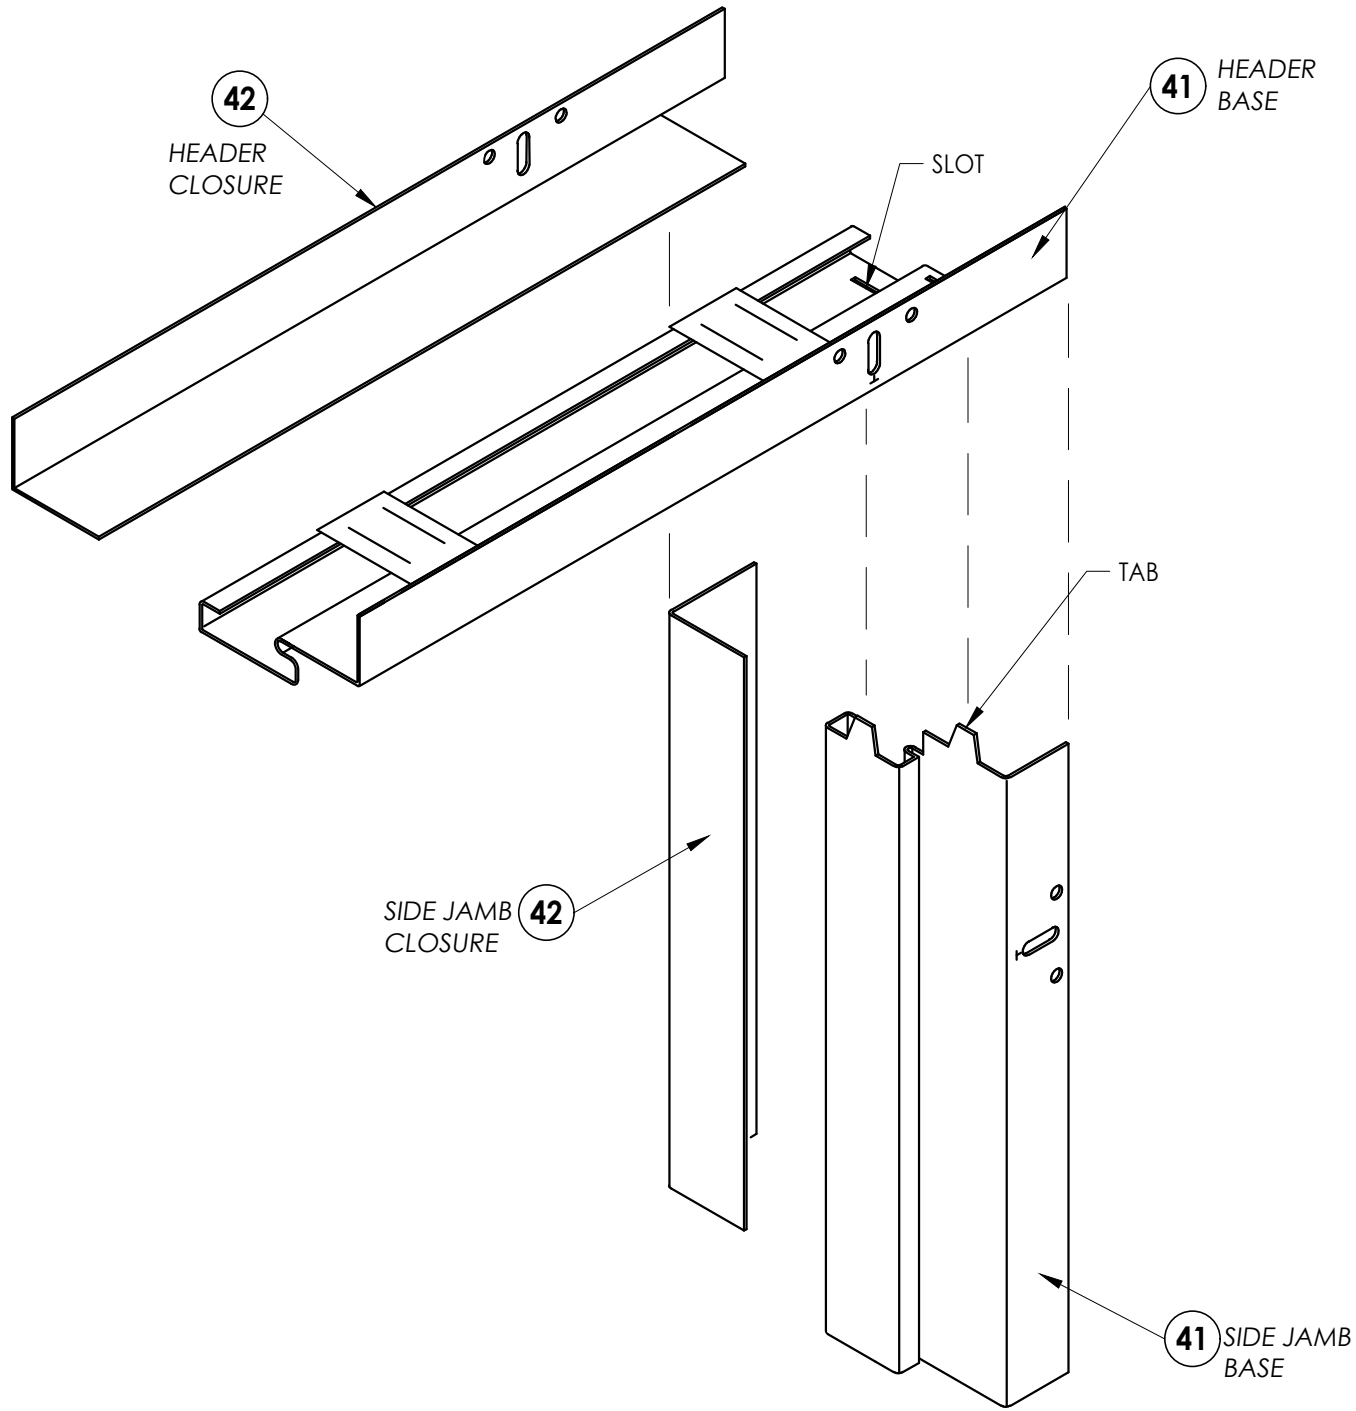


NOTES:


1. HEADER AND SIDE BASE JAMB (41) MINIMUM 18 GA. GALV. STEEL.
2. HEADER AND SIDE CLOSURE JAMB (42) MINIMUM 22 GA. GALV. STEEL.
3. FRAME SHOWN WITHOUT OPTIONAL STEEL TRIM CASING.
4. NON-KERF FRAMES DO NOT MEET AIR AND WATER CRITERIA.

PRODUCT:		DUNBARTON REDIFLEX TWO-PIECE STEEL FRAME		PART OR ASSEMBLY:		STEEL FRAME CROSS SECTION & DETAILS		Documents Prepared By:		Lyndon F. Schmidt P.E. No. 43409		RW BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
5	7/01/26	UPDATE TO 9TH ED. (2026)	FBC	LFS	JK	BY							
4	7/06/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	JK	BY							
3	8/11/20	UPDATE TO 7TH ED. (2020)	FBC	LFS	JK	BY							
2	9/30/17	UPDATE TO 6TH ED. (2017)	FBC	LFS	JK	BY							
1	3/23/15	UPDATE TO 5TH ED. (2014)	FBC	LFS	JK	BY							
NO.		DATE		REVISIONS									
DATE:		6/3/13											
SCALE:		N.T.S.											
DWG. BY:		JK											
CHK. BY:		LFS											
DRAWING NO.:		FL-15341.7											
SHEET		2		OF		9							


G:\2023 FBC Drawings 1.26.26\Dunbarton Corp\FL-15341 R10 Rediflex\FL-15341.5-8.dwg

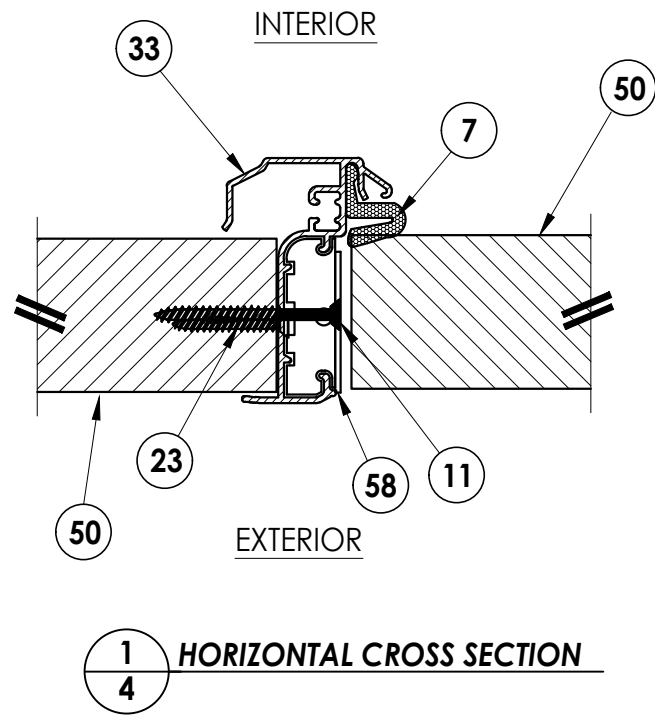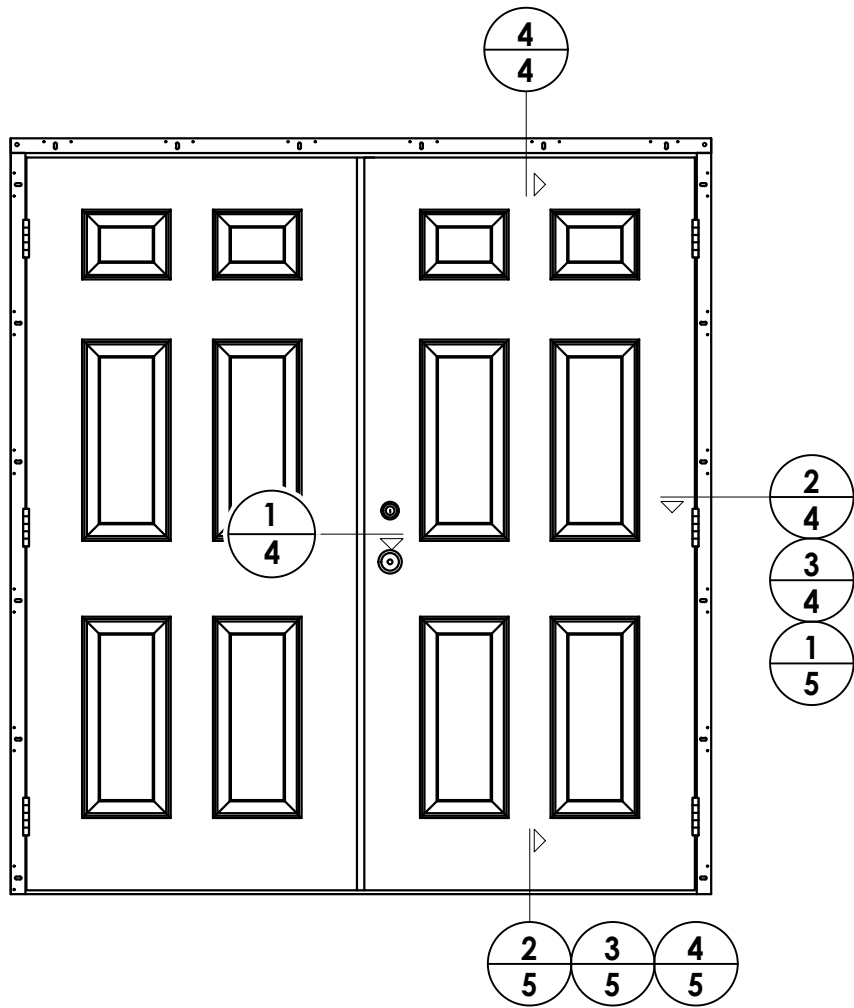


1
4 HORIZONTAL CROSS SECTION

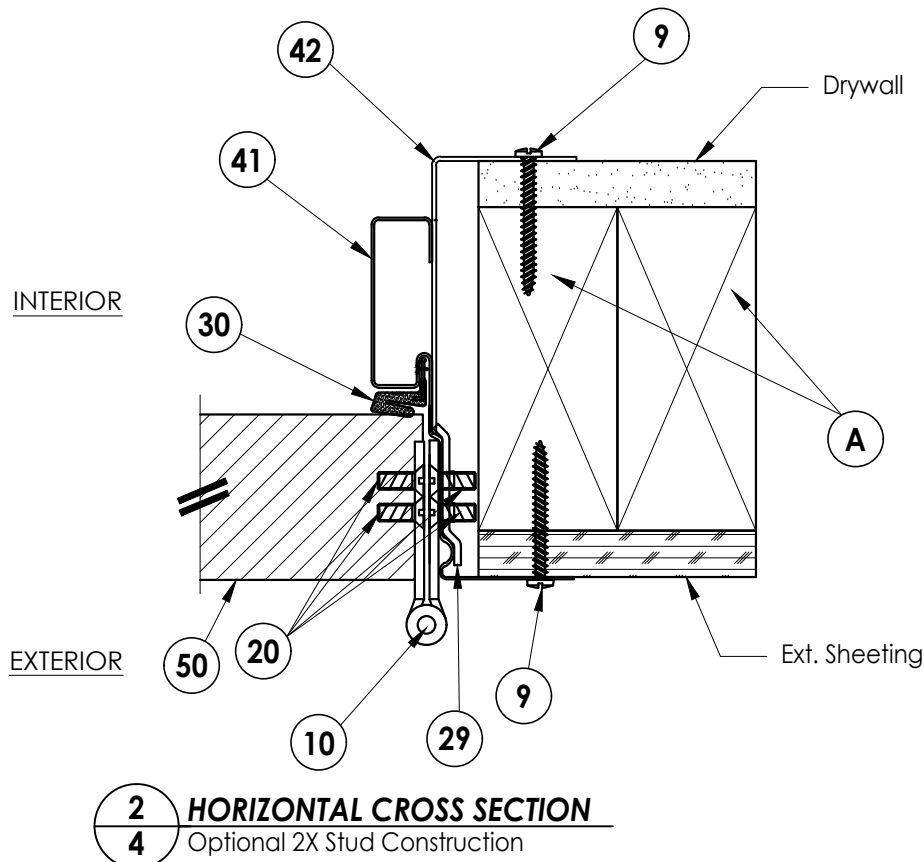

2
4 HORIZONTAL CROSS SECTION
Optional 2X Stud Construction

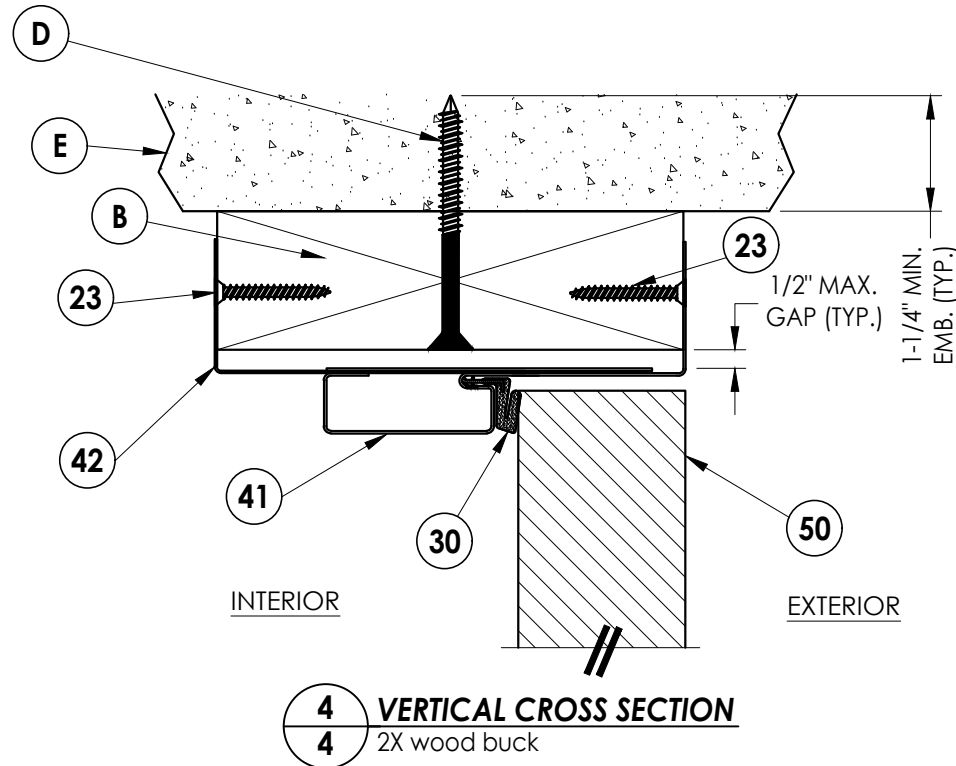

4
4 VERTICAL CROSS SECTION
2X wood buck

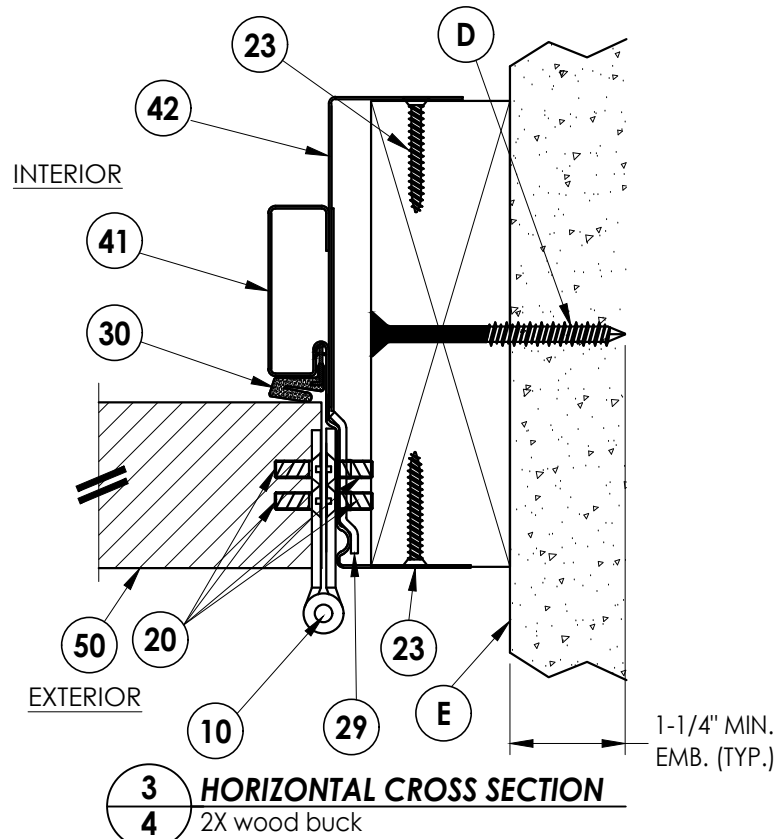


3
4 HORIZONTAL CROSS SECTION
2X wood buck


Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: DUNBARTON REDIFLEX TWO-PIECE STEEL FRAME		PART OR ASSEMBLY: HORIZONTAL & VERTICAL CROSS SECTIONS	
5	7/01/26	UPDATE TO 9TH ED. (2026)	FBC LFS
4	7/06/23	UPDATE TO 8TH ED. (2023)	FBC LFS
3	8/11/20	UPDATE TO 7TH ED. (2020)	FBC DAC
2	9/30/17	UPDATE TO 6TH ED. (2017)	FBC LFS
1	3/23/15	UPDATE TO 5TH ED. (2014)	FBC JK
NO. DATE		REVISIONS	
DATE: 6/3/13			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-15341.7			
SHEET 4 OF 9			

G:\2023 FBC Drawings 1.26.26\Dunbarton Corp\FL-15341 R10 Rediflex\FL-15341.5-8.dwg


Note:
1. A minimum of three threads must protrude completely through the supporting steel stud.

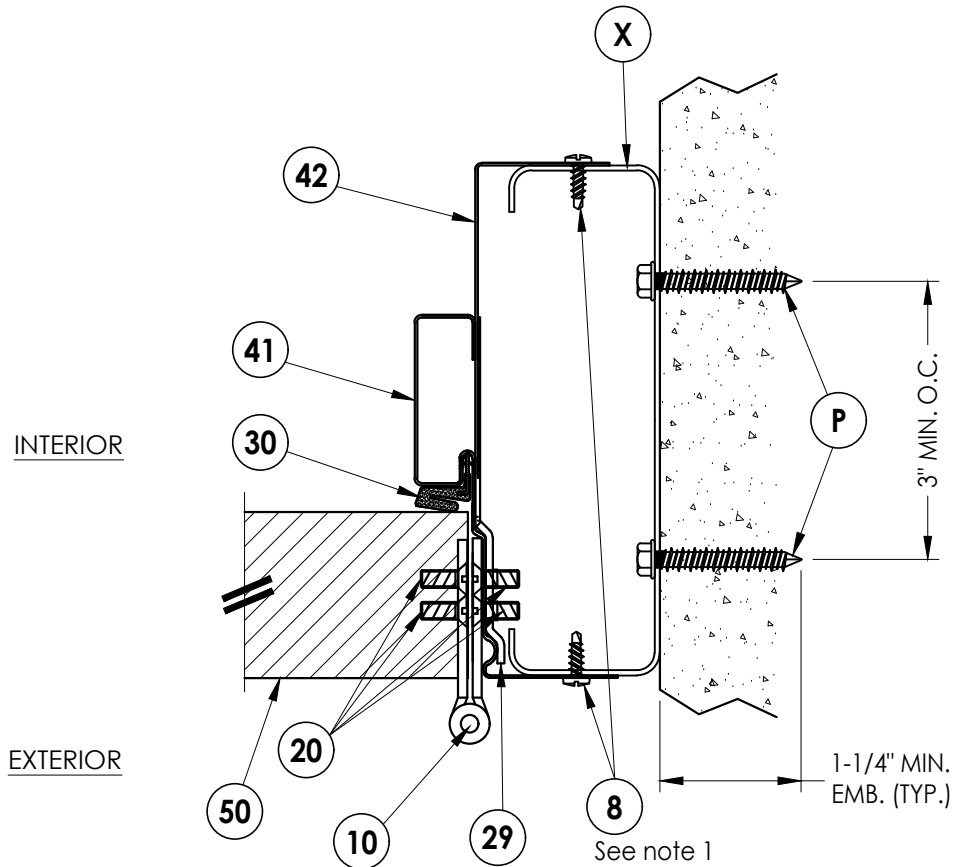


1
5 **HORIZONTAL CROSS SECTION**
Optional steel stud construction

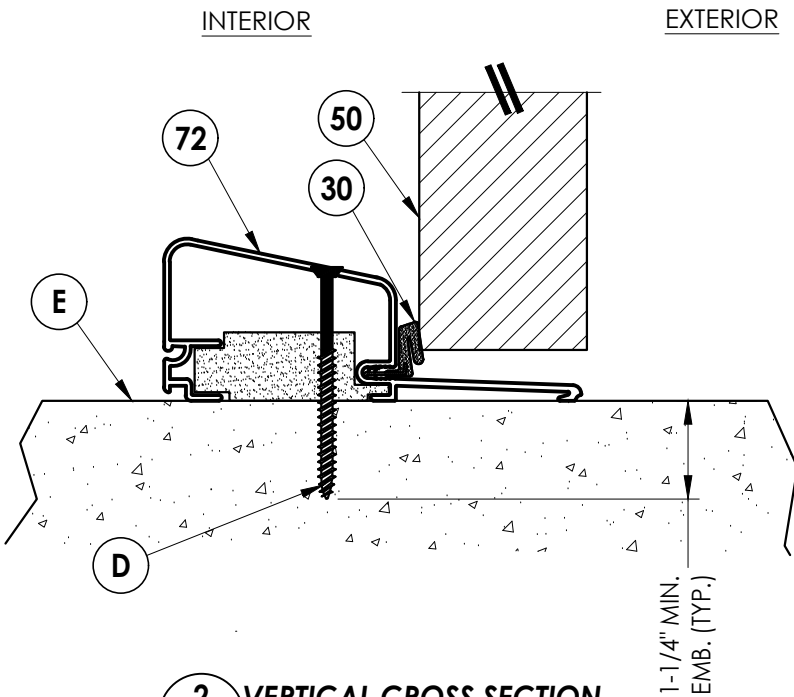

2
5 **VERTICAL CROSS SECTION**
Shown w/ High Dam Threshold

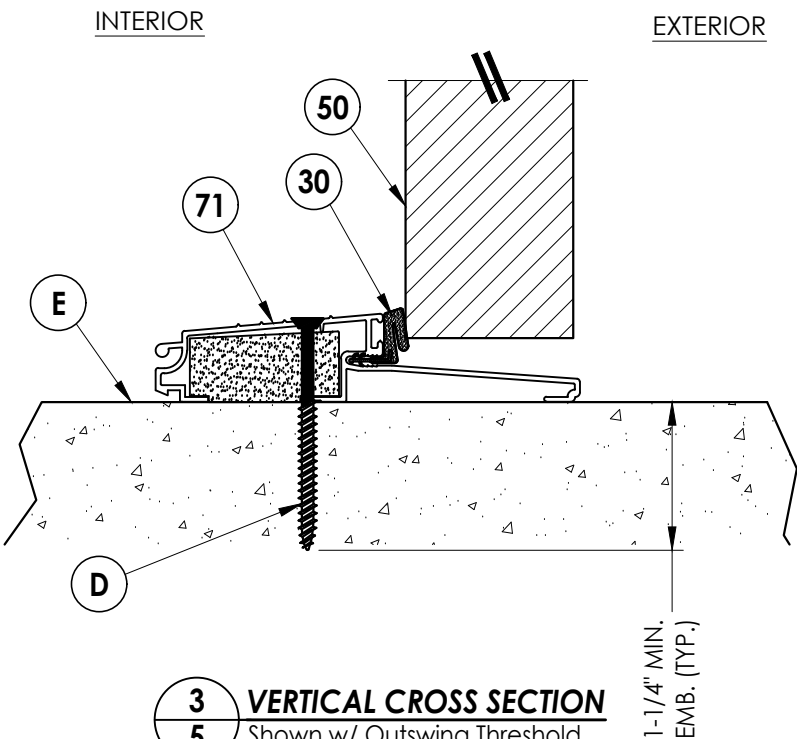

3
5 **VERTICAL CROSS SECTION**
Shown w/ Outswing Threshold

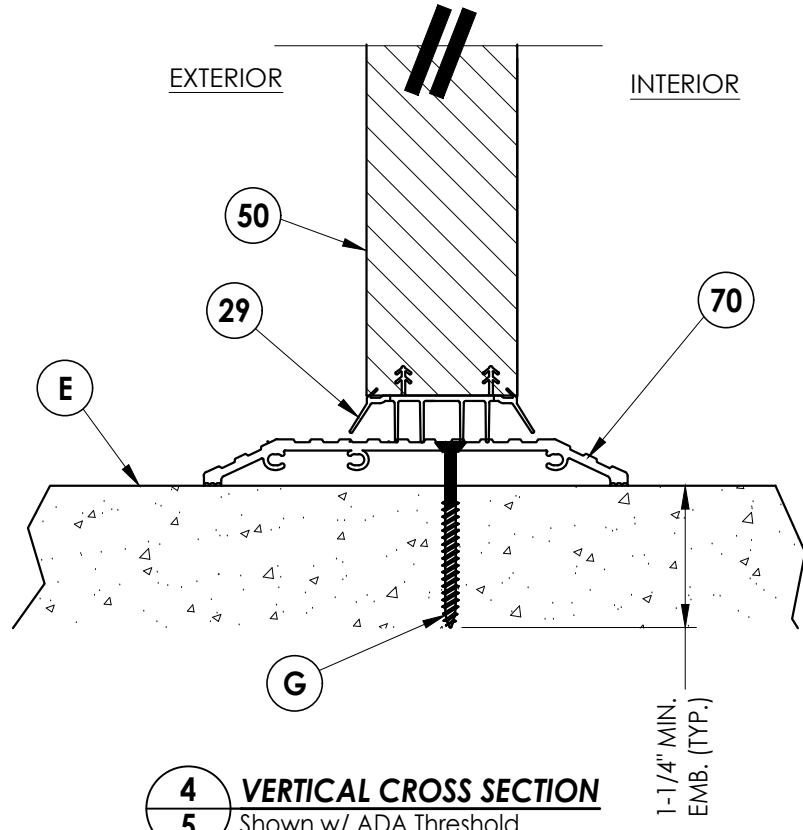

4
5 **VERTICAL CROSS SECTION**
Shown w/ ADA Threshold

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


PRODUCT:
DUNBARTON REDIFLEX
TWO-PIECE STEEL FRAME

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS


NO.	DATE	REVISIONS
5	7/01/26	UPDATE TO 9TH ED. (2026) FBC
4	7/06/23	UPDATE TO 8TH ED. (2023) FBC
3	8/11/20	UPDATE TO 7TH ED. (2020) FBC
2	9/30/17	UPDATE TO 6TH ED. (2017) FBC
1	3/23/15	UPDATE TO 5TH ED. (2014) FBC

DATE: 6/3/13
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-15341.7
SHEET 5 OF 9


G:\2023 FBC Drawings 1.26.26\Dunbarton Corp\FL-15341 R10 Rediflex\FL-15341.5-8.dwg

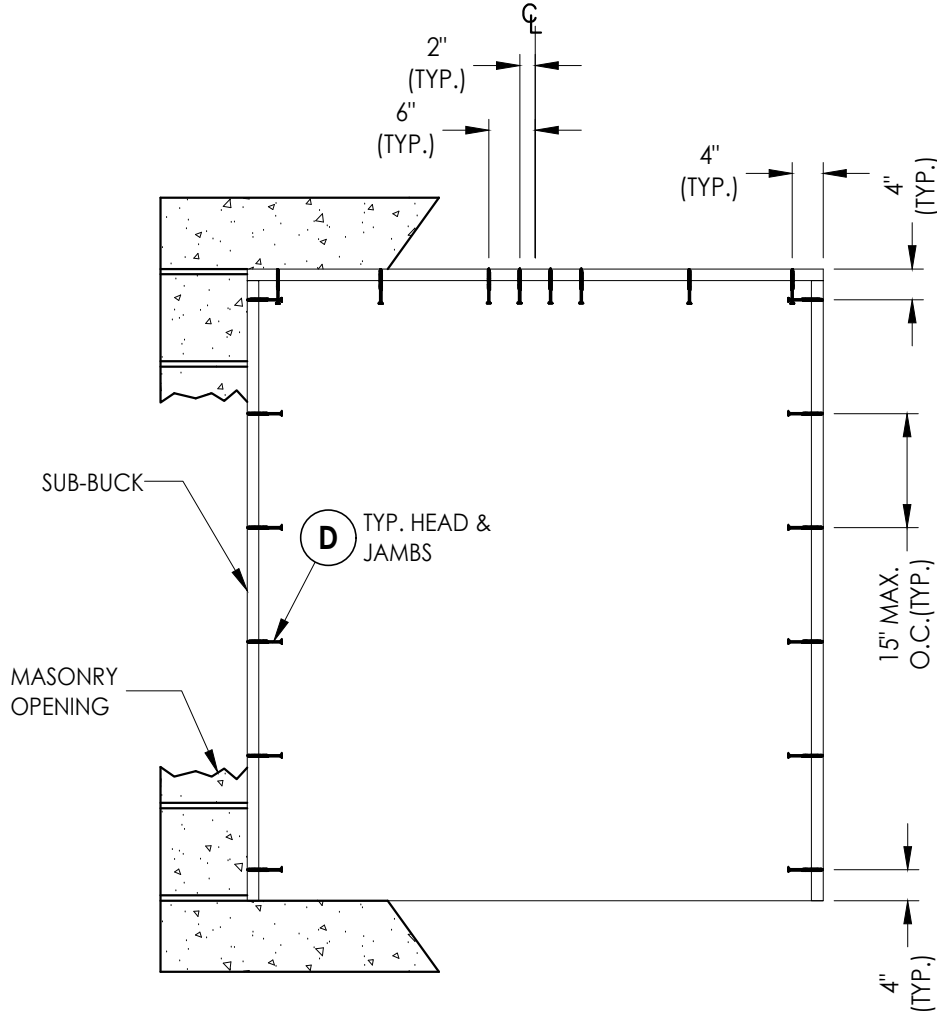

BUCK ANCHORING
Masonry 2X buck construction

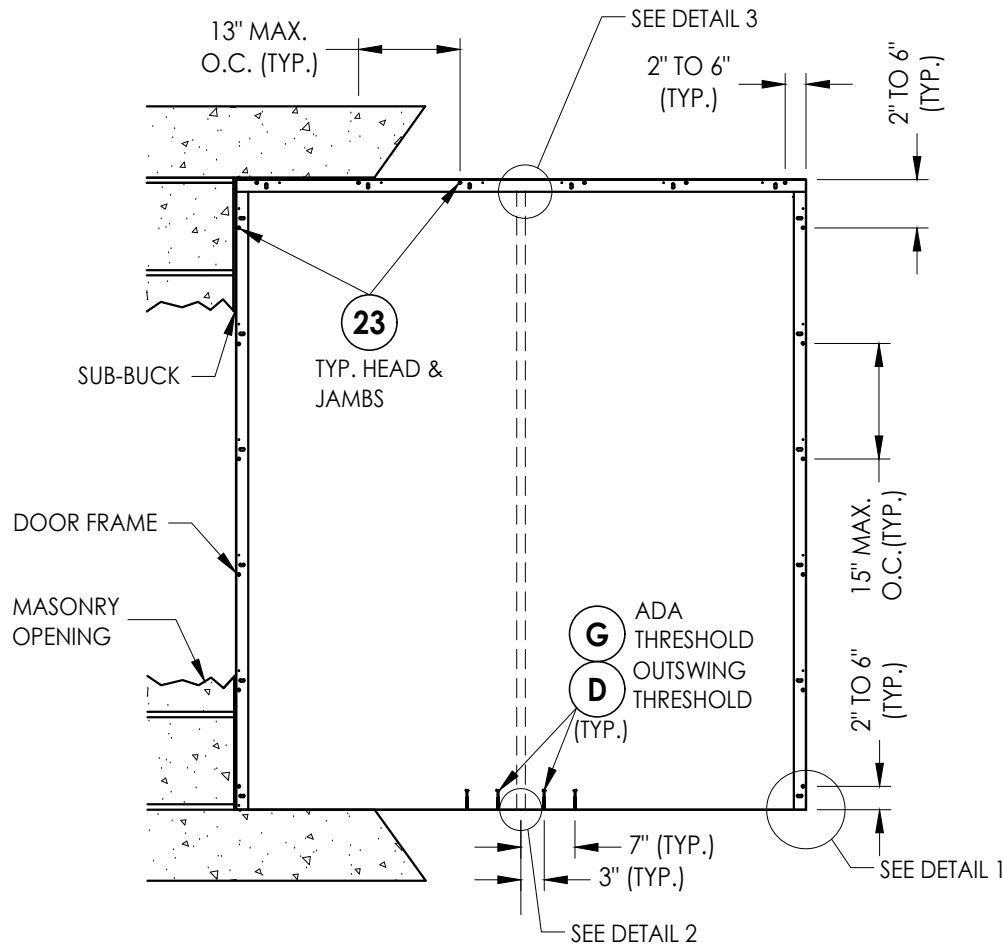

FRAME ANCHORING
Masonry 2X buck construction

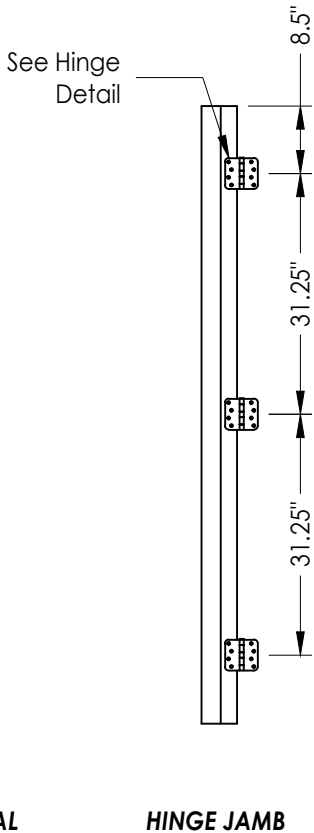

HINGE JAMB



CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

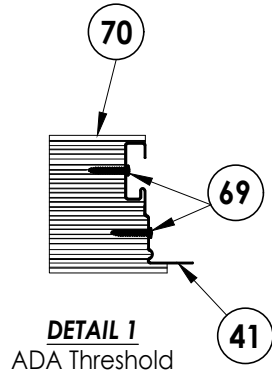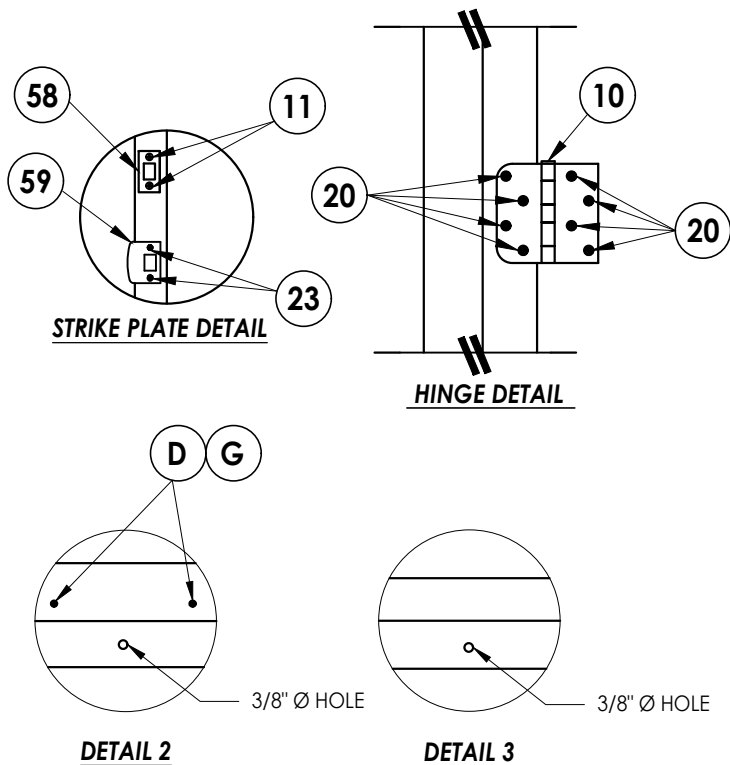

DETAIL 1
ADA Threshold

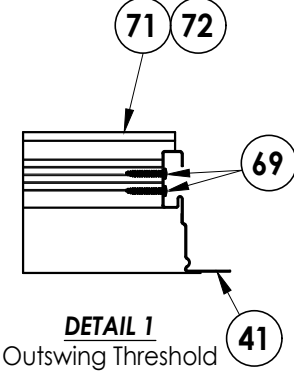

DETAIL 1
Outswing Threshold

PRODUCT:
DUNBARTON REDIFLEX
TWO-PIECE STEEL FRAME

PART OR ASSEMBLY:
BUCK AND FRAME ANCHORING
MASONRY 2X BUCK

NO.	DATE	REVISIONS
5	7/01/26	UPDATE TO 9TH ED. (2026) FBC LFS
4	7/06/23	UPDATE TO 8TH ED. (2023) FBC LFS
3	8/11/20	UPDATE TO 7TH ED. (2020) FBC DAC
2	9/30/17	UPDATE TO 6TH ED. (2017) FBC LFS
1	3/23/15	UPDATE TO 5TH ED. (2014) FBC JK

DATE: 6/3/13

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:


FL-15341.7

SHEET 6 OF 9


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


G:\2023 FBC Drawings 1.26.26\Dunbarton Corp\FL-15341 R10 Rediflex\FL-15341.5-8.dwg

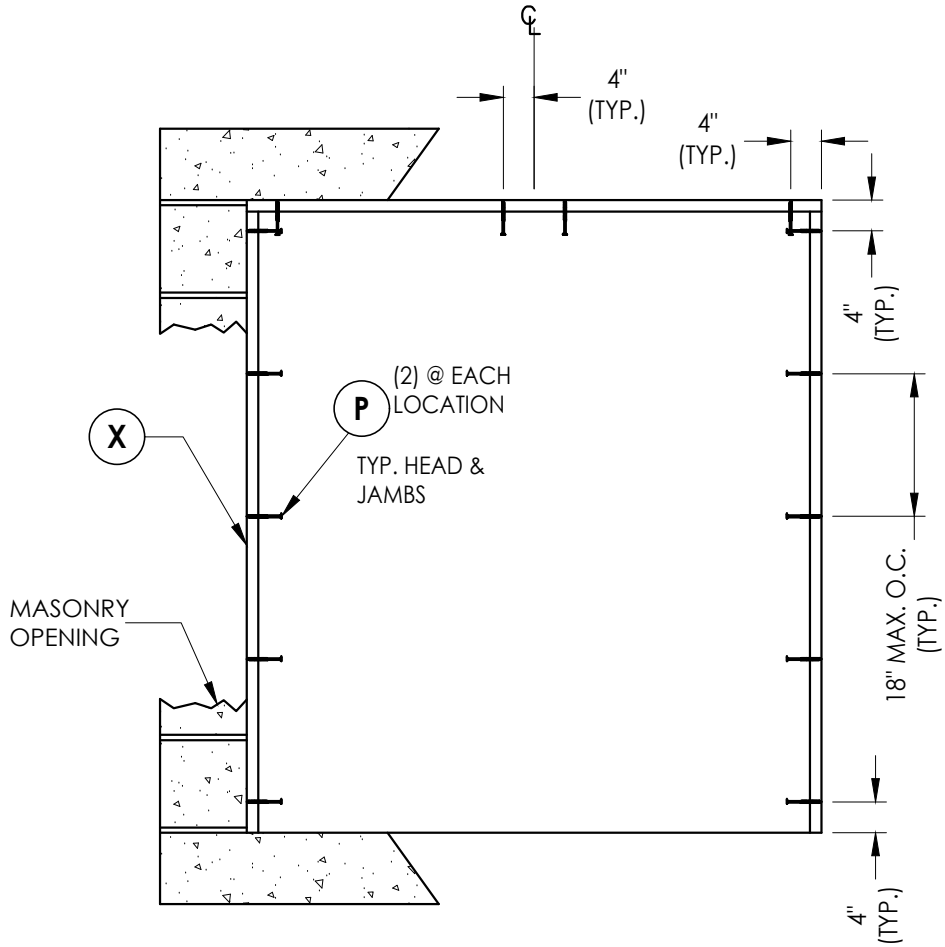

BUCK ANCHORING
Masonry steel stud construction

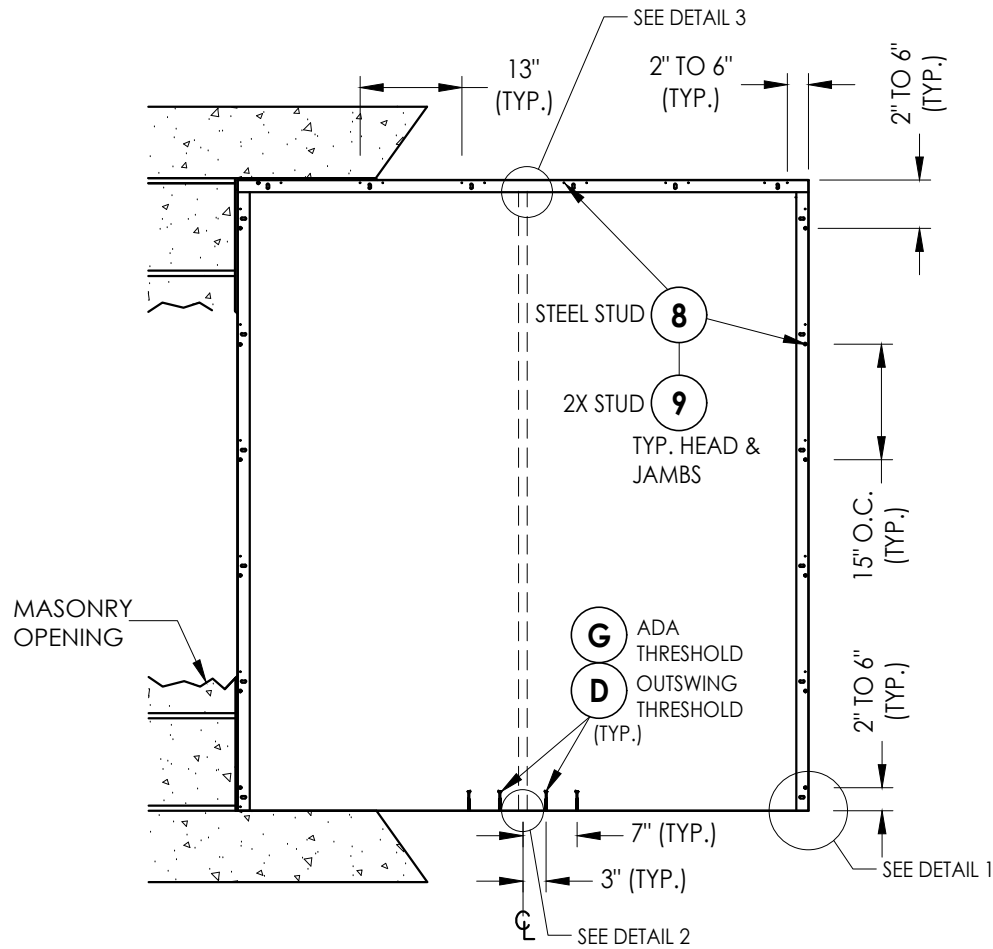

FRAME ANCHORING
Stud construction

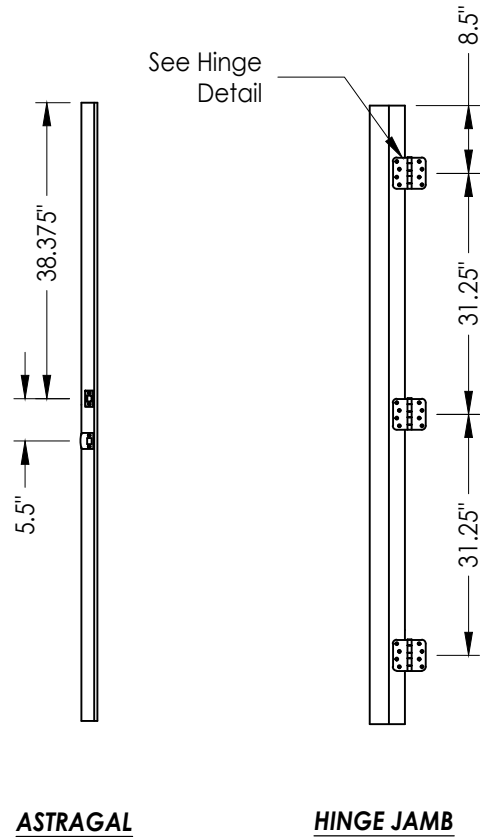

ASTRAGAL

HINGE JAMB


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4" / 3" (steel stud)
DeWALT ULTRACON+®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:


- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

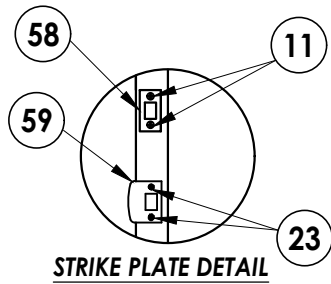


STRIKE PLATE DETAIL

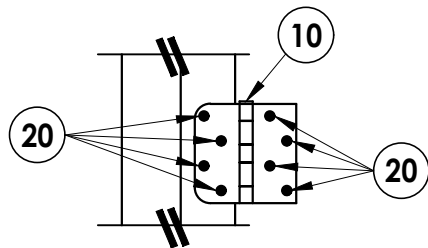


HINGE DETAIL

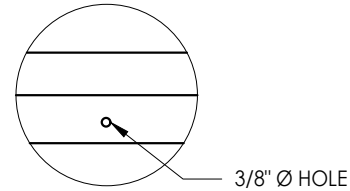


DETAIL 3

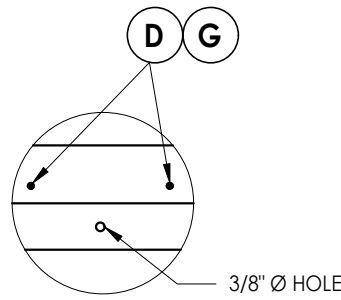

DETAIL 2

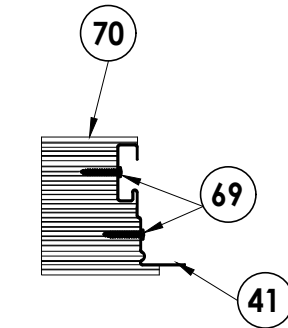

DETAIL 1
ADA Threshold

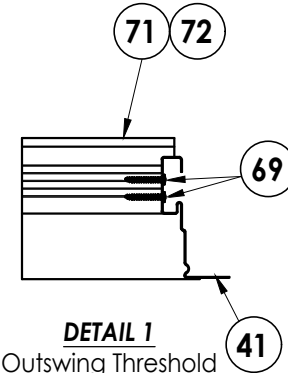

DETAIL 1
Outswing Threshold

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
DUNBARTON REDIFLEX
TWO-PIECE STEEL FRAME

PART OR ASSEMBLY:
BUCK & FRAME ANCHORING
STEEL/2X STUD

NO.	DATE	REVISIONS
5	7/01/26	UPDATE TO 9TH ED. (2026) FBC LFS
4	7/06/23	UPDATE TO 8TH ED. (2023) FBC LFS
3	8/11/20	UPDATE TO 7TH ED. (2020) FBC DAC
2	9/30/17	UPDATE TO 6TH ED. (2017) FBC LFS
1	3/23/15	UPDATE TO 5TH ED. (2014) FBC JK

DATE: 6/3/13

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS


DRAWING NO.: FL-15341.7

SHEET 7 OF 9



G:\2023 FBC Drawings 1.26.26\Dunbarton Corp\FL-15341 R10 Rediflex\FL-15341.5-8.dwg

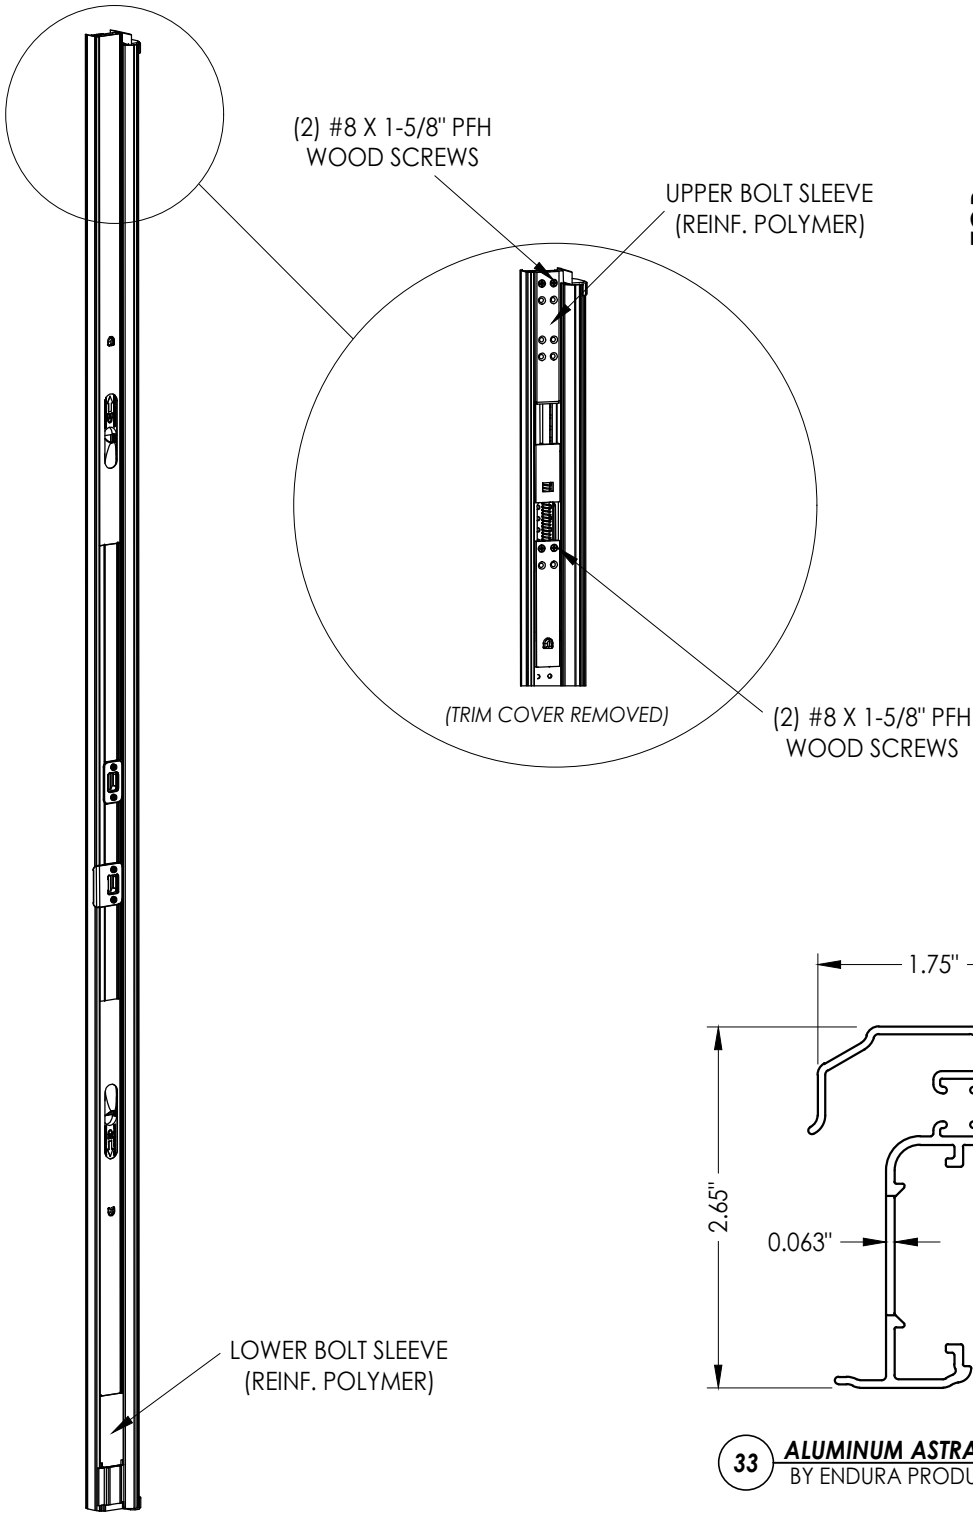


ULTIMATE HURRICANE ASTRAGAL

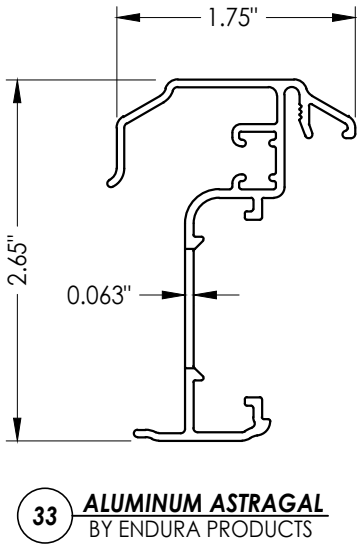

33 ALUMINUM ASTRAGAL
BY ENDURA PRODUCTS

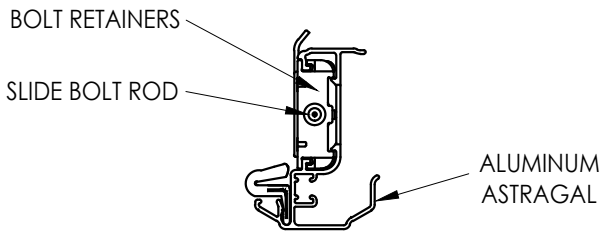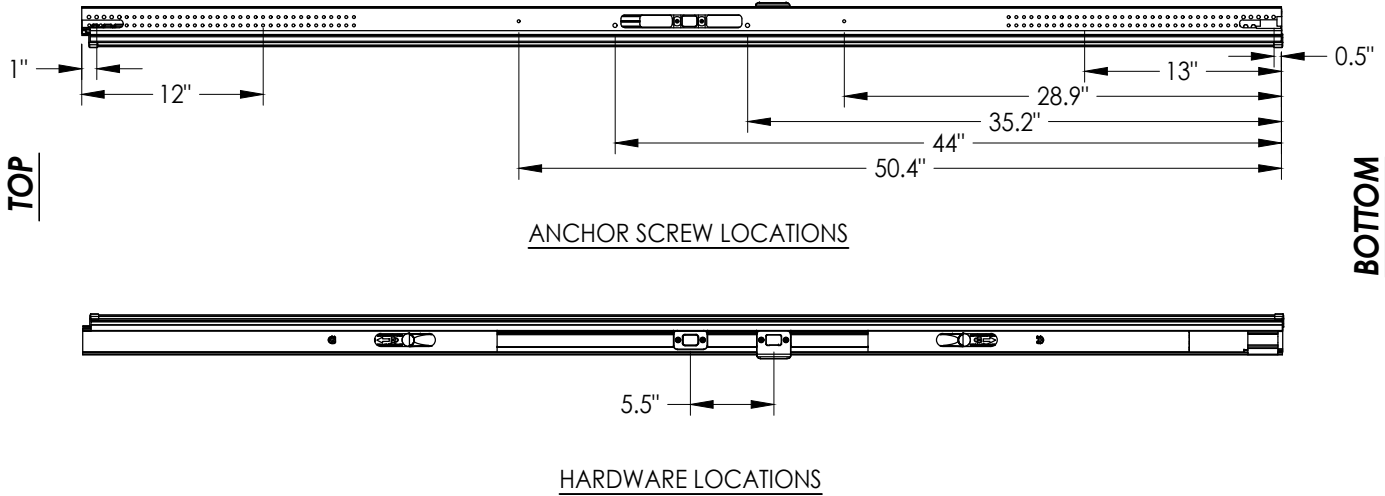

ALUMINUM ASTRAGAL ASSEMBLY

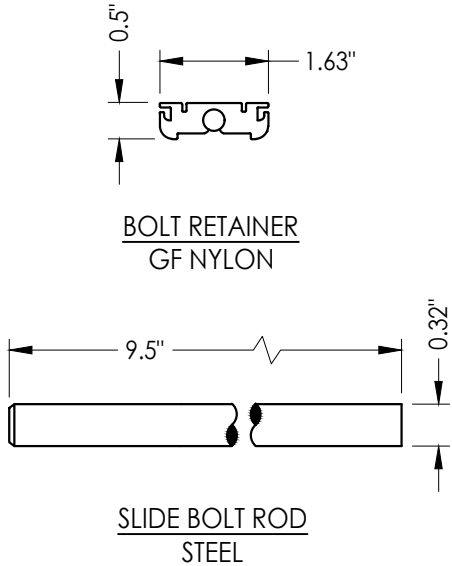

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: DUNBARTON REDIFLEX TWO-PIECE STEEL FRAME		PART OR ASSEMBLY: ASTRAGAL DETAILS	
5	7/01/26	UPDATE TO 9TH ED. (2026)	FBC
4	7/06/23	UPDATE TO 8TH ED. (2023)	FBC
3	8/11/20	UPDATE TO 7TH ED. (2020)	FBC
2	9/30/17	UPDATE TO 6TH ED. (2017)	FBC
1	3/23/15	UPDATE TO 5TH ED. (2014)	FBC
NO.	DATE	REVISIONS	
DATE: 6/3/13			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-15341.7			
SHEET 8 OF 9			

