




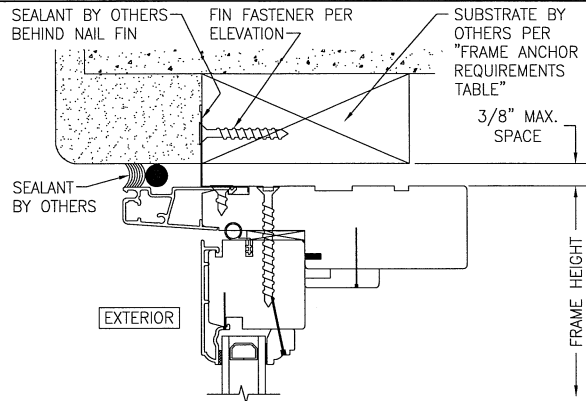


SECTION A-1
SCALE: 1/2 FULL
WITH 1 3/4" DEEP SASH

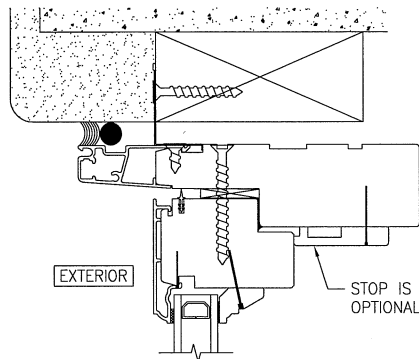

SECTION A-1
SCALE: 1/2 FULL
WITH 2 1/4" DEEP SASH
(FOR INSTALLATION DETAIL, SEE SECTION A/1 WITH 1 3/4" SASH)

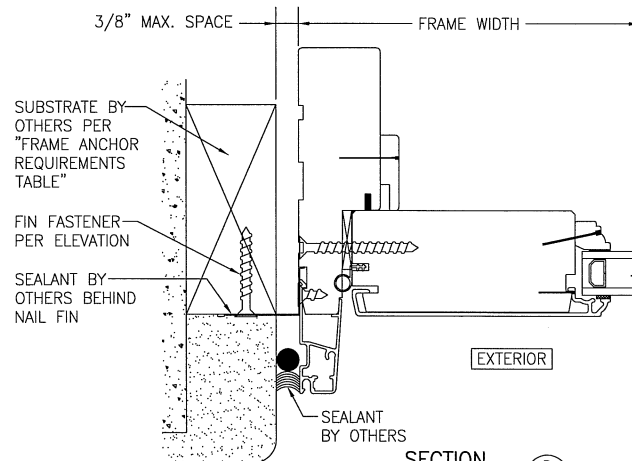

SECTION B-1
SCALE: 1/2 FULL
WITH 1 3/4" DEEP SASH

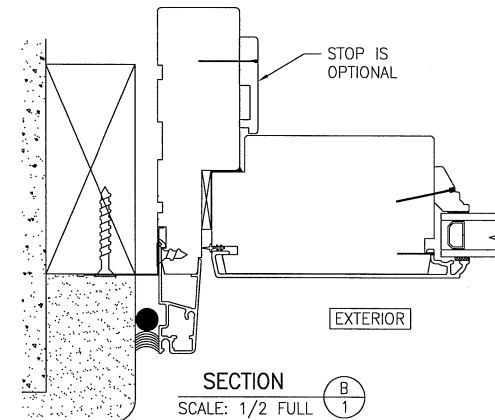

SECTION B-1
SCALE: 1/2 FULL
WITH 2 1/4" DEEP SASH
(FOR INSTALLATION DETAIL, SEE SECTION B/1 WITH 1 3/4" SASH)

THESE DRAWINGS ARE APPLICABLE ONLY TO THE PRODUCT SPECIFIED. THEY MAY NOT BE USED FOR THE ASSEMBLY AND/OR INSTALLATION OF ANY OTHER PRODUCT NOR MAY THEY BE USED FOR RATIONAL AND/OR LOCAL APPROVAL OF ANY PRODUCT NOT PRODUCED BY THE MANUFACTURER STATED ON THESE DRAWINGS.

DRAWN BY: W.R.M.
PLOT: 1=16
DATE: 03/26/12

NO.	REVISION	DESCRIPTION
A1	ADDED	2 1/4" SASH VIEWS

ALUMINUM CLAD WOOD NON-IMPACT TRANSOM WINDOW
C.P. LOEWEN ENTERPRISES
77 HWY 52 WEST
STEINBACH, MB, CANADA R5G 1B2
204-326-6446

FRAME ANCHOR REQUIREMENTS TABLE

NAILING FIN FASTENERS

OPENING TYPE (SUBSTRATE)	NAIL FIN TO OPENING FASTENER TYPE	MINIMUM EMBED	MINIMUM EDGE DIST.
MIN. 2X4 WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	NO. 8 SMS SCREW	1 3/8"	1/2"

GENERAL NOTES:

1. ALL FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS. SPECIFIED ANCHOR EMBED TO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.
2. OPENINGS, BUCKING & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE.
3. THESE NON-IMPACT RATED WINDOW SYSTEM INSTALLATIONS ARE IN ACCORDANCE WITH AND MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (FBC).
4. ALL ANCHORS SECURING WINDOW FRAME TO PRESSURE TREATED BUCKS OR WOOD FRAMING SHALL BE CAPABLE OF RESISTING CORROSION CAUSED BY THE PRESSURE TREATING CHEMICALS IN THE WOOD.
5. MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF FLORIDA BUILDING CODE CHAPTER 20.

DRAWING NO.	REV.
1809	A
SHEET NO.	1 OF 1