



GENERAL NOTES

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE REQUIREMENTS OF THE 7TH EDITION (2020) FLORIDA BUILDING CODE FOR USE OUTSIDE THE HIGH VELOCITY HURRICANE ZONE
2. THIS DOCUMENT ADDRESSES ONLY PRODUCT ANCHORAGE TO ACHIEVE THE INDICATED DESIGN PRESSURES AT THE INDICATED SIZES, IN THE CONFIGURATIONS INDICATED. INSTALL PRODUCTS WITH MAXIMUM SHIM GAP, MINIMUM EDGE DISTANCE AND EMBEDMENT, AND WITH FASTENER TYPE AS SHOWN IN THE DETAILS AND AS INDICATED IN TABLE 1. FOR FULL PRODUCT CONSTRUCTION DETAILS SEE INTERTEK TEST REPORT 51782.02-701-47 AND STORK TEST REPORT 113.94815.1.
3. THIS PRODUCT AS SHOWN IN THIS DRAWING IS NON-IMPACT, AND REQUIRES THE USE OF IMPACT PROTECTIVE DEVICES (SHUTTERS) IN WINDBORNE DEBRIS REGIONS.
4. GLAZING SHALL BE COMPLIANT WITH ASTM E-1300.
5. THE 4/3 ALLOWABLE STRESS INCREASE FACTOR (SHORT-TERM INCREASE FACTOR) HAS NOT BEEN USED IN THE ANCHOR ANALYSIS FOR THIS SYSTEM. THE 1.6 Cd FACTOR WAS USED IN THE ANALYSIS OF ANCHORAGE INTO WOOD SUBSTRATE.
6. THE OPENING SUBSTRATE MATERIALS (FRAMING, MASONRY, BUCKS) AND ATTACHMENT OF BUCKS TO THE SUBSTRATE ARE BY OTHERS AND SHALL BE VERIFIED BY THE ARCHITECT OR ENGINEER OF RECORD OR AS APPROVED BY THE AUTHORITY HAVING JURISDICTION (AHJ). BUCKING, OPENINGS, & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED BY OTHERS IN ACCORDANCE WITH THE FBC TO TRANSFER SUPERIMPOSED LOADS TO THE STRUCTURE. WITH MASONRY OPENINGS, WOOD BUCKS ARE OPTIONAL.
7. DISSIMILAR MATERIALS THAT COME INTO CONTACT SHALL BE COATED OR OTHERWISE PROTECTED TO PREVENT GALVANIC REACTIONS. WOOD BUCKS, IF USED, SHALL BE PRESSURE TREATED, WITH EITHER A TREATMENT OR COATING COMPATIBLE WITH THIS PRODUCT.
8. ANCHORAGE NOTES: ALL ANCHORS USED SHALL BE OF A MATERIAL OR HAVE A COATING COMPATIBLE WITH THE PRESSURE TREATED WOOD BUCKS AND ALL OTHER WINDOW MATERIALS. INSTALL ONE ANCHOR AT EACH LOCATION SHOWN IN THE ELEVATION. INSTALL SHIMS AT EACH ANCHOR LOCATION WHERE A GAP OF 1/16" OR GREATER EXISTS BETWEEN PRODUCT FRAME AND SUBSTRATE. SHIMS SHALL BE LOAD-BEARING (PLASTIC OR METALLIC) AND CAPABLE OF TRANSFERRING LOADS TO SUBSTRATE. SPECIFIED ANCHOR EMBEDMENT TO SUBSTRATE SHALL BE BEYOND WALL FINISH OR STUCCO.
9. WOOD BUCKS LESS THAN 1-1/2" THICK ARE OPTIONAL AND MAY BE USED WITH CONCRETE/CMU, WITH ANCHOR EMBEDMENT BEYOND WOOD BUCKS AND INTO MASONRY.
10. ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS, OR AS APPROVED, SIGNED, AND SEALED BY A FLORIDA-REGISTERED PROFESSIONAL ENGINEER ON A SITE-SPECIFIC BASIS.
11. SEALING AND FLASHING STRATEGIES FOR OVERALL WATER INFILTRATION RESISTANCE OF THE INSTALLED PRODUCT SHALL BE THE RESPONSIBILITY OF OTHERS AND ARE NOT ADDRESSED BY THIS DOCUMENT.

SHORELINE VINYL PICTURE WINDOW, NON-IMPACT

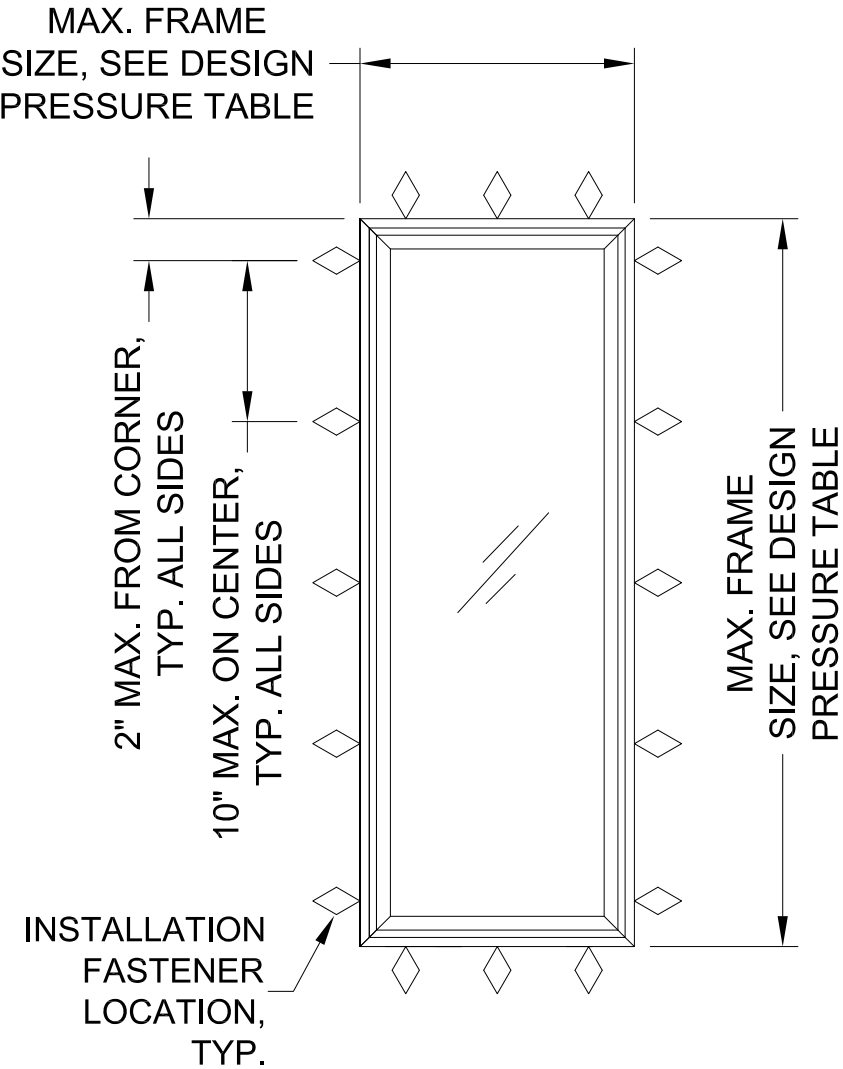

EQUAL LEG ELEVATION
SEE DETAILS SHEETS 2

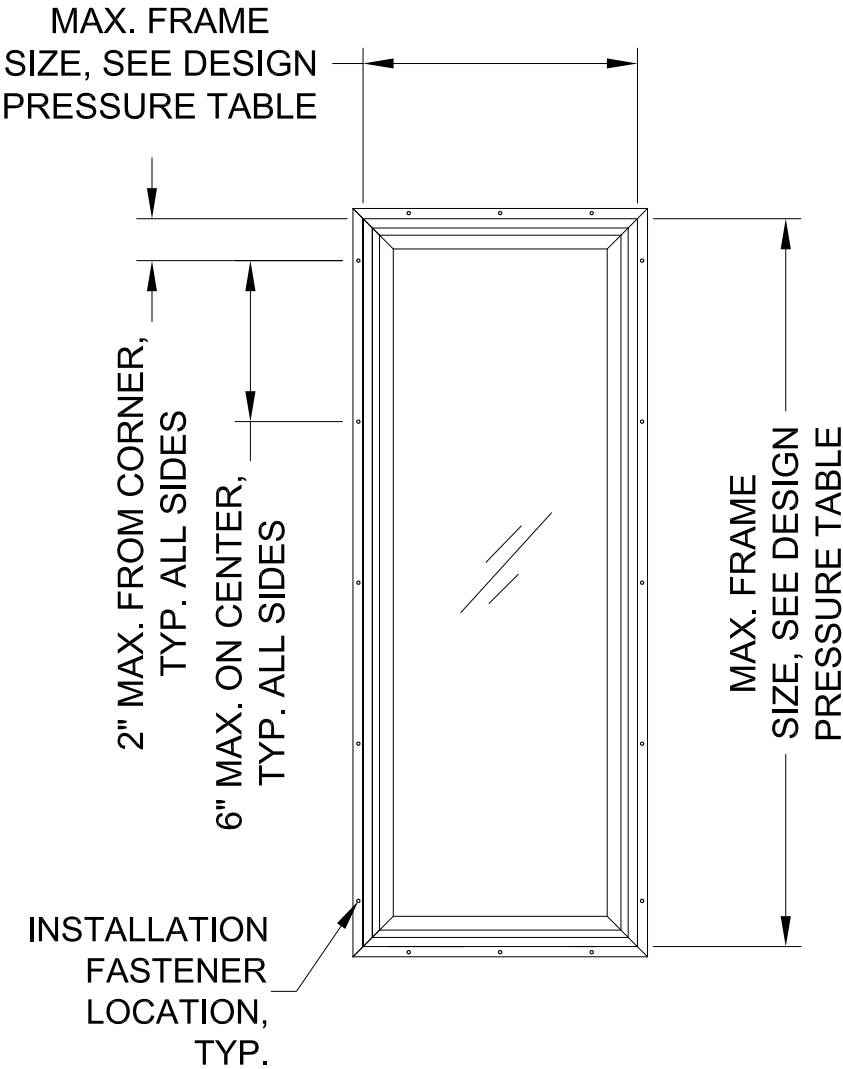

FIN ELEVATION
SEE DETAILS SHEETS 3


Lucas Turner
2021.01.21 16:32:04
-06'00'

DESIGN PRESSURE TABLE

CONFIGURATION	MAX. FRAME SIZE	DESIGN PRESSURE RATING
O	72"x84" OR 84"x72"	+40/-40 PSF
O	60"x72" OR 72"x60"	+45/-45 PSF



NOTE:
GEOMETRIC SHAPES
THAT FIT WITHIN THE
RECTANGULAR SIZES
INDICATED ARE ALSO
ALLOWED.

VIWINTECH® WINDOWS & DOORS 2400 IRVIN COBB DR. PADUCAH, KY 42003 PH. (800) 788-1050	
SHEET DESCRIPTION: NOTES, ELEVATION	DATE DRAWN: 1/21/2021
SCALE: NTS	REV: 0
DRAWING: Shoreline-PW-NI	SHEET: 1 OF 3

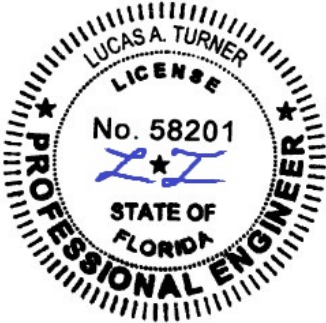

1/21/2021
Lucas A. Turner, P.E.
FL PE #58201
2428 Old Natchez Trc Trl
Camden, TN 38320
Ph. 941-380-1574


SHORELINE VINYL PICTURE WINDOW, NON-IMPACT

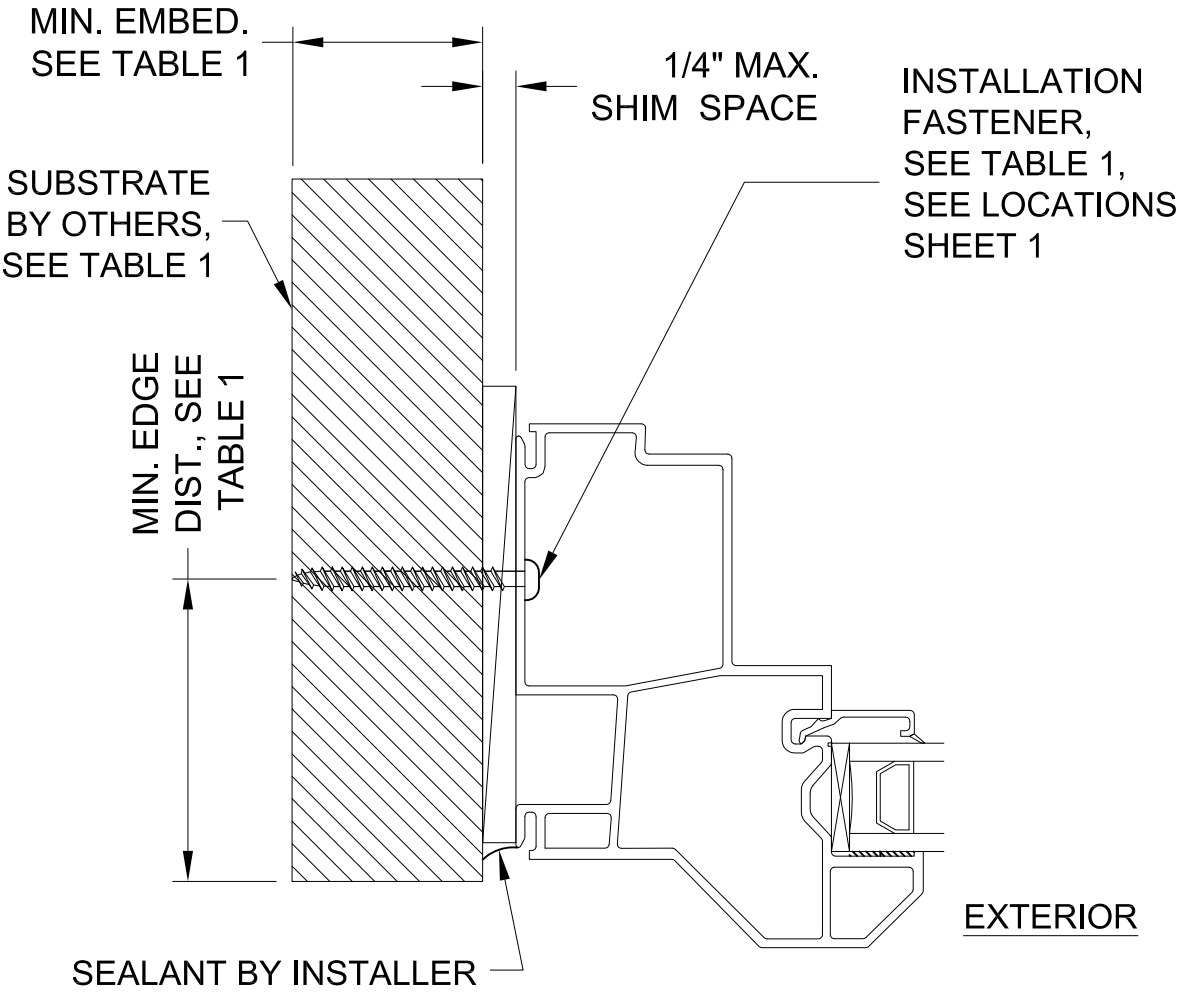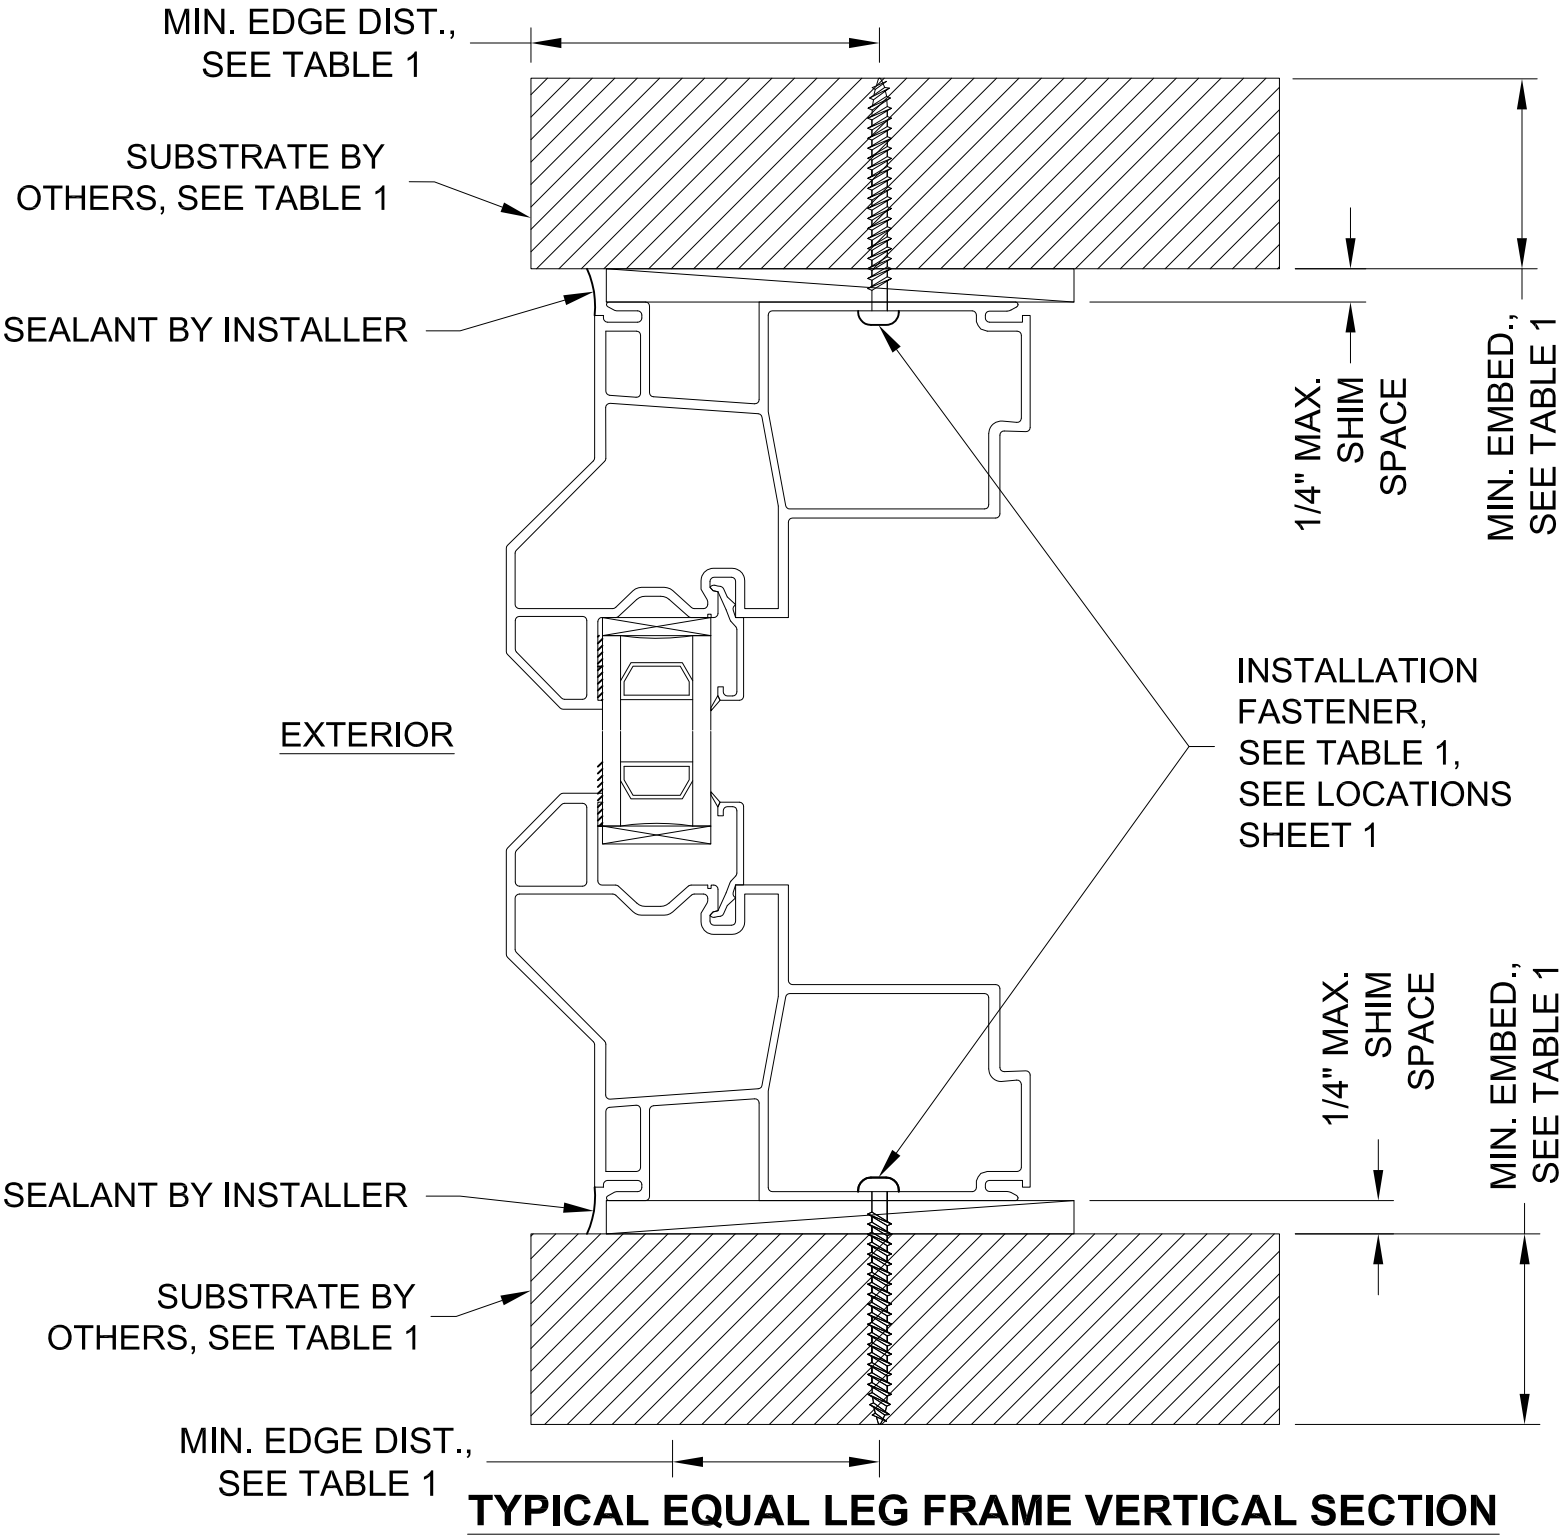

TYPICAL EQUAL LEG JAMB HORIZONTAL SECTION


TABLE 1: EQUAL LEG / FLANGE FRAME INSTALLATION ANCHOR REQUIREMENTS TABLE			
NOTE: ALL ANCHORS ARE PAN HEAD OR HEX WASHER HEAD			
SUBSTRATE TYPE	ANCHOR TYPE	MIN. EMBED.	MIN. EDGE DIST.
CONCRETE (2.0 KSI MIN)	3/16" ITW TAPCON	1"	1 1/8"
HOLLOW OR GROUT-FILLED CMU (117 PCF MIN.)	3/16" ITW TAPCON	1"	2"
CONCRETE (2.85 KSI MIN.)	3/16" ELCO ULTRACON	1"	1"
2X MIN. SOUTHERN PINE WOOD (G=0.55)	#10 GRADE 5 WOOD SCREW	1-3/8"	1"
16 GAUGE (0.060") MIN. STEEL STUD, 33KSI YIELD MIN., OR 1/8" ALUM. 6063-T5 MIN.	#10-16 HILTI KWIK-FLEX OR ITW TEKS SELF-DRILLING SCREW	FULL, PLUS 3 THREADS BEYOND	1/2"

VIWINTeCH WINDOWS & DOORS		2400 IRVIN COBB DR. PADUCAH, KY 42003 PH. (800) 788-1050
SHEET DESCRIPTION: INSTALLATION DETAILS, TABLE		DATE DRAWN: 1/21/2021
SCALE: NTS		REV: 0
DRAWING: Shoreline-PW-NI		SHEET: 2 OF 3

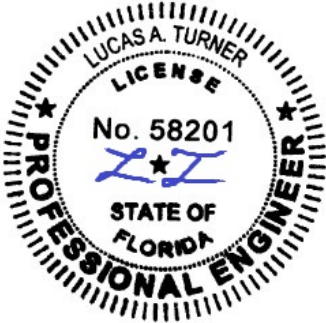


1/21/2021
Lucas A. Turner, P.E.
FL PE #58201
2428 Old Natchez Trc Trl
Camden, TN 38320
Ph. 941-380-1574


SHORELINE VINYL PICTURE WINDOW, NON-IMPACT

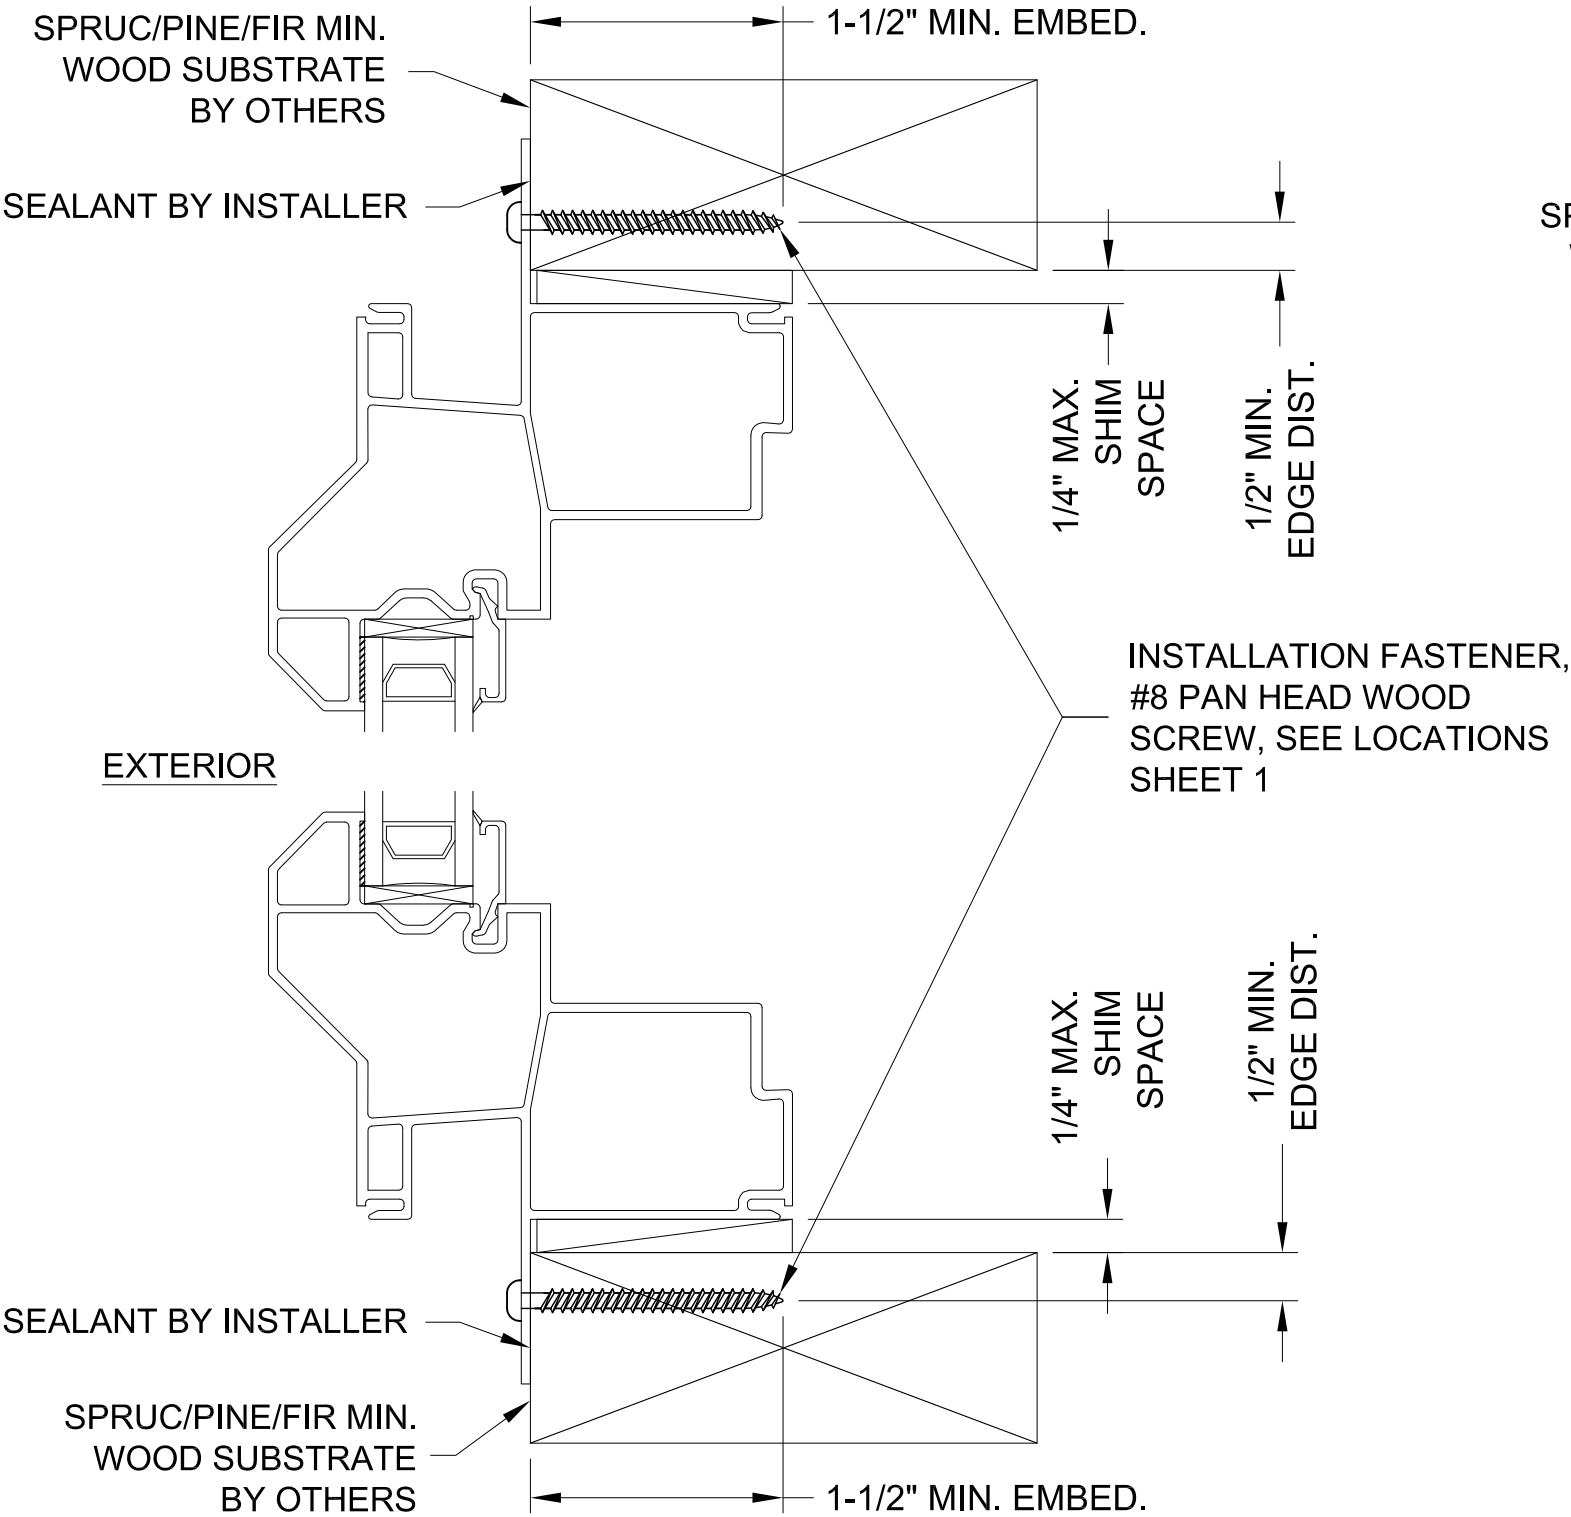

TYPICAL FIN FRAME VERTICAL SECTION

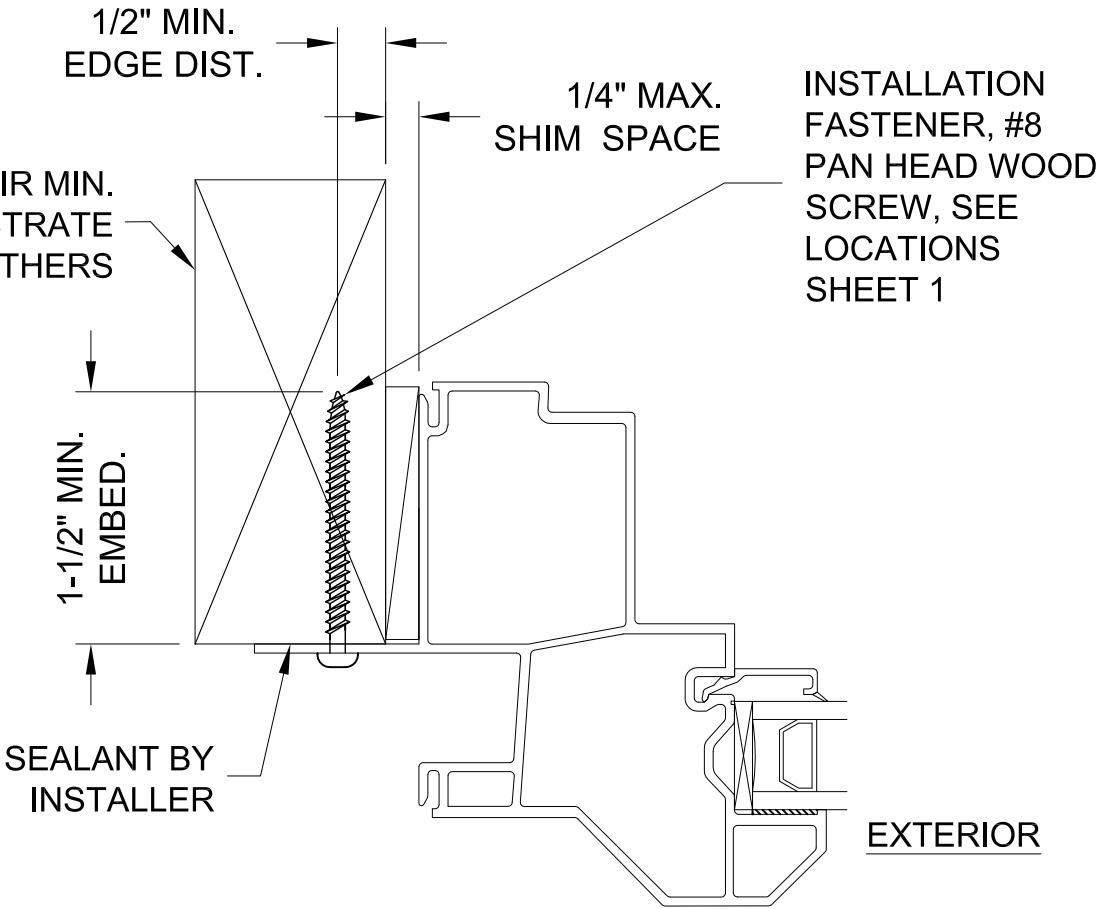

TYPICAL FIN JAMB HORIZONTAL SECTION

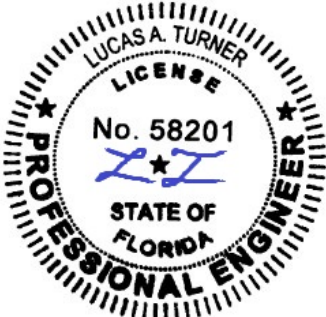		2400 IRVIN COBB DR. PADUCAH, KY 42003 PH. (800) 788-1050
SHEET DESCRIPTION: FIN INSTALLATION DETAILS	DATE DRAWN: 1/21/2021	 1/21/2021 Lucas A. Turner, P.E. FL PE #58201 2428 Old Natchez Trc Trl Camden, TN 38320 Ph. 941-380-1574
SCALE: NTS	REV: 0	
DRAWING: Shoreline-PW-NI	SHEET: 3 OF 3	