


DuraGard and Sashlite Extruded Aluminum Vertical Clipped Structural Mullion


GENERAL NOTES

1. This product has been evaluated and is in compliance with the 7th Edition (2020) Florida Building Code (FBC) structural requirements, excluding the "High Velocity Hurricane Zone".
2. When used in areas requiring wind borne debris protection, this product (if mulled together with impact rated windows) does not require protection from an impact resistant covering when used in Wind Zones 1, 2 and 3 as defined by ASTM E 1996 and FBC Sections 1609.1.2.2 & R301.2.1.2.1.
3. In Wind Zone 4 as defined by ASTM E 1996, this product must be protected with an impact resistant covering complying with FBC Sections 1609.1.2 & R301.2.1.2.
4. Separate product approvals for each glazing product used with these mullions must be submitted along with this mullion product approval. The design pressure rating of the assembly shall be the lesser of the load capacity of the mullion as specified using this approval or the design pressure rating of the individual glazing products used.
5. Anchoring of each glazing product to the mullion shall be as shown in this drawing or as shown in each individual glazing product approval, whichever is more stringent.
6. Mullion anchor embedment to base material shall be beyond wall dressing or stucco.
7. Any conditions not covered in this evaluation are subject to separate engineering evaluation.
8. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.


TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	Typical elevations, design pressures & general notes
2	Mullion details & cross section
3	Anchor bracket details
4	Buck anchoring

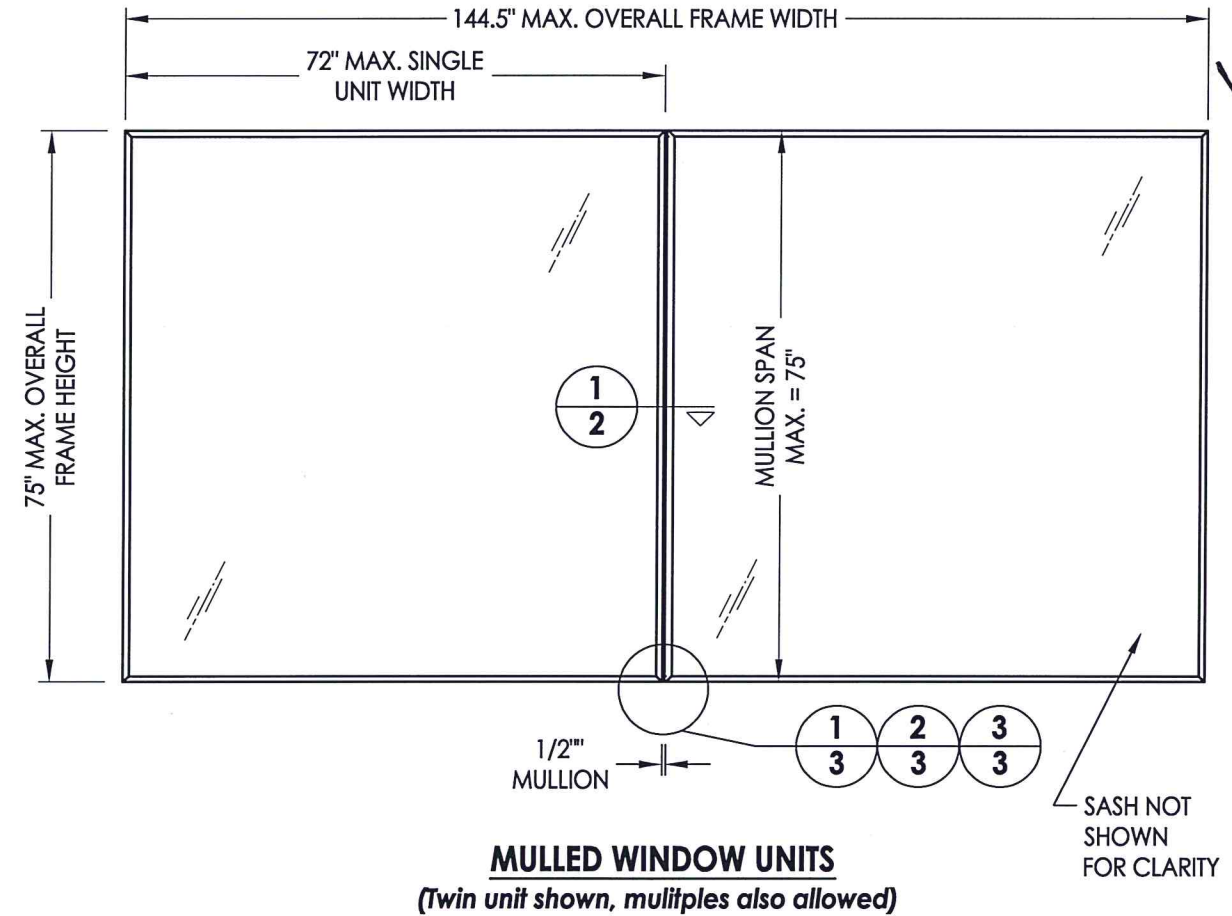

		DESIGN PRESSURE (PSF)										
		MAX. OVERALL FRAME WIDTH										
		62"	74"	86"	92"	98"	104"	110"	116"	122"	134"	144.5"
MAX. VERTICAL MULLION SPAN	75"	49.6	42.6	37.5	35.4	33.5	31.8	30.2	28.9	27.6	25.3	23.7
	72"	50.0	50.0	42.6	40.2	38.0	36.1	34.3	32.8	31.3	28.8	26.8
	66"	50.0	50.0	50.0	50.0	49.9	47.3	45.0	42.9	41.0	37.6	35.1
	60"	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	49.8	46.1	43.4
	54"	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	49.0
	48"	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0
	42"	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0

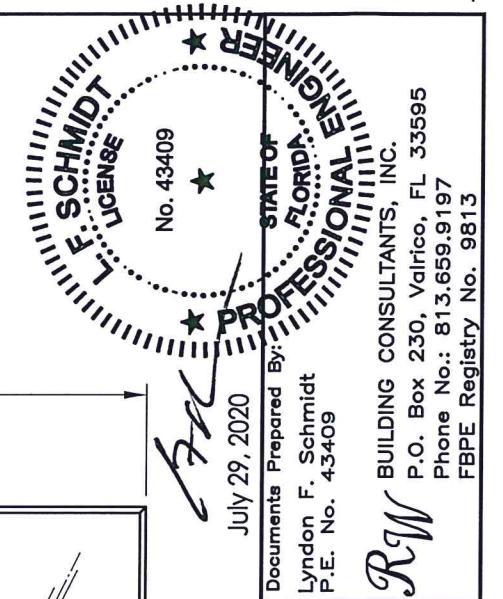

PRODUCT:		CLIPPED MULLION	
PART OR ASSEMBLY:		TYPICAL ELEVATIONS, DESIGN PRESSURES & GENERAL NOTES	
NO.	DATE	REVISIONS	BY
3	7/29/20	UPDATE TO 7TH ED (2020) FBC	LFS
2	9/26/17	UPDATE TO 6TH ED. (2017) FBC	JK
1	04/22/15	UPDATE TO 5TH ED. (2014) FBC	JK
DATE:		4/04/12	
SCALE:		N.T.S.	
DWG. BY:		JK	
CHK. BY:		LFS	
DRAWING NO.:		FL-15417.1	
SHEET		1 OF 4	

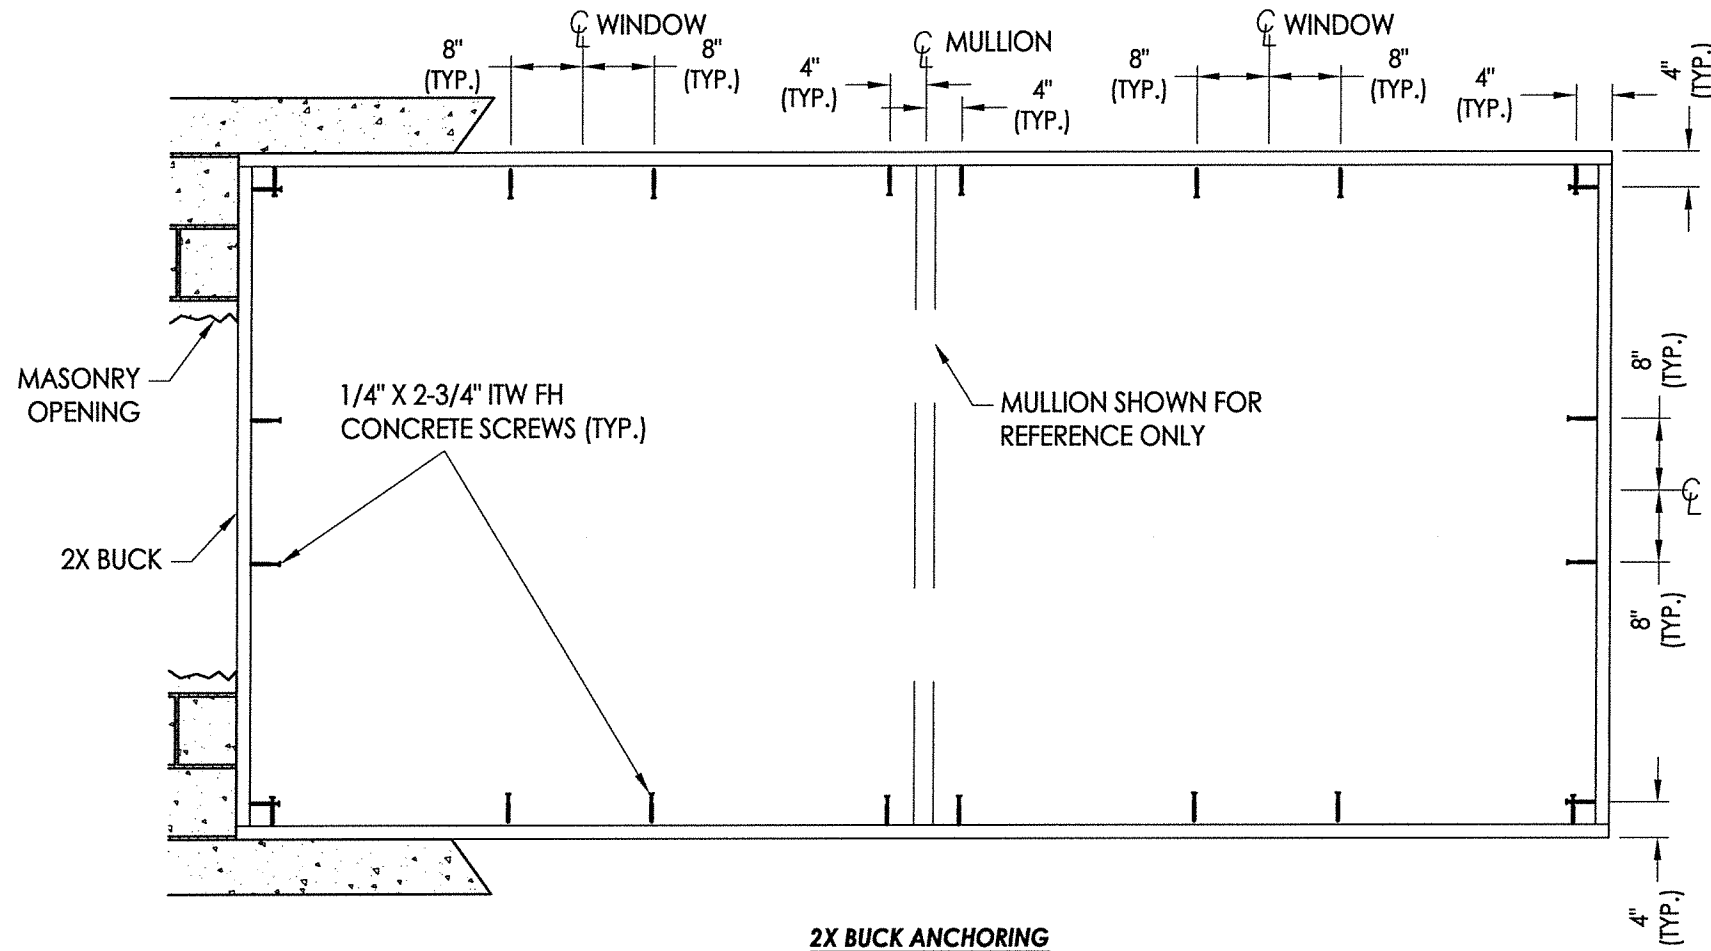

CONCRETE ANCHOR NOTES:

1. Substitution of equal concrete anchors from a different supplier may have different edge distance and center distance requirements.
2. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints. If concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimensions are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	3/16"	1-1/4"	2"	1-7/8"
ITW TAPCON®	1/4"	1-1/4"	2-1/2"	3"

4. Concrete shall be 3,000 PSI conforming to ACI 301 or hollow block conforming to ASTM C90.

