

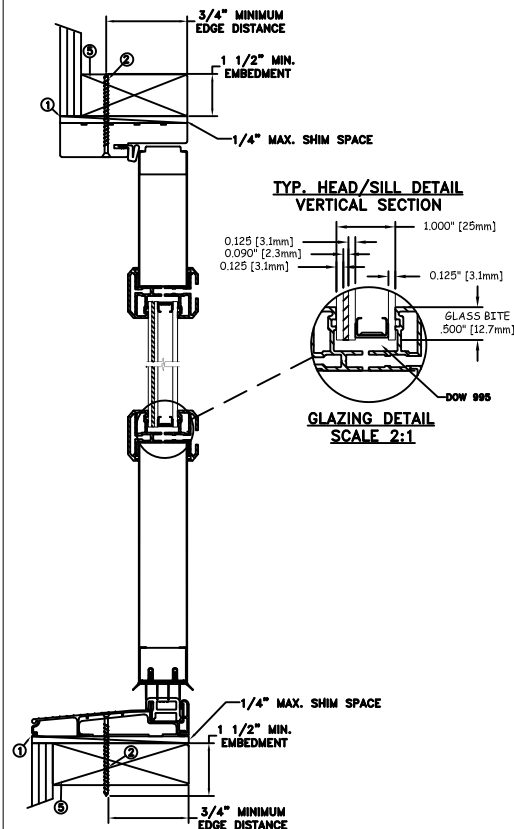


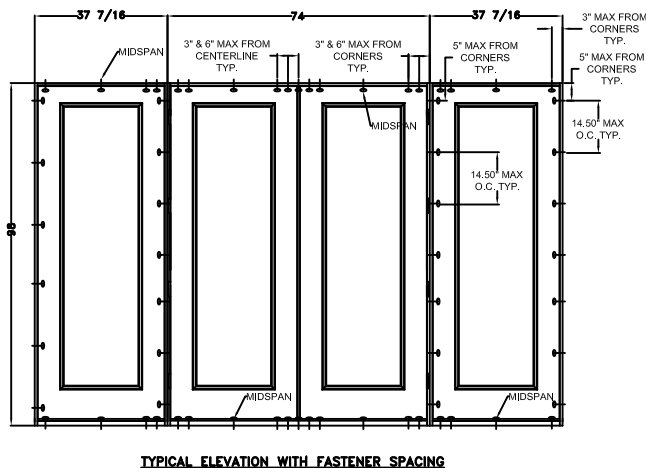

THROUGH FRAME INSTALLATION

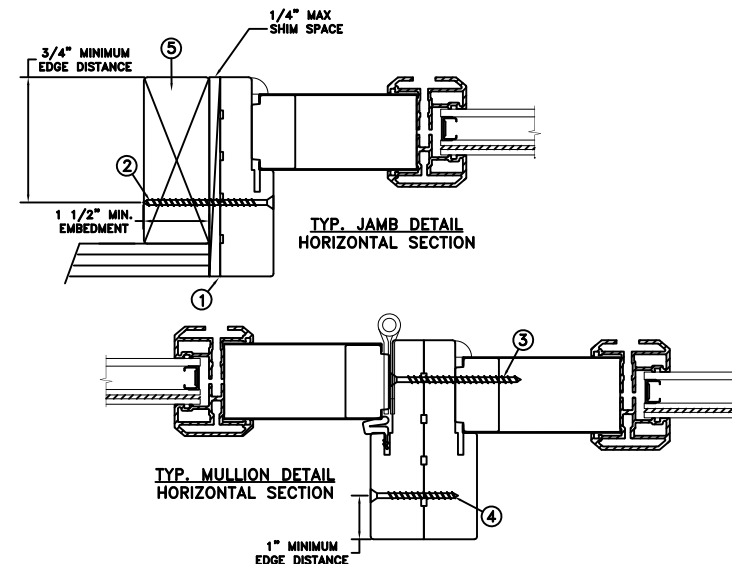

MAXIMUM FRAME	DP	IMPACT
148.375 x 98	+50/-50	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use #10 PH or greater fastener through the head & side jambs with sufficient length to penetrate a minimum of 1-1/2" into the wood framing. For 2x wood frame substrate (min. S.G. = 0.55).
3. Use #9 x 2-1/2" PH screws two (2) per hinge into the jambs.
4. Use #8 x 2" PH fastener at each mullion (min. S.G = 0.55).
5. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2025.02.11 15:22:22 -05'00'


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.1mm tempered - 13.7mm airspace - 3.1mm annealed - 2.3mm PVB interlayer by Kuraray - 3.1mm annealed glass.
4. Use structural or composite shims where required.
5. Tested to TAS 201-94, TAS 202-94, TAS 203-94.
6. Product meets high velocity hurricane zone (HVHZ) requirements.
7. Approved impact protective system is not required on this product in areas requiring impact resistance.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.




DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

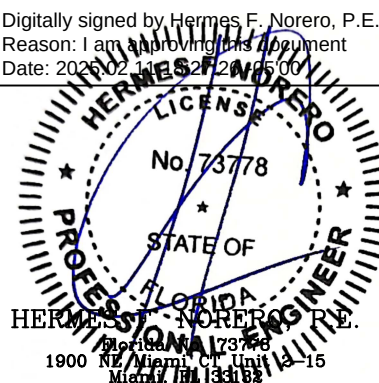

	DATE: 02/05/2025	JELD-WEN 3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936		
DRAWN BY: M.HAM	SCALE: NTS			
CHECKED BY: D.VEZO	TITLE: Contours (S-2500) Steel Wood Swinging Door Inswing 4 Panel OXXO			
APPROVED BY: D.VEZO				
RECORD No.: D1000523				
REPORT No.: ---	CAD DWG. No.: —	REV: C	SHEET 1 of 10	

MASONRY STRAP INSTALLATION

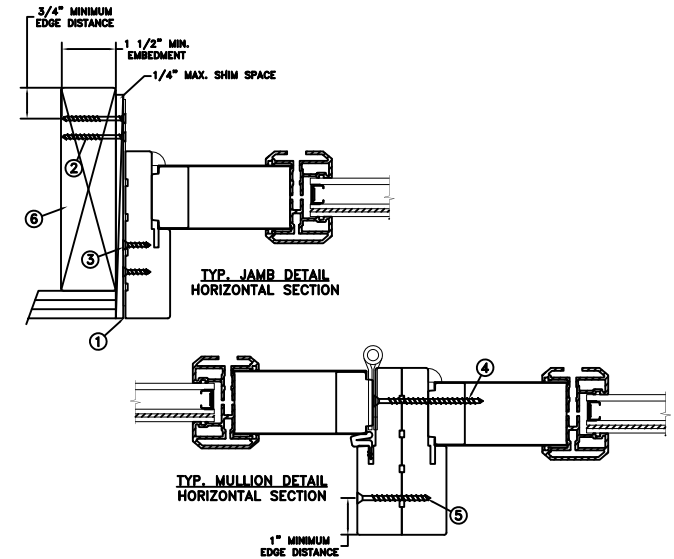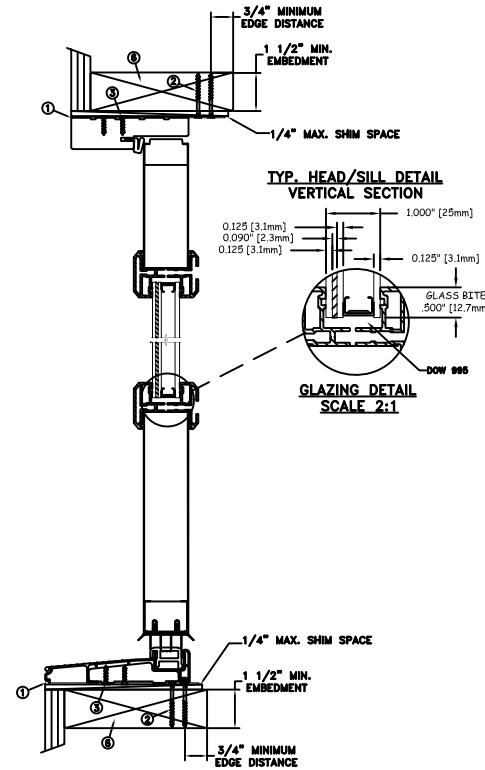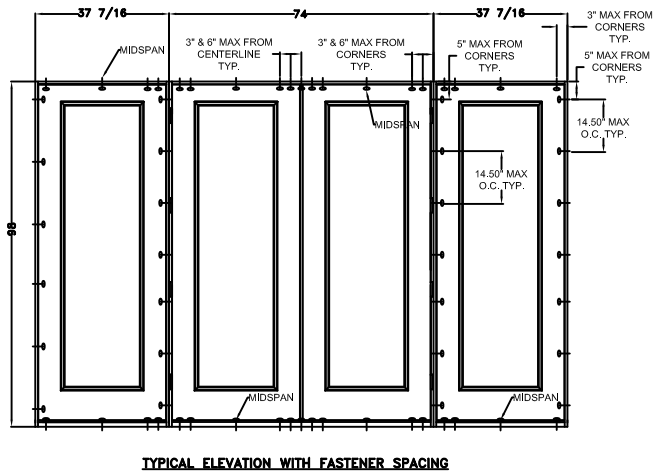

MAXIMUM FRAME	DP	IMPACT
148.375 x 98	+50/-50	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use two (2) - #8 PFH or larger fasteners through masonry strap with sufficient length to penetrate a minimum of 1-1/2" into the buck. For 2x wood frame substrate (min. S.G. = 0.55).
3. Use two (2) - #8 PFH or larger fasteners through masonry strap into jamb without penetrating through the jamb into product causing visibility or collateral damage to product.
4. Use #9 x 2-1/2" PH screw two (2) per hinge into the jambs.
5. Use #8 x 2" PH fastener at each mullion (min. S.G. = 0.55).
6. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.1mm tempered - 13.7mm airspace - 3.1mm annealed - 2.3mm PVB interlayer by Kuraray - 3.1mm annealed glass.
4. Use structural or composite shims where required.
5. Masonry strap specifications: 20 Ga. galvanized steel, .036" min. thickness x 1.5" min. width.
6. Tested to TAS 201-94, TAS 202-94, TAS 203-94.
7. Product meets high velocity hurricane zone (HVHZ) requirements.
8. Approved impact protective system is not required on this product in areas requiring impact resistance.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.




DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

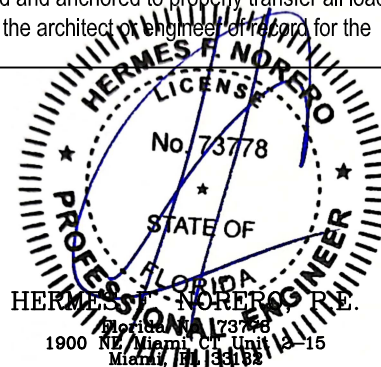

	DATE: 02/05/2025	JELD-WEN 3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936	
DRAWN BY: M.HAM	SCALE: NTS		
CHECKED BY: D.Vezo	TITLE: Contours (S-2500) Steel Wood Swinging Door Inswing 4 Panel OXXO		
APPROVED BY: D.Vezo			
RECORD No.: D1000523			
REPORT No.: ---	CAD DWG. No.: —	REV: C	SHEET 2 of 10

CONCRETE/MASONRY INSTALLATION

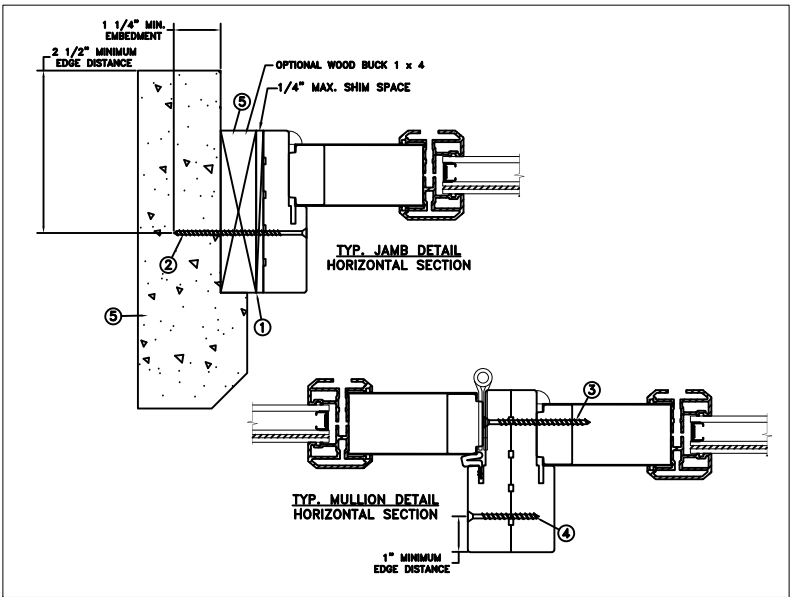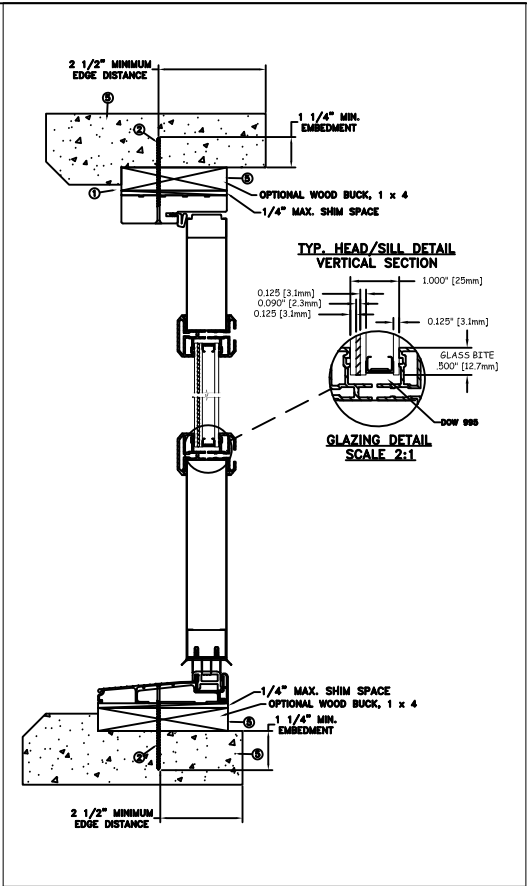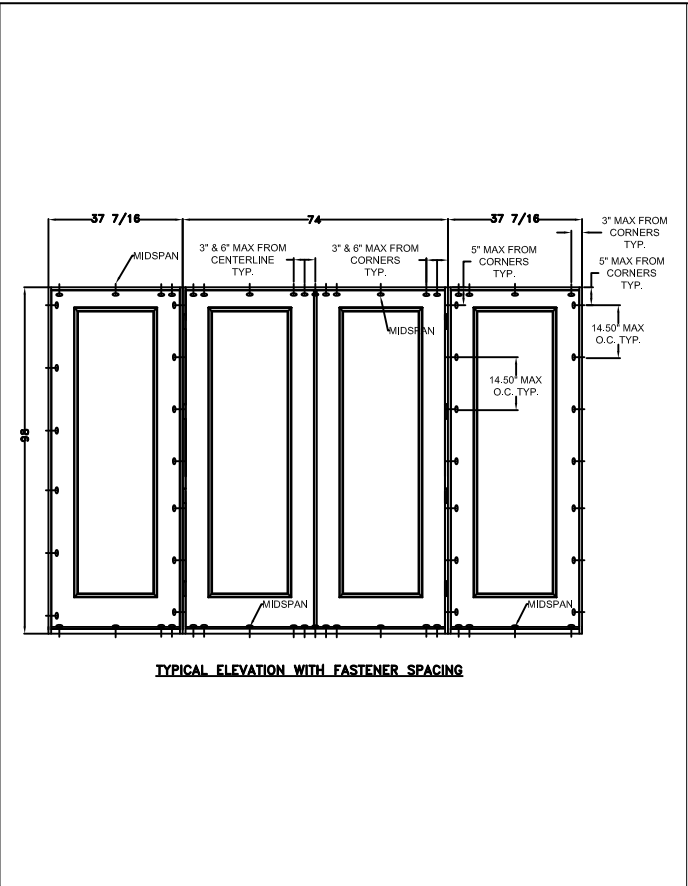

MAXIMUM FRAME	DP	IMPACT
148.375 x 98	+50/-50	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use 1/4" tapcon or equivalent fasteners through frame with sufficient length to penetrate a minimum of 1-1/4" into concrete or masonry at each location with a 2-1/2" min. from edge distance. For concrete (min. fc = 3000 psi) or masonry substrate (CMU shall adhere to ASTM C90).
3. Use #9 x 2-1/2" PH screw two (2) per hinge into the jambs.
4. Use #8 x 2" PH fastener at each mullion (min. S.G. = 0.55).
5. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.1mm tempered - 13.7mm airspace - 3.1mm annealed - 2.3mm PVB interlayer by Kuraray - 3.1mm annealed glass.
4. Use structural or composite shims where required.
5. Tested to TAS 201-94, TAS 202-94, TAS 203-94.
6. Product meets high velocity hurricane zone (HVHZ) requirements.
7. Approved impact protective system is not required on this product in areas requiring impact resistance.


This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

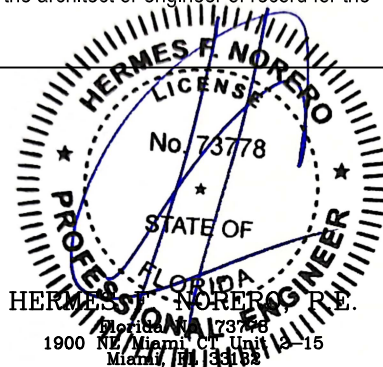


		DATE: 02/05/2025	 3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936	
DRAWN BY: M.HAM	SCALE: NTS			
CHECKED BY: D.VEZO	TITLE: Contours (S-2500) Steel Wood Swinging Door Inswing 4 Panel OXXO			
APPROVED BY: D.VEZO				
RECORD No.: D1000523				
REPORT No.: ---	CAD DWG. No.: —	REV: C	SHEET 3 of 10	

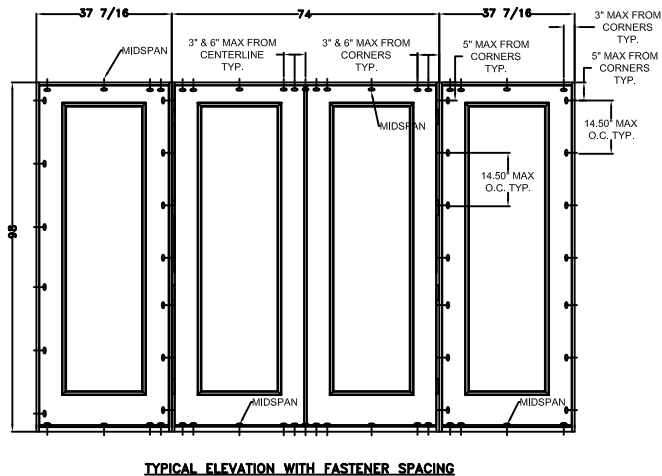

TYPICAL ELEVATION WITH FASTENER SPACING

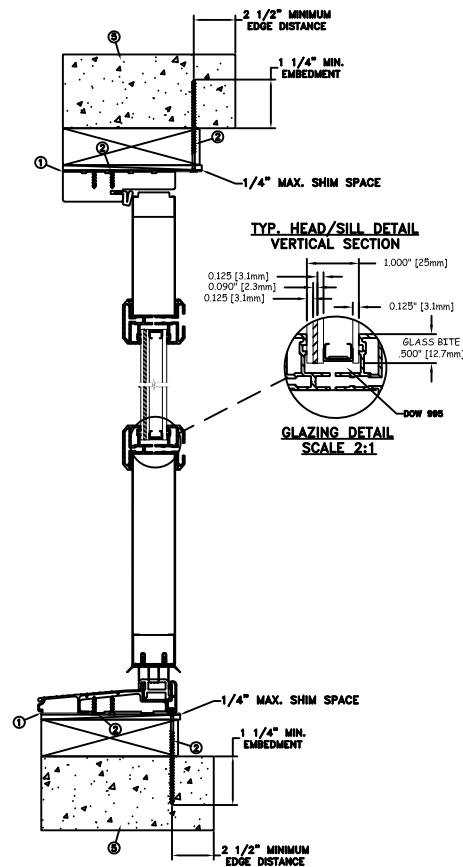

CONCRETE/MASONRY INSTALLATION

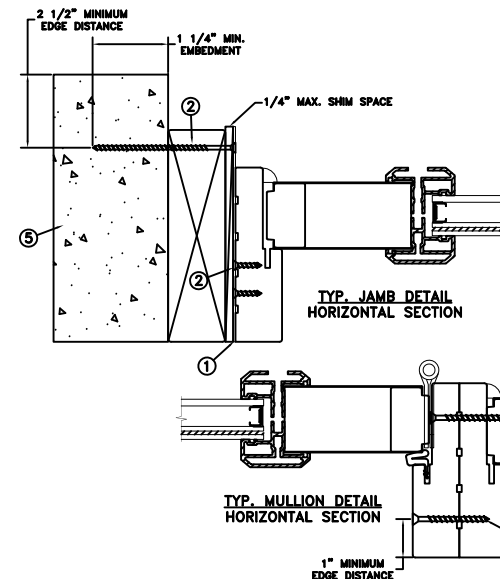

MAXIMUM FRAME	DP	IMPACT
148.375 x 98	+50/-50	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use one (1) - 1/4" tapcon or equivalent fasteners through strap with sufficient length to penetrate a minimum of 1-1/4" into concrete or masonry at each location with a 2-1/2" min. from edge distance. Use two (2) - #8 PFH fasteners through masonry strap into frame. For concrete (min. fc = 3000 psi) or masonry substrate (CMU shall adhere to ASTM C90).
3. Use #9 x 2-1/2" PH screw two (2) per hinge into the jambs.
4. Use #8 x 2" PH fastener at each mullion (min. S.G. = 0.55).
5. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.1mm tempered - 13.7mm airspace - 3.1mm annealed - 2.3mm PVB interlayer by Kuraray - 3.1mm annealed glass.
4. Use structural or composite shims where required.
5. Masonry strap specifications: 20 Ga. galvanized steel, .036" min. thickness x 1.5" min. width.
6. Tested to TAS 201-94, TAS 202-94, TAS 203-94.
7. Product meets high velocity hurricane zone (HVHZ) requirements.
8. Approved impact protective system is not required on this product in areas requiring impact resistance.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.




DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

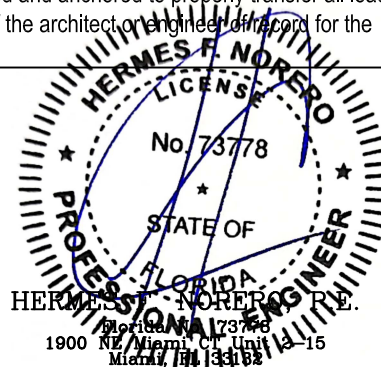

	DATE: 02/05/2025	JELD-WEN 3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936
DRAWN BY: M.HAM	SCALE: NTS	
CHECKED BY: D.Vezo	TITLE:	
APPROVED BY: D.Vezo		
RECORD No.: D1000523		Contours (S-2500) Steel Wood Swinging Door Inswing 4 Panel OXXO
REPORT No.: ---	CAD DWG. No.: ---	REV: C SHEET 4 of 10

MASONRY STRAP INSTALLATION

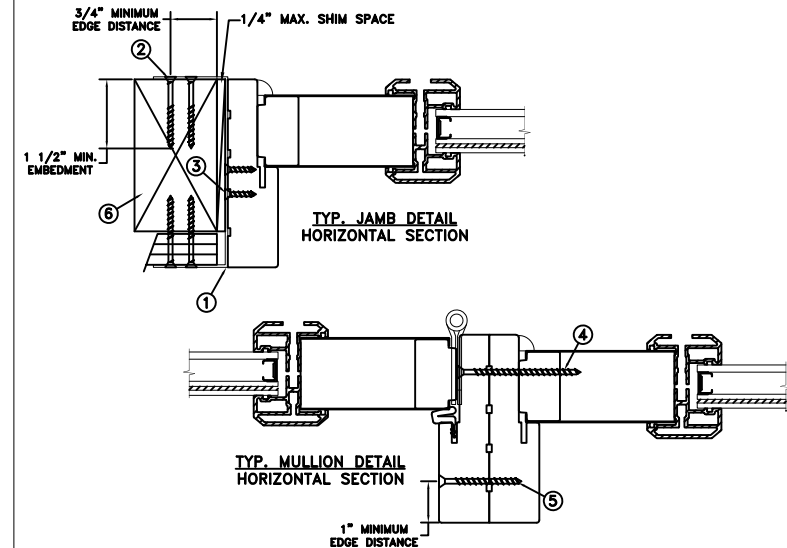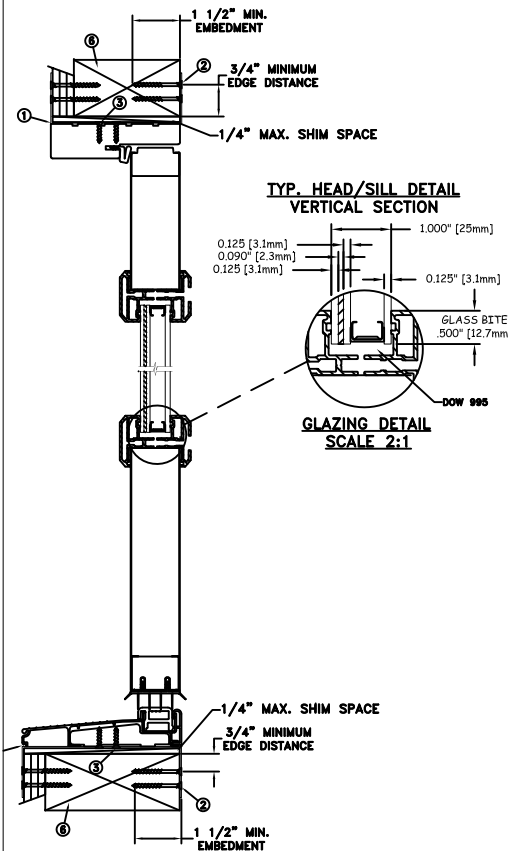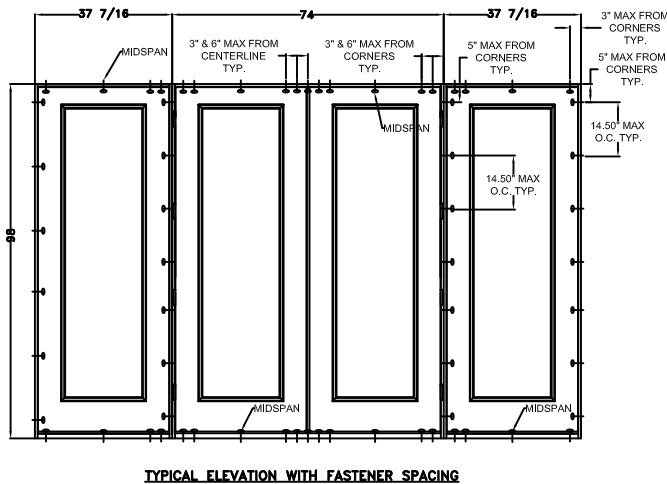

MAXIMUM FRAME	DP	IMPACT
148.375 x 98	+50/-50	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use min. two (2) - #8 PFH or larger fasteners through masonry strap with sufficient length to penetrate a minimum of 1-1/2" into the buck. Bend straps around both sides of the buck. For 2x wood frame substrate (min. S.G. = 0.42).
3. Use min. two (2) - #8 PFH or larger fasteners through masonry strap into jamb without penetrating through the jamb into product causing visibility or collateral damage to product.
4. Use #9 x 2-1/2" PH screw two (2) per hinge into the jambs.
5. Use #8 x 2" PH fastener at each mullion (min. S.G. = 0.55).
6. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.1mm tempered - 13.7mm airspace - 3.1mm annealed - 2.3mm PVB interlayer by Kuraray - 3.1mm annealed glass.
4. Use structural or composite shims where required.
5. Masonry strap specifications: 20 Ga. galvanized steel, .036" min. thickness x 1.5" min. width.
6. Tested to TAS 201-94, TAS 202-94, TAS 203-94.
7. Product meets high velocity hurricane zone (HVHZ) requirements.
8. Approved impact protective system is not required on this product in areas requiring impact resistance.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.




DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

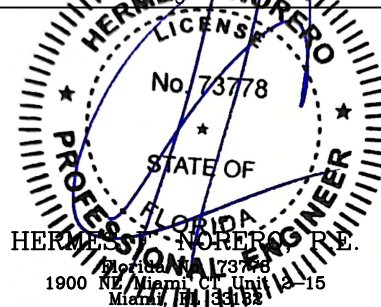

	DATE: 02/05/2025	JELD-WEN 3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936	
DRAWN BY: M.HAM	SCALE: NTS		
CHECKED BY: D.Vezo	TITLE: Contours (S-2500) Steel Wood Swinging Door Inswing 4 Panel OXXO		
APPROVED BY: D.Vezo			
RECORD No.: D1000523			
REPORT No.: ---	CAD DWG. No.: —	REV: C	SHEET 5 of 10

THROUGH FRAME INSTALLATION

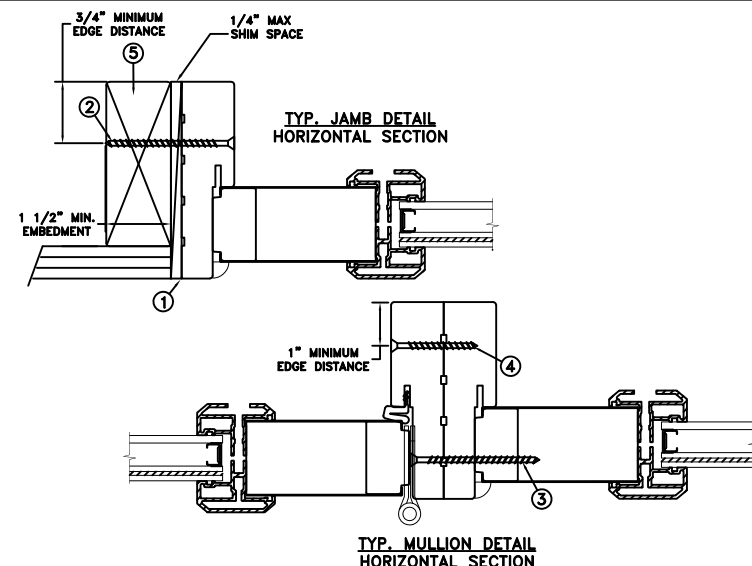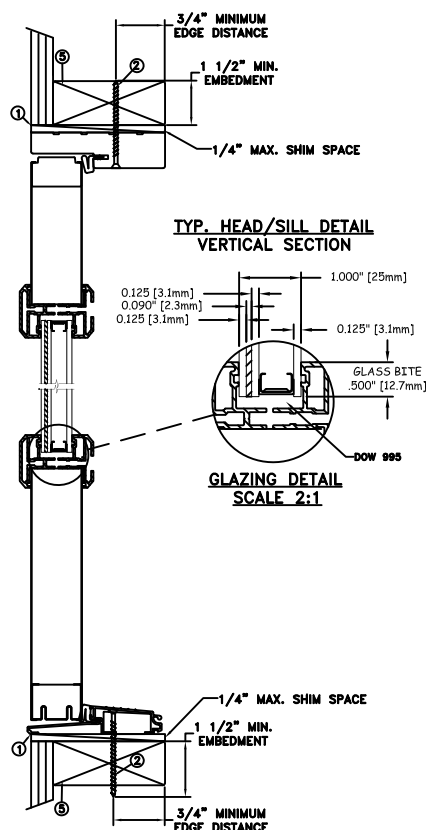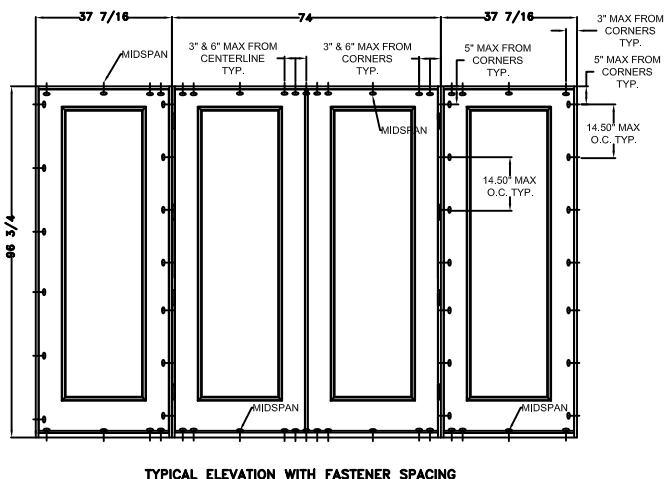

MAXIMUM FRAME	DP	IMPACT
148.375 x 96.75	+50/-50	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use #10 PH or greater fastener through the head & side jambs with sufficient length to penetrate a minimum of 1-1/2" into the wood framing. For 2x wood frame substrate (min. S.G. = 0.55).
3. Use #9 x 2-1/2" PH screws two (2) per hinge into the jambs.
4. Use #8 x 2" PH fastener at each mullion (min. S.G. = 0.55).
5. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.1mm tempered - 13.7mm airspace - 3.1mm annealed - 2.3mm PVB interlayer by Kuraray - 3.1mm annealed glass.
4. Use structural or composite shims where required.
5. Tested to TAS 201-94, TAS 202-94, TAS 203-94.
6. Product meets high velocity hurricane zone (HVHZ) requirements.
7. Approved impact protective system is not required on this product in areas requiring impact resistance.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.




DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

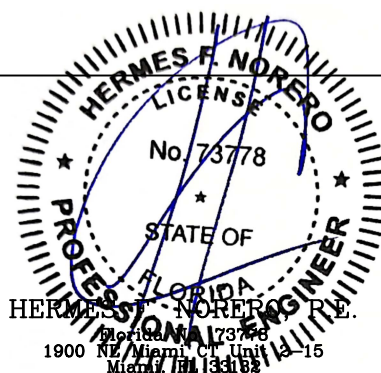

	DATE: 02/05/2025	JELD-WEN 3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936	
DRAWN BY: M.HAM	SCALE: NTS		
CHECKED BY: D.VEZO	TITLE: Contours (S-2500) Steel Wood Swinging Door Outswing 4 Panel OXXO		
APPROVED BY: D.VEZO			
RECORD No.: D1000523			
REPORT No.: ---	CAD DWG. No.: —	REV: C	SHEET 6 of 10

MASONRY STRAP INSTALLATION

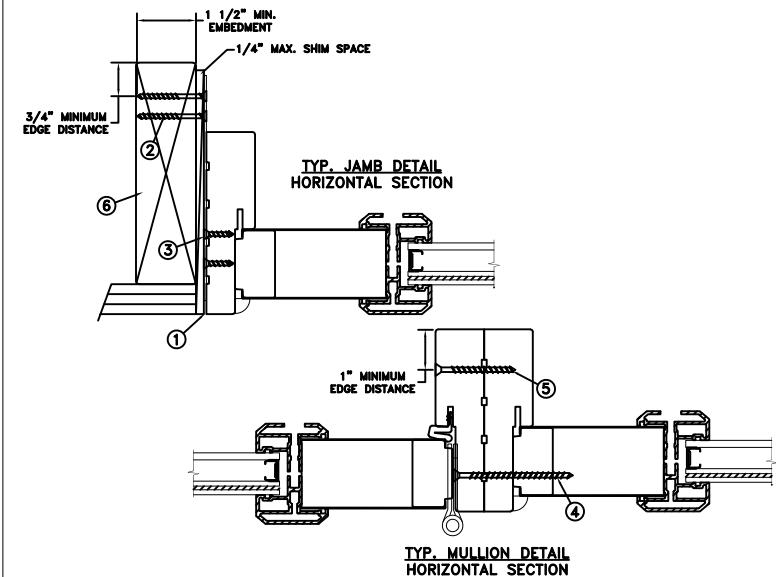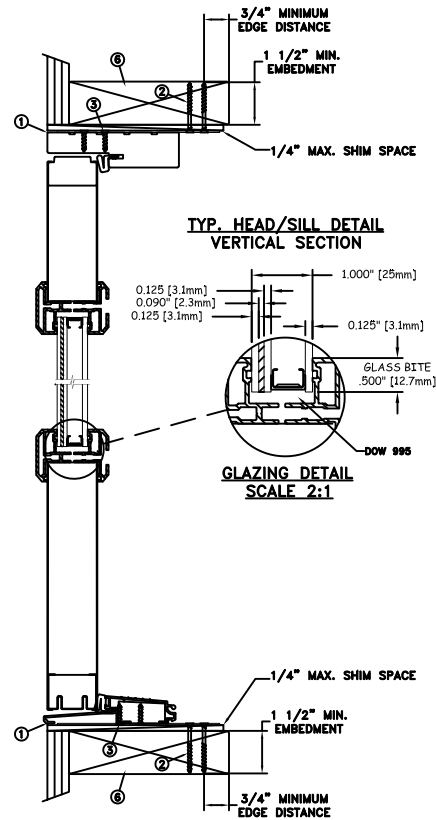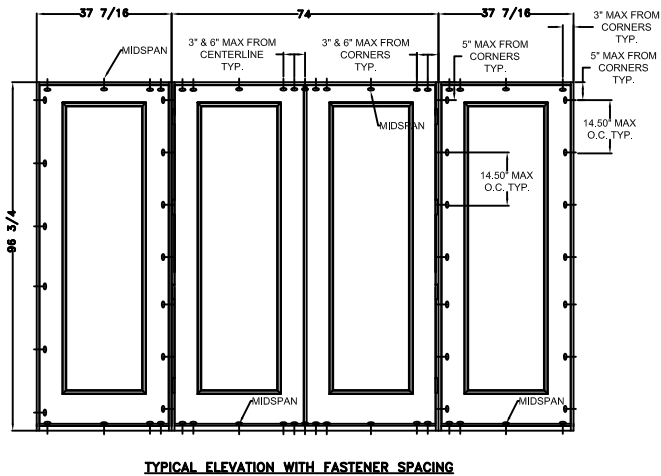

MAXIMUM FRAME	DP	IMPACT
148.375 x 96.75	+50/-50	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use two (2) - #8 PFH or larger fasteners through masonry strap with sufficient length to penetrate a minimum of 1-1/2" into the buck. For 2x wood frame substrate (min. S.G. = 0.55).
3. Use two (2) - #8 PFH or larger fasteners through masonry strap into jamb without penetrating through the jamb into product causing visibility or collateral damage to product.
4. Use #9 x 2-1/2" PH screw two (2) per hinge into the jambs.
5. Use #8 x 2" PH fastener at each mullion (min. S.G. = 0.55).
6. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.1mm tempered - 13.7mm airspace - 3.1mm annealed - 2.3mm PVB interlayer by Kuraray - 3.1mm annealed glass.
4. Use structural or composite shims where required.
5. Masonry strap specifications: 20 Ga. galvanized steel, .036" min. thickness x 1.5" min. width.
6. Tested to TAS 201-94, TAS 202-94, TAS 203-94.
7. Product meets high velocity hurricane zone (HVHZ) requirements.
8. Approved impact protective system is not required on this product in areas requiring impact resistance.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.


DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

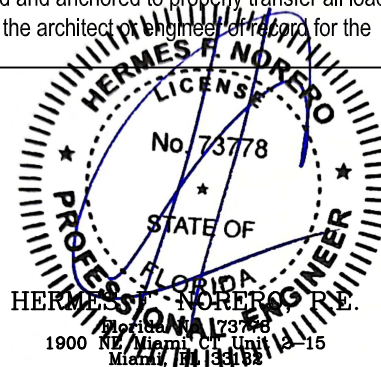


	DATE: 02/05/2025	JELD-WEN 3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936	
DRAWN BY: M.HAM	SCALE: NTS		
CHECKED BY: D.Vezo	TITLE: Contours (S-2500) Steel Wood Swinging Door Outswing 4 Panel OXXO		
APPROVED BY: D.Vezo			
RECORD No.: D1000523			
REPORT No.: ---	CAD DWG. No.: —	REV: C	SHEET 7 of 10

CONCRETE/MASONRY INSTALLATION

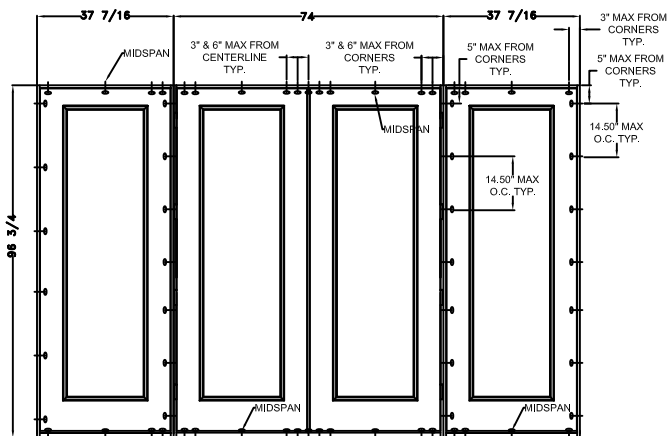


TYPICAL ELEVATION WITH FASTENER SPACING

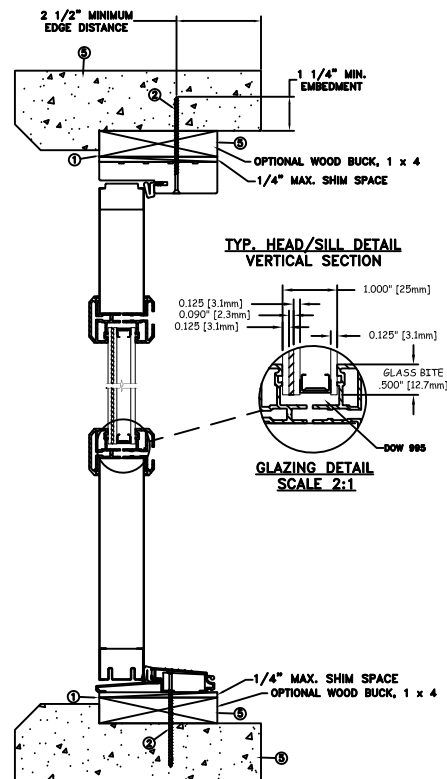


TYP. HEAD/SILL DETAIL
VERTICAL SECTION

GLAZING DETAIL
SCALE 2:1

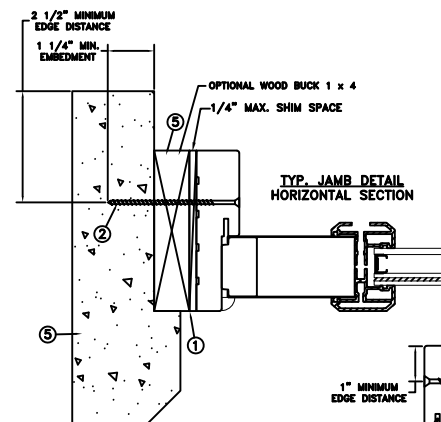

TYP. JAMB DETAIL
HORIZONTAL SECTION

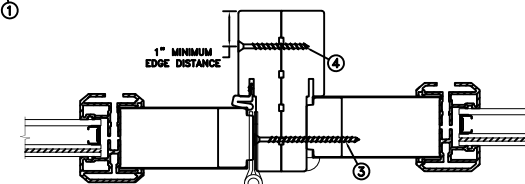

TYP. MULLION DETAIL
HORIZONTAL SECTION

MAXIMUM FRAME	DP	IMPACT
148.375 x 96.75	+50/-50	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use 1/4" tapcon or equivalent fasteners through frame with sufficient length to penetrate a minimum of 1-1/4" into concrete or masonry at each location with a 2-1/2" min. from edge distance. For concrete (min. fc = 3000 psi) or masonry substrate (CMU shall adhere to ASTM C90).
3. Use #9 x 2-1/2" PH screw two (2) per hinge into the jambs.
4. Use #8 x 2" PH fastener at each mullion (min. S.G. = 0.55).
5. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.1mm tempered - 13.7mm airspace - 3.1mm annealed - 2.3mm PVB interlayer by Kuraray - 3.1mm annealed glass.
4. Use structural or composite shims where required.
5. Tested to TAS 201-94, TAS 202-94, TAS 203-94.
6. Product meets high velocity hurricane zone (HVHZ) requirements.
7. Approved impact protective system is not required on this product in areas requiring impact resistance.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.


DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

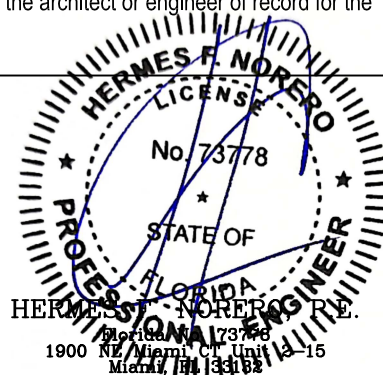


	DATE: 02/05/2025	 3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936	
DRAWN BY: M.HAM	SCALE: NTS		
CHECKED BY: D.VEZO	TITLE: Contours (S-2500) Steel Wood Swinging Door Outswing 4 Panel OXXO		
APPROVED BY: D.VEZO			
RECORD No.: D1000523			
REPORT No.: ---	CAD DWG. No.: —	REV: C	SHEET 8 of 10

CONCRETE/MASONRY INSTALLATION

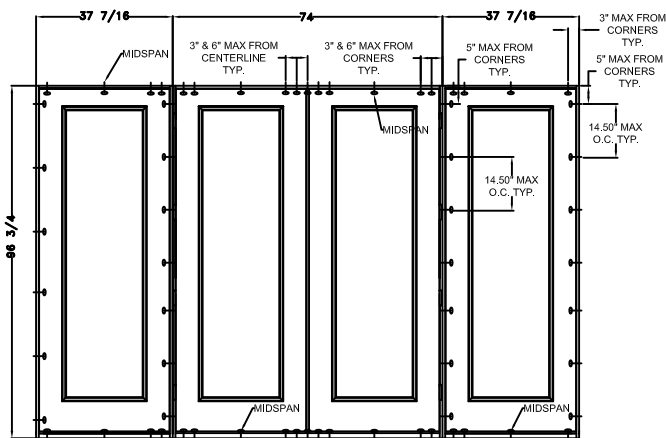


TYPICAL ELEVATION WITH FASTENER SPACING

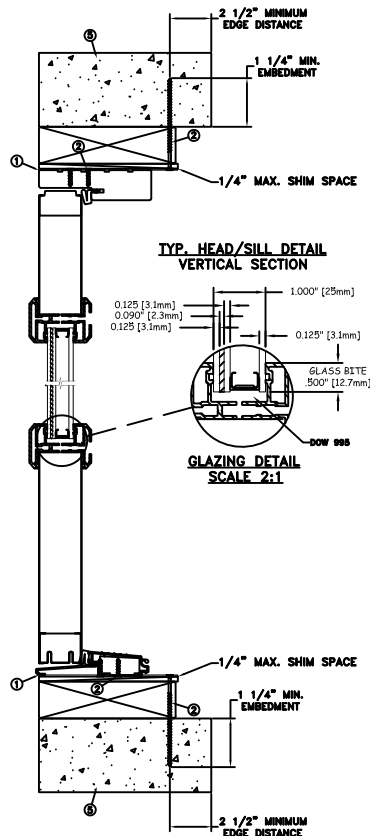

TYP. HEAD/SILL DETAIL
VERTICAL SECTION

GLAZING DETAIL
SCALE 2:1

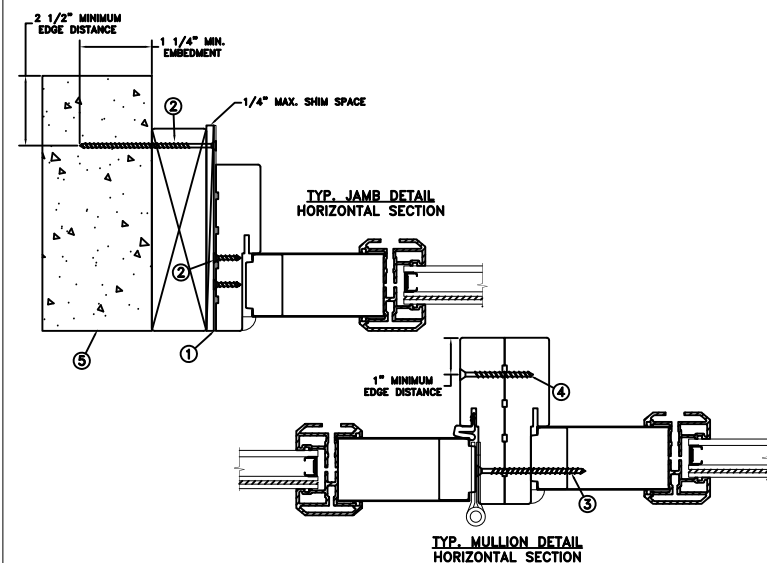

TYP. JAMB DETAIL
HORIZONTAL SECTION

TYP. MULLION DETAIL
HORIZONTAL SECTION

MAXIMUM FRAME	DP	IMPACT
148.375 x 96.75	+50/-50	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use one (1) - 1/4" tapcon or equivalent fasteners through strap with sufficient length to penetrate a minimum of 1-1/4" into concrete or masonry at each location with a 2-1/2" min. from edge distance. Use two (2) - #8 PFH fasteners through masonry strap into frame. For concrete (min. fc = 3000 psi) or masonry substrate (CMU shall adhere to ASTM C90).
3. Use #9 x 2-1/2" PH screw two (2) per hinge into the jambs.
4. Use #8 x 2" PH fastener at each mullion (min. S.G. = 0.55).
5. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.1mm tempered - 13.7mm airspace - 3.1mm annealed - 2.3mm PVB interlayer by Kuraray - 3.1mm annealed glass.
4. Use structural or composite shims where required.
5. Masonry strap specifications: 20 Ga. galvanized steel, .036" min. thickness x 1.5" min. width.
6. Tested to TAS 201-94, TAS 202-94, TAS 203-94.
7. Product meets high velocity hurricane zone (HVHZ) requirements.
8. Approved impact protective system is not required on this product in areas requiring impact resistance.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.




DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

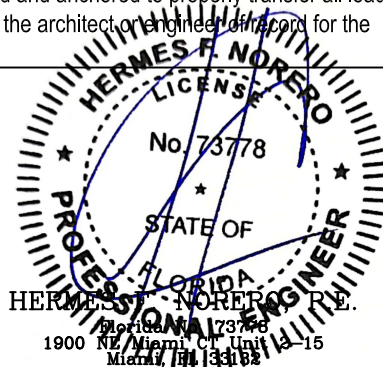

DATE: 02/05/2025	JELD-WEN 3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936
DRAWN BY: M.HAM	
CHECKED BY: D.Vezo	TITLE: Contours (S-2500) Steel Wood Swinging Door Outswing 4 Panel OXO
APPROVED BY: D.Vezo	
RECORD No.: D1000523	
REPORT No.: ---	CAD DWG. No.: ---
REV: C	SHEET 9 of 10

MASONRY STRAP INSTALLATION

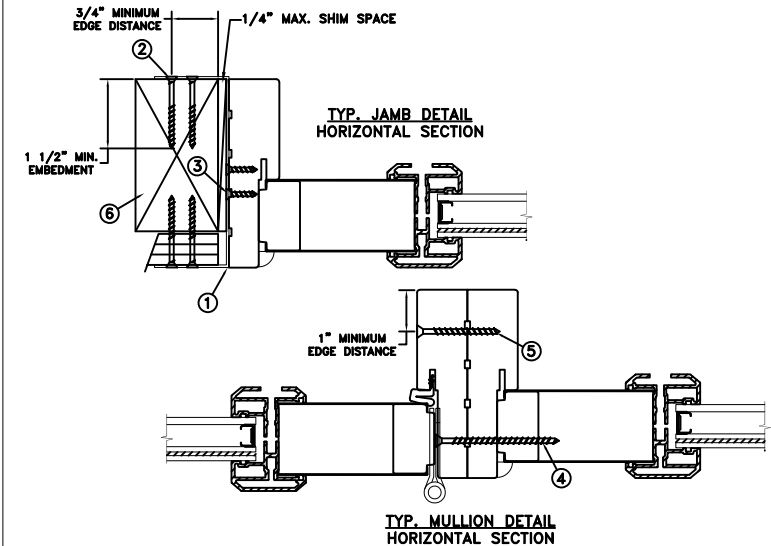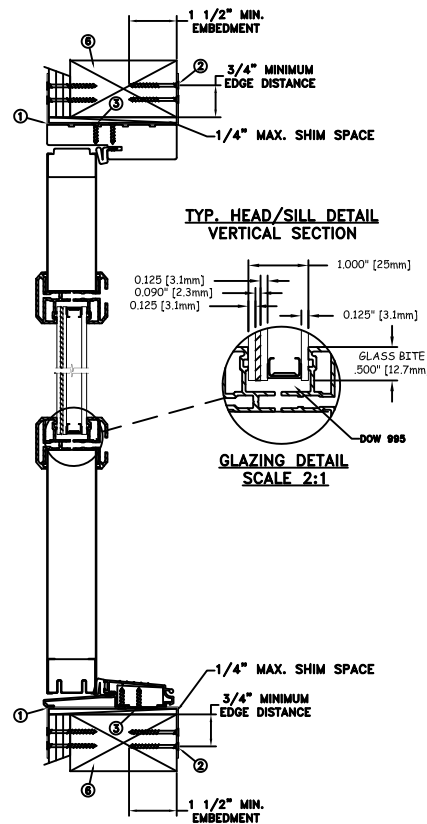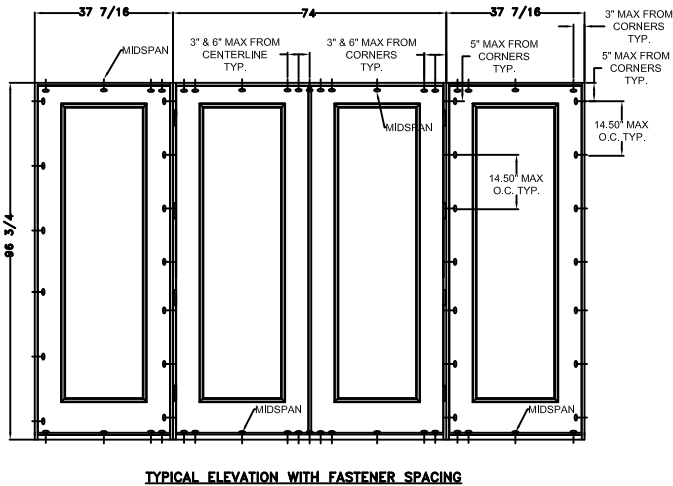

MAXIMUM FRAME	DP	IMPACT
148.375 x 96.75	+50/-50	YES

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use min. two (2) - #8 PFH or larger fasteners through masonry strap with sufficient length to penetrate a minimum of 1-1/2" into the buck. Bend straps around both sides of the buck. For 2x wood frame substrate (min. S.G. = 0.42).
3. Use min. two (2) - #8 PFH or larger fasteners through masonry strap into jamb without penetrating through the jamb into product causing visibility or collateral damage to product.
4. Use #9 x 2-1/2" PH screw two (2) per hinge into the jambs.
5. Use #8 x 2" PH fastener at each mullion (min. S.G. = 0.55).
6. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.1mm tempered - 13.7mm airspace - 3.1mm annealed - 2.3mm PVB interlayer by Kuraray - 3.1mm annealed glass.
4. Use structural or composite shims where required.
5. Masonry strap specifications: 20 Ga. galvanized steel, .036" min. thickness x 1.5" min. width.
6. Tested to TAS 201-94, TAS 202-94, TAS 203-94.
7. Product meets high velocity hurricane zone (HVHZ) requirements.
8. Approved impact protective system is not required on this product in areas requiring impact resistance.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.

DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.



DATE: 02/05/2025	JELD-WEN 3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936
DRAWN BY: M.HAM	
CHECKED BY: D.Vezo	TITLE: Contours (S-2500) Steel Wood Swinging Door Outswing 4 Panel OXXO
APPROVED BY: D.Vezo	
REPORT No.: D1000523	
REPORT No.: ---	CAD DWG. No.: ---
	REV: C
	SHEET 10 of 10