



1 COCHRANE AVE. PENNSBORO, WV 26415 PH.
800-426-2249

STORMBREAKER PLUS 300VL SERIES
MULLIONS WITH MEDIUM ALUMINUM
REINFORCEMENT – NON-HVHZ
FOR IMPACT RESISTANT ASSEMBLIES

GENERAL NOTES:



1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE REQUIREMENTS EXCLUDING HVHZ.
2. THIS MULLION IS ONLY VALID WHEN USED IN CONJUNCTION WITH APPLICABLE SIMONTON WINDOW SYSTEMS.
3. ALL WINDOWS USED WITH THIS MULLION SHALL BE QUALIFIED UNDER SEPARATE APPROVAL. ALL GLAZING PRODUCTS USED WITH THESE MULLIONS MUST MEET THE APPLICABLE FLORIDA BUILDING CODE REQUIREMENTS.
4. ADEQUACY OF EXISTING STRUCTURAL CONCRETE/MASONRY, 2X AND STEEL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT INSTALLATION.
5. 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT INSTALLATION.
6. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
7. THIS MULLION SYSTEM IS SUITABLE FOR ASSEMBLY OF IMPACT RESISTANT PRODUCTS AND DOES NOT REQUIRE AN EXTERNAL IMPACT PROTECTIVE DEVICE IN WINDBORNE DEBRIS REGIONS.

PARTS LIST

NUMBER	DESCRIPTION	PART NO	MATERIAL
1	MEDIUM MULLION COVER	VPI-436	PVC
2	MEDIUM MULLION REINFORCEMENT	20634	6063-T6
3	BASE PLATE		STAINLESS STEEL
4	MULLION L-BRACKET		STAINLESS STEEL


TABLE OF CONTENTS

PAGE NO	DESCRIPTION
1	GENERAL NOTES, PARTS LIST AND CROSS SECTIONS
2	ELEVATION AND DESIGN PRESSURE CHARTS
3	MULLION DETAILS & SILL CROSS SECTIONS

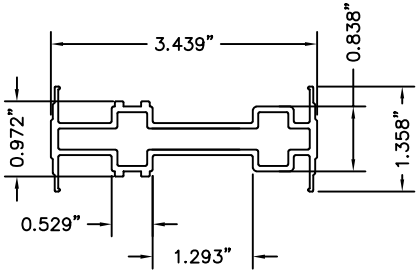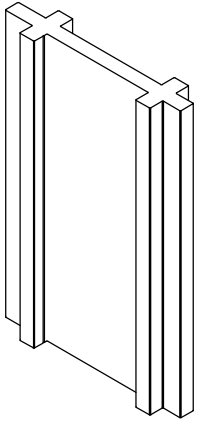


RETROFIT FRAME MULLION


- ① MEDIUM VINYL MULLION COVER #VPI – 436
EXTRUDED VINYL .070" MIN.

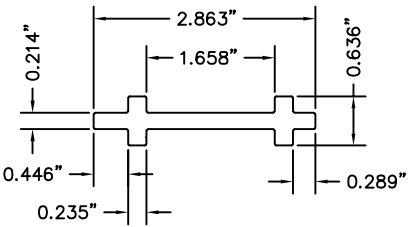

- ② MEDIUM MULLION REINFORCEMENT #20634
ALUMINUM 6063-T6

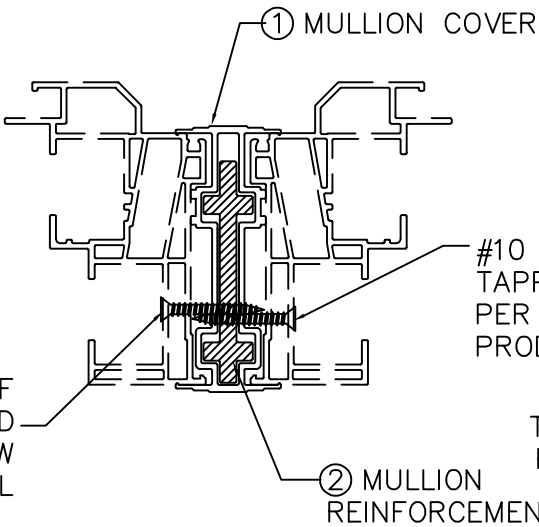


DOUBLE HUNG HORIZONTAL CROSS SECTION

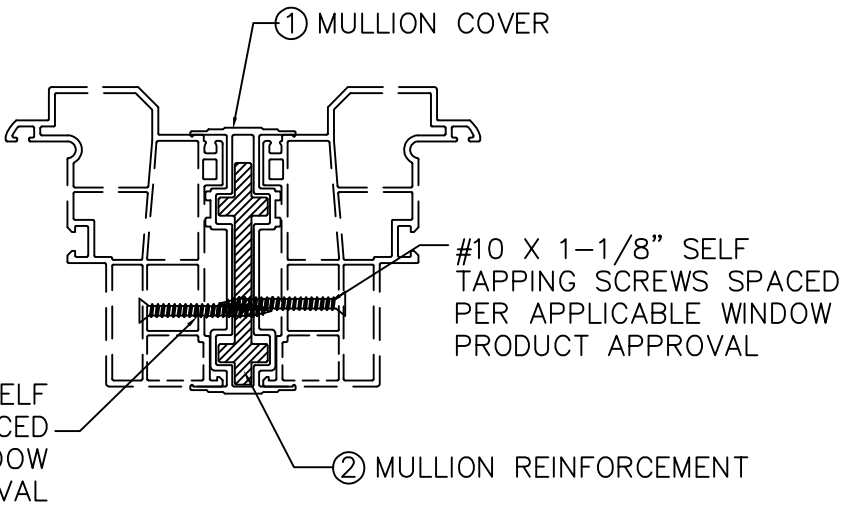

PICTURE (FIXED) HORIZONTAL CROSS SECTION

Lucas Turner
2026.08.13
16:45:48
-05'00'

FL 15534



8/10/2026

LUCAS A. TURNER, P.E. FL PE #58201
TURNER ENGINEERING & CONSULTING, INC.
FBPE C.O.A. #29779 Ph. 941-380-1574
2428 OLD NATCHEZ TRC. TRL, CAMDEN, TN




SIZE: B	DRAWING NO.: RM0052	REV.: 7
DRAWN BY: GLS	DATE: 12/18/08	
CHECKED BY:	DATE: 01-24-12	
APPR'D BY: C.P.	DATE:	

SCALE: FIT



1 COCHRANE AVE. PENNSBORO, WV 26415 PH.
800-426-2249

STORMBREAKER PLUS 300VL SERIES
MULLIONS WITH MEDIUM ALUMINUM
REINFORCEMENT – NON-HVHZ
FOR IMPACT RESISTANT ASSEMBLIES

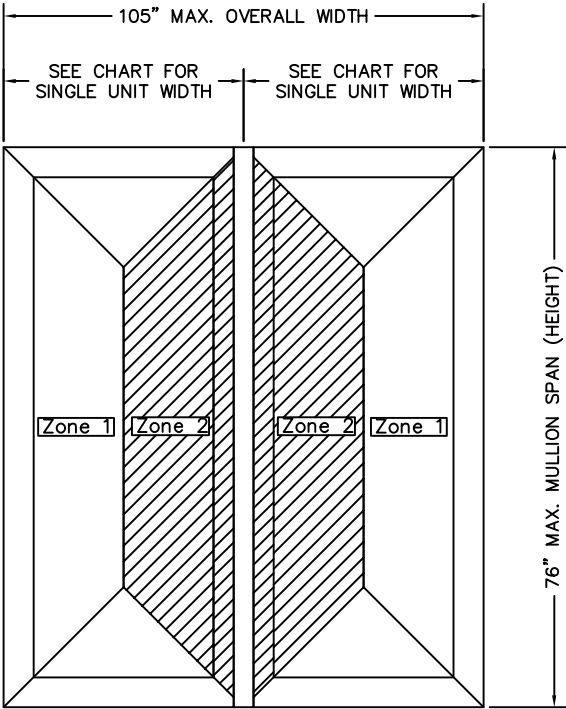

DESIGN PRESSURE CHART FOR MULLING
UNITS IN PSF, MULLION #20634


		Individual Unit Width												
		24	28	30	32	34	36	37	40	42	45	48	50	53
Mullion Length	26	50	50	50	50	50	50	50	50	50	50	50	50	50
	36	50	50	50	50	50	50	50	50	50	50	50	50	50
	42	50	50	50	50	50	50	50	50	50	50	50	50	50
	52	50	50	50	50	50	50	50	50	50	50	50	50	50
	56	50	50	50	50	50	50	50	50	50	50	50	50	50
	58	50	50	50	50	50	50	50	50	50	50	50	50	50
	60	50	50	50	50	50	50	50	50	50	45	45	45	45
	62	50	50	50	50	50	50	45	45	45	40	40	40	40
	63	50	50	50	50	50	45	45	40	40	40	40	35	35
	65	50	50	50	45	45	40	40	40	35	35	35	35	30
	67	50	45	45	40	40	35	35	35	35	30	30	30	30
	68	50	45	40	40	35	35	35	30	30	30	30	30	25
	70	45	40	35	35	35	30	30	30	30	25	25	25	25
	71	45	40	35	35	30	30	30	30	25	25	25	25	25
	72	40	35	35	30	30	30	30	25	25	25	25	20	20
	74	40	35	30	30	25	25	25	25	25	20	20	20	20
76	35	30	30	25	25	25	25	20	20	20	20	20	20	

NOTE:
The pressure chart shows the design pressures for the selected mullion span and panel width for achieving bending capacity, deflection and concentrated load limits specified in the current Florida Building Code.

Adhere to fastening instructions provided in this document to achieve the tabulated design pressures.

Multiple mulled conditions are acceptable as long as load width is not exceeded.

REV. #:	REVISIONS:	REVISED BY:	DATE:
3	UPDATED DESIGN PRESSURE RATINGS CHART PER NEW TESTING.	T.D.D.	06/20/12
4	REVISED PER 5TH ED. (2014) FBC	L.T.	04-25-15
5	UPDATE NOTE 1, SHEET 1, PER 6TH ED. FBC	LMH	10-04-17
6	UPDATE NOTE 1, SHEET 1, PER 7TH ED. FBC	L.T.	9-28-20
7	UPDATED TO CURRENT FBC	LMH	8-10-26




FL 15534				 SIMONTON® W I N D O W S 1 Cochrane Avenue Pennsboro, WV 26415		SIZE: DRAWING NO.: B RM0052		REV.: 7	
8/10/2026		SCALE: FIT				SHEET: 2 of 3		DRAWN BY: GLS DATE: 12/18/08	
		SERIES: STORMBREAKER PLUS 300VL MULLION		CHECKED BY: DATE: 01-24-12		APPRV'D BY: C.P. DATE:			
LUCAS A. TURNER, P.E. FL PE #58201 TURNER ENGINEERING & CONSULTING, INC. FBPE C.O.A. #29779 Ph. 941-380-1574 2428 OLD NATCHEZ TRC. TRL, CAMDEN, TN				TITLE: ELEVATION AND DESIGN PRESSURE CHARTS					



1 COCHRANE AVE. PENNSBORO, WV 26415 PH.
800-426-2249

STORMBREAKER PLUS 300VL SERIES
MULLIONS WITH MEDIUM ALUMINUM
REINFORCEMENT – NON-HVHZ
FOR IMPACT RESISTANT ASSEMBLIES

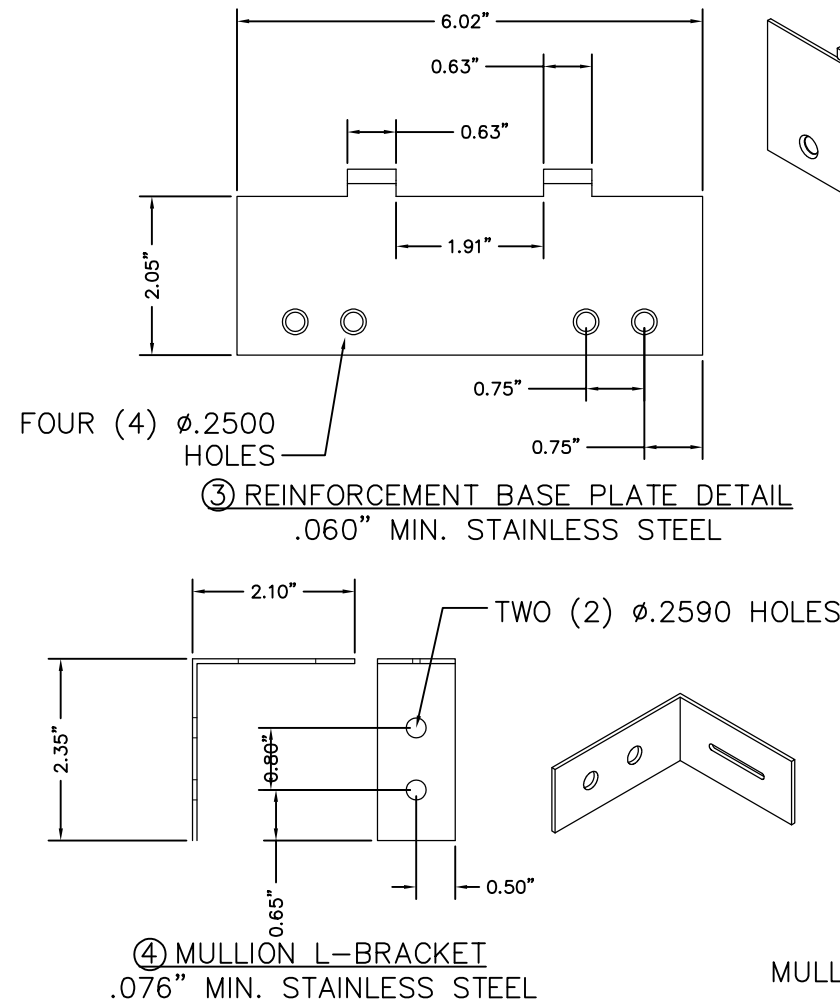

ANCHOR NOTES:

- 1) TO ACHIEVE THE REQUIRED DESIGN PRESSURES, ADHERE TO THE FASTENER REQUIREMENTS BELOW.
- 2) INSTALLATION TO WOOD (G=0.42 MIN):
FOUR (4) #10 WOOD SCREWS FOR EACH BASE PLATE WITH MIN. 1-1/2" EMBEDMENT AND MIN. 7/8" WOOD EDGE DISTANCE.
- 3) INSTALLATION TO CONCRETE/MASONRY:
TWO (2) SCREWS FOR EACH BASE PLATE IN OUTERMOST HOLES. IN GROUT-FILLED CMU BLOCK (ASTM C-90 COMPLIANT) USE 1/4" DEWALT ULTRACONS+ WITH 1-3/8" MIN. EMBED. TO BLOCK AND 1" MIN. EDGE DIST. WITH MIN. 1-1/4" EMBEDMENT. IN SOLID CONCRETE (2.85 KSI MIN.) USE 3/16" ITW TAPCONS OR 1/4" DEWALT ULTRACONS+ WITH 1-3/4" MIN. EMBED TO CONCRETE, AND 1-1/8" MIN. EDGE DIST.
- 4) IF PRODUCT IS INSTALLED WITHIN 3000 FEET OF A SALTWATER COASTLINE, THE ANCHORAGE MUST BE REVIEWED FOR COMPLIANCE WITH FBC SECT. 1711, SEE EVALUATION REPORT FOR THIS APPROVAL FOR DETAILS.



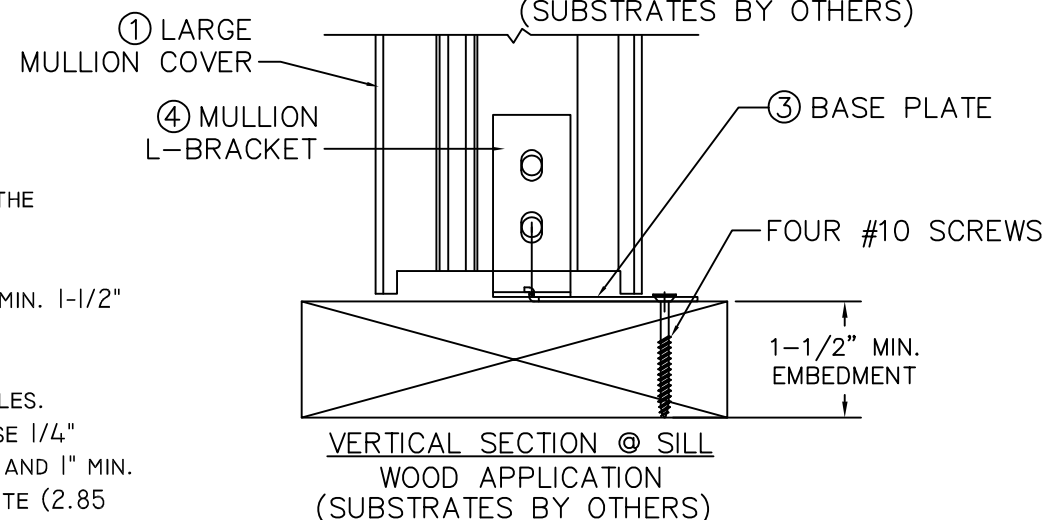


TABLE 1 (MULLION ATTACHING HARDWARE)	
RIVET	.25 DIA. STEEL RIVET WITH A GRIP LENGTH OF .50 MAX.
BARREL NUT	#10-24 OR #10-32 STAINLESS STEEL BARREL NUT, .250 O.D. X .25" LG WITH .125 MIN ENGAGEMENT

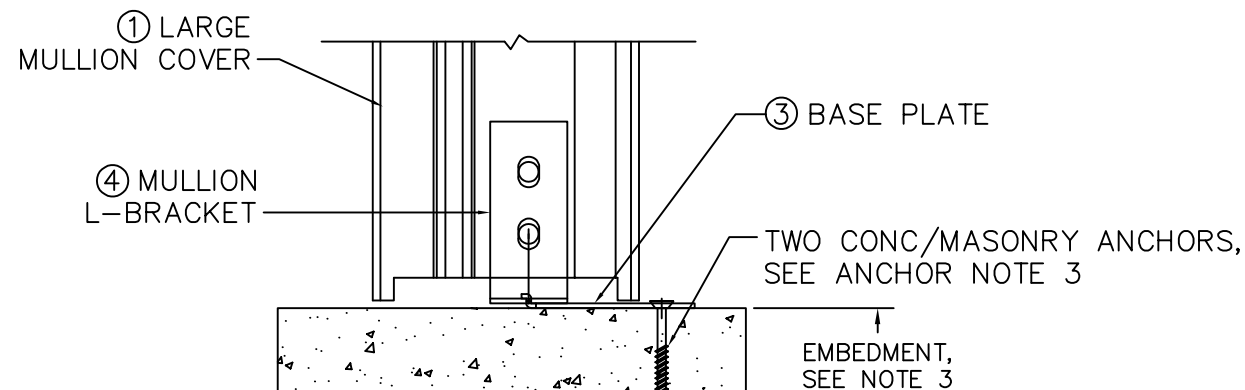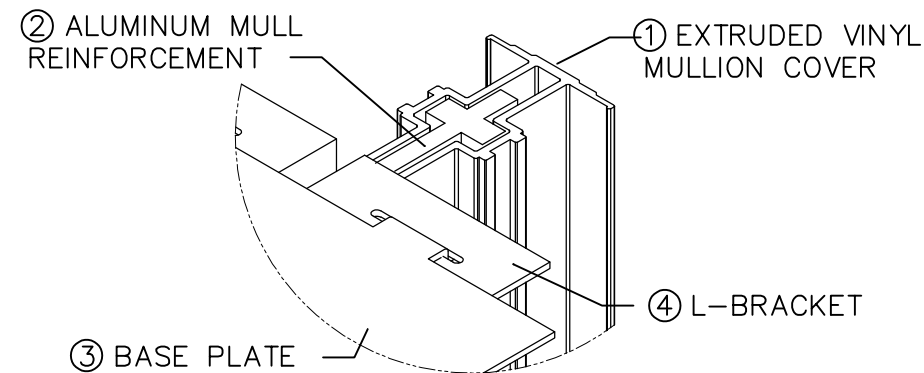

SEE NOTES BELOW AND
MANUFACTURER'S
ATTACHMENT INSTRUCTIONS
FOR ATTACHING REINFORCED
MULLIONS TO WINDOW UNITS


L-BRACKET IS ATTACHED
TO VINYL MULL COVER &
MULL REINFORCEMENT
USING TWO (2) RIVETS
OR BARREL NUTS (305
LB MAX SHEAR) 2 ON
EACH L-BRACKET REFER
TO TABLE 1

PAK-WIK SPACER 1" X
1/2" X 1/4" THK. MAX.
(4) REQ. (2) AT TOP
AND (2) AT BOTTOM

SEE NOTES BELOW AND
MANUFACTURER'S ATTACHMENT
INSTRUCTIONS FOR ATTACHING
REINFORCED MULLIONS TO
WINDOW UNITS

ASSEMBLED MULL AND ATTACHMENT VIEW

FL 15534

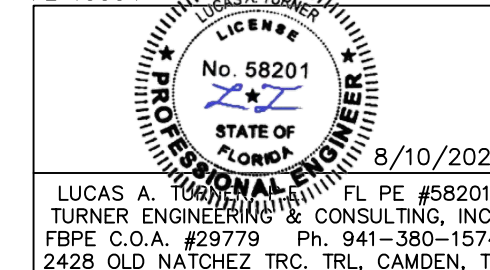

SIMONTON WINDOWS 1 Cochrane Avenue Pennsboro, WV 26415		SIZE: DRAWING NO.: B RM0052	REV.: 7
DRAWN BY: GLS		DATE: 12/18/08	
CHECKED BY:		DATE:	
SCALE: FIT	SHEET: 3 of 3	APPRVD BY: C.P.	DATE: 01-24-12
SERIES: STORMBREAKER PLUS 300VL MULLION			
TITLE: MULLION DETAILS AND SILL CROSS SECTIONS			