

ANDERSEN CORPORATION

A-SERIES CASEMENT WINDOW WITH STORMWATCH PROTECTION (HVHZ)(IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), **INCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
- TAS 201-94

TAS 202-94

TAS 203-94

AAMA/WDMA/CSA 101/I.S.2/A440-17

ASTM E1886-19

ASTM E1996-20
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X & 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS. IN HVHZ AREAS, ONE TIME PRODUCT APPROVAL TO BE OBTAINED FROM MIAMI-DADE RER OR AHJ.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. WINDOW FRAME MATERIAL: PINE (MIN. S.G. = 0.40)
7. CLADDING MATERIAL: FIBREX ® AND FIBERGLASS
8. IN ACCORDANCE WITH FBC, WOOD COMPONENTS SHALL HAVE BEEN PRESERVATIVE TREATED OR SHALL BE OF A DURABLE SPECIES AS PER FBC, CHAPTER 23.
9. GLASS MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 2 FOR GLAZING DETAILS.
10. CONFIGURATION (CONFIG.) NOTATION:

'X' - OPERABLE

'O' - STATIONARY

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES
2	GLAZING DETAILS
3	ELEVATIONS, ANCHOR LAYOUTS & ASSEMBLY NOTES
4	VERTICAL SECTIONS
5	VERTICAL SECTIONS
6	HORIZONTAL SECTIONS
7	INSTALLATION NOTES & ANCHOR DETAILS
8	BILL OF MATERIALS & COMPONENTS
9	COMPONENTS & HARDWARE SCHEDULE

OVERALL SIZE		DESIGN PRESSURE	GLAZING OPTIONS	CONFIG	MISSILE IMPACT RATING
WIDTH	HEIGHT				
35 1/4"	71 1/4"	+70/- 70 PSF	G1 OR G2	'X' OR 'O'	LARGE & SMALL MISSILE IMPACT
41 1/4"	95 1/4"	+50/- 50 PSF	G3		
45 1/4"	87 1/4"		G3		
47 1/4"	46 1/8"		G2		
47 1/4"	47 1/4"		G2		
47 1/4"	71 1/4"		G2		
47 1/4"	79 1/4"		G3		

ANDERSEN
WINDOWS & DOORS

100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096

PH: (651) 264-5150 FX: (651) 264-5485

TITLE: A-SERIES CASEMENT
WINDOW WITH STORMWATCH
PROTECTION
(HVHZ)(IMPACT)
GENERAL NOTES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

BD
BUILDING DROPS

REMARKS	BY	DATE
7 TH FBC CODE CHANGE	SR	3.19.20
PROFILE UPDATE	SM	3.20.24
INSTALLATION REV.	HJ	5.29.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.06.04 12:30:59 -04'00'

FL #:

FL15551

DATE:

12.05.25

DWG. BY:

HJ

CHK. BY:

HFN

SCALE:

NTS

DWG. #:




AWD179

SHEET:

1

OF 9

c:\users\hardley\pant\building drops, inc.\building drops landing - common\projects\andersen corporation\fb-25-1131 - 015551 & 015553 a-series window revisions\dwgs\andersen a-series revision (June upload)\awd179.dwg 6/2/2026 2:45 PM

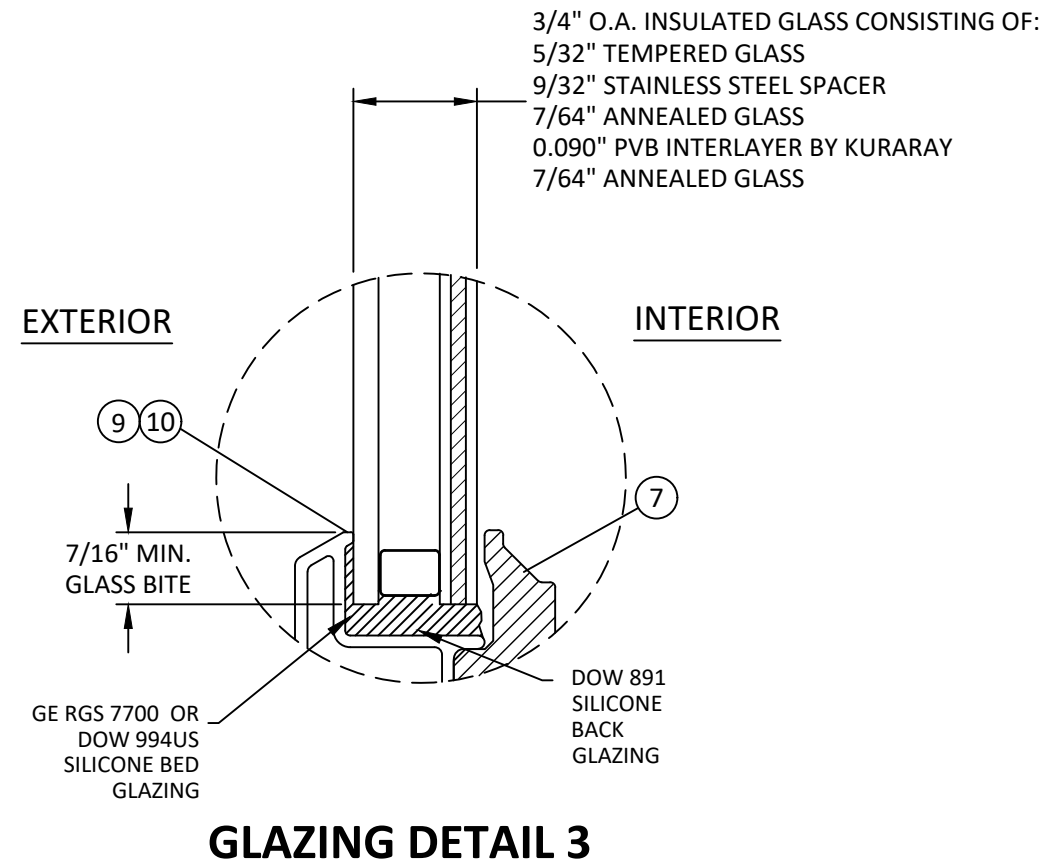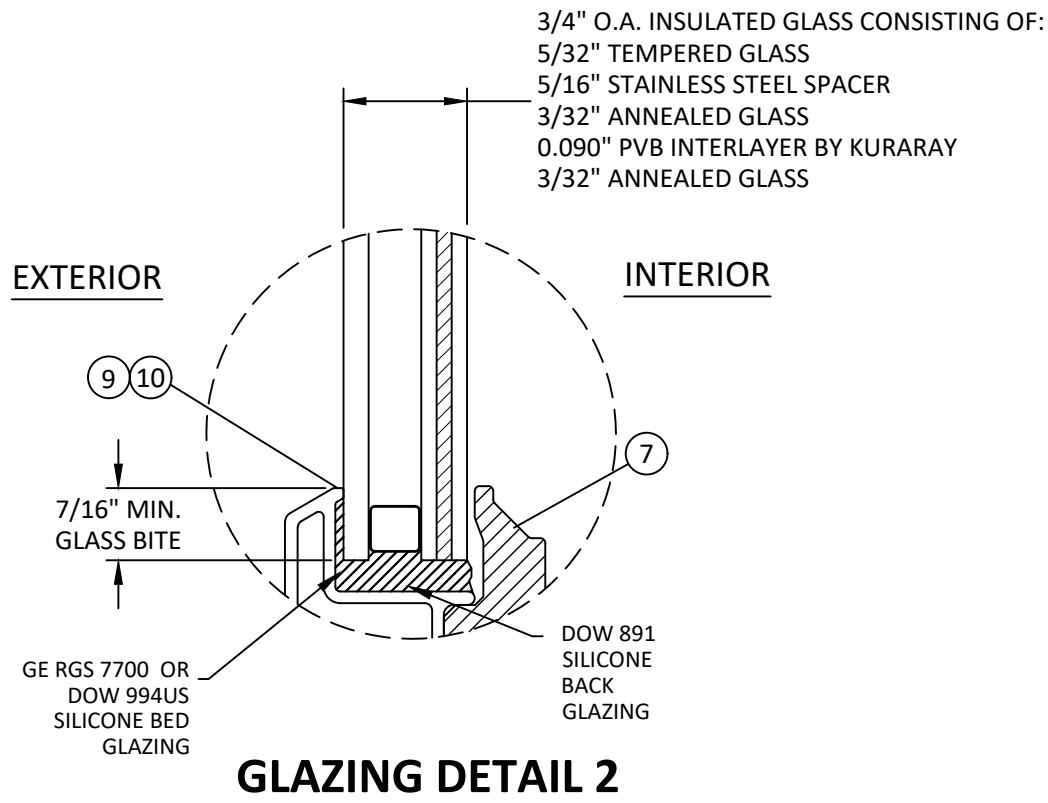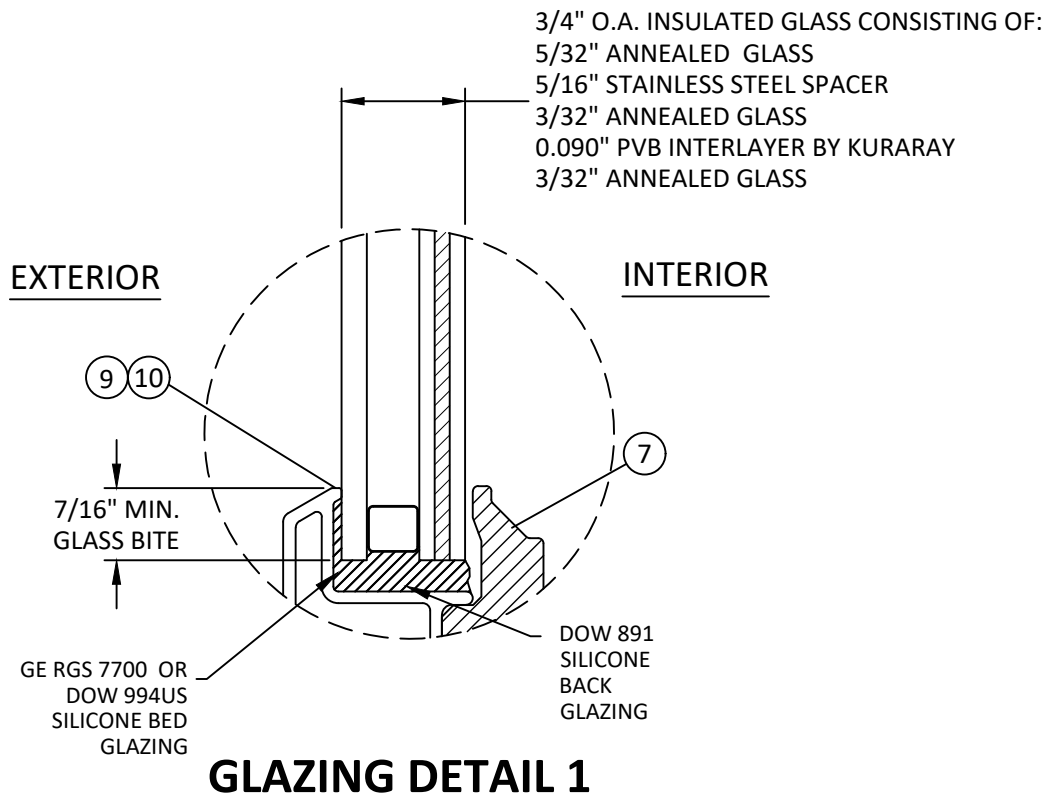

GLAZING NOTES:

1. GLASS TYPE COMPLIES WITH ASTM E1300 AND THE FBC SAFETY GLAZING REQUIREMENTS. PER THE FBC TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
3. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
4. D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.



100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485

TITLE: A-SERIES CASEMENT
WINDOW WITH STORMWATCH
PROTECTION
(HVHZ)(IMPACT)
GLAZING DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
7 TH FBC CODE CHANGE	SR	3.19.20
PROFILE UPDATE	SM	3.20.24
INSTALLATION REV.	HJ	5.29.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT



FL #:

FL15551

DATE: **12.05.25**

DWG. BY:
HJ

CHK. BY:
HFN

SCALE: **NTS**


DWG. #: **AWD179**

SHEET:

2

OF 9


c:\users\barley\pant\building drops, inc.\building drops, inc.\projects\andersen a-series window revisions\dwgs\andersen a-series window revisions\and179.dwg 6/2/2026 2:46 PM

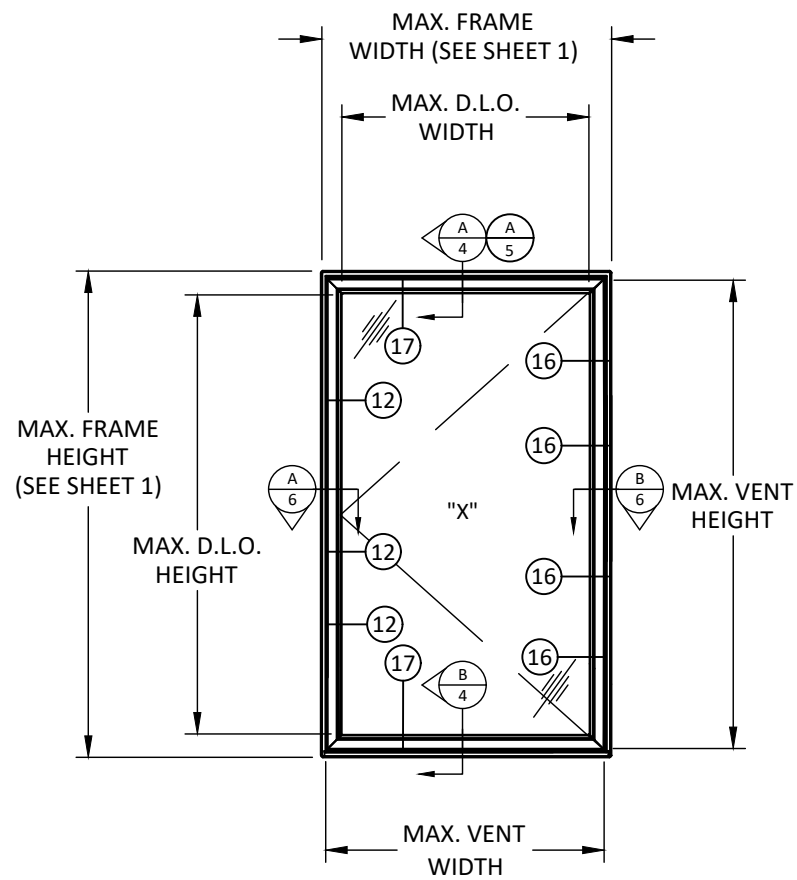

ELEVATION
OPERABLE

VENT HEIGHT = FRAME HEIGHT - 2"
VENT WIDTH = FRAME WIDTH - 2"
D.L.O. HEIGHT (ACW) = FRAME HEIGHT - 6 11/16"
D.L.O. HEIGHT (ACCW) = FRAME HEIGHT - 7 15/32"
D.L.O. WIDTH = FRAME WIDTH - 7 7/16"


- ASSEMBLY NOTES:**
1. LOCK KEEPERS SHALL BE FASTENED TO SASH WITH TWO #7 X 1-1/16" SCREWS.
 2. STATIONARY BRACKETS SHALL BE FASTENED WITH FOUR #8 X 1" SCREWS; TWO THROUGH BRACKET TO SASH, TWO THROUGH BRACKET TO JAMB.
 3. SNUGGER SETS AT HINGE JAMBS SHALL BE FASTENED TO SASH AND FRAME WITH FOUR #7 X 3/4" SCREWS, TWO THROUGH SNUGGER TO FRAME, AND TWO THROUGH SNUGGER TO SASH.
 4. INTERIOR STOPS SHALL BE SECURED WITH 7/32" X 1" STAPLES 3" FROM CORNERS AND 7" O.C. THEREAFTER.
 5. TRIM STOPS SHALL BE SECURED WITH VINYL SPLINE.
 6. WOOD FRAME MEMBERS SHALL BE BONDED TO EXTERIOR FRAME CLADDING WITH HOT MELT ADHESIVE.
 7. TOP AND BOTTOM RAILS TO HAVE GALVANIZED STEEL STIFFENERS INSERTED LOOSELY INTO INTERNAL CAVITY OF RAILS. FOR UNITS EQUAL TO OR LARGER THAN 47.25" X 47.25" OR 35.25" X 71.25", NO STIFFENER IS REQUIRED.
 8. LEFT HAND AND RIGHT HAND STILE TO HAVE GALVANIZED STEEL STIFFENERS INSERTED LOOSELY INTO CAVITY OF STILES. FOR ALL UNITS TALLER THAN 71.25"

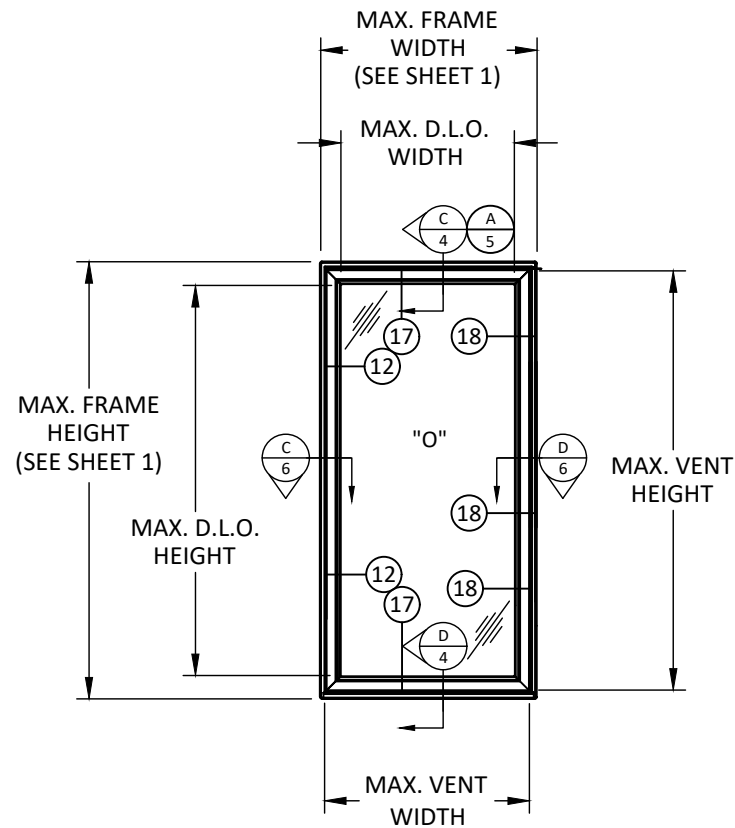

ELEVATION
STATIONARY


- NOTES:**
- 1) OPERABLE UNITS MAY BE EITHER LH OR RH OUTSWING OPERABLE CASEMENT WINDOWS.
 - 2) SEE HARDWARE SCHEDULE ON SHEET 9 FOR HARDWARE OPTIONS AND QUANTITY.

INSTALLATION CLIP ANCHOR QUANTITY SCHEDULE - JAMBS		
HEIGHT (H)	DESCRIPTION	QUANTITY
H > 63.25"	USE FOUR CLIPS PER SIDE	4
H ≤ 71.25" & W ≤ 35.25"	USE THREE CLIPS PER SIDE	3
47.25" < H ≤ 63.25"	USE THREE CLIPS PER SIDE	3
35.25" < H ≤ 47.25"	USE TWO CLIPS PER SIDE	2
H ≤ 35.25"	USE ONE CLIP AT MIDSPAN PER SIDE	1
ANCHOR QUANTITY SCHEDULE - HEAD & SILL		
WIDTH (W)	DESCRIPTION	QUANTITY
W ≤ 35.25"	USE ONE CLIP AT MIDSPAN	1
W > 35.25"	USE TWO CLIPS 12" FROM EA. CORNER	2

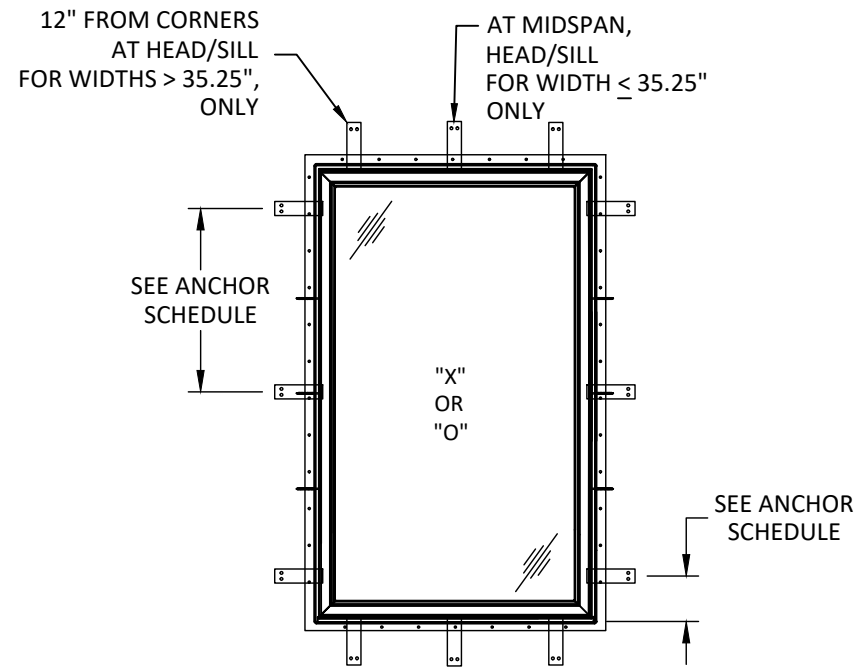

ANCHOR LAYOUT
CLIP & NAIL FIN INSTALLATION

NOTE: WHEN NAILING FLANGE IS UTILIZED WITH INSTALLATION CLIPS, UNITS SHALL BE FASTENED THROUGH THE NAILING FLANGE AND INSTALLATION CLIP. FOR NAILING FLANGE ANCHOR LAYOUT FOLLOW MANUFACTURER'S INSTRUCTIONS

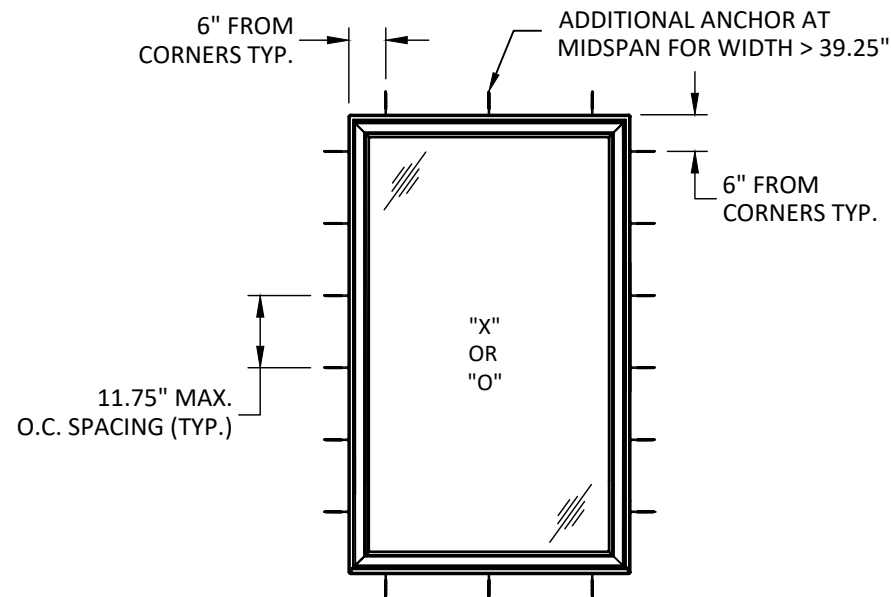

ANCHOR LAYOUT
THROUGH FRAME INSTALLATION

ANCHOR LEGEND	
	INSTALLATION CLIP
	THROUGH FRAME ANCHOR
	NAILING FLANGE ANCHOR LOCATION




100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485

TITLE: A-SERIES CASEMENT
WINDOW WITH STORMWATCH
PROTECTION
(HVHZ)(IMPACT)
ELEVATIONS, ANCHOR LAYOUTS
& ASSEMBLY NOTES
PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 474-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
7 TH FBC CODE CHANGE	SR	3.19.20
PROFILE UPDATE	SM	3.20.24
INSTALLATION REV.	HJ	5.29.26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT

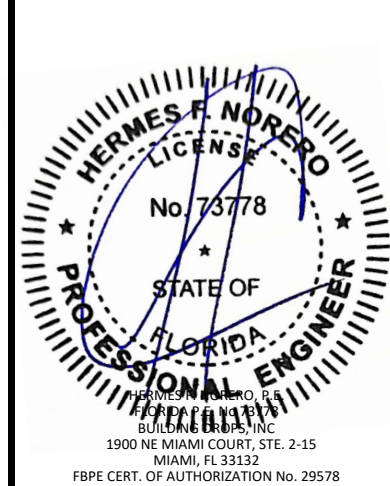


FL #:
FL15551
DATE: **12.05.25**
DWG. BY: **HJ** CHK. BY: **HFN**
SCALE: **NTS**
DWG. #: **AWD179**
SHEET:

3

c:\users\harley\pant\building drops, inc.\building drops landing - common\projects\andersen corporation\bc-25-1131 - fl15551 & fl15553 a-series window revisions\dwgs\andersen a-series window revisions\awd179.dwg 6/2/2026 2:45 PM

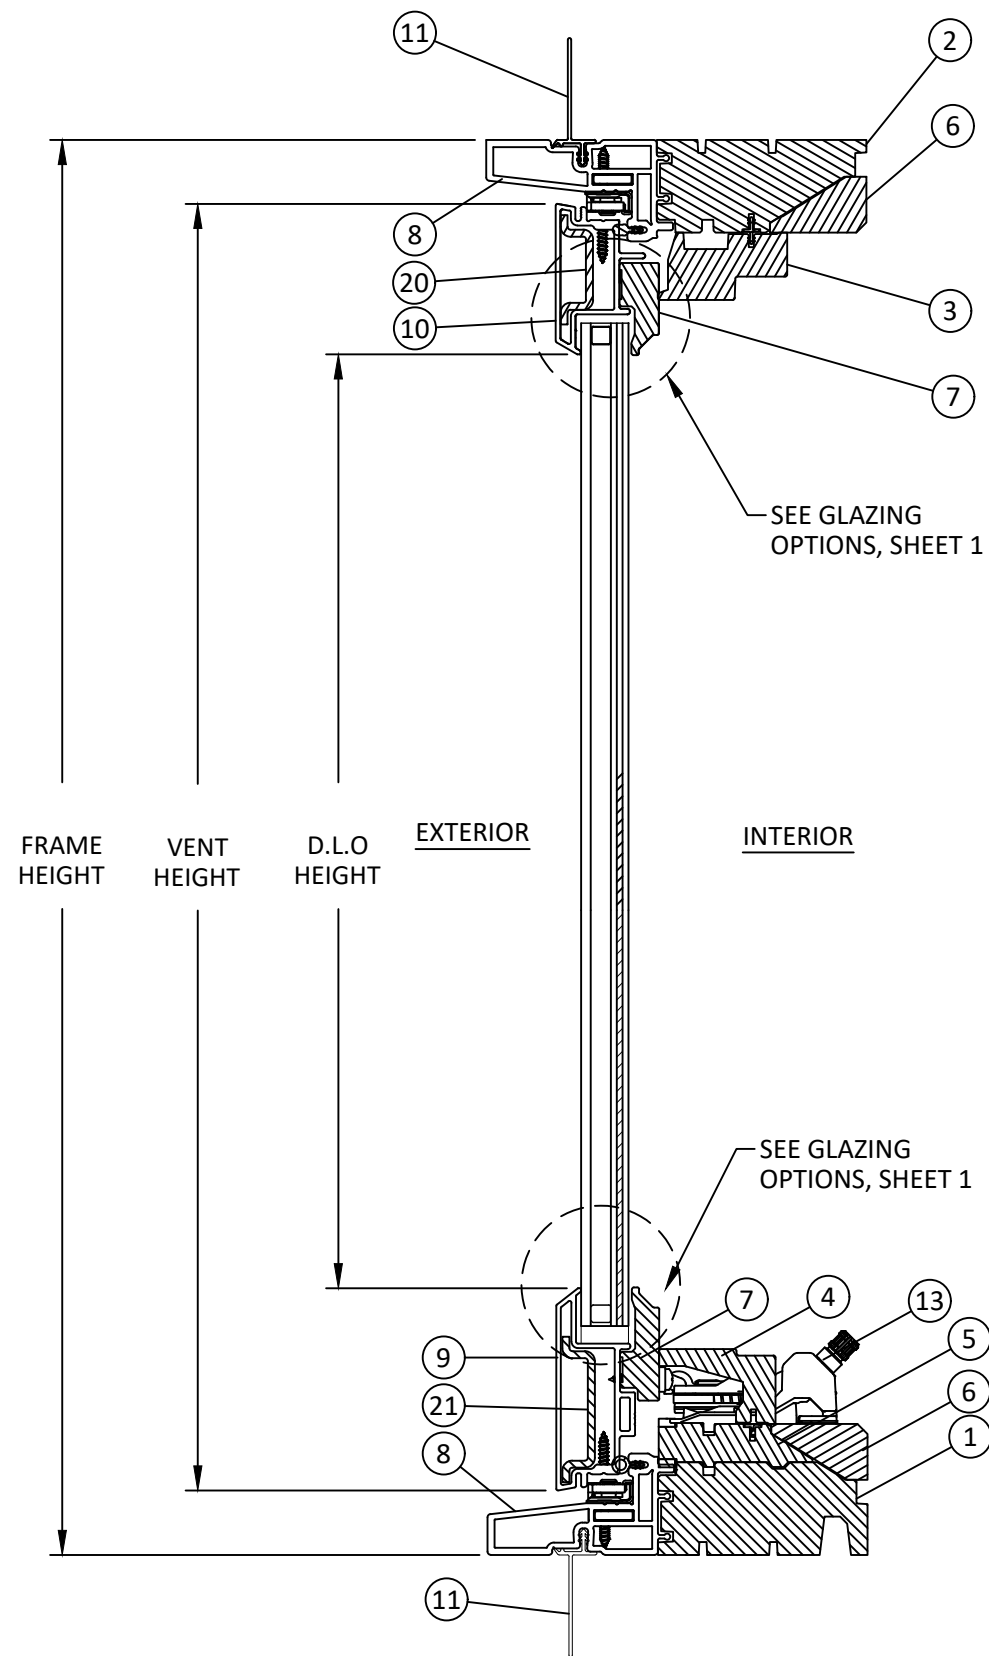

A
4 **VERTICAL SECTION**
NAIL FIN INSTALLATION - OPERABLE
ACW - TRADITIONAL BOTTOM RAIL

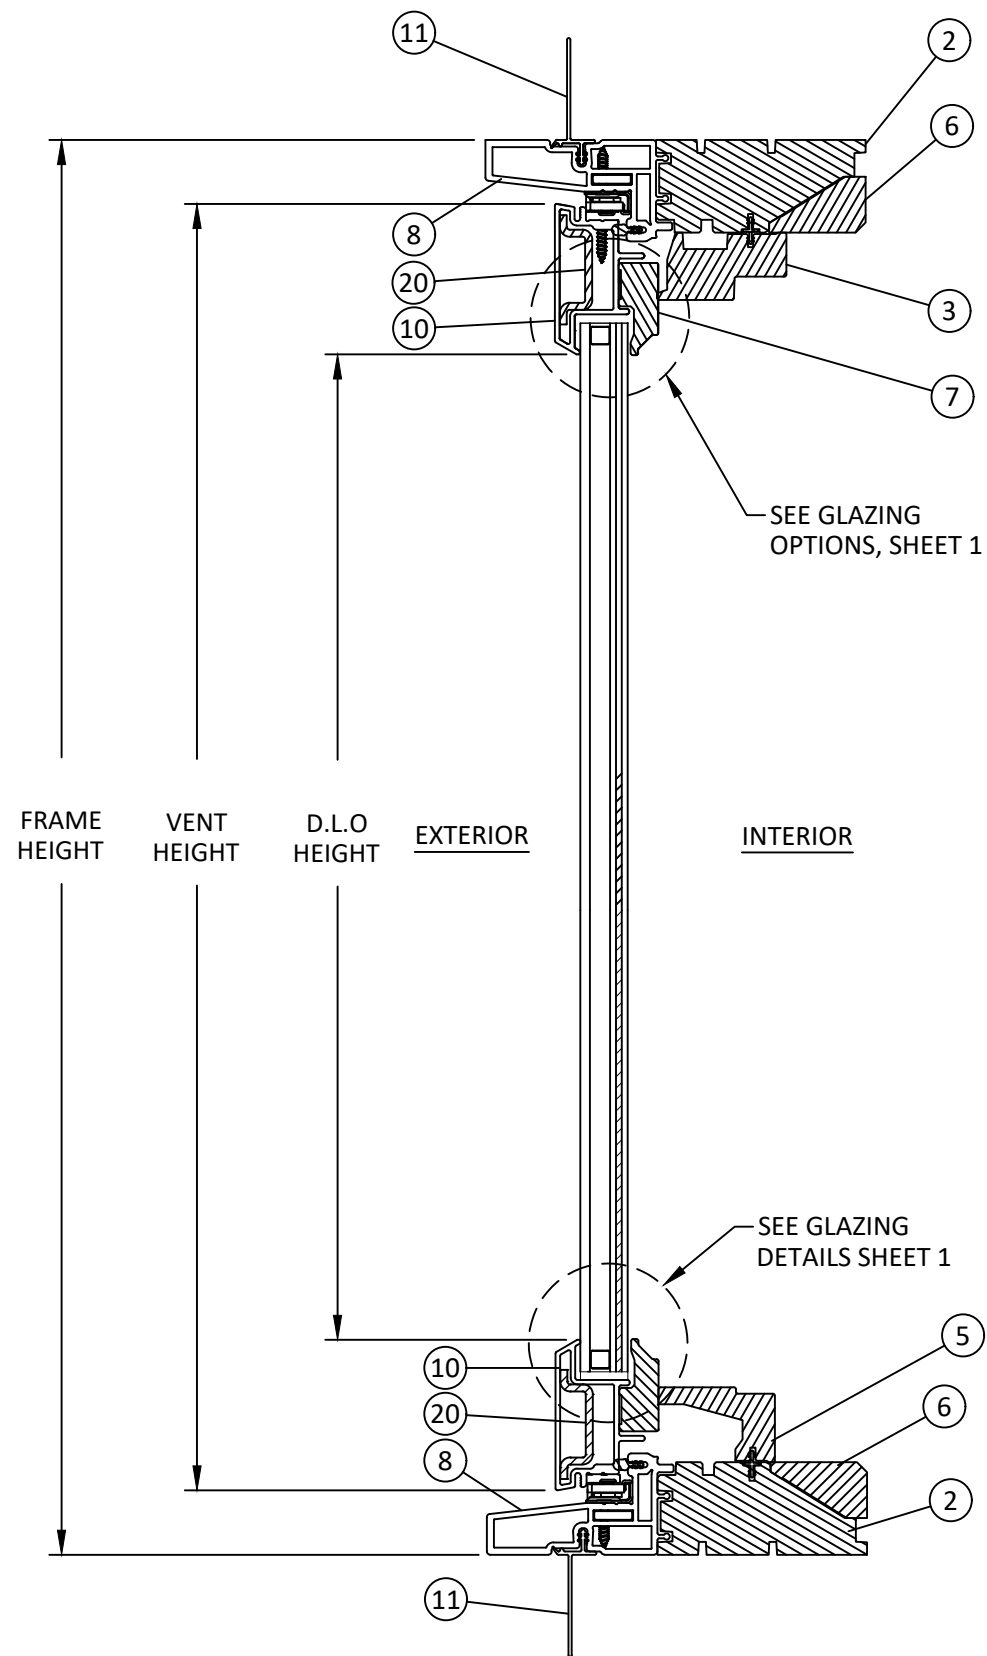

B
4 **VERTICAL SECTION**
NAIL FIN INSTALLATION - STATIONARY
ACCW - CONTEMPORARY BOTTOM RAIL



ANDERSEN
WINDOWS & DOORS

100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485

TITLE: A-SERIES CASEMENT
WINDOW WITH STORMWATCH
PROTECTION
(HVHZ)(IMPACT)
VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
7 TH FBC CODE CHANGE	SR	3.19.20
PROFILE UPDATE	SM	3.20.24
INSTALLATION REV.	HJ	5.29.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT



FL #:
FL15551

DATE: **12.05.25**

DWG. BY: **HJ** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **AWD179**


SHEET:

4

OF 9

B
5 **VERTICAL SECTION**
THRU FRAME/CLIP INSTALLATION - OPERABLE
ACCW - CONTEMPORARY BOTTOM RAIL

c:\users\hardley\pant\building drops, inc\building drops - common\projects\andersen corporation\fb-25-1131 - 015551 & 015553 a-series window revisions\dwgs\andersen a-series revision (june upload)\awd179.dwg 6/2/2026 2:46 PM

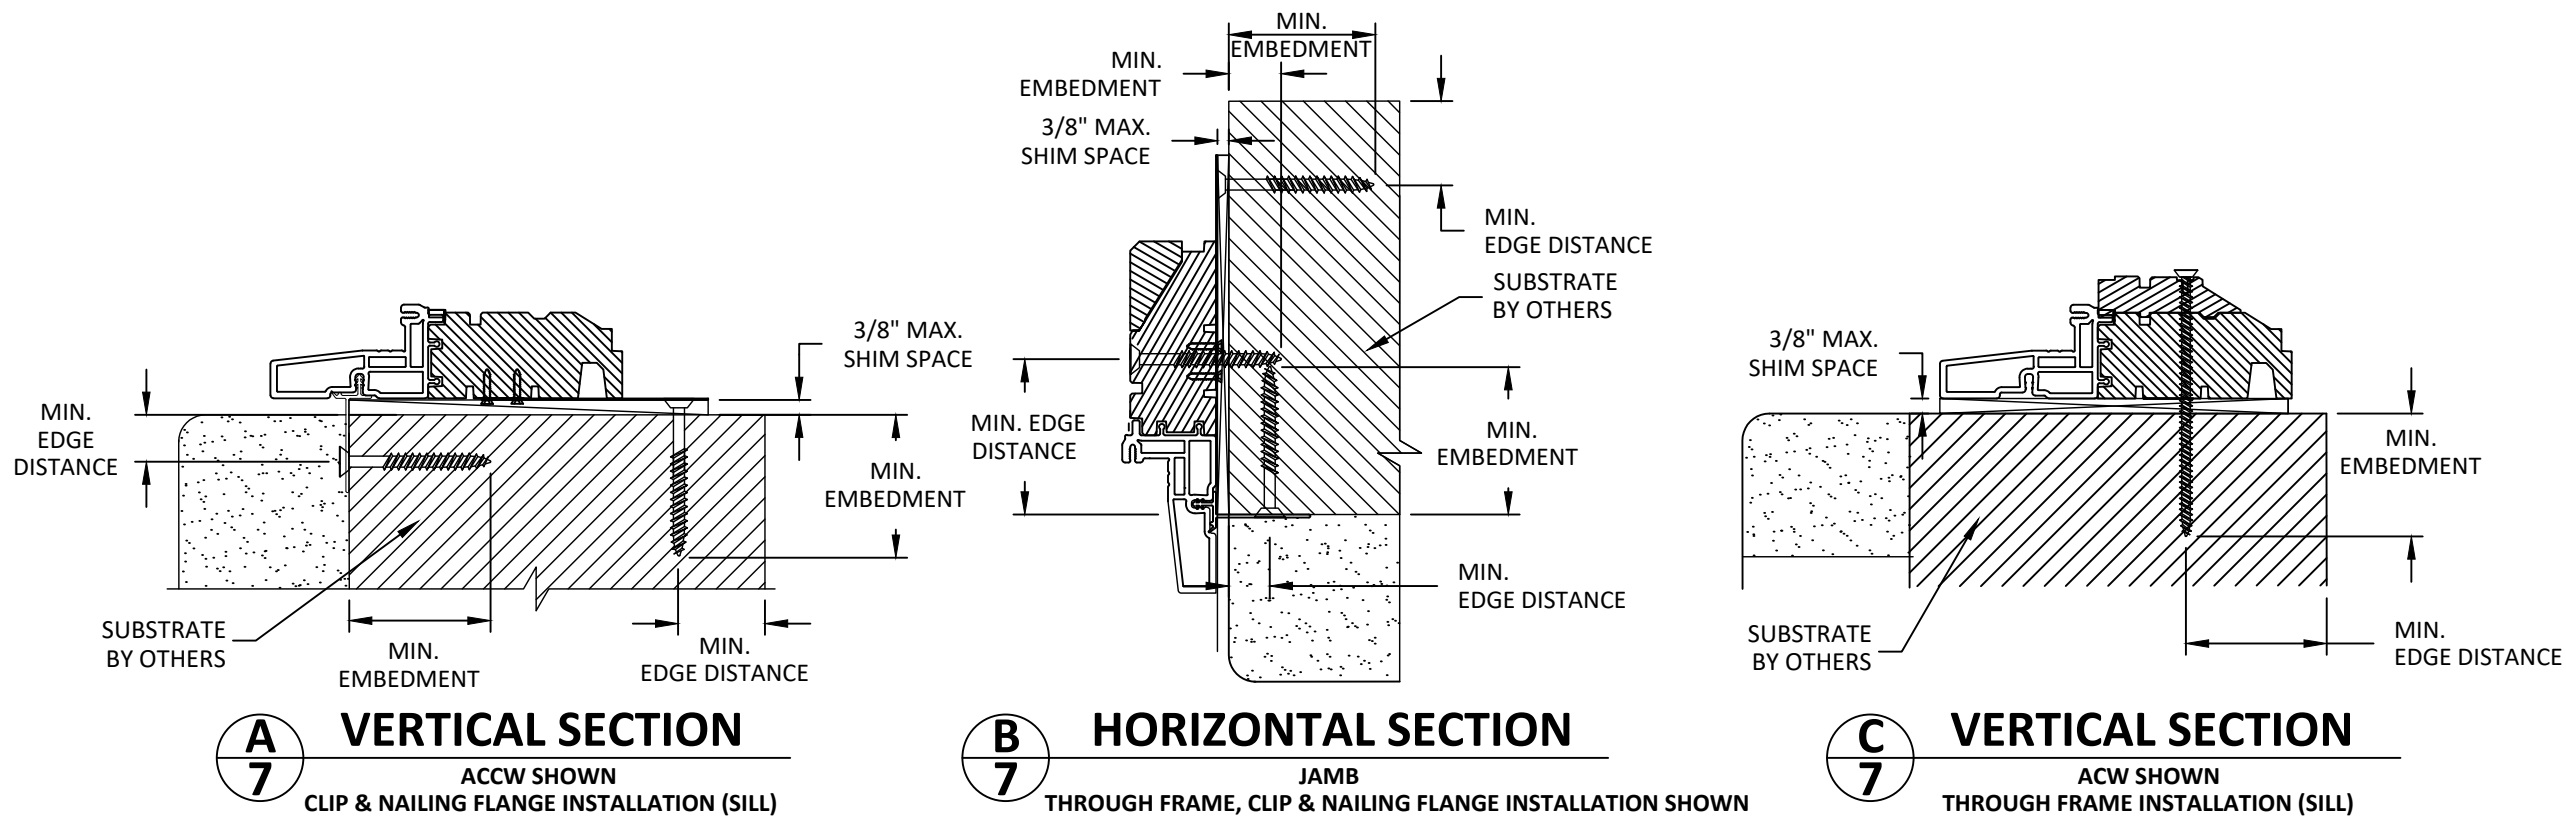

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN. UNLESS SPECIFIED ON SHEETS 3 & 7.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ± 1.000 INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- UNITS OF HEIGHT > 71.25 " ONLY - REQUIRE THROUGH THE JAMB INSTALLATION USING #10 X 3 INCH WOOD SCREWS, ONE (1) EACH AT QUARTER POINTS AND MID POINT ALONG THE HEIGHT OF THE SIDE JAMBS OF SUFFICIENT LENGTH TO ACHIEVE 1-1/2 INCH MINIMUM EMBEDMENT INTO ROUGH OPENING.

NOTES: ADDITIONAL THROUGH JAMB FASTENERS REQUIRED ON UNITS FOR HEIGHTS > 71.25 "

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
CLIP INSTALLATION	WOOD: MIN. SG = 0.55	#10 PAN HEAD WOOD SCREW	1.50"	0.75"
	METAL: 18 GAUGE Steel, MIN. Fy = 33KSI	#10 TEK SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.50"
	CONCRETE: f'c=3000PSI	3/16" ITW TAPCON FLAT HEAD	1.00"	1.50"
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI	3/16" ITW TAPCON FLAT HEAD	1.00"	2.00"
THROUGH FRAME INSTALLATION	WOOD: MIN. SG = 0.55	#10 WOOD SCREW	1.50"	1.00"
	METAL: 18 GAUGE Steel, MIN. Fy = 33KSI	#10 TEK SELF-TAP	3 THREADS MIN PENETRATION BEYOND METAL	0.50"
	CONCRETE: f'c=3000PSI	3/16" ITW TAPCON	1.00"	1.50"
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI	3/16" ITW TAPCON	1.00"	2.00"



100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485


TITLE: A-SERIES CASEMENT
WINDOW WITH STORMWATCH
PROTECTION
(HVHZ)(IMPACT)
INSTALLATION NOTES
& ANCHOR DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
7 TH FBC CODE CHANGE	SR	3.19.20
PROFILE UPDATE	SM	3.20.24
INSTALLATION REV.	HJ	5.29.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT

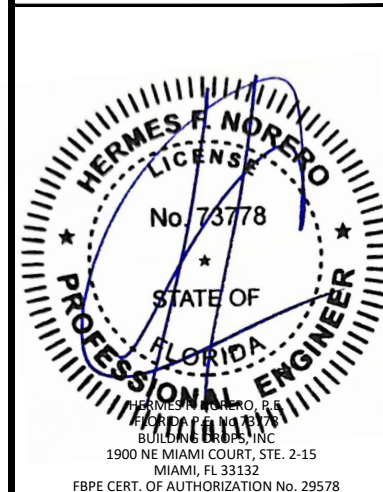


FL #:	FL15551
DATE:	12.05.25
DWG. BY:	HJ
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	AWD179
SHEET:	7

BILL OF MATERIALS			
ITEM #	DESCRIPTION	MATERIAL	MANUFACTURER
1	FRAME - SILL	WOOD	ANDERSEN
2	FRAME - HEAD, SILL & JAMBS	WOOD	ANDERSEN
3	TRIM STOP - HEAD & JAMBS	WOOD	ANDERSEN
4	TRIM STOP - SILL	WOOD	ANDERSEN
5	FRAME STOP - SILL (ACW ONLY)	WOOD	ANDERSEN
6	INTERIOR TRIM STOP	WOOD	ANDERSEN
7	SASH RAIL/STILE, INTERIOR	WOOD	ANDERSEN
8	FRAME CLADDING	FIBREX	ANDERSEN
9	SASH CLADDING - BOTTOM RAIL (ACW ONLY)	FIBERGLASS	ANDERSEN
10	SASH CALDDING - RAILS/STILES	FIBERGLASS	ANDERSEN
11	NAILING FLANGE	RIGID PVC	ANDERSEN
12	SNUGGER KIT	-	ANDERSEN
13	ROTO OPERATOR (STRAIGHT OR SPLIT ARM)	-	ANDERSEN
14	THREE POINT SURFACE MOUNTED LOCK	-	ANDERSEN
15	TWO POINT SURFACE MOUNTED LOCK	-	ANDERSEN
16	LOCK KEEPER	-	ANDERSEN
17	10" HINGE KIT ASSEMBLY	-	ANDERSEN
18	STATIONARY BRACKET KIT	GALVANIZED STEEL	ANDERSEN
19	INSTALLATION CLIP	304 SS	ANDERSEN
20	RAIL & STILE REINFORCING	GALVANIZED STEEL	ANDERSEN
21	BOTTOM RAIL REINFORCING	GALVANIZED STEEL	ANDERSEN
22	OPERATOR TRACK LIMITER	304 SS	ANDERSEN


1

FRAME - SILL
WOOD




2

FRAME - HEAD, SILL & JAMBS
WOOD




3

TRIM STOP - HEAD & JAMBS
WOOD




4

TRIM STOP - SILL
WOOD




5

FRAME STOP - SILL
WOOD (ACW ONLY)




6

INTERIOR TRIM STOP
WOOD




7

SASH RAIL/STILE, INTERIOR
WOOD




8

FRAME CLADDING
FIBREX

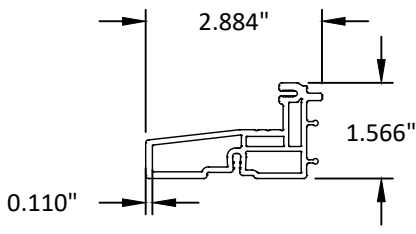


9

SASH CLADDING - BOTTOM RAIL
FIBERGLASS (ACW ONLY)

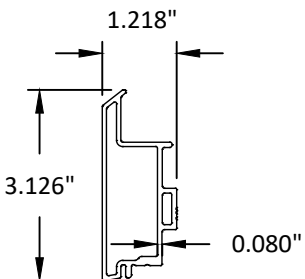

10

SASH CLADDING - RAILS/STILES
FIBERGLASS

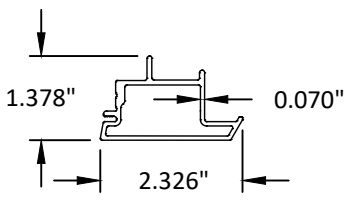

100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485

TITLE: A-SERIES CASEMENT
WINDOW WITH STORMWATCH
PROTECTION
(HVHZ)(IMPACT)

BILL OF MATERIALS & COMPONENTS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
7 TH FBC CODE CHANGE	SR	3.19.20
PROFILE UPDATE	SM	3.20.24
INSTALLATION REV.	HJ	5.29.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT

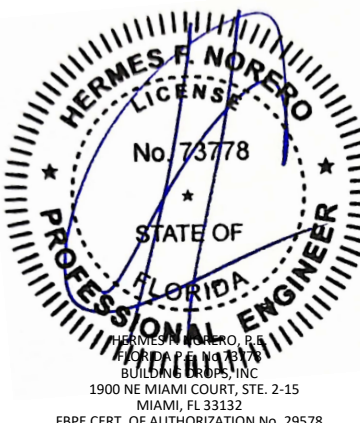

FL #:
FL15551

DATE: **12.05.25**

DWG. BY: **HJ** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **AWD179**


SHEET:

8


11 NAILING FLANGE
RIGID PVC




12 SNUGGER KIT



18 STATIONARY BRACKET KIT

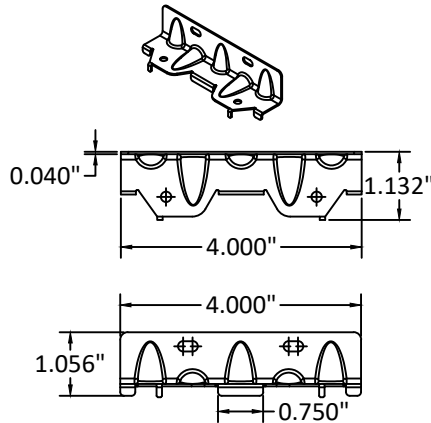


19 INSTALLATION CLIP
304 SS

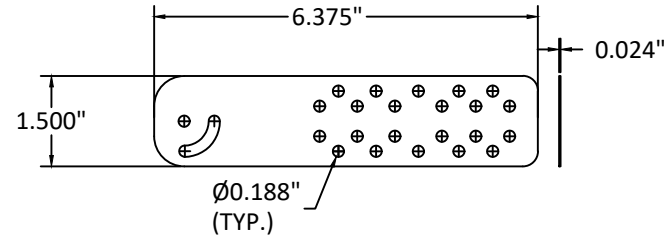


NOTE: INSTALLATION CLIPS SHALL BE ATTACHED TO WINDOW FRAME WITH TWO (2) #8 X 5/8" SCREWS

20 RAIL AND STILE REINFORCING
GALV. STEEL



21 BOTTOM RAIL REINFORCING
GALV. STEEL



HARDWARE SCHEDULE			
UNIT TYPE	HEIGHT	HARDWARE	QUANTITY
X	79.25" ≥ H > 71.25"	SNUGGERS	3
		LOCK SYSTEM	4-POINT
		STATIONARY BRACKETS	4
X	71.25" ≥ H > 46.125"	SNUGGERS	2
		LOCK SYSTEM	3-POINT
X	H ≤ 46.125"	SNUGGERS	1
		LOCK SYSTEM	2-POINT
O	71.25" ≥ H > 46.125"	SNUGGERS	2
		STATIONARY BRACKETS	3
O	H ≤ 46.125"	SNUGGERS	1
		STATIONARY BRACKETS	2
O	79.25" ≥ H > 71.25"	SNUGGERS	3
		STATIONARY BRACKETS	8 (4 EACH SIDE)
X	H > 79.25"	SNUGGERS	3-SETS (6 TOTAL)
		LOCK SYSTEM	4-POINT
		STATIONARY BRACKETS	4
O	H > 79.25"	SNUGGERS	3-SETS (6 TOTAL)
		STATIONARY BRACKETS	8 (4 EACH SIDE)



100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485


TITLE: A-SERIES CASEMENT
WINDOW WITH STORMWATCH
PROTECTION
(HVHZ)(IMPACT)
COMPONENTS
& HARDWARE SCHEDULE

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com


BUILDING DROPS

REMARKS	BY	DATE
7 TH FBC CODE CHANGE	SR	3.19.20
PROFILE UPDATE	SM	3.20.24
INSTALLATION REV.	HJ	5.29.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT

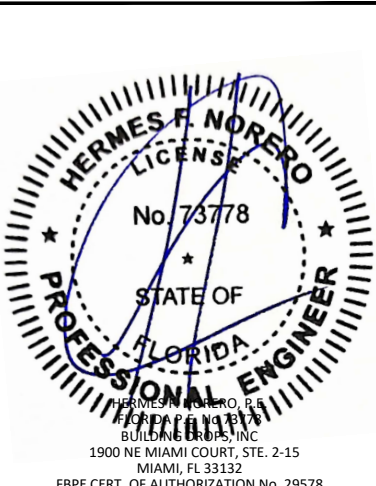

FL #:
FL15551

DATE: **12.05.25**

DWG. BY: **HJ**CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **AWD179**

SHEET: