




Series 3300-T
Sliding Glass Door
w/ Thermal Break Frame
"NON-IMPACT"

GENERAL NOTES

- 1. This product has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
- 2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
- 3. When used in areas requiring wind borne debris protection this product is required to be protected with an impact resistant covering that complies with FBC Sections 1609.1.2 & R301.2.1.2.
- 4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
- 5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.


TABLE OF CONTENTS	
SHEET#	DESCRIPTION
1	Typical elevations, design pressures and general notes
2	Horizontal cross sections
3	Vertical cross sections
4	Buck anchoring
5	Frame anchoring
6	Components
7	Bill of materials, components and glazing details

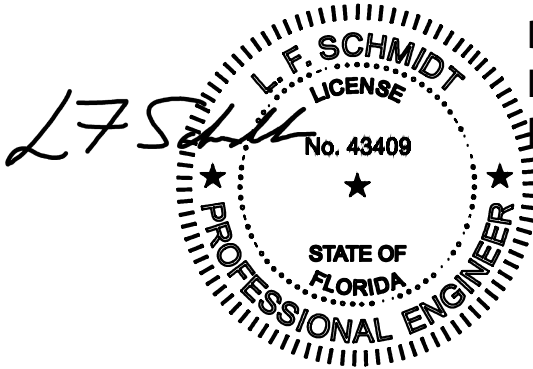

Digitally signed by
Lyndon F Schmidt
Date: 2026.07.06
4:23:36 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

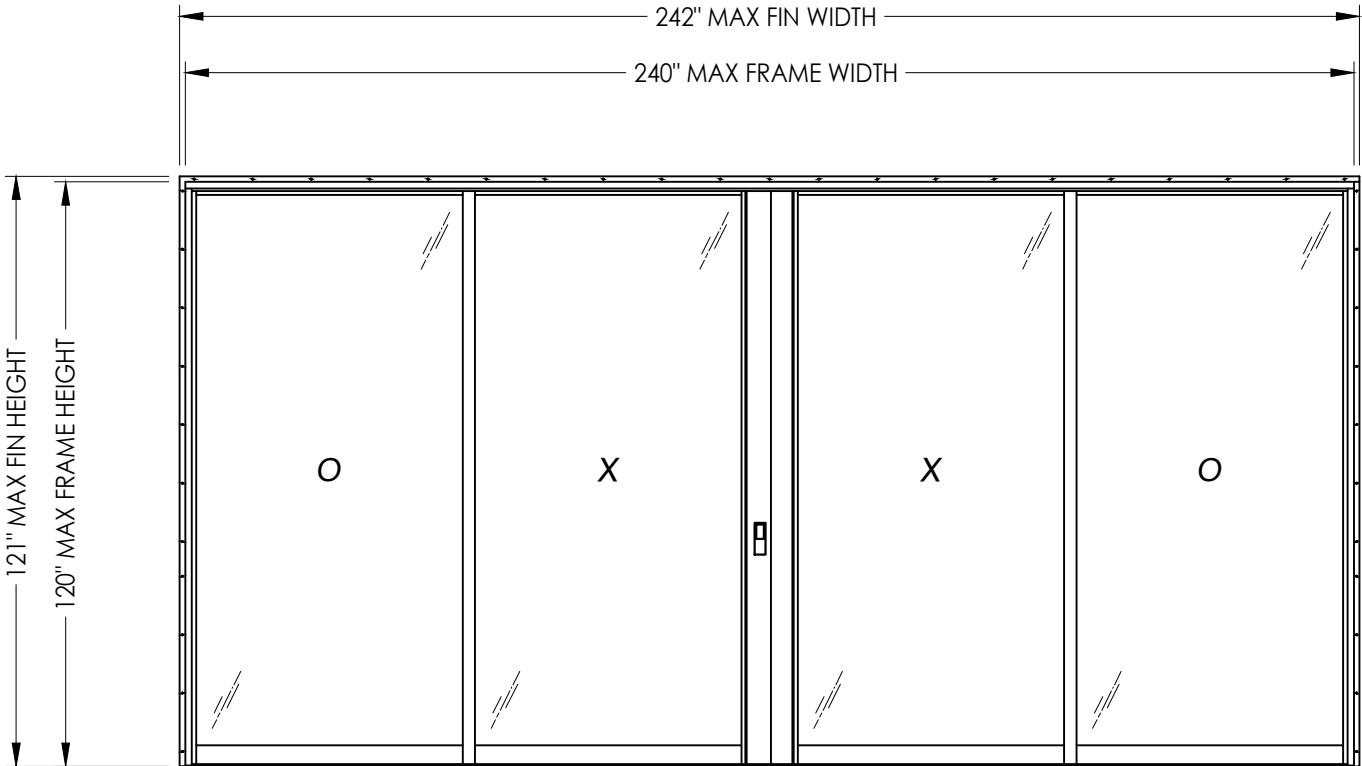

MAX PANEL DIMENSION	OVERALL D.L.O. DIMENSION	GLASS TYPE	DESIGN PRESSURE (PSF)	
			POSITIVE	NEGATIVE
62.0" X 118.25"	54.75" X 112.75"	G1	+40.0	-50.0
			+50.0*	-50.0

*Requires 3" sill pan.



Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: FLEETWOOD
Series 3300-T
PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES



NO.	DATE	REVISIONS			
		DATE	BY	DESCRIPTION	
6	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS	
5	7/12/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	
4	8/10/20	UPDATE TO 7TH ED. (2020)	FBC	DAC	

DATE: 4/4/14
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.:
FL-15560.16
SHEET 1 OF 7

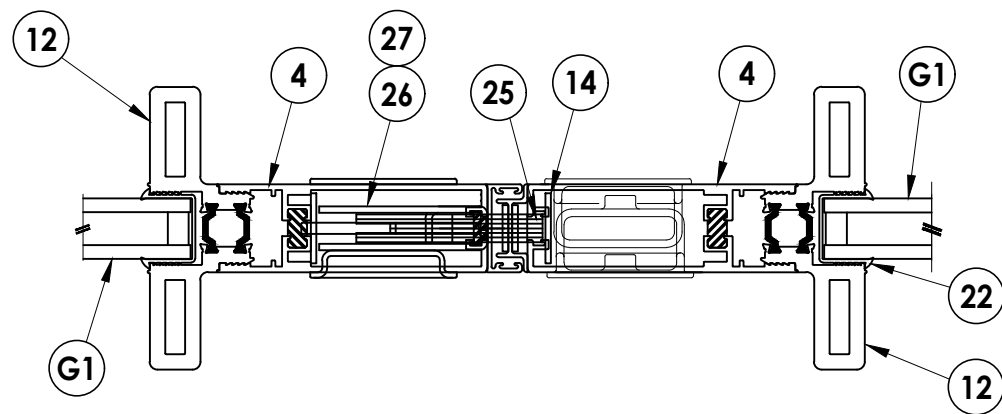

© 2014 R.W. BUILDING CONSULTANTS INC.


Z:\2023 FBC Drawings\Fleetwood Windows & Doors\FL-15560 R15 Sliding Patio Door\FL-15560.14-16.dwg

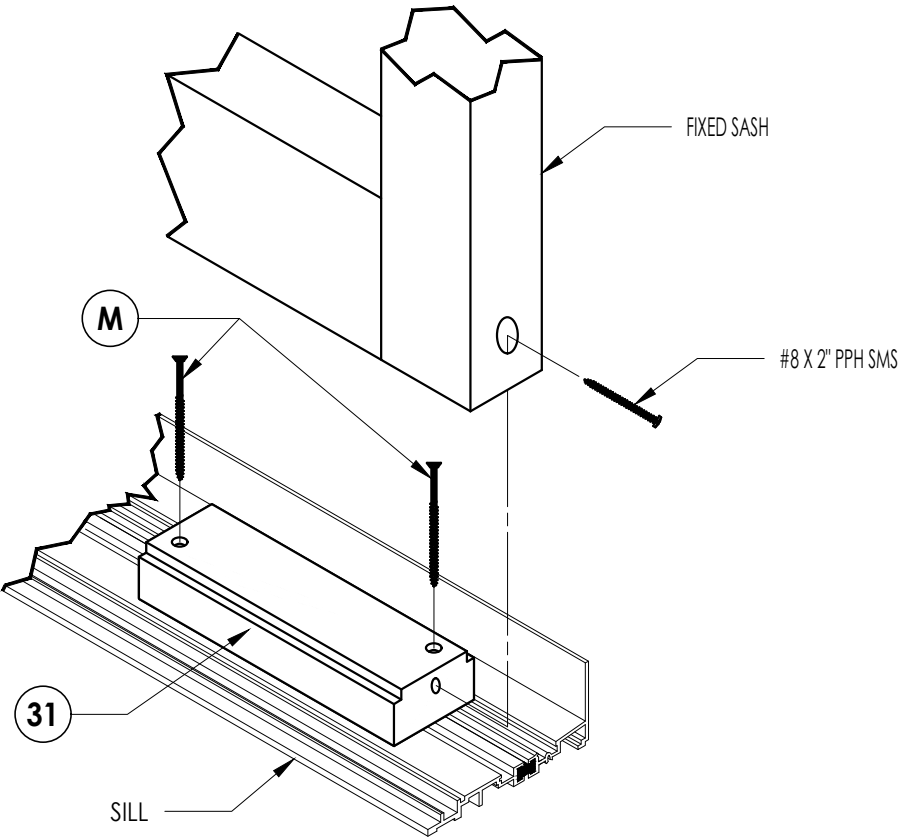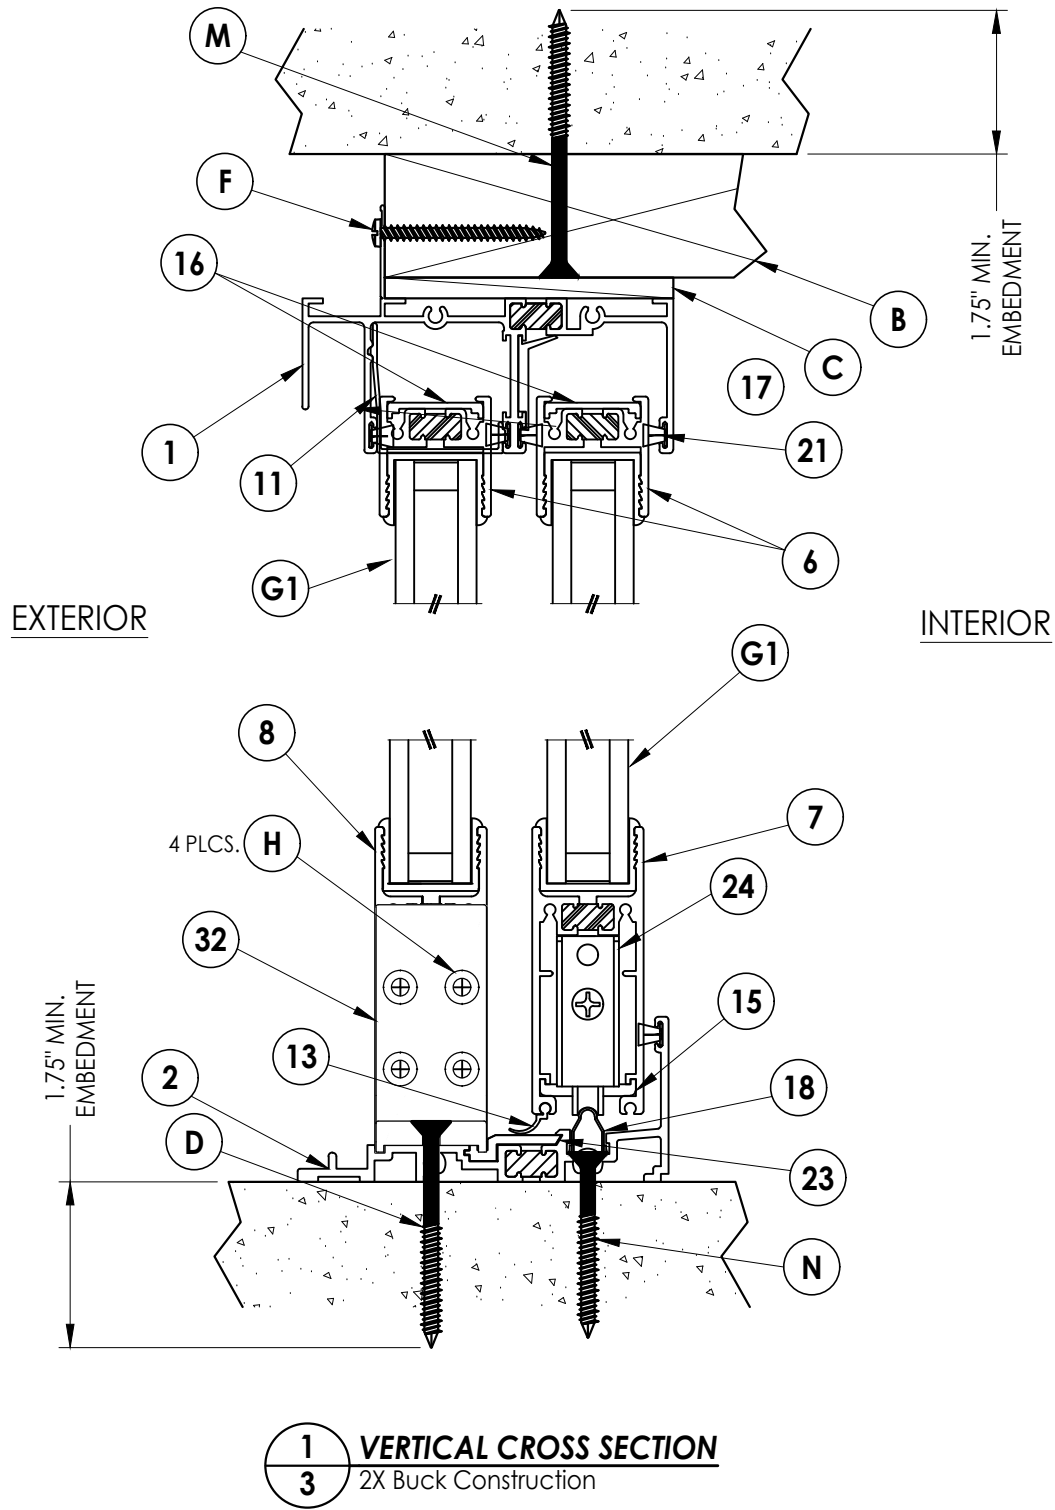

Fixed Interlock Block Detail

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409					BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813				
PRODUCT: FLEETWOOD Series 3300-T					PART OR ASSEMBLY: VERTICAL CROSS SECTION				
6	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS					
5	7/12/23	UPDATE TO 8TH ED. (2023)	FBC	LFS					
4	8/10/20	UPDATE TO 7TH ED. (2020)	FBC	DAC					
NO.	DATE			BY					
					REVISIONS				
DATE: 4/4/14									
SCALE: N.T.S.									
DWG. BY: JK									
CHK. BY: LFS									
DRAWING NO.: FL-15560.16									
SHEET 3 OF 7									

Z:\2023 FBC Drawings\Fleetwood Windows & Doors\FL-15560 R15 Sliding Patio Door\FL-15560.14-16.dwg

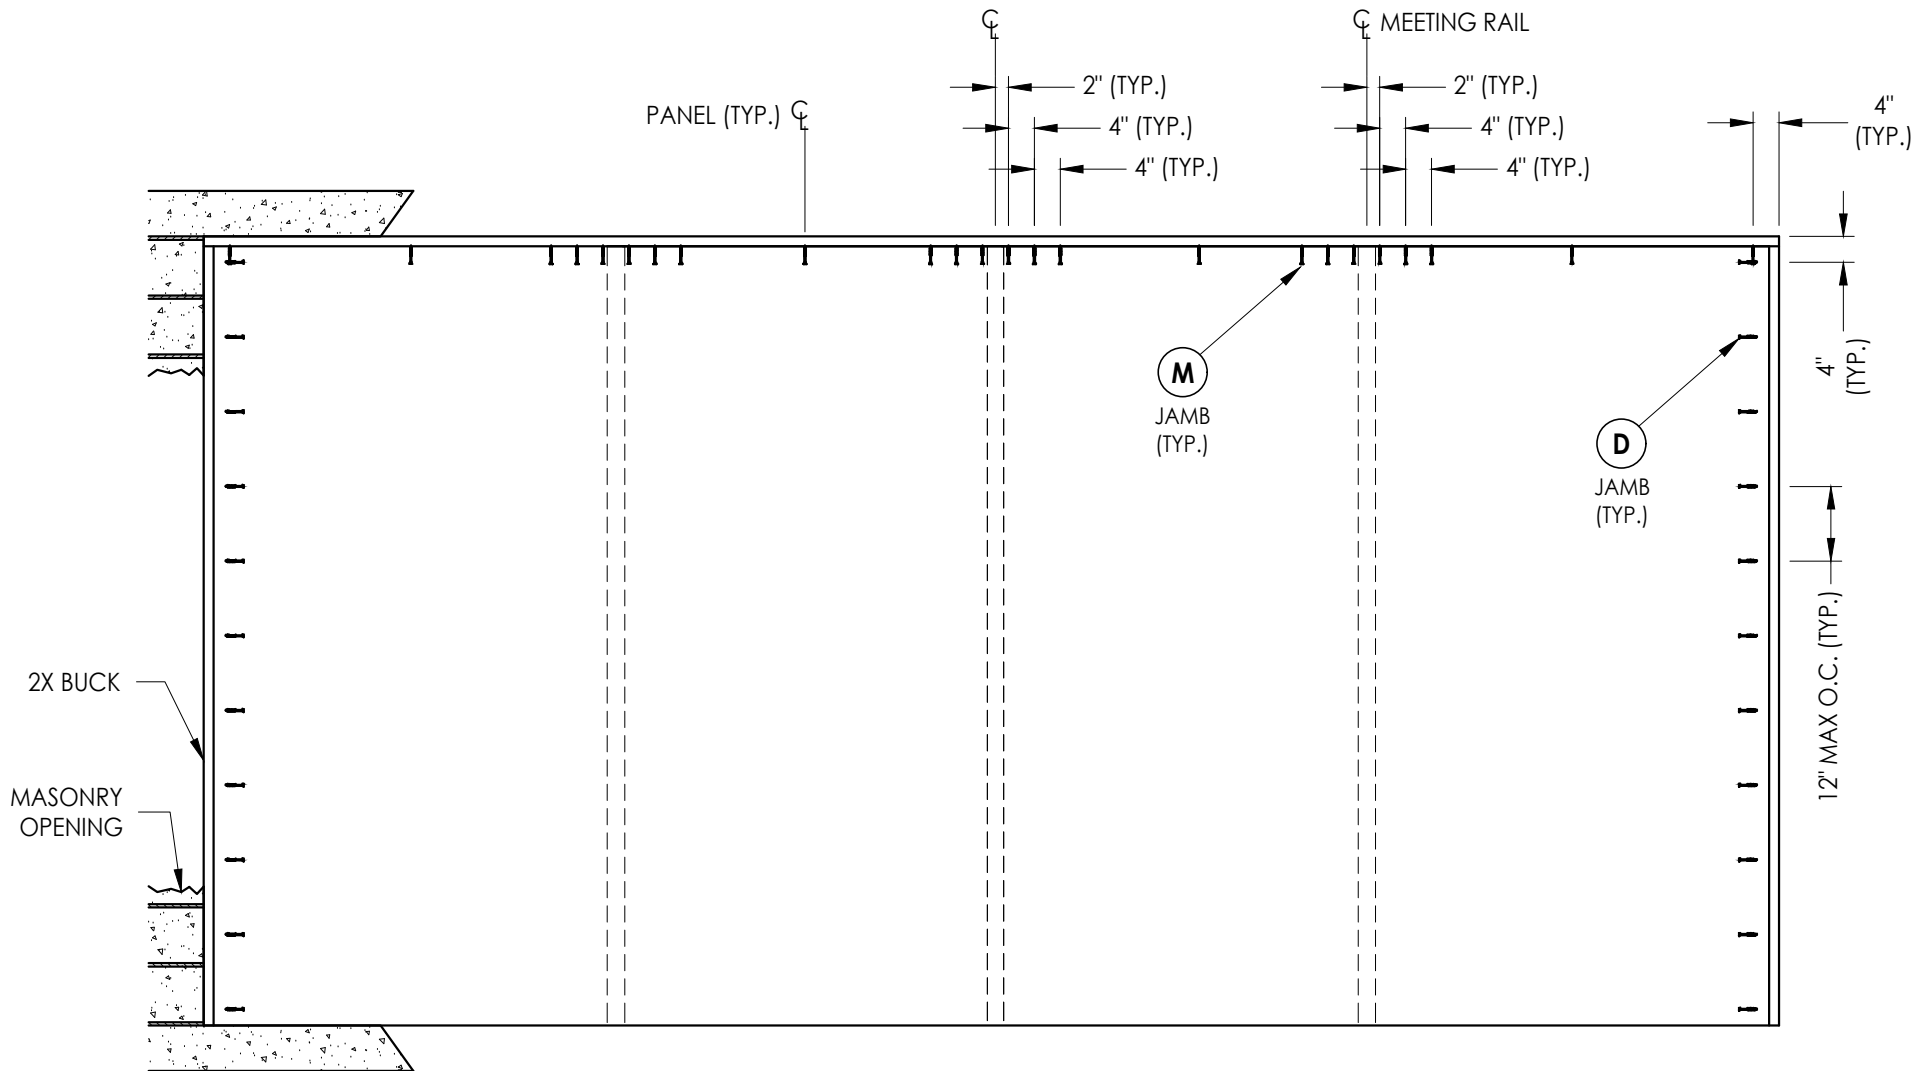

2X BUCK ANCHORING
Sliding Glass Door

CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
DeWALT ULTRACON [®] +	1/4"	1-1/4" (Jambs) 1-3/4" (Head/Sill)	2-1/2"	2-1/2"

		6	7/02/26	UPDATE TO 9TH ED. (2026)	FBC LFS
		5	7/12/23	UPDATE TO 8TH ED. (2023)	FBC LFS
		4	8/10/20	UPDATE TO 7TH ED. (2020)	FBC DAC
		NO	DATE		BY

DATE: 4/4/14

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:
FL-15560.16

SHEET 4 OF 7

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R^W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
FLEETWOOD
Series 3300-T

PART OR ASSEMBLY:
BUCK ANCHORING





CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
DeWALT ULTRACON®	1/4"	1-1/4" (Jambs) 1-3/4" (Head/Sill)	2-1/2"	2-1/2"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

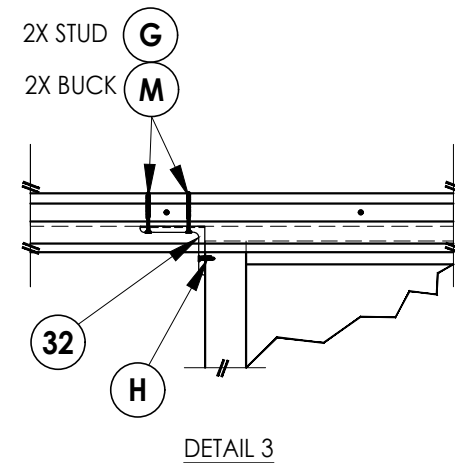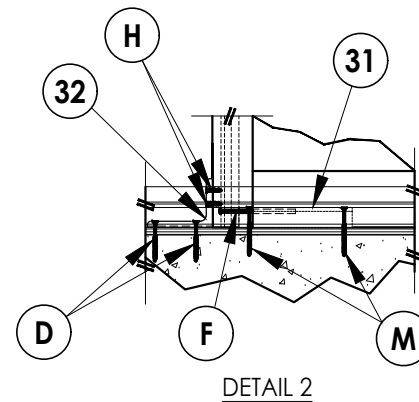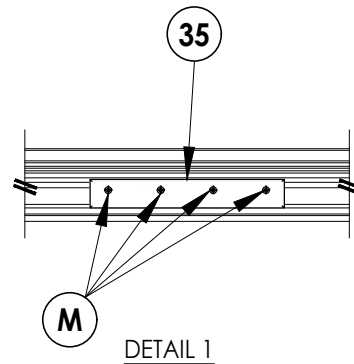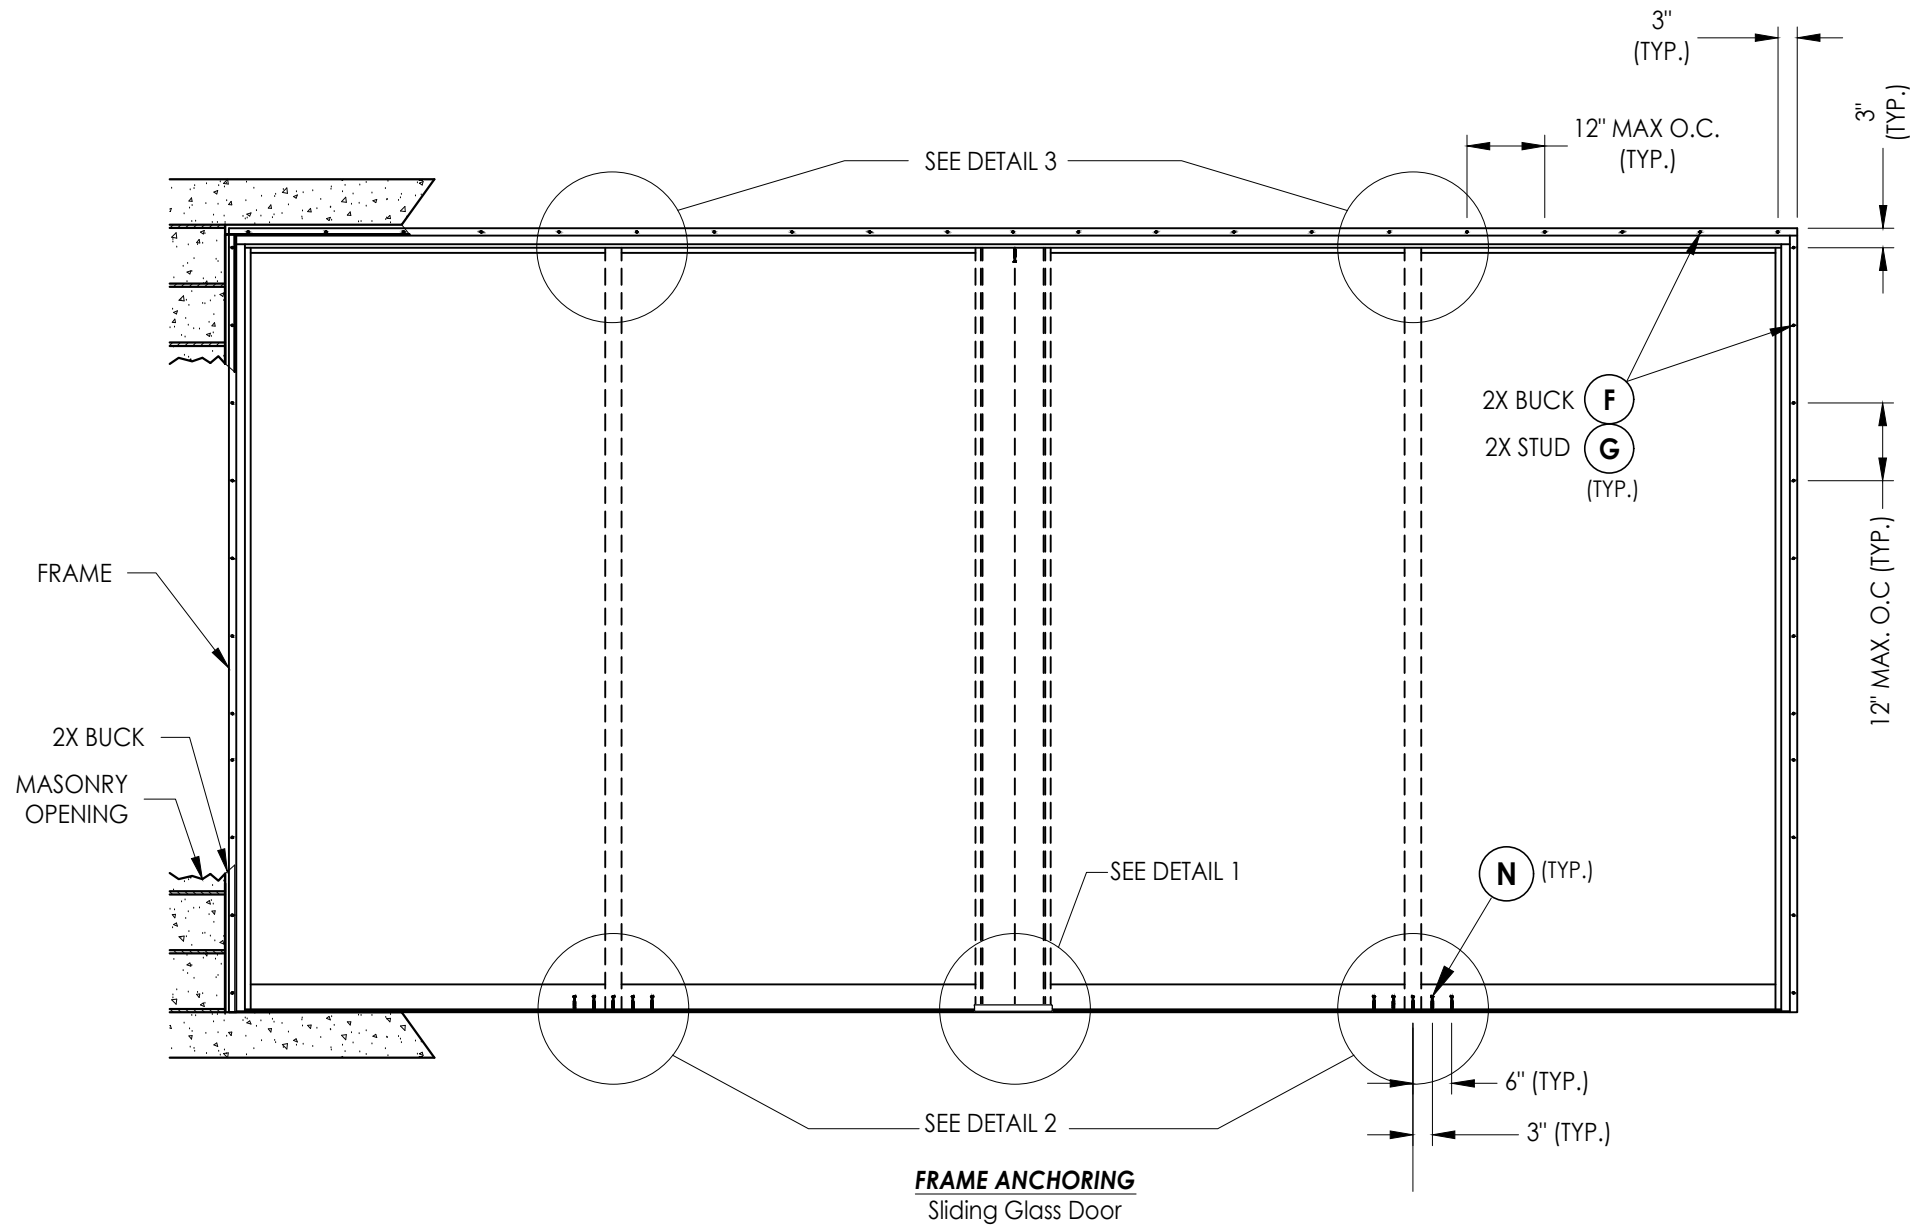[illegible]

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Technical drawing of a mechanical assembly showing a cross-section of a joint. The drawing includes dimensions: a total width of 1.35 inches, a height of 4 inches, and a gap of 0.1 inches. The assembly consists of two vertical plates with a central horizontal component and a shaded rectangular block in the middle.

Technical drawing of a cross-section of a composite material. The drawing shows a profile with a total width of 4.5" and a total height of 2". A specific feature on the right side has a width of 0.09". A hatched area is shown within the profile, indicating a specific material or layer.

Diagram showing the front view of the enclosure with dimensions: 4.38" (width), 1.43" (height), and 0.09" (thickness). A detail callout points to a feature labeled 30 (TYP.).

Technical drawing of a square component with a width of 2.5" and a height of 3.34". The component features a central rectangular opening with rounded corners. The base of the component is wider, measuring 3" in total width. The drawing includes dimension lines and arrows indicating the measurements.

Technical drawing of a rectangular plate with a central slot. The overall width is 9.25 inches. The central slot has a width of 1.13 inches and a depth of 1 inch. The drawing shows the top and side views of the plate.

Technical drawing of a metal bracket. The main view shows a side profile of a bracket with a total length of 12". The bracket has a base with a width of 1.13" and a mounting flange with a width of 3.25". The cross-section view on the right shows a U-shaped profile with a width of 1.76".

Technical drawing of a fixed interlock block. The top view shows a rectangular block with a width of 1.25" and a length of 2.2". A circular feature is located on the top surface. The side view shows a block with a height of 0.5" and a length of 7".

Technical drawing of a rectangular plate with the following dimensions and features:

- Overall width: 1.38"
- Overall height: 3"
- Top edge offset: 1" from the top edge to the center of the top row of holes.
- Left edge offset: 0.83" from the left edge to the center of the left column of holes.
- Bottom edge offset: 1" from the bottom edge to the center of the bottom row of holes.
- Right edge offset: 0.69" from the right edge to the center of the right column of holes.
- Four circular holes arranged in a 2x2 grid.
- A central rectangular feature at the bottom edge, likely a mounting point or connector.

DATE:	4/4/14
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-15560.16
SHEET	<u>6</u> OF <u>7</u>


Series 3300-T

PART OR ASSEMBLY:


COMPONENTS

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

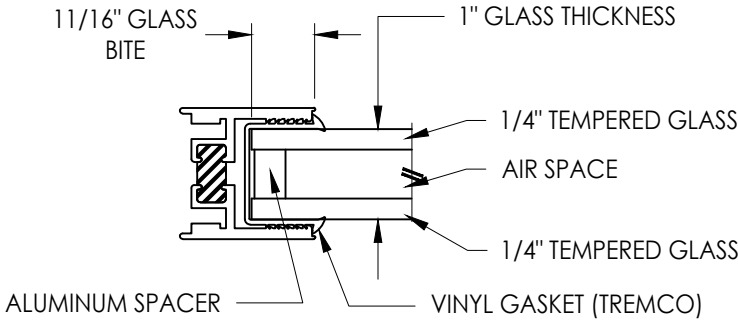

G1 GLAZING DETAIL

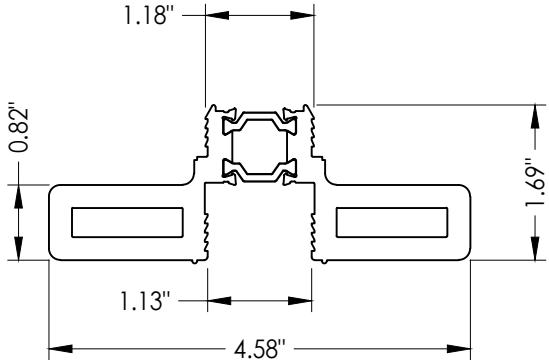

12 HP THERMAL ADAPTOR - DOUBLE WING

[illegible]