

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED INSTALLATION DETAILS	07/10/17	R.L.

NOTES:


1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
4. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" WINDOW UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
5. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. WINDOW UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
6. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
7. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
8. FOR FIN INSTALLATION SHIM AS NEEDED. FOR FRAME INSTALLATION SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
9. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
10. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
11. FRAME MATERIAL: EXTRUDED RIGID PVC.
12. UNITS MUST BE GLAZED PER ASTM E1300-04/09, SEE SHEET 2 FOR GLASS DETAILS.
13. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
14. FOR ANCHORING THROUGH FIN INTO WOOD FRAMING OR 2X BUCK USE #6 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

15. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 3/16" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
17. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
18. ALL FASTENERS TO BE CORROSION RESISTANT.
19. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - A. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42
 - B. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.
 - C. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH Fm=2,000PSI MINIMUM.
 - D. METAL STRUCTURE: STEEL 18GA (.048") FY=33KSI/FU=52KSI OR ALUMINUM 6063-T5 FU=30KSI .048" THICK MINIMUM

SIGNED: 07/10/2017


TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATIONS
3 - 6	INSTALLATION DETAILS

VIWINCO INC. P.O. BOX 499 MORGANTOWN, PA 19543		
OCEANVIEW IMPACT HORIZONTAL SLIDER 72" X 60" NOTES		
DRAWN: N.G.	DWG NO. 08-02939	REV A
SCALE NTS	DATE 08/08/16	SHEET 1 OF 6
L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@rlomaspe.com		

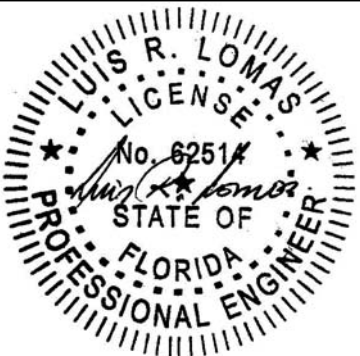


Luis R. Lomas P.E.
FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED INSTALLATION DETAILS	07/10/17	R.L.

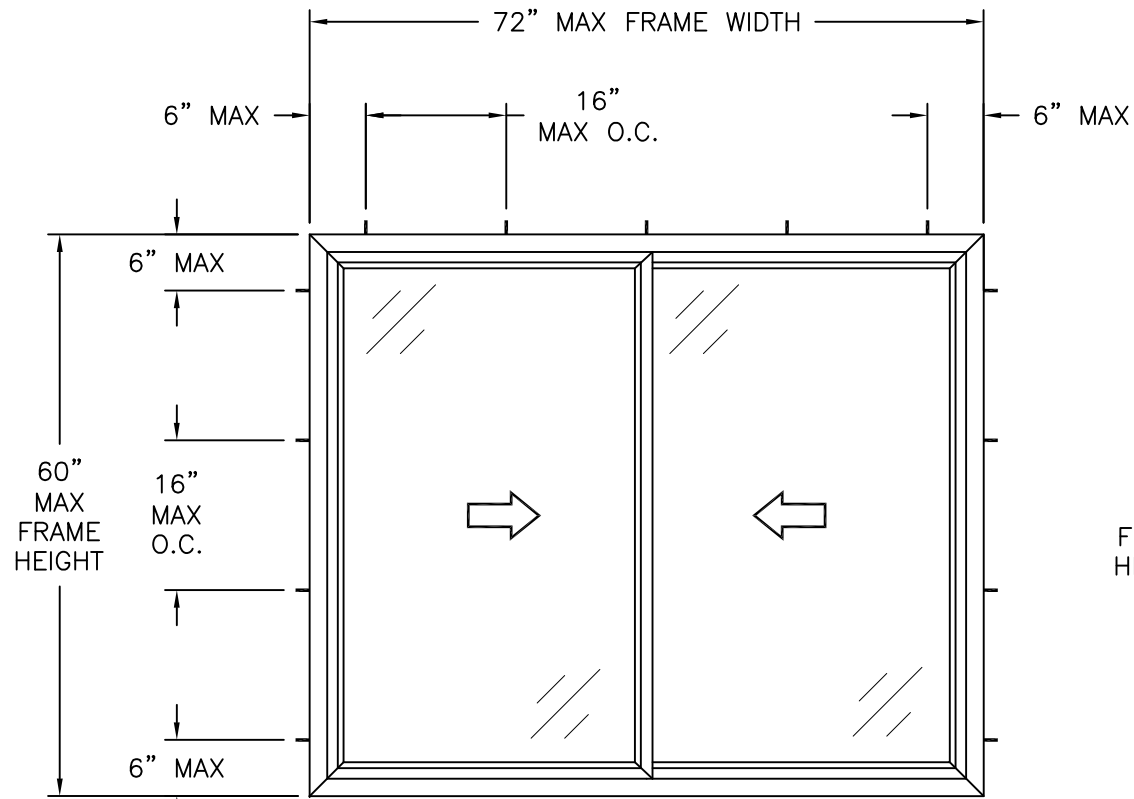

OCEANVIEW IMPACT HORIZONTAL SLIDER
EXTERIOR VIEW
FRAME INSTALLATION

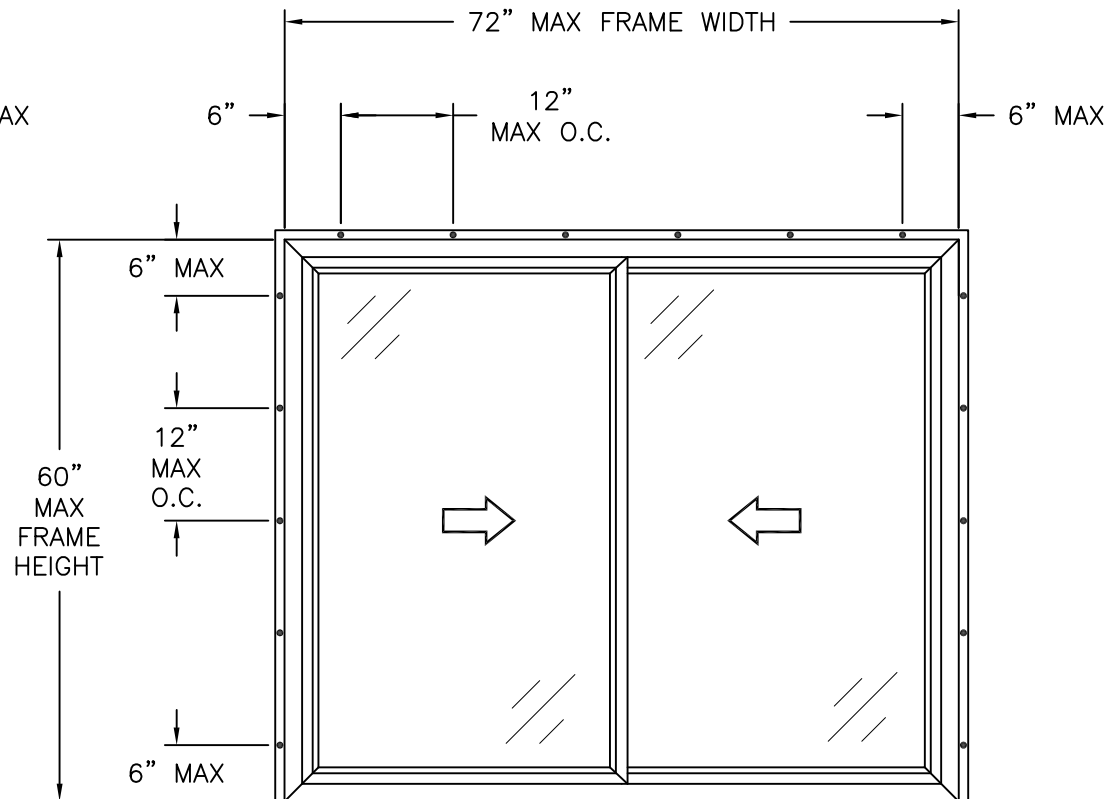

OCEANVIEW IMPACT HORIZONTAL SLIDER
EXTERIOR VIEW
FIN INSTALLATION

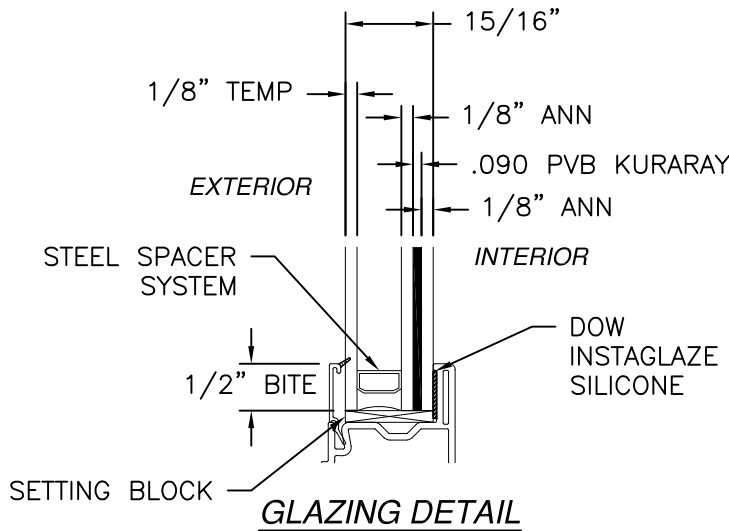

DESIGN PRESSURE RATING	IMPACT RATING
± 50.0 PSF	LARGE AND SMALL MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 3

NOTES:

1. MAXIMUM SASH SIZE: 35" X 54 1/2"
2. MAXIMUM D.L.O.: 31 1/2" X 50 3/4"
3. (2) 3/8" X 3/16" WEEPSLOT AT 4 3/8" FROM OUTSIDE CORNER OF BOTTOM RAIL, GLAZING TRACK AND INTERIOR WEB AND 3 3/8" FROM OUTSIDE CORNER OF BOTTOM RAIL BOTTOM SURFACE.
4. (2) 1/2" X 1/8" WEEPSLOT AT 5" FROM OUTSIDE SILL EXTERIOR SCREEN LEG.
5. (4) 1" X 1/8" WEEPSLOT AT 5" FROM OUTSIDE CORNER SILL EXTERIOR SASH TRACK.
6. (2) 1" X 1/8" WEEPSLOT AT 1 3/8" FROM INSIDE CORNER OF SILL EXTERIOR SIDE OF INTERIOR PANEL TRACK.
7. (2) 1" X 1/8" WEEPSLOT AT EACH END OF SILL INTERMEDIATE WALL.
8. (2) 1" X 1/8" WEEPSLOT AT 3 5/8" FROM OUTSIDE CORNER OF SILL EXTERIOR FACE.


HARDWARE SCHEDULE	
A.	(2) METAL CAM LOCK WITH KEEPER AT 12" FROM EACH END OF INTERIOR SASH MEETING STILE
B.	SLIDER SASH T-BOLT AT TOP OF INTERIOR AND EXTERIOR MEETING STILES
C.	ALUMINUM REINFORCEMENT (10006608) AT INTERIOR AND EXTERIOR SASH MEETING STILES
D.	ALUMINUM REINFORCEMENT (5516-1) AT INTERIOR AND EXTERIOR SASH MEETING STILES

VIWINCO INC. P.O. BOX 499 MORGANTOWN, PA 19543		
OCEANVIEW IMPACT HORIZONTAL SLIDER 72" X 60" ELEVATION		
DRAWN: N.G.	DWG NO. 08-02939	REV A
SCALE NTS	DATE 08/08/16	SHEET 2 OF 6
L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@rlomaspe.com		

SIGNED: 07/10/2017




Luis R. Lomas P.E.
FL No.: 62514

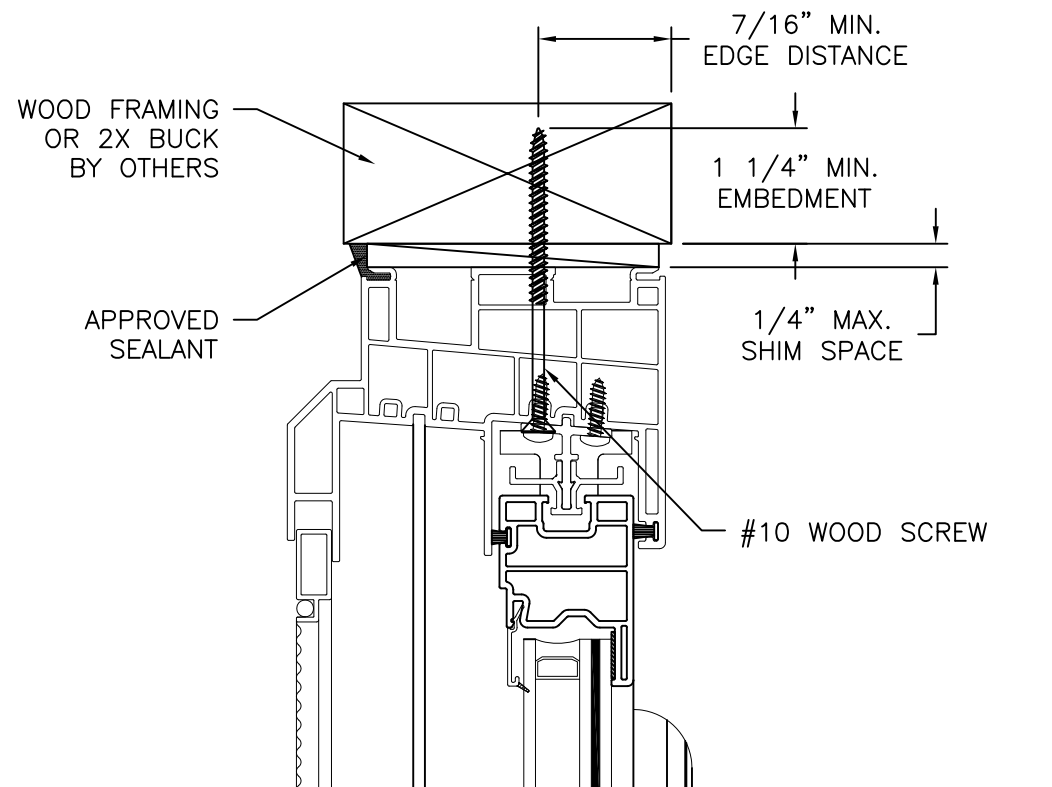


EXTERIOR

INTERIOR

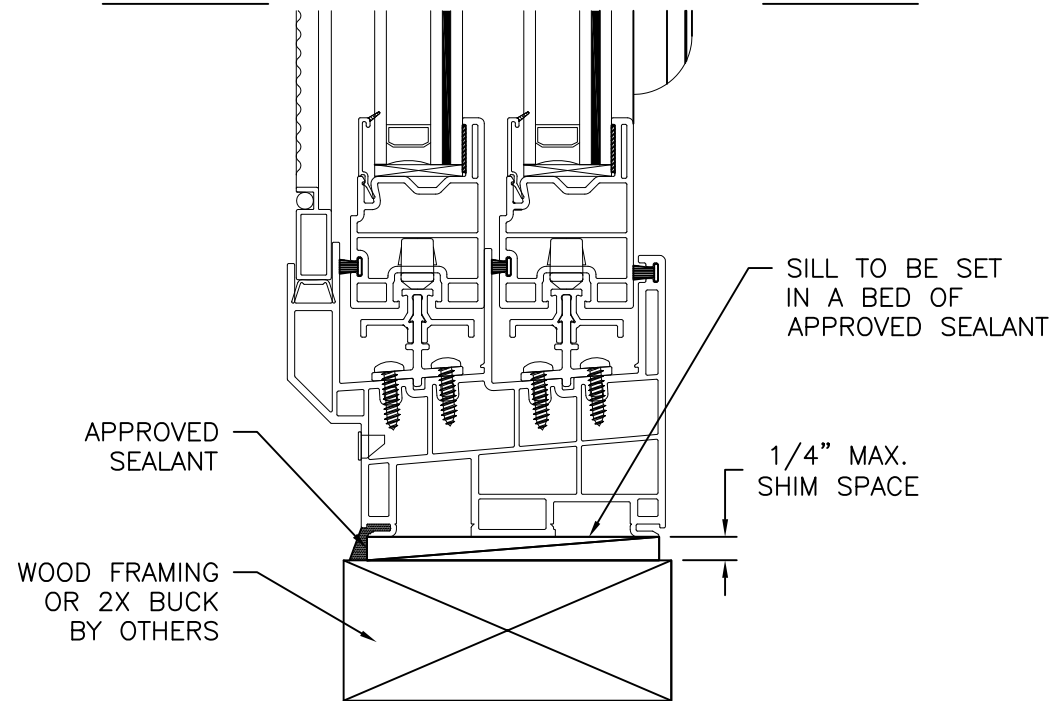

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

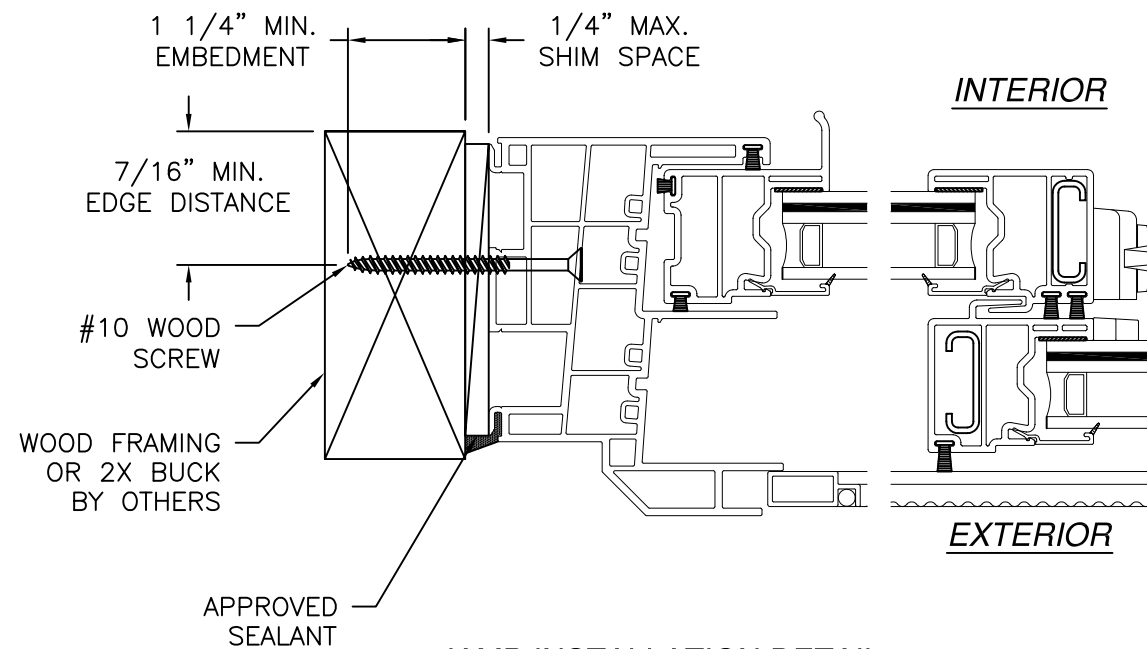

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION


NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED INSTALLATION DETAILS	07/10/17	R.L.

SIGNED: 07/10/2017


VIWINCO INC. P.O. BOX 499 MORGANTOWN, PA 19543		
OCEANVIEW IMPACT HORIZONTAL SLIDER 72" X 60" INSTALLATION DETAILS		
DRAWN: N.G.	DWG NO. 08-02939	REV A
SCALE NTS	DATE 08/08/16	SHEET 3 OF 6
L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@rlomaspe.com		

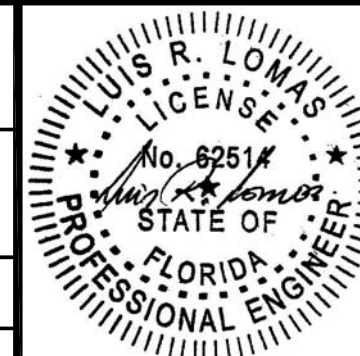

Luis R. Lomas P.E.
FL No.: 62514

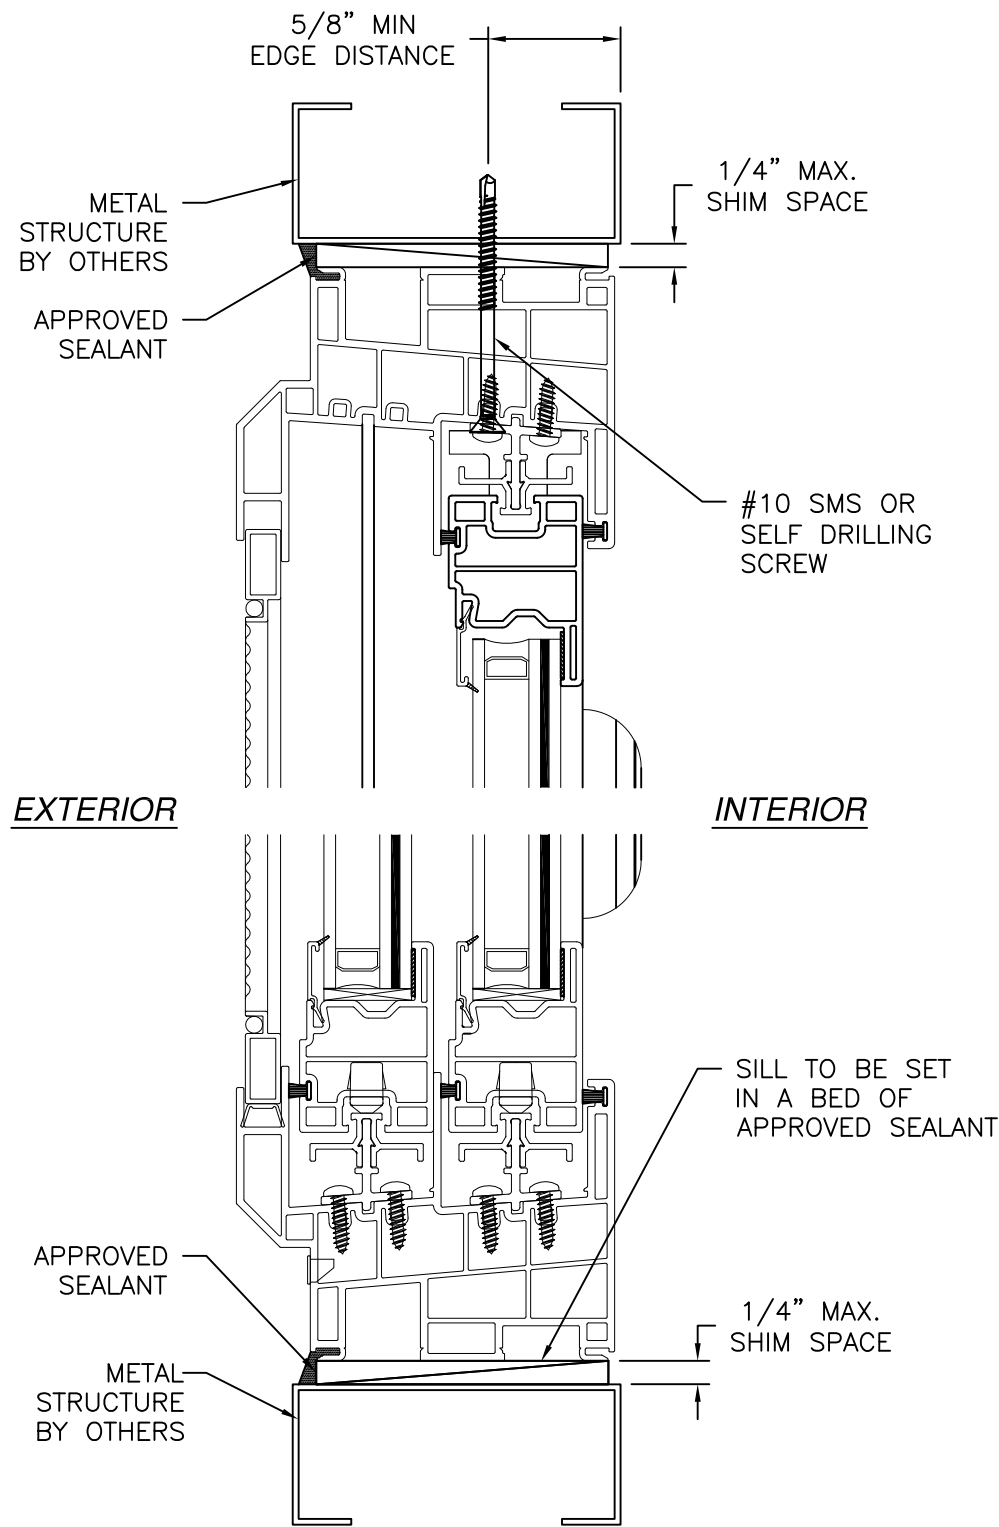

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

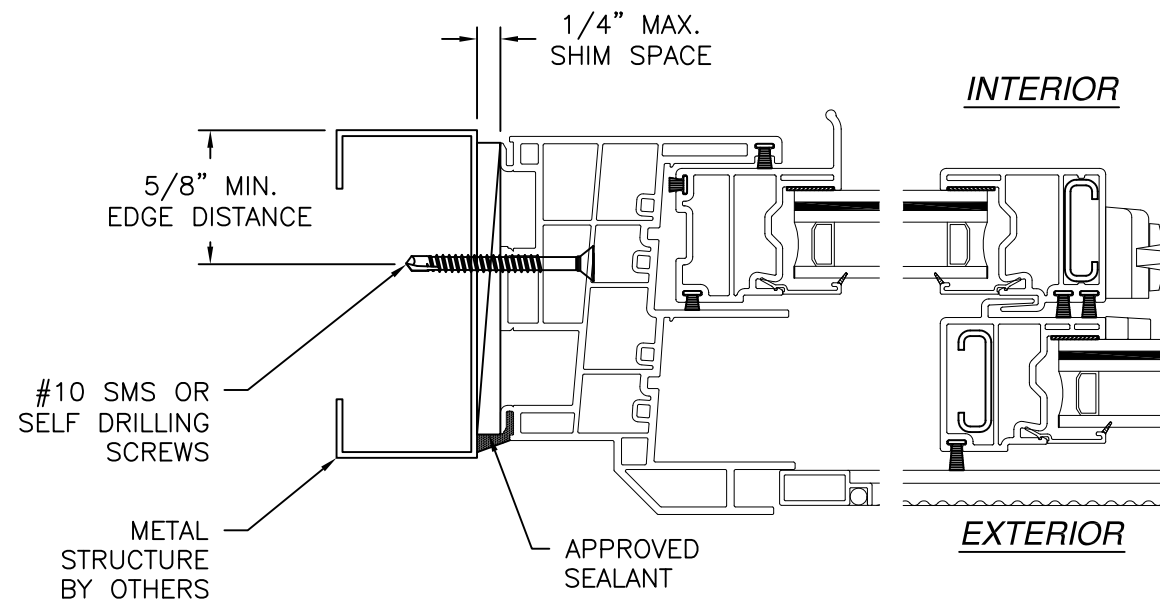

JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION


NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112



REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED INSTALLATION DETAILS	07/10/17	R.L.

SIGNED: 07/10/2017


VIWINCO INC. P.O. BOX 499 MORGANTOWN, PA 19543		
OCEANVIEW IMPACT HORIZONTAL SLIDER 72" X 60" INSTALLATION DETAILS		
DRAWN: N.G.	DWG NO. 08-02939	REV A
SCALE NTS	DATE 08/08/16	SHEET 4 OF 6
L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@rlomaspe.com		

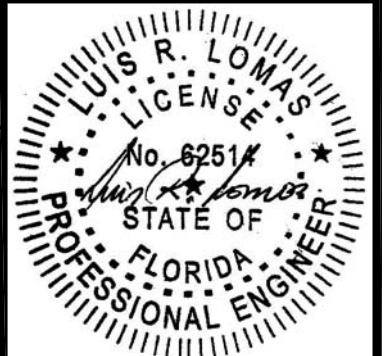

Luis R. Lomas P.E.
FL No.: 62514

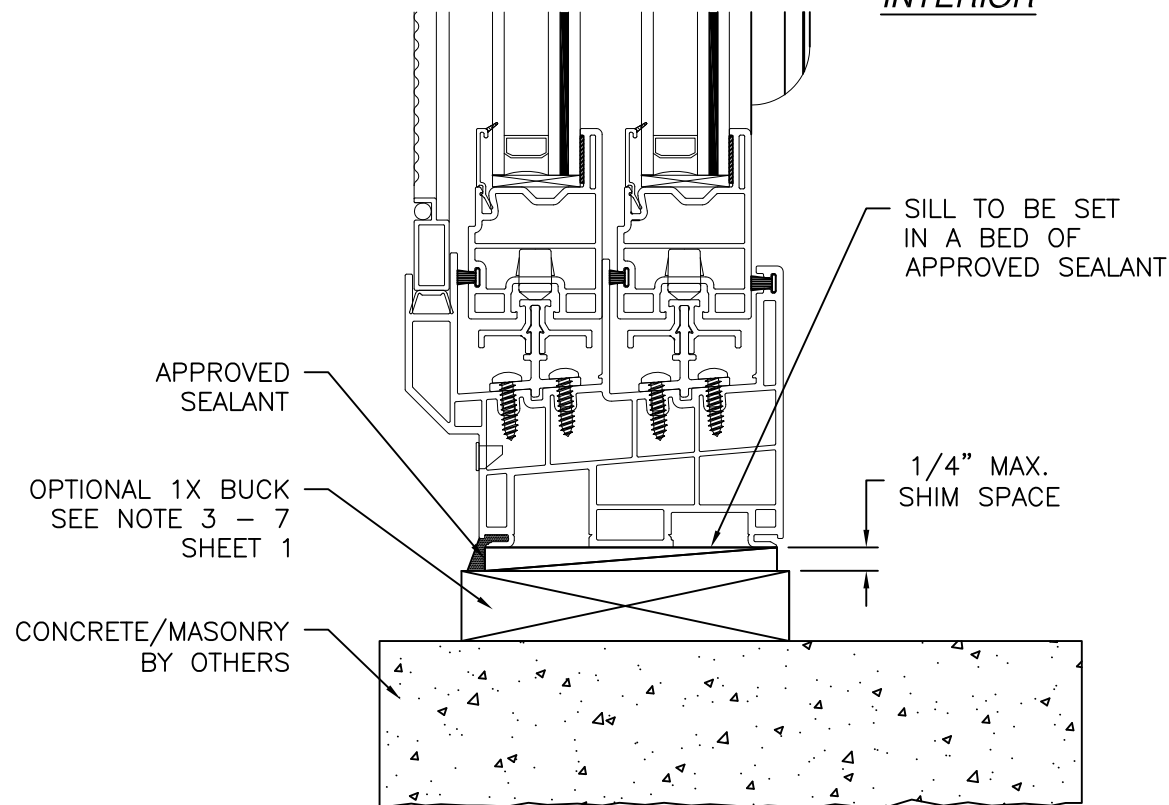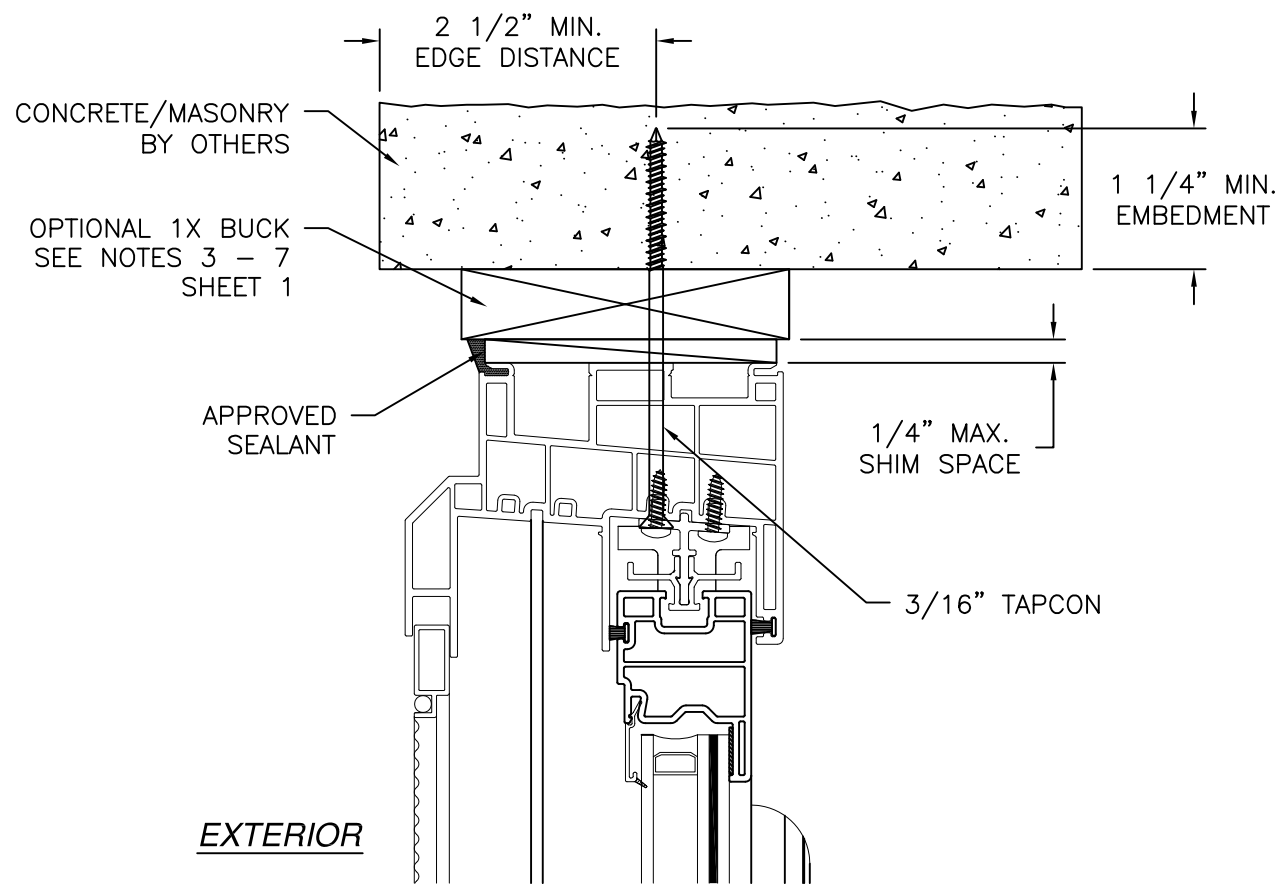

VERTICAL CROSS SECTION
CONCRETE/MASONRY INSTALLATION

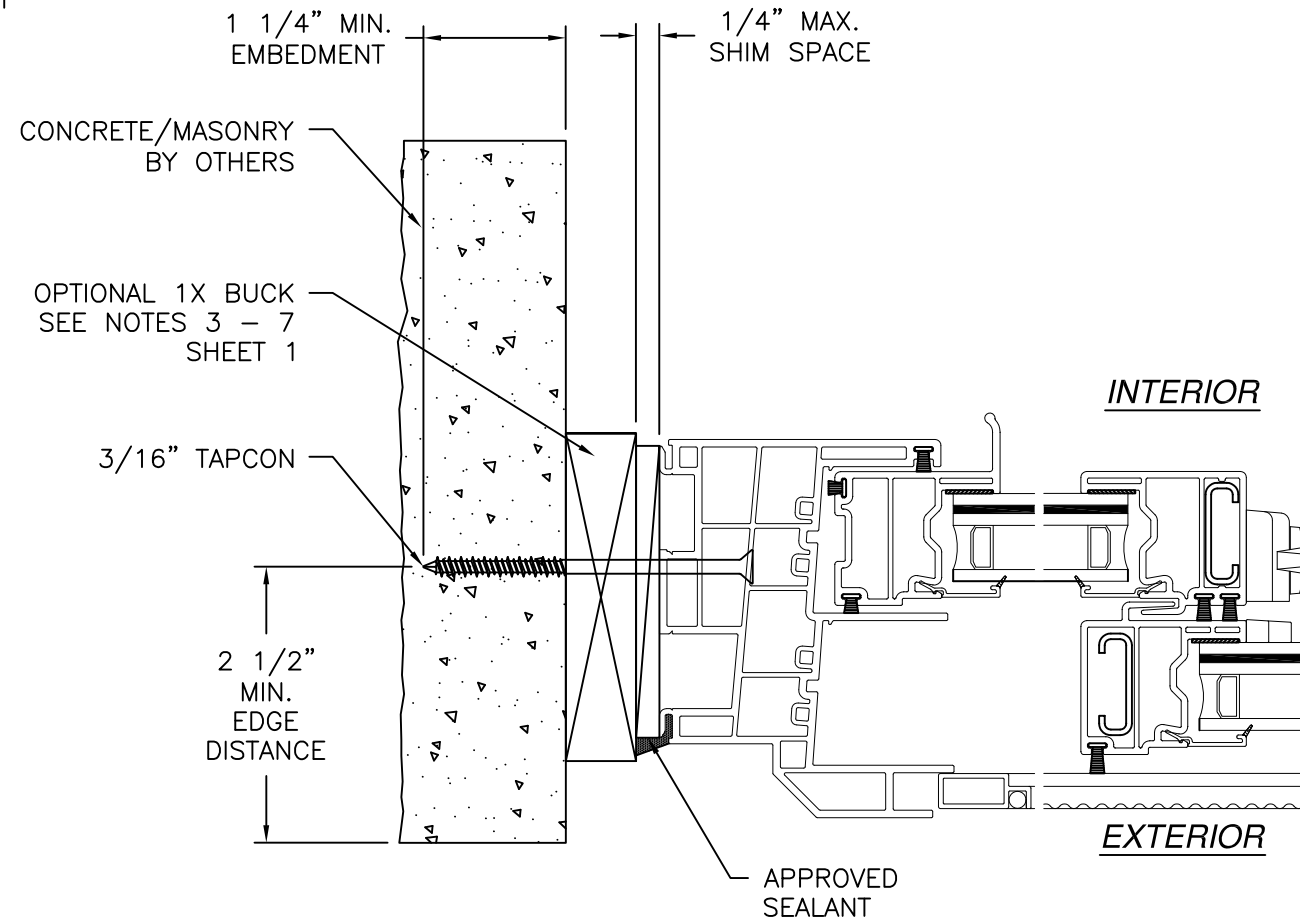

JAMB INSTALLATION DETAIL
CONCRETE/MASONRY INSTALLATION

NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED INSTALLATION DETAILS	07/10/17	R.L.

VIWINCO INC.


P.O. BOX 499
MORGANTOWN, PA 19543

OCEANVIEW IMPACT HORIZONTAL SLIDER
72" X 60"
INSTALLATION DETAILS




DRAWN: N.G.	DWG NO. 08-02939	REV A
SCALE NTS	DATE 08/08/16	SHEET 5 OF 6

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@rlomaspe.com

SIGNED: 07/10/2017

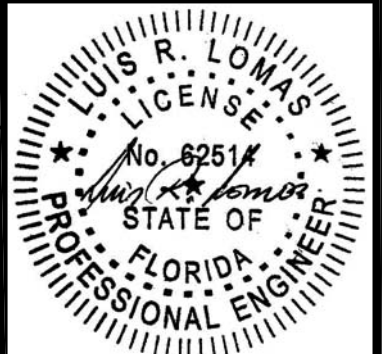

Luis R. Lomas P.E.
FL No.: 62514

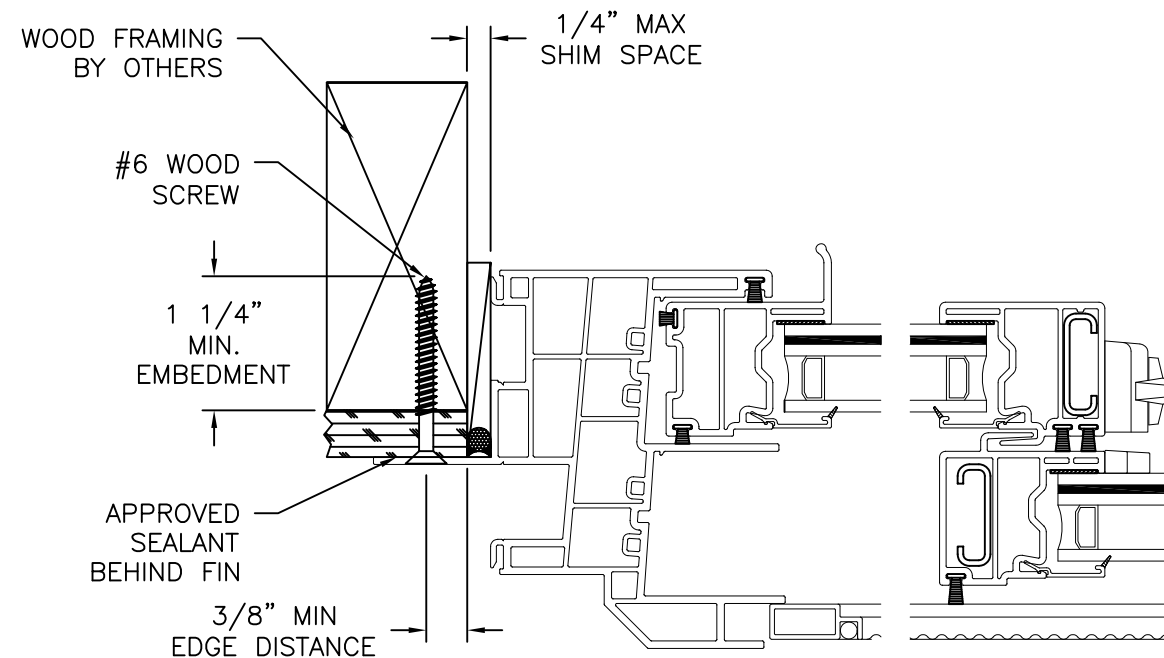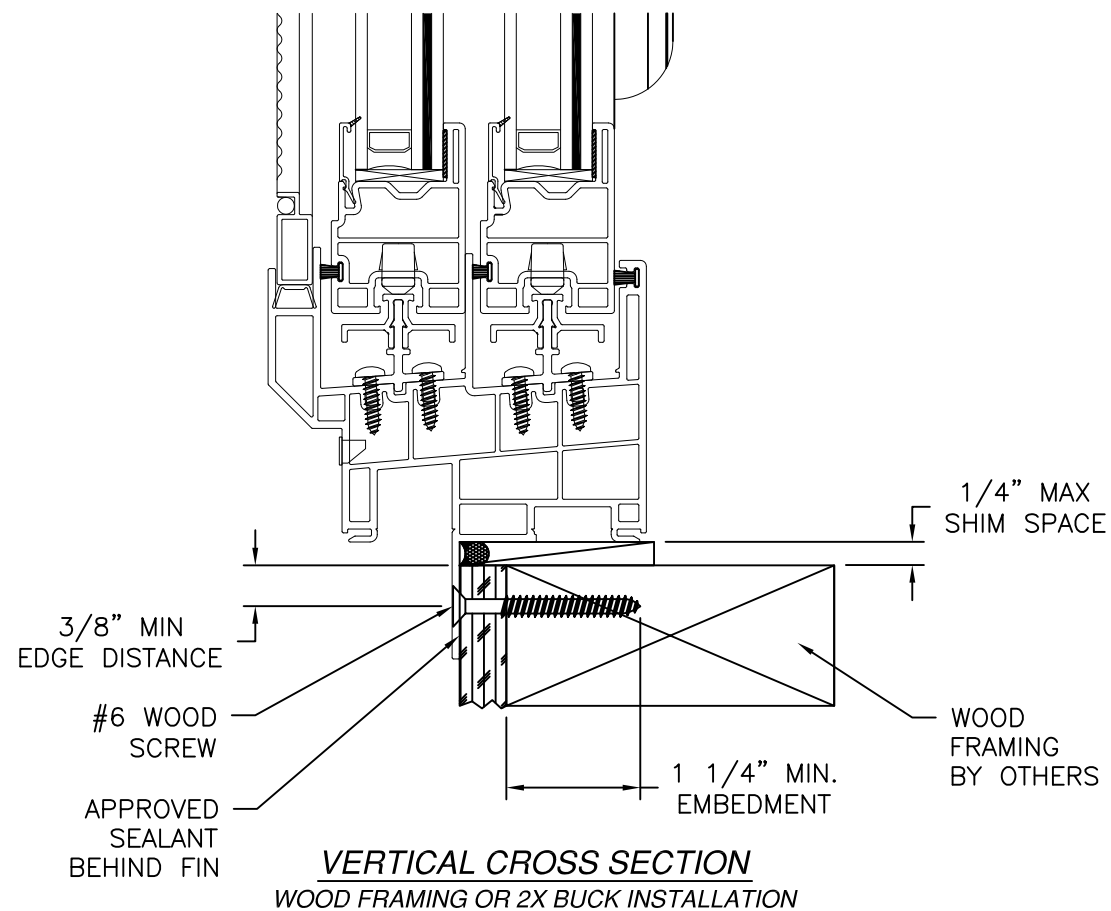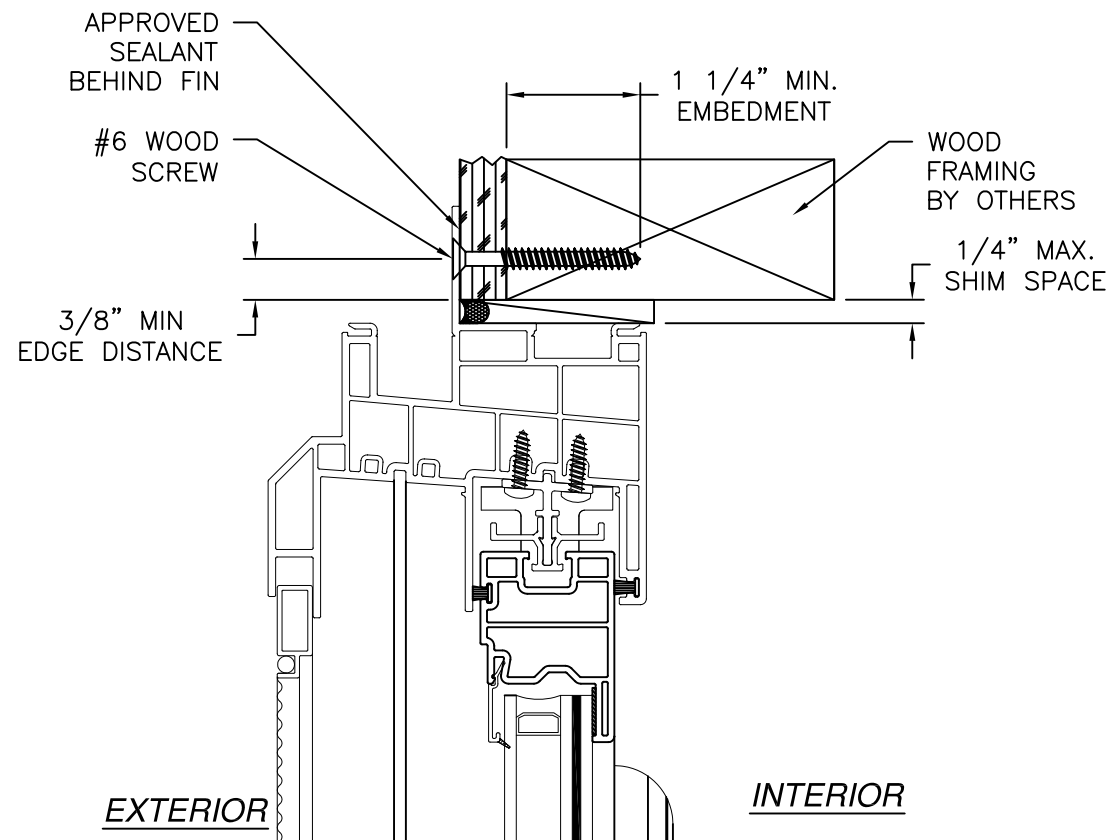

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION


NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED INSTALLATION DETAILS	07/10/17	R.L.

SIGNED: 07/10/2017

VIWINCO INC. P.O. BOX 499 MORGANTOWN, PA 19543		
OCEANVIEW IMPACT HORIZONTAL SLIDER 72" X 60" FIN INSTALLATION DETAILS		
DRAWN: N.G.	DWG NO. 08-02939	REV A
SCALE NTS	DATE 08/08/16	SHEET 6 OF 6
L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@lrlomaspe.com		

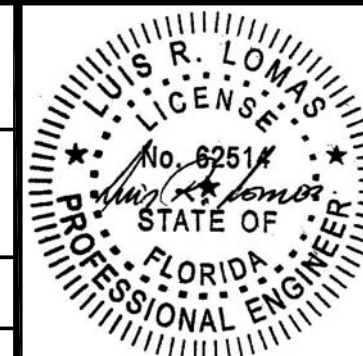

Luis R. Lomas P.E.
FL No.: 62514