


BRANNEN MILLWORK

3379 EAST HWY. 46
REGISTER, GEORGIA 30452

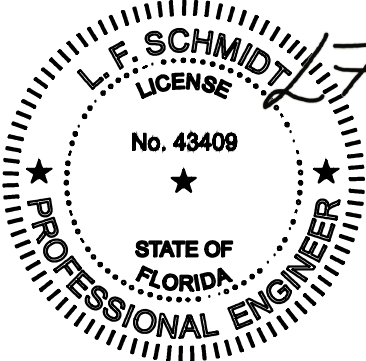

Digitally signed by Lyndon F Schmidt
Date: 2026.10.07 09:48:43 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.


THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

GLAZED & OPAQUE WOOD DOORS
INSWING/OUTSWING
"IMPACT"

GENERAL NOTES

- 1. This product has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone".
- 2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
- 3. When used in areas requiring wind borne debris protection this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E 1996.
- 4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
- 5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	TYPICAL ELEVATIONS, DESIGN PRESSURES & GENERAL NOTES
2	GLAZED DOOR PANEL SECTIONS AND GLAZING DETAIL
3	OPAQUE DOOR PANEL SECTIONS
4	HORIZONTAL CROSS SECTIONS
5	VERTICAL CROSS SECTIONS
6	BUCK AND FRAME ANCHORING RECTANGULAR DOOR
7	BUCK ANCHORING RADIUS TOP DOOR
8	FRAME ANCHORING RADIUS TOP DOOR
9	MULTI-POINT LOCK HARDWARE DETAILS
10	SURFACE BOLT HARDWARE DETAILS
11	HINGE & STRIKE HARDWARD DETAILS
12	COMPONENTS
13	BILL OF MATERIALS & COMPONENTS

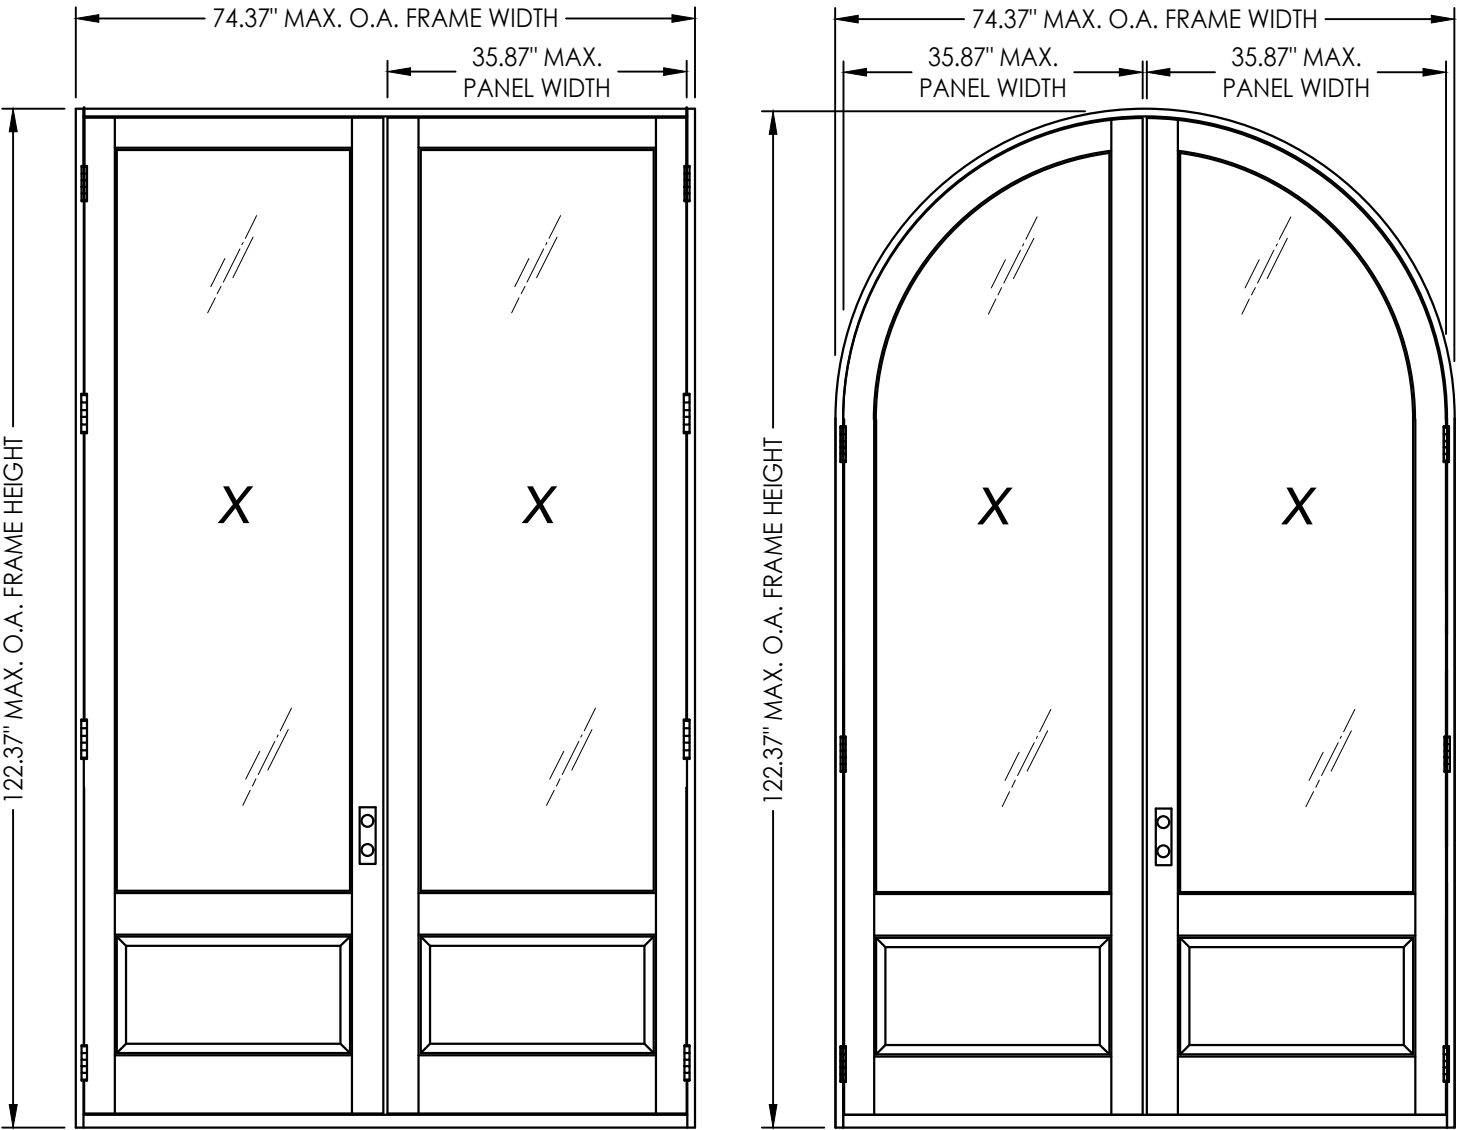

LOCK TYPE	OVERALL FRAME DIMENSION	SWING	DESIGN PRESSURE (PSF)	
			POSITIVE	NEGATIVE
HOPPE HLS9000 SERIES MULTI-POINT LOCK	74.37" x 122.37"	INSWING	+55.0	-60.0
		OUTSWING	+55.0	-55.0
SURFACE BOLTS EUREKO-DECO (France or Louis V)	74.37" x 122.37"	INSWING	+55.0	-60.0

SEE SHEET 2 FOR GLAZING DETAIL DESIGN PRESSURE LIMITATIONS

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
GLAZED & OPAQUE
WOOD DOOR

DATE: 6/25/12

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-15737.13

SHEET 1 OF 13

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

REVISIONS

The image contains two technical drawings of horizontal cross sections for door hardware, labeled 3 and 4.

Drawing 3: Standard Handle
 This drawing shows a horizontal cross section of a door with a standard handle. The handle is labeled 3. The door is labeled 1. The handle is mounted on the door with screws labeled 10 and 12. The handle has a cylindrical shape with a grip area labeled G1 and G2. The drawing is labeled **3** **HORIZONTAL CROSS SECTION** with a **2** in a circle below the title.

Drawing 4: Lever Handle
 This drawing shows a horizontal cross section of a door with a lever handle. The lever handle is labeled 4. The door is labeled 1. The lever handle is mounted on the door with screws labeled 10 and 12. The lever handle has a rectangular shape with a grip area labeled G1 and G2. The drawing is labeled **4** **HORIZONTAL CROSS SECTION** with a **2** in a circle below the title.

1. Glass infill stop anchorage: item #12 located typ. 2" from each corner and 7.78" max. o.c. at the stiles & 6.125" max. o.c. at the rails.
2. Panel infill stop anchorage: item #12 located typ. 2" from each corner and at the panel infill centerline at the stiles & 6.125" max. o.c. at the rails.

5/8" GLASS BITE

15/16" THK. GLASS

5/32" TEMP.

AIR SPACE

3/16" ANN.

0.090" SAFLEX PVB INTERLAYER

3/16" ANN.

SEE NOTE 1

G2

GLAZING DETAIL

MAXIMUM DESIGN PRESSURE
INSWING +50/-60 PSF, OUTSWING +50/-50 PSF

VERTICAL CROSS SECTION


Technical drawing of a mechanical assembly in cross-section. The assembly consists of a shaft (14) passing through a housing (8) and a base (9). The shaft is supported by bearings (10, 11) and has a key (12) at the top. The drawing includes a break line (//) and a reference to "SEE NOTE 2".

DATE:	6/25/12
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-15737.13
SHEET	2 OF 13



R^gW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2012 R.W. BUILDING CONSULTANTS INC.

Z:\2023 FBC Drawings\Brannen Millwork\FL-15737 R6 Swing Doors\FL-15737.7-14.dwg

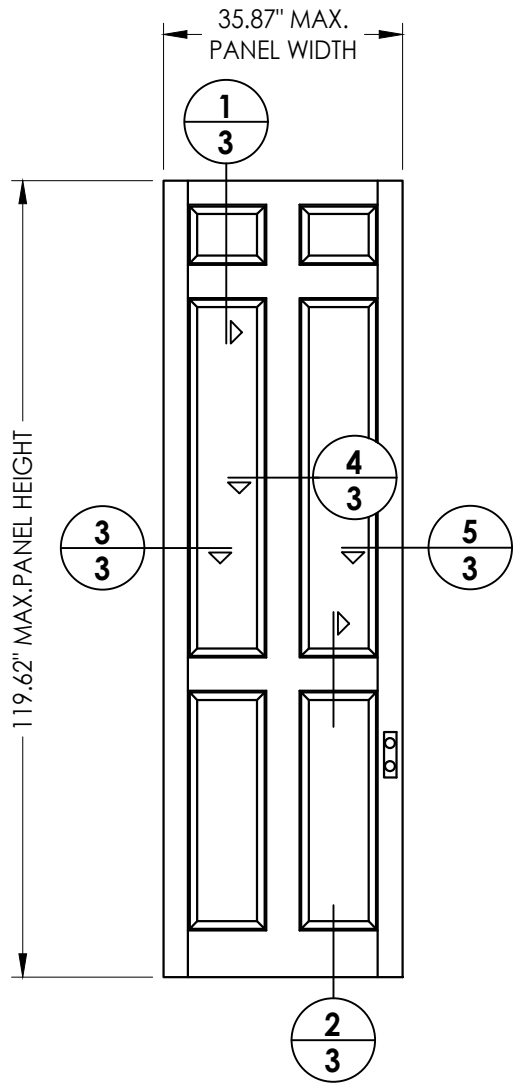

OPAQUE DOOR PANEL
Six panel model shown
Other models are available

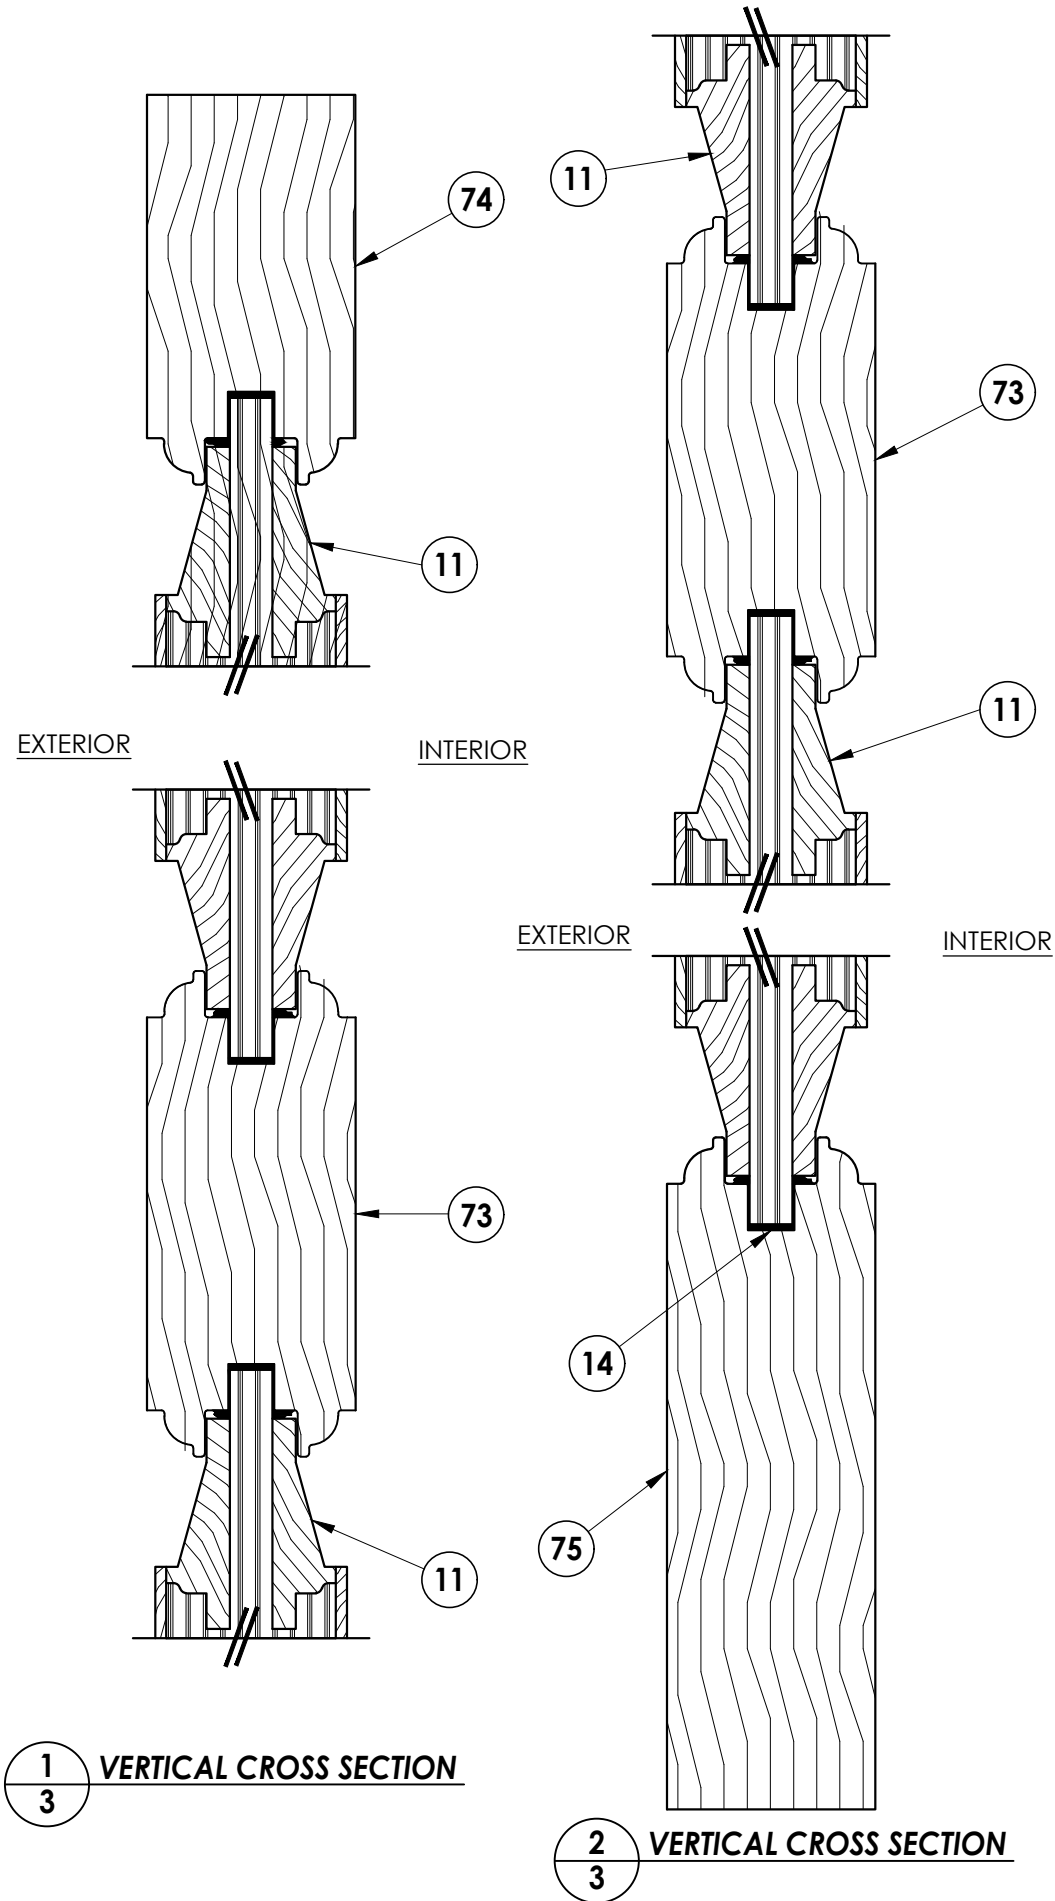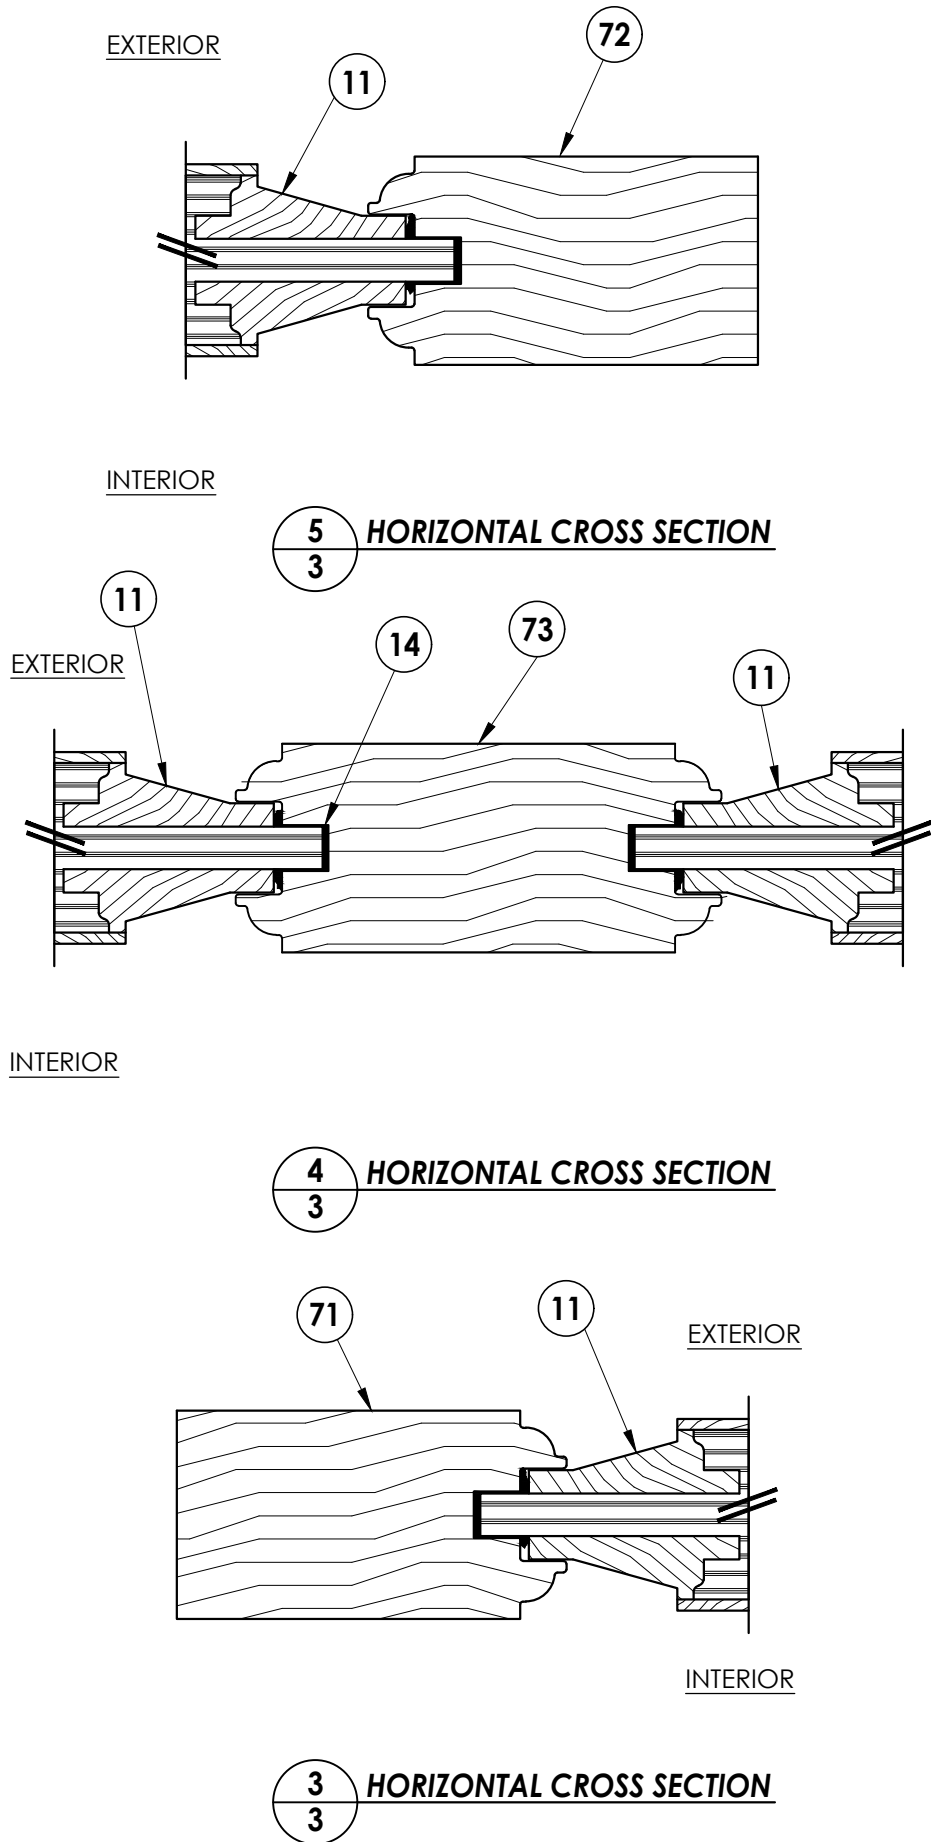

NO.	DATE	REVISIONS				
		DATE	BY	LFS	FBC	BY
5	9/22/26	UPDATE TO 9TH ED.	(2026)	FBC	LFS	
4	10/4/23	UPDATE TO 8TH ED.	(2023)	FBC	LFS	
3	9/16/20	UPDATE TO 7TH ED.	(2020)	FBC	LFS	
2	07/11/17	UPDATE TO 6TH ED.	(2017)	FBC	LFS	
1	08/10/15	UPDATE TO 5TH ED.	(2014)	FBC	LFS	

DATE: 6/25/12

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-15737.13

SHEET 3 OF 13


PRODUCT: OPAQUE & GLAZED WOOD DOOR

PART OR ASSEMBLY: OPAQUE DOOR PANEL SECTIONS




Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Brannen Millwork\FL-15737 R6 Swing Doors\FL-15737.7-14.dwg

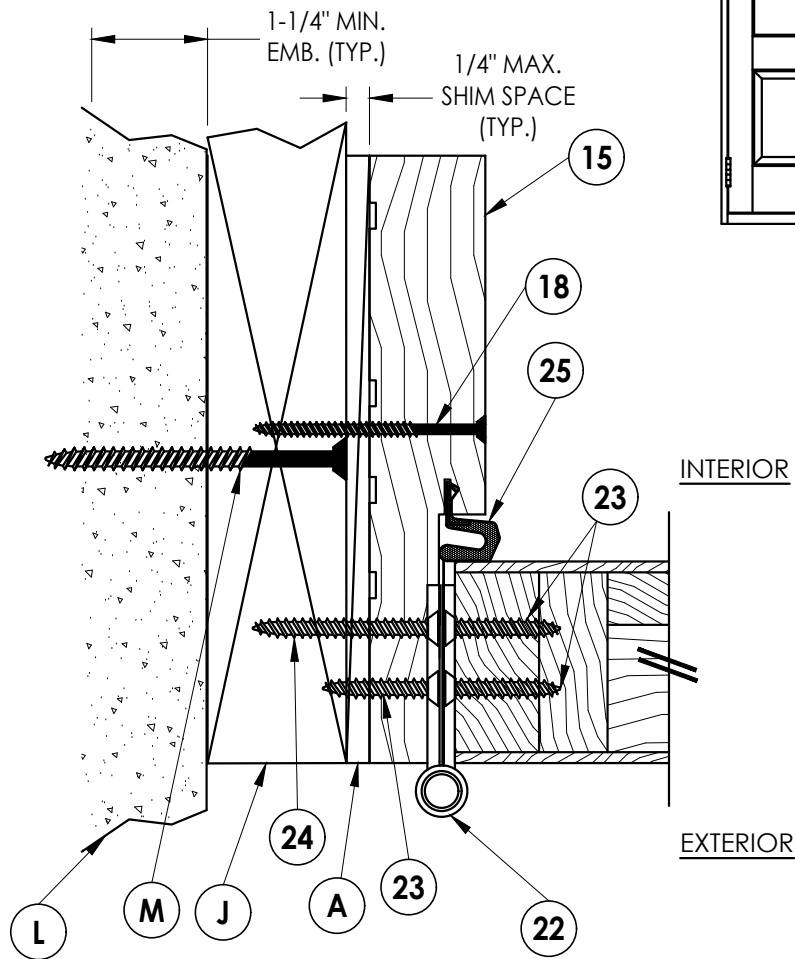

1
4 **HORIZONTAL CROSS SECTION**
Glazed door shown - opaque door also approved
Outswing shown - inswing also approved

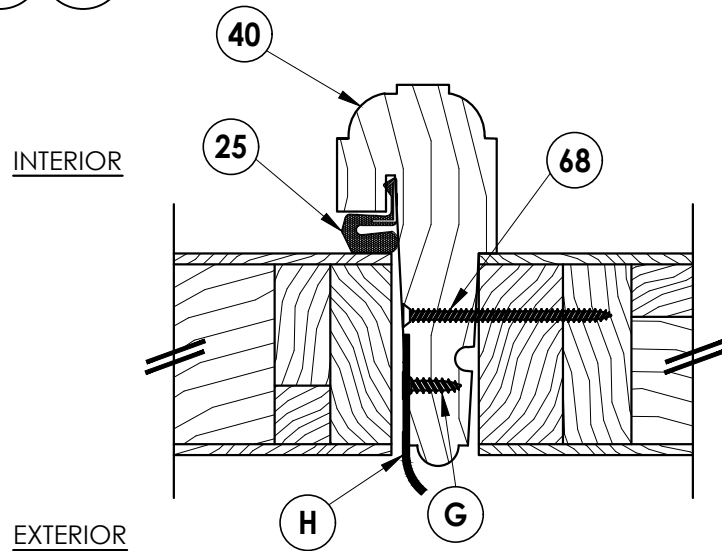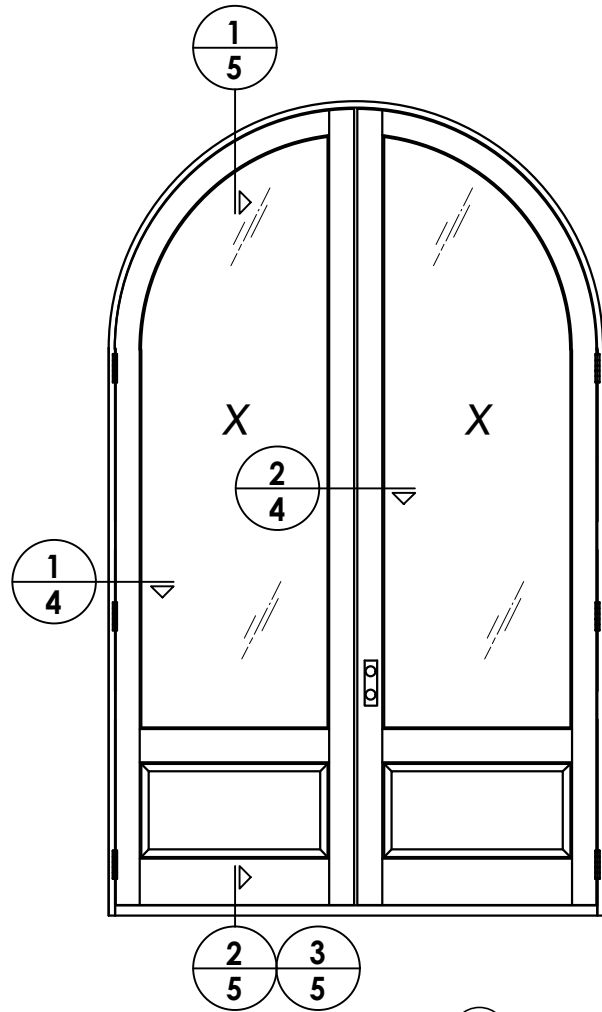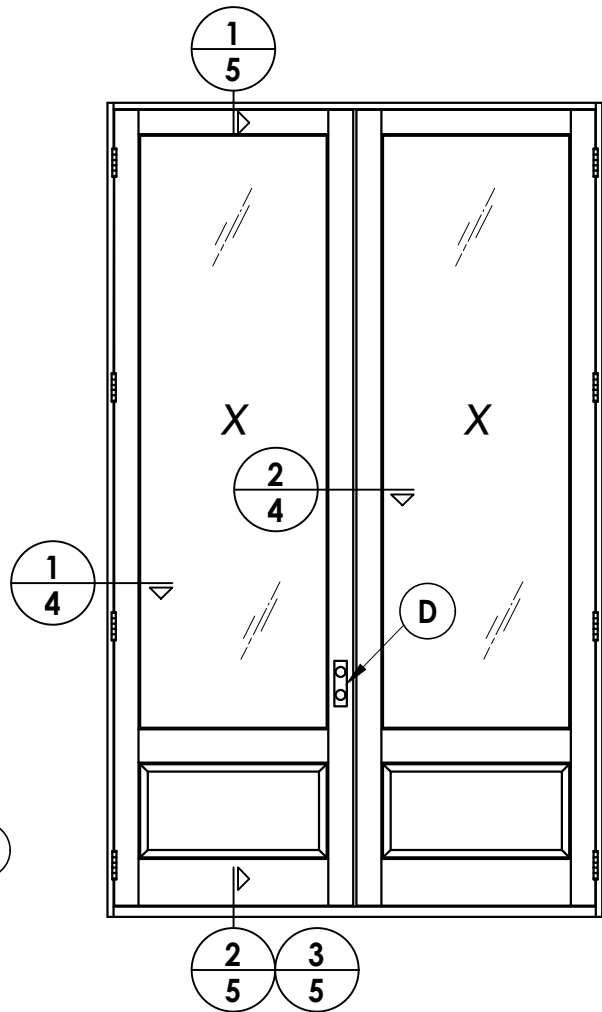

2
4 **HORIZONTAL CROSS SECTION**
Glazed door shown - opaque door also approved
Outswing shown - inswing also approved

NO.	DATE	REVISIONS
5	9/22/26	UPDATE TO 9TH ED. (2026) FBC LFS
4	10/4/23	UPDATE TO 8TH ED. (2023) FBC LFS
3	9/16/20	UPDATE TO 7TH ED. (2020) FBC LFS
2	07/11/17	UPDATE TO 6TH ED. (2017) FBC LFS
1	08/10/15	UPDATE TO 5TH ED. (2014) FBC LFS

DATE: 6/25/12

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-15737.13

SHEET 4 OF 13


PRODUCT: GLAZED & OPAQUE WOOD DOOR

PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Vairico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Brannen Millwork\FL-15737 R6 Swing Doors\FL-15737.7-14.dwg

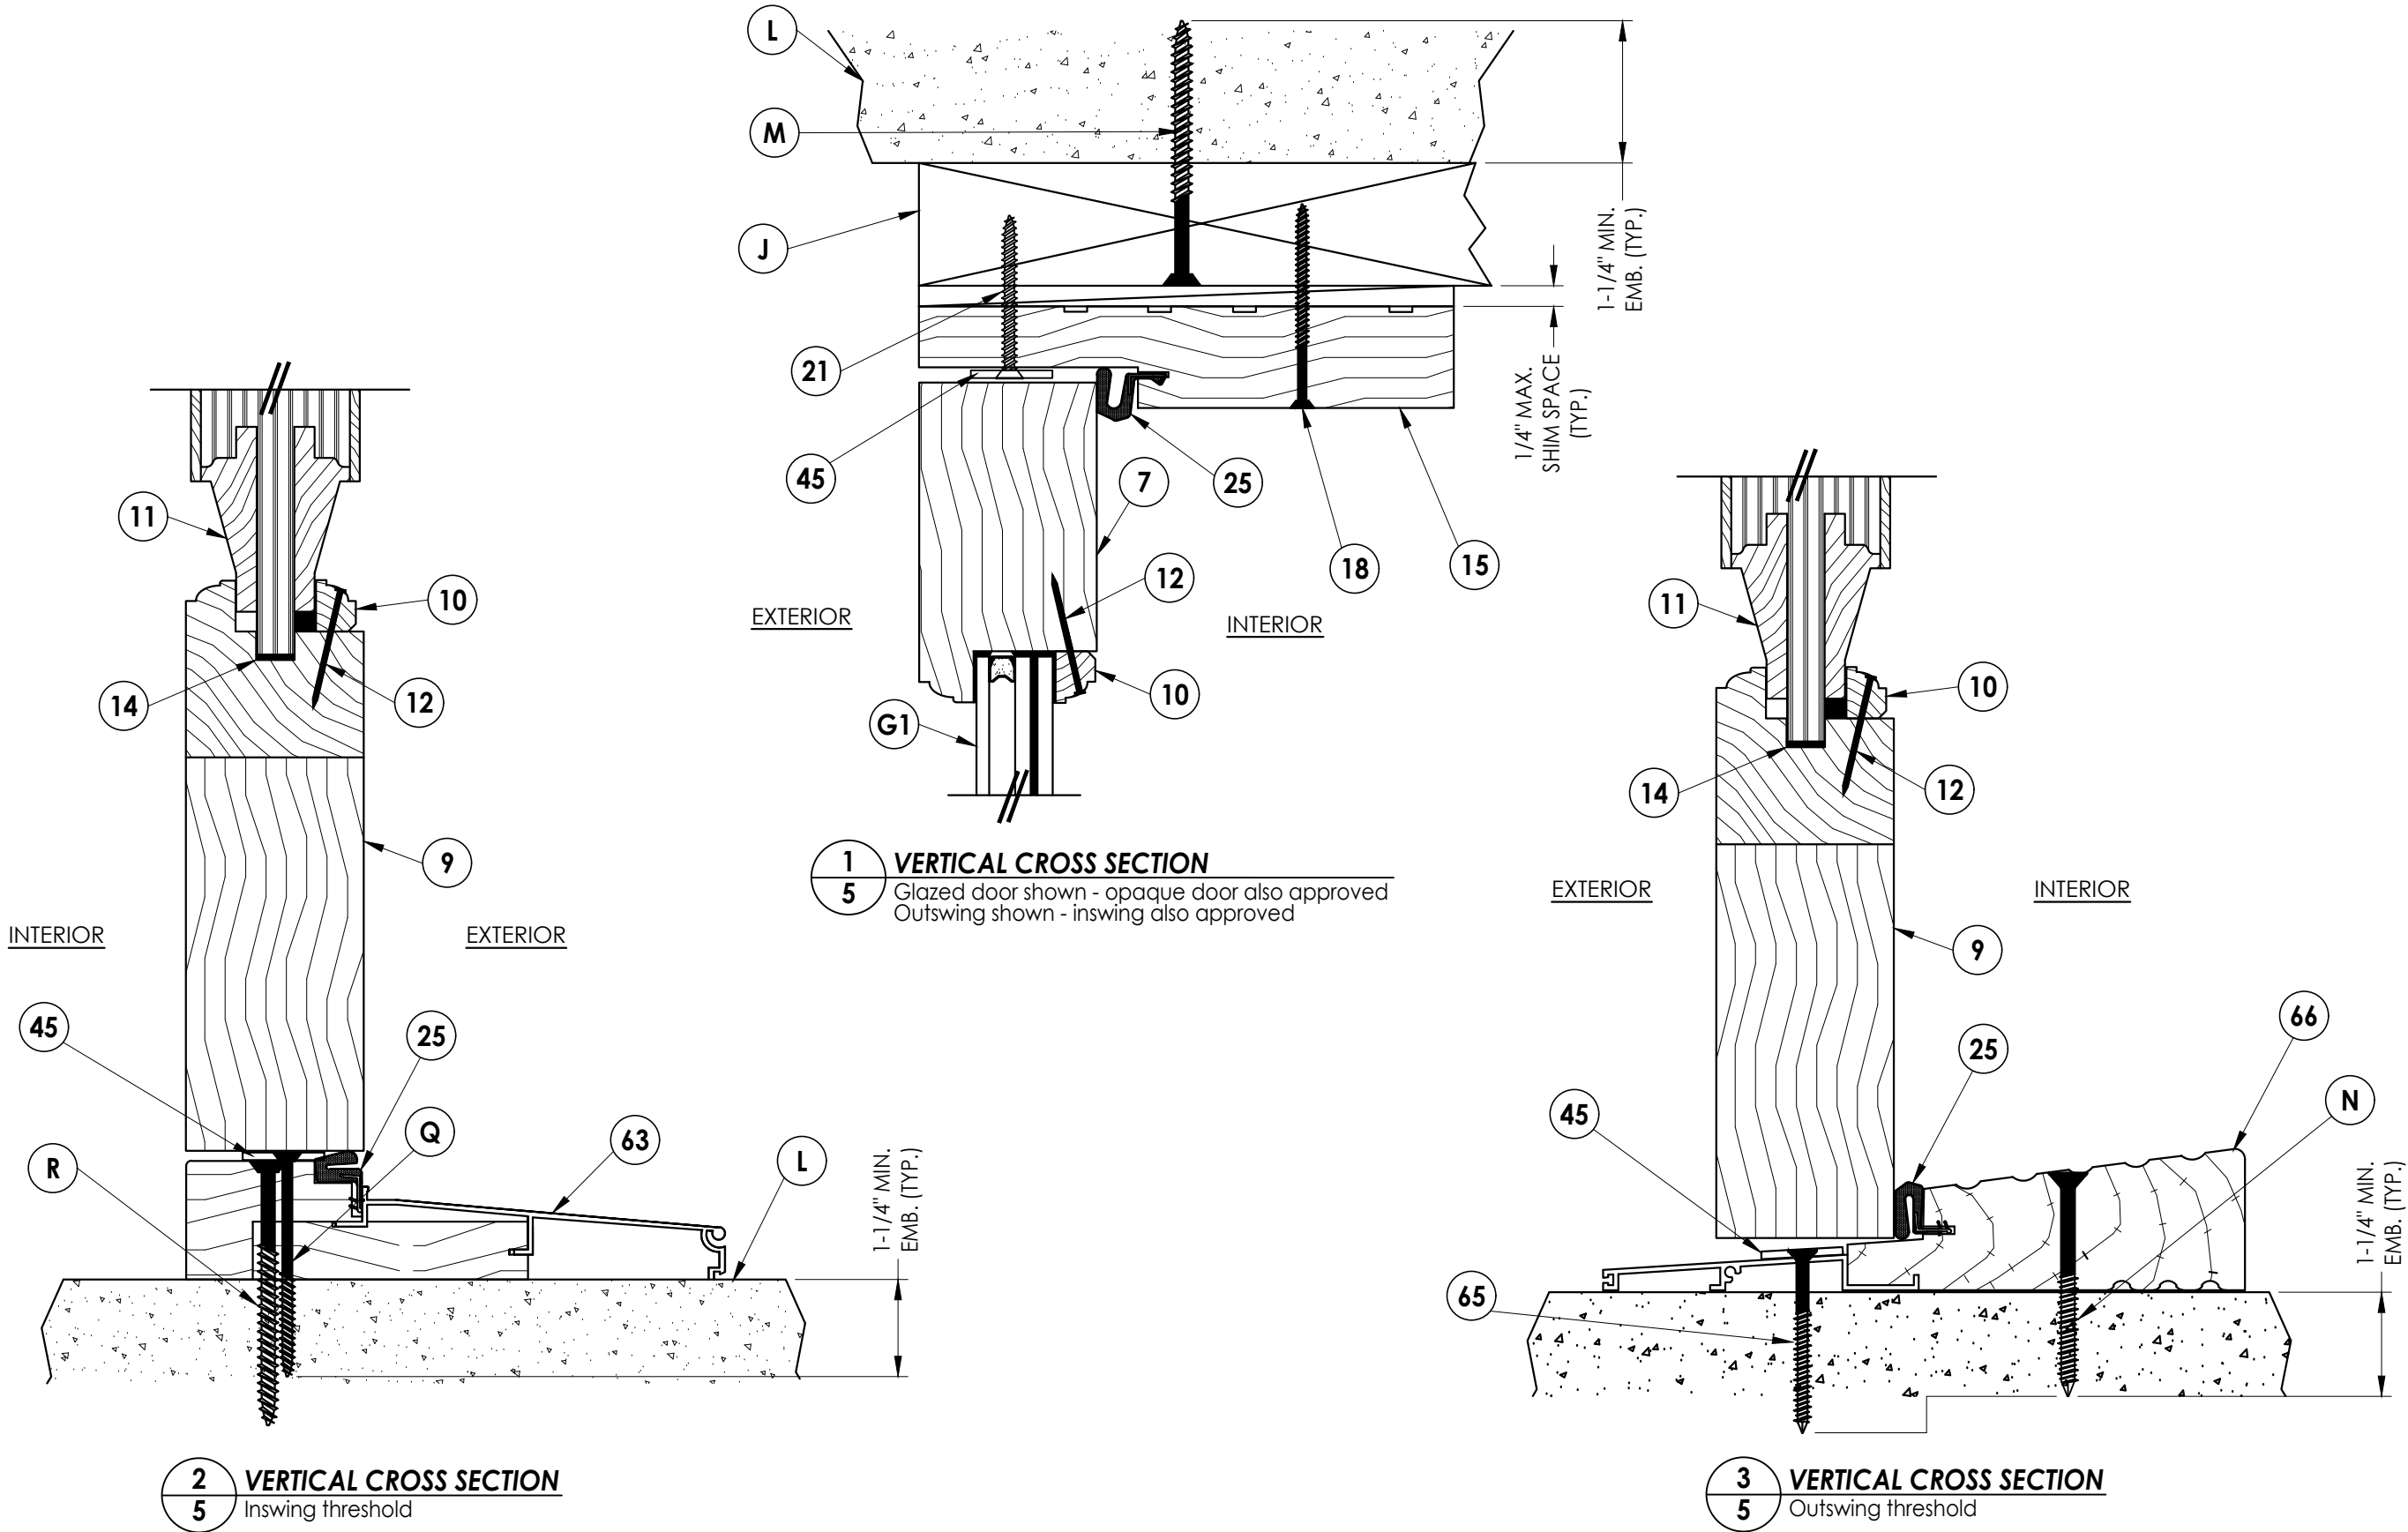

PRODUCT:		GLAZED & OPAQUE WOOD DOOR		PART OR ASSEMBLY:		VERTICAL CROSS SECTIONS	
5	9/22/26	UPDATE TO 9TH ED. (2026)	FBC	LFS			
4	10/4/23	UPDATE TO 8TH ED. (2023)	FBC	LFS			
3	9/16/20	UPDATE TO 7TH ED. (2020)	FBC	LFS			
2	07/11/17	UPDATE TO 6TH ED. (2017)	FBC	LFS			
1	08/10/15	UPDATE TO 5TH ED. (2014)	FBC	LFS			
NO.	DATE			BY			
				REVISIONS			
DATE: 6/25/12							
SCALE: N.T.S.							
DWG. BY: JK							
CHK. BY: LFS							
DRAWING NO.: FL-15737.13							
SHEET 5 OF 13							

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

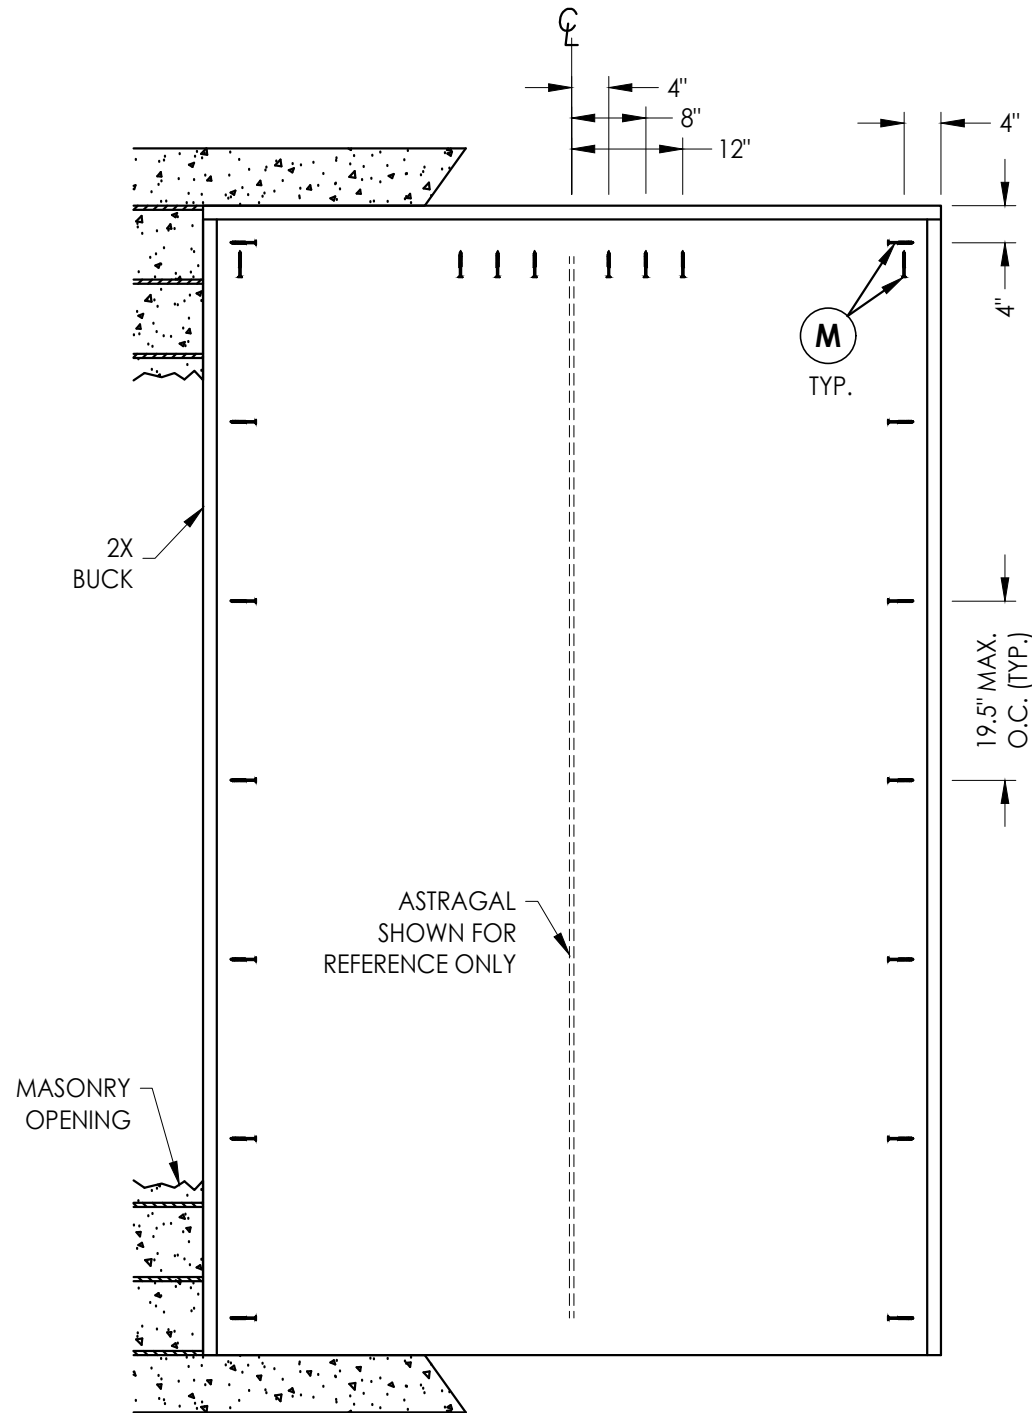

BUCK ANCHORING


CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	3/16"	1-1/4"	3"	1-1/2"
	1/4"	1-1/4"	3"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	2-1/2"	4"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

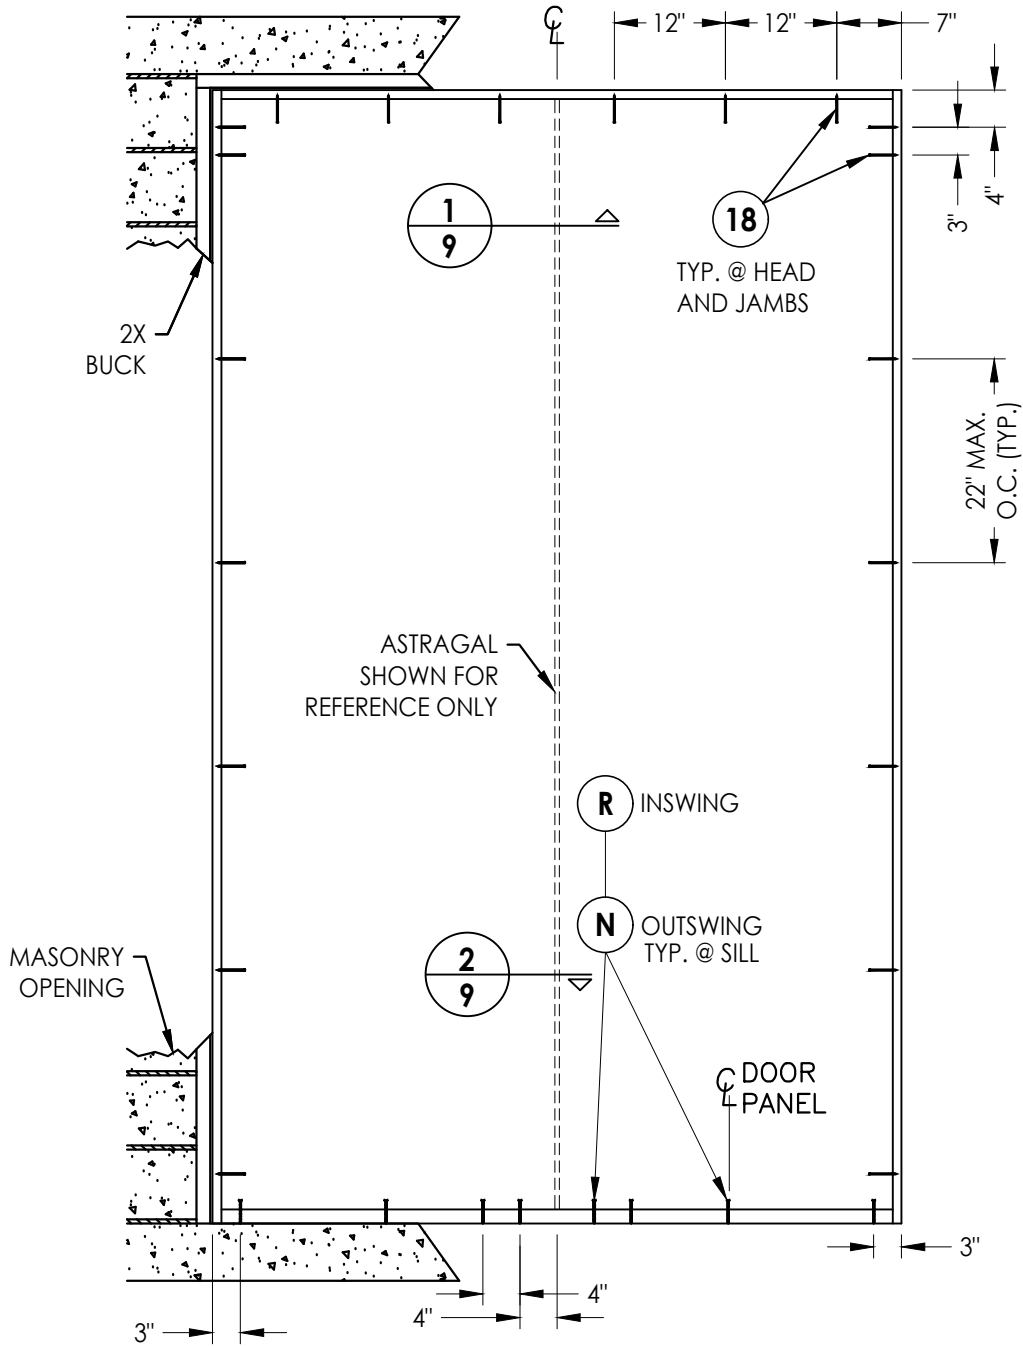

FRAME ANCHORING

Masonry 2X buck construction

5	9/22/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
4	10/4/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
3	9/16/20	UPDATE TO 7TH ED. (2020)	FBC	LFS
2	07/11/17	UPDATE TO 6TH ED. (2017)	FBC	LFS
1	08/10/15	UPDATE TO 5TH ED. (2014)	FBC	LFS
NO.	DATE			BY
REVISIONS				

DATE: 6/25/12

SCALE: *N.T.S.*

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-15737.13


SHEET 6 OF 13

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2012 R.W. BUILDING CONSULTANTS INC.

Z:\2023 FBC Drawings\Brannen Millwork\FL-15737 R6 Swing Doors\FL-15737.7-14.dwg

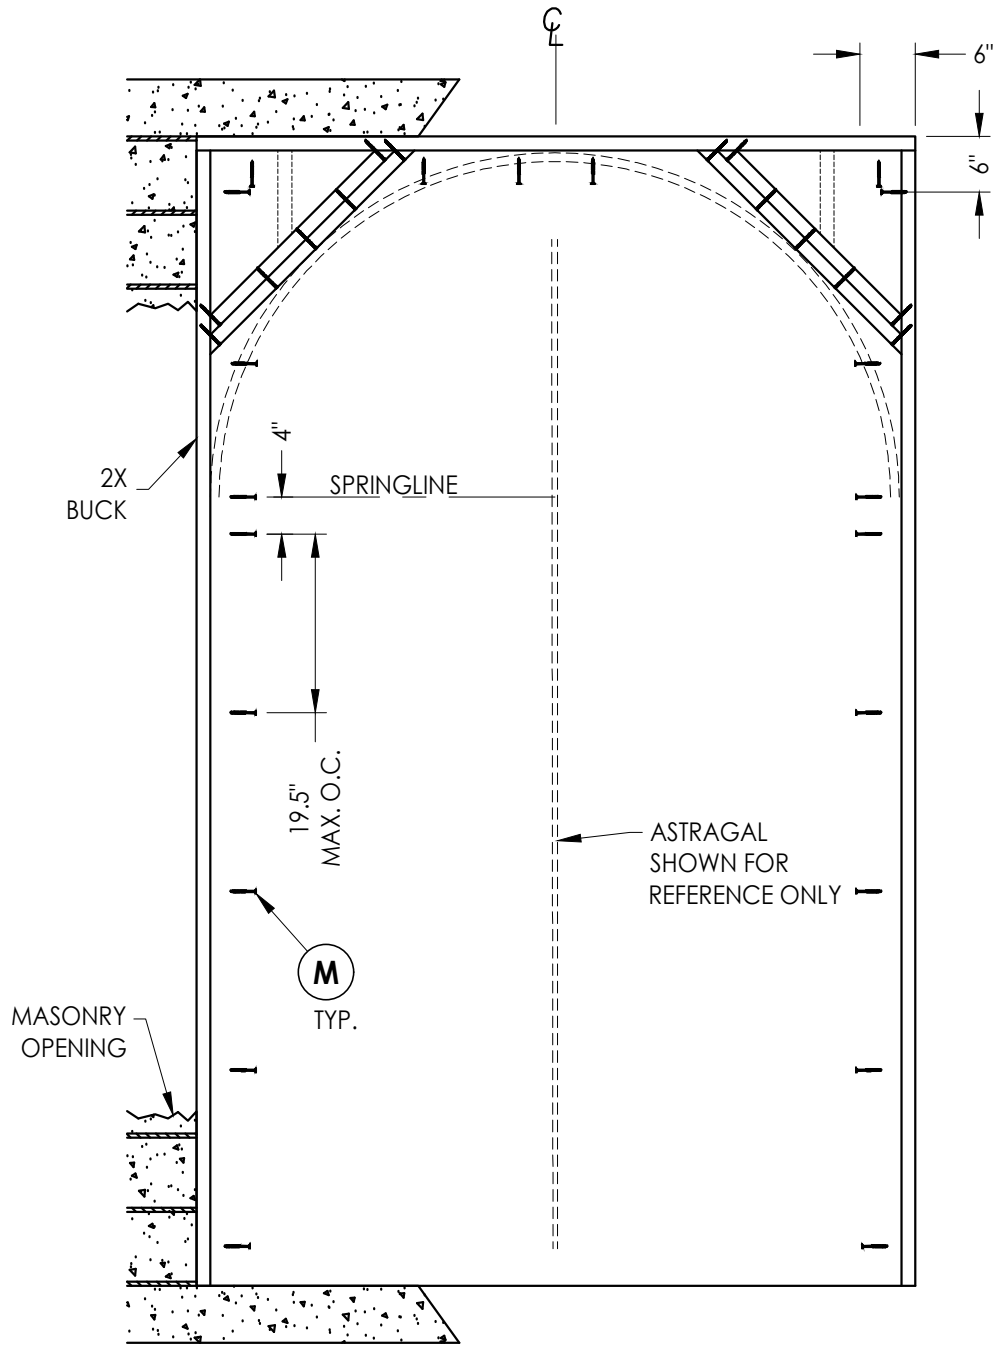

BUCK ANCHORING

CONCRETE ANCHOR NOTES:


- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	3/16"	1-1/4"	3"	1-1/2"
	1/4"	1-1/4"	3"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	2-1/2"	4"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

2X FRAMING TO BE DESIGNED BY THE ENGINEER OR ARCHITECT OF RECORD BASED ON WIND LOADS AND THE CLADDING BEING USED.

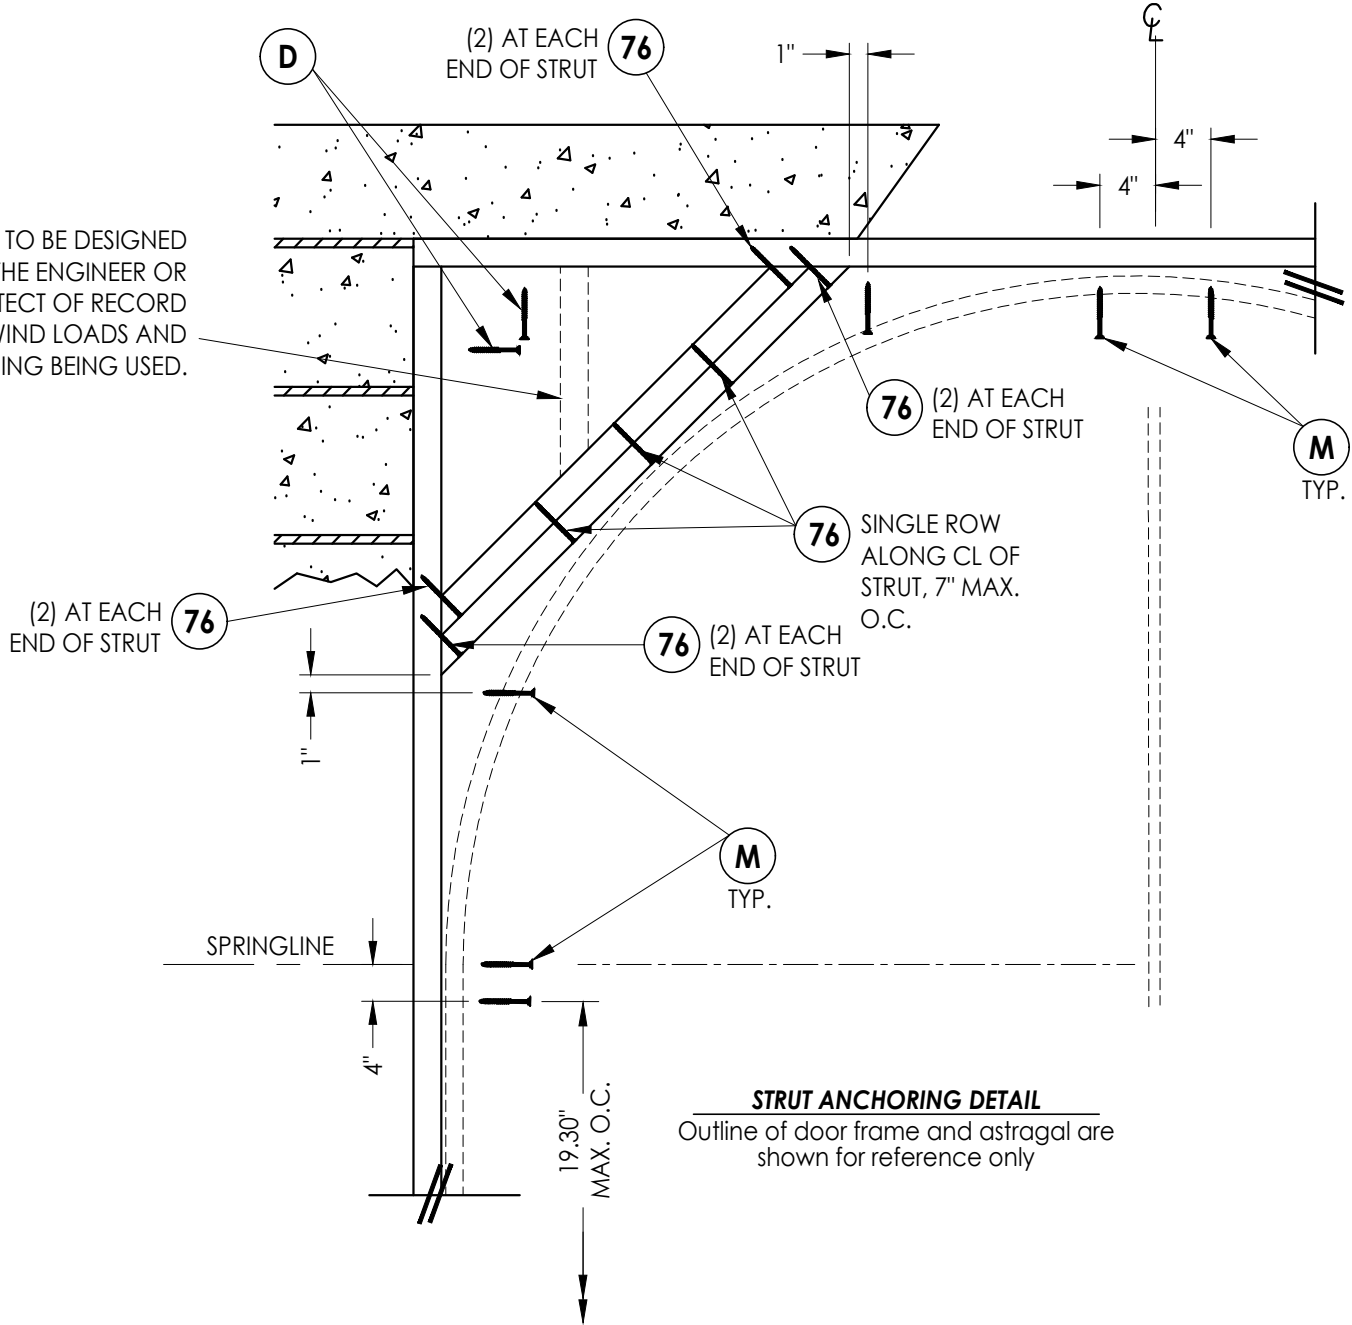

STRUT ANCHORING DETAIL

Outline of door frame and astragal are shown for reference only

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
GLAZED & OPAQUE
WOOD DOOR

PART OR ASSEMBLY:
BUCK ANCHORING
RADIUS TOP DOOR

		9/22/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
5	10/4/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	
4	9/16/20	UPDATE TO 7TH ED. (2020)	FBC	LFS	
3	07/11/17	UPDATE TO 6TH ED. (2017)	FBC	LFS	
2	08/10/15	UPDATE TO 5TH ED. (2014)	FBC	LFS	
1	DATE				
NO.	DATE				

REVISIONS

DATE: 6/25/12

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-15737.13

SHEET 7 OF 13

Z:\2023 FBC Drawings\Brannen Millwork\FL-15737 R6 Swing Doors\FL-15737.7-14.dwg


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	3/16"	1-1/4"	3"	1-1/2"
	1/4"	1-1/4"	3"	4"
DeWALT ULTRACON+®	1/4"	1-1/4"	2-1/2"	4"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

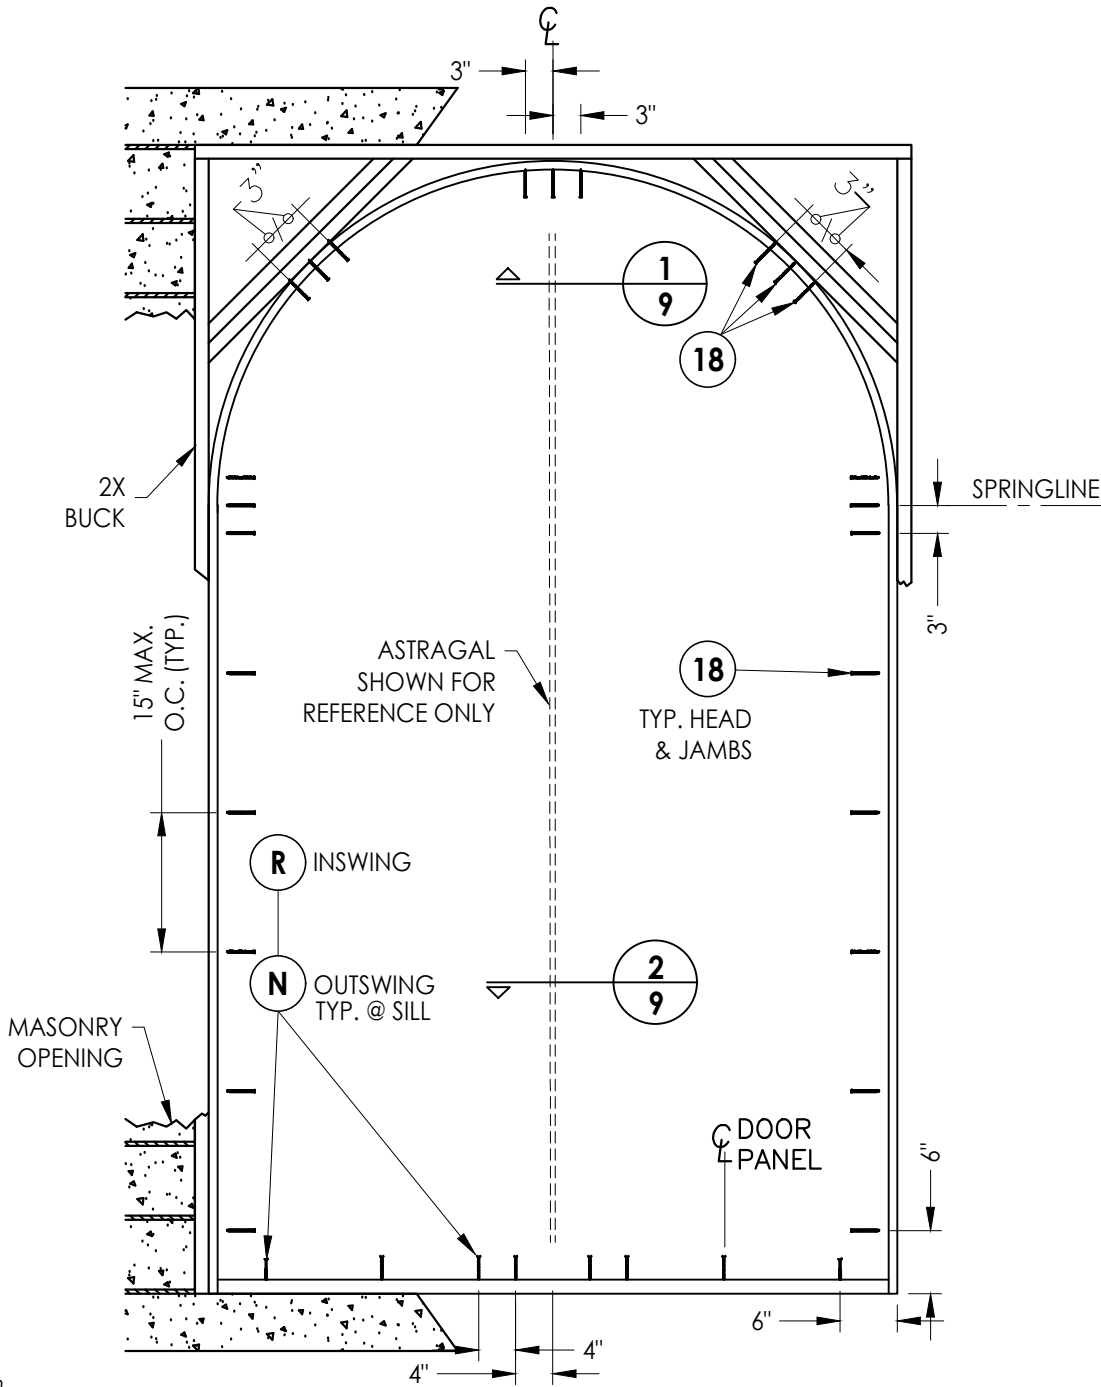

FRAME ANCHORING

NO.	DATE	REVISIONS			
		DATE	BY	REVISIONS	
5	9/22/26	UPDATE TO 9TH ED. (2026)	FBC	LFS	
4	10/4/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	
3	9/16/20	UPDATE TO 7TH ED. (2020)	FBC	LFS	
2	07/11/17	UPDATE TO 6TH ED. (2017)	FBC	LFS	
1	08/10/15	UPDATE TO 5TH ED. (2014)	FBC	LFS	

DATE: 6/25/12

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:
FL-15737.13

SHEET 8 OF 13


PRODUCT:
GLAZED & OPAQUE
WOOD DOOR

PART OR ASSEMBLY:
FRAME ANCHORING
RADIUS TOP DOOR


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Brannen Millwork\FL-15737 R6 Swing Doors\FL-15737.7-14.dwg

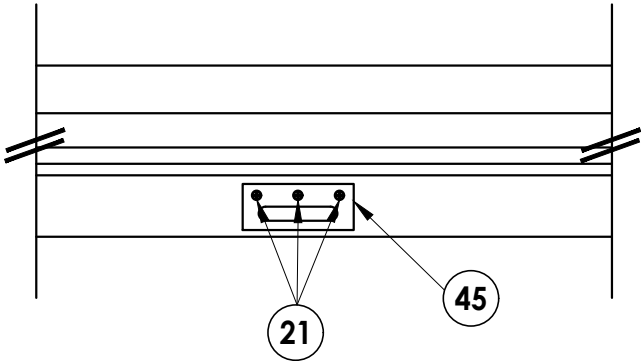


1
9 **MULTI-POINT STRIKE INSTALLATION**
View looking up @ head

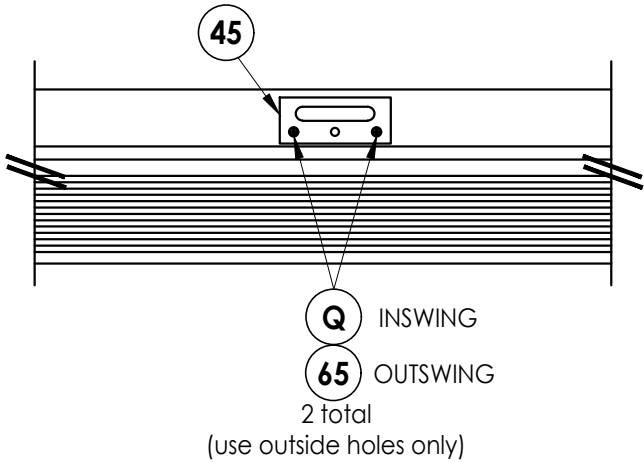


2
9 **MULTI-POINT STRIKE INSTALLATION**
View looking down @ sill

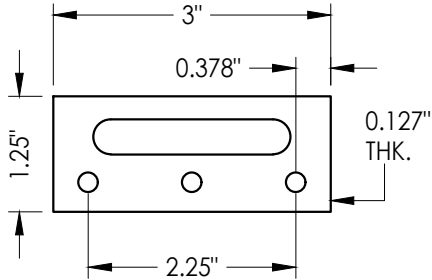

45 **MULTI-POINT STRIKE PLATE**
@ head & sill

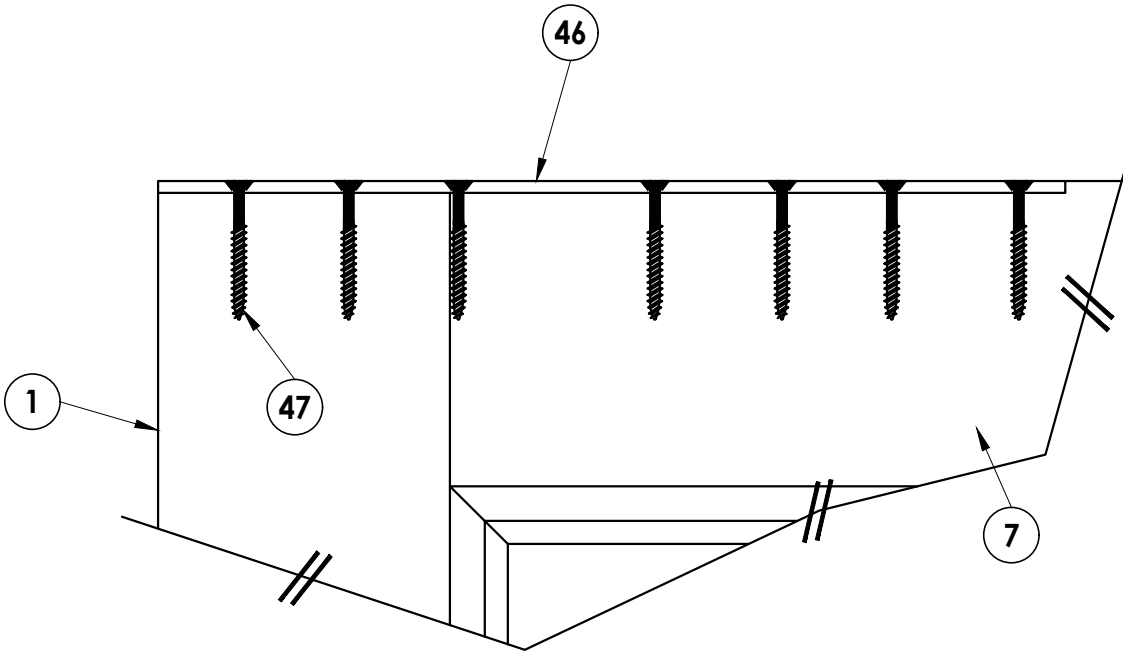

DOOR REINF. FOR multi-point LOCK
Typical at top & bottom of door

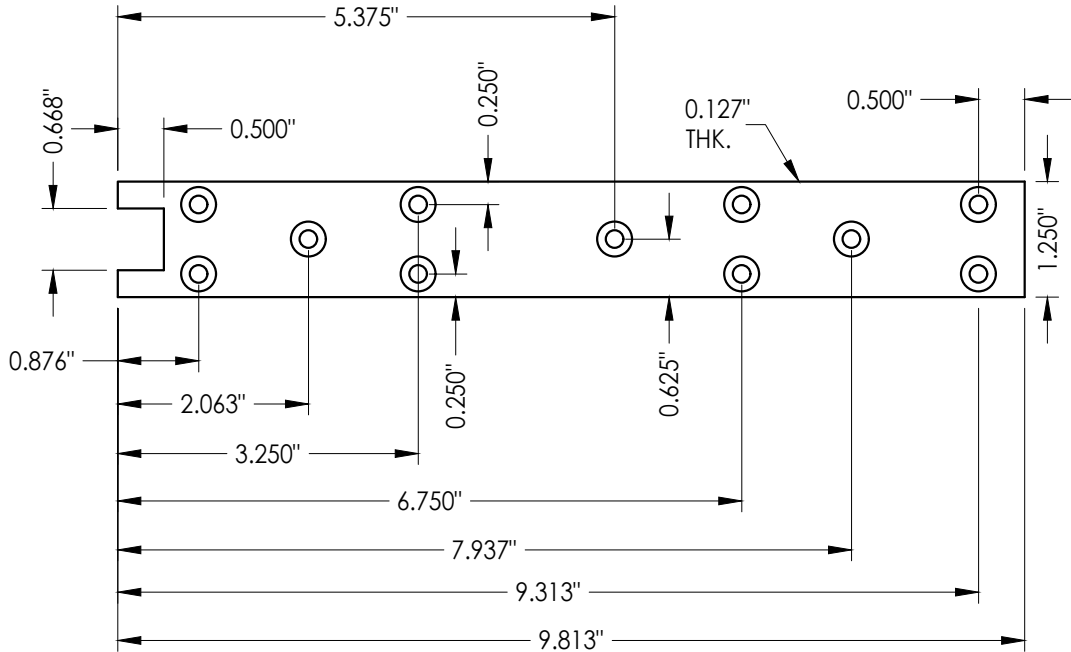

46 **REINFORCEMENT PLATE**
Multi-point lock assy.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Vairico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: GLAZED & OPAQUE
WOOD DOOR

PART OR ASSEMBLY:
MULTI-POINT LOCK
HARDWARE DETAILS

NO.	DATE	REVISIONS
5	9/22/26	UPDATE TO 9TH ED. (2026) FBC
4	10/4/23	UPDATE TO 8TH ED. (2023) FBC
3	9/16/20	UPDATE TO 7TH ED. (2020) FBC
2	07/11/17	UPDATE TO 6TH ED. (2017) FBC
1	08/10/15	UPDATE TO 5TH ED. (2014) FBC
		BY

DATE: 6/25/12

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:
FL-15737.13


SHEET 9 OF 13

Z:\2023 FBC Drawings\Brannen Millwork\FL-15737 R6 Swing Doors\FL-15737.7-14.dwg

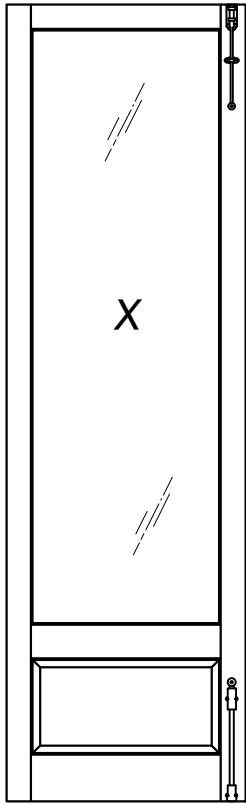


SURFACE BOLTS

When surface bolts are used,
the Hoppe multi-point lock is
not required

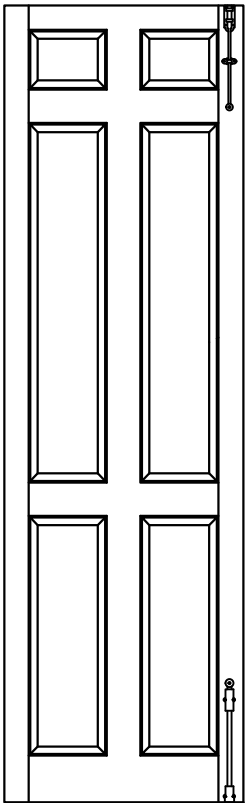


SURFACE BOLTS


When surface bolts are used,
the Hoppe multi-point lock is
not required

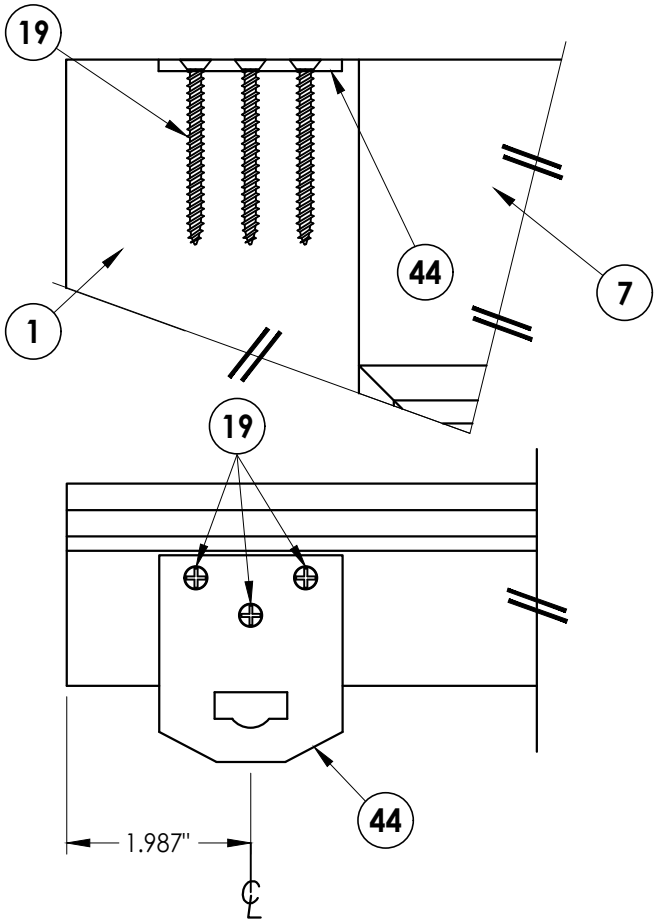

SURFACE BOLT STRIKE PLATE
ATTACHMENT TO PANEL DETAIL
TYP. TOP & BOTTOM
OF DOOR PANELS

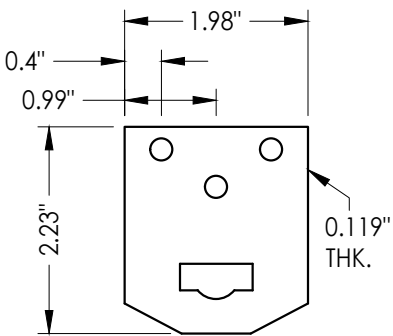


44 SURFACE BOLT STRIKE PLATE
@ Head & Sill
Typ. Panel & frame

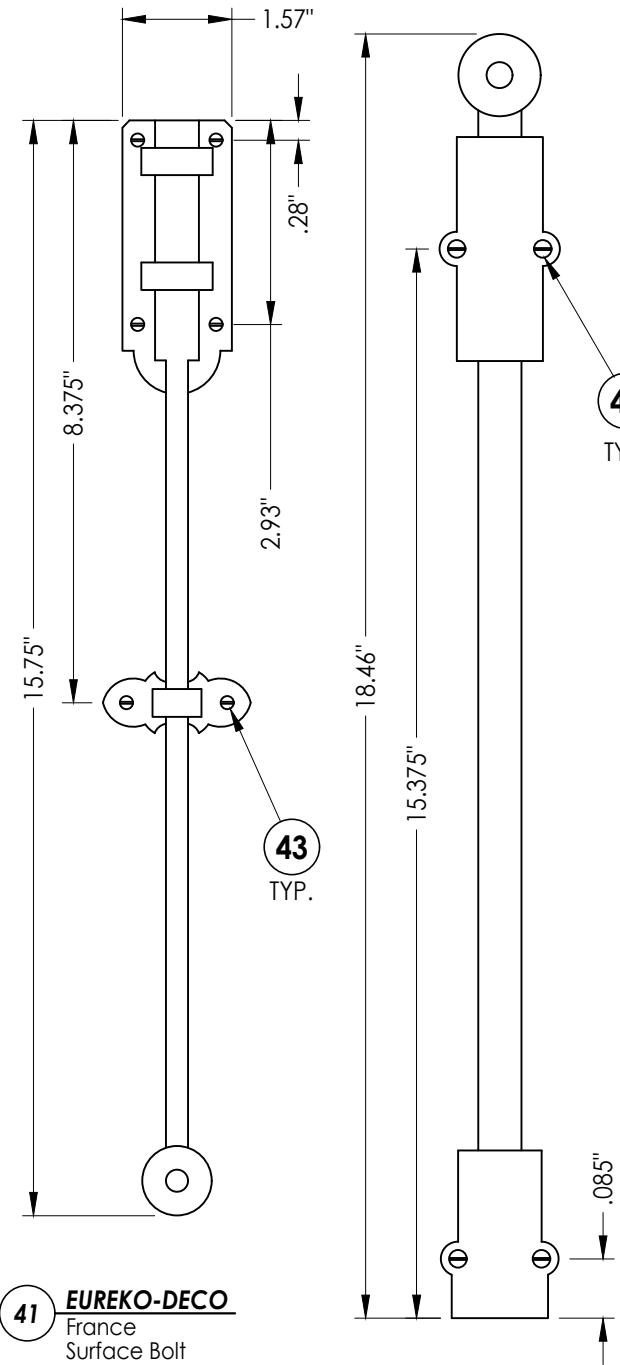


41 EUREKO-DECO
France
Surface Bolt

42 EUREKO-DECO
Louis V
Surface Bolt

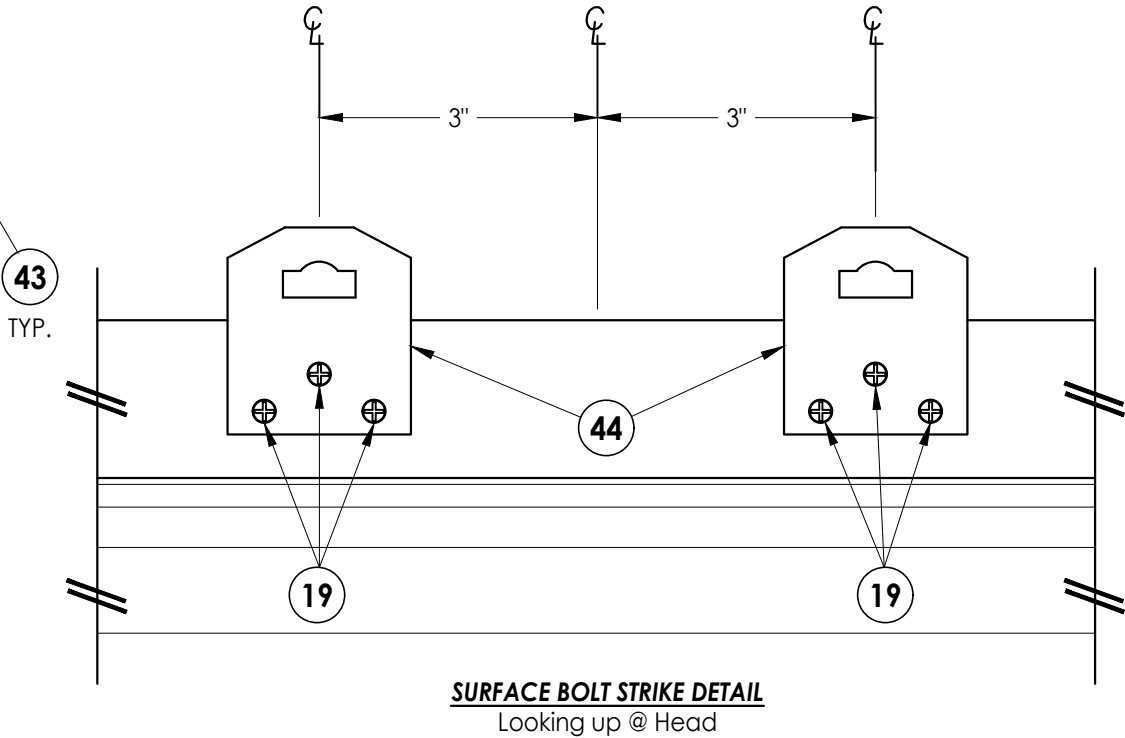

SURFACE BOLT STRIKE DETAIL
Looking up @ Head

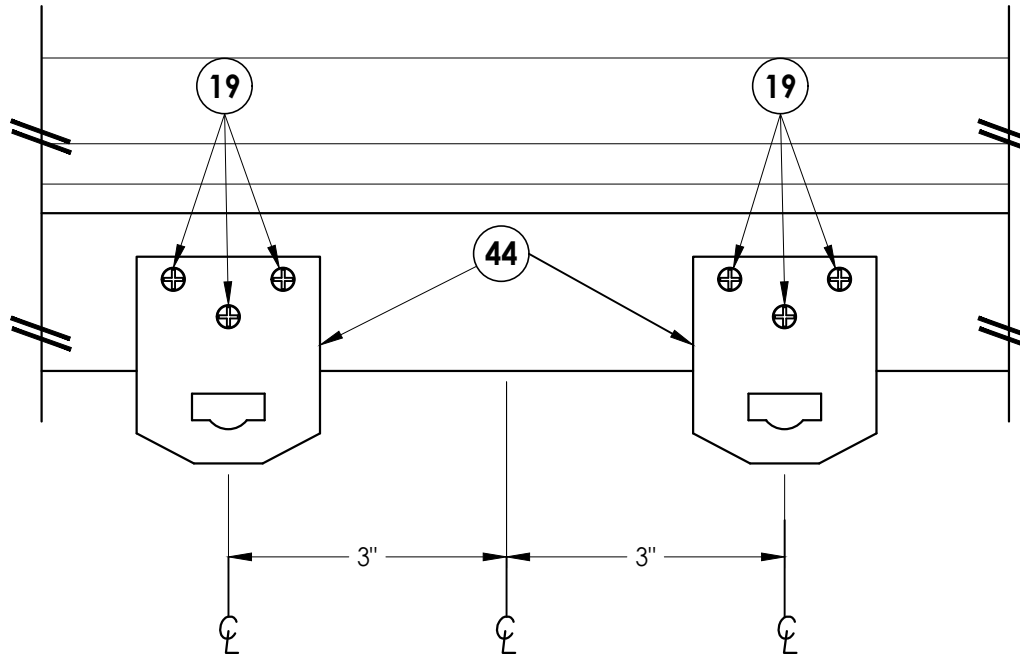

SURFACE BOLT STRIKE DETAIL
Looking Down @ Sill

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: GLAZED & OPAQUE
WOOD DOOR

PART OR ASSEMBLY:
SURFACE BOLT
HARDWARE DETAILS

NO.	DATE	REVISIONS
5	9/22/26	UPDATE TO 9TH ED. (2026) FBC LFS
4	10/4/23	UPDATE TO 8TH ED. (2023) FBC LFS
3	9/16/20	UPDATE TO 7TH ED. (2020) FBC LFS
2	07/11/17	UPDATE TO 6TH ED. (2017) FBC LFS
1	08/10/15	UPDATE TO 5TH ED. (2014) FBC LFS

DATE: 6/25/12

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS


DRAWING NO.:

FL-15737.13


SHEET 10 OF 13

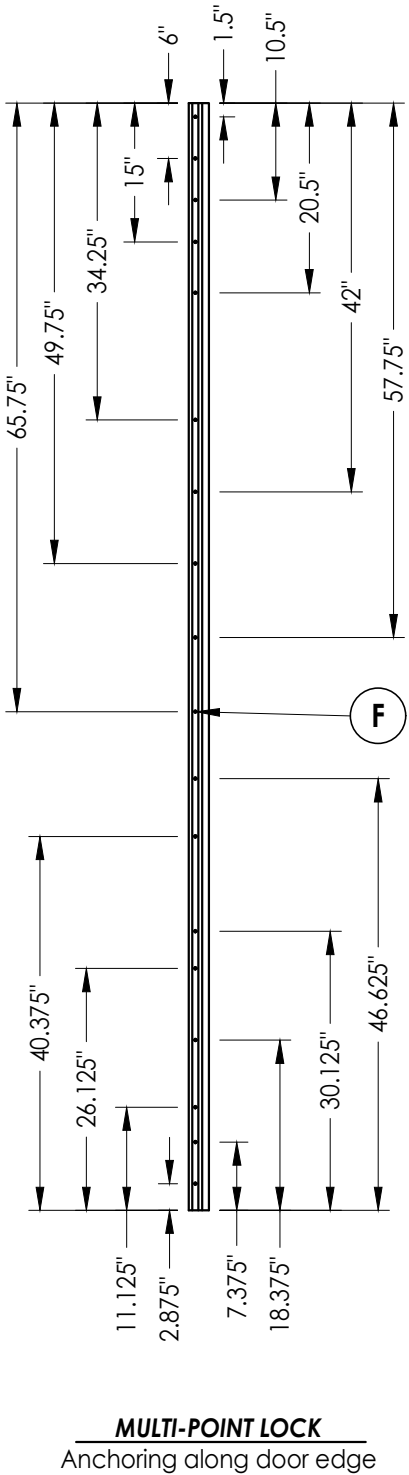


MULTI-POINT LOCK
Anchoring along door edge

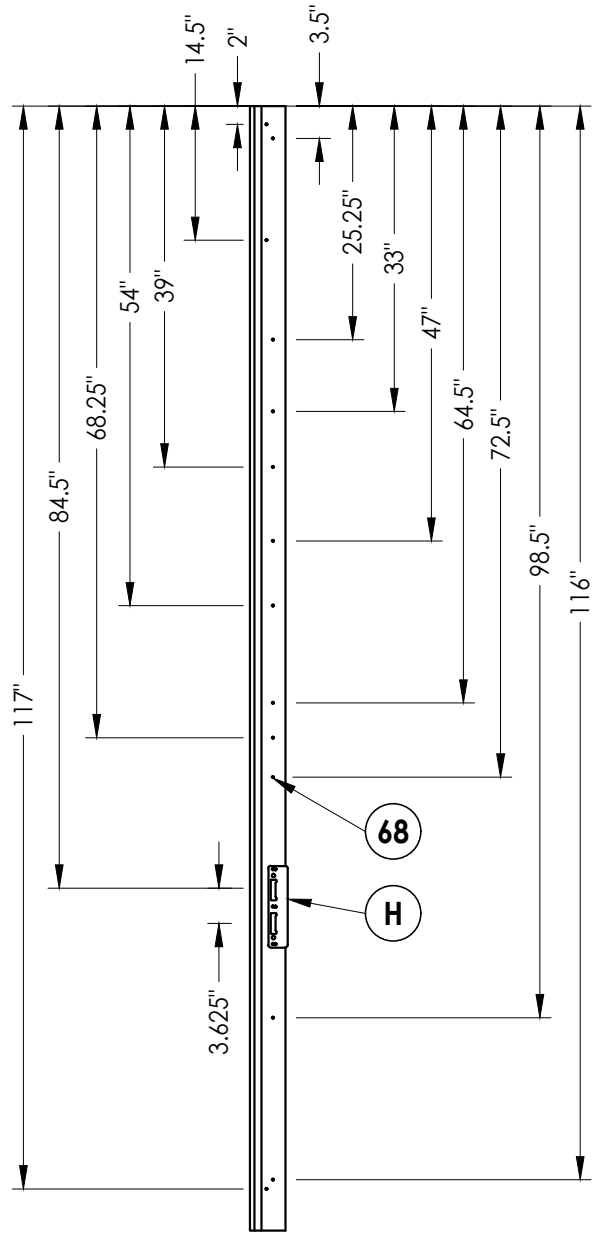


STRIKE LOCATIONS
On the astragal

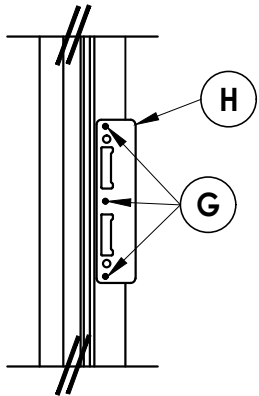


STRIKE ANCHORING DETAIL

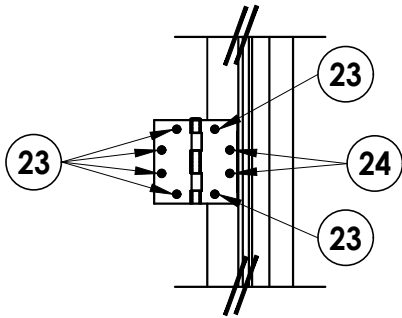

HINGE ANCHORING DETAIL

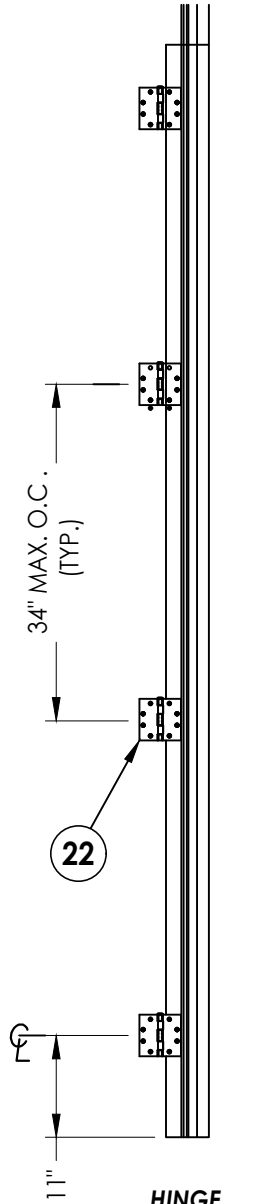

HINGE
Location on
Door Panel
(Rectangular)

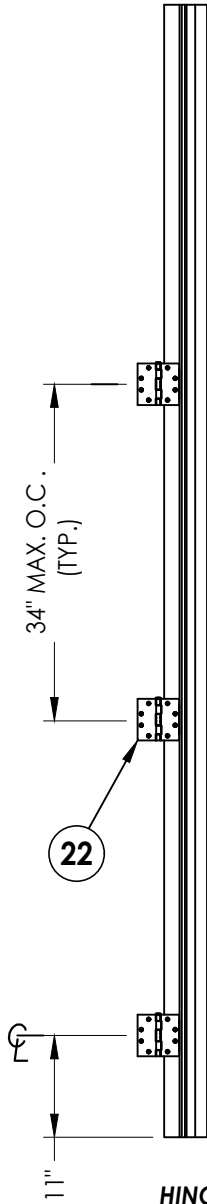

HINGE
Location on
Door Panel
(Radius Top)

DATE:	6/25/12
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-15737.13
SHEET	11 of 13


NO.	DATE	REVISIONS
5	9/22/26	UPDATE TO 9TH ED. (2026) FBC LFS
4	10/4/23	UPDATE TO 8TH ED. (2023) FBC LFS
3	9/16/20	UPDATE TO 7TH ED. (2020) FBC LFS
2	07/11/17	UPDATE TO 6TH ED. (2017) FBC LFS
1	08/10/15	UPDATE TO 5TH ED. (2014) FBC LFS

PRODUCT:	GLAZED & OPAQUE WOOD DOOR
PART OR ASSEMBLY:	HINGE & STRIKE HARDWARE DETAILS


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Vairico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Brannen Millwork\FL-15737 R6 Swing Doors\FL-15737.7-14.dwg

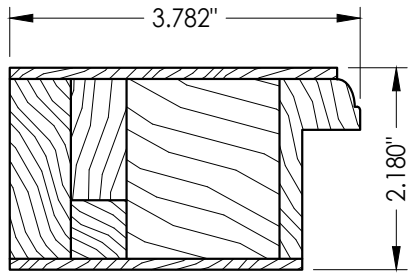


1 **LATCH STILE**
For glass infill

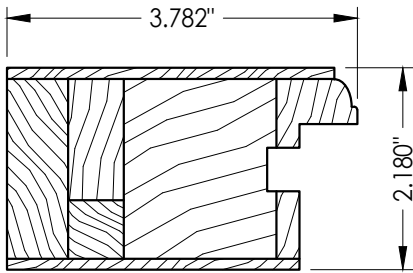


2 **LATCH STILE**
For panel infill

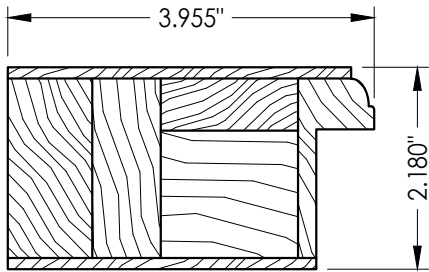


3 **HINGE STILE**
For glass infill

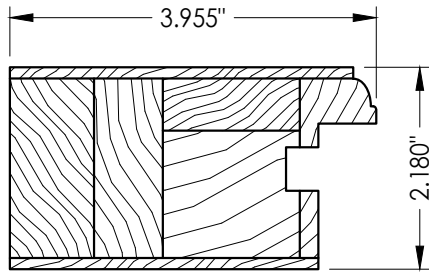


4 **HINGE STILE**
For panel infill

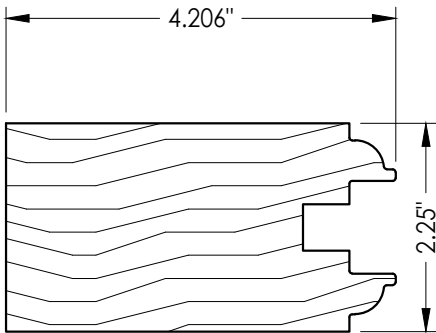


71 **LATCH STILE**
Opaque Door

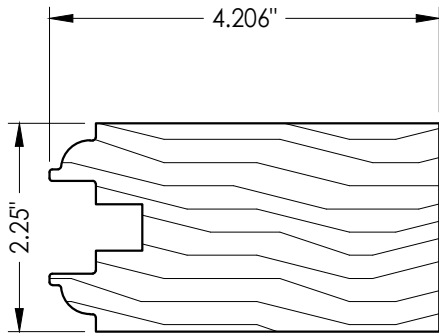


72 **HINGE STILE**
Opaque Door

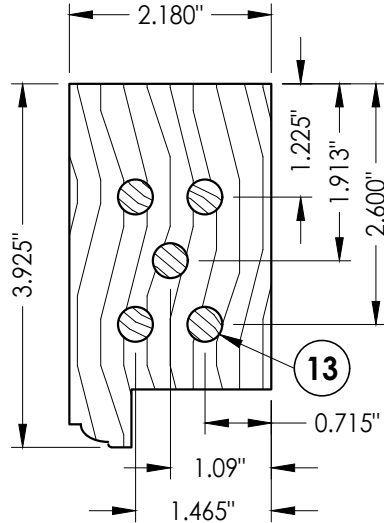


7 **TOP RAIL**
Glazed door

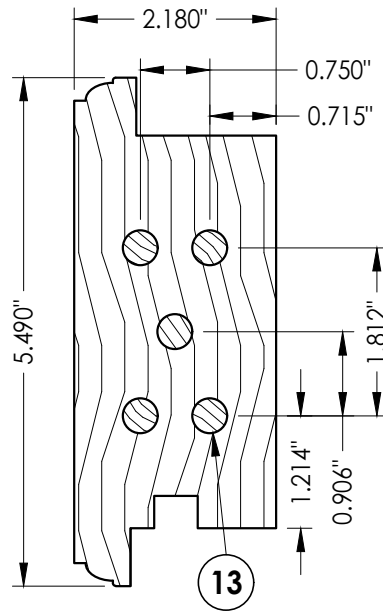


8 **MID RAIL**
Glazed door

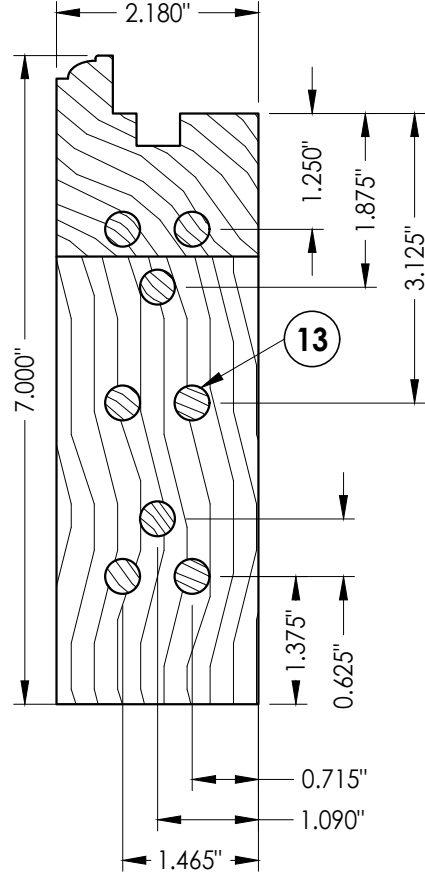


9 **BOTTOM RAIL**
Glazed door

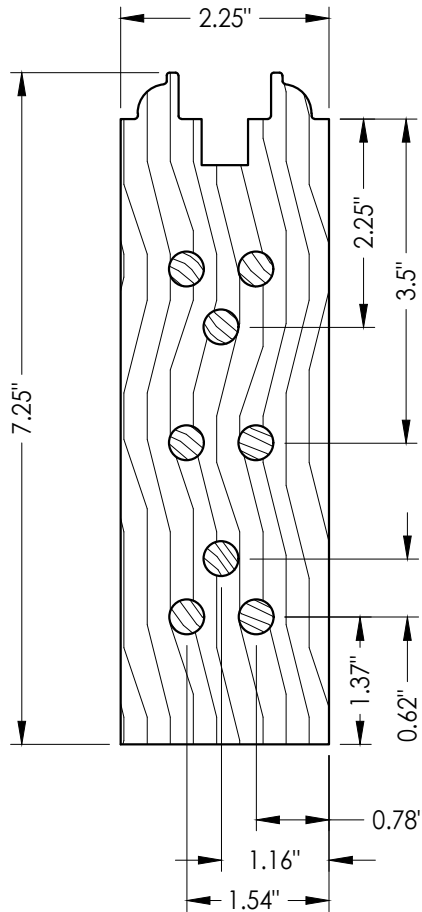

75 **BOTTOM RAIL**
Opaque Door

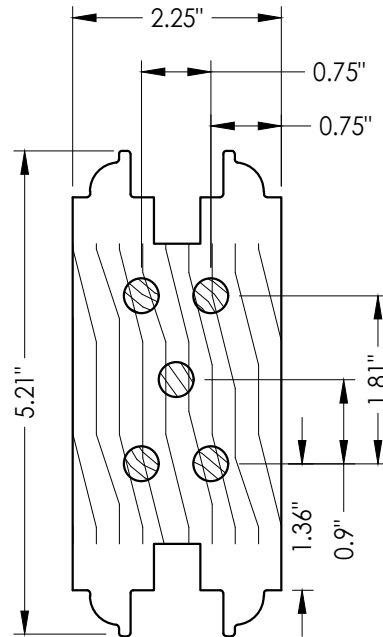

73 **MID RAIL**
Opaque Door

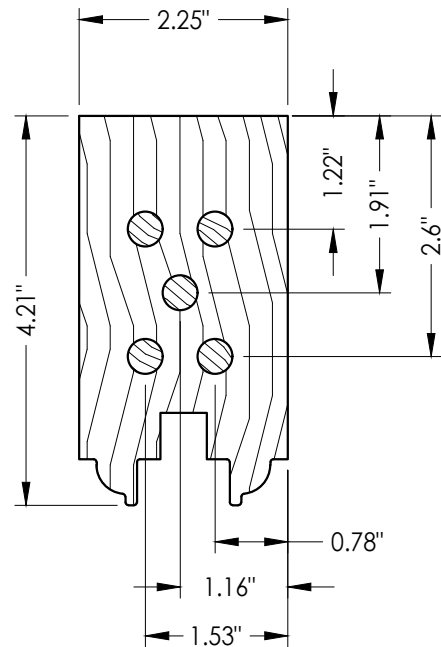

74 **TOP RAIL**
Opaque Door

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: **GLAZED & OPAQUE
WOOD DOOR**

PART OR ASSEMBLY:
COMPONENTS

NO.	DATE	REVISIONS
5	9/22/26	UPDATE TO 9TH ED. (2026) FBC LFS
4	10/4/23	UPDATE TO 8TH ED. (2023) FBC LFS
3	9/16/20	UPDATE TO 7TH ED. (2020) FBC LFS
2	07/11/17	UPDATE TO 6TH ED. (2017) FBC LFS
1	08/10/15	UPDATE TO 5TH ED. (2014) FBC LFS

DATE: 6/25/12

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS







DRAWING NO.:

FL-15737.13

SHEET 12 OF 13

Z:\2023 FBC Drawings\Brannen Millwork\FL-15737 R6 Swing Doors\FL-15737.7-14.dwg

BILL OF MATERIALS		
ITEM	DESCRIPTION	MATERIAL
1	LATCH STILE FOR GLASS (SG >= 0.46)	WOOD
2	LATCH STILE FOR PANEL INFIL (SG >= 0.46)	WOOD
3	HINGE STILE FOR GLASS (SG >= 0.46)	WOOD
4	HINGE STILE FOR PANEL INFIL (SG >= 0.46)	WOOD
7	TOP RAIL (SG >= 0.46)	WOOD
8	MID RAIL (SG >= 0.46)	WOOD
9	BOTTOM RAIL (SG >= 0.46)	WOOD
10	GLASS & PANEL INFIL STOP (SG >= 0.46)	WOOD
11	PANEL INFIL (SG >= 0.46)	LVL/WOOD
12	.074" X 1-1/2" BRAD NAIL	STEEL
13	3/8"Ø X 2-3/4" DOWEL (SG >= 0.46)	WOOD
14	SEALANT	SILICONE
15	JAMB (SG >= 0.46)	WOOD
18	#8 X 2-1/2" WOOD SCREW (1.15" MIN. EMBEDMENT w/ 0.15" C'-SINK)	STEEL
19	#10 X 1-1/2" PFH SMS	STEEL
21	#10 X 2-1/2" PFH SMS	STEEL
22	4-1/2" HINGE	BRASS
23	#12 X 1-1/4" PFH SMS	STEEL
24	#12 X 2" PFH SMS	STEEL
25	WEATHERSTRIP	FOAM
40	ASTRAGAL (SG >= 0.46)	WOOD
41	EUREKO-DECO FRANCE SURFACE BOLT	STEEL
42	EUREKO-DECO LOUIS V SURFACE BOLT	STEEL
43	#7 X 1-3/4" PFH SMS	STEEL
44	SURFACE BOLT STRIKE PLATE @ HEAD & SILL	ST. STEEL
45	STRIKE PLATE @ HEAD & SILL	ST. STEEL
46	REINFORCEMENT PLATE	ST. STEEL
47	#8 X 1-1/2" SFH SMS	ST. STEEL
50	GLAZING SPACER (DESICCANT FILLED)	ST. STEEL
51	GLAZING COMPOUND DOW #1199	SILICONE
63	INSWING SADDLE THRESHOLD	OAK/ALUM
65	3/16" x 2-1/4" ITW PFH CONCRETE SCREW	STEEL
66	OUTSWING HIGH DAM THRESHOLD	OAK/ALUM
68	#6 x 1-1/2" SQ. DRIVE FLAT HEAD SCREW	STEEL
71	LATCH STILE FOR OPAQUE DOOR (SG >= 0.46)	WOOD
72	HINGE STILE FOR OPAQUE DOOR (SG >= 0.46)	WOOD
73	MID RAIL OPAQUE DOOR (SG >= 0.46)	WOOD
74	TOP RAIL OPAQUE DOOR (SG >= 0.46)	WOOD
75	BOTTOM RAIL OPAQUE DOOR (SG >= 0.46)	WOOD
76	#8 X 3" PFH WOOD SCREW	STEEL

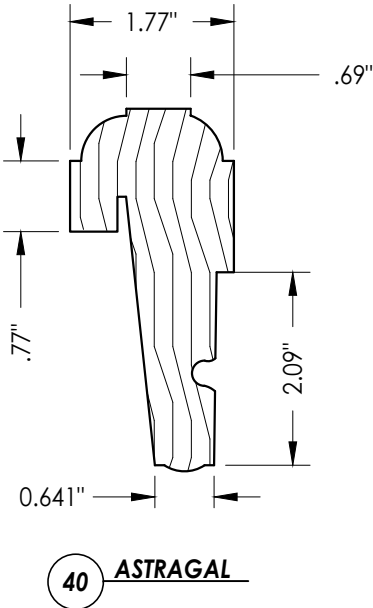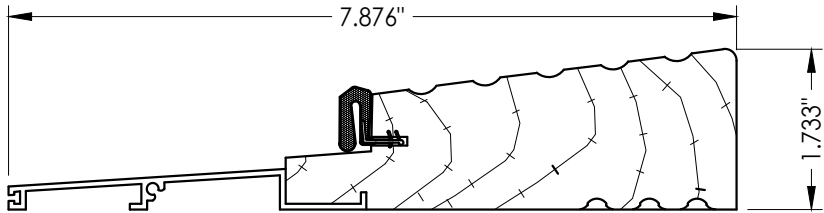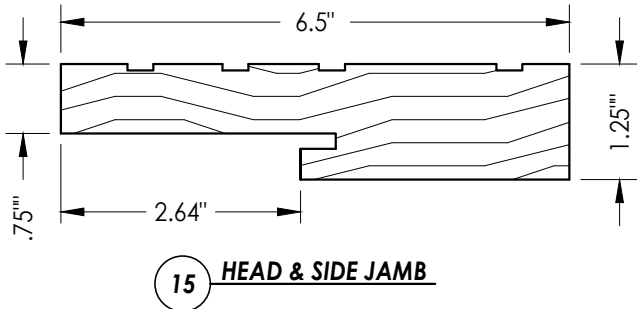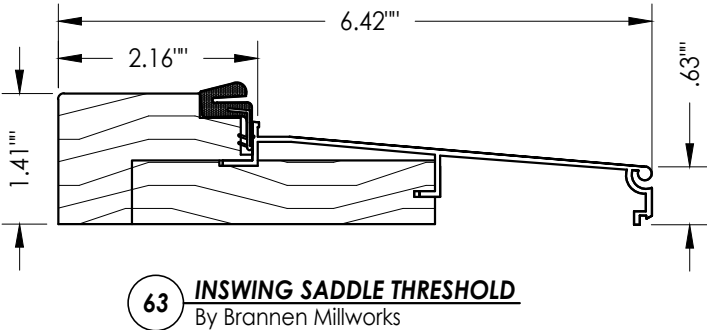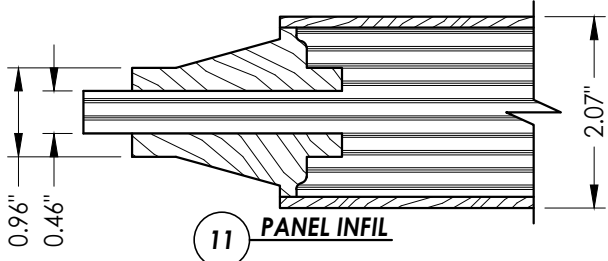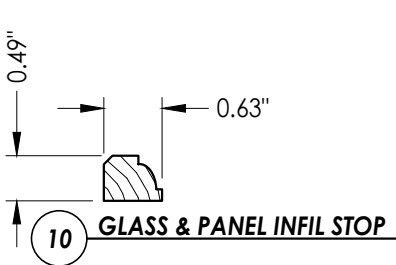

CORROSION RESISTANCE - SALTWATER ENVIRONMENTS
Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or R332.1.

BILL OF MATERIALS		
ITEM	DESCRIPTION	MATERIAL
A	1/4" MAX. SHIM SPACE	WOOD
D	MULTI-POINT HOPPE HLS9000 MANUAL SHOOTBOLT GEAR SYSTEM	STEEL
F	#7 X 1-3/4" PFH SMS	ST. STEEL
G	#8 X 5/8" PFH SMS	STEEL
H	LOCK STRIKE PLATE (0.100" THK.)	BRASS
J	2X BUCK (SG >= 0.55)	WOOD
L	MASONRY - 3,000 PSI CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90.	CONCRETE
M	1/4" X 2-3/4" DeWALT OR ITW PFH CONCRETE SCREW	STEEL
N	1/4" X 2-3/4" ITW PFH CONCRETE SCREW	STEEL
Q	3/16" X 3-1/4" ITW PFH CONCRETE SCREW	STEEL
R	1/4" X 3-1/4" ITW PFH CONCRETE SCREW	STEEL

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW
BUILDING CONSULTANTS, INC.
P.O. Box 230, Vairico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: GLAZED & OPAQUE
WOOD DOOR

PART OR ASSEMBLY:
BILL OF MATERIALS
& COMPONENTS

		LFS		BY	
		FBC		FBC	
5	9/22/26	UPDATE TO 9TH ED. (2026)	FBC	LFS	
4	10/4/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	
3	9/16/20	UPDATE TO 7TH ED. (2020)	FBC	LFS	
2	07/11/17	UPDATE TO 6TH ED. (2017)	FBC	LFS	
1	08/10/15	UPDATE TO 5TH ED. (2014)	FBC	LFS	
NO.		DATE		REVISIONS	

DATE: 6/25/12

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-15737.13

SHEET 13 OF 13