



PICTURE WINDOW - IMPACT

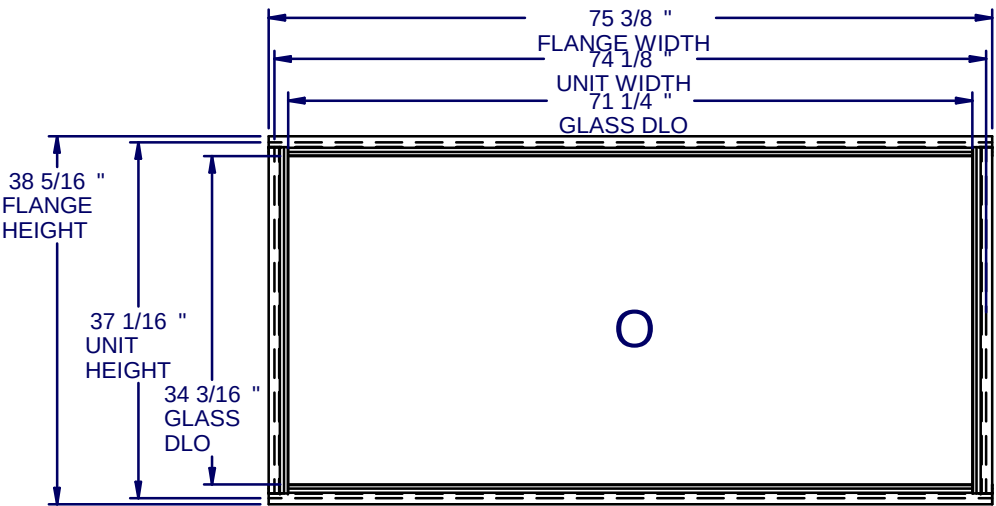

GENERAL NOTES:

- 1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE FLORIDA BUILDING CODE (FBC), CURRENT EDITION INCLUDING THE HIGH VELOCITY HURRICANE ZONE (HVHZ) AND IS RATED FOR WIND ZONE 4 MISSILE LEVEL D IMPACT USE AS DEFINED IN ASTM E 1996 PER THE FBC.
- 2. GLAZING DETAIL: (SEE SHEET 2)
- 3. CONFIGURATIONS: "O"
- 4. DESIGN PRESSURES:
 - NEGATIVE DESIGN LOADS BASED ON TESTED PRESSURE AND GLASS TABLES ASTM E-1300-04e01/09.
 - POSITIVE DESIGN LOADS BASED ON TESTED PRESSURE, WATER INFILTRATION TEST PRESSURE, AND GLASS TABLES ASTM E-1300-04e01/09.
- 5. ANCHORAGE: THE 33 1/3% STRESS INCREASE HAS NOT BEEN USED IN THE DESIGN OF THIS PRODUCT. SEE SHEET 7 FOR INSTALLATION DETAIL. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
- 6. PRODUCTS APPROVED FOR IMPACT RESISTANCE. SHUTTERS ARE NOT REQUIRED.
- 7. ALL JOINTS CAN BE EITHER MECHANICALLY FASTENED OR WELDED AT THE MANUFACTURER'S DISCRETION. SMALL JOINT SEAM SEALANT USED AT ALL JOINTS.
- 8. SERIES / MODEL DESIGNATION PW-3300. (A.K.A. PW-4700)
- 9. THE DESIGNATION X AND O STAND FOR THE FOLLOWING:
 - O = FIXED LITE
- 10. SECTION CALLOUTS APPLY TO ALL CONFIGURATIONS.
- 11. PICTURE WINDOWS CAN BE INSTALLED IN ANY ORIENTATION.

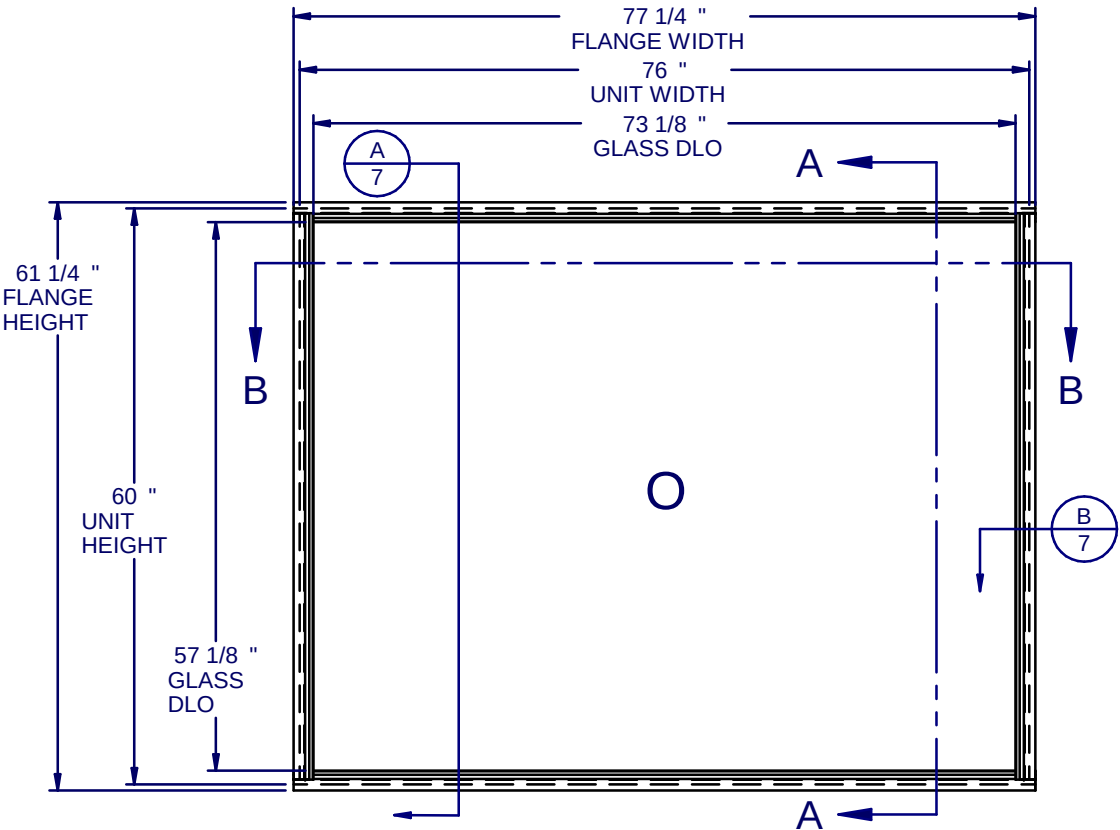


1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

3300 ALUM.
PICTURE WINDOW
IMPACT

PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN
THIS DRAWING IS THE SOLE
PROPERTY OF CUSTOM WINDOW
SYSTEMS, INC. ANY
REPRODUCTION IN PART OR AS A
WHOLE WITHOUT THE WRITTEN
PERMISSION OF CUSTOM WINDOW
SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
15810

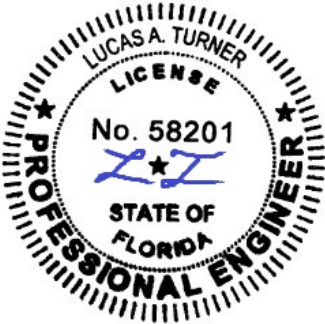

9/19/2023

LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering &
Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574

SHEET DESCRIPTION:

DRAWN BY:	DATE:
MCS	9/5/2023
DWG #:	REV.:
CWS-811	F
SCALE:	SHEET
1:20	1 OF 7

TABLE OF CONTENTS

GENERAL NOTES & ELEVATIONS.....1
GLAZING DETAILS.....2
ARCHITECTUAL SHAPES.....3
SECTION VIEWS.....4
BOM AND EXTRUSIONS.....5
ANCHOR SCHEDULE & NOTES.....6
INSTALLATION DETAILS.....7

MAX. UNIT SIZE	DESIGN PRESSURE RATING	IMPACT RATING
76" x 60"	+/- 65 PSF	LARGE MISSILE IMPACT
74-1/8" x 37-1/16"	+/- 80 PSF	LARGE MISSILE IMPACT

Lucas Turner
2023.09.19
17:01:45
-05'00'

DESIGN PRESSURE (PSF)	MAX. SIZE	FIXED GLASS
+/- 65	76" x 60"	A or C
+/- 80	74-1/8" x 37-1/16"	B or D



1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

3300 ALUM.
PICTURE WINDOW
IMPACT

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
15810







9/19/2023


LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering & Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574

SHEET DESCRIPTION:


DRAWN BY:	DATE:
MCS	9/5/2023
DWG #:	REV.:
CWS-811	F
SCALE:	SHEET
1:1	2 OF 7

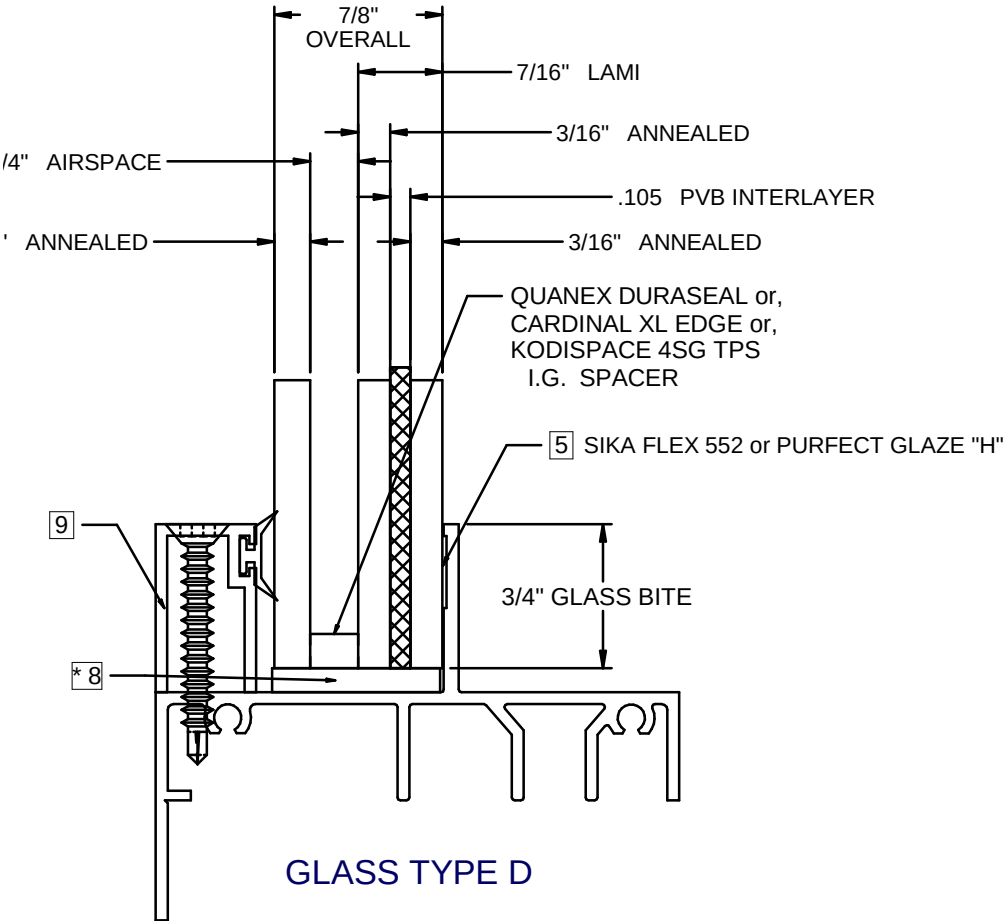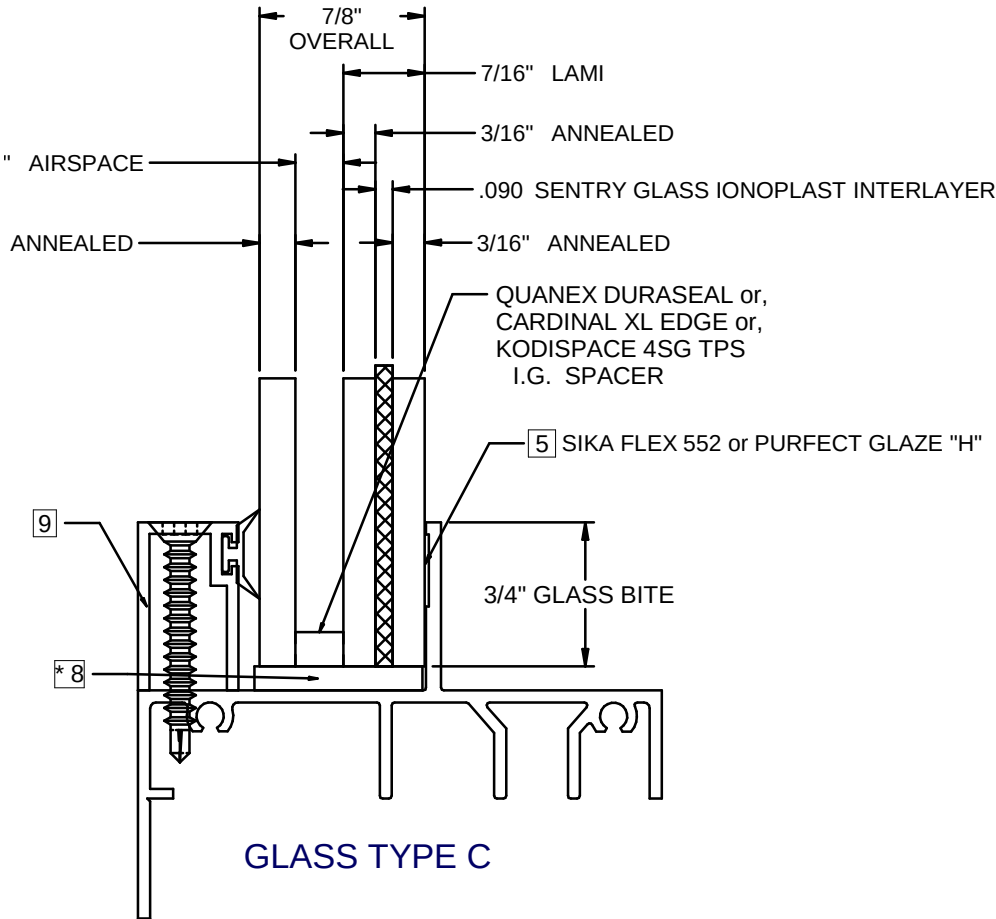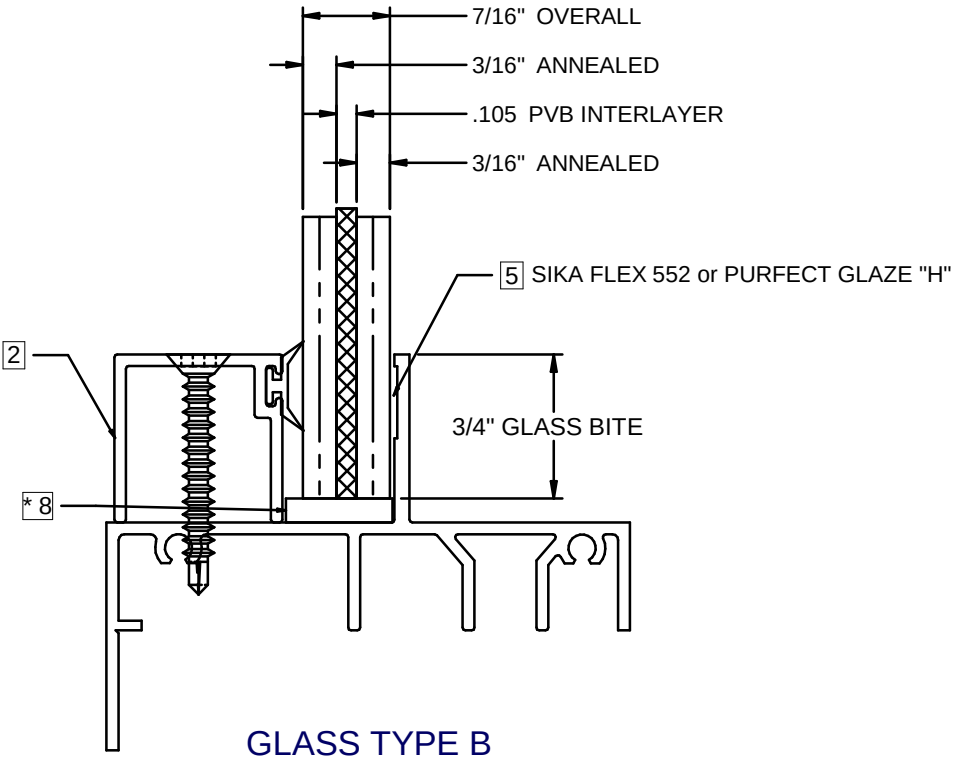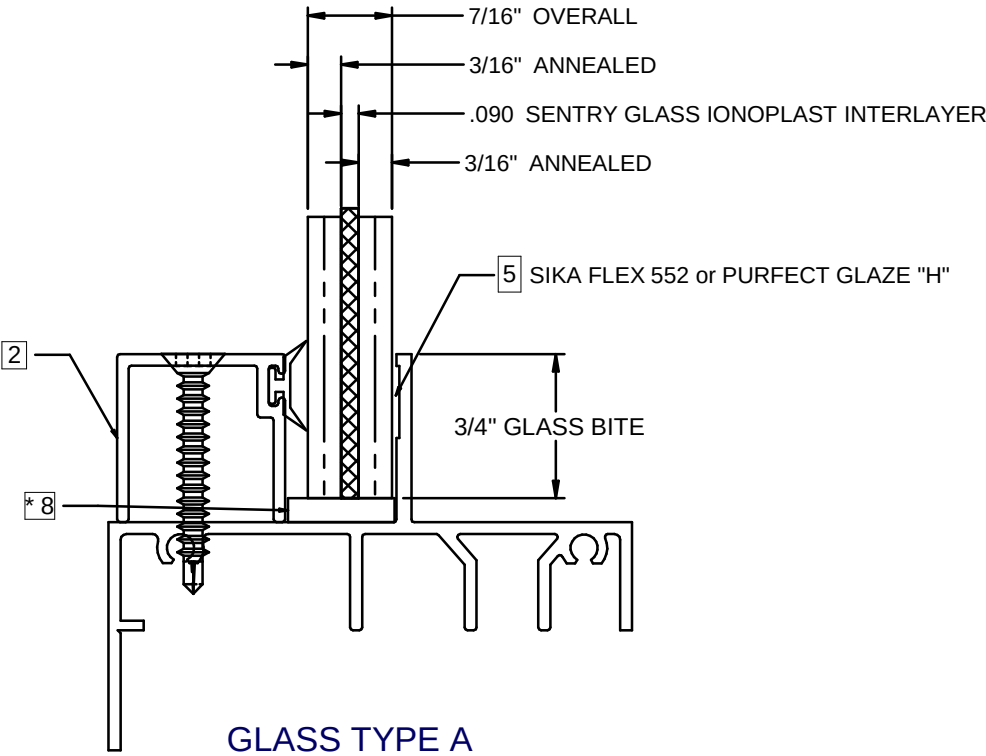


* Setting Blocks per FBC 2411.3.3.1

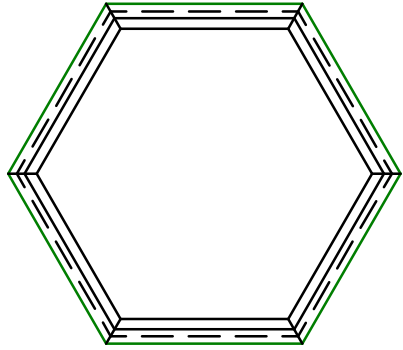


HEXAGON

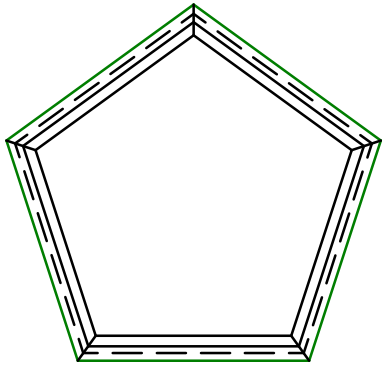


PENTAGON

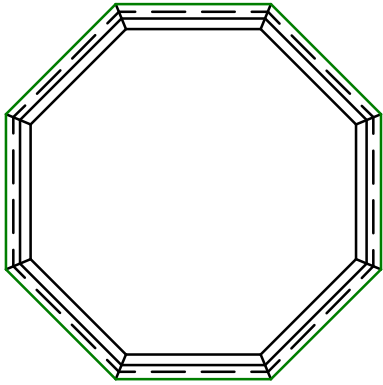


OCTOGON

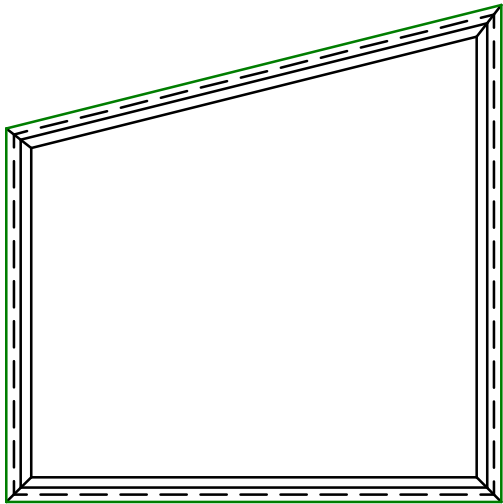


TRAPEZOID

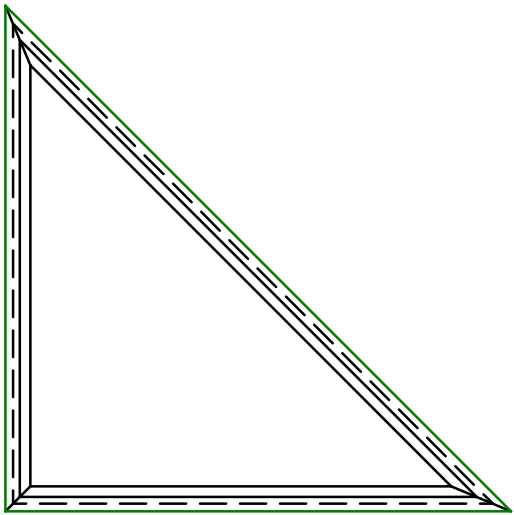


TRIANGLE

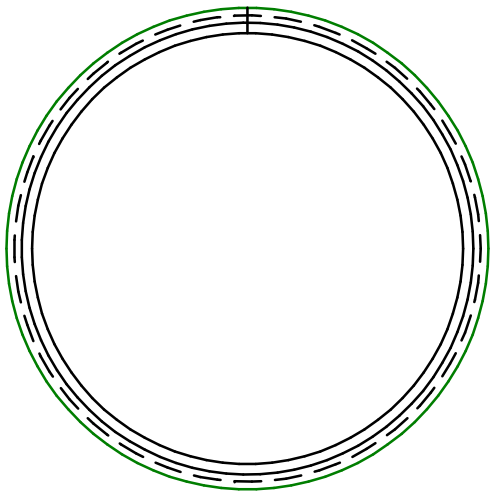


FULL CIRCLE

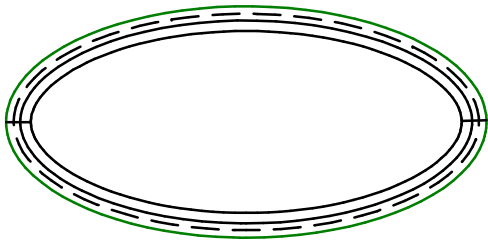


FULL ELLIPSE (OVAL)

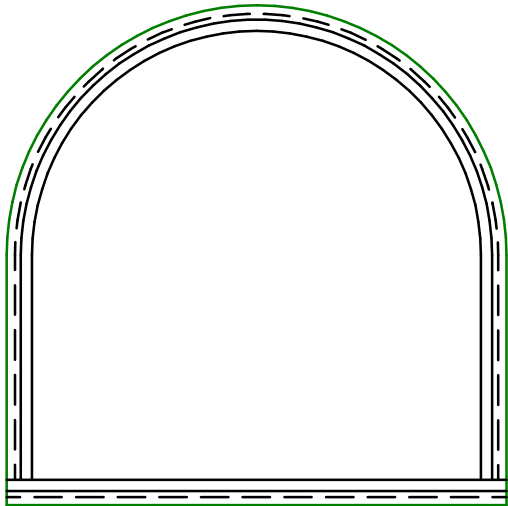


TOMBSTONE

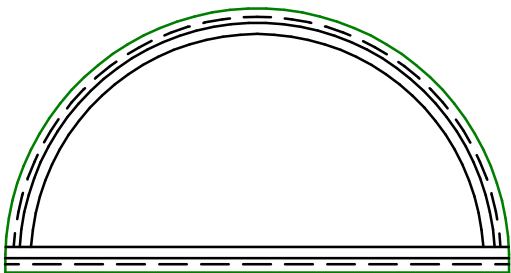


1/2 CIRCLE

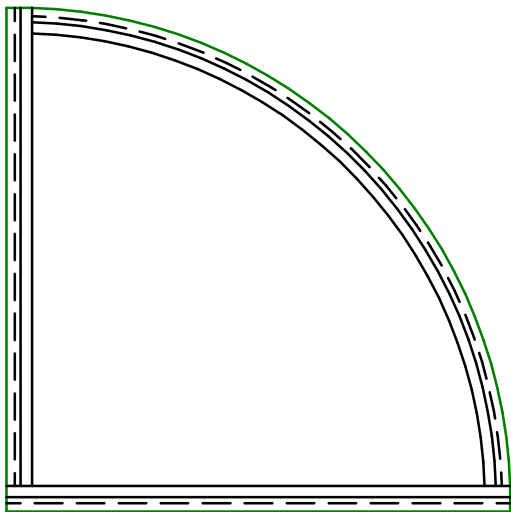

1/4 CIRCLE

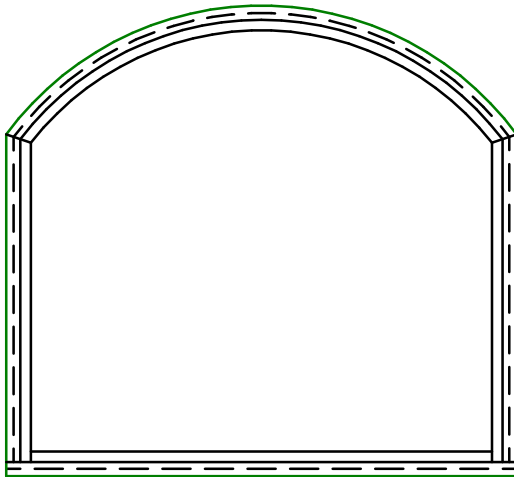

EYEBROW w/LEGS

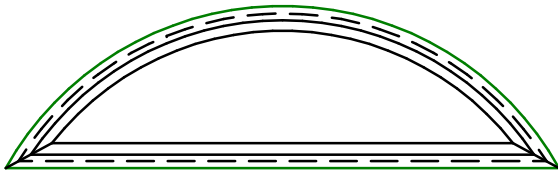

EYEBROW

- NOTES:
1. SEE SHEET 6 FOR DETAILED ANCHOR INSTALLATION REQUIREMENTS
 2. OVERALL SIZE MUST NOT EXCEED THE MAX WIDTH AND HEIGHT OF RECTANGULAR WINDOWS ON SHEET 1.
 3. ANCHOR SPACING FOR ARCHITECTUAL FLANGE WINDOWS MUST FOLLOW NOTE 1, SHEET 6.
 4. SEE SHEET 5 FOR CORNER ASSEMBLY DETAIL.




1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

**3300 ALUM.
PICTURE WINDOW
IMPACT**

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN
THIS DRAWING IS THE SOLE
PROPERTY OF CUSTOM WINDOW
SYSTEMS, INC. ANY
REPRODUCTION IN PART OR AS A
WHOLE WITHOUT THE WRITTEN
PERMISSION OF CUSTOM WINDOW
SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
15810

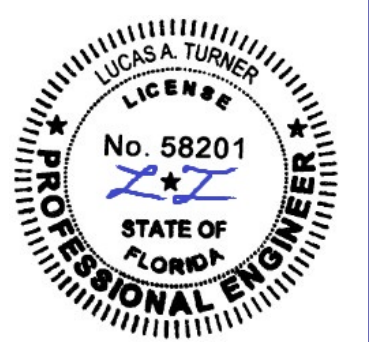

9/19/2023

LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering &
Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574

SHEET DESCRIPTION:

DRAWN BY:	DATE:
MCS	9/5/2023
DWG #:	REV.:
CWS-811	F
SCALE:	SHEET
1:16	3 OF 7




1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

3300 ALUM.
PICTURE WINDOW
IMPACT

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
15810

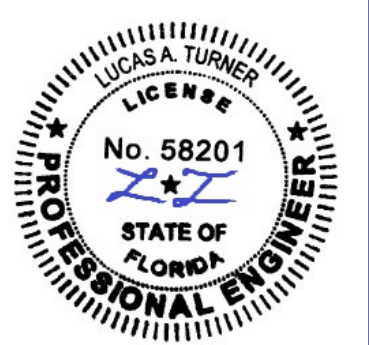


9/19/2023


LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering & Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574

SHEET DESCRIPTION:


DRAWN BY:	DATE:
MCS	9/5/2023
DWG #:	REV.:
CWS-811	F
SCALE:	SHEET
1:1	4 OF 7

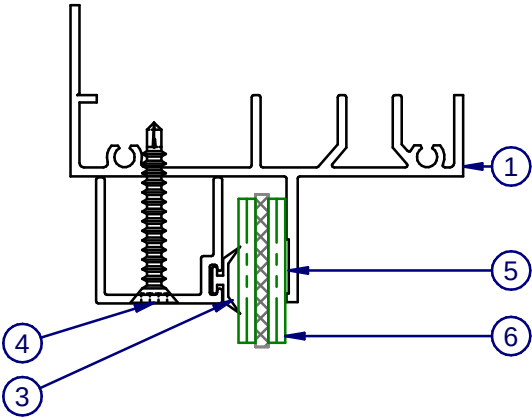


INTERIOR

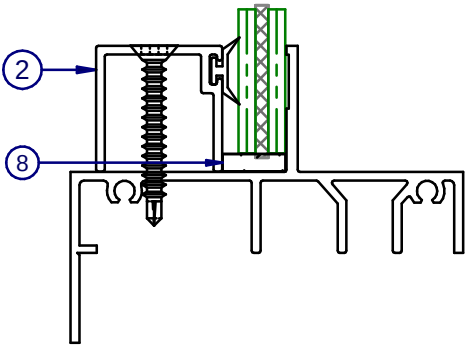


SECTION A-A

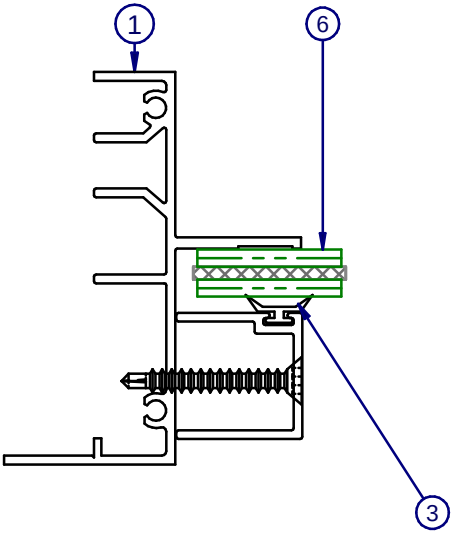

INTERIOR

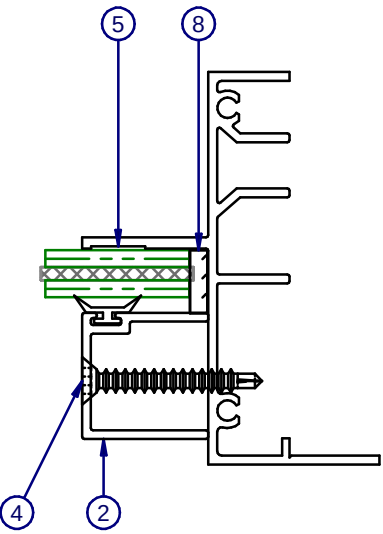

SECTION B-B





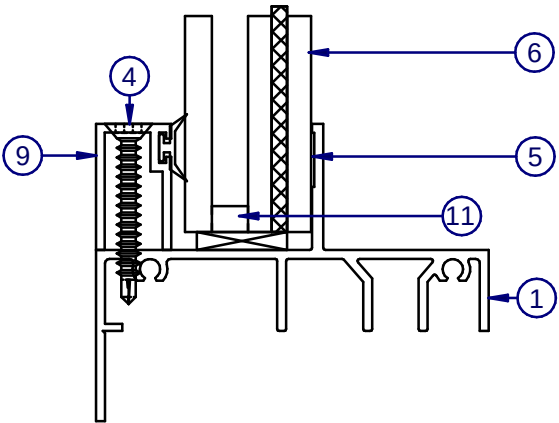


INTERIOR

ALTERNATE IGU GLAZING DETAIL

PARTS LIST			
ITEM	PART #	DESCRIPTION	MATERIAL
1	S-1943	Frame, all sides	Aluminum
2	S-1944	Glazebead	Aluminum
3	P-5317	WSTP .195 x .187 (Flex PVC / 80 Duro)	
4	P-4051	#8 x 1 1/4" Ph FLAT Type A TEK	Steel
5		SikaFlex 552 or Purfect Glaze"H"	
6	GLASS	SEE SHEET 2	
7	P-4144	#8 x 1" w/ 1/4" lead Quad Type A SMS	Steel
8	P-5637	Setting Block, 85 Dur. 1/8" x 3/8" x 2"	Rubber
9	S-1968	Glazebead, I.G.	Aluminum
10		Aluminum Rod, 1/8" Dia x 4"	Aluminum

NOTE: ALUMINUM PROFILES ARE 6063-T6 UNLESS OTHERWISE NOTED.

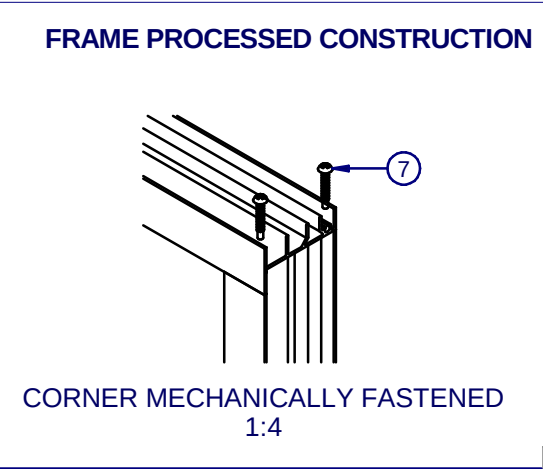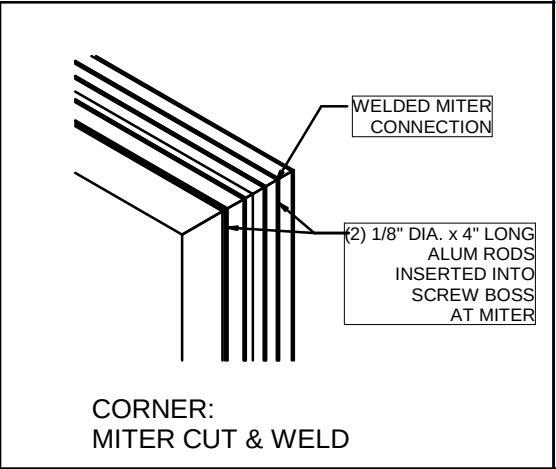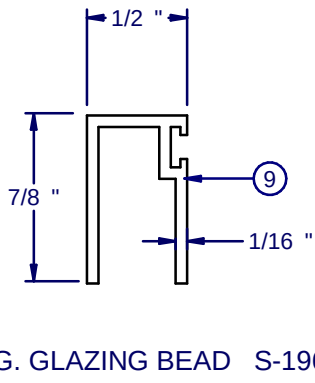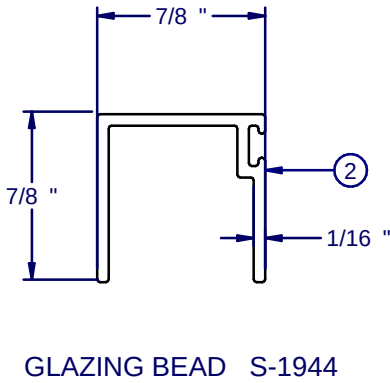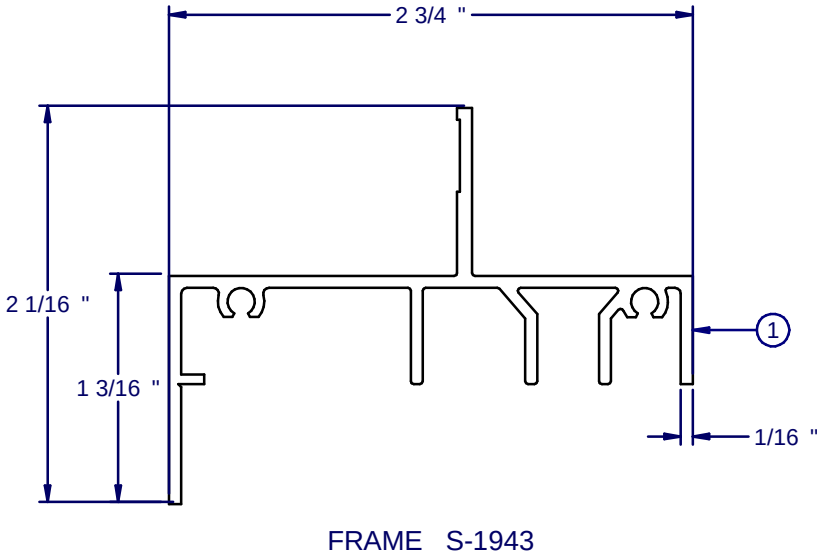



1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

3300 ALUM.
PICTURE WINDOW
IMPACT

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
15810




9/19/2023


LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering & Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574

SHEET DESCRIPTION:

DRAWN BY:	DATE:
MCS	9/5/2023
DWG #:	REV.:
CWS-811	F
SCALE:	SHEET
1:1	5 OF 7

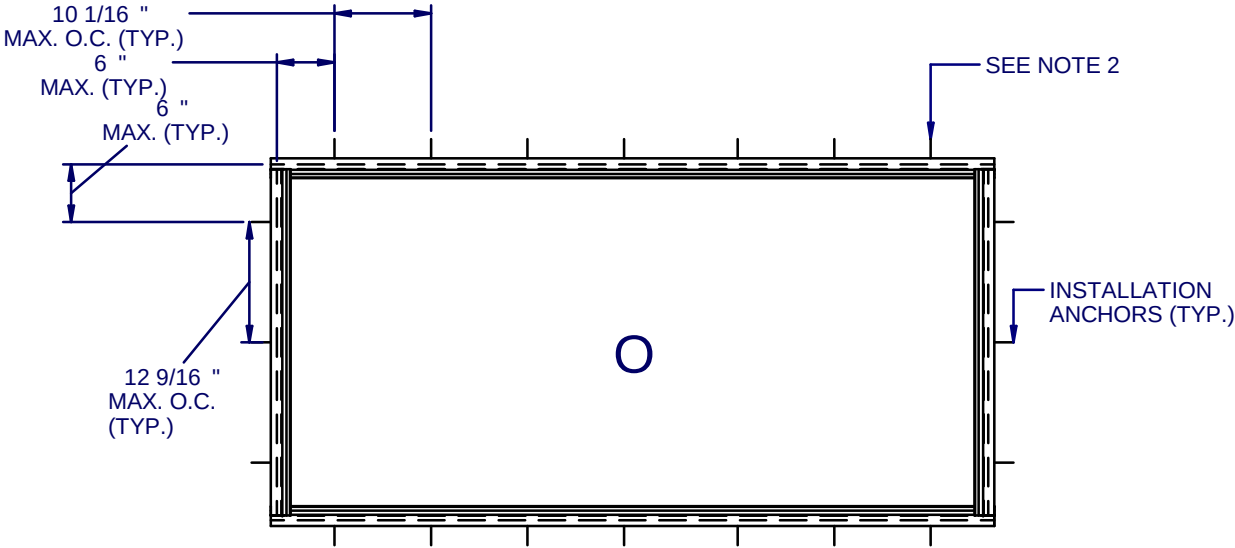

ANCHOR LAYOUT - (FLANGE)
FOR UNITS RATED ±80 PSF

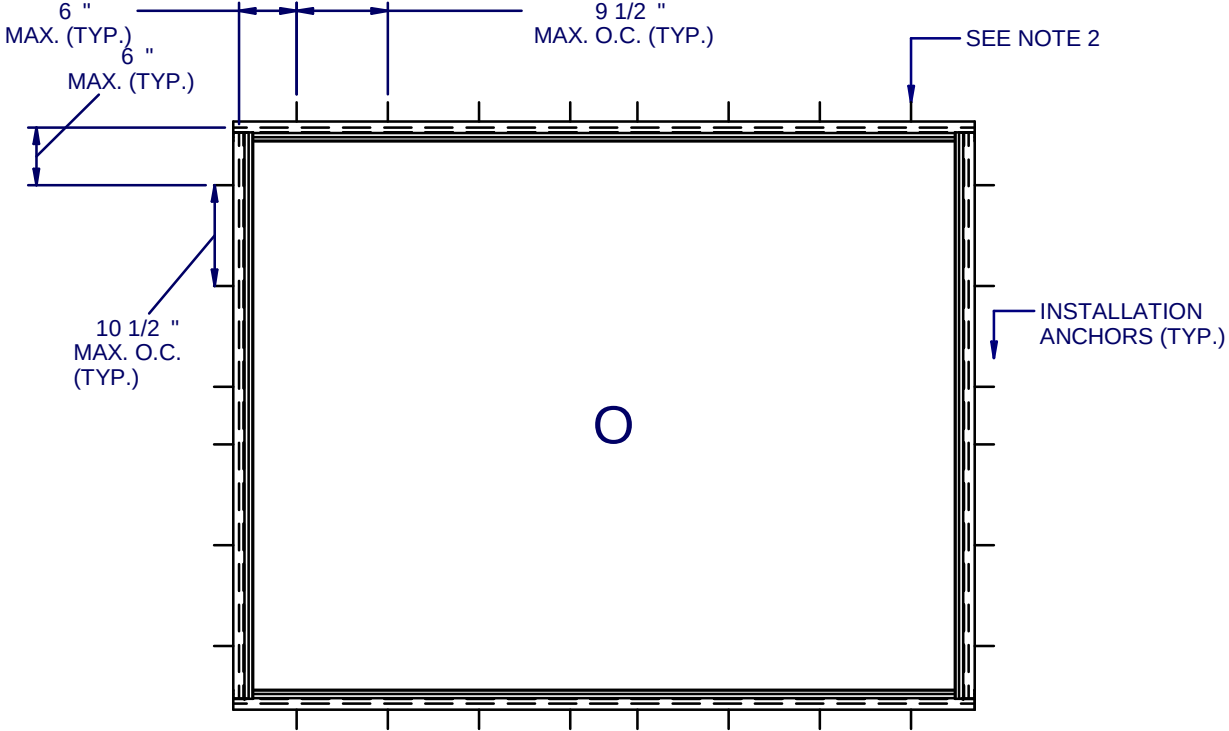

ANCHOR LAYOUT - (FLANGE)
FOR UNITS RATED ±65 PSF

NOTES:

1. INSTALL ONE ANCHOR AT EACH LOCATION. ANCHOR SPACING FOR FLANGE INSTALLATION APPLIES TO ALL SHAPES ALONG ALL FRAME EDGES. SILL ANCHOR SAME AS HEAD.
2. SHIM AS REQ AT EACH INSTALLATION ANCHOR USING LOAD BEARING SHIMS. MAX. ALLOWABLE SHIM STACK TO BE 1/4". USE SHIMS WHERE SPACE GREATER THAN 1/16" IS PRESENT. LOAD BEARING SHIMS SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER. WOOD SHIMS ARE NOT ALLOWED.
3. ANCHOR TYPE, SIZE, SPACING AND EMBEDMENT SHALL BE AS SPECIFIED IN THESE DRAWINGS, SEE TABLE 1, SHEET 7.
4. ALL INSTALLATION ANCHORS MUST BE MADE OF OR PROTECTED WITH A CORROSION RESISTANT MATERIAL OR COATING. DISSIMILAR METALS OR MATERIALS IN CONTACT WITH PRESSURE TREATED WOOD MUST BE PROTECTED TO PREVENT REACTION.
5. INSTALLATION ANCHORS SHALL BE IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM SPECIFIED IN TABLE 1, SHEET 7.
6. ANCHOR EMBEDMENT TO SUBSTRATE SHALL BE BEYOND WALL DRESSING OR STUCCO. FOR CONCRETE/CMU OPENINGS, EMBEDMENT SHALL BE BEYOND WOOD BUCKS, IF USED, INTO SUBSTRATE. INSTALLATIONS TO SOLID CONCRETE OR GROUT-FILLED CMU MAY INCLUDE BUT DO NOT REQUIRE 1X WOOD BUCKS BETWEEN THE PRODUCT AND THE SUBSTRATE. INSTALLATIONS TO HOLLOW CMU REQUIRE THE USE OF 1X BUCKS BETWEEN THE PRODUCT AND SUBSTRATE.
7. A MINIMUM CENTER-TO-CENTER SPACING SHALL BE MAINTAINED BETWEEN ALL FASTENERS: 3-9/16" FOR MASONRY, 1" FOR WOOD AND METAL.
8. WOOD OR MASONRY OPENINGS, BUCKS AND BUCK FASTENERS SHALL BE PROPERLY DESIGNED BY THE ARCHITECT OR ENGINEER OF RECORD AND INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE. SUBSTRATES SHALL MEET THE MINIMUM STRENGTH REQUIREMENTS AS SHOWN IN TABLE1, SHEET 7. CONCRETE AND MASONRY SUBSTRATES MAY NOT BE CRACKED.
9. SEALING AND FLASHING STRATEGIES FOR OVERALL WATER RESISTANCE OF INSTALLATION SHALL BE DONE BY OTHERS FOLLOWING THE CURRENT VERSION OF THE REFERENCE DOCUMENTS:
FMA/AAMA 100(FIN WINDOWS), FMA/AAMA 200(FLANGE WINDOWS), FMA/WDMA 250(BOX WINDOWS), FMA/AAMA/WDMA 300(EXTERIOR DOORS)

**3300 ALUM.
PICTURE WINDOW
IMPACT**

PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN
THIS DRAWING IS THE SOLE
PROPERTY OF CUSTOM WINDOW
SYSTEMS, INC. ANY
REPRODUCTION IN PART OR AS A
WHOLE WITHOUT THE WRITTEN
PERMISSION OF CUSTOM WINDOW
SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
15810



9/19/2023

LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering &
Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574

SHEET DESCRIPTION:

DRAWN BY:	DATE:
MCS	9/5/2023
DWG #:	REV.:
CWS-811	F
SCALE:	SHEET
1:20	6 OF 7


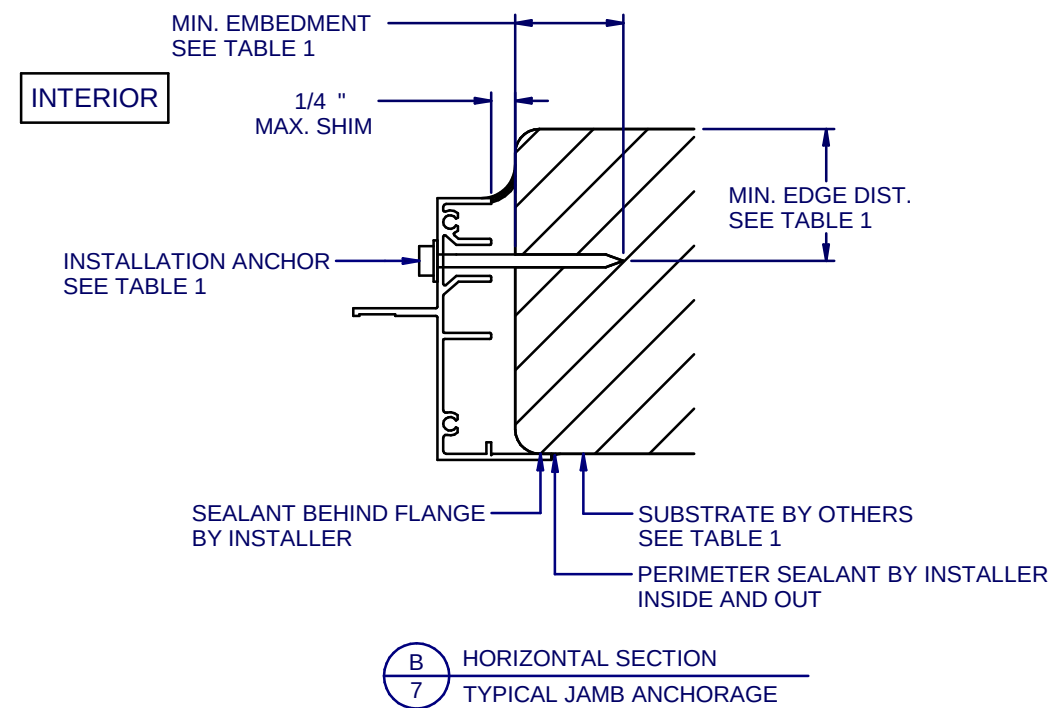


TABLE 1: APPROVED INSTALLATION FASTENERS			
SUBSTRATE TYPE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DIST.
CONCRETE (2.0 KSI MIN.)	3/16" ITW TAPCON	1-1/2"	1-1/4"
HOLLOW OR GROUT-FILLED CMU (117 PCF MIN.)	3/16" ITW TAPCON	1"	2"
CONCRETE (3.05 KSI MIN.)	3/16" DEWALT ULTRACON+	1-3/4"	1"
HOLLOW OR GROUT-FILLED CMU (ASTM C-90)	3/16" DEWALT ULTRACON+	1-3/4"	2-1/2"
2X MIN. SOUTHERN PINE (G=0.55)	3/16" ITW TAPCON OR DEWALT ULTRACON+	1-3/8"	7/8"
2X MIN. SOUTHERN PINE (G=0.55)	#10 WOOD SCREW	1-3/8"	7/8"
16 GAUGE (0.060") MIN. STEEL STUD (33 KSI YIELD MIN)	#10-16 HILTI KWIK-FLEX OR ITW TEKS SELF-DRILLING SCREW	FULL THREAD THRU 0.060"	7/16"
1/8" ALUM. (6063-T5 MIN.) OR 1/8" STEEL (33 KSI MIN.)	#10 GRADE 5 SELF-TAPPING / DRILLING SCREW	FULL THREAD THRU 0.125"	7/16"

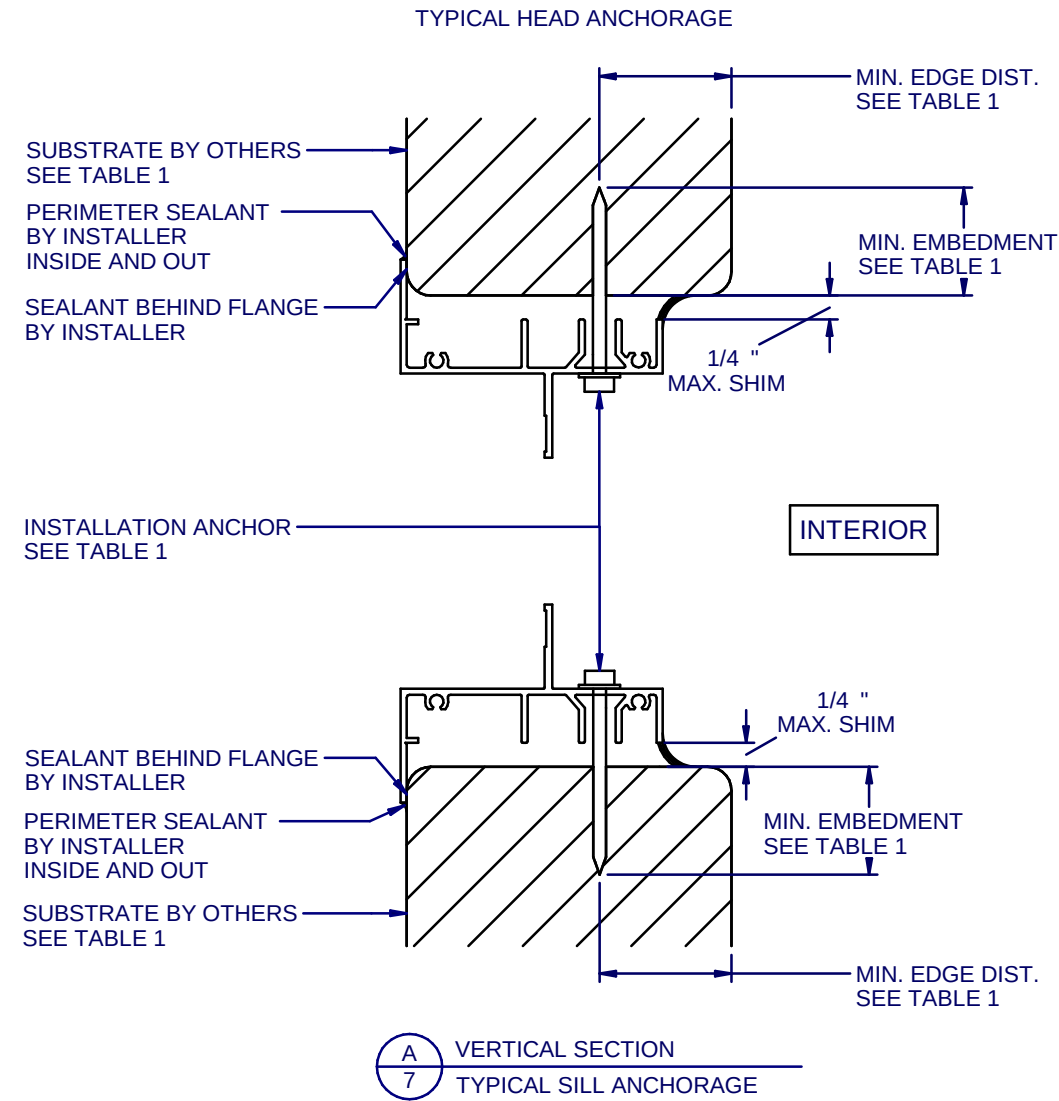

1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC


3300 ALUM. PICTURE WINDOW IMPACT

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN
THIS DRAWING IS THE SOLE
PROPERTY OF CUSTOM WINDOW
SYSTEMS, INC. ANY
REPRODUCTION IN PART OR AS A
WHOLE WITHOUT THE WRITTEN
PERMISSION OF CUSTOM WINDOW
SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:

15810

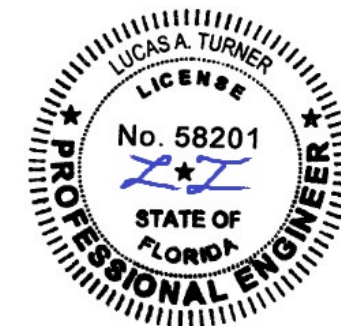

9/19/2023

LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering &
Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574

SHEET DESCRIPTION:

DRAWN BY:

MCS

DATE:

9/5/2023

DWG #:

CWS-811

REV.:

F

SCALE:

1:2

SHEET

7 OF 7