



SUNDOR 5000 SLIDING GLASS DOOR "LARGE MISSILE IMPACT"

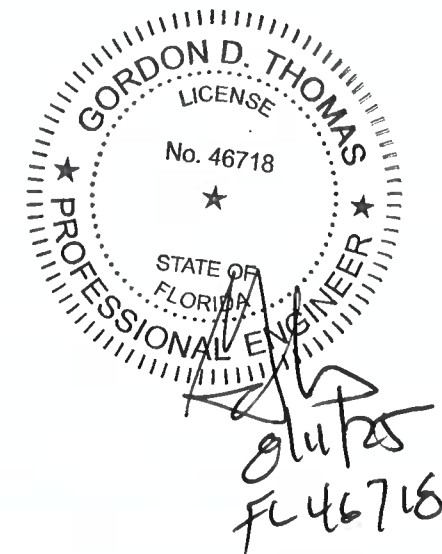
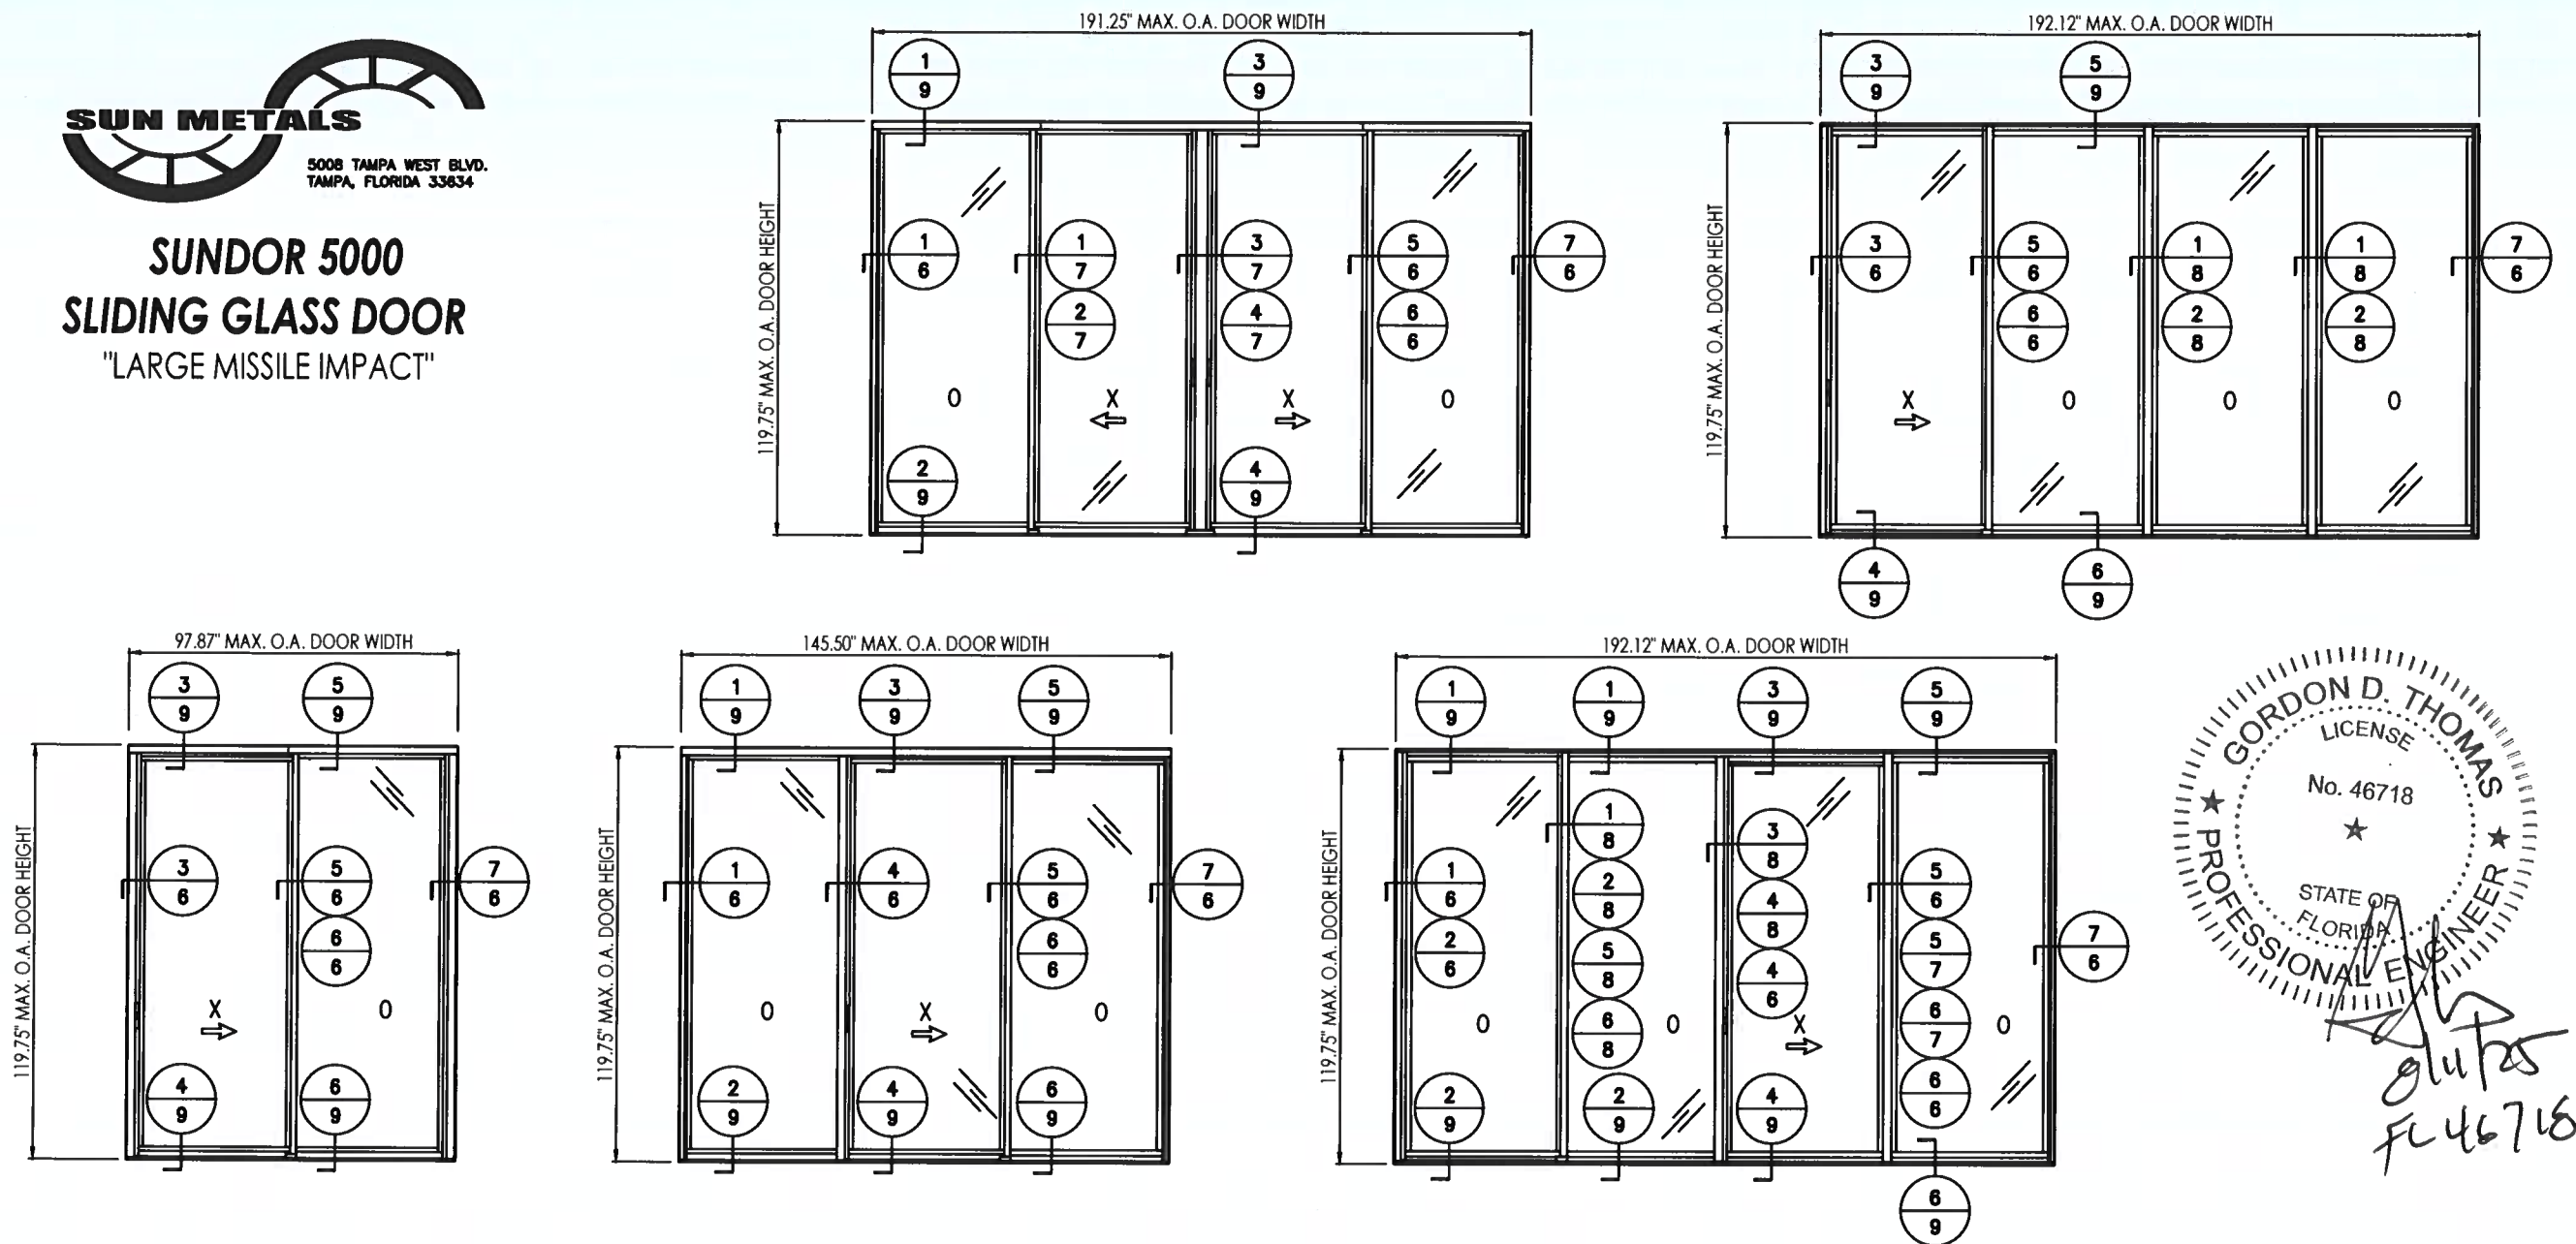


TABLE OF CONTENTES	
SHEET #	DESCRIPTION
1	Typical elevations, design pressures and general notes
2	Door panel details
3	Door panel details
4	Sidelite panel details
5	Corner details
6	Horizontal cross sections
7	Horizontal cross sections
8	Horizontal cross sections
9	Vertical cross sections
10	Anchoring (Max. DP<= 75 PSF)
11	Anchoring (Max. DP<= 135 PSF)
12	Components
13	Bill of materials & Components

MAX. SIZE	REINFORCED	GLASS TYPE	DESIGN PRESSURE (PSF)	
			POSITIVE	NEGATIVE
192.12"	YES	G3, G4	+ 100.0	- 100.0
X				
119.75"	NO	G1, G2	+ 70.0	- 75.0
X				
192.12"	NO	G1, G2	+ 70.0	- 75.0
X				
119.75"	NO	G3, G4	+ 115.0	- 135.0
X				
95.75"	NO	G1, G2	+ 115.0	- 135.0
X				
80.25"	NO	G5, G6	+ 60.0	- 65.0
X				
95.75"	NO	G5, G6	+ 60.0	- 65.0
X				

GENERAL NOTES:

- This product has been evaluated and is in compliance with the 8th Edition (2023) Florida Building Code structural requirements including the "High Velocity Hurricane Zone" (HVHZ).
- Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
- When used in "HVHZ" this product complies with Section 1626 of the Florida Building Code and does not require an impact resistant covering.
- When used in areas outside of the "HVHZ" requiring wind borne debris protection this product complies with Section 1609.1.2 of the 2023 FBC and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E1996.
- Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.
- This product meets water infiltration requirements for "HVHZ".
- Gaskets and setting blocks shall comply with Section 2411.3.4 of the FBC.
- Aluminum components, including fasteners; shall meet the requirements of FBC Section 2003.

5008 TAMPA WEST BLVD.
TAMPA, FLORIDA 33634
PHONE: (813) 889-0718
FAX: (813) 886-0666

PRODUCT: SLIDING GLASS DOOR

PART OR ASSEMBLY: TYPICAL ELEVATIONS, DESIGN PRESSURES & GENERAL NOTES

NO	DATE	DESCRIPTION	BY
5	7/14/25	UPDATE TO 8TH ED. (2023) FBC	ECV
4	9/21/20	UPDATE TO 7TH ED. (2020) FBC	JCB
3	8/09/19	UPDATE TO 6TH ED. (2017) FBC	ECV
2	4/09/17	REVISE PER COMMENTS	ECV
1	3/14/17	UPDATE TO 5TH ED. (2014) FBC	LFS

DATE: 03/14/17












SCALE: NTS

DWG. BY: CO

CHK BY: ECV

DRAWING NO.: FL-15903.1

SHEET: 1 OF 13

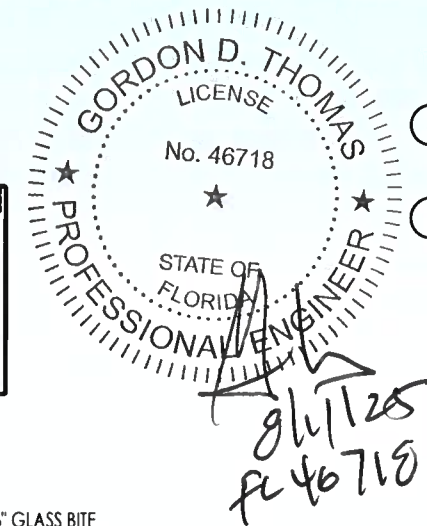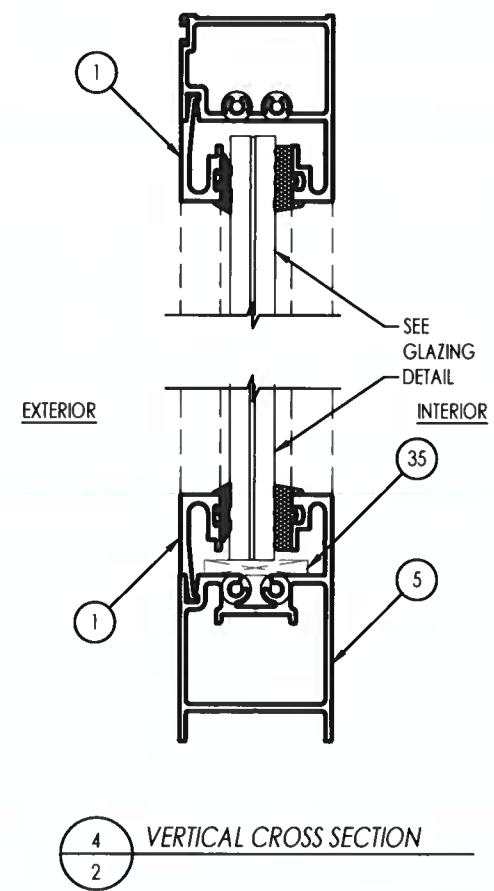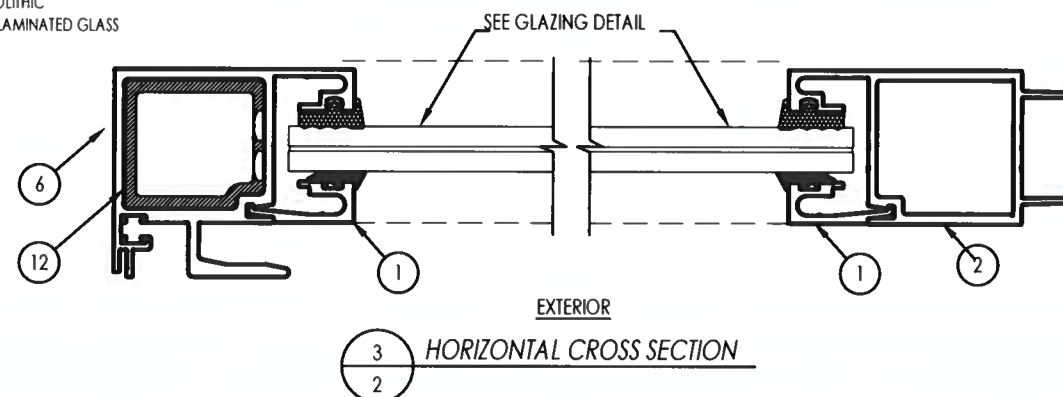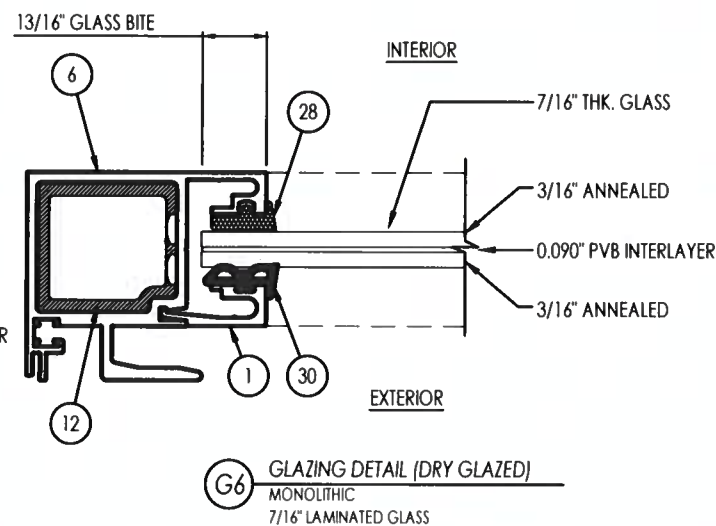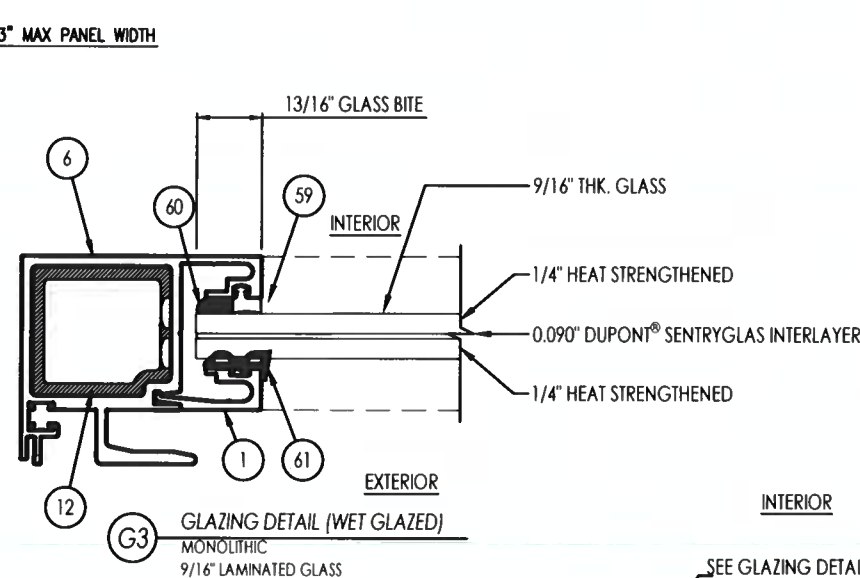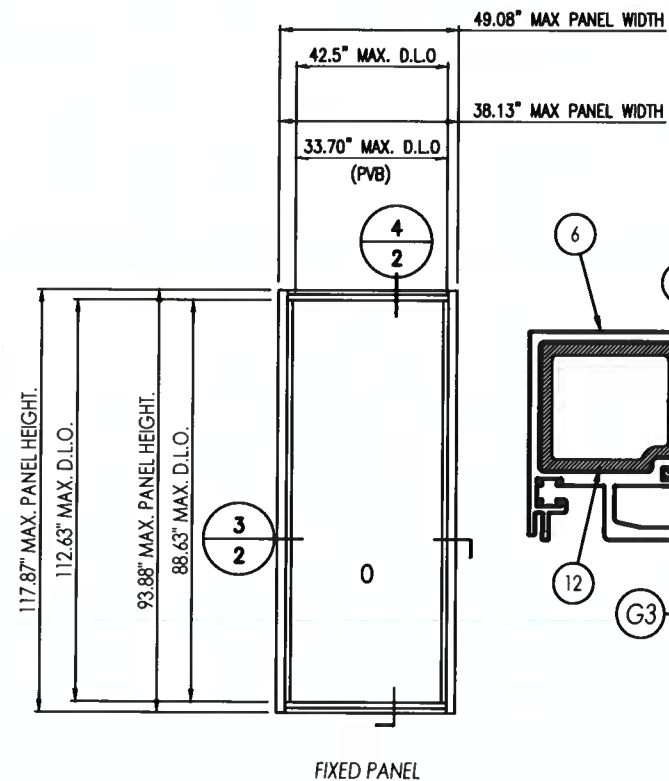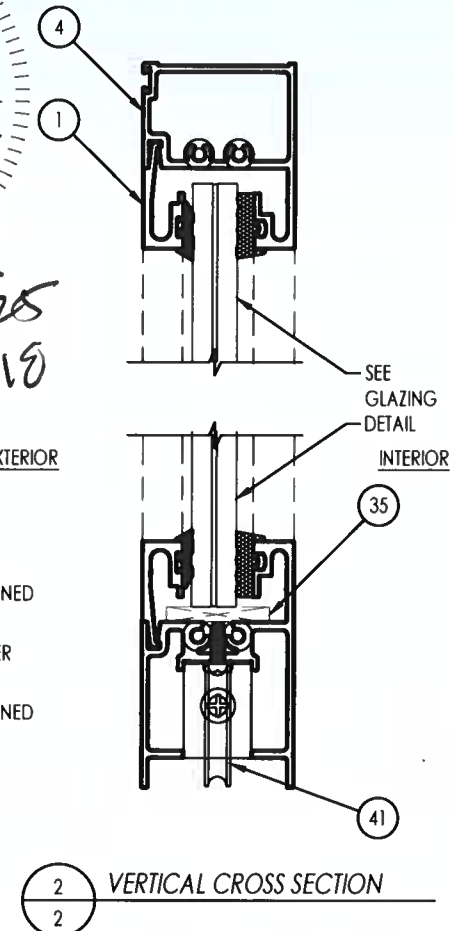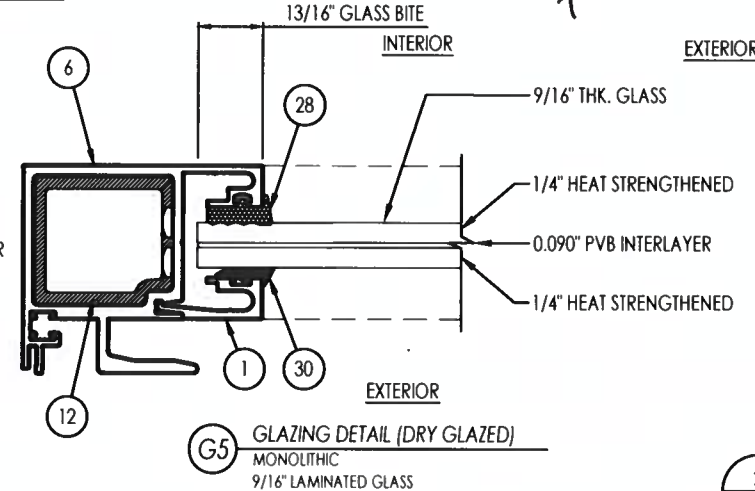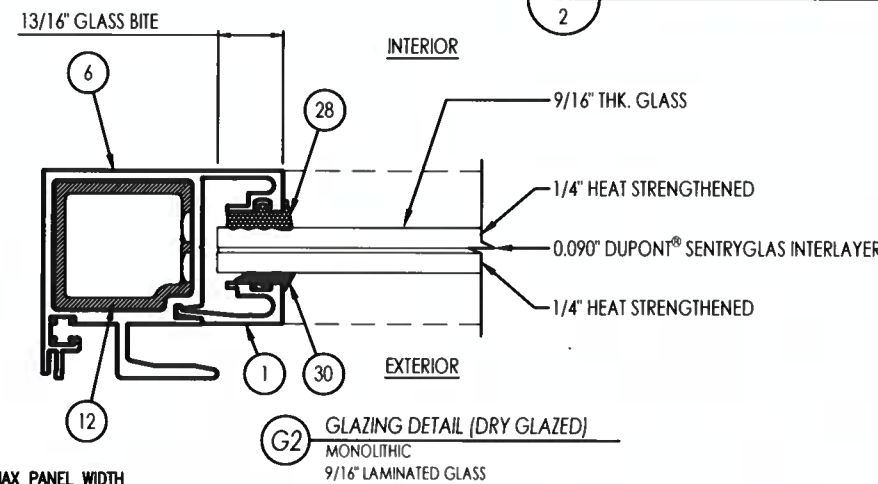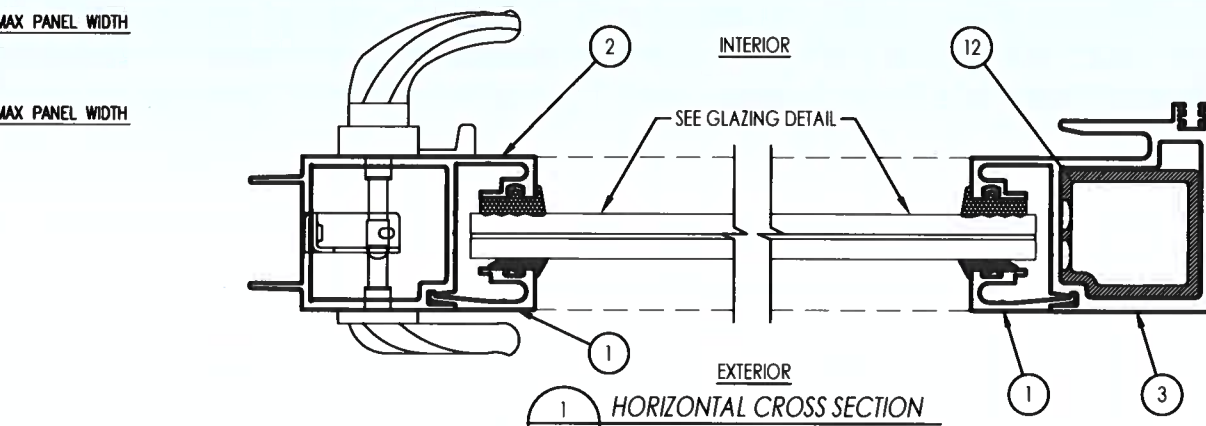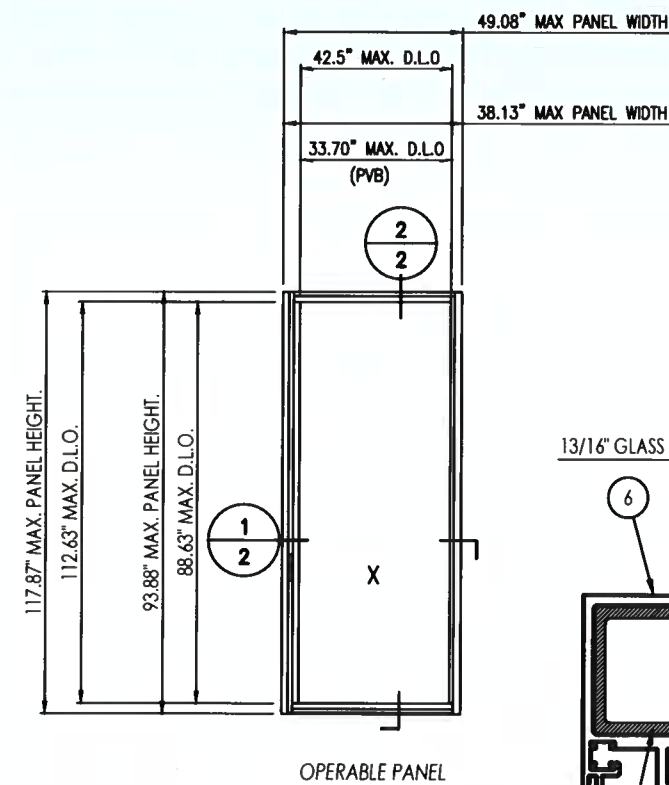

5008 TAMPA WEST BLVD.
TAMPA, FLORIDA 33634
PHONE: (813) 889-0718
FAX: (813) 886-0666



PRODUCT: SLIDING GLASS DOOR

PART OR ASSEMBLY: DOOR PANEL DETAILS

NO	DATE	DESCRIPTION	BY
1	3/14/17	UPDATE TO 5TH ED. (2014) FBC	LFS
2	4/09/17	REVISE PER COMMENTS	ECV
3	8/09/19	UPDATE TO 6TH ED. (2017) FBC	ECV
4	9/21/20	UPDATE TO 7TH ED. (2020) FBC	JCB
5	7/14/25	UPDATE TO 8TH ED. (2023) FBC	ECV

DATE: 3/14/17




SCALE: NTS

DWG. BY: CO


CHK BY: ECV

DRAWING NO.: FL-15903.1


SHEET: 2 OF 13

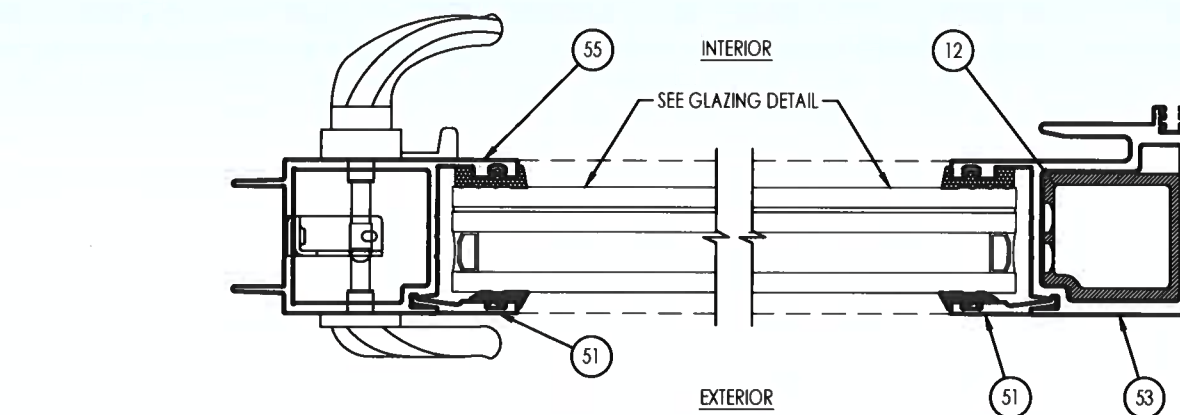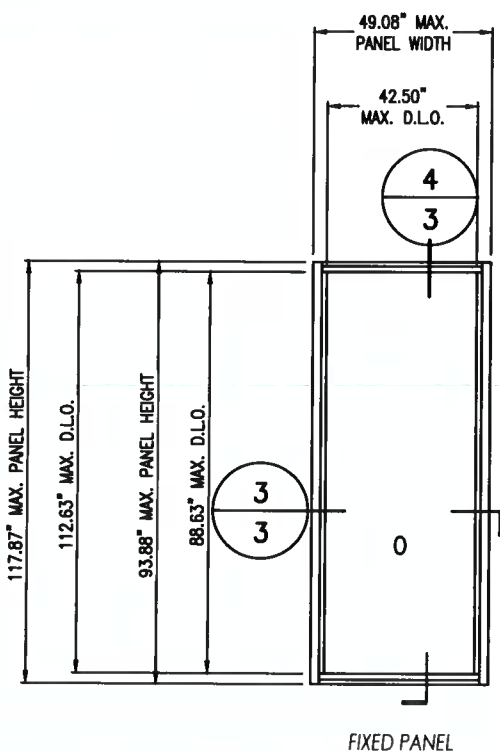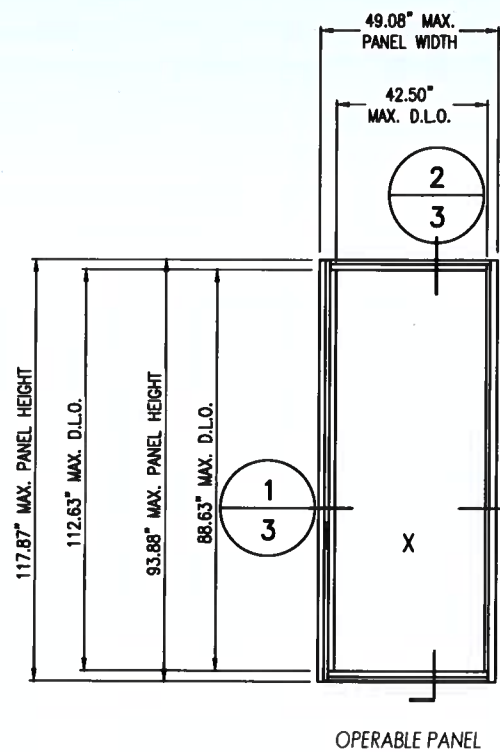


1
3 HORIZONTAL CROSS SECTION

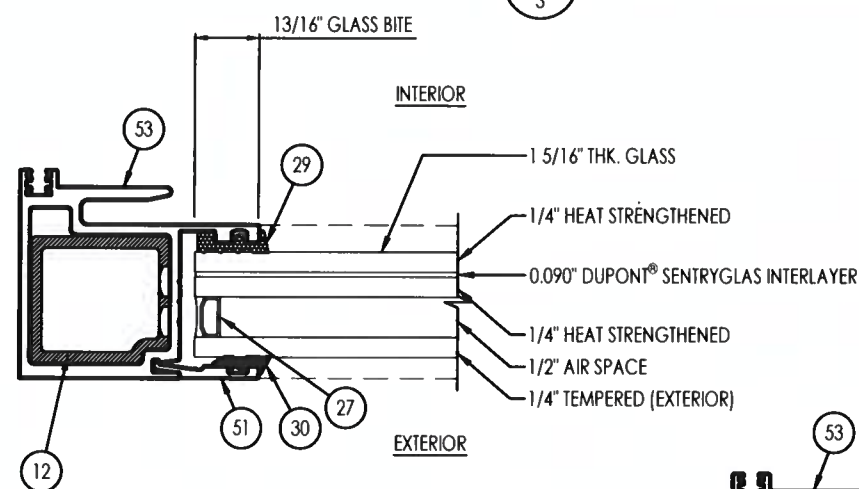


G1 GLAZING DETAIL (DRY GLAZED)
1 5/16\"/>

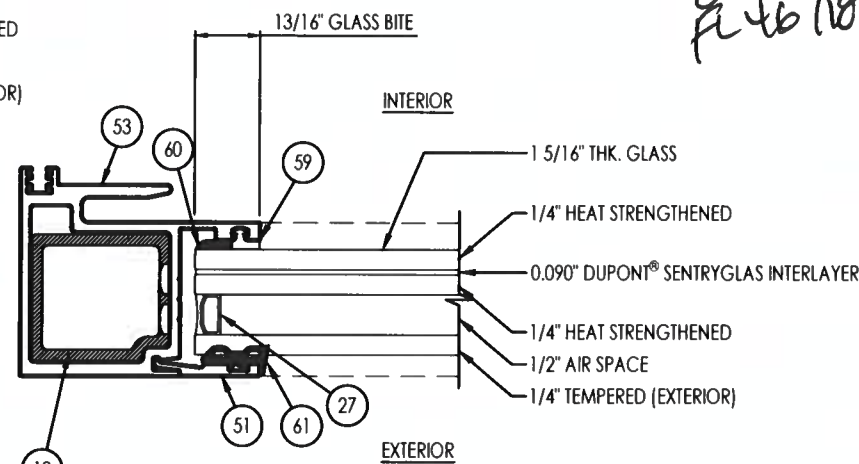


G4 GLAZING DETAIL (WET GLAZED)
1 5/16\"/>

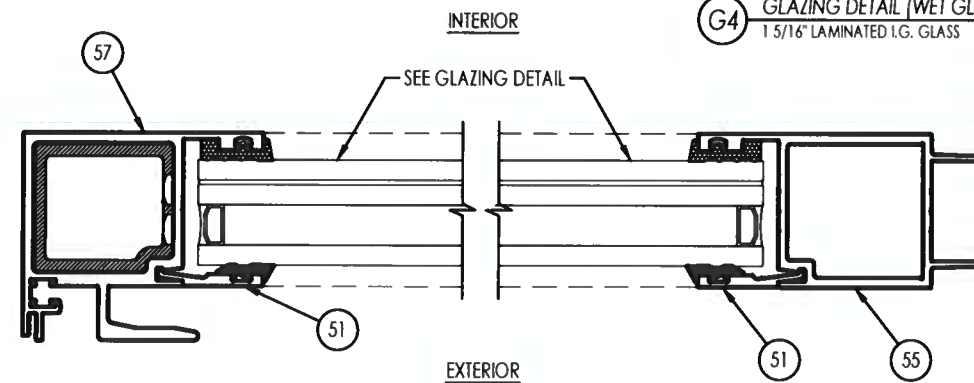


3
3 HORIZONTAL CROSS SECTION

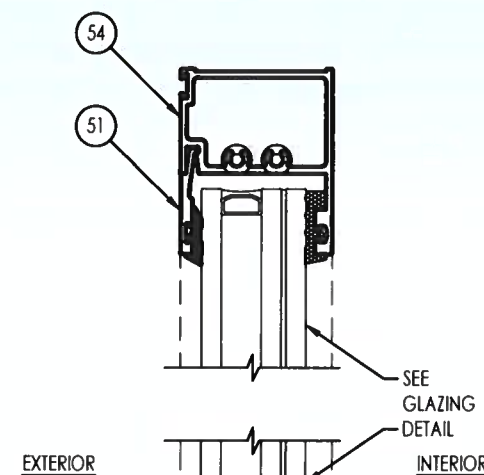

2
3 VERTICAL CROSS SECTION

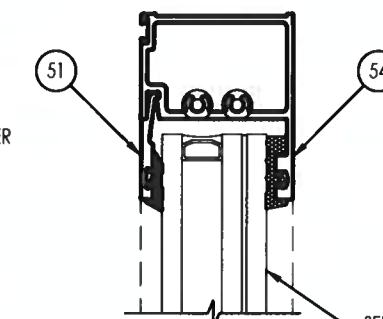

4
3 VERTICAL CROSS SECTION

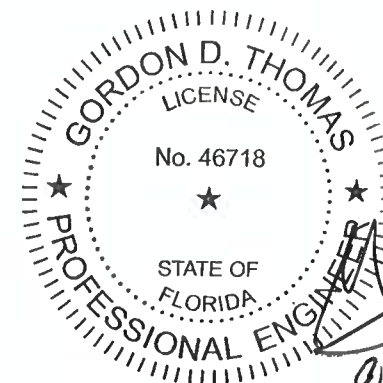

5008 TAMPA WEST BLVD.
TAMPA, FLORIDA 33634
PHONE: (813) 889-0718
FAX: (813) 886-0666



PRODUCT: SLIDING GLASS DOOR

PART OR ASSEMBLY: DOOR PANEL DETAILS

NO	DATE	DESCRIPTION	BY
5	7/14/25	UPDATE TO 8TH ED. (2023) FBC ECV	JCB
4	9/21/20	UPDATE TO 7TH ED. (2020) FBC ECV	JCB
3	8/09/19	UPDATE TO 6TH ED. (2017) FBC ECV	JCB
2	4/09/17	REVISE PER COMMENTS ECV	JCB
1	3/14/17	UPDATE TO 5TH ED. (2014) FBC LFS	JCB
REVISIONS			

DATE: 3/14/17

SCALE: NTS



DWG. BY: CO

CHK BY: ECV

DRAWING NO.:
FL-15903.1

SHEET: 3 OF 13

<u>PRODUCT:</u>		SLIDING GLASS DOOR		<u>PART OR ASSEMBLY:</u>	
				SIDELITE PANEL DETAILS	
	5	7/14/25	UPDATE TO 8TH ED. (2023)	FBC	ECV
	4	9/21/20	UPDATE TO 7TH ED. (2020)	FBC	JCB
	3	8/09/19	UPDATE TO 6TH ED. (2017)	FBC	ECV
	2	4/09/17	REVISE PER COMMENTS		ECV
	1	3/14/17	UPDATE TO 5TH ED. (2014)	FBC	LFS
	NO	DATE	DESCRIPTION	BY	
REVISIONS					
DATE: 3/14/17					
SCALE: NTS					
DWG. BY: CO					
CHK BY: ECV					
DRAWING NO.:					
FL-15903.1					
SHEET: 4 OF 13					

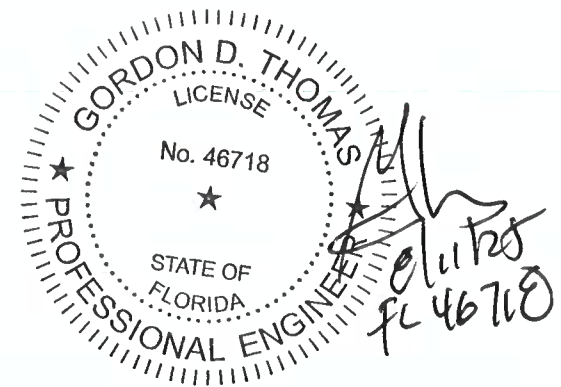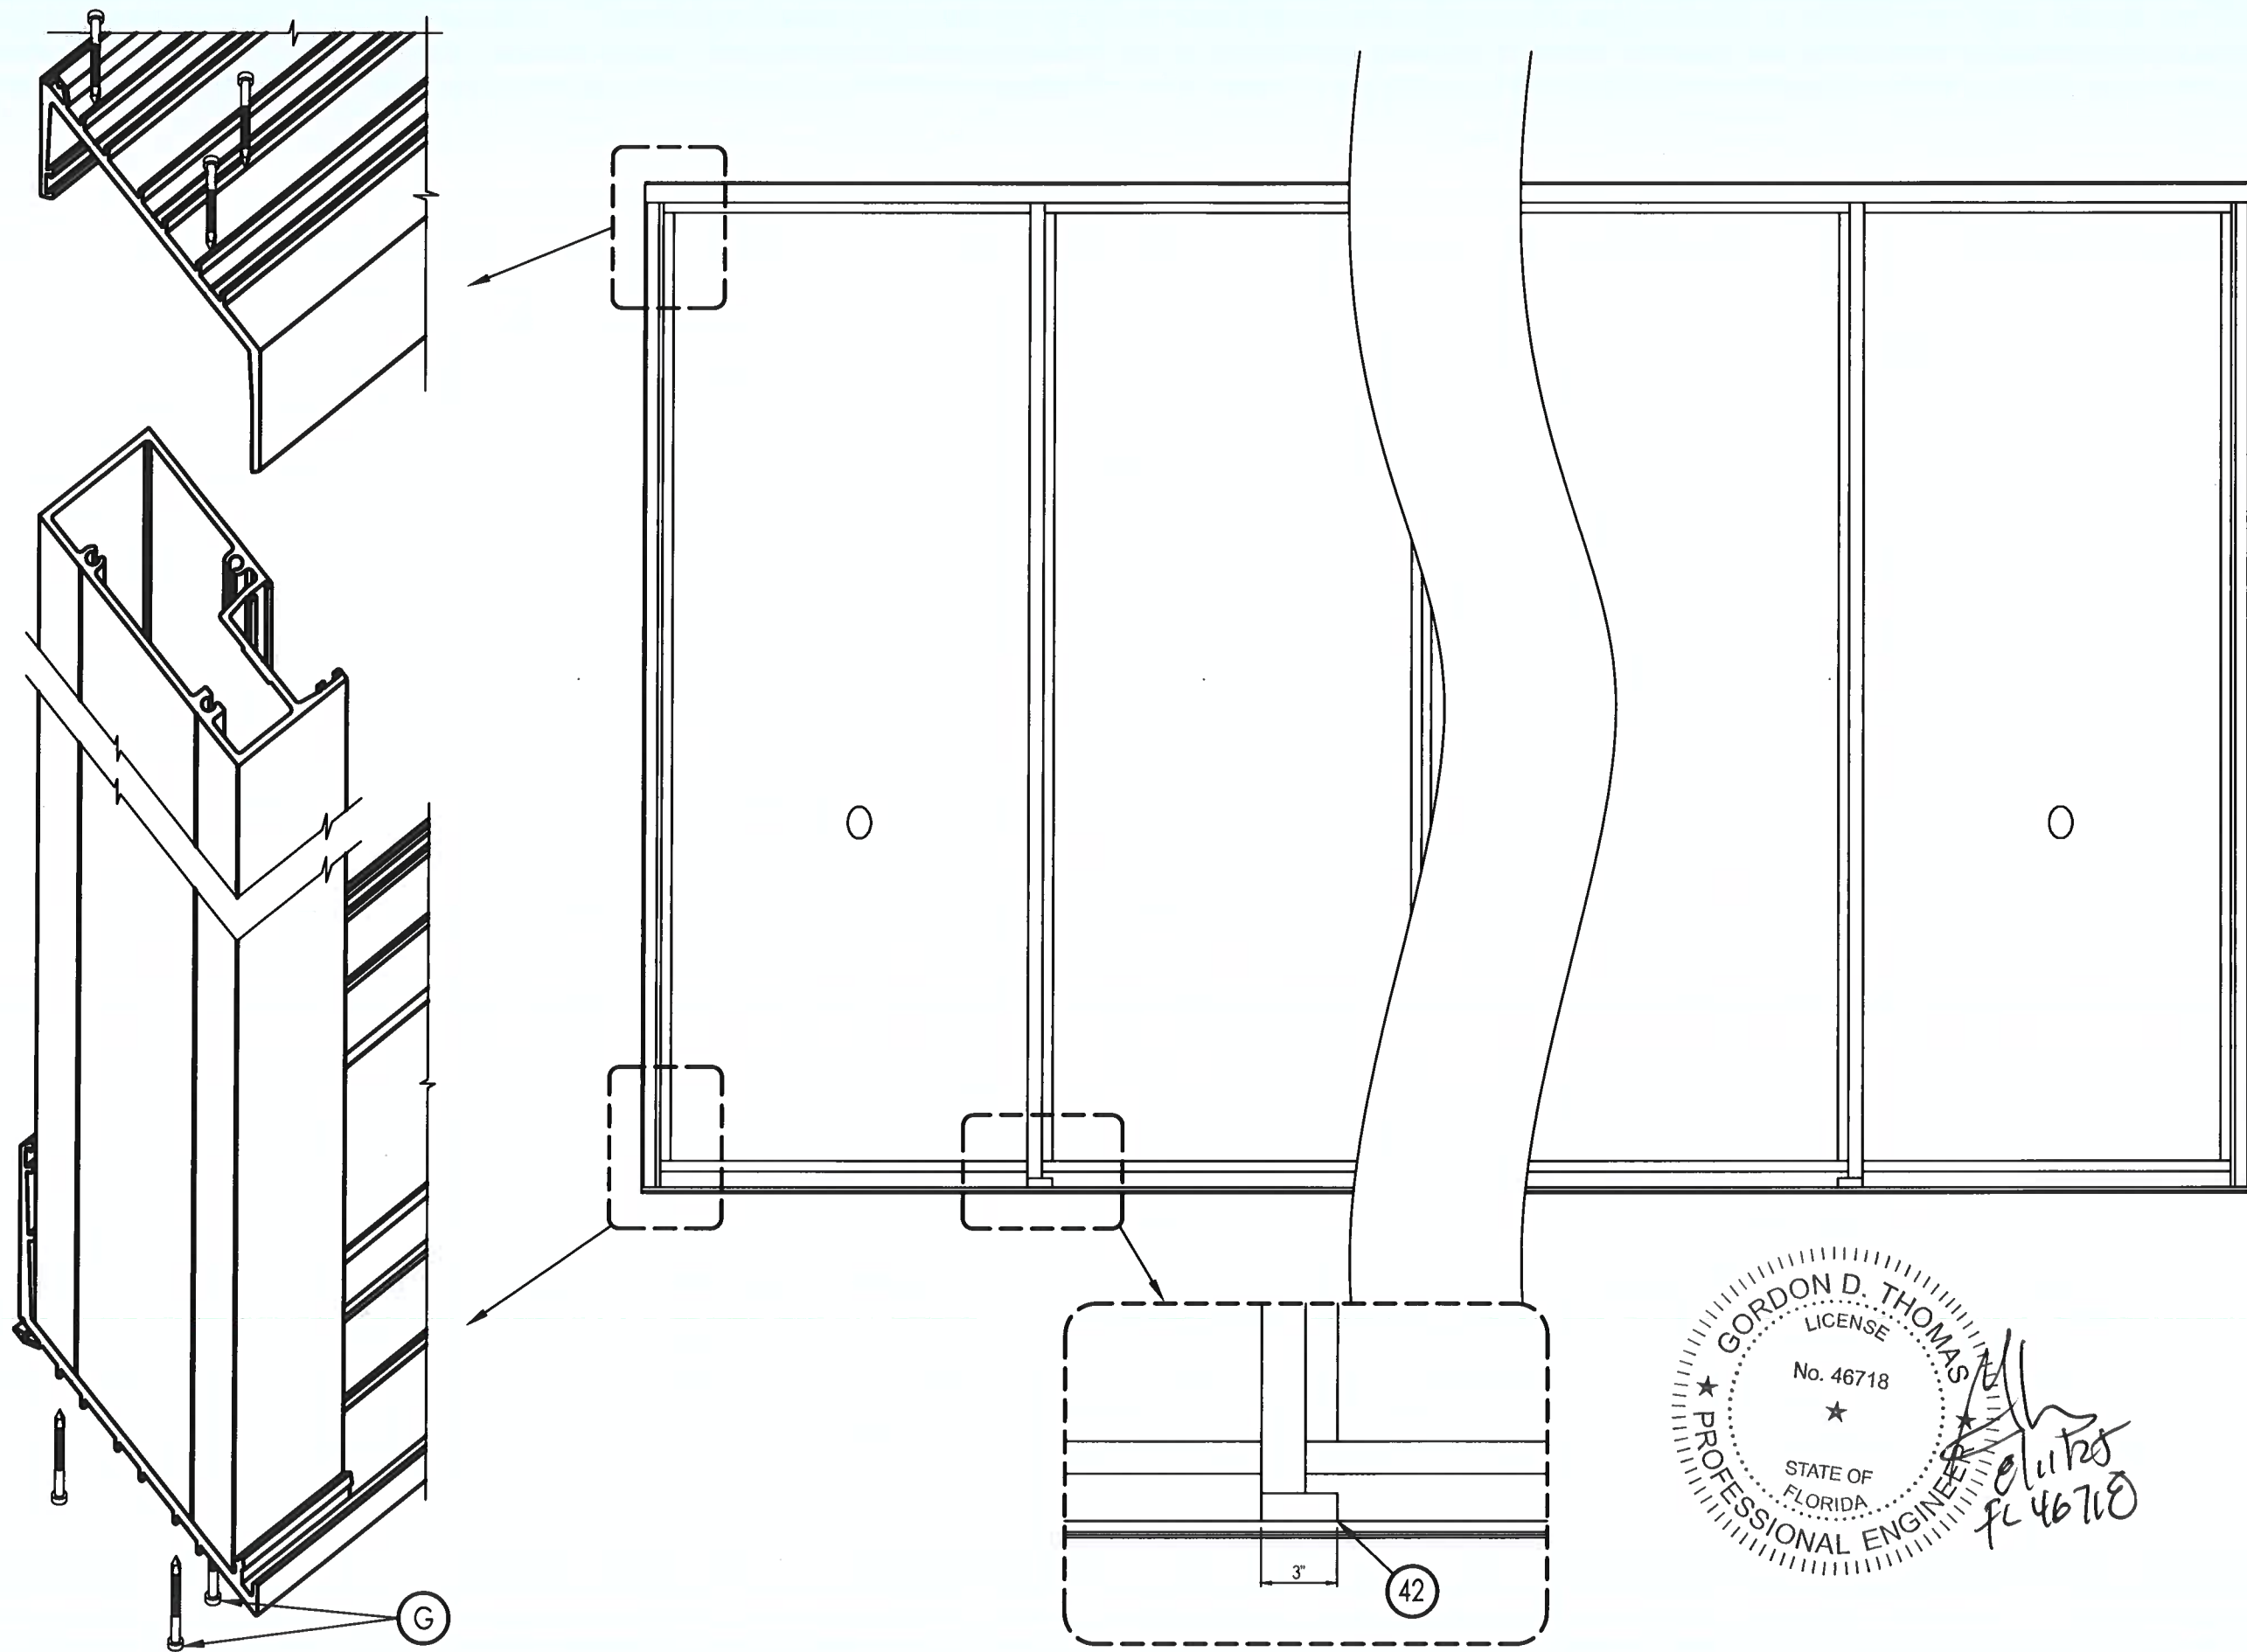


NO	DATE	DESCRIPTION	BY
5	7/14/25	UPDATE TO 8TH ED. (2023) FBC	ECV
4	9/21/20	UPDATE TO 7TH ED. (2020) FBC	JCB
3	8/09/19	UPDATE TO 6TH ED. (2017) FBC	ECV
2	4/09/17	REVISE PER COMMENTS	ECV
1	3/14/17	UPDATE TO 5TH ED. (2014) FBC	LFS


DATE: 3/14/17
 SCALE: NTS
 DWG. BY: CO
 CHK BY: ECV
 DRAWING NO.: FL-15903.1
 SHEET: 5 OF 13

PRODUCT: SLIDING GLASS DOOR
 PART OR ASSEMBLY: CORNER DETAILS


SUN METALS
 5008 TAMPA WEST BLVD.
 TAMPA, FLORIDA 33634
 PHONE: (813) 889-0718
 FAX: (813) 886-0666

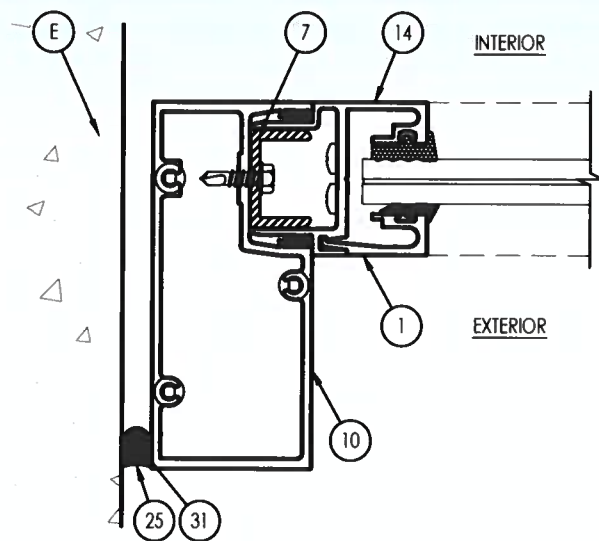


1 HORIZONTAL CROSS SECTION
6 Panel at interior track fixed

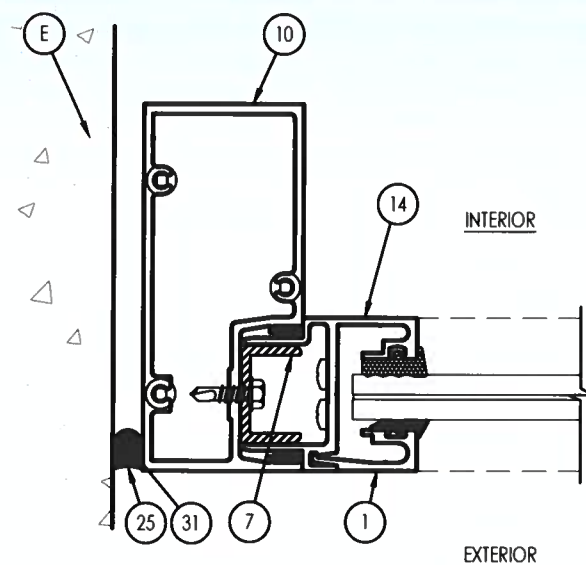



2 HORIZONTAL CROSS SECTION
6 Panel at exterior track fixed

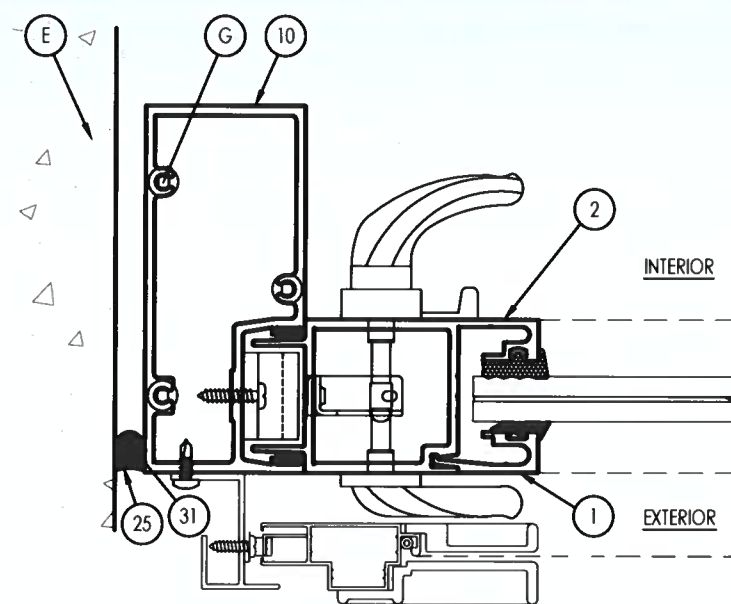


3 HORIZONTAL CROSS SECTION
6

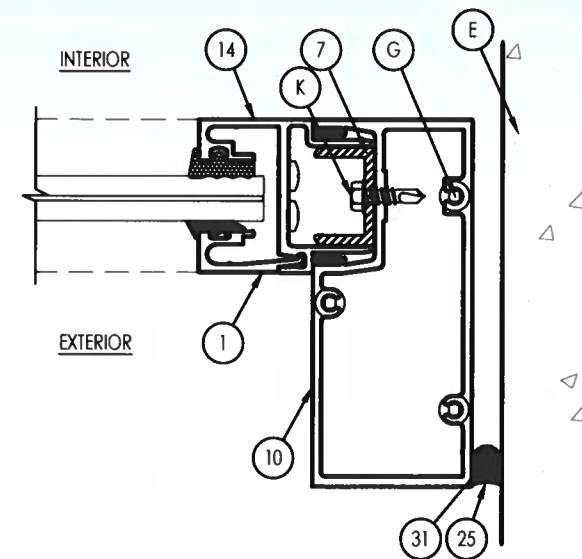


7 HORIZONTAL CROSS SECTION
6

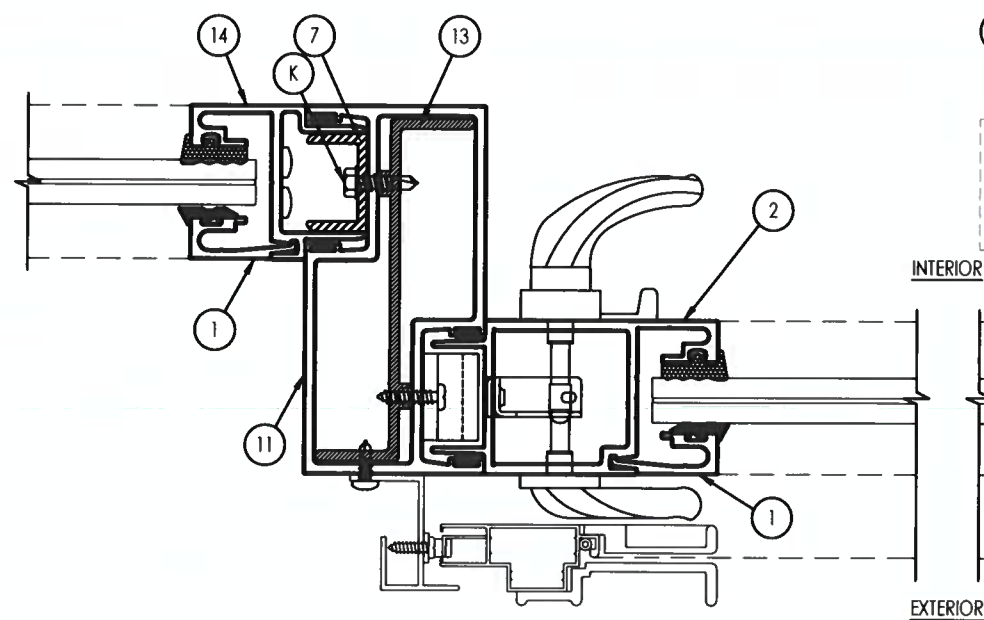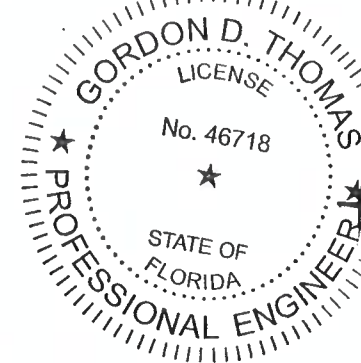

4 HORIZONTAL CROSS SECTION
6 OXO Adapter requires
OXO Reinforcement

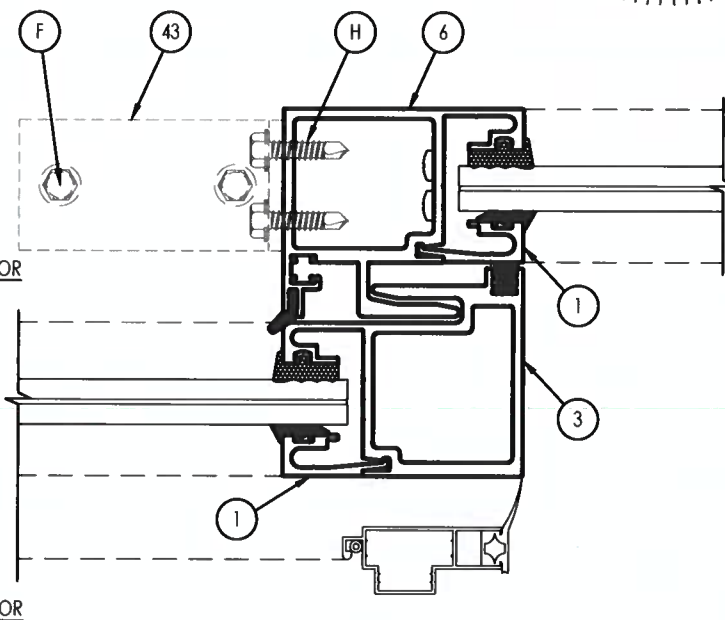


5 HORIZONTAL CROSS SECTION
6 Without Reinforcement

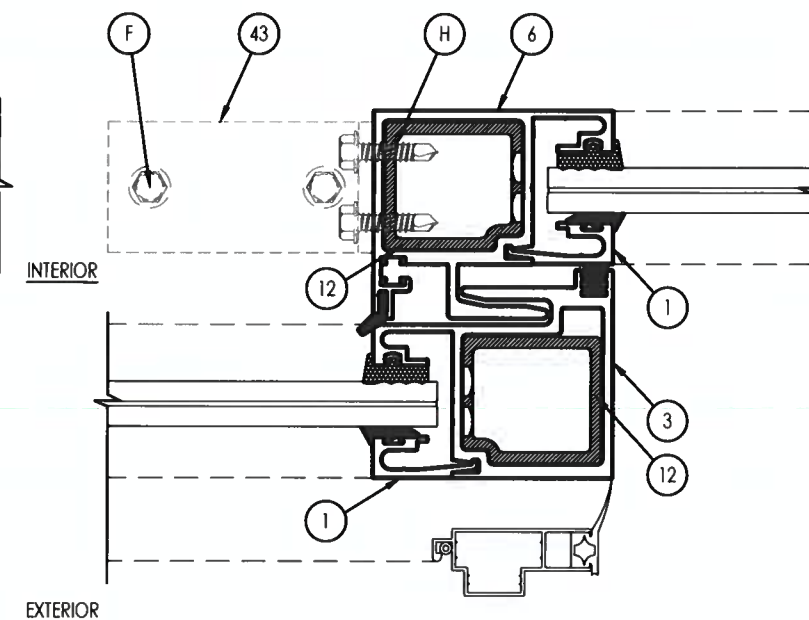


6 HORIZONTAL CROSS SECTION
6 With Reinforcement


5008 TAMPA WEST BLVD.
TAMPA, FLORIDA 33634
PHONE: (813) 889-0718
FAX: (813) 886-0666

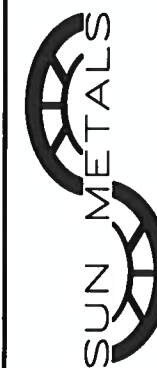


PRODUCT:		SLIDING GLASS DOOR	
PART OR ASSEMBLY:		HORIZONTAL CROSS SECTIONS	
NO	DATE	DESCRIPTION	BY
5	7/14/25	UPDATE TO 8TH ED. (2023) FBC	ECV
4	9/21/20	UPDATE TO 7TH ED. (2020) FBC	JOE
3	8/09/19	UPDATE TO 6TH ED. (2017) FBC	ECV
2	4/09/17	REVISE PER COMMENTS	ECV
1	3/14/17	UPDATE TO 5TH ED. (2014) FBC	LFS
REVISIONS			
DATE: 3/14/17			
SCALE: NTS			
DWG. BY: CO			
CHK BY: ECV			
DRAWING NO.: FL-15903.1			
SHEET: 6 OF 13			

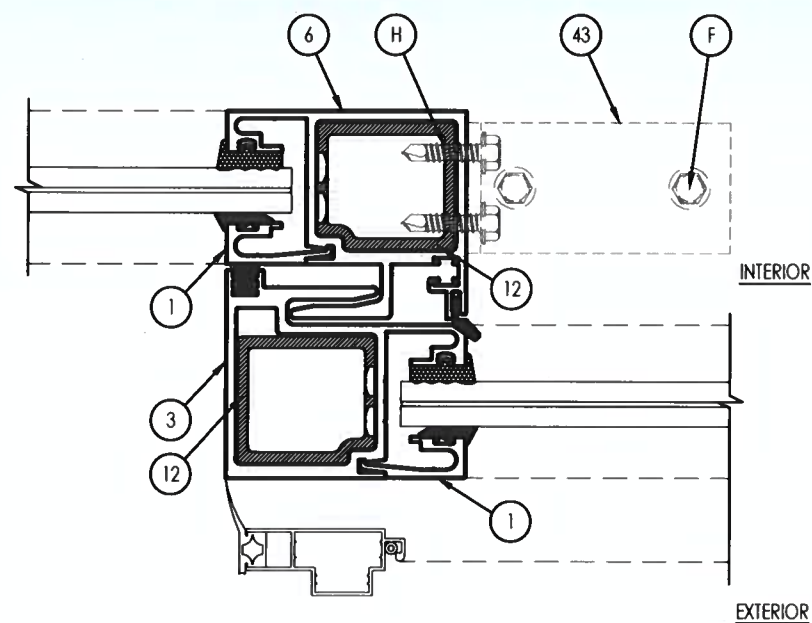


1 HORIZONTAL CROSS SECTION
7 With Reinforcement

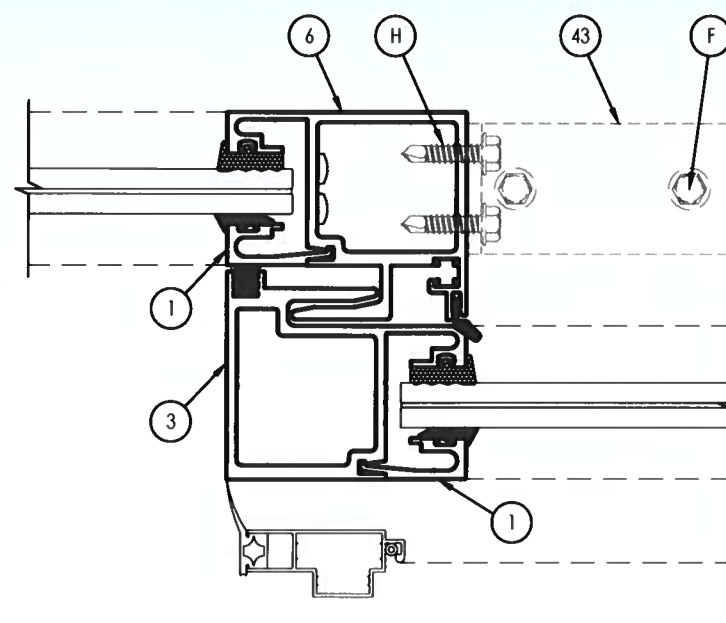


2 HORIZONTAL CROSS SECTION
7 Without Reinforcement

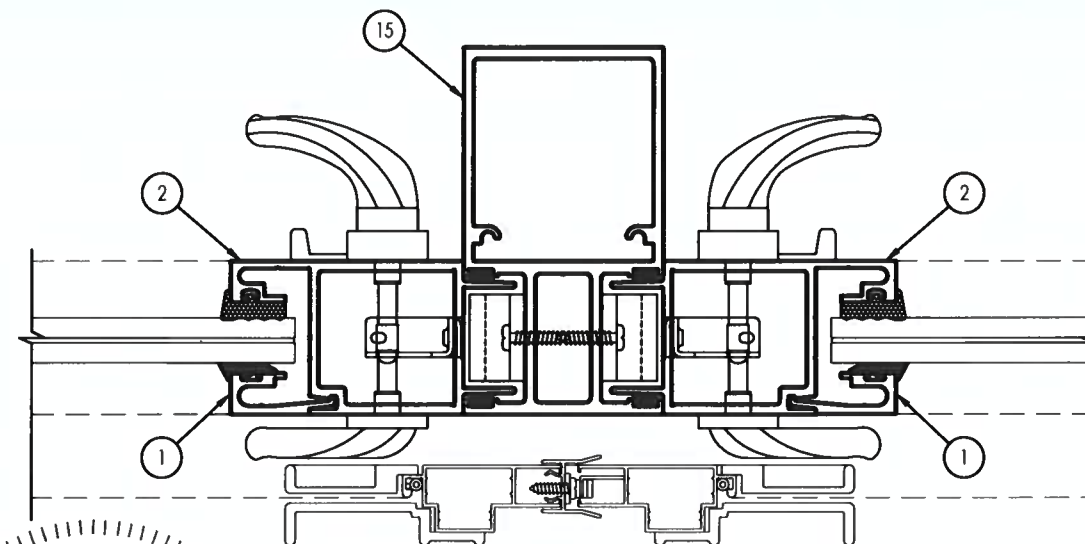


4 HORIZONTAL CROSS SECTION
7 Without Reinforcement

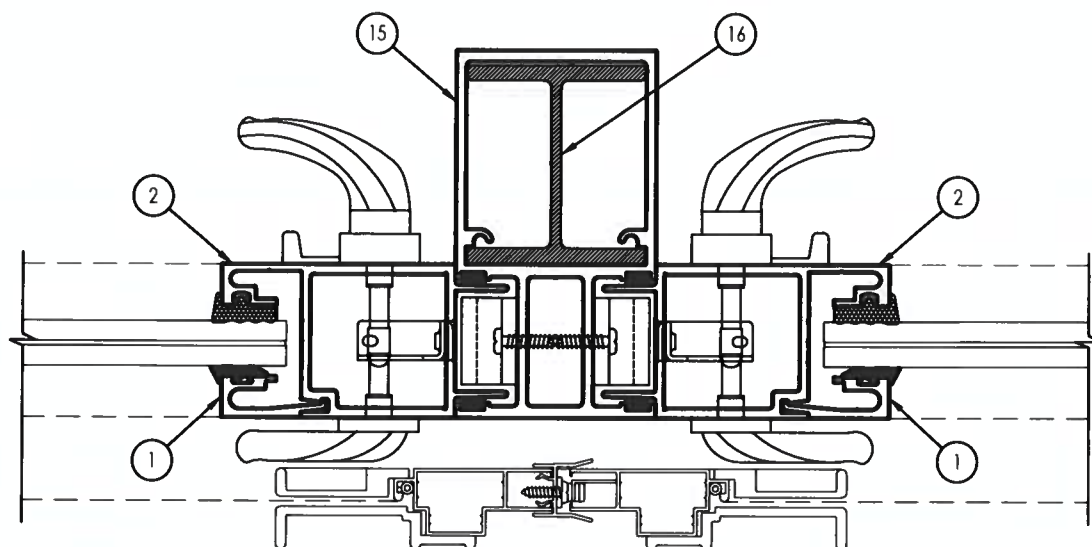


3 HORIZONTAL CROSS SECTION
7 With Reinforcement

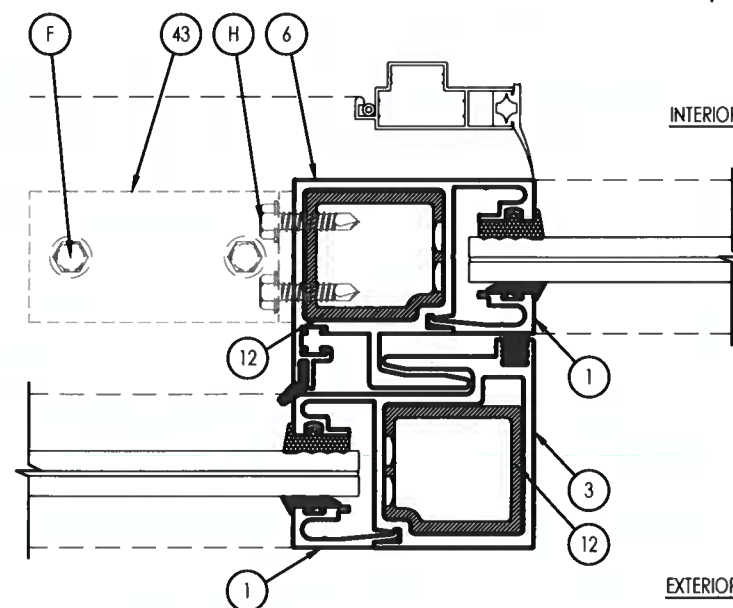

5 HORIZONTAL CROSS SECTION
7 With Reinforcement
With Interior Screen

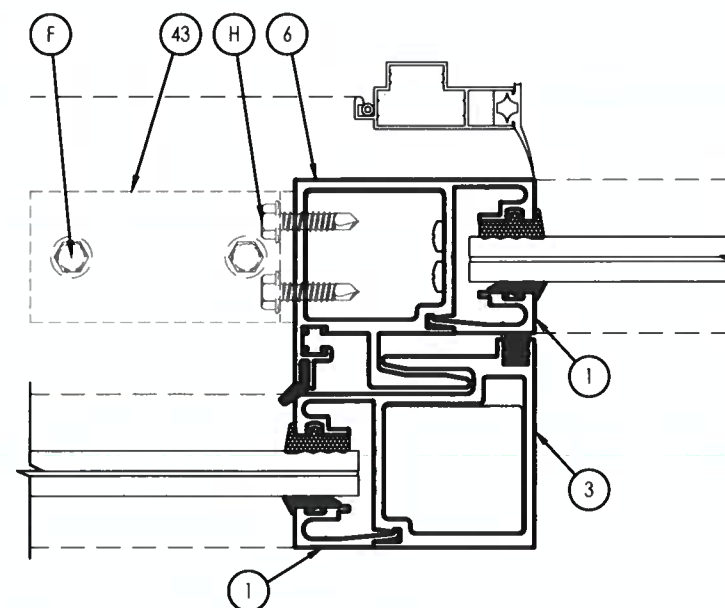


6 HORIZONTAL CROSS SECTION
7 With Reinforcement
With Interior Screen

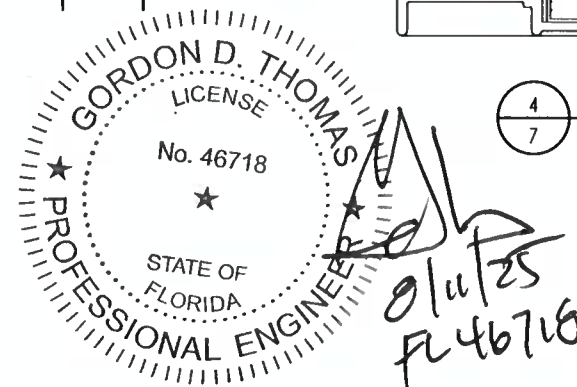


5008 TAMPA WEST BLVD.
TAMPA, FLORIDA 33634
PHONE: (813) 889-0718
FAX: (813) 886-0666




PRODUCT:		SLIDING GLASS DOOR	
PART OR ASSEMBLY:		HORIZONTAL CROSS SECTIONS	
NO	DATE	DESCRIPTION	BY
5	7/14/25	UPDATE TO 8TH ED. (2023) FBC	ECV
4	9/21/20	UPDATE TO 7TH ED. (2020) FBC	JCB
3	8/09/19	UPDATE TO 6TH ED. (2017) FBC	ECV
2	4/09/17	REVISE PER COMMENTS	ECV
1	3/14/17	UPDATE TO 5TH ED. (2014) FBC	LFS
REVISIONS			
DATE: 3/14/17			
SCALE: NTS			
DWG. BY: CO			
CHK BY: ECV			
DRAWING NO.: FL-15903.1			
SHEET: 7 OF 13			

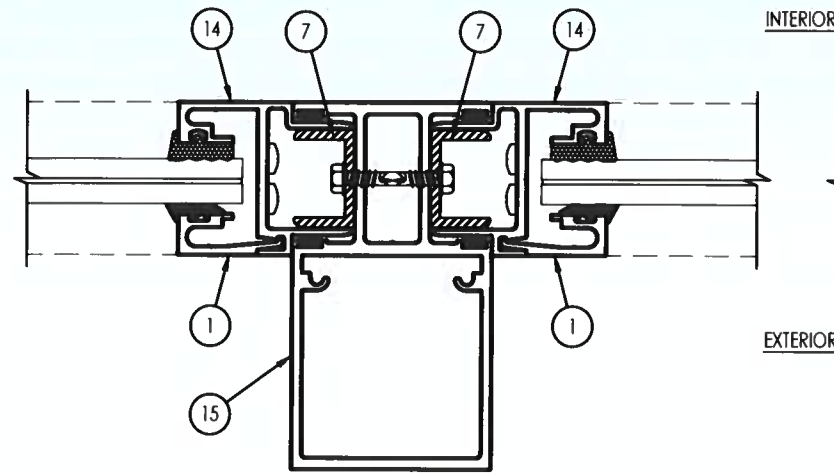


1 HORIZONTAL CROSS SECTION
8 Without Reinforcement
Panel at Interior track fixed

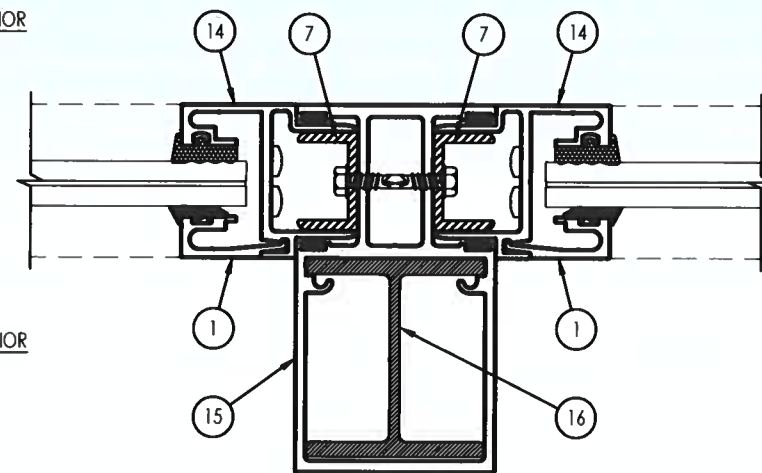


2 HORIZONTAL CROSS SECTION
8 With Reinforcement
Panel at Interior track fixed

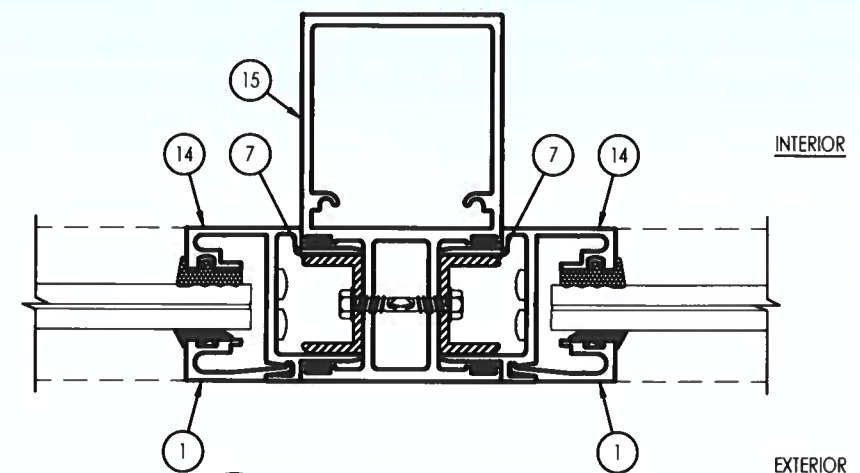


5 HORIZONTAL CROSS SECTION
8 Without Reinforcement
Panel at exterior track fixed

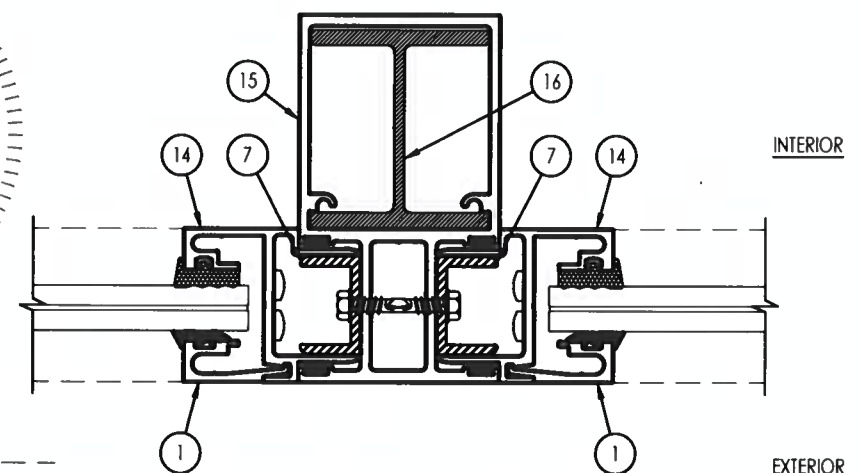


6 HORIZONTAL CROSS SECTION
8 With Reinforcement
Panel at exterior track fixed

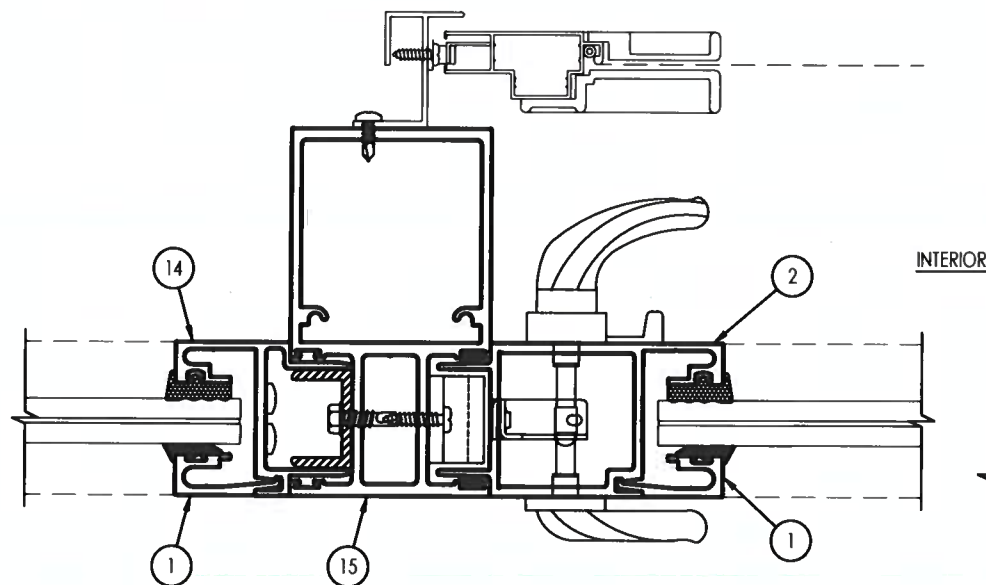


3 HORIZONTAL CROSS SECTION
8 Without Reinforcement
Panel at exterior track fixed

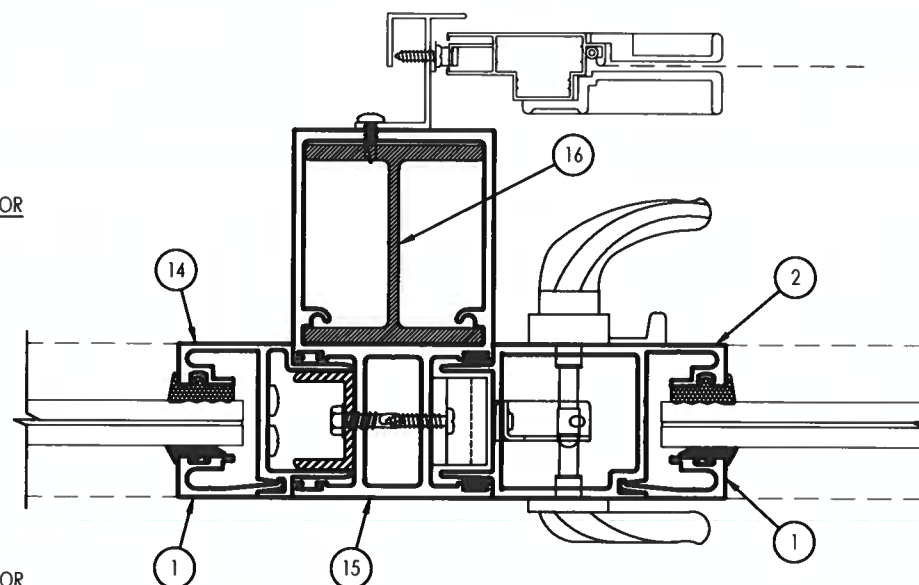

4 HORIZONTAL CROSS SECTION
8 With Reinforcement
Panel at exterior track fixed

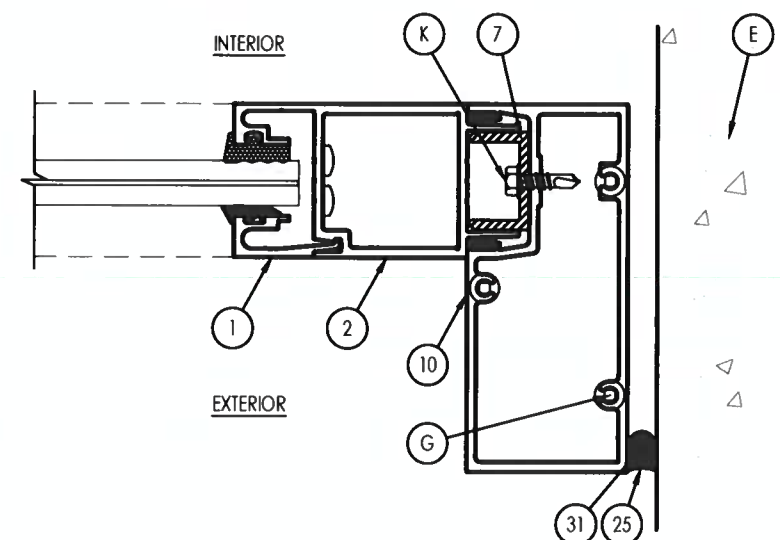

7 HORIZONTAL CROSS SECTION
8 Panel at interior track fixed

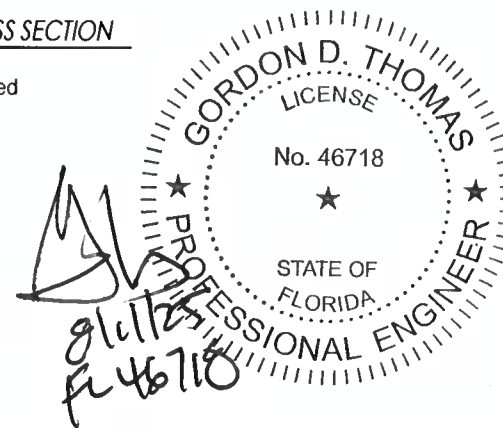

5008 TAMPA WEST BLVD.
TAMPA, FLORIDA 33634
PHONE: (813) 889-0718
FAX: (813) 886-0666










PRODUCT: SLIDING GLASS DOOR

PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS

NO	DATE	DESCRIPTION	BY
5	7/14/25	UPDATE TO 8TH ED. (2023) FBC ECV	JCB
4	9/21/20	UPDATE TO 7TH ED. (2020) FBC JCB	JCB
3	8/09/19	UPDATE TO 6TH ED. (2017) FBC ECV	ECV
2	4/09/17	REVISE PER COMMENTS	ECV
1	3/14/17	UPDATE TO 5TH ED. (2014) FBC LFS	LFS

DATE: 3/14/17
SCALE: NTS
DWG. BY: CO
CHK BY: ECV
DRAWING NO.: FL-15903.1
SHEET: 8 OF 13

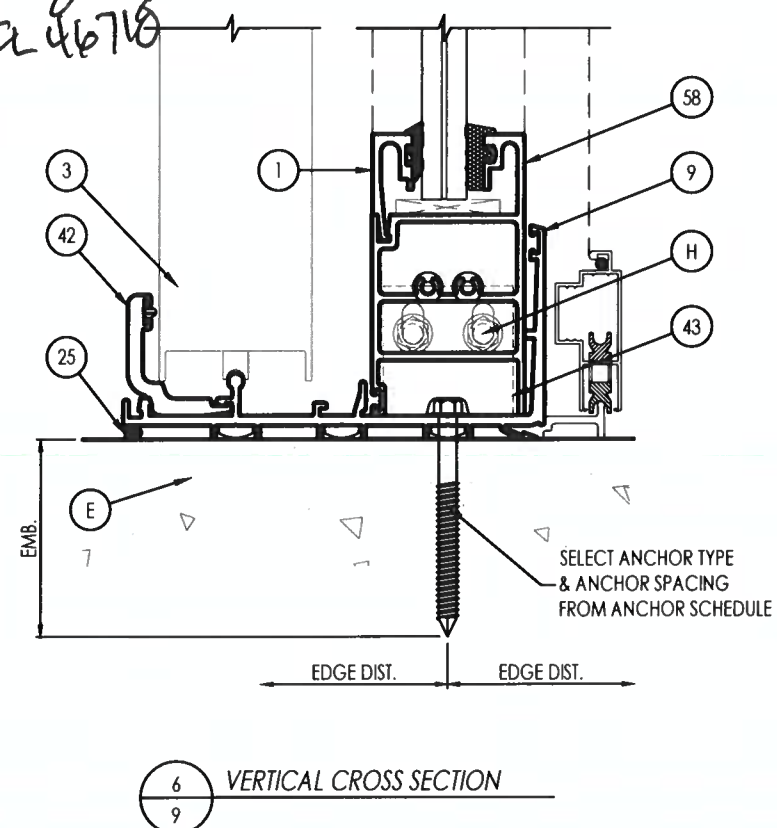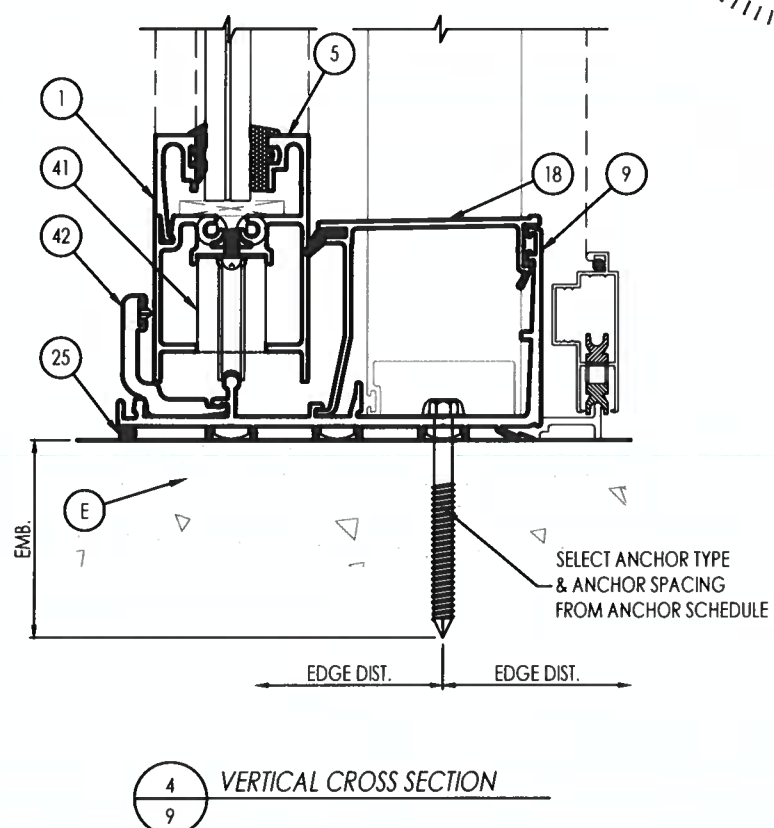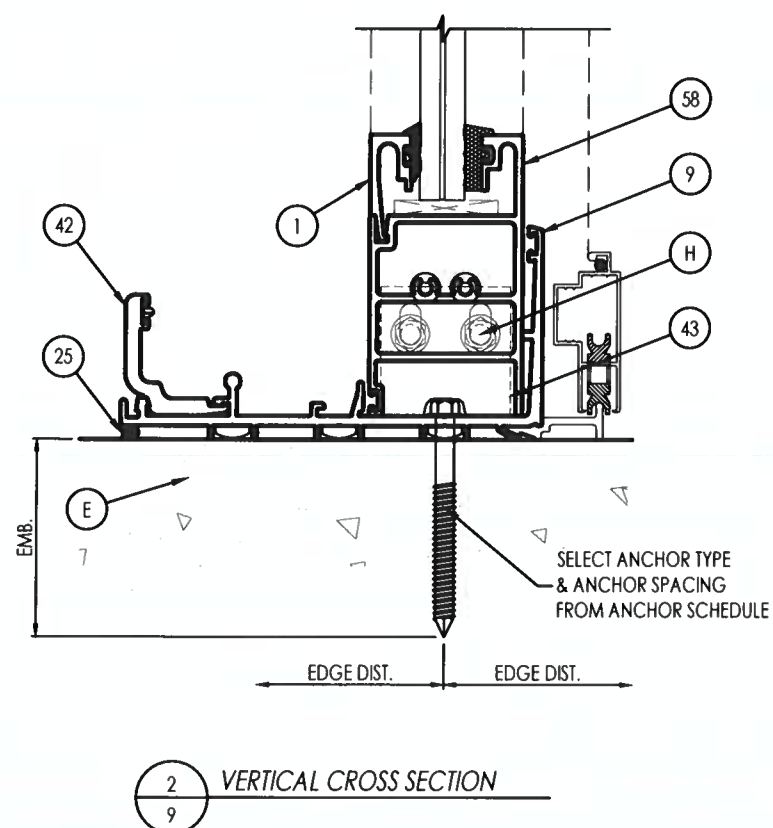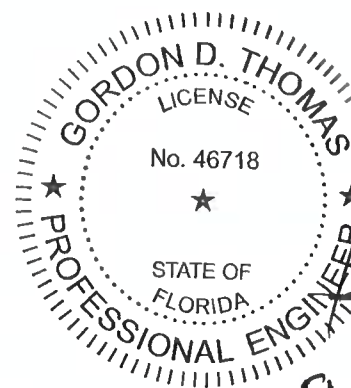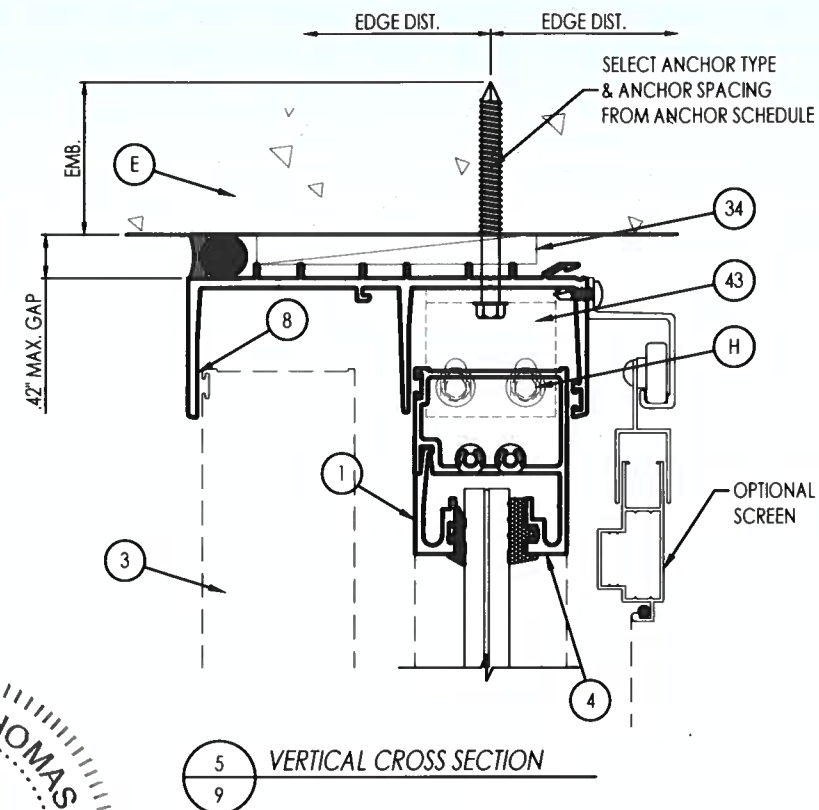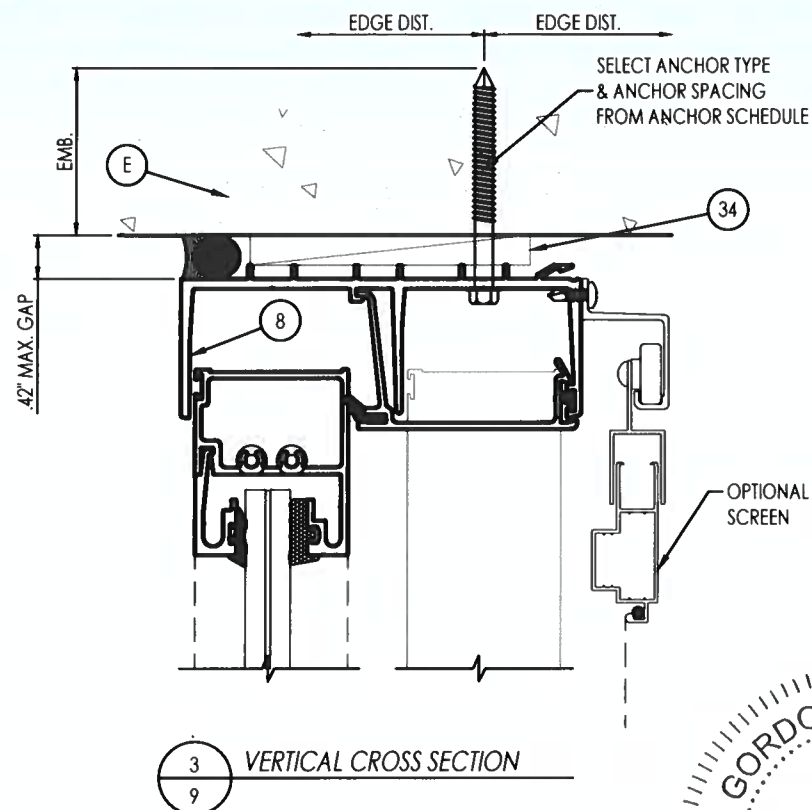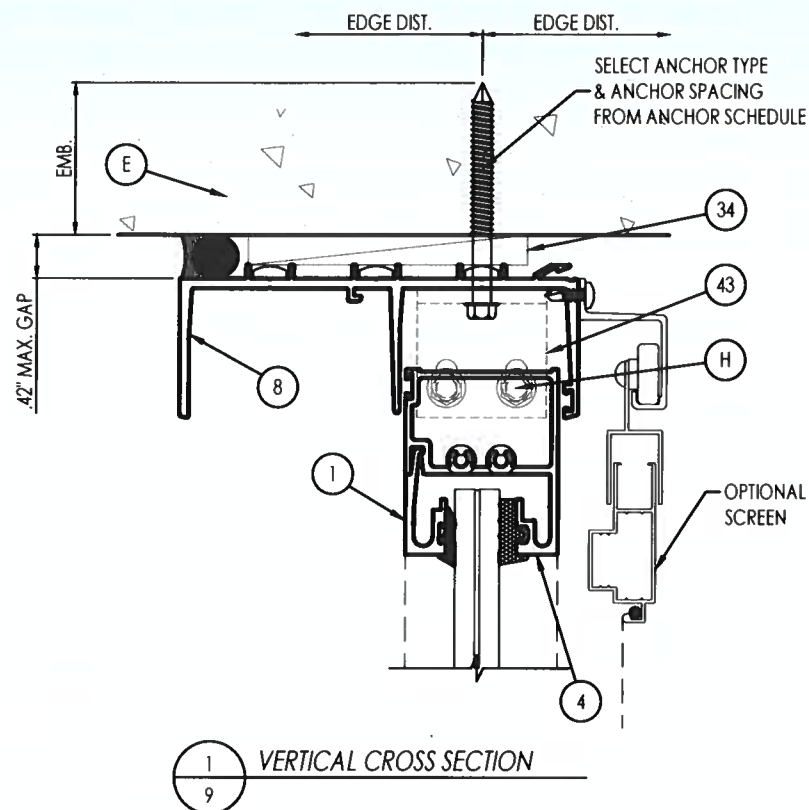

5008 TAMPA WEST BLVD.
TAMPA, FLORIDA 33634
PHONE: (813) 889-0718
FAX: (813) 886-0686



PRODUCT: SLIDING GLASS DOOR

PART OR ASSEMBLY:
VERTICAL CROSS SECTIONS

NO	DATE	DESCRIPTION	BY
5	7/14/25	UPDATE TO 8TH ED. (2023) FBC	ECV
4	9/21/20	UPDATE TO 7TH ED. (2020) FBC	JCB
3	8/09/19	UPDATE TO 6TH ED. (2017) FBC	ECV
2	4/09/17	REVISE PER COMMENTS	ECV
1	3/14/17	UPDATE TO 5TH ED. (2014) FBC	LFS

DATE: 3/14/17






SCALE: NTS

DWG. BY: CO

CHK BY: ECV


DRAWING NO.:
FL-15903.1

SHEET: 9 OF 13

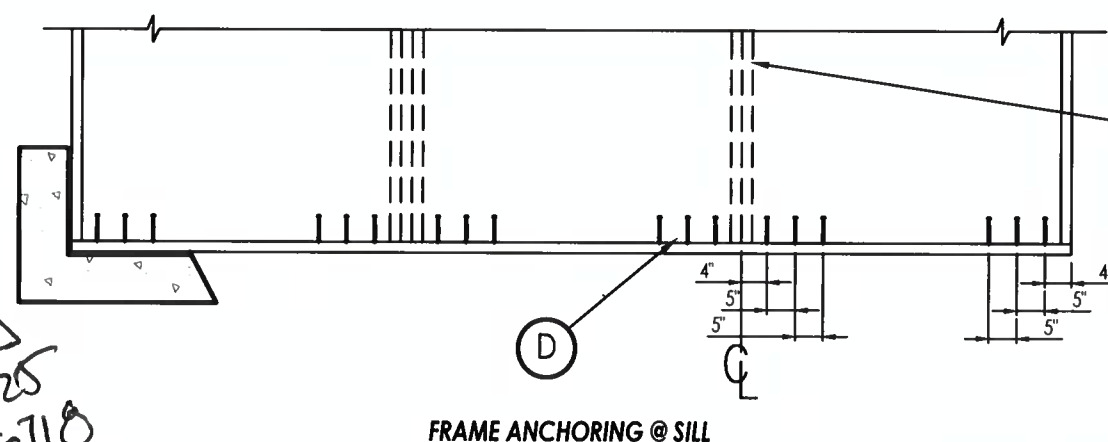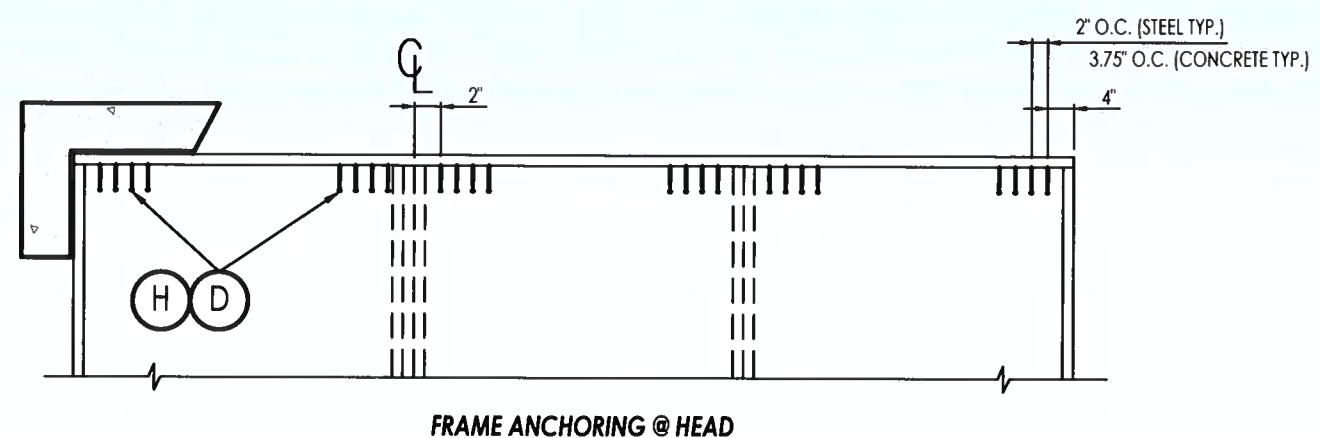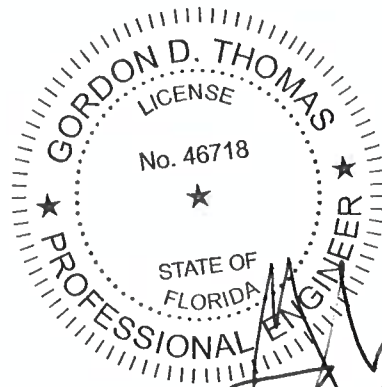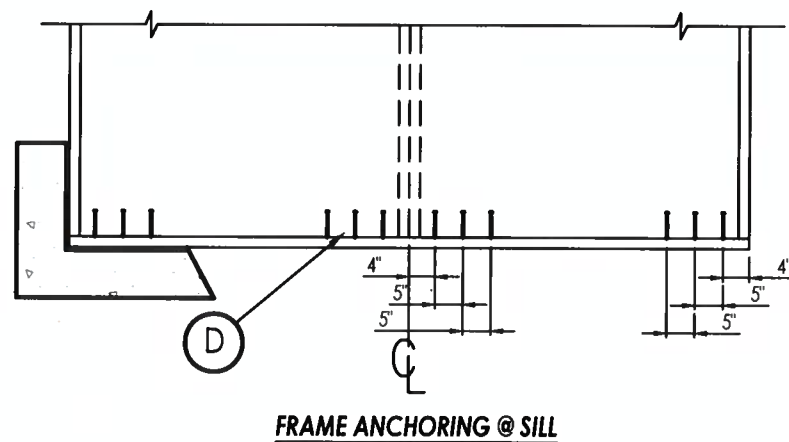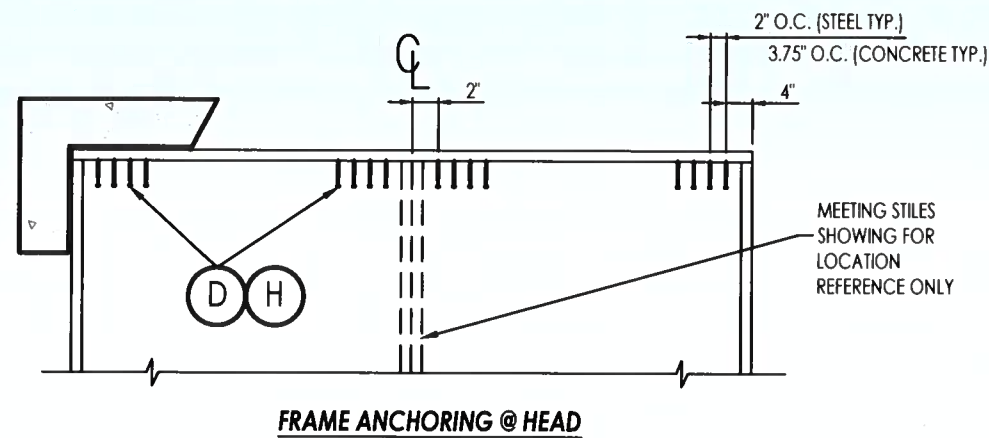


MAX. DP <= 75 PSF

SUBSTRATE		ANCHOR SCHEDULE
CONCRETE	D	5/16" Ø HWH ITW Tapcon® XL concrete anchor with 1-3/4" min. embedment, 2-3/16" minimum edge distance and 3-3/4" minimum clearance to adjacent concrete anchors. Concrete is 3,000 PSI minimum conforming to ACI 301.
STEEL	H	1/4-20 HWH Hilti KWIK-FLEX® self drilling screws. Steel with 0.125" minimum wall thickness conforming to ASTM A500 Grade B, Fy=46,000 PSI & Fu=58,000 PSI or ASTM A653, Fy=33,000 PSI, Fu= 45,000 PSI. Minimum embedment of 3 threads through steel substrate, with 1" min. edge distance and 1" min. CL to CL spacing.

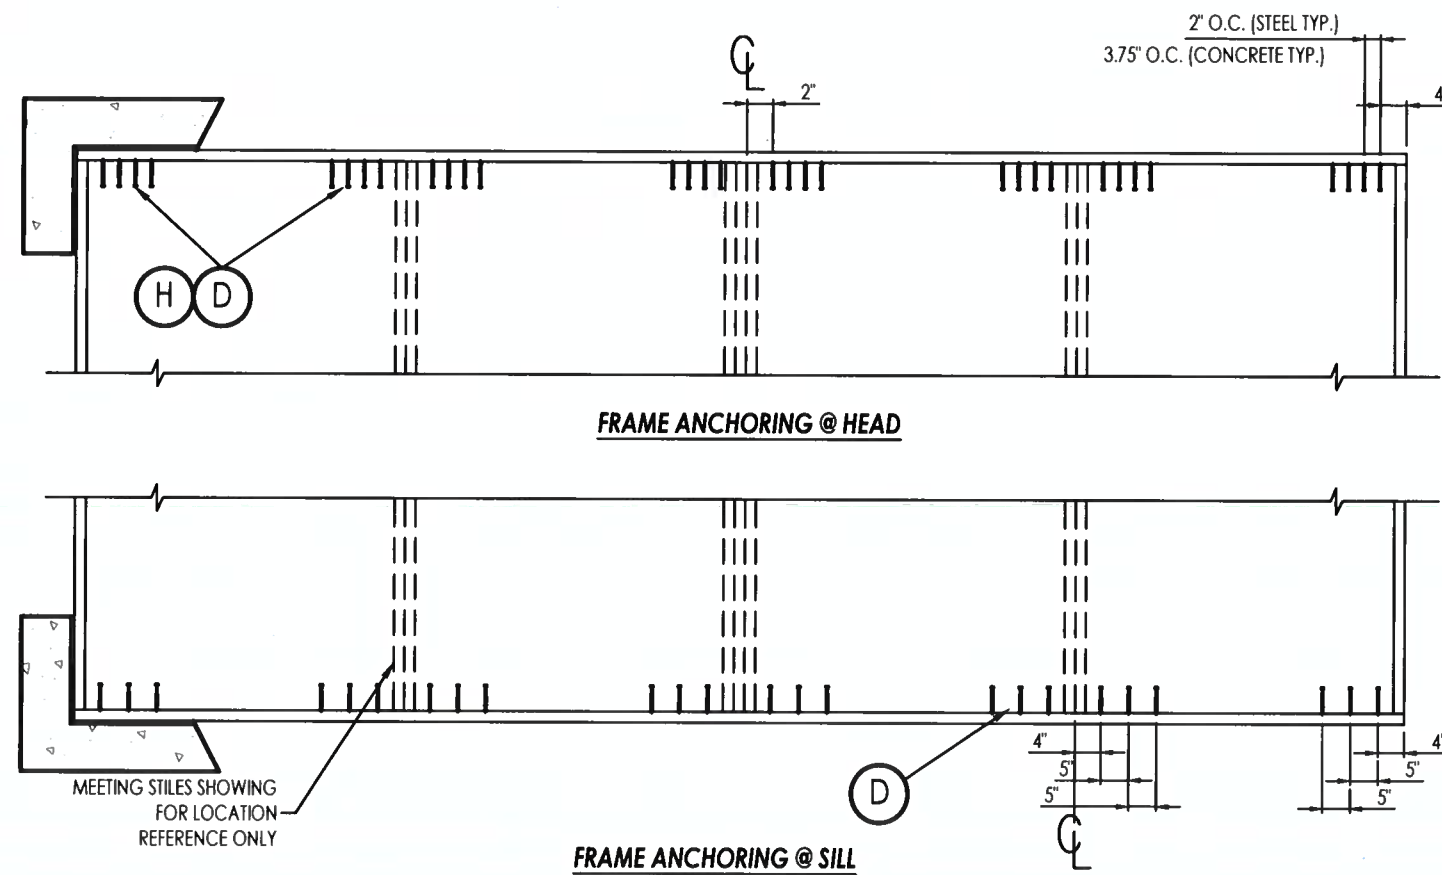

5008 TAMPA WEST BLVD.
TAMPA, FLORIDA 33634
PHONE: (813) 889-0718
FAX: (813) 886-0666

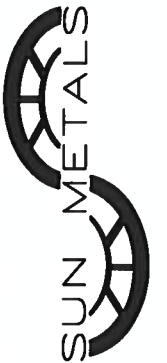

PRODUCT: SLIDING GLASS DOOR

PART OR ASSEMBLY: ANCHORING
(MAX. DP <= 75 PSF)

NO	DATE	DESCRIPTION	BY
5	7/14/25	UPDATE TO 8TH ED. (2023) FBC ECV	
4	9/21/20	UPDATE TO 7TH ED. (2020) FBC JOB	
3	8/09/19	UPDATE TO 6TH ED. (2017) FBC ECV	
2	4/09/17	REVISE PER COMMENTS	
1	3/14/17	UPDATE TO 5TH ED. (2014) FBC LFS	

DATE: 3/14/17


SCALE: NTS

DWG. BY: CO


CHK BY: ECV

DRAWING NO.: FL-15903.1


SHEET: 10 OF 13

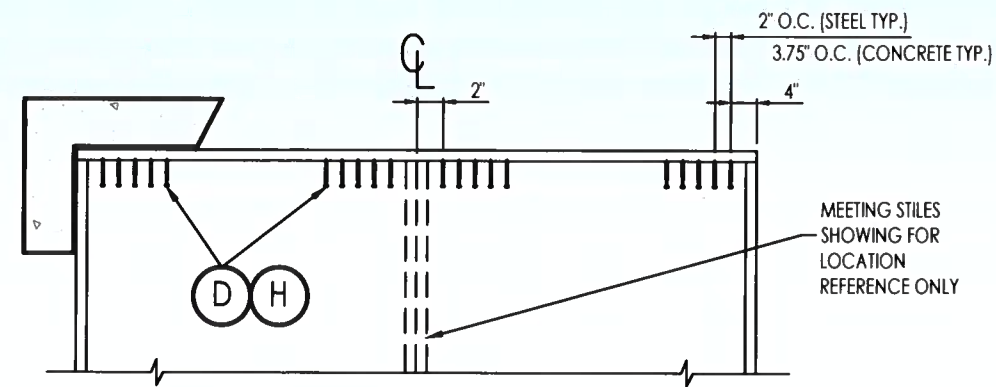


FRAME ANCHORING @ HEAD

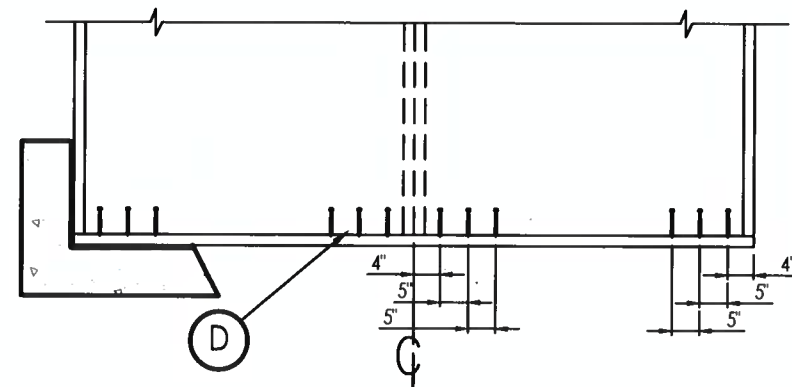


FRAME ANCHORING @ SILL

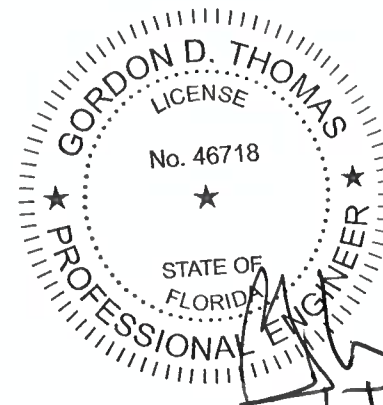


MAX. DP <= 135 PSF

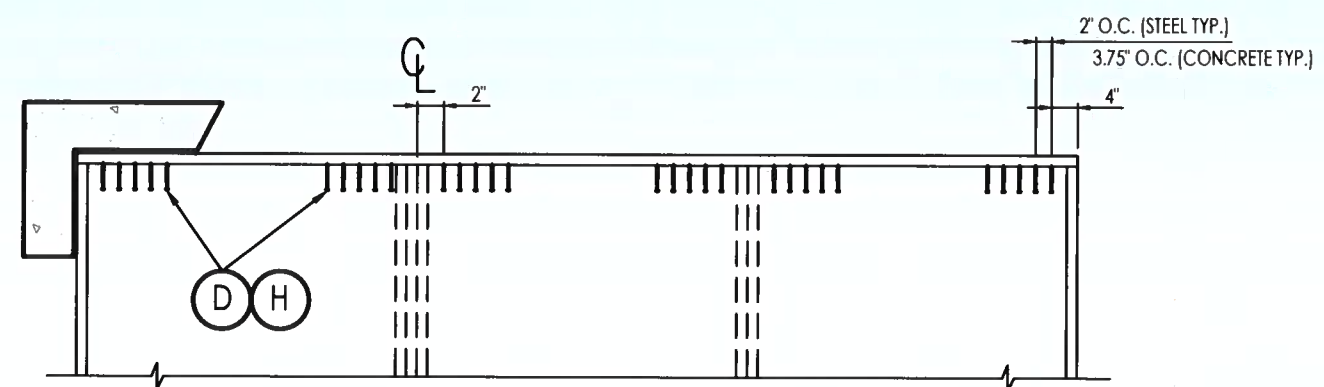


FRAME ANCHORING @ HEAD

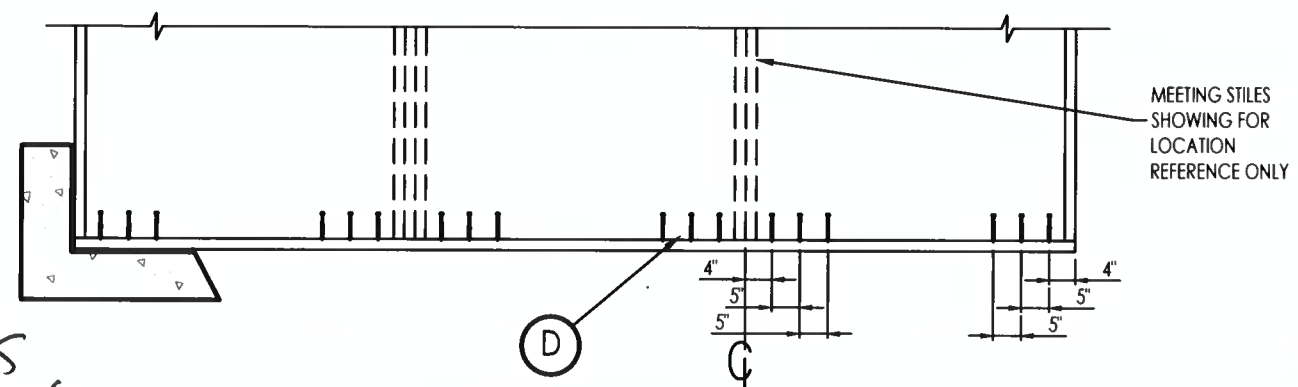

FRAME ANCHORING @ SILL

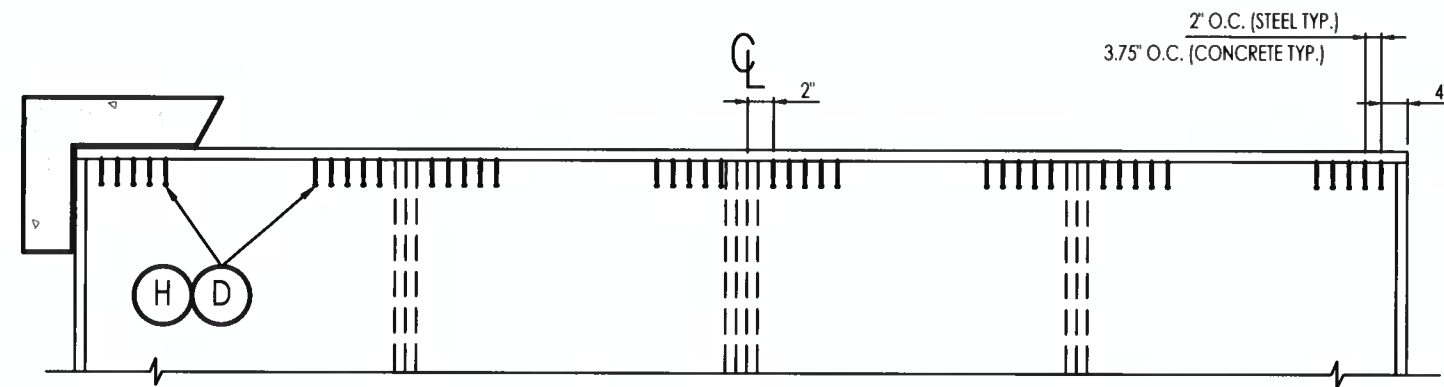

FRAME ANCHORING @ HEAD

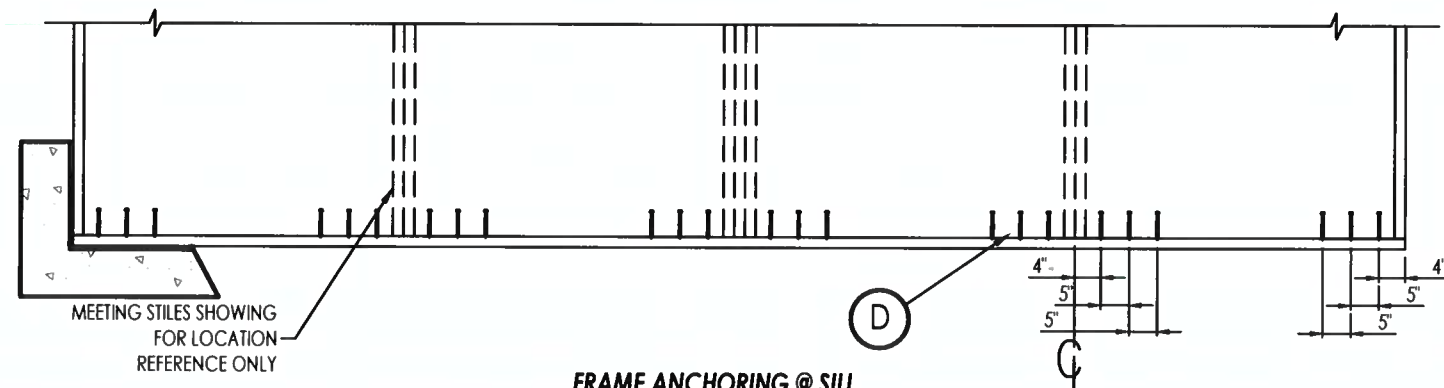

FRAME ANCHORING @ SILL

SUBSTRATE		ANCHOR SCHEDULE
CONCRETE	(D)	5/16" Ø HWH ITW Tapcon® XL concrete anchor with 1-3/4" min. embedment, 2-3/16" minimum edge distance and 3-3/4" minimum clearance to adjacent concrete anchors. Concrete is 3,000 PSI minimum conforming to ACI 301.
STEEL	(H)	1/4-20 HWH Hilti KWIK-FLEX® self drilling screws. Steel with 0.125" minimum wall thickness conforming to ASTM A500 Grade B, Fy=46,000 PSI & Fu=58,000 PSI or ASTM A653, Fy=33,000 PSI, Fu= 45,000 PSI. Minimum embedment of 3 threads through steel substrate, with 1" min. edge distance and 1" min. CL to CL spacing.

5008 TAMPA WEST BLVD.
TAMPA, FLORIDA 33634
PHONE: (813) 889-0718
FAX: (813) 886-0666



PRODUCT:
SLIDING GLASS DOOR

PART OR ASSEMBLY:
ANCHORING
(MAX. DP <= 135 PSF)

NO	DATE	DESCRIPTION	BY
5	7/14/25	UPDATE TO 8TH ED. (2023) FBC ECV	JCB
4	9/21/20	UPDATE TO 7TH ED. (2020) FBC JCB	ECV
3	8/09/19	UPDATE TO 6TH ED. (2017) FBC ECV	ECV
2	4/09/17	REVISE PER COMMENTS	ECV
1	3/14/17	UPDATE TO 5TH ED. (2014) FBC LFS	BY

DATE: 3/14/17





















SCALE: NTS

DWG. BY: CO

CHK BY: ECV

DRAWING NO.:
FL-15903.1

SHEET: 11 OF 13

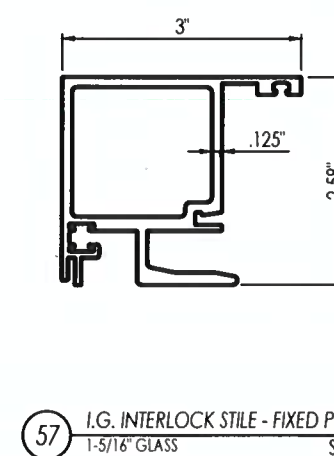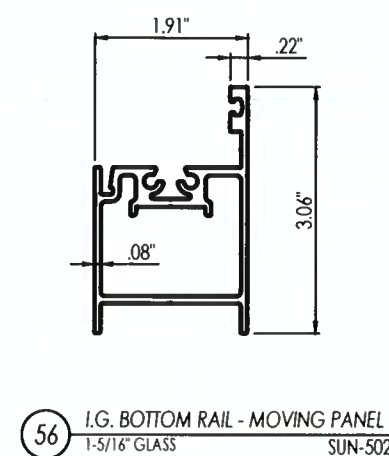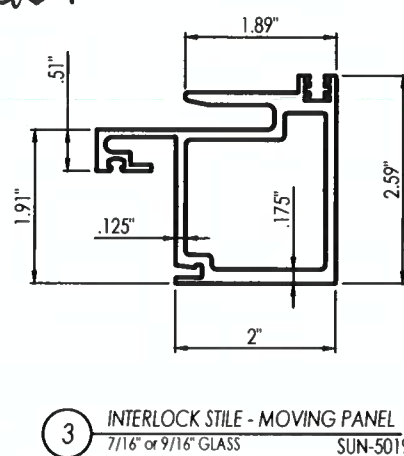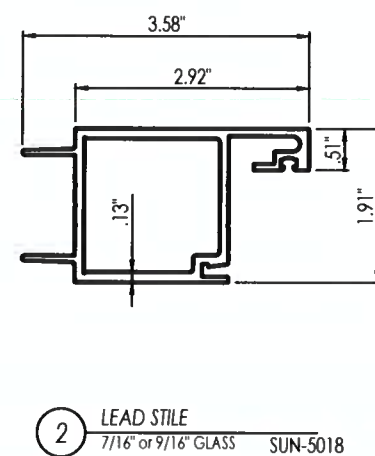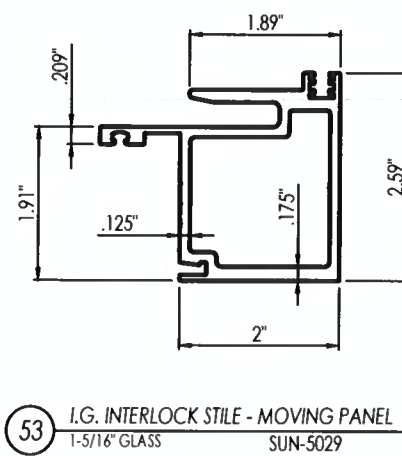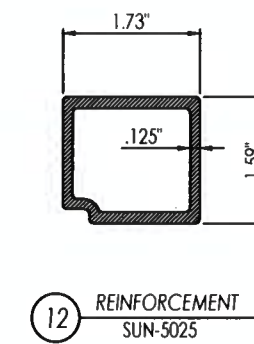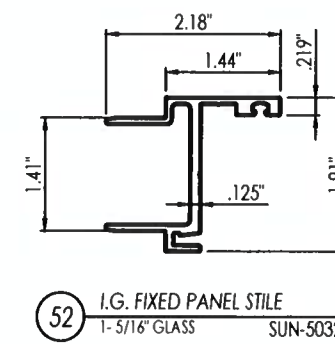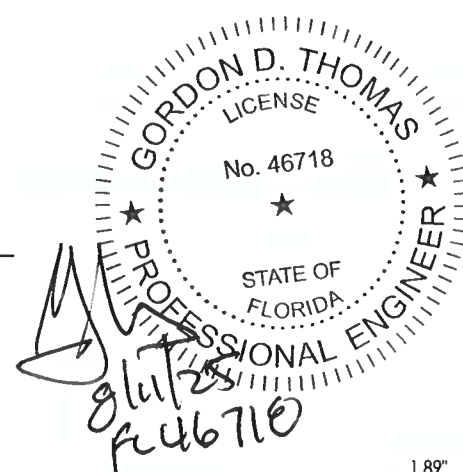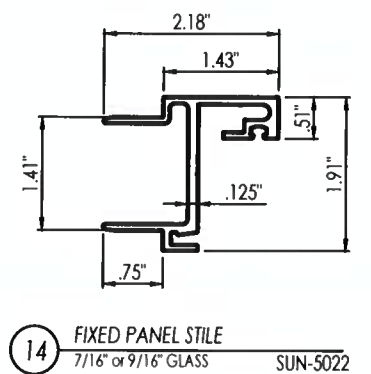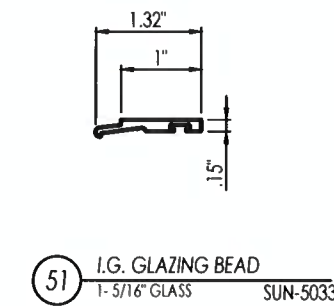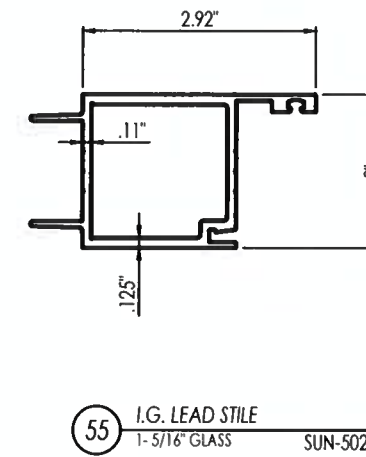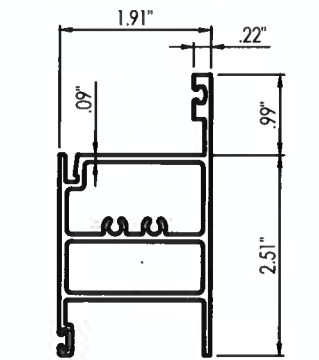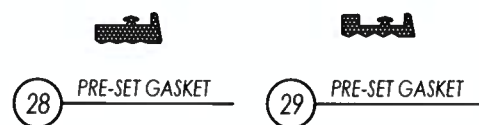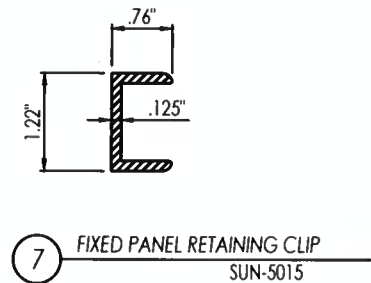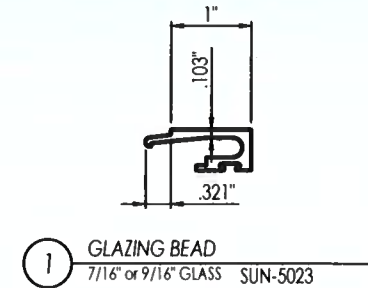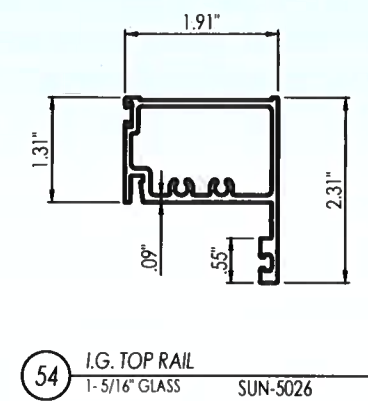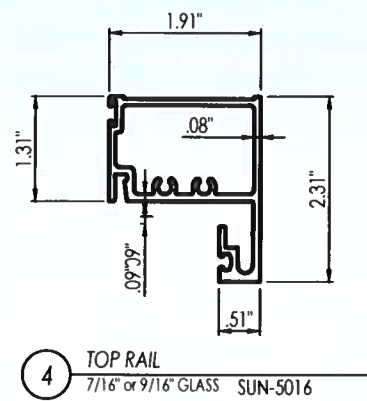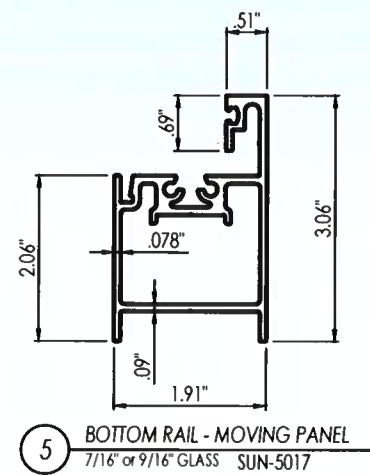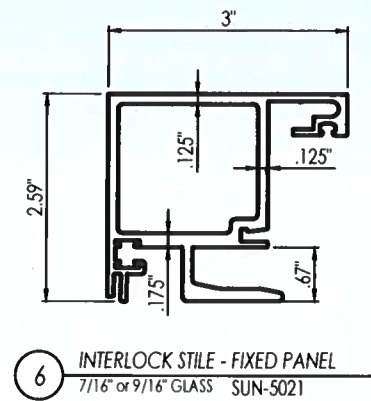

5008 TAMPA WEST BLVD.
TAMPA, FLORIDA 33634
PHONE: (813) 889-0718
FAX: (813) 886-0666

SUN METALS

PRODUCT: SLIDING GLASS DOOR

PART OR ASSEMBLY: COMPONENTS

		DATE		DESCRIPTION		BY	
		NO		DATE		BY	
5	7/14/25	UPDATE TO 8TH ED. (2023)	FBC	ECV			
4	9/21/20	UPDATE TO 7TH ED. (2020)	FBC	JCB			
3	8/09/19	UPDATE TO 6TH ED. (2017)	FBC	ECV			
2	4/09/17	REVISE PER COMMENTS	ECV				
1	3/14/17	UPDATE TO 5TH ED. (2014)	FBC	LFS			

DATE: 3/14/17

SCALE: NTS



DWG. BY: CO

CHK BY: ECV

DRAWING NO.: FL-15903.1

SHEET: 12 OF 13

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
D	5/16" x 2-3/4" HWH ITW TAPCON XL CONCRETE ANCHOR	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301	CONCRETE
F	3/16" x 2-3/4" HWH ITW TAPCON CONCRETE ANCHOR	STEEL
G	#10 x 1-1/2" SQ-PH ASSEMBLY SCREW	STL. STEEL
H	1/4-20 HWH HILTI KWIK-FLEX SELF DRILLING SCREW	STEEL
K	#10 x 3/4" HH SELT TAP SCREW	STL. STEEL
1	GLAZING BEAD 6063-T6 (9/16")	ALUM 6063-T6
2	LEAD STILE 6063-T6 (9/16")	ALUM 6063-T6
3	INTERLOCK STILE - MOVING PANEL 6005-T5 (9/16")	ALUM 6005-T5
4	TOP RAIL 6063-T6 (9/16")	ALUM 6063-T6
5	BOTTOM RAIL - MOVING PANEL 6063-T6 (9/16")	ALUM 6063-T6
6	INTERLOCK STILE - FIXED PANEL 6005-T5 (9/16")	ALUM 6005-T5
7	FIXED PANEL RETAINING CLIP 6063-T6	ALUM 6063-T6
8	FRAME HEAD 6063-T6	ALUM 6063-T6
9	FRAME SILL 6063-T6	ALUM 6063-T6
10	FRAME JAMB 6063-T6	ALUM 6063-T6
11	OXO ADAPTOR 6005-T5	ALUM 6005-T5
12	REINFORCEMENT 6005-T5	ALUM 6005-T5
13	OXO ADAPTOR REINFORCEMENT 6005-T5	ALUM 6005-T5
14	FIXED PANEL STILE 6063-T6 (9/16")	ALUM 6063-T6
15	XX ADAPTOR 6005-T5	ALUM 6005-T5
16	XX ADAPTOR REINFORCEMENT 6005-T5	ALUM 6005-T5
17	FRAME HEAD POCKET COVER 6063-T6	ALUM 6063-T6
18	FRAME SILL POCKET COVER 6063-T6	ALUM 6063-T6
25	WEATHERSEAL SEALANT (WS001) DOW 795	SILICONE
27	GLAZING SPACER	ALUM 6063-T6
28	GASKET, EPDM CLOSED CELL FOAM (9/16" GLAZING) (TREMCO)	EPDM
29	GASKET, EPDM CLOSED CELL FOAM (1-5/16" GLAZING) (TREMCO)	EPDM
30	WEDGE 70±5 EPDM (9/16" & 1-5/16" GLAZING) (TREMCO)	EPDM
31	BACKER ROD - CLOSED CELL EXTRUDED FOAM	POLYETHYLENE
34	SHIM	-
35	SETTING/ EDGE BLOCK	SILICONE
41	ROLLER ASSM.	STL. STEEL
42	REACTION CLIP 6005-T5	ALUM 6005-T5
43	TOE ANCHOR 6005-T5	ALUM 6005-T5
49	BOTTOM RAIL - FIXED PANEL 6063-T6 (1-5/16")	ALUM 6063-T6
51	I.G. GLAZING BEAD 6063-T6 (1-5/16")	ALUM 6063-T6
52	I.G. FIXED PANEL STILE 6063-T6 (1-5/16")	ALUM 6063-T6
53	I.G. INTERLOCK STILE - MOVING PANEL 6063-T6 (1-5/16")	ALUM 6063-T6
54	I.G. TOP RAIL 6063-T6 (1-5/16")	ALUM 6063-T6
55	I.G. LEAD STILE 6063-T6 (1-5/16")	ALUM 6063-T6
56	I.G. BOTTOM RAIL - MOVING PANEL 6063-T6 (1-5/16")	ALUM 6063-T6
57	INTERLOCK STILE - FIXED PANEL 6005-T5 (1-5/16")	ALUM 6005-T5
58	BOTTOM RAIL - FIXED PANEL 6063-T6 (7/16" OR 9/16")	ALUM 6063-T6
59	CAULK STOP, EPDM CLOSED CELL FOAM (9/16" & 1-5/16" GLAZING) (TREMCO)	EPDM
60	STRUCTURAL SILICONE DOW 995	SILICONE
61	WEDGE 70±5 EPDM (9/16" & 1-5/16" GLAZING) (TREMCO)	EPDM
62	WEDGE 70±5 EPDM (7/16" GLAZING) (TREMCO)	EPDM

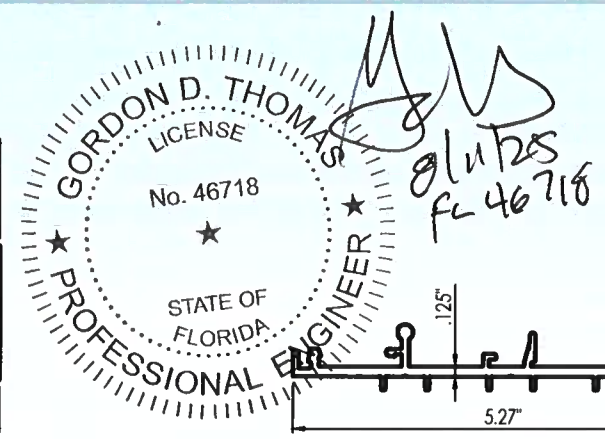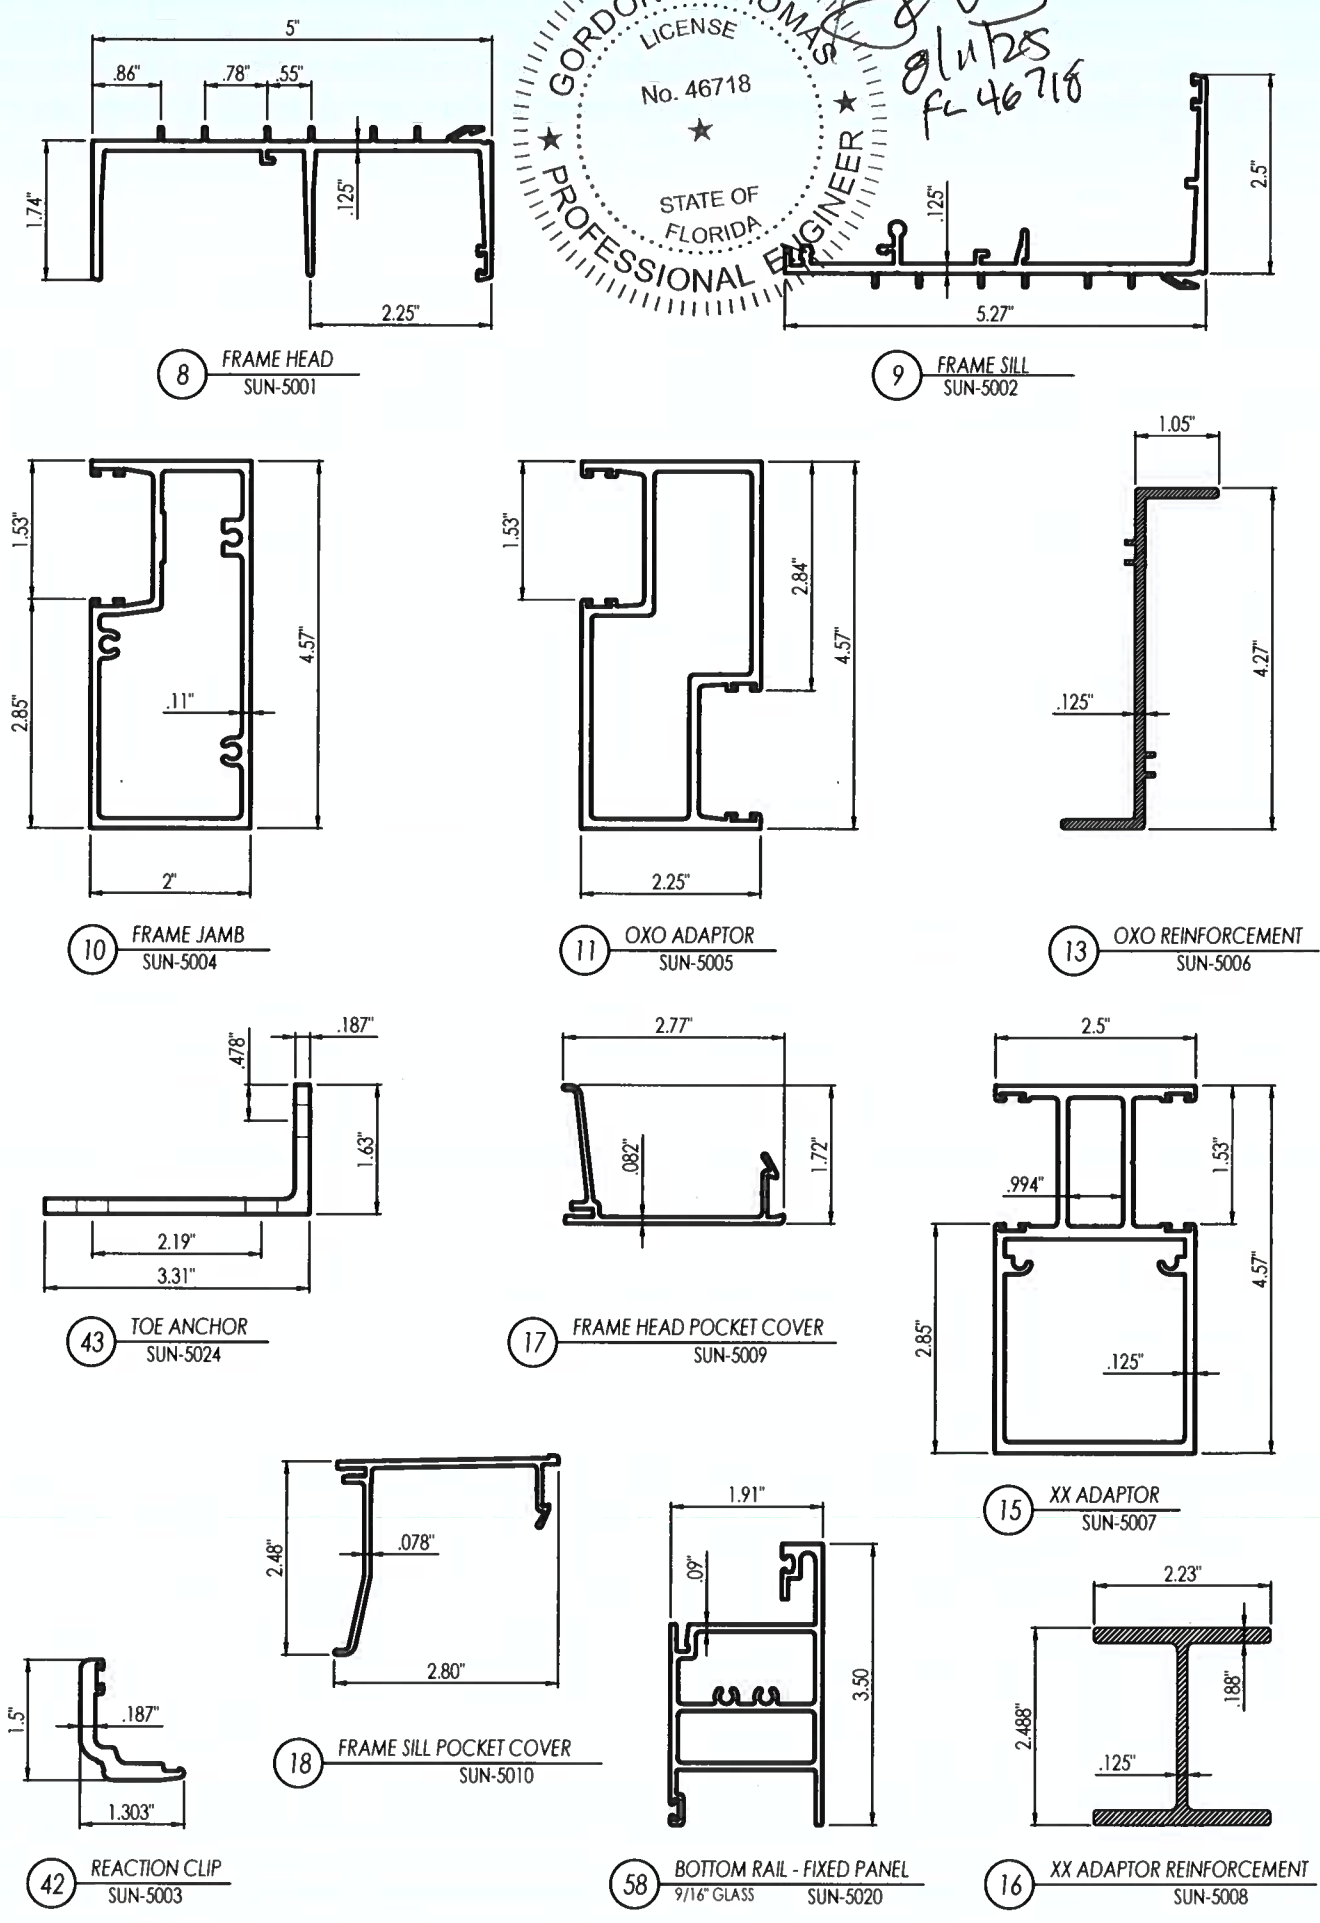

5008 TAMPA WEST BLVD. TAMPA, FLORIDA 33634 PHONE: (813) 889-0718 FAX: (813) 886-0666		
SUN METALS		
PRODUCT: SLIDING GLASS DOOR		
PART OR ASSEMBLY: BILL OF MATERIALS & COMPONENTS		
5	7/14/25	UPDATE TO 8TH ED. (2023) FBC ECV
4	9/21/20	UPDATE TO 7TH ED. (2020) FBC JCB
3	8/09/19	UPDATE TO 6TH ED. (2017) FBC ECV
2	4/09/17	REVISE PER COMMENTS ECV
1	3/14/17	UPDATE TO 5TH ED. (2014) FBC LFS
NO	DATE	DESCRIPTION
		REVISIONS
DATE: 3/14/17		
SCALE: NTS		
DWG. BY: CO		
CHK BY: ECV		
DRAWING NO.: FL-15903.1		
SHEET: 13 OF 13		