

# ANDERSEN CORPORATION


## SERIES 100 SINGLE HUNG WINDOW WITH PG UPGRADE (NON-IMPACT) (NON-HVHZ)

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
  - AAMA/WDMA/CSA 101/I.S.2/A440-17
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: FIBREX®.
- GLASS SHALL MEET THE REQUIREMENTS OF ASTM E1300. SEE SHEET 1 FOR GLAZING DETAIL.
- DESIGNATIONS "X" AND "O" STAND FOR THE FOLLOWING:  
X: OPERABLE PANEL  
O: FIXED PANEL
- CUSTOM SIZES AVAILABLE UPON REQUEST.

| TABLE OF CONTENTS |                                                             |
|-------------------|-------------------------------------------------------------|
| SHEET             | SHEET DESCRIPTION                                           |
| 1                 | GENERAL & INSTALLATION NOTES                                |
| 2                 | ELEVATIONS & ANCHOR LAYOUTS                                 |
| 3                 | ELEVATION & ANCHOR LAYOUT                                   |
| 4                 | ELEVATION & ANCHOR LAYOUT                                   |
| 5                 | ELEVATION & ANCHOR LAYOUT                                   |
| 6                 | ELEVATIONS & ANCHOR LAYOUTS                                 |
| 7                 | VERTICAL SECTIONS                                           |
| 8                 | HORIZONTAL SECTIONS                                         |
| 9                 | ANCHOR DETAILS, INSTALLATION NOTES, & REINFORCEMENT DETAILS |

| UNIT# | SIZE               | CONFIGURATION | SASH RATIO | DESIGN PRESSURE | MISSILE IMPACT RATING |
|-------|--------------------|---------------|------------|-----------------|-----------------------|
| 1     | 47 1/2" X 77 1/2"  | (O/X)         | 1:1        | +/- 50 PSF      | NON-IMPACT            |
| 2     | 41 1/2" X 83"      | (O/X)         | 1:1        | +/- 50 PSF      | NON-IMPACT            |
| 3     | 47 1/2" X 95 1/2"  | (O/O/X)       | 1:1        | +/- 50 PSF      | NON-IMPACT            |
| 4     | 143 1/2" X 59 1/2" | (O/X,O,O/X)   | 1:1        | +/- 50 PSF      | NON-IMPACT            |
| 5     | 143 1/2" X 65 1/2" | (O/X,O/X,O/X) | 1:1        | +/- 50 PSF      | NON-IMPACT            |
| 6     | 143 1/2" X 23 1/2" | (OOO)         | 1:2:1      | +/- 50 PSF      | NON-IMPACT            |
| 7     | 143 1/2" X 23 1/2" | (OOO)         | 1:1:1      | +/- 50 PSF      | NON-IMPACT            |

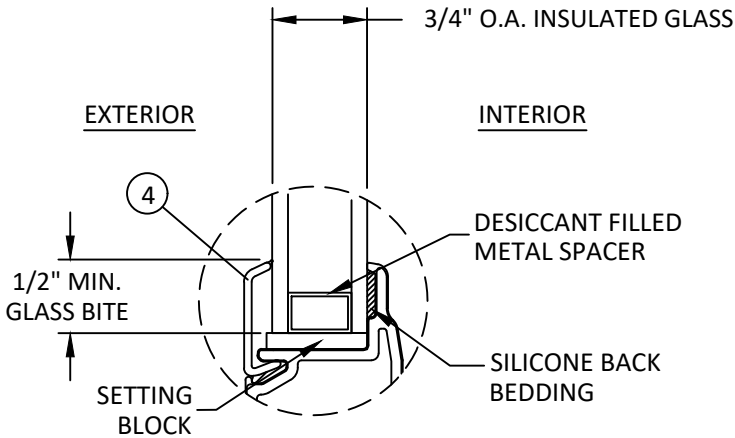

GLAZING DETAIL 1

GLAZING NOTES:

- GLASS TYPE & THICKNESS SHALL COMPLY WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
- SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
- SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
- DESIGN PRESSURES MAY NOT EXCEED MAX VALUES IN DESIGN PRESSURE TABLE ON SHEET 1.



100 FOURTH AVE NORTH  
BAYPORT, MN 55003-1096  
PH: (651) 264-5150 FX: (651) 264-5485

TITLE: SERIES 100 SINGLE HUNG WINDOW  
WITH PG UPGRADE  
(NON-IMPACT) (NON-HVHZ)

GENERAL AND INSTALLATION NOTES


PREPARED BY:  
BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954) 399-8478  
FAX: (954) 744-4738  
WEB: www.buildingdrops.com

BUILDING DROPS

| REMARKS             | BY | DATE    |
|---------------------|----|---------|
| 8TH FBC CODE CHANGE | SH | 5.26.23 |
|                     |    |         |
|                     |    |         |
|                     |    |         |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.  
Reason: I am approving this document  
Date: 2023.08.14 21:08:28 -04'00'

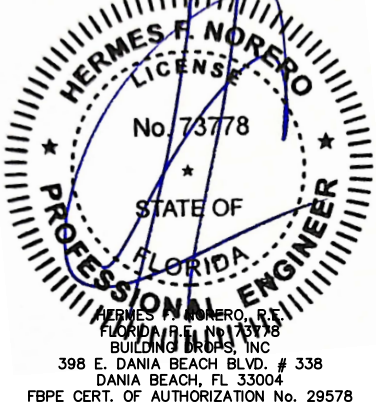

FL #: FL15906

DATE: 06.22.2018

DWG. BY: JA

CHK. BY: HFN


SCALE: NTS

DWG. #: AWD239


SHEET: 1

OF 9


8/14/2023 2:25 PM  
s:\projects\andersen windows\cc-23-0347 - fbc 2023 code change (8th edition)\dwgs\115906\awd239.dwg

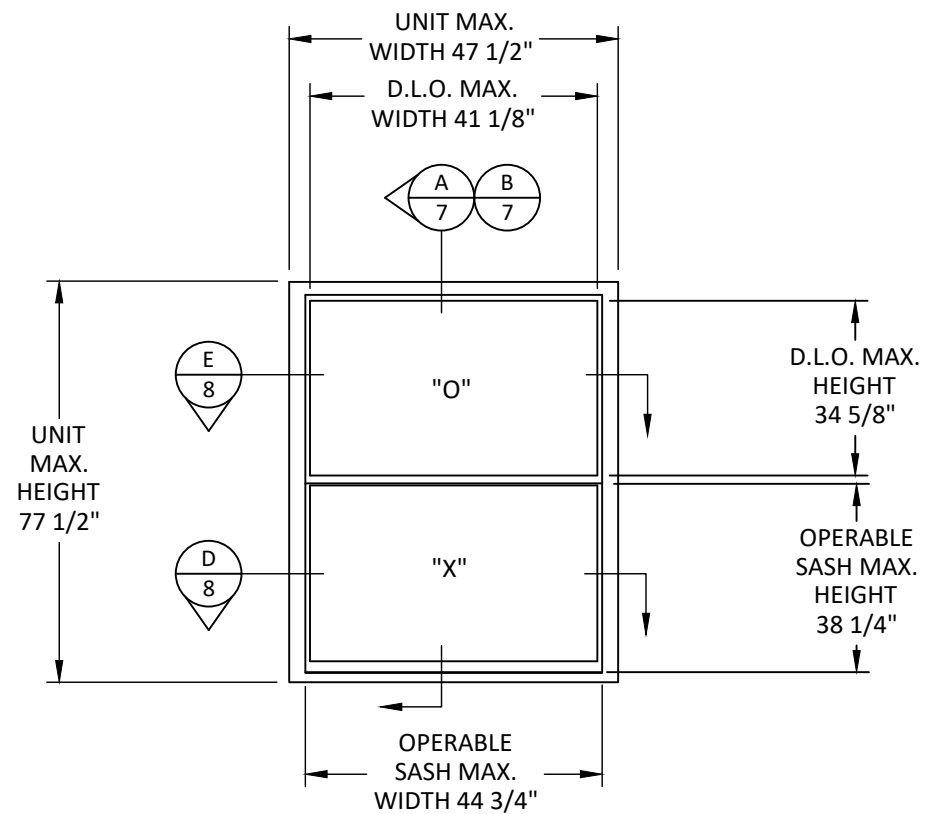


**ELEVATION**  
O/X

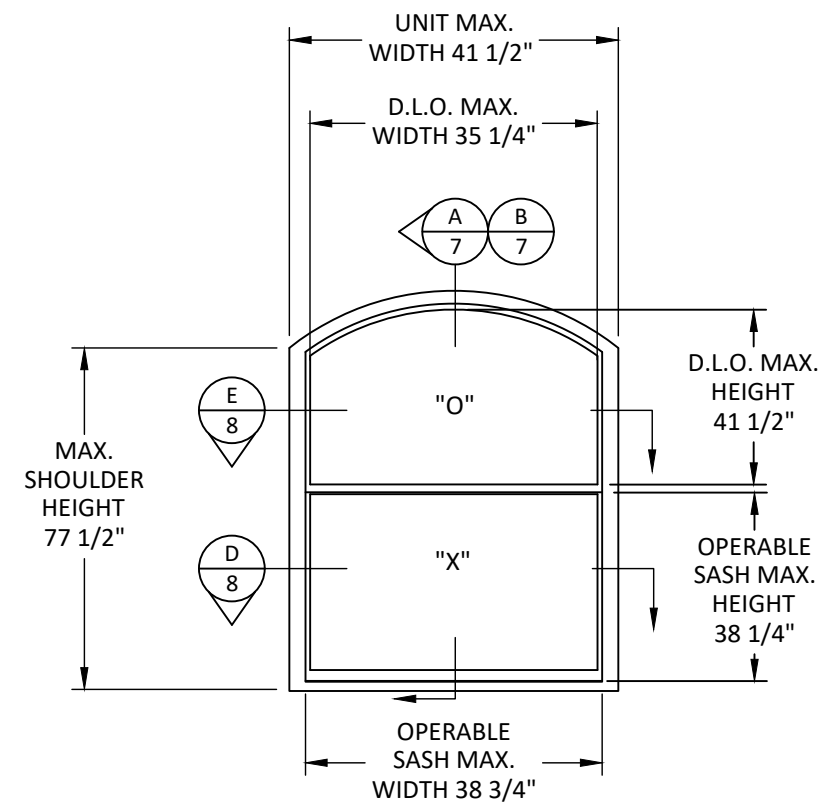

**ELEVATION**  
O/X

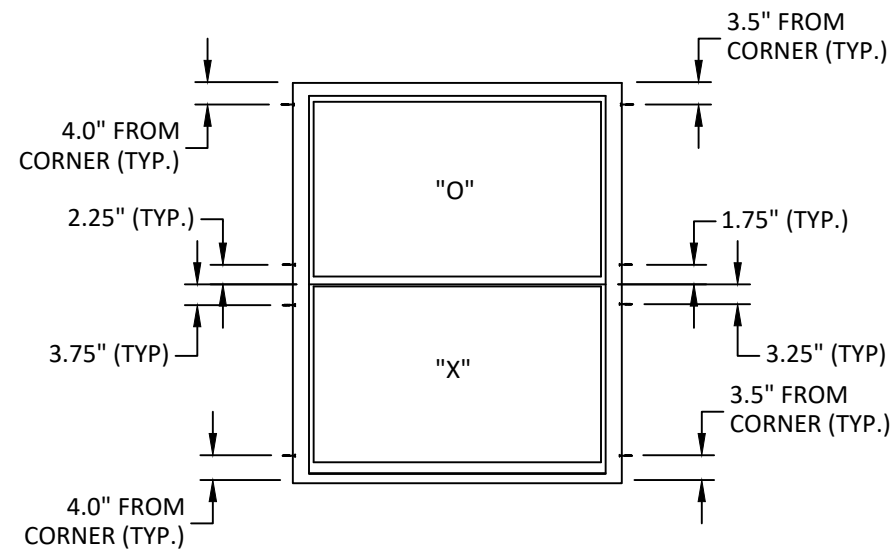

**ANCHOR LAYOUT**  
THROUGH FRAME/  
INSTALLATION CLIP

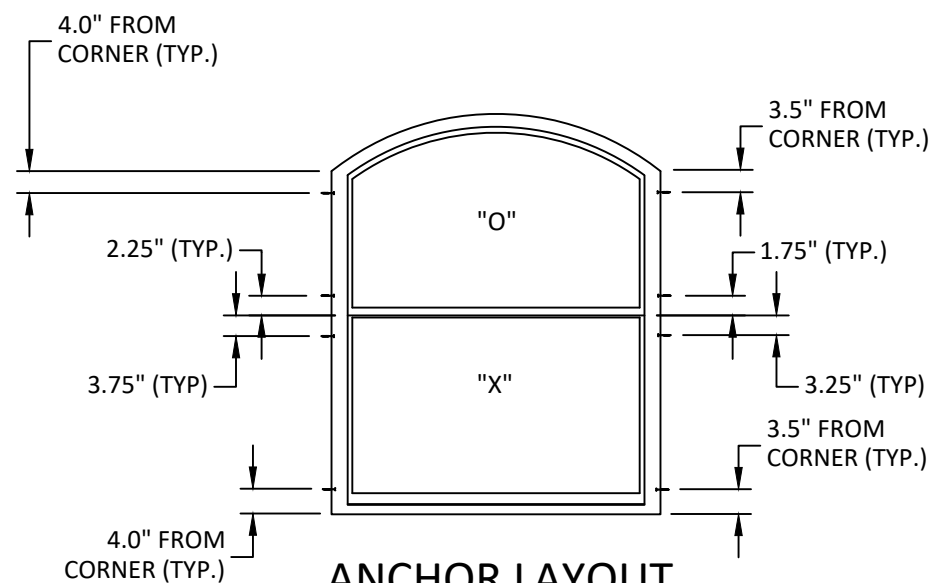

**ANCHOR LAYOUT**  
THROUGH FRAME/  
INSTALLATION CLIP



100 FOURTH AVE NORTH  
BAYPORT, MN 55003-1096  
PH: (651) 264-5150 FX: (651) 264-5485

TITLE: SERIES 100 SINGLE HUNG WINDOW  
WITH PG UPGRADE  
(NON-IMPACT) (NON-HVHZ)

ELEVATIONS & ANCHOR LAYOUTS

PREPARED BY: BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954) 399-8478  
FAX: (954) 744-4738  
WEB: www.buildingdrops.com



| REMARKS             | BY | DATE    |
|---------------------|----|---------|
| 8TH FBC CODE CHANGE | SH | 5.26.23 |
|                     |    |         |
|                     |    |         |
|                     |    |         |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: **FL15906**

DATE: **06.22.2018**

DWG. BY: **JA** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **AWD239**

SHEET:

**2**


OF 9

s:\projects\andersen windows\cc-23-0347 - fbc 2023 code change (8th edition)\dwgs\115906\awd239.dwg 8/14/2023 2:25 PM

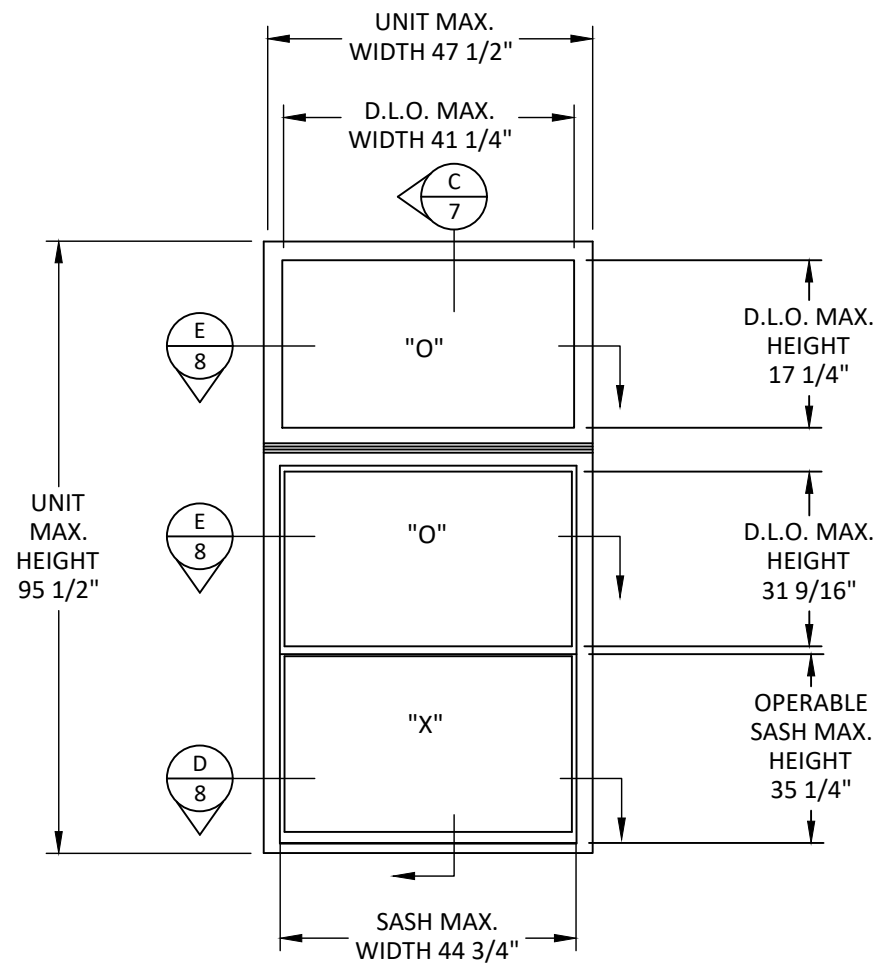

ELEVATION  
O/O/X

NOTE:  
1. ALL MULLED UNITS SHOWN ARE INTEGRAL  
MULLED UNITS.

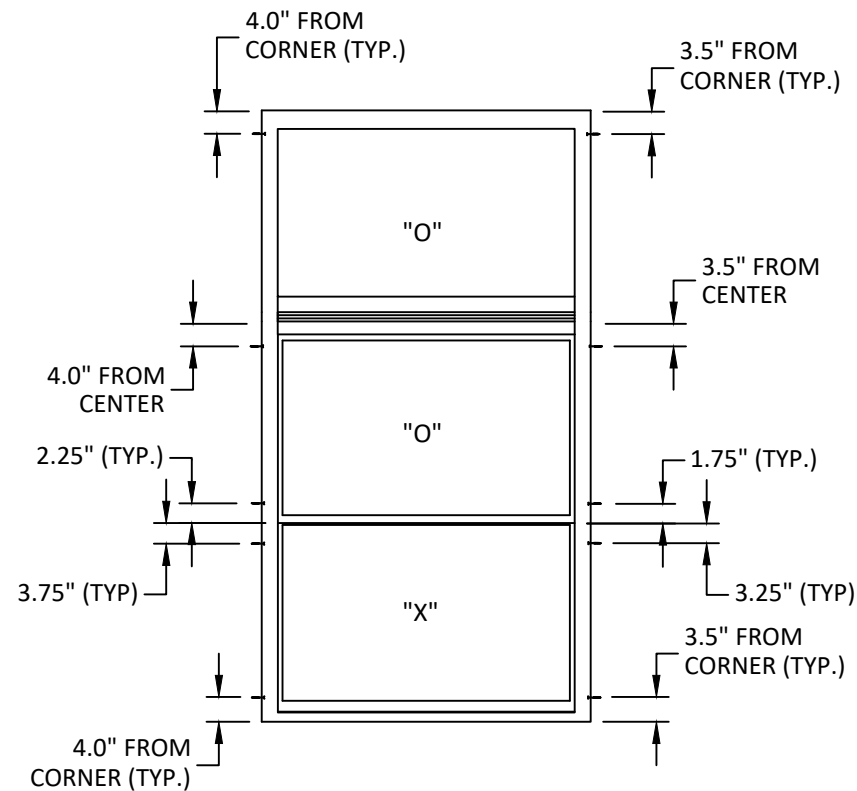

ANCHOR LAYOUT  
THROUGH FRAME/  
INSTALLATION CLIP



100 FOURTH AVE NORTH  
BAYPORT, MN 55003-1096  
PH: (651) 264-5150 FX: (651) 264-5485


TITLE: SERIES 100 SINGLE HUNG WINDOW  
WITH PG UPGRADE  
(NON-IMPACT) (NON-HVHZ)  
ELEVATION & ANCHOR LAYOUT

PREPARED BY:  
BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954) 399-8478  
FAX: (954) 744-4738  
WEB: www.buildingdrops.com



| REMARKS             | BY | DATE    |
|---------------------|----|---------|
| 8TH FBC CODE CHANGE | SH | 5.26.23 |
|                     |    |         |
|                     |    |         |
|                     |    |         |


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC  
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC  
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE  
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED  
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC  
DOCUMENTS FOR USE WITH THIS DOCUMENT.

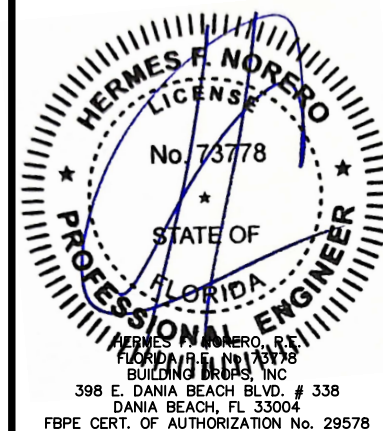


|          |            |
|----------|------------|
| FL #:    | FL15906    |
| DATE:    | 06.22.2018 |
| DWG. BY: | CHK. BY:   |
| JA       | HFN        |
| SCALE:   | NTS        |
| DWG. #:  | AWD239     |
| SHEET:   | 3          |




NOTE:  
1. ALL MULLED UNITS SHOWN ARE INTEGRAL  
MULLED UNITS.










NOTE:  
1. ALL MULLED UNITS SHOWN ARE INTEGRAL  
MULLED UNITS.



8/14/2023 2:25 PM  
s:\projects\andersen windows\cc-23-0347 - fbc 2023 code change (8th edition)\dwgs\115906\awd239.dwg

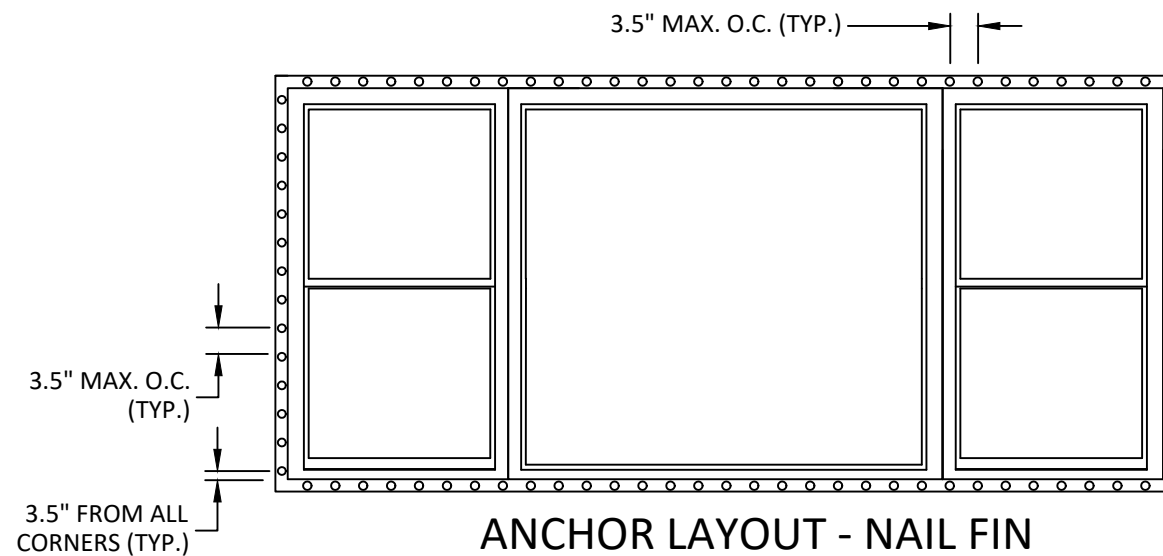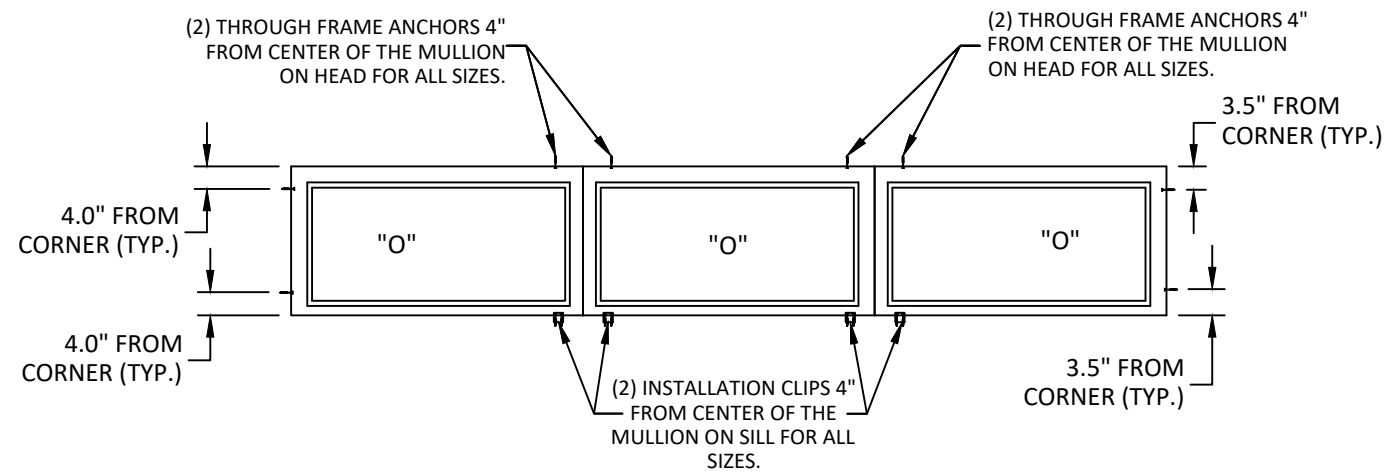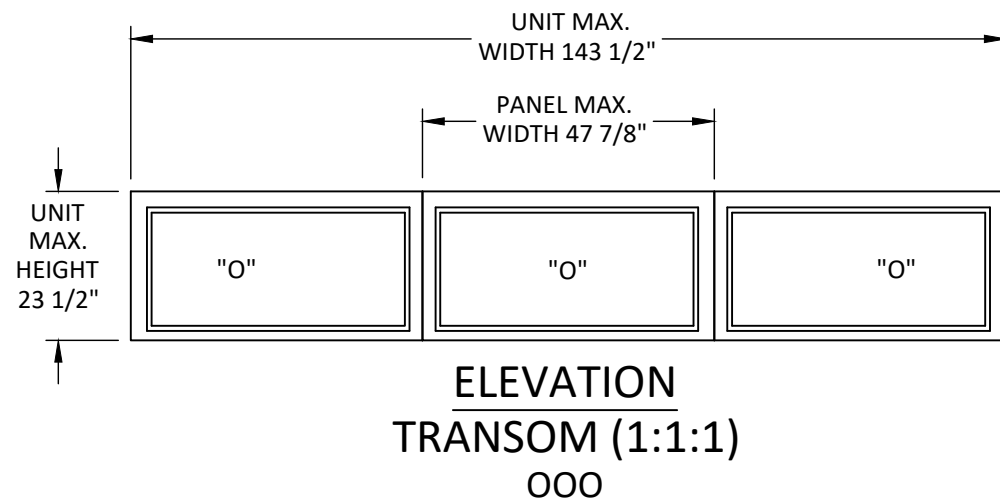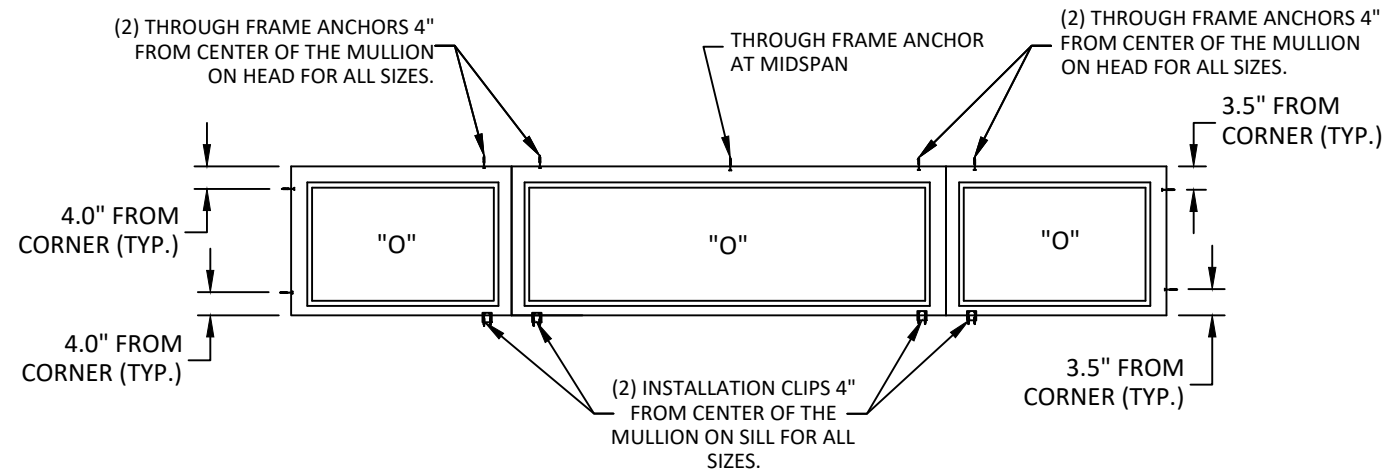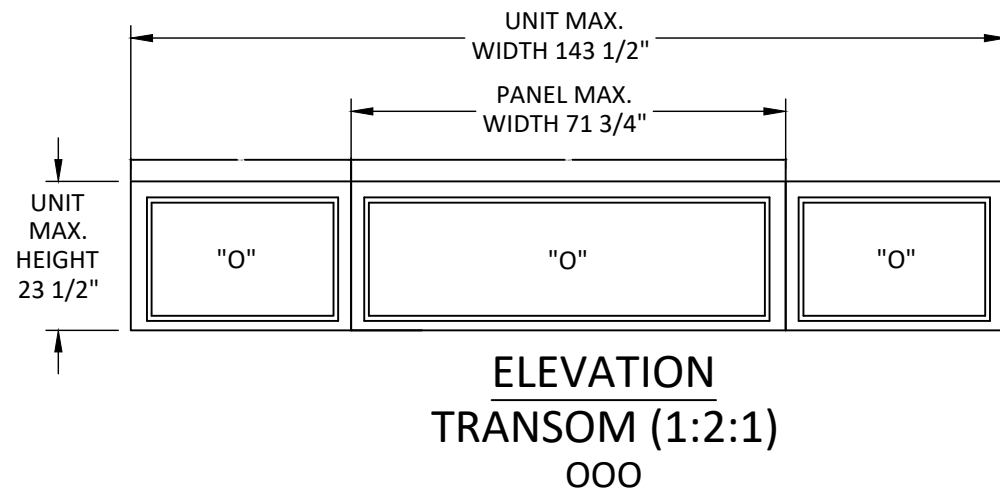

- NOTE:
1. ALL MULLED UNITS SHOWN ARE INTEGRAL MULLED UNITS.
  2. TRANSOMS APPROVED FOR USE ON MATCHING RATIOS, TWIN AND TRIPLE SINGLE HUNG WINDOWS ON PREVIOUS SHEETS.



100 FOURTH AVE NORTH  
BAYPORT, MN 55003-1096  
PH: (651) 264-5150 FX: (651) 264-5485

TITLE: SERIES 100 SINGLE HUNG WINDOW  
WITH PG UPGRADE  
(NON-IMPACT) (NON-HVHZ)

ELEVATIONS & ANCHOR LAYOUTS

PREPARED BY: BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954) 399-8478  
FAX: (954) 744-4738  
WEB: www.buildingdrops.com




| REMARKS             | BY | DATE    |
|---------------------|----|---------|
| 8TH FBC CODE CHANGE | SH | 5.26.23 |
|                     |    |         |
|                     |    |         |
|                     |    |         |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




|          |            |
|----------|------------|
| FL #:    | FL15906    |
| DATE:    | 06.22.2018 |
| DWG. BY: | CHK. BY:   |
| JA       | HFN        |
| SCALE:   | NTS        |
| DWG. #:  | AWD239     |
| SHEET:   | 6          |


8/14/2023 2:25 PM  
s:\projects\andersen windows\cc-23-0347 - fbc 2023 code change (8th edition)\dwgs\115906\awd239.dwg

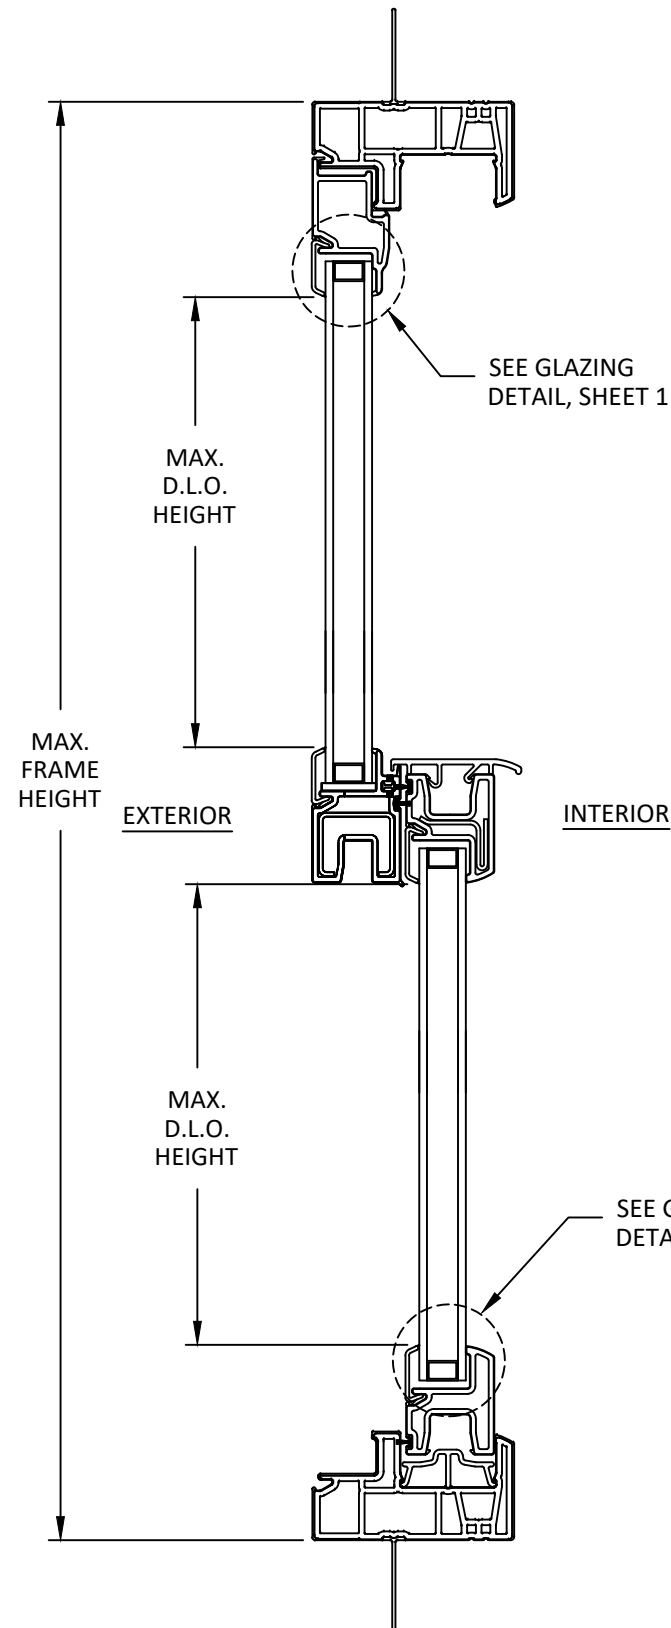

**A**  
**7** **VERTICAL SECTION**  
NAIL FIN INSTALLATION

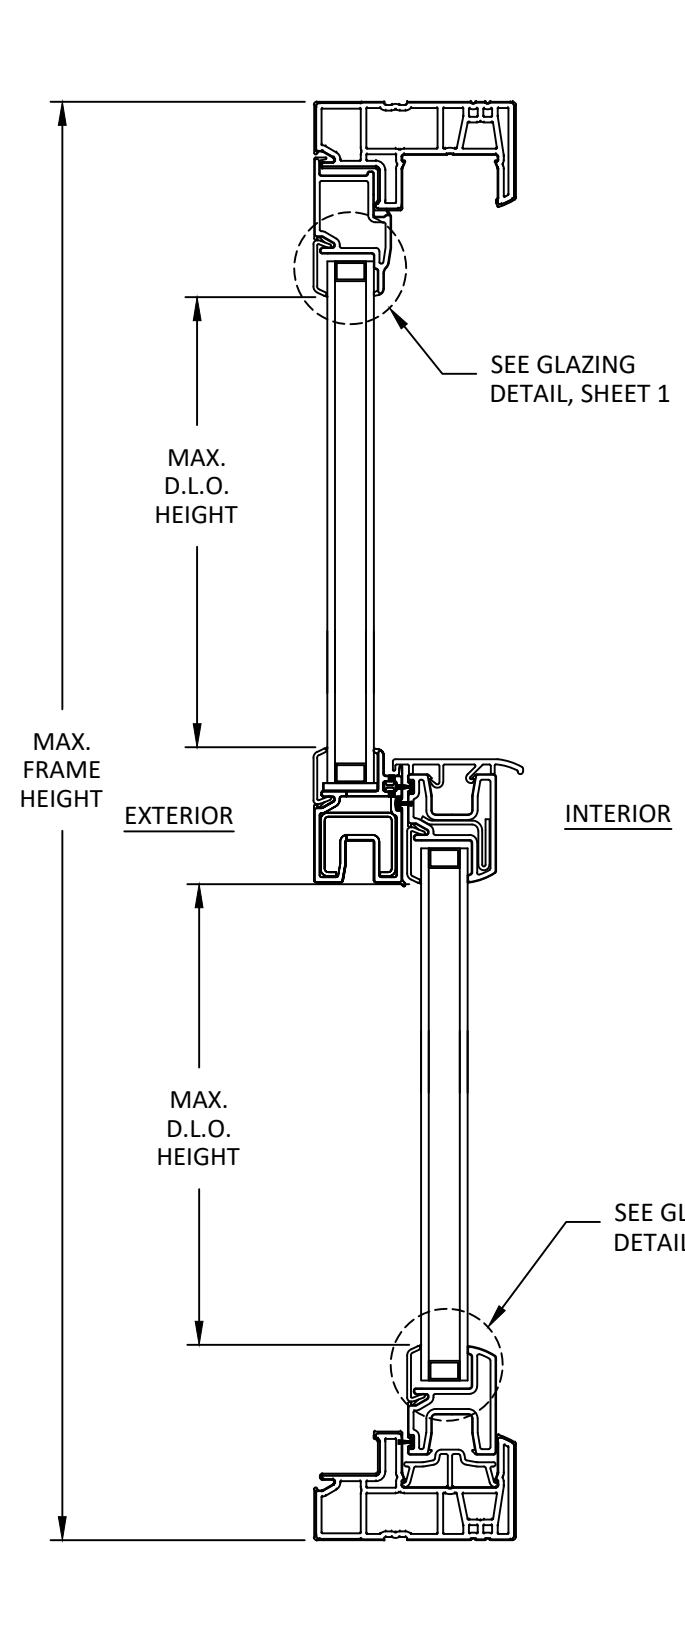

**B**  
**7** **VERTICAL SECTION**  
THROUGH FRAME/INSTALLATION CLIP

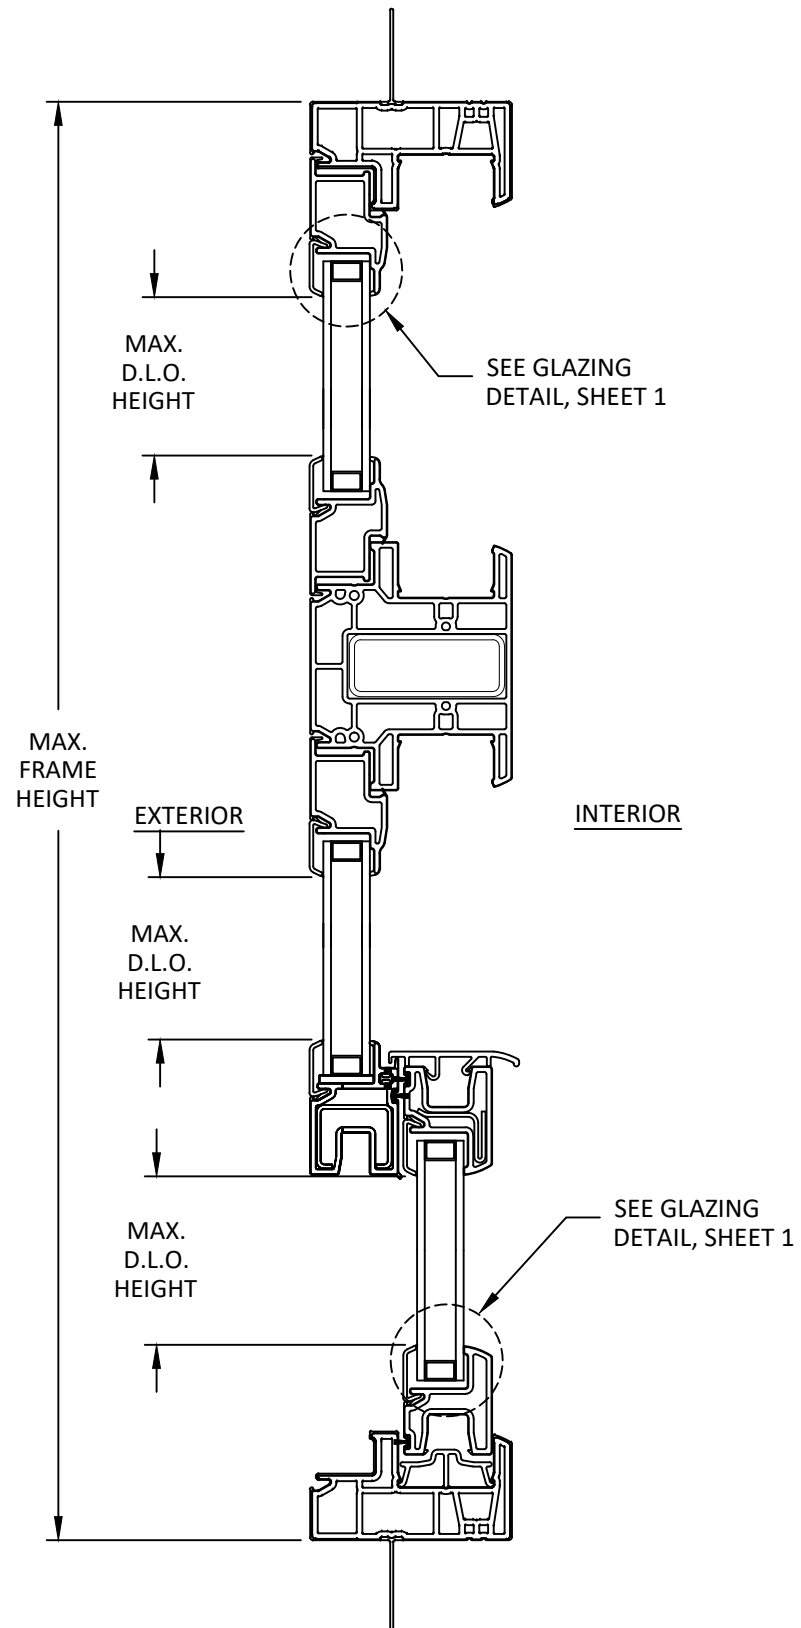

**C**  
**7** **VERTICAL SECTION**  
NAIL FIN INSTALLATION

NOTE:  
THE HORIZONTAL MULLION CAN BE COMBINED  
WITH NAIL FIN OR INSTALLATION CLIP SECTIONS.



100 FOURTH AVE NORTH  
BAYPORT, MN 55003-1096  
PH: (651) 264-5150 FX: (651) 264-5485

TITLE: SERIES 100 SINGLE HUNG WINDOW  
WITH PG UPGRADE  
(NON-IMPACT) (NON-HVHZ)


VERTICAL SECTIONS

PREPARED BY:  
**BUILDING DROPS, INC.**  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954) 399-8478  
FAX: (954) 744-4738  
WEB: www.buildingdrops.com

**BD**  
BUILDING DROPS

| REMARKS             | BY | DATE    |
|---------------------|----|---------|
| 8TH FBC CODE CHANGE | SH | 5.26.23 |
|                     |    |         |
|                     |    |         |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC  
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC  
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE  
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED  
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC  
DOCUMENTS FOR USE WITH THIS DOCUMENT.

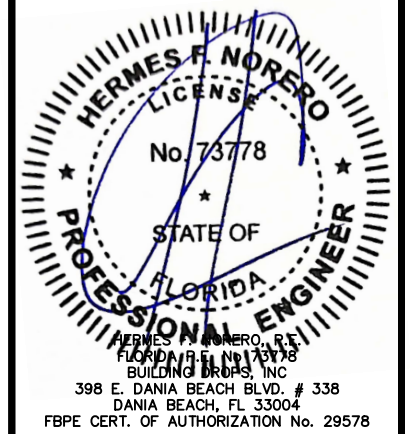

FL #:  
**FL15906**

DATE: **06.22.2018**


|                       |                        |
|-----------------------|------------------------|
| DWG. BY:<br><b>JA</b> | CHK. BY:<br><b>HFN</b> |
|-----------------------|------------------------|

SCALE: **NTS**


DWG. #: **AWD239**

SHEET:


s:\projects\andersen windows\cc-23-0347 - fbc 2023 code change (8th edition)\dwgs\115906\awd239.dwg 8/14/2023 2:25 PM

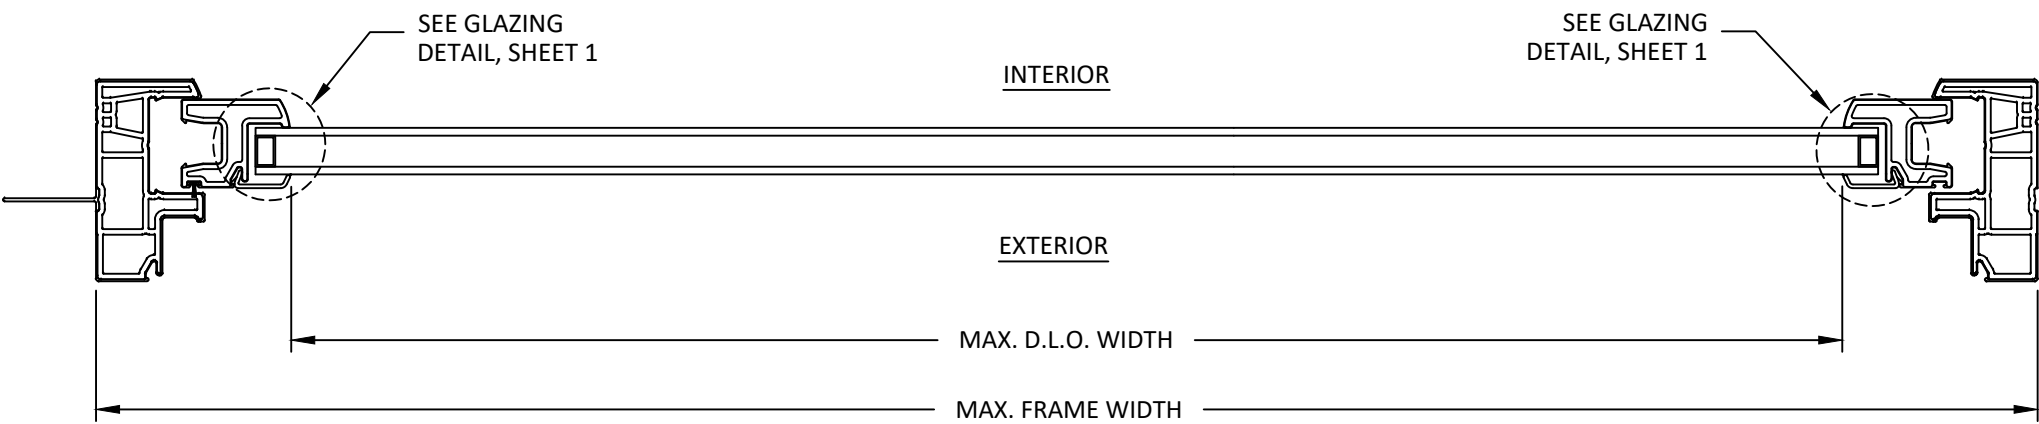

**D**  
**8** **HORIZONTAL SECTION**  
LOWER SASH  
NAIL FIN / TROUGH FRAME INSTALLATION

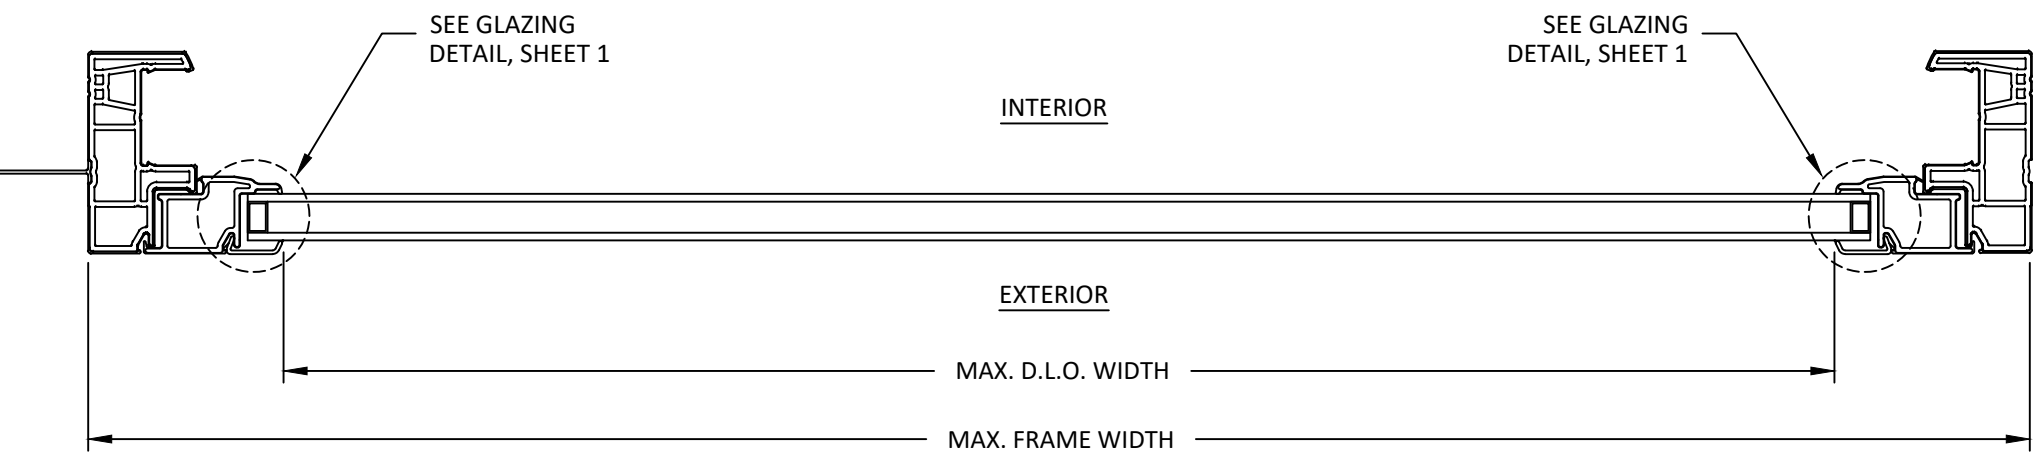

**E**  
**8** **HORIZONTAL SECTION**  
UPPER FIXED LITE  
NAIL FIN / TROUGH FRAME INSTALLATION

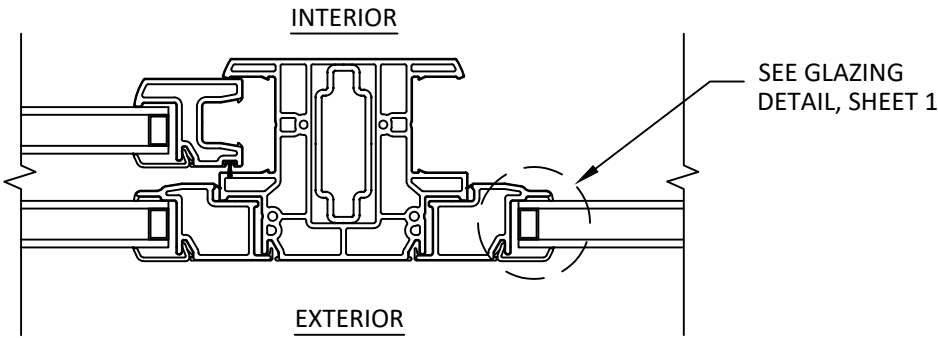

**F**  
**8** **HORIZONTAL SECTION**  
INTEGRAL MULLION POST



100 FOURTH AVE NORTH  
BAYPORT, MN 55003-1096  
PH: (651) 264-5150 FX: (651) 264-5485


TITLE: SERIES 100 SINGLE HUNG WINDOW  
WITH PG UPGRADE  
(NON-IMPACT) (NON-HVHZ)  
HORIZONTAL SECTIONS

PREPARED BY:  
**BUILDING DROPS, INC.**  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954) 399-8478  
FAX: (954) 744-4738  
WEB: www.buildingdrops.com




| REMARKS             | BY | DATE    |
|---------------------|----|---------|
| 8TH FBC CODE CHANGE | SH | 5.26.23 |
|                     |    |         |
|                     |    |         |
|                     |    |         |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

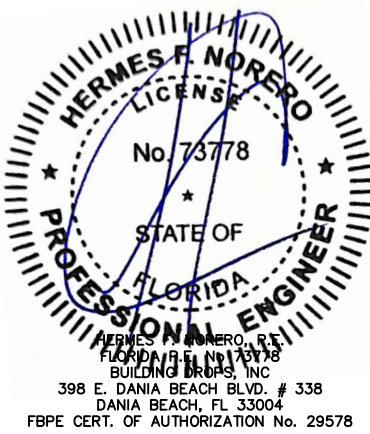


|          |                   |
|----------|-------------------|
| FL #:    | <b>FL15906</b>    |
| DATE:    | <b>06.22.2018</b> |
| DWG. BY: | JA                |
| CHK. BY: | HFN               |
| SCALE:   | <b>NTS</b>        |
| DWG. #:  | <b>AWD239</b>     |
| SHEET:   | <b>8</b>          |


s:\projects\andersen windows\cc-23-0347 - fbc 2023 code change (8th edition)\dwgs\115906\awd239.dwg 8/14/2023 2:25 PM

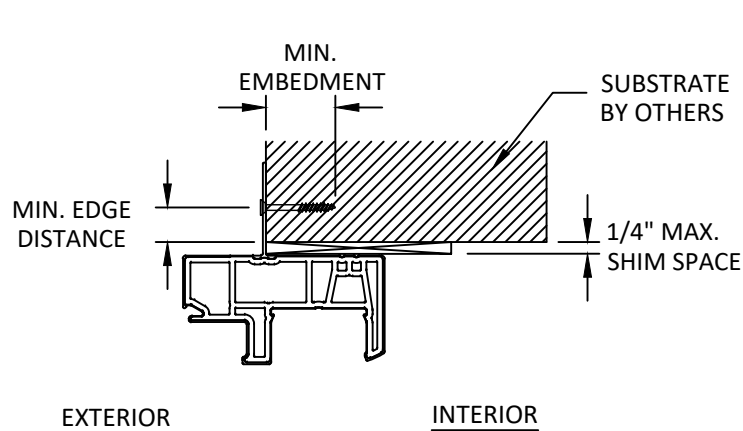


**A**  
**9** **VERTICAL SECTION**  
NAIL FIN (HEAD)  
SILL HAS SIMILAR DETAIL

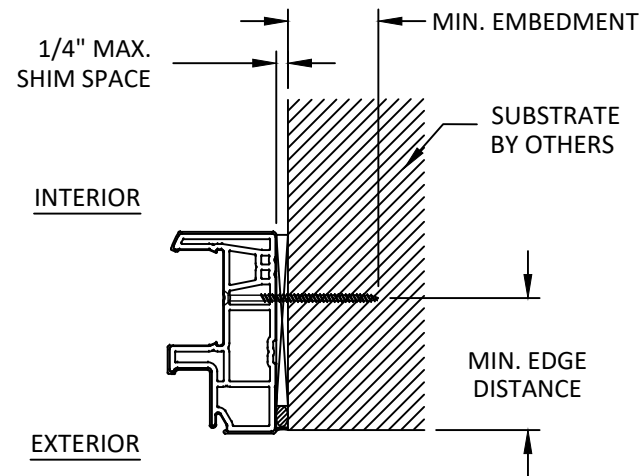


**D**  
**9** **HORIZONTAL SECTION**  
THROUGH FRAME (JAMB)

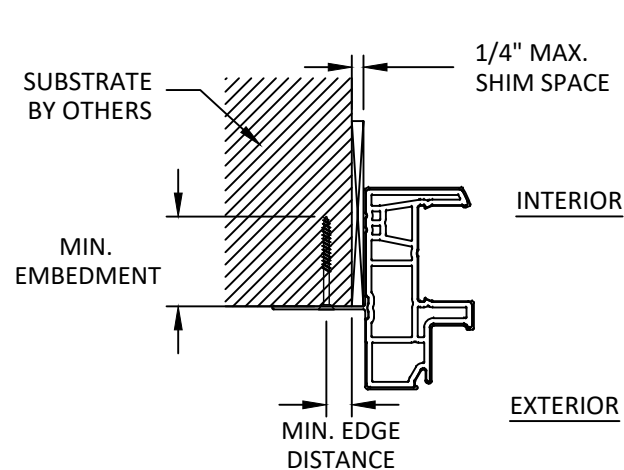


**B**  
**9** **HORIZONTAL SECTION**  
NAIL FIN (JAMB)

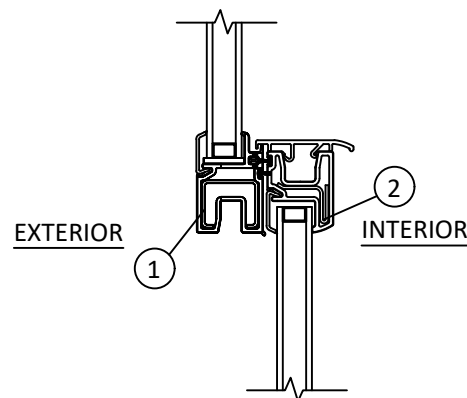

**E**  
**9** **VERTICAL SECTION**  
MEETING RAIL

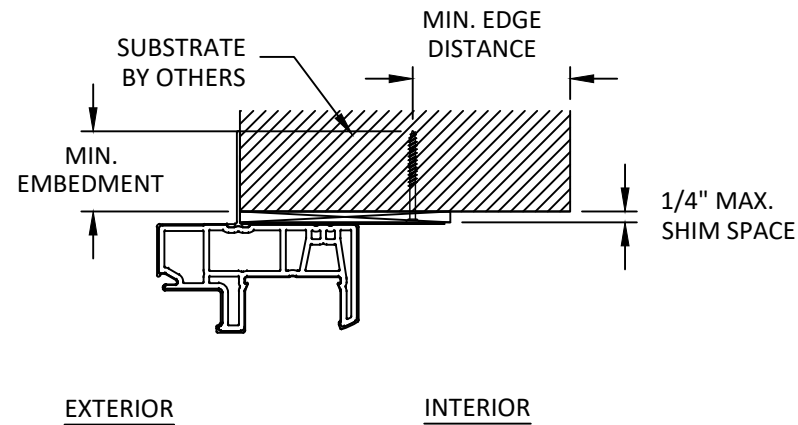

**C**  
**9** **VERTICAL SECTION**  
INSTALLATION CLIP (HEAD)  
SILL HAS SIMILAR DETAIL

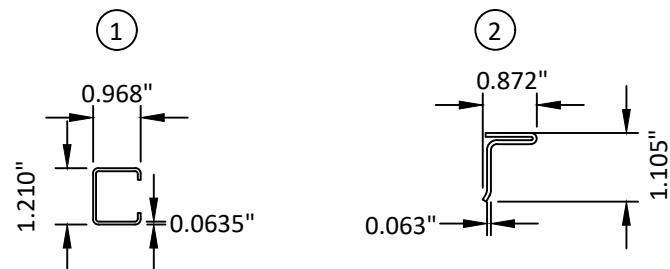

**INTERLOCK REINFORCEMENTS**  
**GALVANIZED STEEL**

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN UNLESS OTHERWISE SPECIFIED.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF  $\pm 1/2$  INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER. FOR NAIL FIN INSTALLATION, THE QUANTITY AND PLACEMENT OF SHIMS TO BE SUCH AS TO MAINTAIN PLUM AND LEVEL OF WINDOWS.
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

| ANCHOR SCHEDULE                      |                                            |                                            |                                              |                    |
|--------------------------------------|--------------------------------------------|--------------------------------------------|----------------------------------------------|--------------------|
| METHOD                               | SUBSTRATE                                  | ANCHOR SCHEDULE                            | MIN EMBEDMENT                                | MIN. EDGE DISTANCE |
| NAILING FIN                          | WOOD: MIN. SG = 0.55                       | #8 WOOD SCREW<br>PAN HEAD                  | 1.5"                                         | 0.75"              |
|                                      | WOOD: MIN. SG = 0.55                       | 8D COMMON NAIL                             | 1.5"                                         | 0.75"              |
| INSTALLATION CLIP /<br>THROUGH FRAME | METAL: 18 GAUGE<br>STEEL, MIN. Fy = 33KSI  | #8 TEK SCREW                               | 3 THREADS MIN<br>PENETRATION BEYOND<br>METAL | 0.50"              |
|                                      | WOOD: MIN. SG = 0.55                       | #10 WOOD SCREW                             | 1.5"                                         | 0.75"              |
|                                      | METAL: 18 GAUGE<br>STEEL, MIN. Fy = 33KSI  | #10 SELF-DRILLING OR<br>SELF-TAPPING SCREW | 3 THREADS MIN<br>PENETRATION BEYOND<br>METAL | 0.50"              |
|                                      | CONCRETE: f'c=3000PSI                      | 3/16" ITW TAPCON<br>FLAT HEAD              | 1.25"                                        | 2.25"              |
|                                      | MASONRY: CMU per<br>ASTM C90 MIN. 2000 PSI | 3/16" ITW TAPCON<br>FLAT HEAD              | 1"                                           | 2"                 |




100 FOURTH AVE NORTH  
BAYPORT, MN 55003-1096  
PH: (651) 264-5150 FX: (651) 264-5485

TITLE: SERIES 100 SINGLE HUNG WINDOW  
WITH PG UPGRADE  
(NON-IMPACT) (NON-HVHZ)  
ANCHOR DETAILS, INSTALLATION NOTES,  
& REINFORCEMENT DETAILS  
PREPARED BY:  
BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD., STE. 338  
DANIA BEACH, FL 33004  
PH: (954) 399-8478  
FAX: (954) 744-4738  
WEB: www.buildingdrops.com

| REMARKS             | BY | DATE    |
|---------------------|----|---------|
| 8TH FBC CODE CHANGE | SH | 5.26.23 |
|                     |    |         |
|                     |    |         |
|                     |    |         |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC  
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC  
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE  
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED  
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC  
DOCUMENTS FOR USE WITH THIS DOCUMENT.

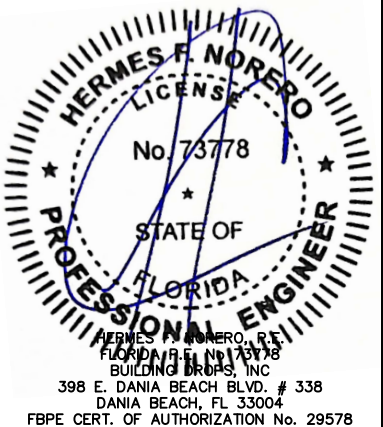

FL #:  
**FL15906**

DATE: **06.22.2018**

DWG. BY: **JA** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **AWD239**

SHEET:  
**9**  
OF 9