

c:\users\sebastian\hereros\building drops. inc\building drops landing - common\projects\2026 code change projects\caoba doors\cc-26-0457 2 - 2026 code change - 1711.dwg
8/17/2026 6:29 PM
cab044.dwg

INSTALLATION NOTES:

1.

THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR TYP. PRODUCT INSTALLATION.
2.

MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
3.

USE ONE (1) INSTALLATION ANCHOR PER TRACK, PER LOCATION FOR EACH ANCHOR LOCATION SHOWN ON HEAD AND SILL. (SEE SHEET 3)
4.

USE TWO (2) INSTALLATION ANCHORS THROUGH POCKET JAMBS AT EACH ANCHOR LOCATION SHOWN ON POCKET APPLICATIONS. (SEE SHEET 3)
5.

USE MINIMUM ONE (1) INSTALLATION ANCHOR THROUGH JAMBS AT EACH ANCHOR LOCATION SHOWN. (SEE SHEET 3)
6.

FOR INSTALLATION INTO WOOD FRAMING, USE #12 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT. WOOD INSTALLATION ANCHORS SHALL MAINTAIN MINIMUM 3/4" EDGE DISTANCE & 3" MIN. O.C. SPACING.
7.

FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY OR DIRECTLY INTO CONCRETE/MASONRY, USE 1/4 INCH ITW TAPCONS OF SUFFICIENT LENGTH TO ACHIEVE 1 5/8 INCH MINIMUM EMBEDMENT THROUGH HEAD, JAMB, OR RAISED SILL FRAME.
8.

FOR INSTALLATION THROUGH GROUT INTO CONCRETE, USE 3/8 INCH ITW REDHEAD TRUBOLT WEDGE ANCHORS OF SUFFICIENT LENGTH TO ACHIEVE 1 5/8 INCH MINIMUM EMBEDMENT AT FLUSH SILL TRACK. CONCRETE/MASONRY ANCHORS SHALL MAINTAIN A MIN. EDGE DISTANCE 2 5/8" & 4" MIN. O.C. SPACING.
9.

INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING:

•

FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).

•

CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
10.

FOR GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
11.

INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
12.

INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:

A.

WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.

B.

CONCRETE -MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.

C.

GROUT - NON-SHRINK, NON-METALLIC, MINIMUM F'c = 2000 PSI

D.

MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, F'c = 2000 PSI.

GENERAL NOTES:

1.

THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ.

•

TAS 201-94

•

TAS 202-94

•

TAS 203-94
2.

ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3.

1X BUCKS, 2X BUCKS, AND/OR JAMB POCKET STUD WALLS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK AND POCKET DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4.

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT TO BE REVIEWED BY BUILDING OFFICIAL OR AUTHORITY HAVING JURISDICTION (AHJ).
5.

APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE UP INCLUDING WIND ZONE 4 AND HVHZ AS SPECIFIED IN CH16 OF THE FBC.
6.

DOOR FRAME MATERIAL: MAHOGANY (MIN. S.G. = 0.42)
DOOR PANEL MATERIAL: SOLID MAHOGANY W/ MAHOGANY VENEER (S.G. = 0.42)
7.

GLASS MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 5 FOR GLAZING DETAILS.
8.

IN ACCORDANCE WITH THE FBC, WOOD COMPONENTS SHALL HAVE BEEN PRESERVATIVE TREATED OR SHALL BE OF A DURABLE SPECIES.
9.

STEEL COMPONENTS SHALL BE COATED OR PROVIDED WITH CORROSION RESISTANCE PROTECTION IN CONFORMANCE WITH THE MATERIAL PROTECTION PROVISIONS OF THE FBC.
10.

IN ACCORDANCE WITH THE FBC, DISSIMILAR METALS INCLUDING FASTENERS THAT MAY COME INTO CONTACT WITH ALUMINUM UNIT FRAMING SHALL BE PROTECTED.
11.

DESIGNATIONS "X" AND "O" STAND FOR THE FOLLOWING:

X:

OPERABLE PANEL

O:

FIXED PANEL

P:

POCKET
12.

APPROVED CONFIGURATIONS INCLUDE:

1 TRACK

- PX-XP, PX, XP

2 TRACK

- PXX-XXP, OX-XXP, PXX-XO, PXX, XXP, OX-XO, OX, XO, OXO

3 TRACK

- PXXX, XXXP, XXO, OXX, PXXX-XXXP, OXX-XXO, PXXX-XXO, OXX-XXXP

4 TRACK

- PXXXX, XXXXP, OXXX, XXXO, PXXXX-XXXXP, OXXX-XXXO, PXXXX-XXXO, OXXX-XXXXP

5 TRACK

- XXXXP, PXXXX, OXXXX, XXXXO, PXXXX-XXXXXP, OXXXX-XXXO, PXXXX-XXXO, OXXXX-XXXXP

MULTIPLE CONTINUOUS PANELS ARE QUALIFIED BY TESTING OF 6-PANEL CONFIGURATIONS.

MAX. ALLOWED FRAME SIZE

1.5 x 244 SQ. FT. (TESTED SIZE) = 366 SQ. FT.

SUCH THAT THE MAXIMUM PANEL SIZE, AS SHOWN HEREIN, IS NOT EXCEEDED.

CAOBA DOORS

ALUMINUM CLAD LIFT & SLIDE DOOR

(HVHZ)(IMPACT)

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	ELEVATION
3	ANCHOR LAYOUT
4	VERTICAL SECTIONS
5	VERTICAL SECTIONS AND GLAZING DETAILS
6	HORIZONTAL SECTIONS
7	HORIZONTAL SECTIONS
8	HORIZONTAL SECTIONS & DETAILS
9	COMPONENTS
10	COMPONENTS
11	COMPONENTS
12	COMPONENTS & B.O.M
13	COMPONENTS & BOLT DETAILS

DESIGN PRESSURE RATING		
GLAZE TYPE	DESIGN PRESSURE	MISSILE IMPACT RATING
1-3	+/- 47.50 PSF	LARGE AND SMALL MISSILE IMPACT RATED

caoba[®]

DOORS

4918 CEDAR AVENUE
PHILADELPHIA, PA 19143

PH: (215) 525-5048 FX: (215) 747-8908

TITLE: ALUMINUM CLAD LIFT & SLIDE DOOR (HVHZ)(IMPACT)

INSTALLATION & GENERAL NOTES

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

BD

BUILDING DROPS

REMARKS

BY

DATE

2026 FBC UPDATE

LS

07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.08.15 15:56:47 -03'00'

HERMES F. NORERO

LICENSE

No. 73778

STATE OF FLORIDA

PROFESSIONAL ENGINEER

HERMES F. NORERO, P.E.

BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15

MIAMI, FL 33132

FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL15927

DATE:

11.02.20

DWG. BY:

CHK. BY:

RV

HFN

SCALE:

NTS

DWG. #:

CAB044

SHEET:


REV.

1


A

OF 13

c:\users\sebastian\hereros\building drops, inc\building drops landing - common\projects\2026 code change - 1711\dwgs\115927-6\aluminum clad lift & slide door fl15927 cab044.dwg 8/17/2026 6:29 PM

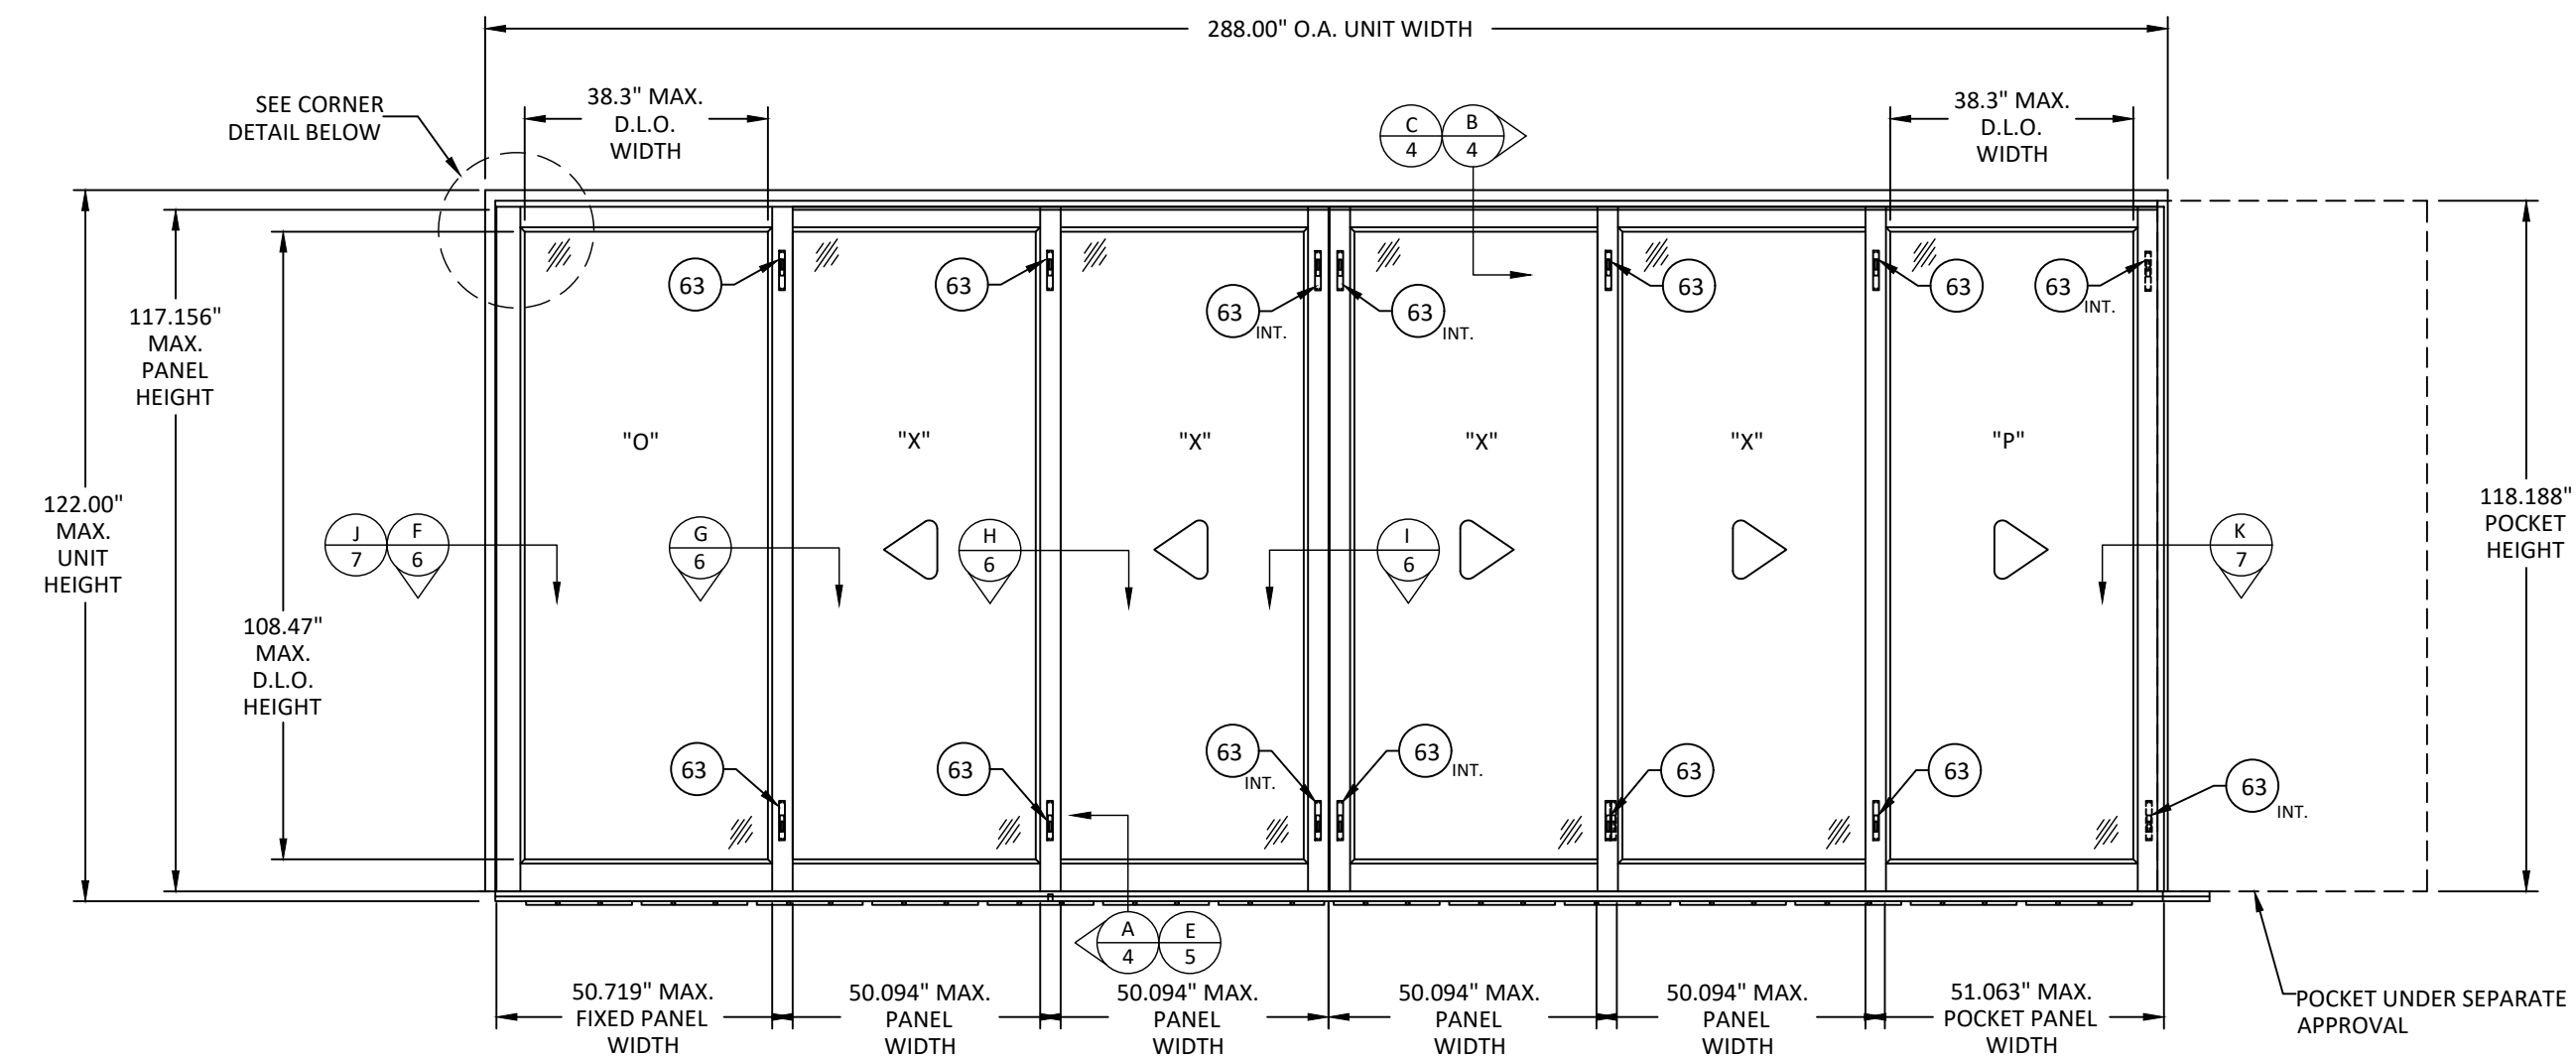

FRAMES WERE COPED AND BUTTED, CORNERS UTILIZED FIVE (5) #8 X 3" F.H. WOOD SCREWS. ALL SEAMS WERE SEALED WITH MARINE GLUE

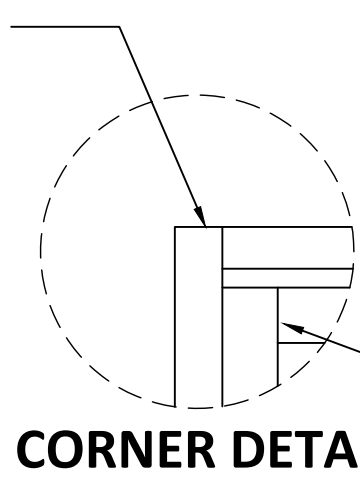

CORNER DETAIL

- PANEL CONSTRUCTION NOTES:
1. ALL PANEL VERTICAL STILES AND HORIZONTAL RAILS ARE TO BE CONSTRUCTED OF SOLID MAHOGANY PIECES, GLUED TOGETHER WITH A 1/4" THICK MAHOGANY VENEER AT THE SURFACE.
 2. PANEL STILES AND RAILS UTILIZED MORTISE AND TENON CONSTRUCTION WITH ADHESIVE COMPOUND SECURED TO THE JAMB, INTERLOCK, LOCK, AND POCKET STILES.

MAX. ALLOWED FRAME SIZE
1.5 x 244 SQ. FT. (TESTED SIZE) = 366 SQ. FT.
SUCH THAT THE MAXIMUM PANEL SIZE, AS SHOWN
HEREIN, IS NOT EXCEEDED.

PANEL RAILS AND STILES UTILIZED MORTISE AND TENON CONSTRUCTION AND ARE MARINE GLUED TOGETHER.

LIFT & SLIDE HARDWARE OPTIONS	
OPTION	DESCRIPTION
1	LIFT & SLIDING HARDWARE KIT BY SIEGENIA, SERIES HS300.
2	LIFT & SLIDING HARDWARE KIT BY FFI, SERIES SST 439.
THROW BOLT OPTIONS	
OPTION	DESCRIPTION
1	USE 12" SOLID BRASS DELTANA FLUSH BOLTS (ITEM #63), APPLIED TOP & BOTTOM, AT THE INTERIOR AND EXTERIOR OF EACH INTERLOCKING STILE; AT THE TOP AND BOTTOM INTERIOR OF EACH MEETING STILE AND POCKET STILE. SEE DETAIL O/13 FOR TYP. BOLT DETAILS. (SHOWN IN ELEVATION)
2	USE CENTOR DROP BOLTS (ITEM #65) AT INTERLOCK STILE EDGES, TOP & BOTTOM. USE 12" SOLID BRASS DELTANA FLUSH BOLTS (ITEM #63), APPLIED AT THE TOP AND BOTTOM INTERIOR OF EACH MEETING STILE. SEE DETAILS N/13 & O/13 FOR TYP. BOLT DETAILS.
3	FOR UP TO FOUR (4) PANEL CONFIGURATIONS ONLY, USE CENTOR DROP BOLTS (ITEM #65) AT INTERLOCK STILE EDGES, TOP & BOTTOM. SEE DETAIL N/13 FOR TYP. BOLT DETAILS.
4	FOR RAISED SILL UNITS ONLY, IN LIEU OF BOLTS, USE TWO (2) RETAINER BLOCKS (ITEM #66) AT THE HEAD OF EACH ACTIVE PANEL. SEE DETAIL P/13 FOR TYP. BLOCK DETAILS.



4918 CEDAR AVENUE
PHILADELPHIA, PA 19143
PH: (215) 525-5048 FX: (215) 747-8908


TITLE: ALUMINUM CLAD LIFT & SLIDE DOOR (HVHZ)/(IMPACT) ELEVATION

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com






REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

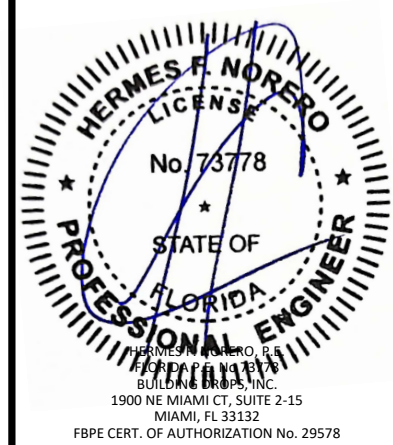

FL #:	FL15927
DATE:	11.02.20
DWG. BY:	RV
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	CAB044
SHEET:	2
REV.	A

c:\users\sebastian\hereros\building drops, inc\building drops, inc\projects\2026 code change projects\caoba doors\2026 code change - 1711\dwgs\115927-6\aluminum clad lift & slide door fl15927_cab044.dwg 8/17/2026 6:29 PM

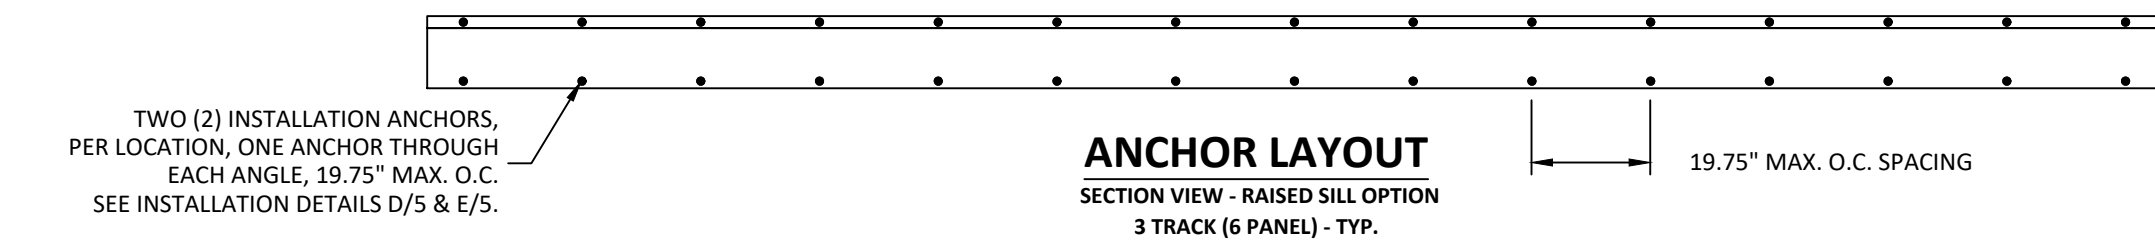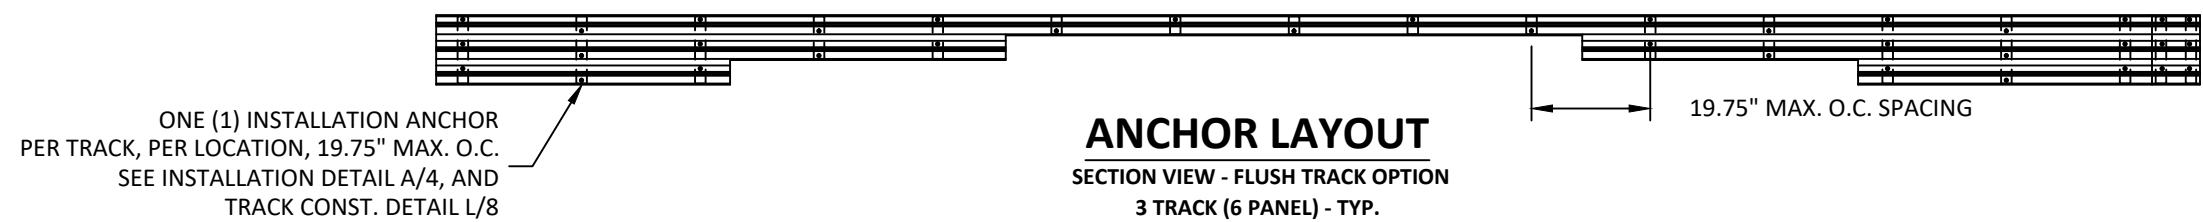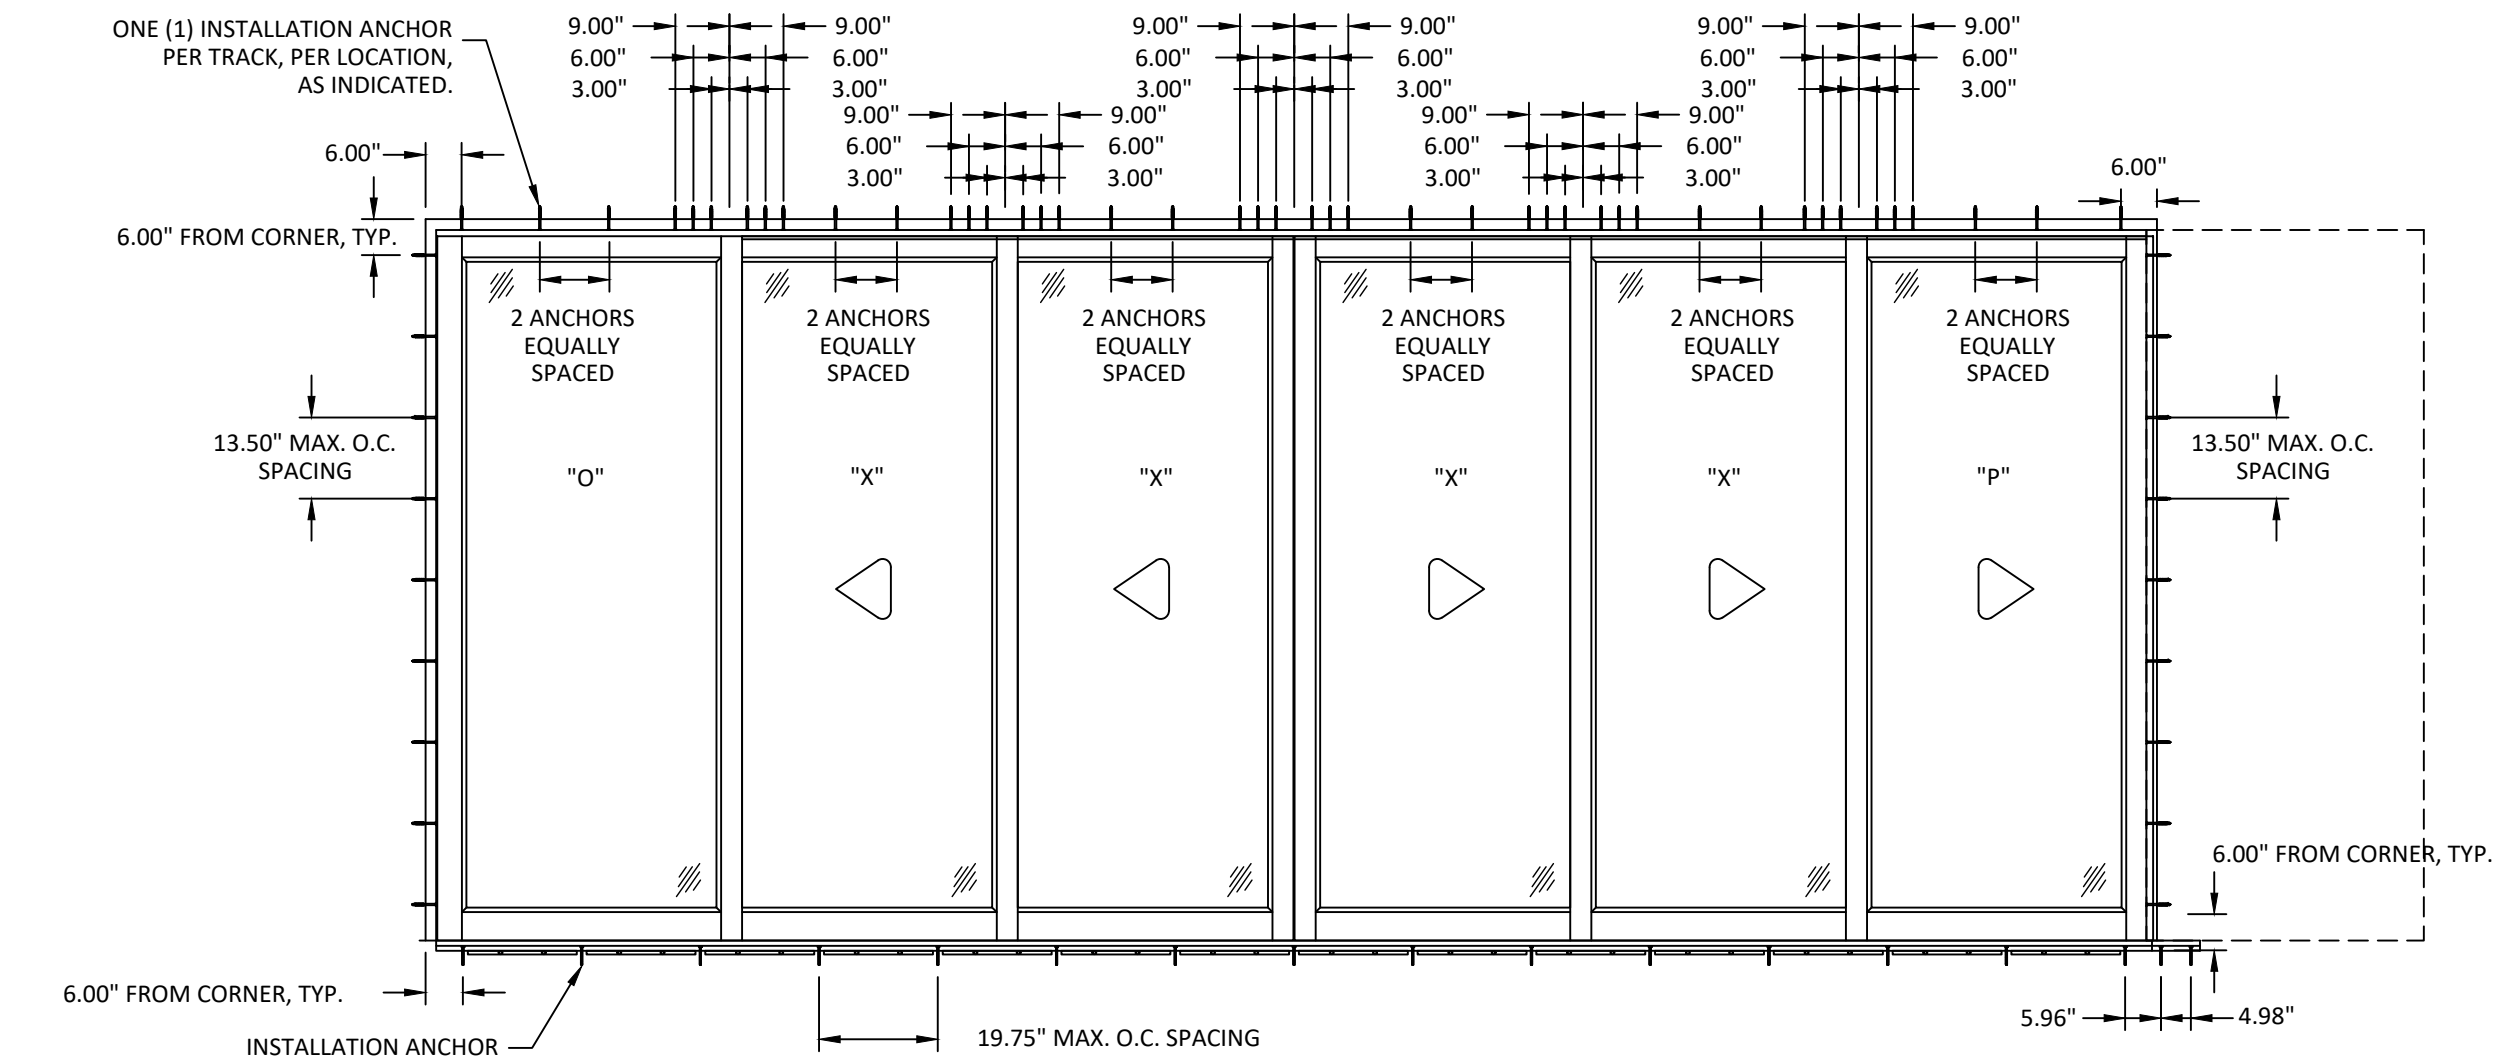


4918 CEDAR AVENUE
PHILADELPHIA, PA 19143
PH: (215) 525-5048 FX: (215) 747-8908

TITLE: ALUMINUM CLAD LIFT & SLIDE DOOR (HVHZ)(IMPACT) ANCHOR LAYOUT

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

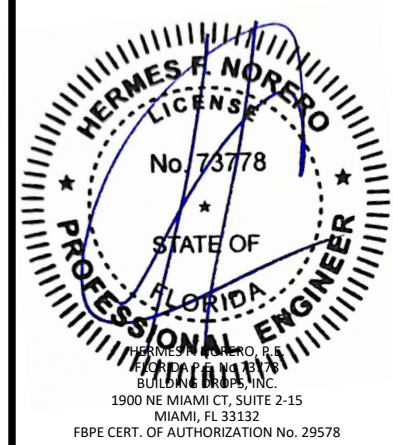

FL #: **FL15927**

DATE: **11.02.20**

DWG. BY: **RV** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **CAB044**


SHEET: **3** REV. **A**

OF 13


c:\users\sebastianh\documents\building drops, inc\building drops landing - common\projects\caoba doors\cc-26-0457 2 - 2026 code change - 1711.dwg
8/17/2026 6:29 PM
cab044.dwg

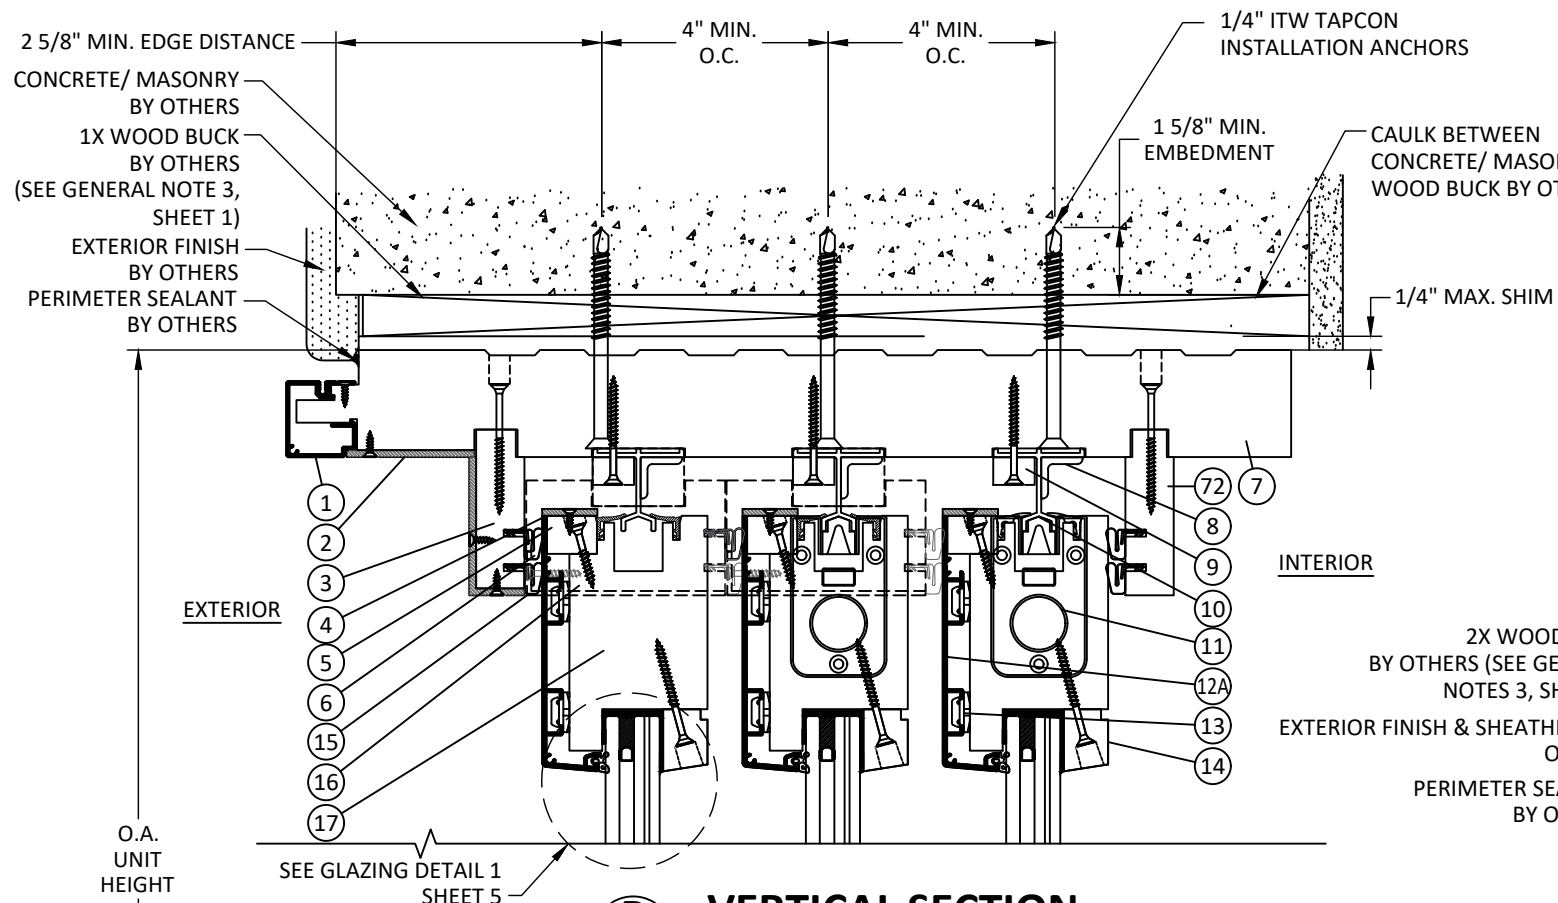

B
4
VERTICAL SECTION
CONCRETE/MASONRY - HEAD
3 TRACK

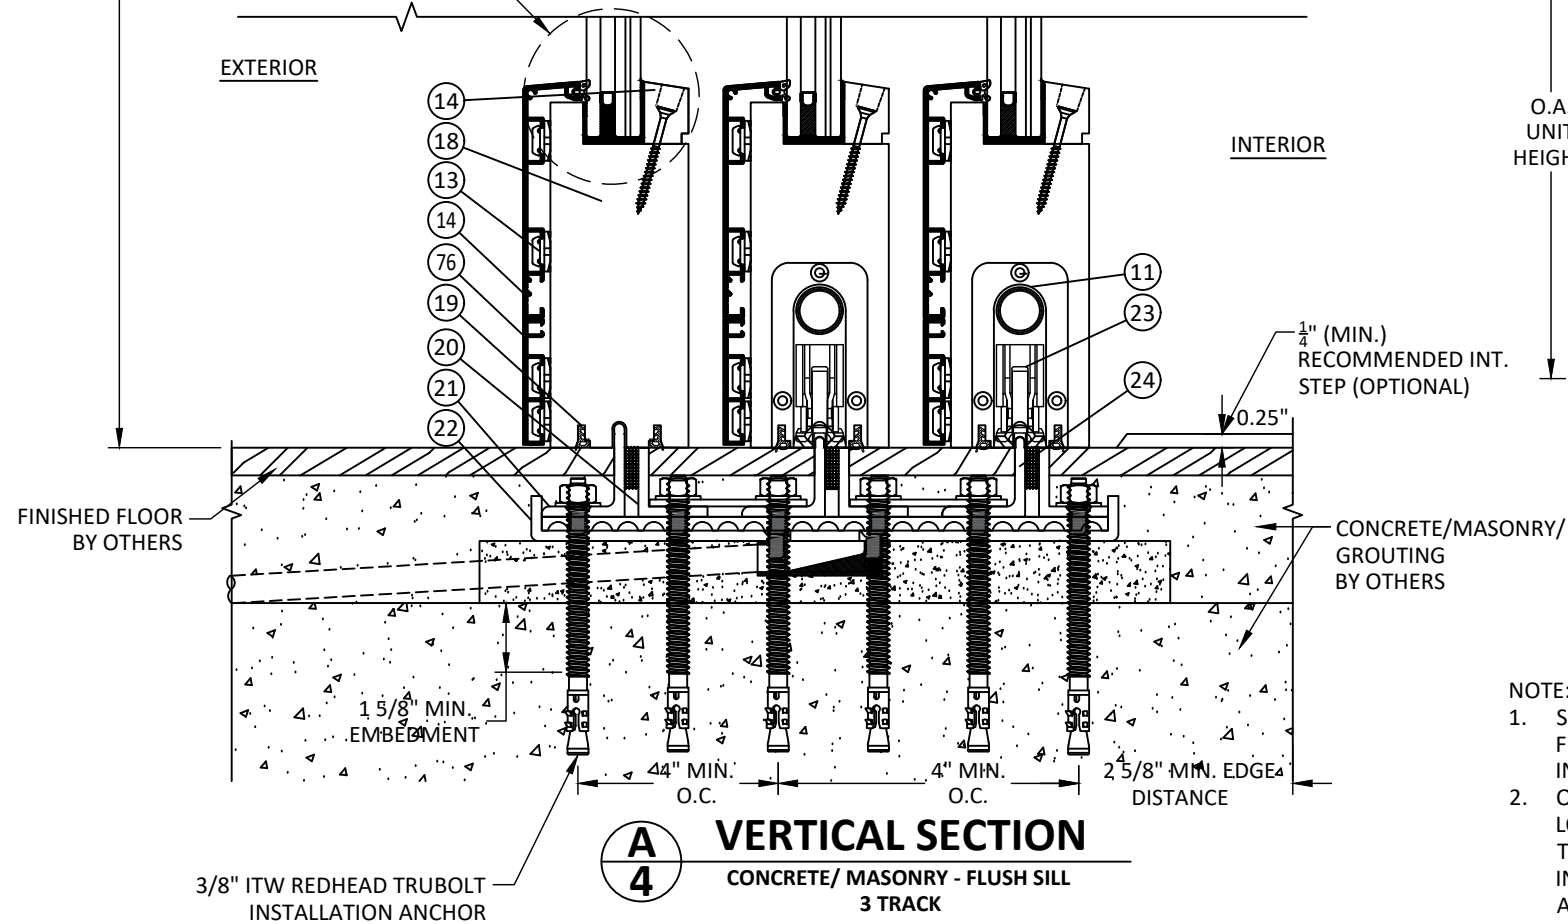

A
4
VERTICAL SECTION
CONCRETE/MASONRY - FLUSH SILL
3 TRACK

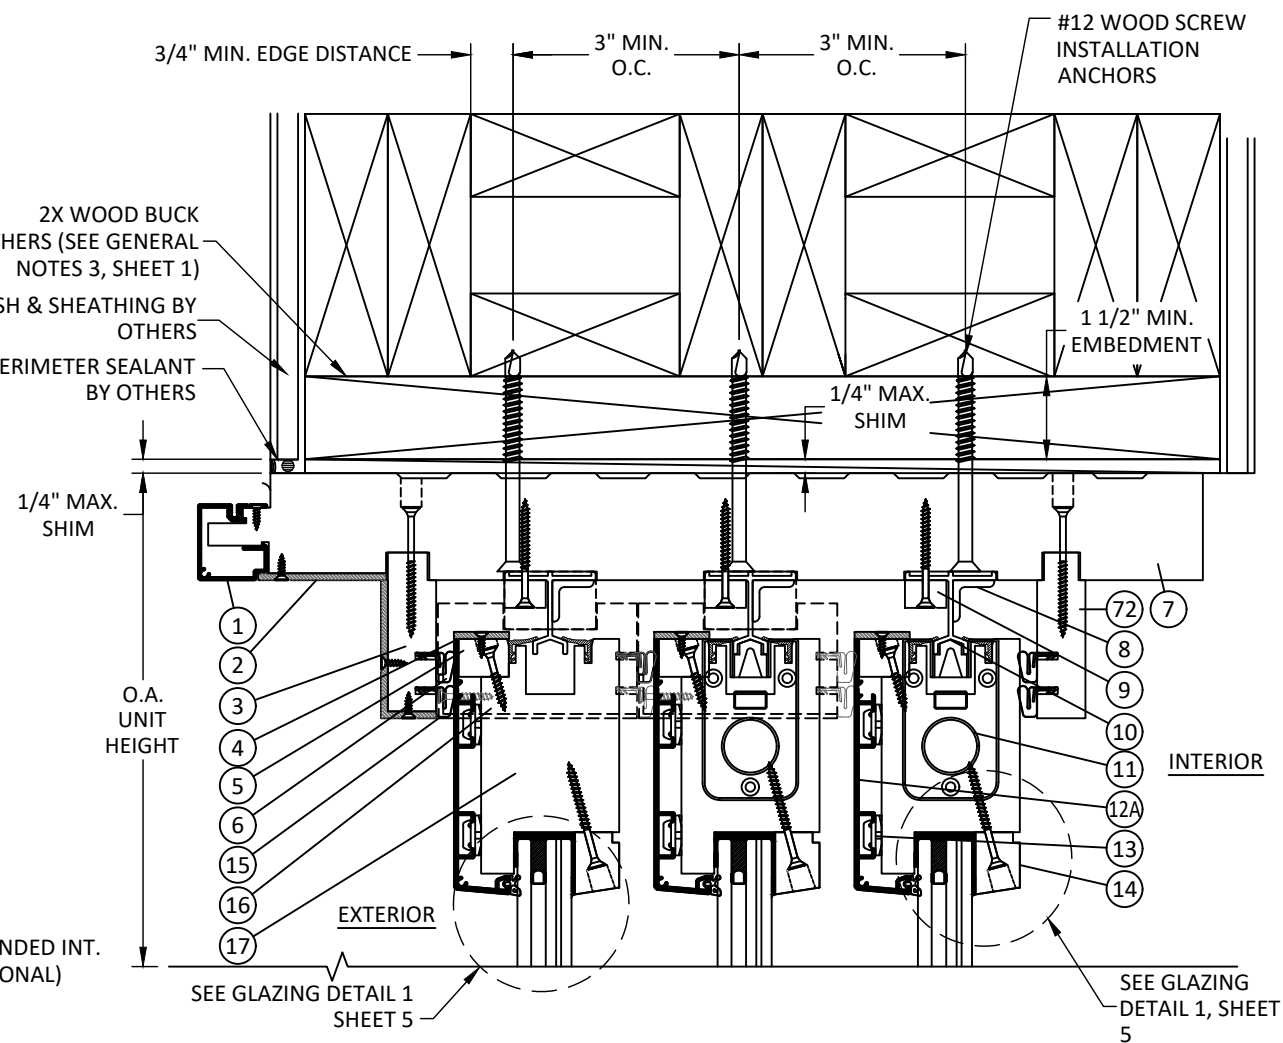

C
4
VERTICAL SECTION
2X WOOD BUCK - HEAD
3 TRACK

NOTE:

- SEE DETAIL L/8 & ITEM #62 COMPONENT DETAILS FOR FURTHER REQUIREMENTS OF FLUSH SILL INSTALLATION.
- ONE (1) INSTALLATION ANCHOR PER TRACK PER LOCATION INDICATED IN ANCHOR LAYOUT. SINGLE TRACK SECTIONS SHALL BE INSTALLED WITH TWO (2) INSTALLATION ANCHORS, ONE (1) AT THE INTERIOR AND EXTERIOR MOST ANGLES.

caoba
DOORS

4918 CEDAR AVENUE
PHILADELPHIA, PA 19143

PH: (215) 525-5048 FX: (215) 747-8908

TITLE: ALUMINUM CLAD LIFT &
SLIDE DOOR
(HVHZ)(IMPACT)

VERTICAL SECTIONS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

BD
BUILDING DROPS


REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

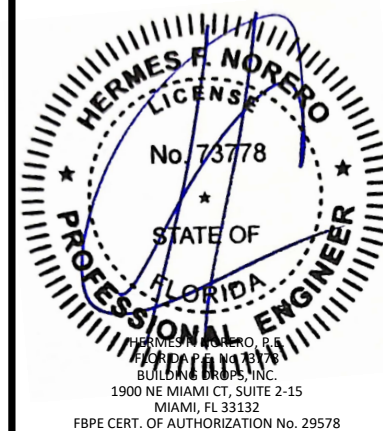


FL #:	FL15927
DATE:	11.02.20
DWG. BY:	RV
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	CAB044
SHEET:	4
REV.	A


c:\users\sebastian\hereros\building drops, inc\building drops landing - common\projects\caoba doors\cc-26-04572-2 - 2026 code change - 1711.dwg (115927-6)\aluminum clad lift & slide door-f15927_cab044.dwg 8/17/2026 6:29 PM

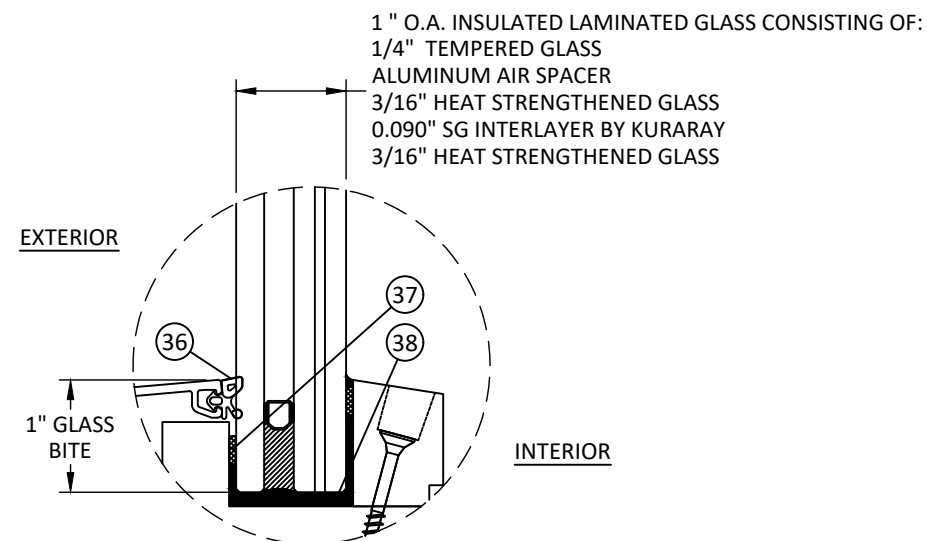


GLAZING DETAIL 1

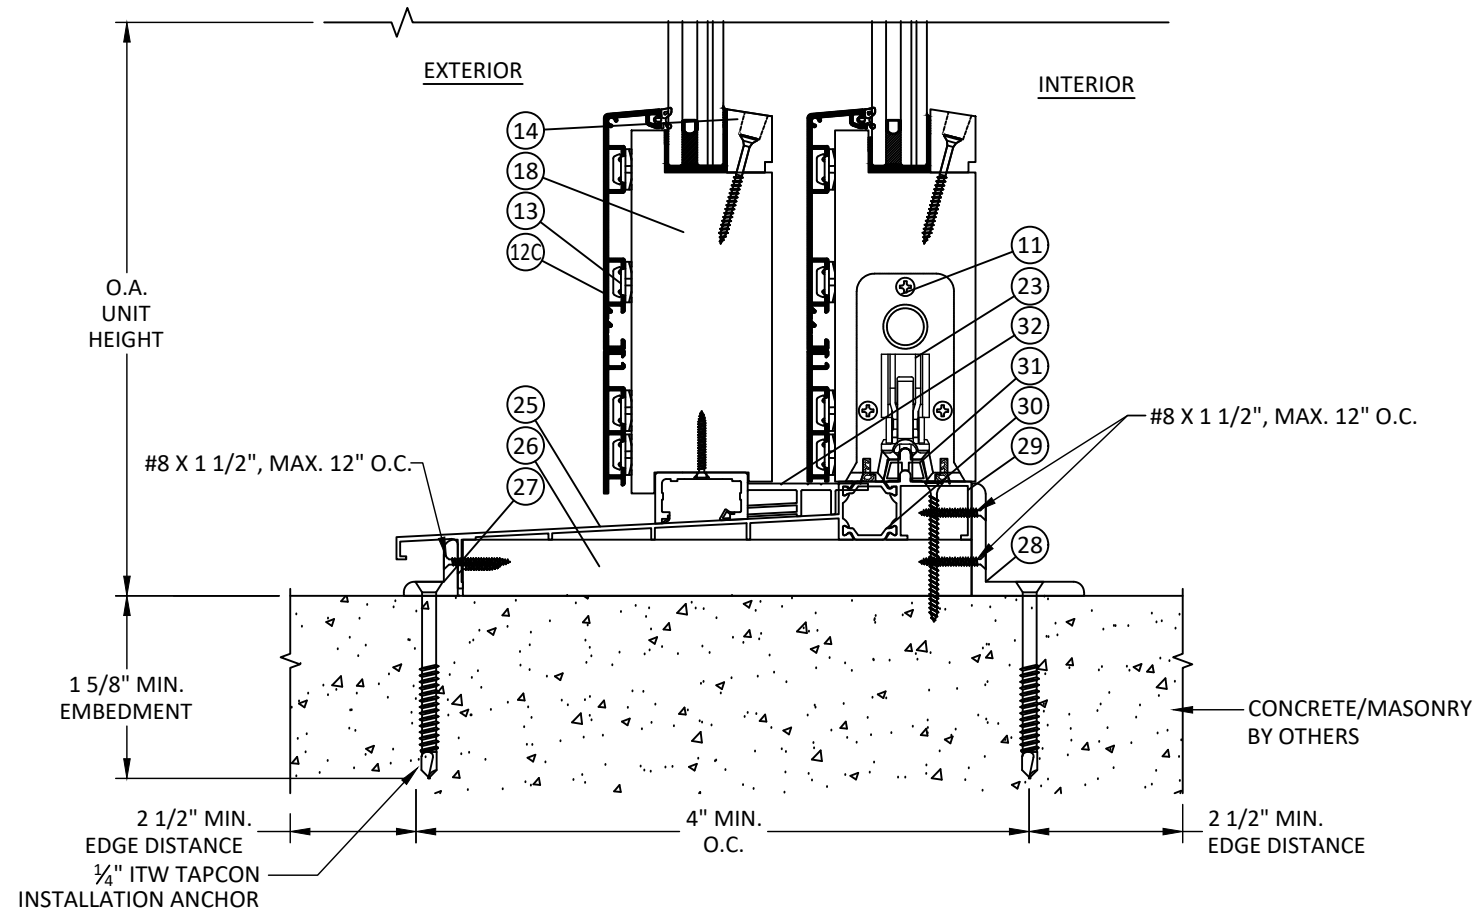

D
5 VERTICAL SECTION
CONCRETE/ MASONRY - RAISED SILL
2 TRACK

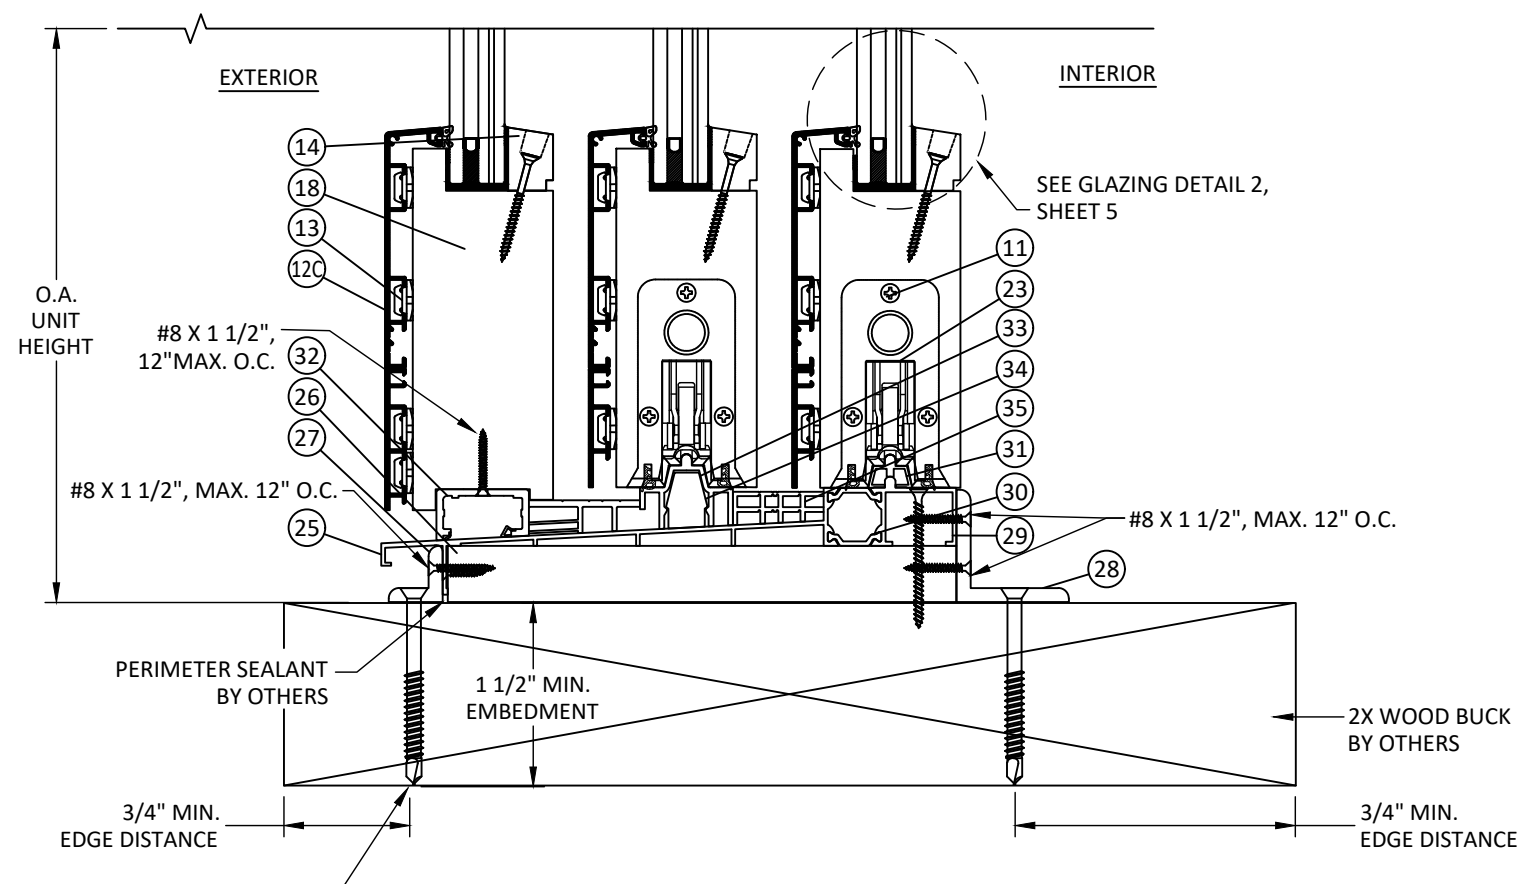

E
5 VERTICAL SECTION
2X WOOD BUCK - RAISED SILL
3 TRACK - OPTIONAL ALUM. CLAD PANEL

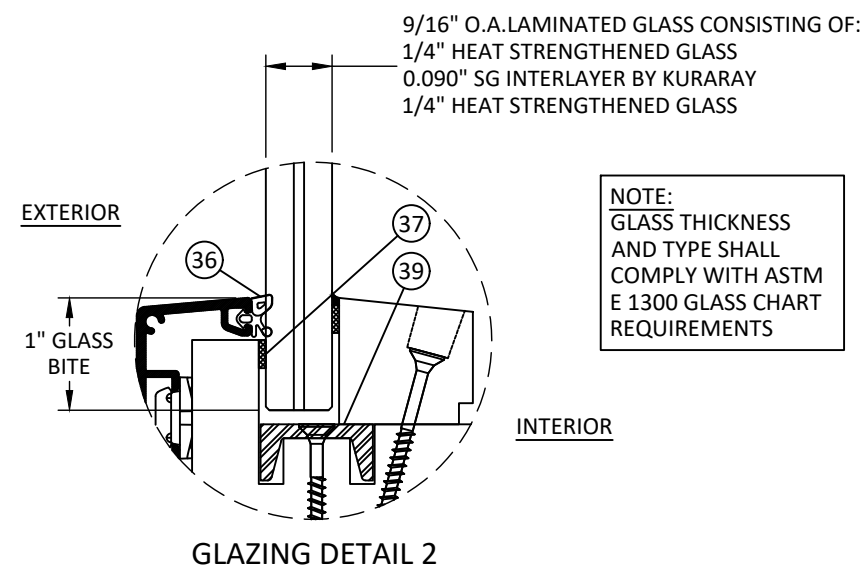

GLAZING DETAIL 2

- NOTE:
1. GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300 (3 SEC. GUSTS) AND CHAPTER 17 OF THE CURRENT FBC FOR SIZES OTHER THAN TESTED.
 2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN CHAPTER 24.
 3. SETING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER CHAPTER 24.
 4. D.L.O. MAY NOT EXCEED MAX DIMENSIONS IN GLASS CHARTS FOR GLASS TYPE.

caoba
DOORS

4918 CEDAR AVENUE
PHILADELPHIA, PA 19143

PH: (215) 525-5048 FX: (215) 747-8908


TITLE: ALUMINUM CLAD LIFT &
SLIDE DOOR
(HVHZ)/(IMPACT)
VERTICAL SECTIONS AND
GLAZING DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

B.D.
BUILDING DROPS


REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE
GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR
A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION
TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN,
A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE
SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

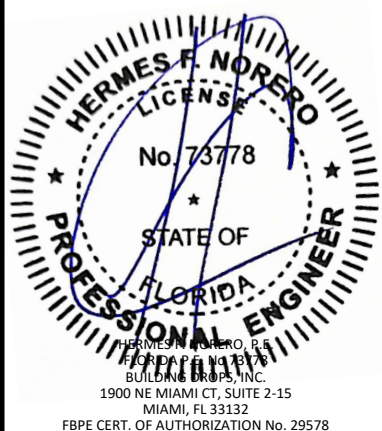


FL #:	FL15927
DATE:	11.02.20
DWG. BY:	RV
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	CAB044
SHEET:	5
REV.	A


c:\users\sebastianh\documents\building drops, inc\building drops landing - common\projects\2026 code change projects\caoba doors\cc-26-0457 2 - 2026 code change - 1711.dwg (115927-6)\aluminum clad lift & slide door fl15927 cab044.dwg 8/17/2026 6:29 PM

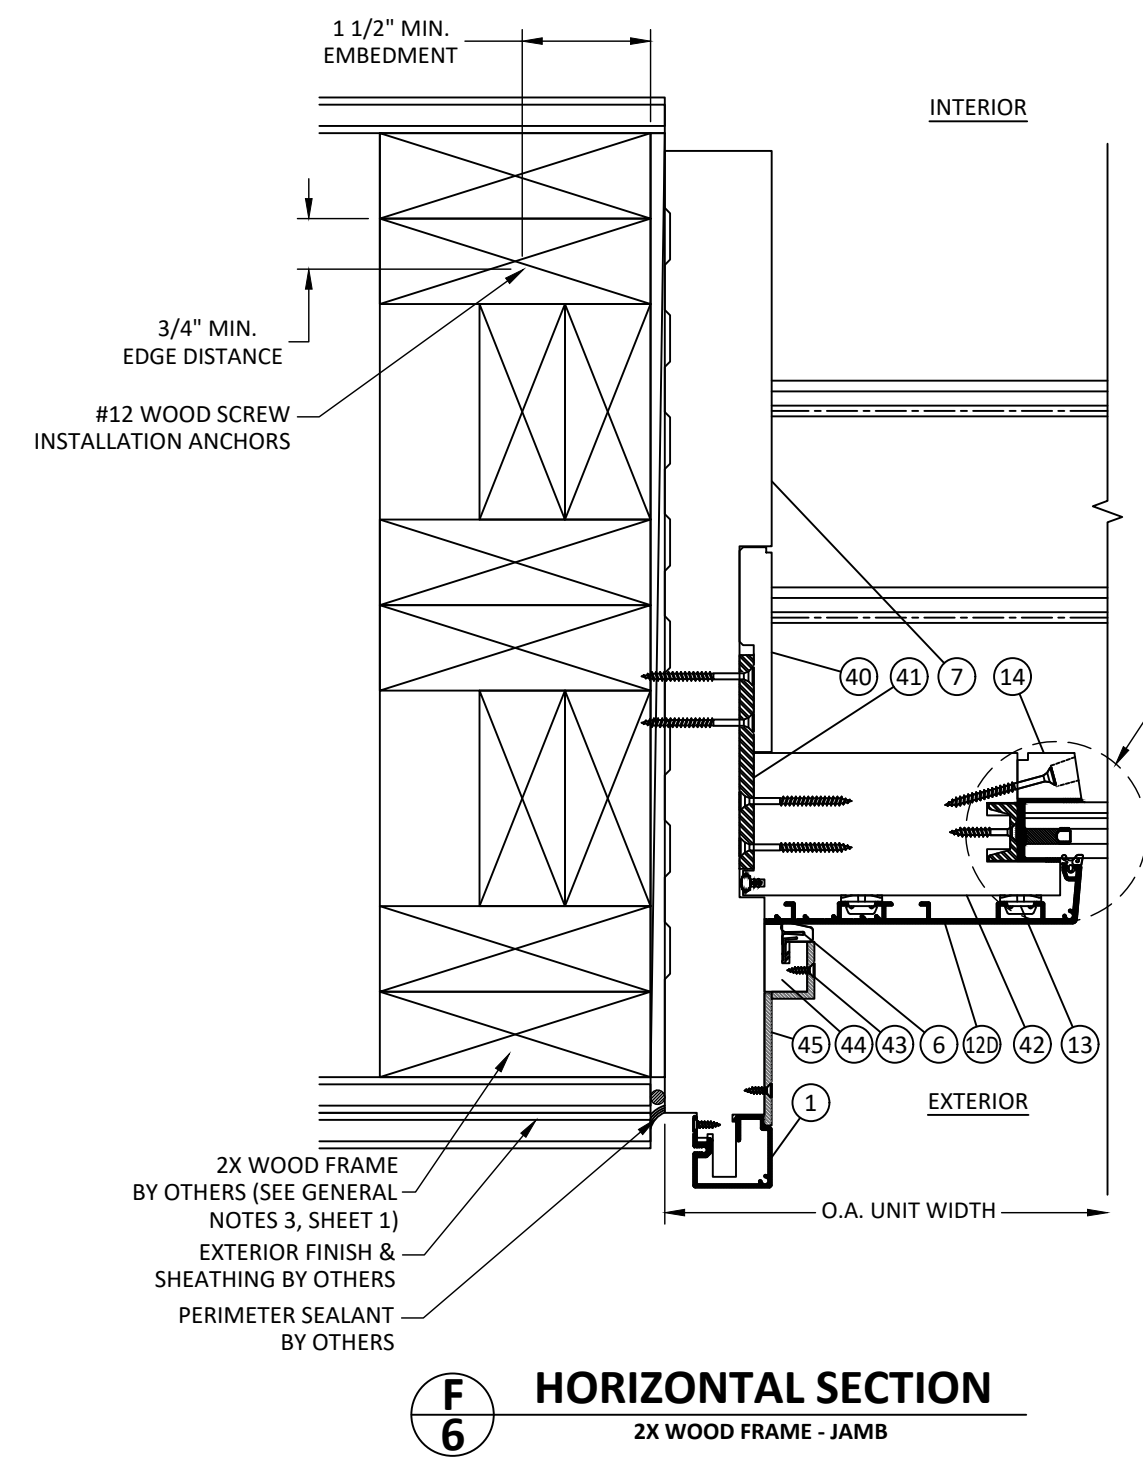


F
6 **HORIZONTAL SECTION**
2X WOOD FRAME - JAMB

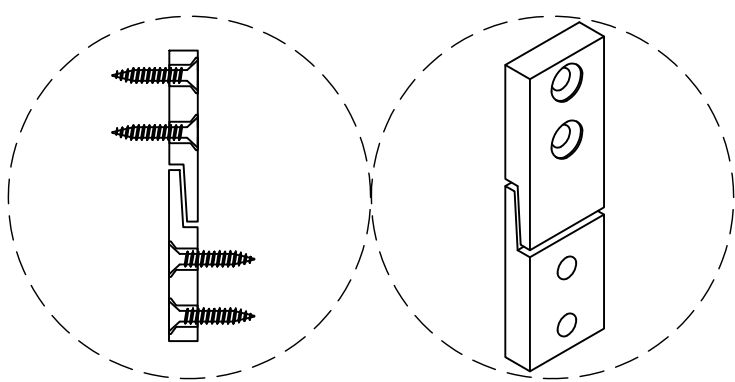


STEEL INTERLOCK REINFORCEMENT DETAILS

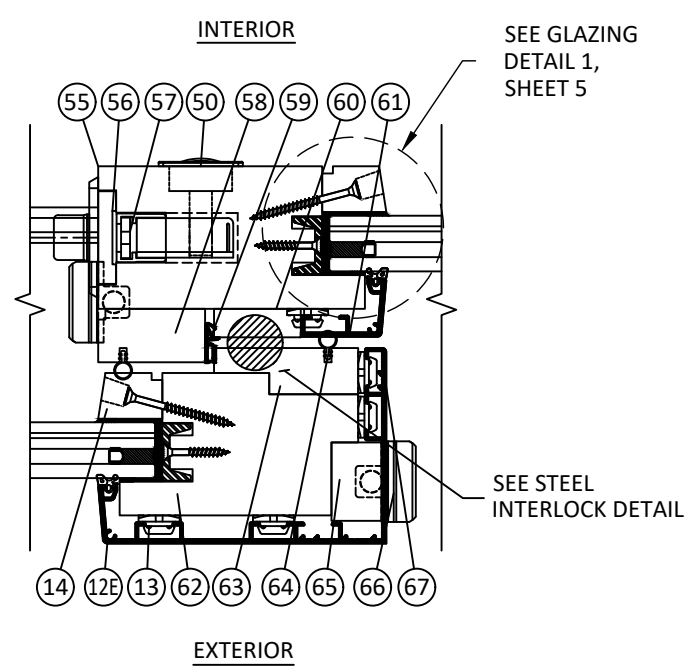

G
6 **HORIZONTAL SECTION**
PANEL INTERLOCK WITH STEEL INTERLOCK

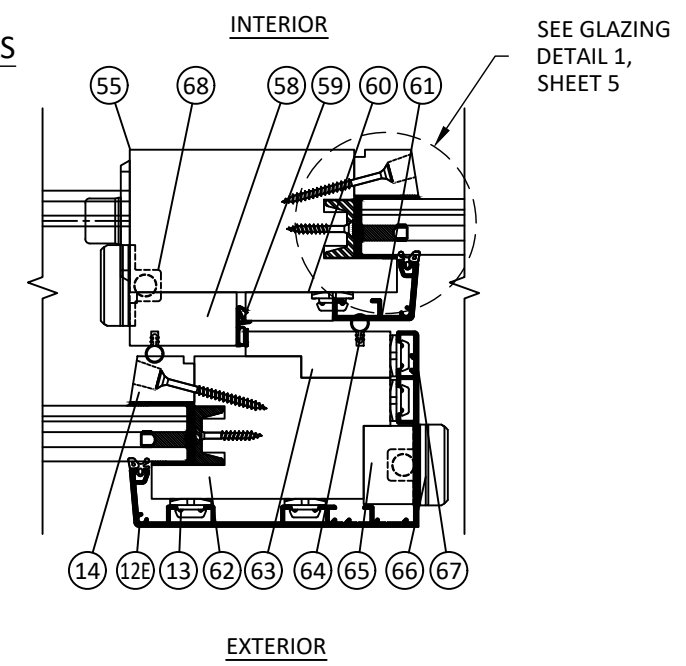

H
6 **HORIZONTAL SECTION**
PANEL INTERLOCK WITH STEEL INTERLOCK

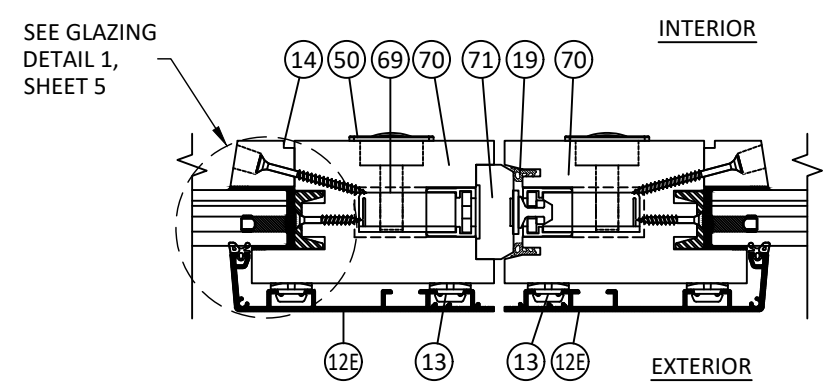

I
6 **HORIZONTAL SECTION**
PANEL BUTT STILE



4918 CEDAR AVENUE
PHILADELPHIA, PA 19143
PH: (215) 525-5048 FX: (215) 747-8908


TITLE: ALUMINUM CLAD LIFT & SLIDE DOOR (HVHZ)(IMPACT)
HORIZONTAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

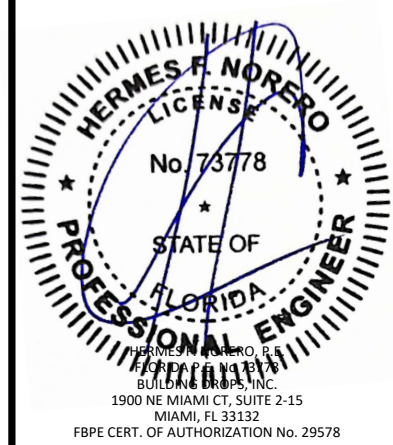


FL #:	FL15927
DATE:	11.02.20
DWG. BY:	RV
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	CAB044
SHEET:	6
REV.	A

c:\users\sebastianherroero\building drops - common\projects\2026 code change projects\caoba doors\cc-26-0457.2 - 2026 code change - 1711\dwgs\fl15927-r6\aluminum clad lift & slide door fl15927 - cab044.dwg 8/17/2026 6:29 PM

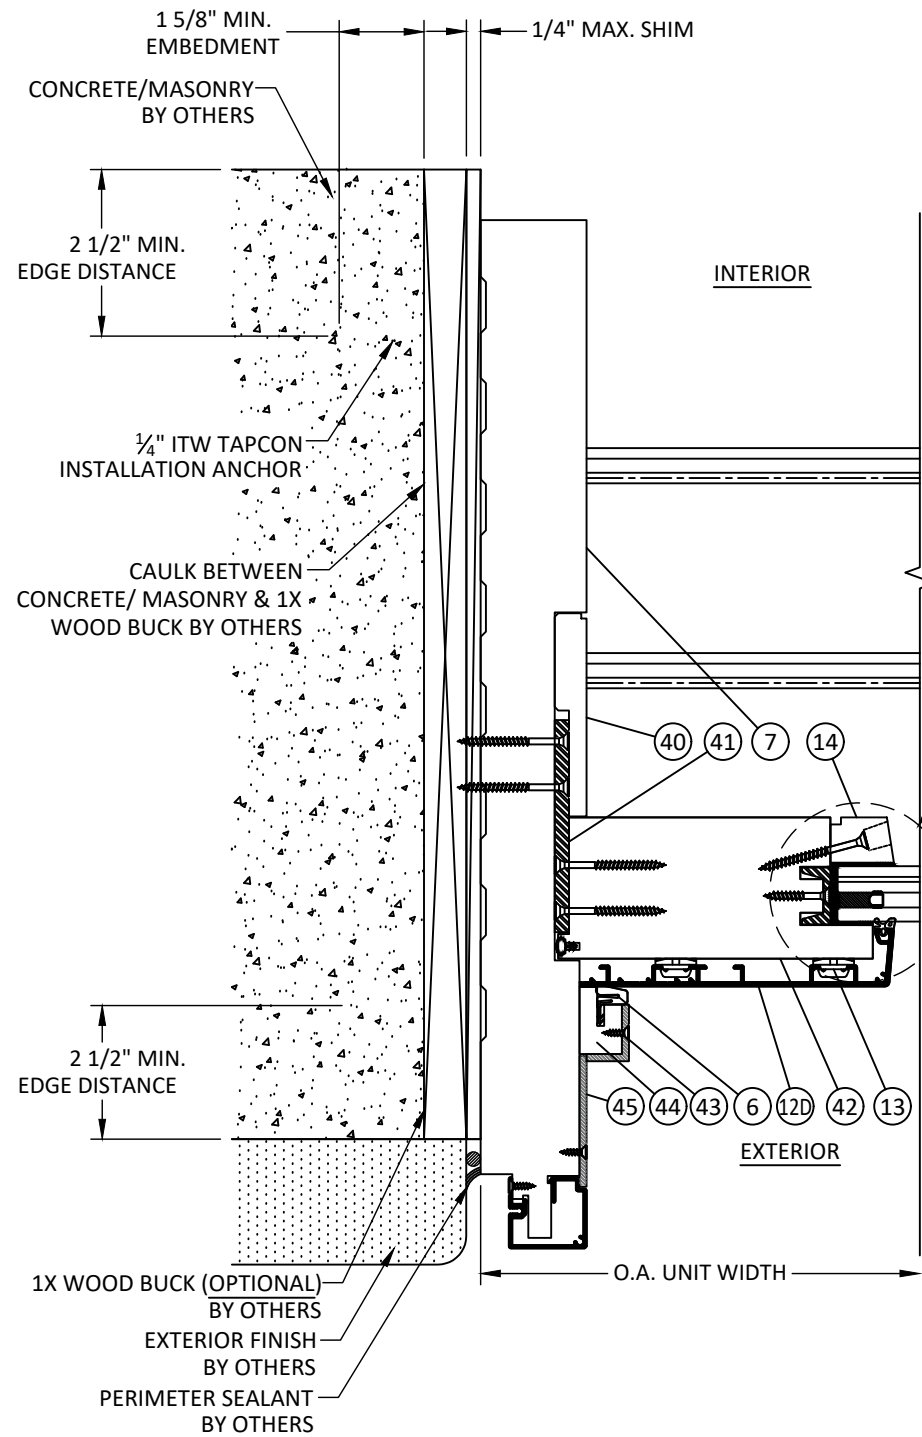

**J
7** **HORIZONTAL SECTION**
CONCRETE/MASONRY - JAMB

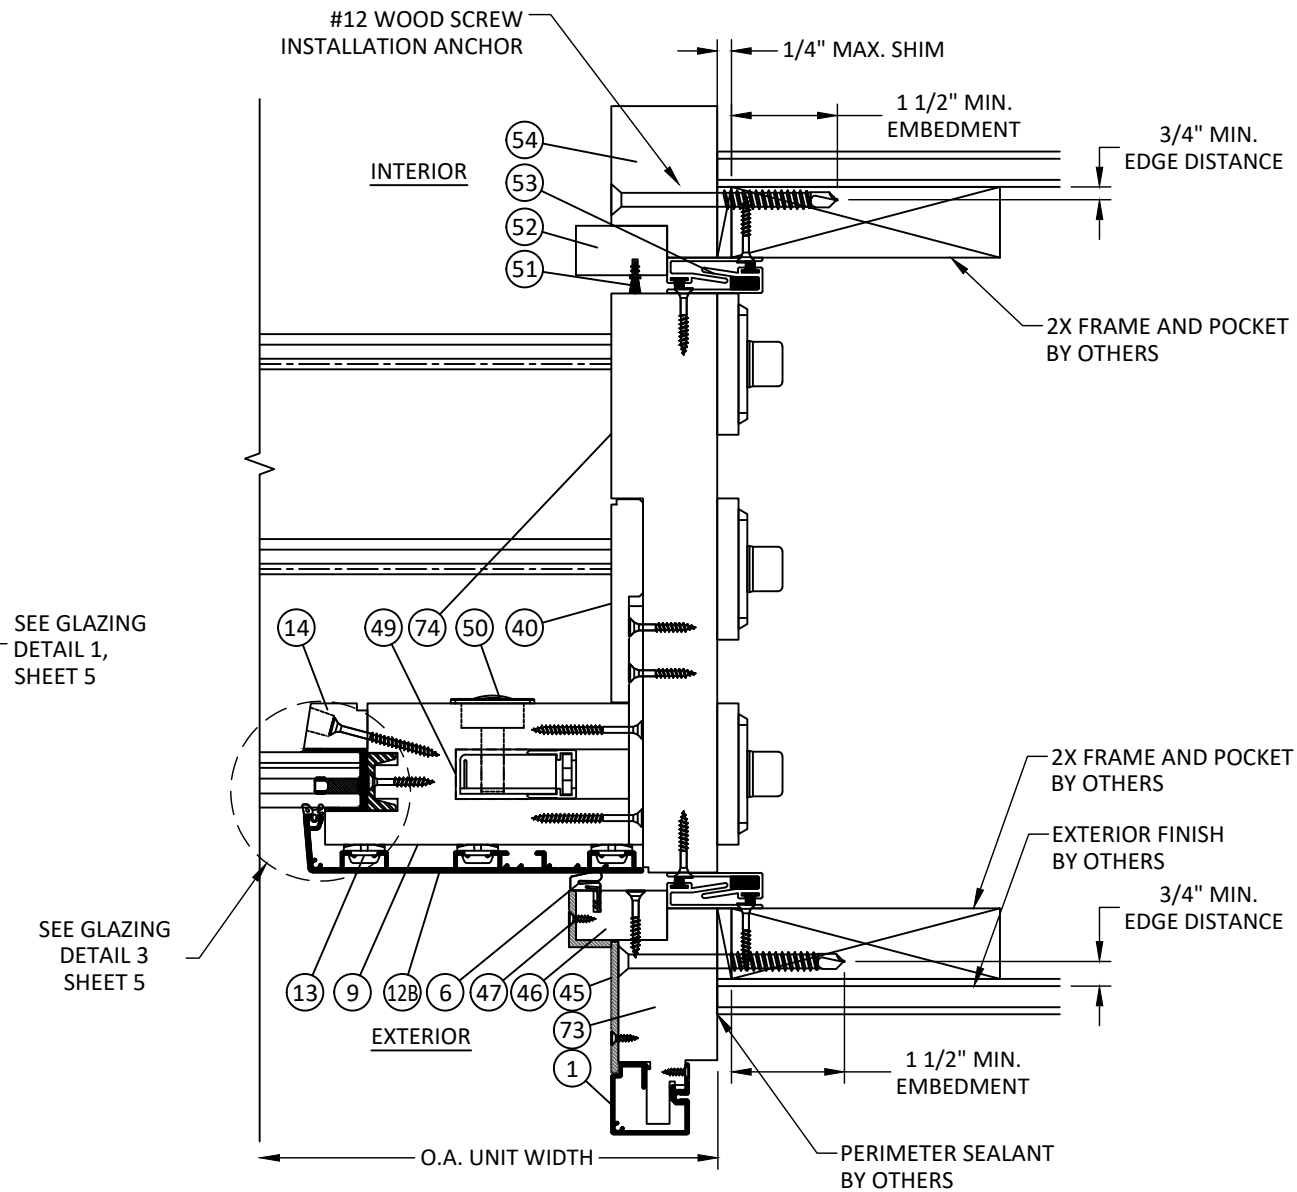

**K
7** **HORIZONTAL SECTION**
2X WOOD FRAME - POCKET JAMB



4918 CEDAR AVENUE
PHILADELPHIA, PA 19143

PH: (215) 525-5048 FX: (215) 747-8908


TITLE: ALUMINUM CLAD LIFT &
SLIDE DOOR
(HVHZ)(IMPACT)
HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 999-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE
GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR
A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION
TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN,
A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE
SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

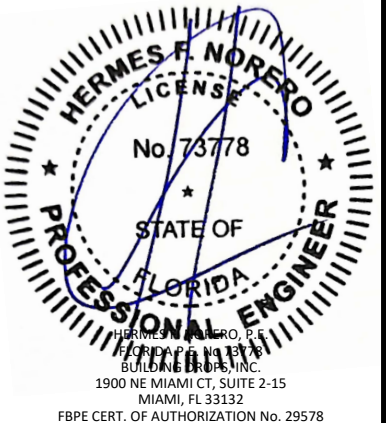

FL #:
FL15927

DATE: **11.02.20**

DWG. BY: **RV** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **CAB044**




SHEET: **7** REV. **A**

c:\users\sebastianh\documents\projects\caoba doors\2026 code change projects\caoba doors\cc-26-0457 2 - 2026 code change - 1711.dwg (15927-6)aluminum clad lift & slide door fin5927 cab044.dwg 8/17/2026 6:29 PM


1 CLADDING



2 SASH STOP

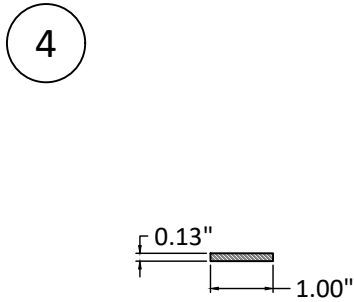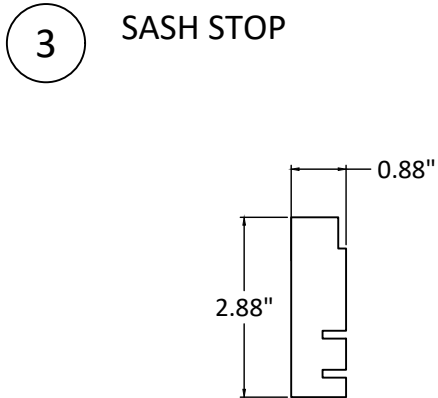


5 SASH STOP




7 FRAME




8 STRUC. ANGLE




9 RETAINER BLOCK




10 TOP TRACK




12A CLADDING

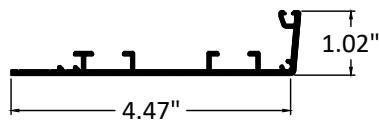


12B CLADDING




12C CLADDING

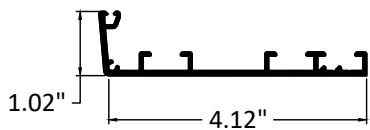


12D CLADDING




12E CLADDING

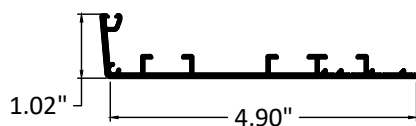


14 MOULDING




15 HEAD TRIM



16 HEAD TRIM

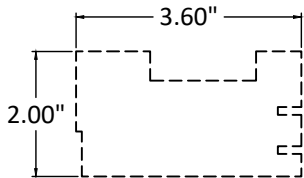

17 TOP RAIL



4918 CEDAR AVENUE
PHILADELPHIA, PA 19143

PH: (215) 525-5048 FX: (215) 747-8908

TITLE: ALUMINUM CLAD LIFT &
SLIDE DOOR
(HVHZ)(IMPACT)
COMPONENTS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE
GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR
A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION
TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN,
A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE
SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

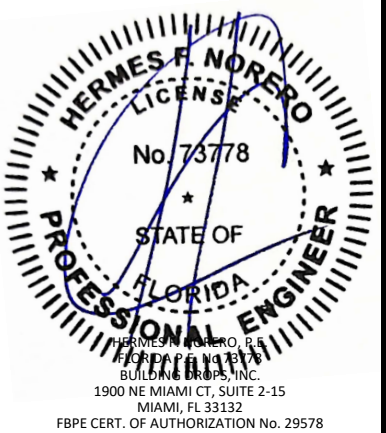


FL #:	FL15927
DATE:	11.02.20
DWG. BY:	CHK. BY:
RV	HFN
SCALE:	NTS
DWG. #:	CAB044
SHEET:	REV.
9	A
OF 13	

c:\users\sebastian\hereros\building drops, inc\building drops landing - common\projects\2026 code change projects\caoba doors\cc-26-0457 2 - 2026 code change - 1711.dwg (115927-6)\aluminum clad lift & slide door fl15927 cab044.dwg 8/17/2026 6:29 PM


18 BOTTOM RAIL

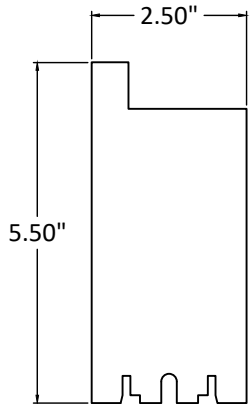


22 FLUSH TRACK




25 SILL

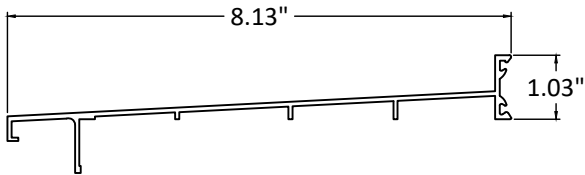


26 SILL BASE

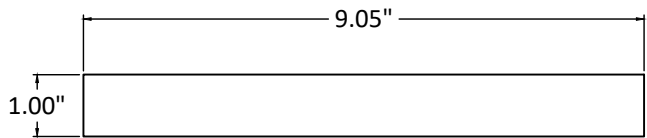


20 STRUC. ANGLE




27 STRUC. ANGLE




31 BOTTOM TRACK




40 SASH STOP

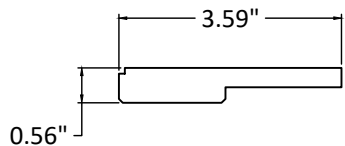


21 STRUC. ANGLE




28 STRUC. ANGLE




33 BOTTOM TRACK




41




24 STRUC. ANGLE




29 SILL



34



42 JAMB STILE

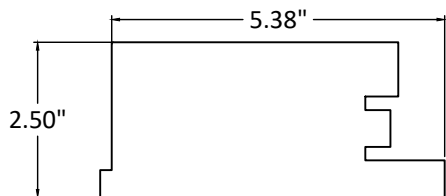

4918 CEDAR AVENUE
PHILADELPHIA, PA 19143

PH: (215) 525-5048 FX: (215) 747-8908

TITLE: ALUMINUM CLAD LIFT &
SLIDE DOOR
(HVHZ)/(IMPACT)


COMPONENTS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE
GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR
A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION
TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN,
A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE
SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

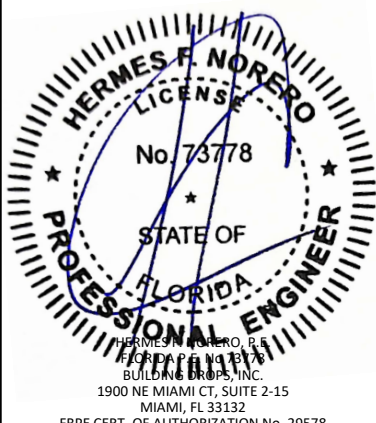


FL #:	FL15927
DATE:	11.02.20
DWG. BY:	CHK. BY:
RV	HFN
SCALE:	NTS
DWG. #:	CAB044
SHEET:	REV.
10	A
OF 13	

c:\users\sebastianherrerros\building drops, inc\building drops landing - common\projects\caoba doors\2026 code change projects\caoba doors\cc-26-04572 - 2026 code change - 1711.dwg (115927-6)\aluminum clad lift & slide door.f115927 cab044.dwg 8/17/2026 6:29 PM


43




47




56




62 JAMB STILE

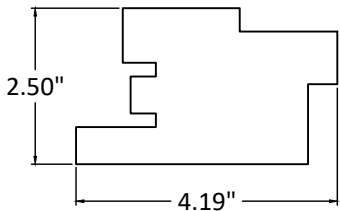


70 JAMB STILE

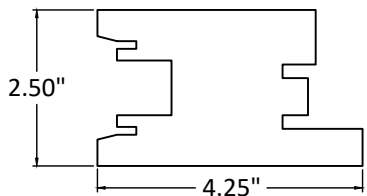


44 SASH STOP




52 JAMB LEG POCKET




58 INTERLOCK




63 INTERLOCK




71 LOCK POINT




45




54 JAMB LEG POCKET




60 INTERLOCK




65 JAMB STILE - A WOOD




72 SASH STOP




46 SASH STOP




55 JAMB STILE

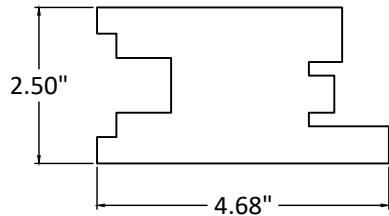


61 CLADDING



67 CLADDING



73 JAMB LEG POCKET

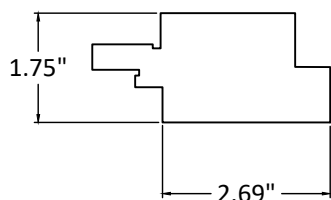

caoba[®]
DOORS

4918 CEDAR AVENUE
PHILADELPHIA, PA 19143

PH: (215) 525-5048 FX: (215) 747-8908


TITLE: ALUMINUM CLAD LIFT &
SLIDE DOOR
(HVHZ)/(IMPACT)
COMPONENTS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

BUILDING DROPS

REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE
GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR
A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION
TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN,
A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE
SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

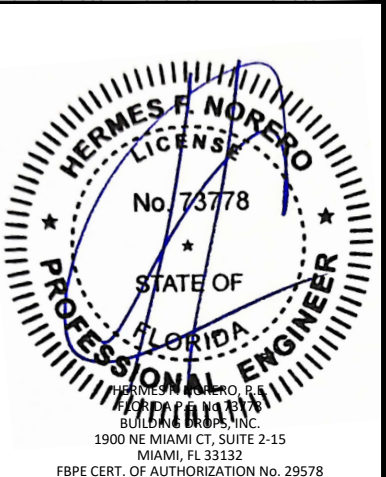


FL #:	FL15927
DATE:	11.02.20
DWG. BY:	CHK. BY:
RV	HFN
SCALE:	NTS
DWG. #:	CAB044
SHEET:	REV.
11	A
OF 13	

c:\users\sebastianherrerros\building drops, inc\building drops landing - common\projects\2026 code change projects\caoba doors\cc-26-0457 2 - 2026 code change - 1711.dwg (115927-6)\aluminum clad lift & slide door f15927 cab044.dwg 8/17/2026 6:29 PM

BILL OF MATERIALS				
ITEM#	PART#	ITEM DESCRIPTION	MANUFACTURER	MATERIAL
1	JDE001	FRAME CLADDING	EXTRALUM	ALUMINUM
2		FRAME CLADDING EXTENSION	METALS DEPOT	ALUMINUM
3		SASH STOP	CAOBA DOORS	WOOD
4		SASH TOP COVER	METALS DEPOT	ALUMINUM
5		SASH TOP	CAOBA DOORS	WOOD
6	12610.0000	WEATHERSTRIP	AMESBURY	FOAM
7		HEAD JAMB AND JAMB LEG	CAOBA DOORS	WOOD
8		TRACK REINFORCEMENT	METALS DEPOT	ALUMINUM
9		RATAINER BLOCK	CAOBA DOORS	WOOD
10	126844PC1	TOP GUIDE	SIEGENIA	ALUMINUM
11		COVER PLATE	SIEGENIA	TPU
12A	SIM001	TOP RAIL CLADDING	EXTRALUM	ALUMINUM
12B	SIM001	POCKET SILE CLADDING	EXTRALUM	ALUMINUM
12C	SIM001	BOTTOM RAIL CLADDING	EXTRALUM	ALUMINUM
12D	SIM001	JAMB STILE CLADDING	EXTRALUM	ALUMINUM
12E	SIM001	STILE CLADDING	EXTRALUM	ALUMINUM
13	LC50/3	CLADDING CLIPS	CAOBA DOORS	TPU
14		MOULDING	CAOBA DOORS	WOOD
15		TOP COVER CLADDING	METALS DEPOT	ALUMINUM
16		HEAD TRIM COVER	CAOBA DOORS	WOOD
17		TOP RAIL	CAOBA DOORS	WOOD
18		BOTTOM RAIL	CAOBA DOORS	WOOD
19	HH0134-02	WEATHERSEAL	SIEGENIA	RUBBER
20		FDT ANGLE	UPPE	ALUMINUM
21		FDT ANGLE	UPPE	ALUMINUM
22		FDT BASE	UPPE	ALUMINUM
23		LIFT & SLIDING ROLLER	SIEGENIA	SST
24		FDT ANGLE	UPPE	ALUMINUM
25		EXTERIOR SILL COMPONENT	SIEGENIA	ALUMINUM
26		SILL BASE	CAOBA DOORS	WOOD
27		STRUCTURAL ANGLE	METALS DEPOT	ALUMINUM
28		STRUCTURAL ANGLE	METALS DEPOT	ALUMINUM
29		INTERIOR SILL COMPONENT	SIEGENIA	ALUMINUM
30		SILL THERMAL BRAKE	SIEGENIA	
31	126257PC1	BACK DOOR RUNNING RAIL	SIEGENIA	ALUMINUM
32	PPZB0090-023010	SUPPORT RAIL	SIEGENIA	
33		SECONDARY DOOR RUNNING RAIL	SIEGENIA	ALUMINUM
34		SECONDARY DOOR RUNNING RAIL	SIEGENIA	
35	PBZB0030-0E6010	INSULATION	SIEGENIA	RUBBER
36	K2031	CLAD WEATHERSEAL	TRELLEBORG	TSP-FOAM
37	AWT3	1/4" X 1/16" GLAZING TAPE	ARLON	TAPE
38	795.0000	DOW CORNING SEALANT	DOWSIL	SILICONE
39		STILE REINFORCEMENT	METALS DEPOT	STEEL
40		BRACKET CAP	CAOBA DOORS	WOOD
41		FIXED DOOR BRACKET	METALS DEPOT	ALUMINUM
42		JAMB STILE	CAOBA DOORS	WOOD
43		SASH STOP CLADDING	METALS DEPOT	ALUMINUM
44		SASH STOP	CAOBA DOORS	WOOD
45		JAMB LEG EXTENSION CLADDING	METALS DEPOT	ALUMINUM
46		POCKET JAMB STOP	CAOBA DOORS	WOOD
47		POCKET JAMB STOP CLADDING	METALS DEPOT	ALUMINUM
49		POCKET LIFT & SLIDING GEAR	SIEGENIA	SST
50		FLAT HANDLE	SIEGENIA	
51	KP51	PILE WEATHERSTRIP	AMESBURY	PILE
52		INTERIOR POCKET JAMB STOP	CAOBA DOORS	WOOD
53	DW-INT	INTERLOCK	DW	BLACK
54		INTERIOR POCKET JAMB LEG	CAOBA DOORS	WOOD
55		DOOR STILE	CAOBA DOORS	WOOD
56		GEAR STILE COVER	CAOBA DOORS	WOOD
57		LIFT & SLIDING GEAR	SIEGENIA	SST
58		INTERLOCK	CAOBA DOORS	WOOD
59		INTERLOCK WEATHERSEAL	DEVENTER	RUBBER
60		INTERLOCK	CAOBA DOORS	WOOD
61		INTERLOCK STILE CLADDING	EXTRALUM	ALUMINUM
62		INTERLOCK STILE	CAOBA DOORS	WOOD
63		INTERLOCK	CAOBA DOORS	WOOD
64		BULB WEATHERSTRIP	CONSERVATION	RUBBER
65		DROP BOLT SUPPORT	CAOBA DOORS	WOOD
66		DROP BOLT	CENTOR	SST
67		EDGE STILE CLADDING	EXTRALUM	ALUMINUM
69		INACTIVE INTERLOCK	SIEGENIA	SST
70		ACTIVE & INACTIVE DOOR STILE	CAOBA DOORS	WOOD
71		LOCK POINT COVER	CAOBA DOORS	WOOD
72		INTERIOR TOP SAHS STOP	CAOBA DOORS	WOOD
73		EXTERIOR JAMB LEG	CAOBA DOORS	WOOD
74		POCKET COVER	CAOBA DOORS	WOOD
75		FIXED DOOR BOTTOM RAIL	CAOBA DOORS	WOOD
76		BOTTOM RAIL CLADDING EXTENSION	EXTRALUM	ALUMINUM


74

POCKET COVER

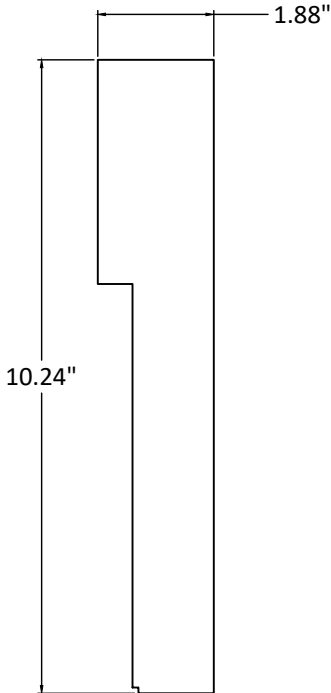


75

BOTTOM RAIL

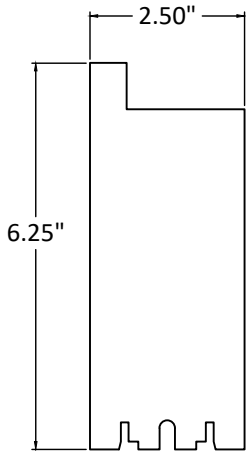

76

CLADDING



4918 CEDAR AVENUE
PHILADELPHIA, PA 19143

PH: (215) 525-5048 FX: (215) 747-8908

TITLE: ALUMINUM CLAD LIFT &
SLIDE DOOR
(HVHZ)(IMPACT)
COMPONENTS & B.O.M

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132

PH: (954) 399-8478
FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE
GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR
A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION
TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN,
A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE
SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	
FL15927	
DATE: 11.02.20	
DWG. BY: RV	CHK. BY: HFN
SCALE: NTS	
DWG. #: CAB044	
SHEET:	REV. A
12 OF 13	

